



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Gerard Roofing Technologies  
955 Colombia Street  
Brea, CA. 92821**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Gerard Granite / Diplomat Plus Ridge Metal Shingle**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This renews NOA #07-0521.07 and consists of pages 1 through 4.  
The submitted documentation was reviewed by Alex Tigera.



**NOA #: 08-0320.08  
Expiration Date: 09/11/13  
Approval Date: 05/15/08  
Page 1 of 4**

## ROOFING SYSTEM APPROVAL:

Category: Roofing  
Sub-Category: Metal, Panels (Non-Structural)  
Material: Steel  
  
Deck Type: Wood  
Maximum Design Pressure -129.25 psf

## TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Granite Ridge / Diplomat Plus	Length 46 1/16 “ Width 15 5/8 “ Thickness min. 0.017	TAS 125	Stone Coated Metal Panel Shingle

## EVIDENCE SUBMITTED:

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Underwriters Laboratories Inc	02NK14679	UL 1897	11/14/02
Underwriters Laboratories Inc	02NK28696	UL 580	06/16/02
Underwriters Laboratories Inc	02NK43282	UL 790	05/11/01
PRI Asphalt Technologies	GRT001-02-01	TAS 100	01/19/01
Hurricane Test Laboratory	0102-0603-05	TAS 125	06/07/05
PRI Construction Materials Tech.	MUSA-012-02-04	ASTM G 26	10/08/07
PRI Construction Materials Tech.	MUSA-012-02-014	ASTM B 117	12/26/07

## SYSTEM LIMITATIONS

1. The maximum designed pressure listed herein shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners).
2. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved."
3. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 9B-72 of the Florida Administrative Code.
4. Fire classification is not part of this acceptance; refer to current Approved Roofing Materials Directory for fire ratings of this product.



NOA #: 08-0320.08  
Expiration Date: 09/11/13  
Approval Date: 05/15/08  
Page 2 of 4

## APPROVED SYSTEMS

<b>SYSTEM:</b>	Granite Ridge / Diplomat Plus
<b>Deck Type:</b>	Wood, Non-insulated
<b>Deck Description:</b>	New Construction or Re-roof <sup>19</sup> / <sub>32</sub> " or greater plywood or wood plank
<b>Slope Range:</b>	2:12 or greater
<b>Maximum Uplift Pressure:</b>	The maximum allowable uplift pressure shall be <b>-129.25psf.</b>

---

**Deck Attachment:** In accordance with applicable Building Code, but in no case shall it be less than #8 x 2-<sup>1</sup>/<sub>2</sub>" wood screws spaced 6" o.c. In reroofing, where the deck is less than <sup>19</sup>/<sub>32</sub>" thick (Minimum <sup>15</sup>/<sub>32</sub>" ) the above attachment method must be in addition to existing attachment.

**Fire Barrier:** When required (by code), any approved fire barrier having a current NOA. For a class A or B fire rating, install minimum <sup>1</sup>/<sub>4</sub>" thick Georgia Pacific "Dens Deck" (with current NOA) or minimum 4mm thick of Tritex, RockRoof (with current NOA) or <sup>5</sup>/<sub>8</sub>" water resistant type X gypsum sheathing with treated core and facer. For use with Elk Versashield or any other fire barrier, refer to a current Approved Roofing Materials Directory for fire ratings of this product.

**Underlayment:** Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 12 gauge 1 <sup>1</sup>/<sub>4</sub>" annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any approved underlayment having a current NOA.


**Valleys:** Valley construction shall be in compliance with the minimum requirements provided in Roofing Application Standard RAS 133.

**Metal Panels and Accessories:** Install the " Granite Ridge / Diplomat Plus " and accessories in compliance with Gerard Roofing Technologies' current, published installation instructions and details. Flashings, penetrations, valley construction and other details shall be constructed in compliance with the minimum requirements provided in Roofing Application Standard RAS 133.


Panels shall be fastened with corrosion resistant #8 pan head screw of sufficient length (but not less than 1") to penetrate through the sheathing a minimum of <sup>3</sup>/<sub>16</sub>", at a spacing not exceed 6" o.c. For a minimum of seven screws for each full panel length. (See detail drawings herein)



**DETAIL DRAWING:**

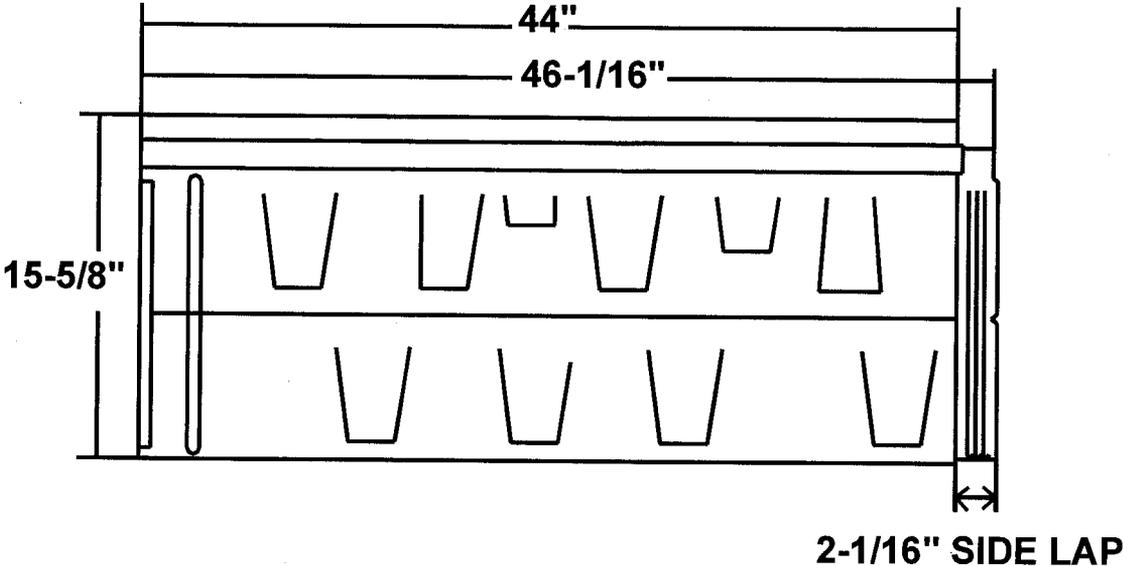

**SHINGLE NAILING PATTERN SEVEN NAILS PER PANEL**

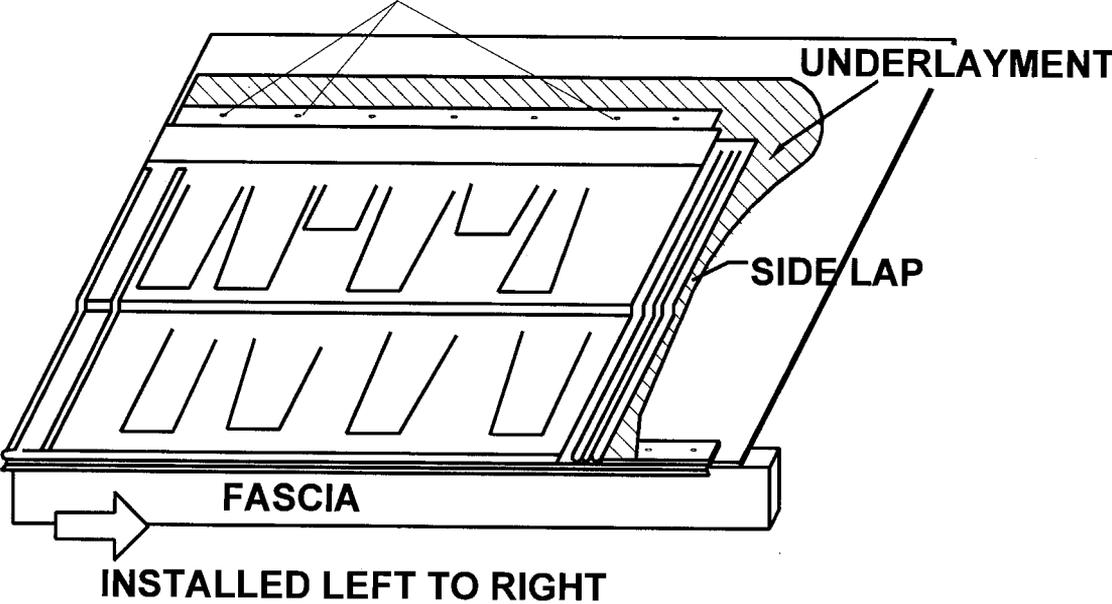

**END OF THIS ACCEPTANCE**



NOA #: 08-0320.08  
Expiration Date: 09/11/13  
Approval Date: 05/15/08  
Page 4 of 4