



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339**

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

**Kolbe & Kolbe Millwork Co.
1211 Depot Street
Manawa, WI 54949**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "V707 DH" Tilt White PVC Double Hung Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **FL 00335**, titled "V707DH Tilt White PVC Double Hung Window", sheets 1 thru 4 of 4, dated 12/09/07 with revision A dated 9/16/08, prepared by manufacturer, signed and sealed by Luis R. Lomas, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1 as well as approval document mentioned above. The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 08-0324.20
Expiration Date: October 30, 2013
Approval Date: October 30, 2008
Page 1**

Kolbe & Kolbe Millwork Co.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **FL 00335**, Sheets 1 thru 4 of 4, titled "Series V707DH Tilt White PVC Double Hung Window", dated 12/09/07 with revision A dated 9/16/08, prepared by manufacturer, signed and sealed by Luis R. Lomas, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of a series V707DH Tilt White PVC Double Hung Window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-110-10633-3**, dated 09/12/06, signed and sealed by Harold E. Rupp, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, dated 11/26/07, prepared, signed and sealed by Luis R. Lomas, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **05-1208.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite PVB, Interlayer**" dated January 05, 2006, expiring on December 11, 2010.
2. Notice of Acceptance No. **07-0517.07** issued to Thermoplast, Inc. for their "**White Rigid PVC Exterior Profile Extrusions for Windows and Doors**" dated 07/05/07, expiring on 07/05/12.

F. STATEMENTS


1. Statement letter of conformance and of no financial interest, dated December 15, 2007, signed and sealed by Luis R. Lomas, P.E.

G. OTHER

1. None.

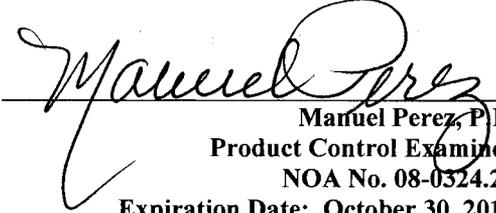
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-0324.20
Expiration Date: October 30, 2013
Approval Date: October 30, 2008

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATED PER M.D. COMMENTS	9/16/08	R.L.

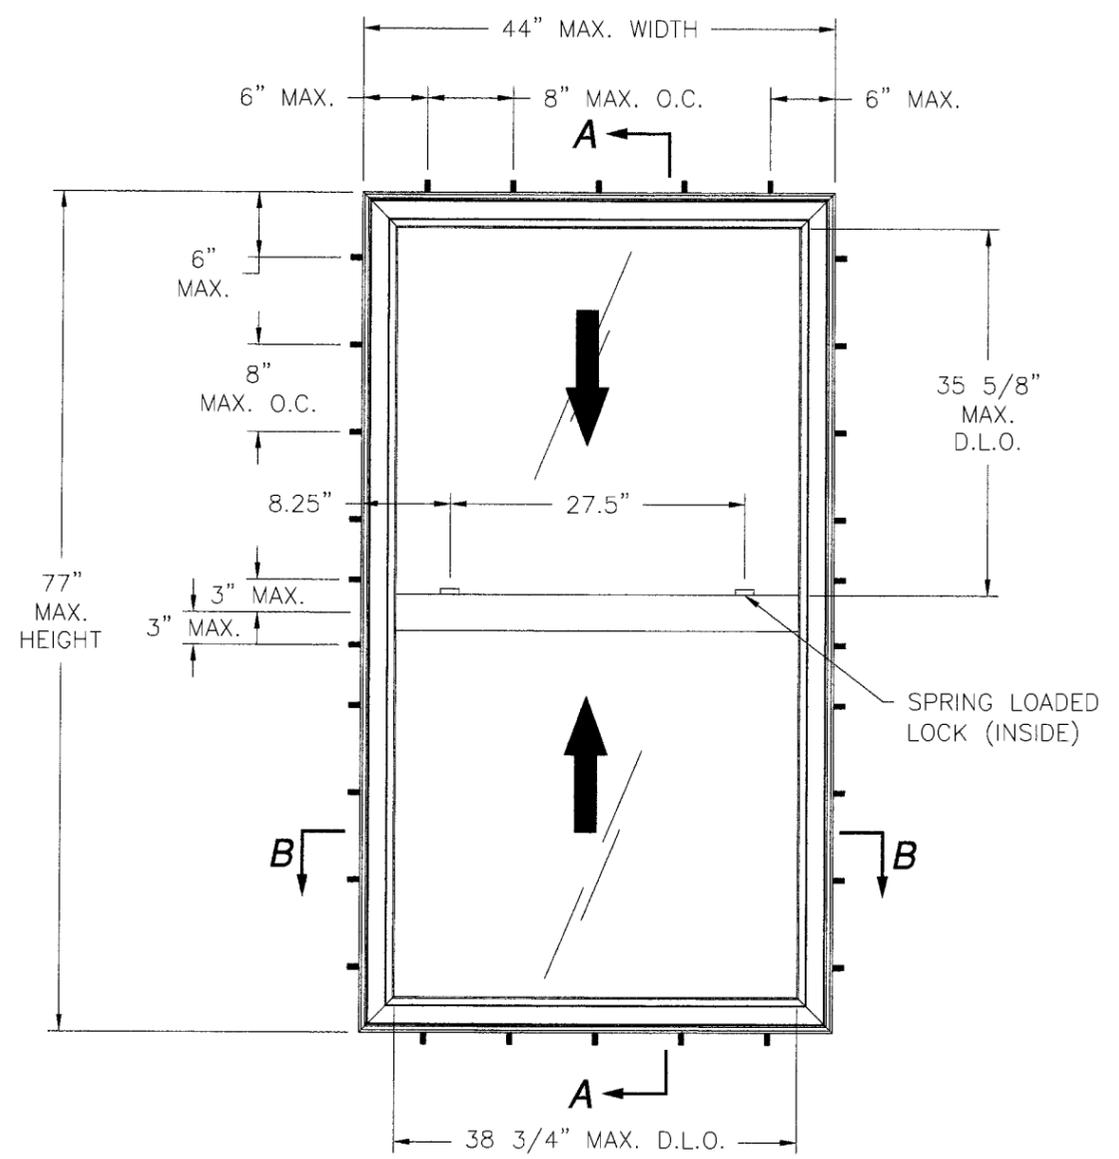

V707DH
X/X CONFIGURATION
UP TO 44" X 77"
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
± 60.0 PSF	LARGE AND SMALL MISSILE IMPACT

NOTES:


- 1) THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ
- 2) WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3) CONTRACTOR IS RESPONSIBLE FOR MAINTAINING STRUCTURAL INTEGRITY OF WINDOW OPENING AND ALL WOOD FRAMING AROUND WINDOW.
- 4) UNITS MUST BE GLAZED WITH 7/8" IGU CONSISTING OF: 1/8" ANNEALED INTERIOR PANEL - AIR - LAMINATED EXTERIOR PANEL CONSISTING OF 1/8" ANN - .090 DUPONT BUTACITE PVB - 1/8" ANN PER ASTM E1300.
- 5) APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN AREAS WHERE WIND BORNE DEBRIS PROTECTION IS REQUIRED.
- 6) SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 7) FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREW WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 8) FOR ANCHORING INTO MASONRY USE 3/16" ITW TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 5/8" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 9) ALL FASTENERS TO BE CORROSION RESISTANT.
- 10) INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 A. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42
 B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3,200 PSI.
 C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
- 11) ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 12) FRAME AND SASH MATERIAL: PVC
- 13) WHITE PVC TO BE LABELED WITH AAMA CERTIFICATION LABEL, EXTRUDER NAME, CODE CITY AND "MDCA".

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	ELEVATION AND GENERAL NOTES
2	CROSS SECTIONS AND B.O.M.
3	INSTALLATION DETAILS
4	COMPONENTS

Approved as complying with the Florida Building Code Date: <u>Oct. 30, 2008</u> NOA# <u>08-0324-20</u> Miami Dade Product Control Division By: <u>Manuel Perez</u>	KOLBE & KOLBE MILLWORK 1211 DEPOT ST MANAWA, WI 54949		 9/15/08. Luis R. Lomas P.E. Florida No. 62514
	V707DH TILT WHITE PVC DOUBLE HUNG WINDOW ELEVATIONS AND NOTES		
DRAWN: R.L.	DWG NO. FL 00335	REV A	SCALE NTS DATE 12/09/07 SHEET 1 OF 4

PARTS LIST				
NO.	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	4005	SILL FRAME	THERMOPLAST INC	WHITE PVC
2	4006	JAMB FRAME	THERMOPLAST INC	WHITE PVC
3	4012	EXTERIOR SILL	THERMOPLAST INC	WHITE PVC
4	4080A	OUTSIDE SASH INTERLOCK	THERMOPLAST INC	WHITE PVC
6	4027A	SASH FRAME	THERMOPLAST INC	WHITE PVC
6	4011	HEAD	THERMOPLAST INC	WHITE PVC
7	4219	SILL ADAPTER	THERMOPLAST INC	WHITE PVC
8	4022	7/8" GLAZING BEAD	THERMOPLAST INC	WHITE PVC
9	4030	SCREEN SPACER		
10	4010	SASH STOP	THERMOPLAST INC	WHITE PVC
11	4013	7/8" GLAZING BEAD	THERMOPLAST INC	WHITE PVC
12	LDB-100109T	WHEATHERSTRIP	SCHLEGEL	
13	HF-7320-187	WHEATHERSTRIP	SCHLEGEL	
14	PB-8830-187	WHEATHERSTRIP	SCHLEGEL	
15	0901012345	BALANCE	FERCO	
16	090151	BALANCE SUPPORT	FERCO	
17	090155	TILT SHOE	FERCO	
18	M090161	PIVOT	FERCO	
19	808-0018	TILT LATCH		
20	97-03-00-00	VALVE	GEARMOLD	
21	SL047500	LOCK	ROTO	
22	SL047550	KEEPER	ROTO	
23		7/16" SCREEN FRAME		
24		BALANCE SCREWS PH #8 X 1"		
25		BALANCE SCREWS PH #8 X 1 1/2"		
26		LOCK SCREWS FH #6 X 1"		
27		KEEPER SCREWS FH #6 X 1 1/2"		
28		SETTING BLOCK 7/8" X 1" X 1/8"		80 DUROMETER
29		SCREEN SPRING		
30		PIVOT SCREWS FH #8 X 1/2"		
31	4084A	INSIDE SASH INTERLOCK	THERMOPLAST	WHITE PVC
32	995	STRUCTURAL SEALANT	DOW CORNING	
33		RECEPTABLE SCREWS FH #10 X 2"		
34		TILT LATCH SCREWS FH #8 X 1"		
35	A110-02M095	SASH REINFORCEMENT		ALUMINUM 6063-T5
36		REINFORCEMENT SCREWS #8 X 1/2"		SST.
37	A111-02M096	MEETING RAIL REINFORCEMENT		ALUMINUM 6063-T5
38	4560	INSTALLATION STRIP		STEEL G60

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATED PER M.D. COMMENTS	9/16/08	R.L.


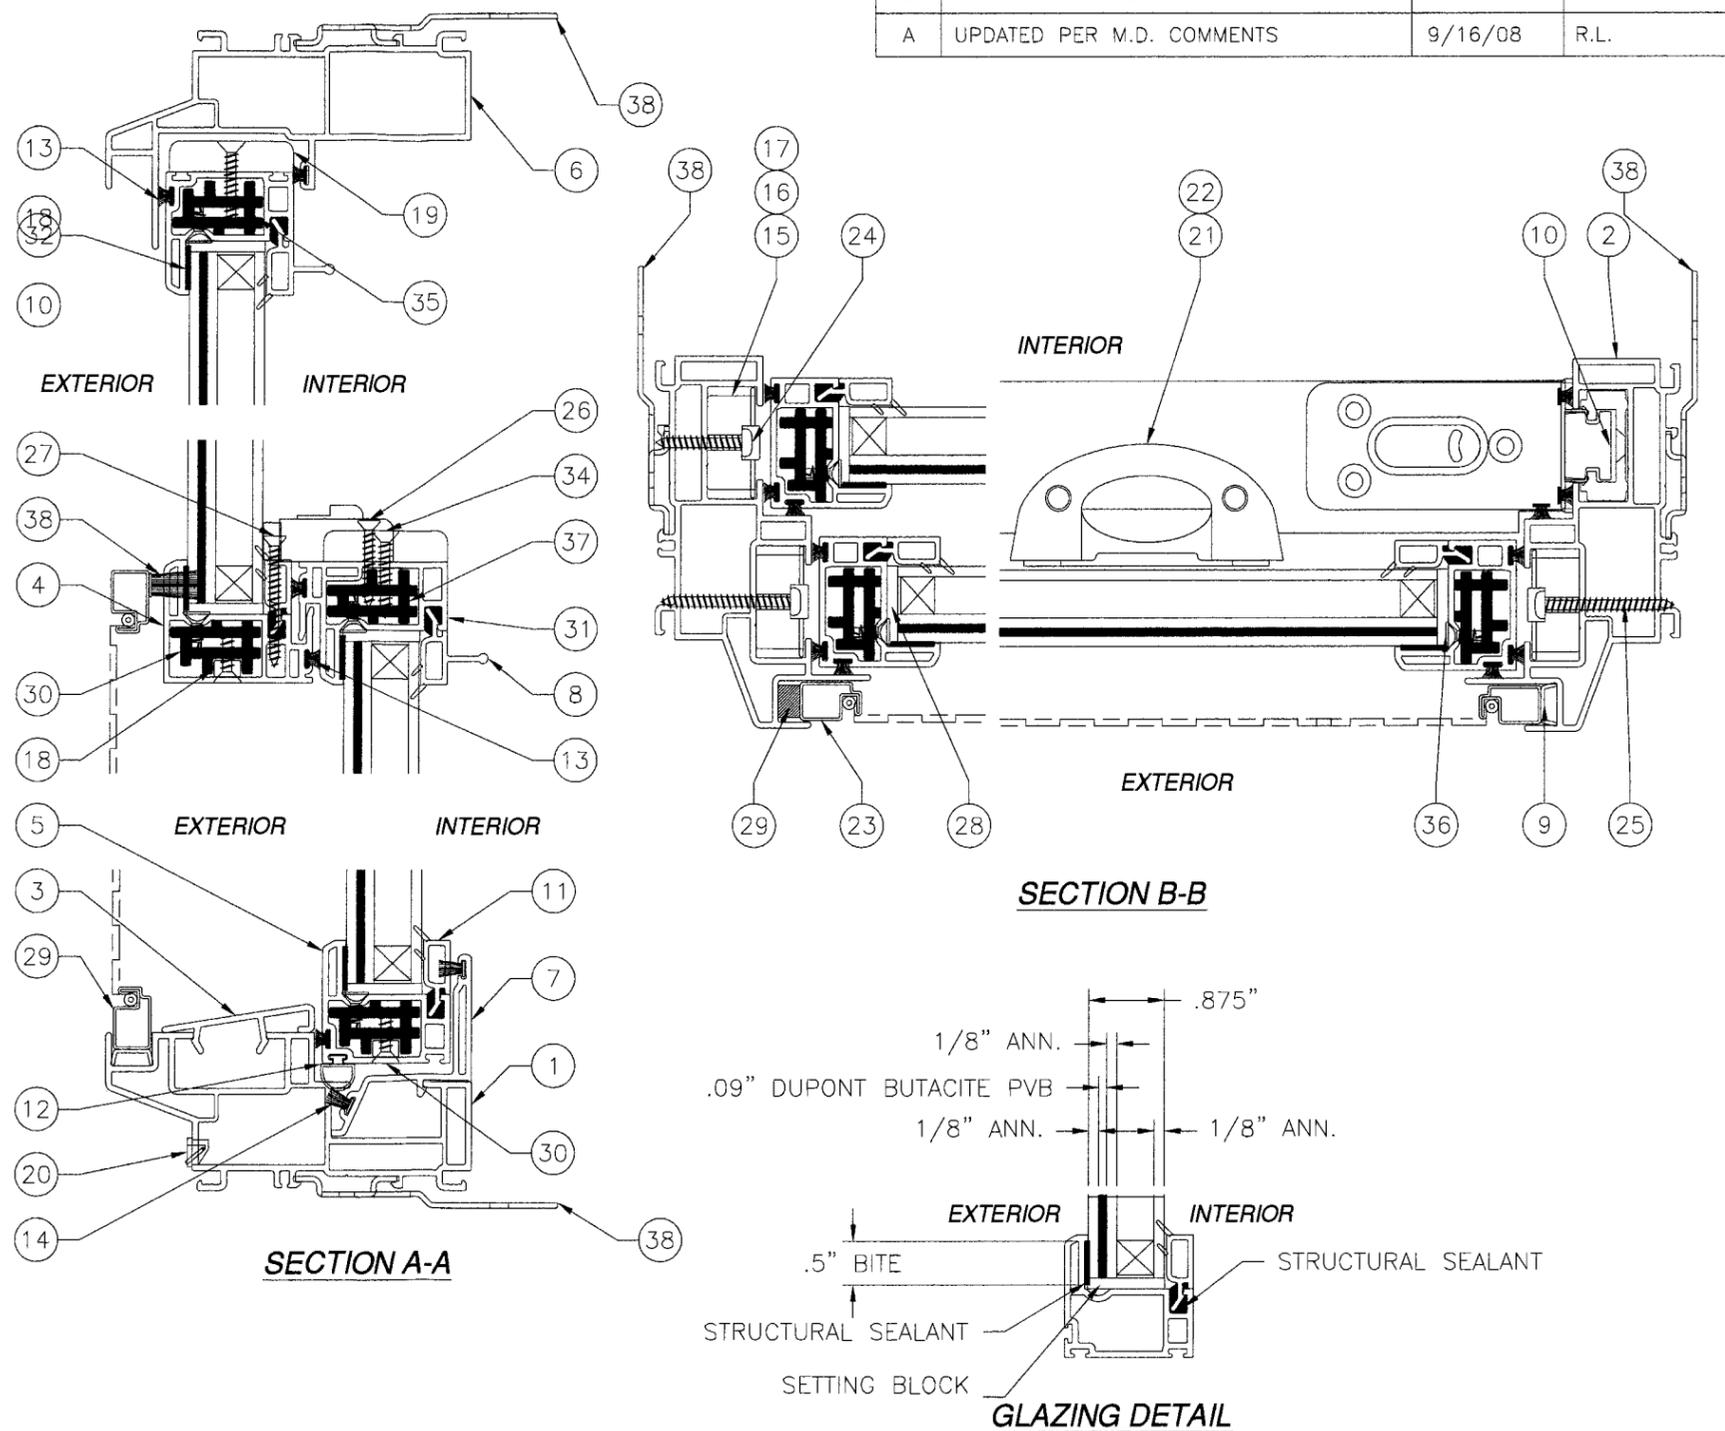


Approved as complying with the Florida Building Code
 Date: 09-30-2008
 NOA#: 08-0324-20
 By: *Manuel Perez*

KOLBE & KOLBE MILLWORK 1211 DEPOT ST MANAWA, WI 54949		
V707DH TILT WHITE PVC DOUBLE HUNG WINDOW CROSS SECTIONS AND B.O.M.		
DRAWN: R.L.	DWG NO. FL 00335	REV A
SCALE NTS	DATE 12/09/07	SHEET 2 OF 4


Luis R. Lomas
 9/18/08
 Luis R. Lomas P.E.
 Florida No. 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATED PER M.D. COMMENTS	9/16/08	R.L.

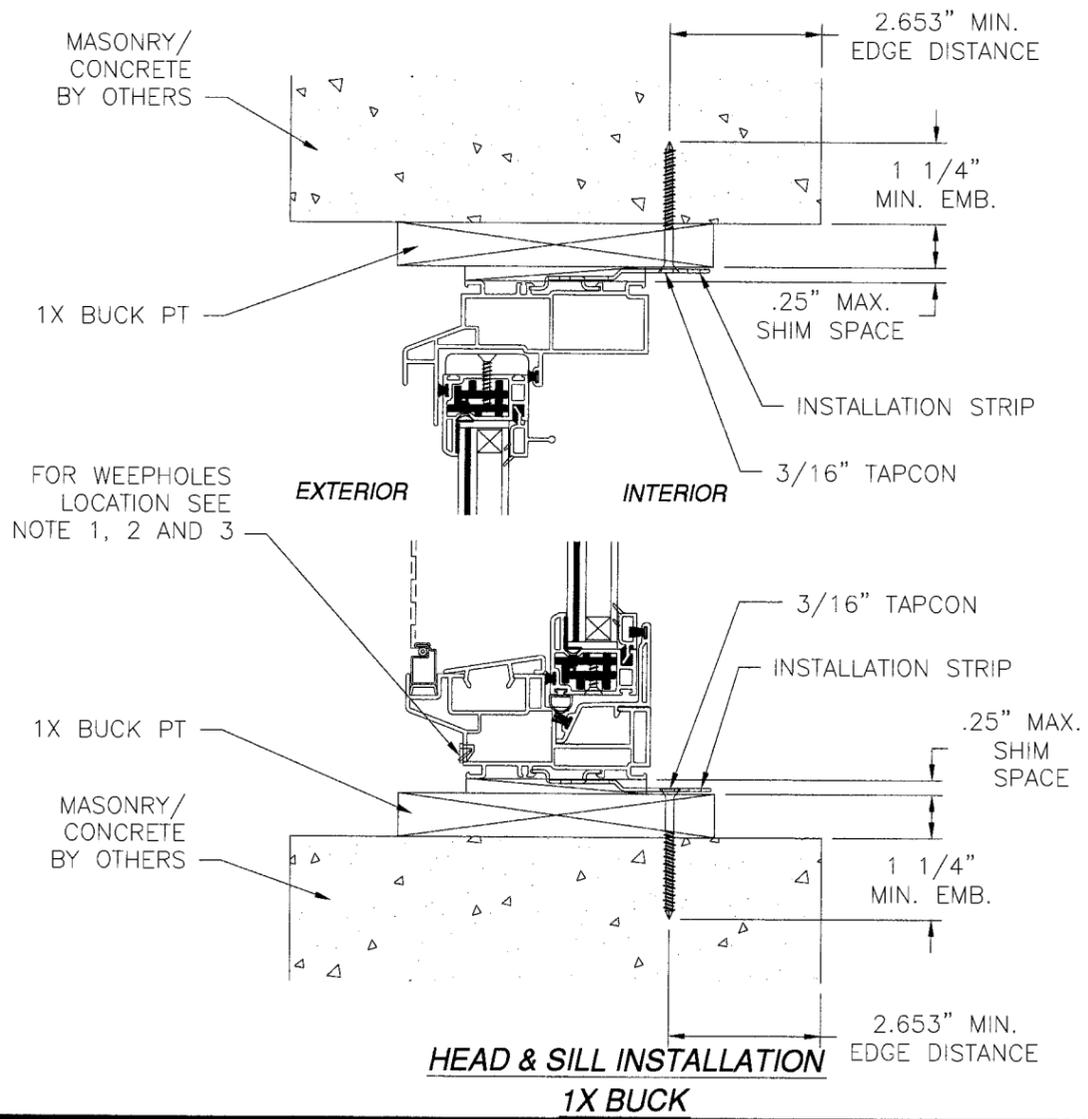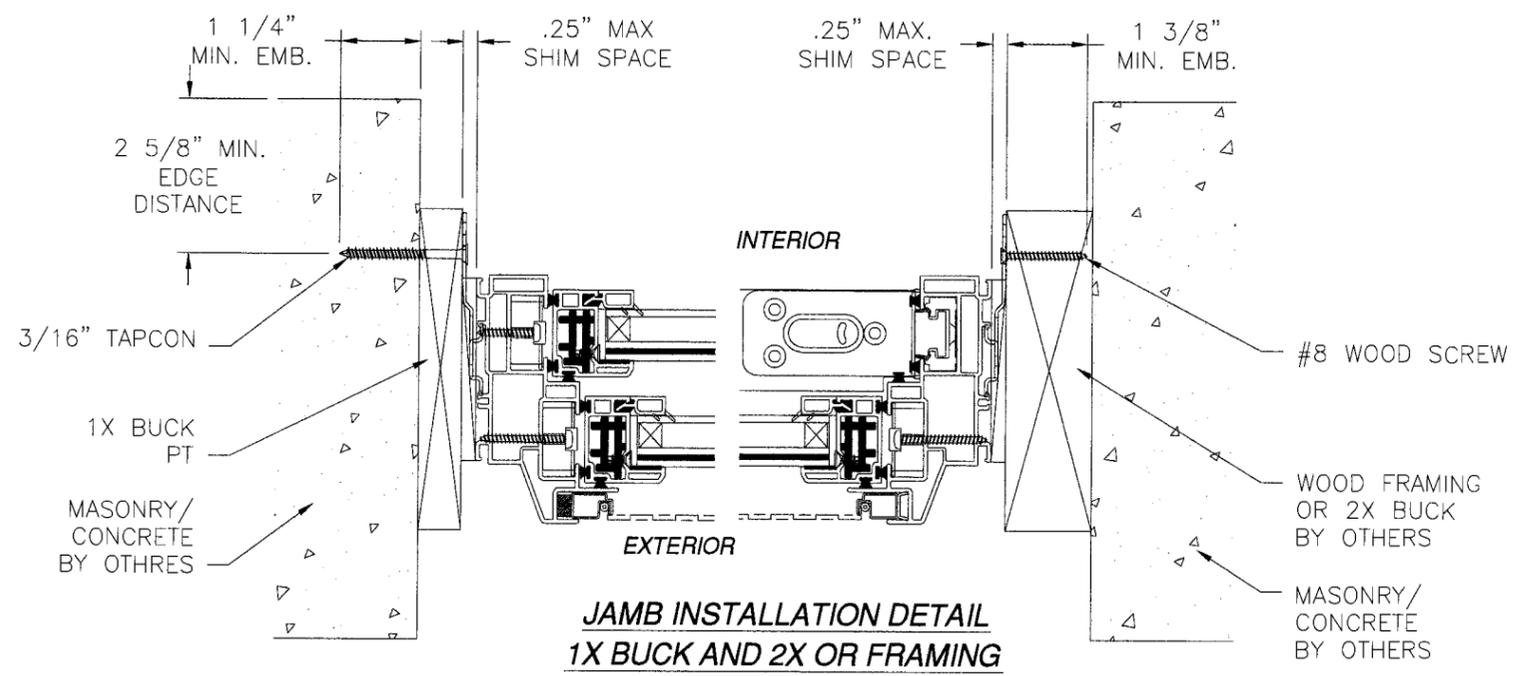

NOTES:

- 1) 3/4" X 1/4" WEEP HOLES LOCATED 1 1/2" FROM EACH END OF INTERIOR SILL TRACK AND 2" FROM EACH END OF EXTERIOR SILL TRACK.
- 2) 5/8" X 1/8" WEEP HOLES LOCATED 3 1/4" FROM EACH END OF SCREEN RETAINER AND 3" FROM EACH END OF EXTERIOR MEETING RAIL AND BOTTOM RAIL.
- 3) 1" X 1/4" WEEP HOLE WITH WEEP COVER LOCATED 4 1/4" FROM EACH END OF EXTERIOR SILL FACE.

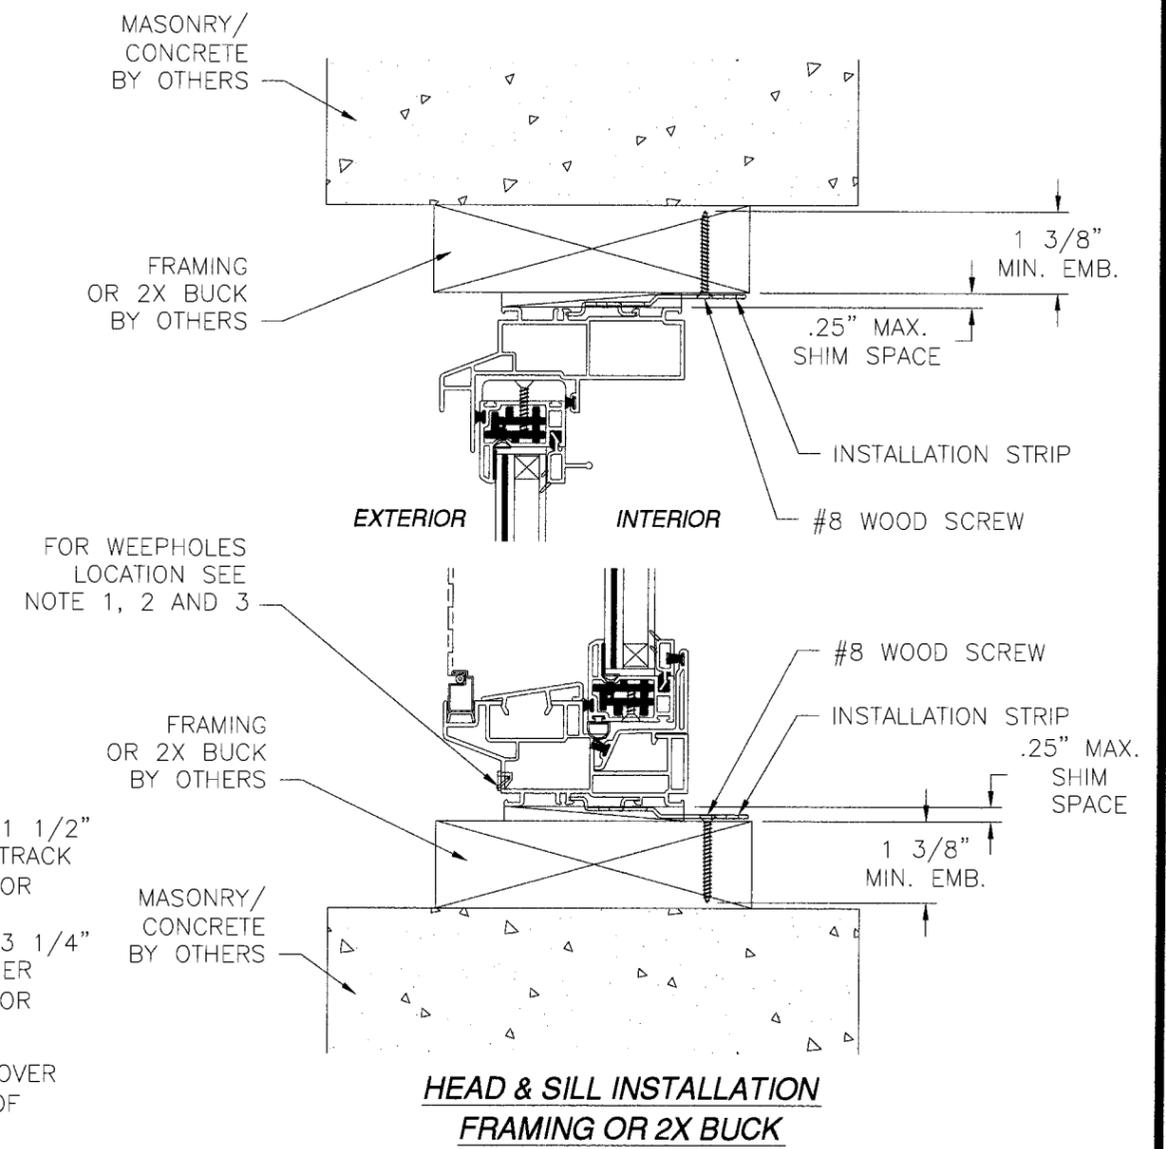

Approved as complying with the Florida Building Code
 Date: Oct. 30, 2008
 NCAP: 08-0324-70
 Miami Code Product Control
 Design By: Manuel Perez

KOLBE & KOLBE MILLWORK
 1211 DEPOT ST
 MANAWA, WI 54949

V707DH TILT WHITE PVC DOUBLE HUNG WINDOW
 INSTALLATION DETAILS


DRAWN: R.L. DWG NO. FL 00335 REV A

SCALE NTS DATE 12/09/07 SHEET 3 OF 4


Luis R. Lomas
 9/18/08

Luis R. Lomas P.E.
 Florida No. 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATED PER M.D. COMMENTS	9/16/08	R.L.

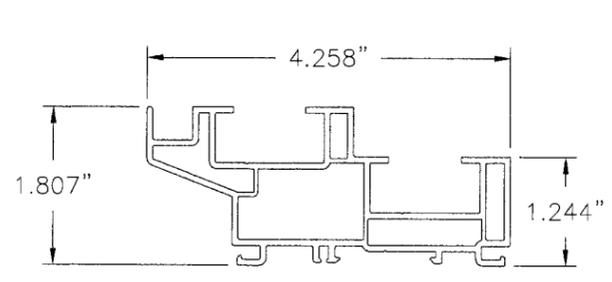


① **SILL FRAME**
VINYL PVC .069 THICK

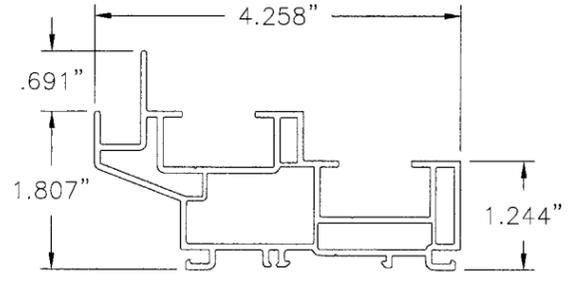


② **JAMB FRAME**
VINYL PVC .069 THICK

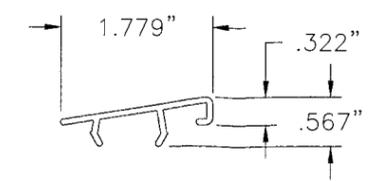


③ **EXTERIOR SILL**
VINYL PVC .069 THICK

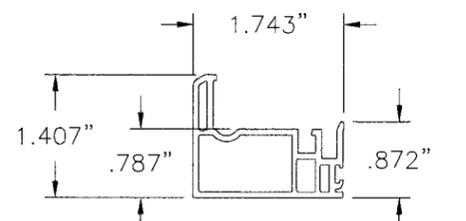


④ **OUTSIDE SASH INTERLOCK**
VINYL PVC .069 THICK

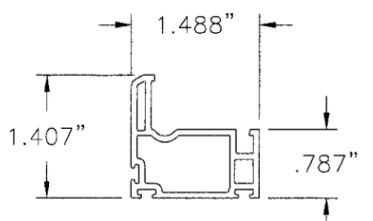


⑤ **SASH FRAME**
VINYL PVC .069 THICK

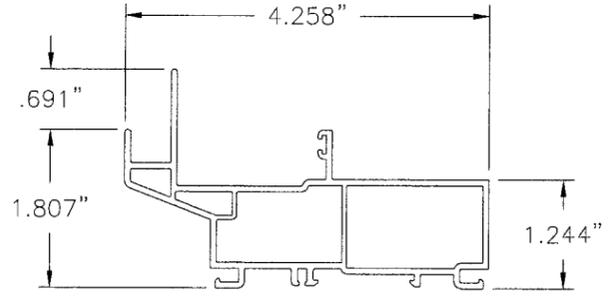


⑥ **HEAD FRAME**
VINYL PVC .069 THICK

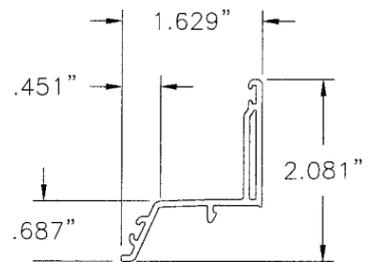


⑦ **SILL ADAPTER**
VINYL PVC .069 THICK

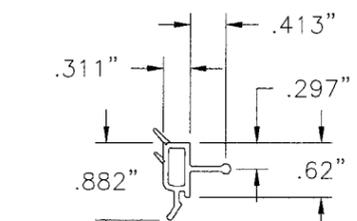

⑧ **7/8\"/>**

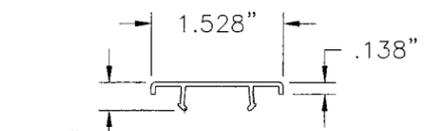


⑩ **SASH STOP**
VINYL PVC .047 THICK

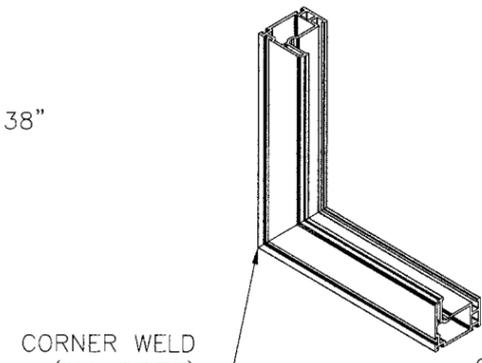


CORNER WELD
(ALL SIDES)

**SASH CORNER
CONSTRUCTION**

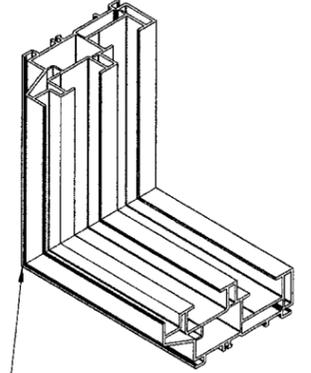


CORNER WELD
(ALL SIDES)


**FRAME CORNER
CONSTRUCTION**

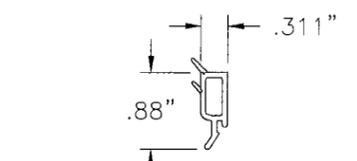


⑪ **7/8\"/>**

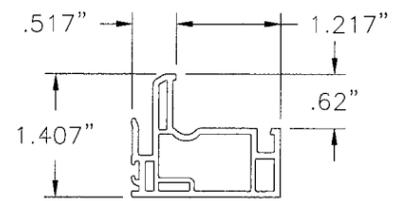


③① **INSIDE SASH INTERLOCK**
VINYL PVC .069 THICK

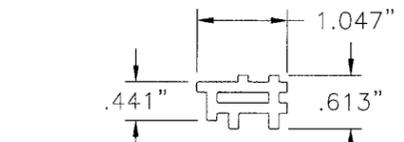


③⑤ **SASH REINFORCEMENT**
AL 6063-T5 .118 THICK

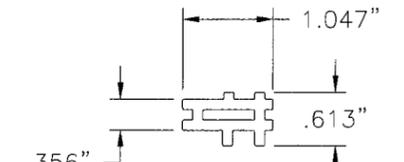

③⑦ **RAIL REINFORCEMENT**
AL 6063-T5 .118 THICK

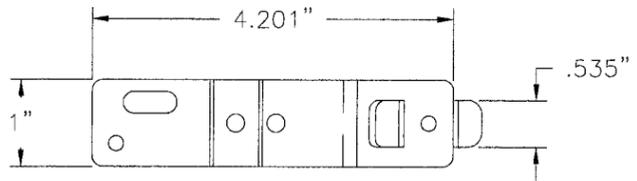

③⑧ **INSTALLATION STRIP**
GALVANIZED STEEL G60

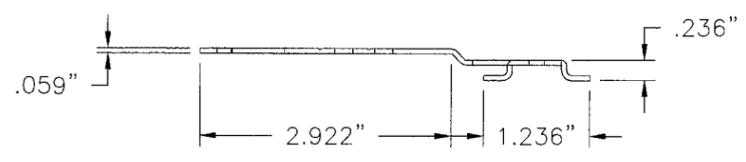

Approved as complying with the Florida Building Code Date: <u>Oct. 30, 2008</u> NCAP: <u>08-0324.20</u> Miami Code Product Control Division By: <u>Manuel Perez</u>	KOLBE & KOLBE MILLWORK 1211 DEPOT ST MANAWA, WI 54949			 9/18/08 Luis R. Lomas P.E. Florida No. 62514
	V707DH TILT WHITE PVC DOUBLE HUNG WINDOW COMPONENTS			
	DRAWN: R.L.	DWG NO. FL 00335	REV A	
	SCALE NTS	DATE 12/09/07	SHEET 4 OF 4	