



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

Jeld-Wen, Inc. (OR)
3737 Lakeport Blvd.
Klamath Falls, OR 97601

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Custom Collection Double Hung" Aluminum Clad Wood Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **07-JWN-0013**, titled "Custom Collection Double Hung Fixed Window – Large Missile Impact Resistant", sheets 1 through 6 of 6, dated 03/04/08, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.


The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 08-0402.01
Expiration Date: September 18, 2013
Approval Date: September 18, 2008
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- A. DRAWINGS**
1. Manufacturer's die drawings and sections.
 2. Drawing No **07-JWN-0013**, Sheets 1 through 6 of 6, titled "Custom Collection Double Hung Fixed Window – Large Missile Impact Resistant", dated 03/04/08, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.
- B. TESTS**
1. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a custom collection aluminum clad double hung wood fixed window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3442-1**, dated 06/19/07, signed and sealed by Gerard J. Ferrara, P.E.
- C. CALCULATIONS**
1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Engineering Express, dated 03/05/08, signed and sealed by Frank L. Bennardo, P.E.
Complies with ASTM E1300-02
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont SentryGlas ® Plus**" dated 01/03/08, expiring on 01/14/12.
- F. STATEMENTS**
1. Statement letter of conformance, dated March 18, 2008, signed and sealed by Frank L. Bennardo, P.E.
 2. Statement letter of no financial interest, dated March 18, 2008, signed and sealed by Frank L. Bennardo, P.E.
 3. Laboratory compliance letter for Test Report no. **NCTL- 210-3442-1**, issued by National Certified Testing Laboratories, dated 09/06/08, signed and sealed by Gerard J. Ferrara, P.E.

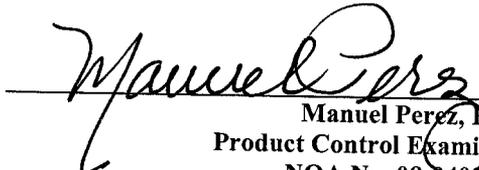
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-0402.01
Expiration Date: September 18, 2013
Approval Date: September 18, 2008

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

4. Addendum letter of Acrylic Sealant for Test Report no. **NCTL-210-3442-1**, issued by National Certified Testing Laboratories, dated June 25, 2008, signed and sealed by Gerard J. Ferrara, P.E.
5. Addendum letter of the Silicone Sealant for Test Report no. **NCTL-210-3442-1**, issued by National Certified Testing Laboratories, dated July 01, 2008, signed and sealed by Harold E. Rupp, P.E.

G. OTHERS

1. None.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-0402-01
Expiration Date: September 18, 2013
Approval Date: September 18, 2008

CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW

LARGE MISSILE IMPACT RESISTANT

FRANK L. BENNARDO, P.E.
PE0046549

08/18/2008

ENGINEERING EXPRESS®

160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM

CERT. OF AUTH. #9886
A FRANK L. BENNARDO, P.E., INC. INNOVATION


JELD-WEN

3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE WITH 2006 SUPPLEMENTS AND THE 2007 FLORIDA BUILDING CODE, FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201 / 202 / 203 & ASTM E1300-02 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
5. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
6. ALL WOOD COMPONENTS OF THIS PRODUCT SHALL BE PRESSURE TREATED WESTERN PINE OR WESTERN WOODS WITH G=0.36 OR GREATER DENSITY, UNLESS NOTED OTHERWISE.
7. UNITS GLAZED AS SHOWN HEREIN ARE LARGE MISSILE IMPACT RESISTANT AND DO NOT REQUIRE IMPACT RESISTANT SHUTTERS.
8. PLASTIC COMPONENTS USED WITHIN THE HVHZ MUST MEET ALL APPLICABLE FIRE/SMOKE/UV PERFORMANCE REQUIREMENTS AS SET FORTH IN THE ABOVE-NOTED BUILDING CODE.
9. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.

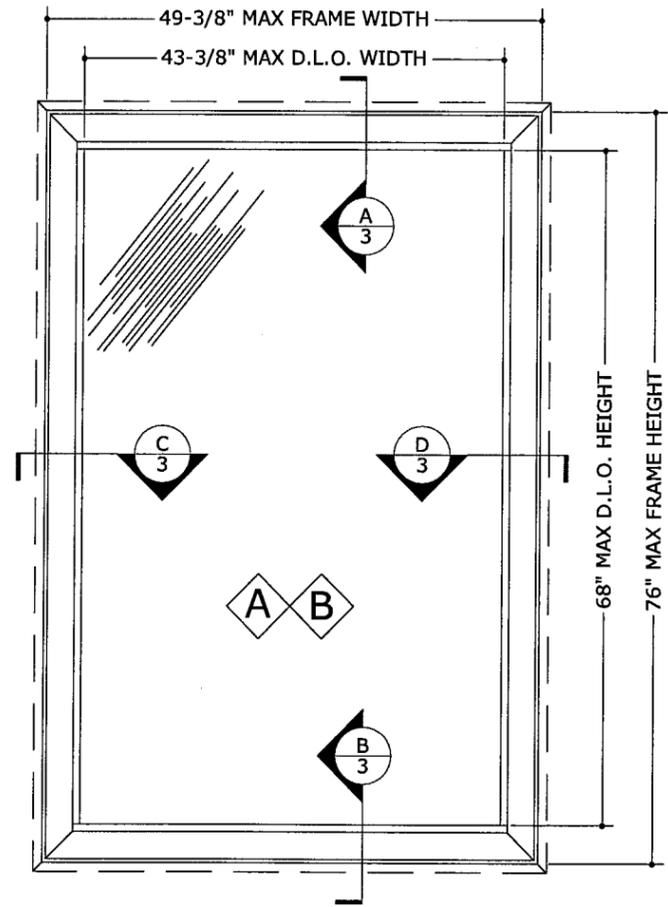

NOTE: MAXIMUM FRAME DIMENSIONS DO NOT INCLUDE INTEGRAL NAILING FIN. SEE DESIGN SCHEDULE FOR MAXIMUM ALLOWABLE DESIGN PRESSURES.

1 TYPICAL ELEVATION
1 N.T.S. EXTERIOR VIEW

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	RKB	CL	03/04/08

07-JWN-0013
SCALE: 01
PAGE DESCRIPTION:

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 68-0462.01
Miami Dade Product Control
Division
By *Manuel Puz*



F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0013 Custom Wood - Double Hung, Fixed, LMI (NOA)\07-JWN-0013_01f Custom Wood - Double Hung, Fixed, LMI (NOA).dwg
08/18/2008 - 4:46pm keithl

DESIGN SCHEDULE

FRAME HEIGHT	SASH HEIGHT	D.L.O. HEIGHT	GLAZING TYPE	18"	20"	24"	28"	30"	32"	36"	37-3/8"	40"	42"	48"	49-3/8"	FRAME WIDTH
				16"	18"	22"	26"	28"	30"	34"	35-3/8"	38"	40"	46"	47-3/8"	SASH WIDTH
				12"	14"	18"	22"	24"	26"	30"	31-3/8"	34"	36"	42"	43-3/8"	D.L.O. WIDTH
18"	14-1/2"	10"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	MAXIMUM ALLOWABLE DESIGN PRESSURES (PSF)
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
20"	16-1/2"	12"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
24"	20-1/2"	16"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
30"	26-1/2"	22"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
32"	28-1/2"	24"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
36"	32-1/2"	28"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
40"	36-1/2"	32"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
42"	38-1/2"	34"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
48"	44-1/2"	40"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
54"	50-1/2"	46"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
56"	52-1/2"	48"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
60"	56-1/2"	52"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
64"	60-1/2"	56"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
66"	62-1/2"	58"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
72"	68-1/2"	64"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	
76"	72-1/2"	68"	A	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	+55/-75	
			B	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	+55/-65	

GLAZING TYPE A
5/16" LAMINATED, LMI
FOR USE AT ANY HEIGHT ABOVE GRADE

GLAZING TYPE B
3/4" INSULATED LAMINATED, LMI
NOT FOR USE ABOVE 30' ABOVE GRADE

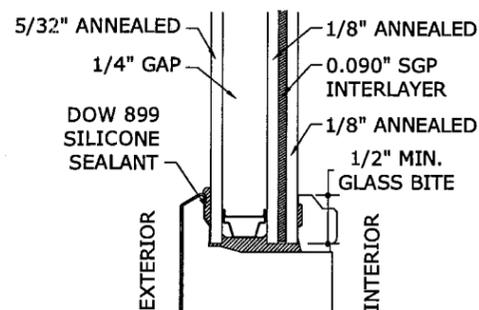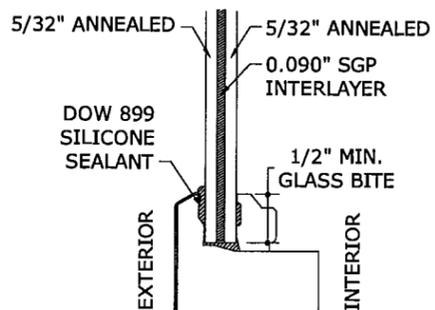

1 GLAZING DETAILS
2 N.T.S. VERT SECTION

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 08-0402.01
Miami Dade Product Control
Division
By *Manuel Diaz*

FRANK L. BENNARDO, P.E.
PE0046549

08/18/2008

ENGINEERING EXPRESS

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #9895
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE
INIT. ISSUE	03/04/08
DRWN	CL
CHKD	
RKB	
CL	

07-JWN-0013
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION: 01

2

F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0013 Custom Wood - Double Hung, Fixed, LMI (NOA)\07-JWN-0013_01 Custom Wood - Double Hung, Fixed, LMI (NOA).dwg
08/18/2008 - 4:46pm keith

08/18/2008

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606
CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE



REMARKS	DATE
INIT ISSUE	03/04/08

07-JWN-0013
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION: 01


Approved as complying with the Florida Building Code
Date 09/18/2008
NOA# 08-0402.01
Miami Dade Product Control
By *Manuel Ortiz*

3

A TYPICAL HEAD ASSEMBLY
3 N.T.S. VERT SECTION

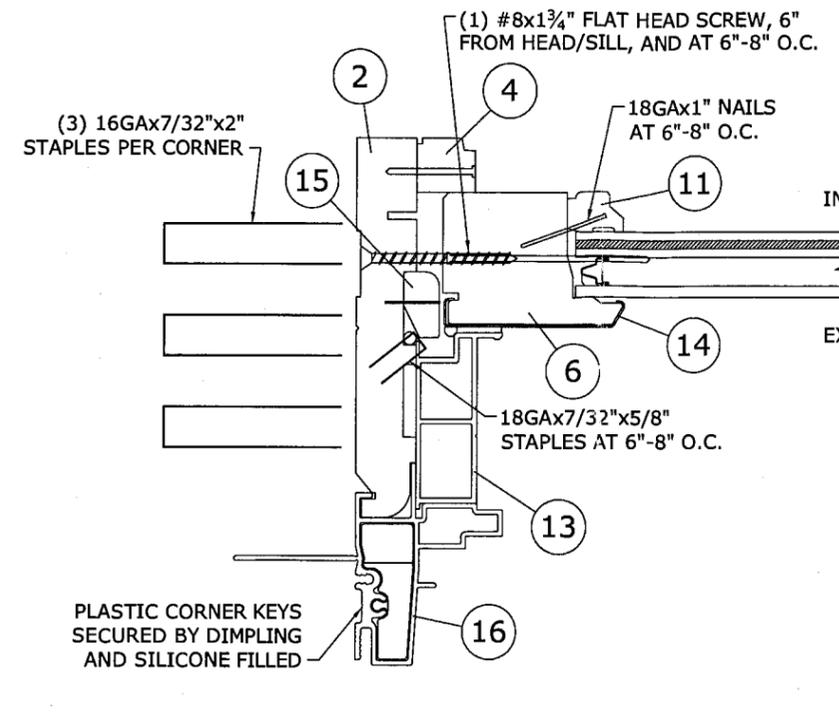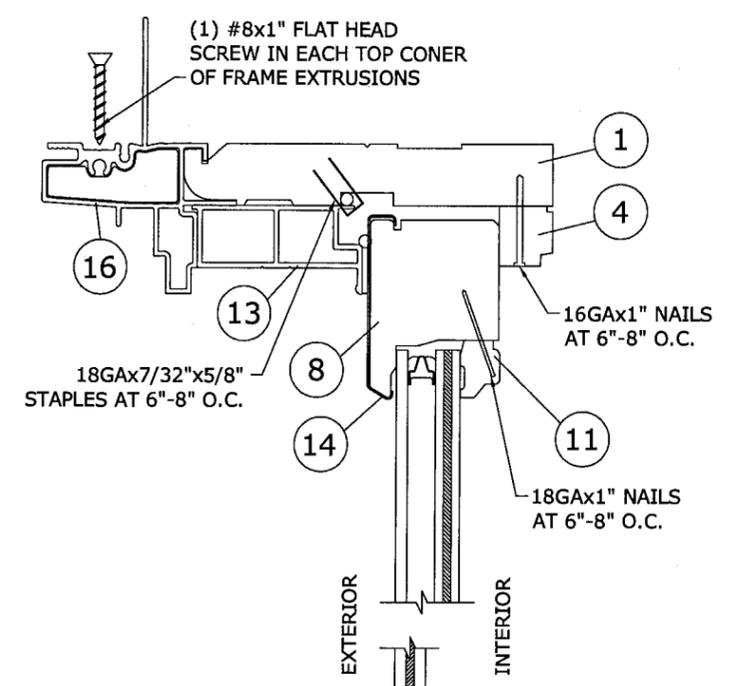


D TYPICAL JAMB ASSEMBLY
3 N.T.S. HORIZ SECTION

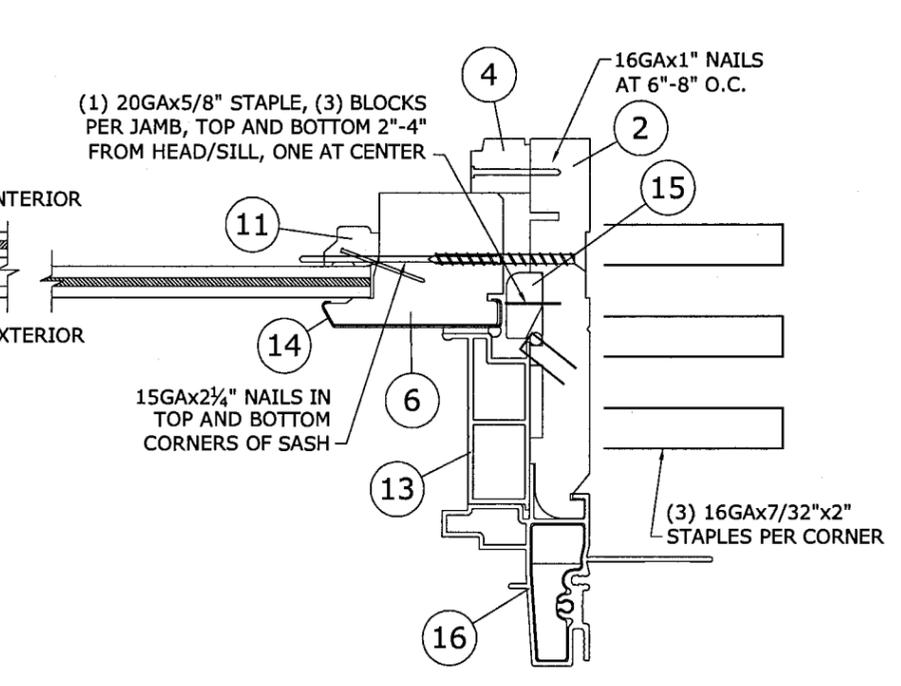


C TYPICAL JAMB ASSEMBLY
3 N.T.S. HORIZ SECTION

B TYPICAL SILL ASSEMBLY
3 N.T.S. VERT SECTION

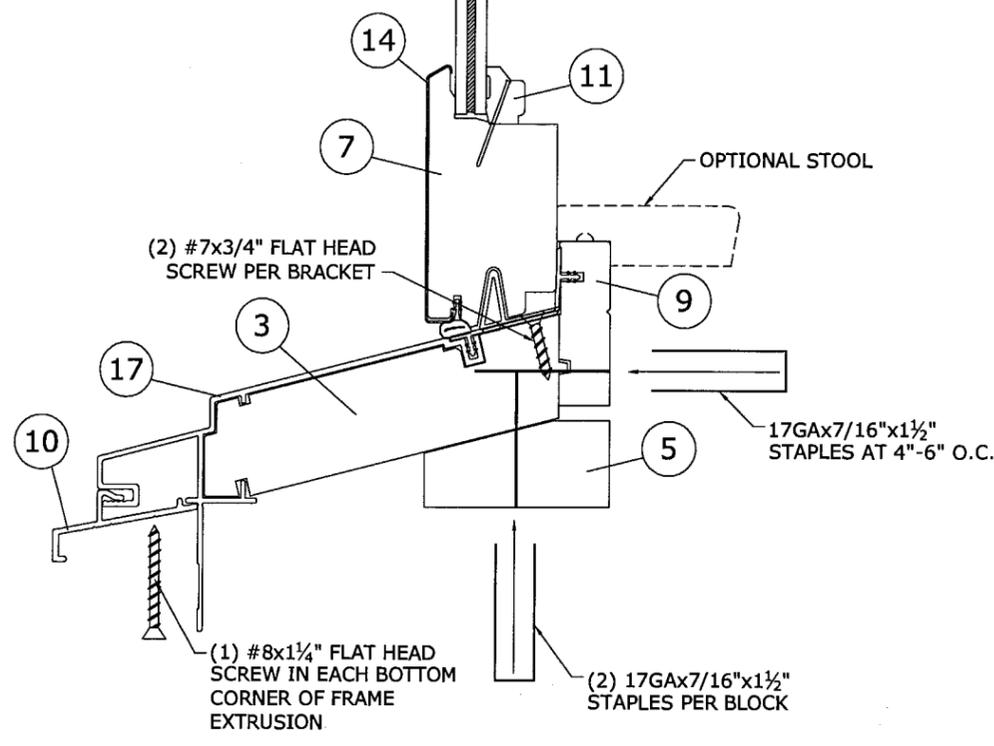

F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0013 Custom Wood - Double Hung, Fixed, LMI (NOA).dwg
08/18/2008 - 4:46pm keithl

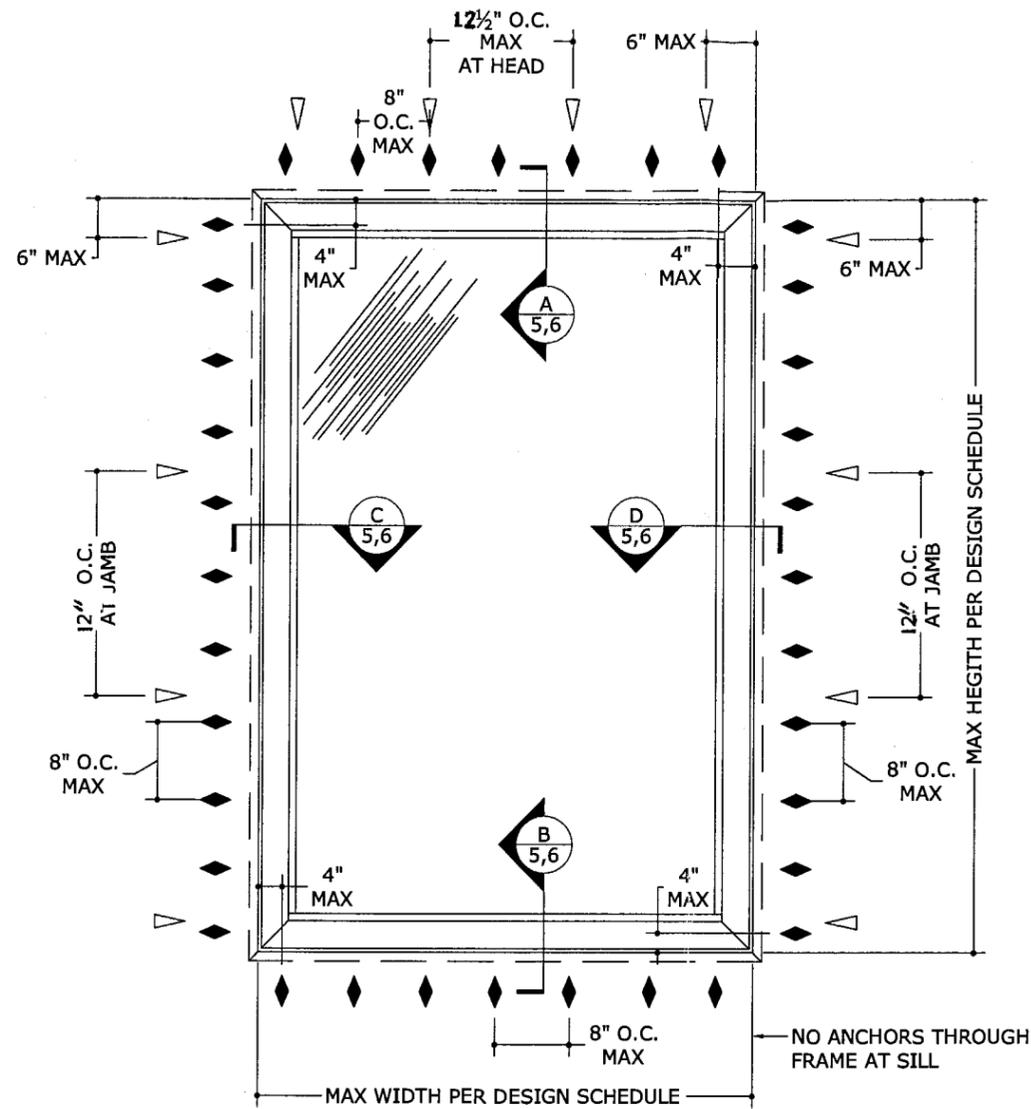

ANCHOR LEGEND:

- ▽ DENOTES ANCHOR THROUGH FRAME
 - ◆ DENOTES ANCHOR THROUGH NAIL FIN
- (THROUGH FRAME AND NAIL FIN ANCHOR SHALL BE INSTALLED SIMULTANEOUSLY FOR ALL APPLICATIONS).

1 ANCHOR ELEVATION
4 N.T.S. EXTERIOR VIEW

ANCHOR SCHEDULE:

TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):

- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION.
- 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION.

ANCHOR NOTES:

1. SEE ANCHOR ELEVATIONS FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
4. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
5. MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
6. ANCHOR SCHEDULE APPLIES TO ALL PRODUCTS CERTIFIED HEREIN.
7. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
8. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

Approved as complying with the Florida Building Code
 Date 09/18/2008
 NOA# 08-0402-01
 Miami Dade Product Control Division
 By *Manuel Perez*

FRANK L. BENNARDO, P.E.
 #PE0046549

08/18/2008

ENGINEERING EXPRESS®

160 SW 12th AVENUE, #106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0443
 WWW.ENGEXP.COM

CERT. OF AUTH. #9885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
 3737 LAKEPORT BOULEVARD
 KLAMATH FALLS, OREGON 97601
 PHONE: (541) 850 - 2606

CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE
INT ISSUE	03/04/08

07-JWN-0013
 SCALE: 01
 PAGE DESCRIPTION:
 4

08/18/2008

ENGINEERING EXPRESS
160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELDWEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606
CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DRWN	CHKD	DATE
INIT ISSUE	RKB	CL	03/04/08

07-JWN-0013
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION: 01


Approved as complying with the Florida Building Code
Date 09/18/2008
NOAH 08-0402.01
Miami Dade Product Control
By *[Signature]*

5


A
5 N.T.S. VERT SECTION
INSTALLATION THROUGH NAIL FIN AT FRAME HEAD

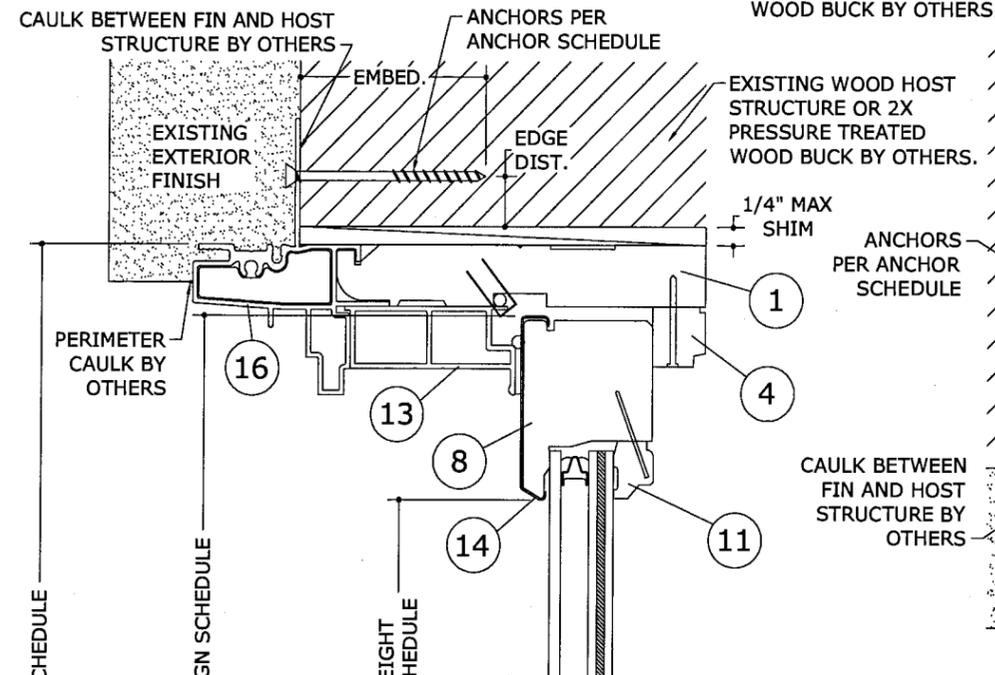

C
5 N.T.S. HORIZ SECTION
INSTALLATION THROUGH NAIL FIN AT FRAME JAMB

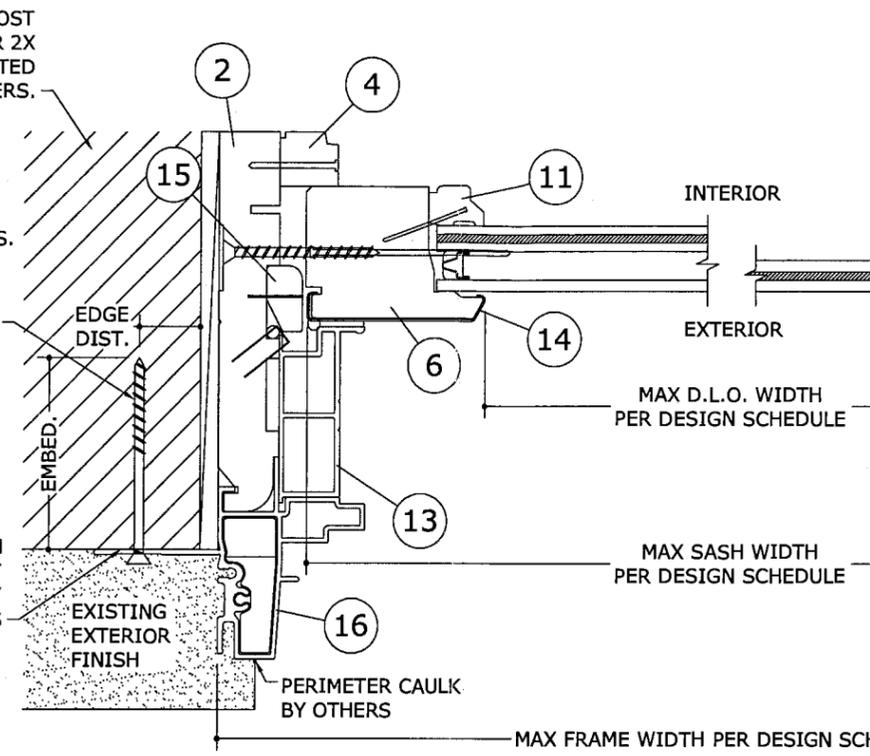


D
5 N.T.S. HORIZ SECTION
INSTALLATION THROUGH NAIL FIN AT FRAME JAMB

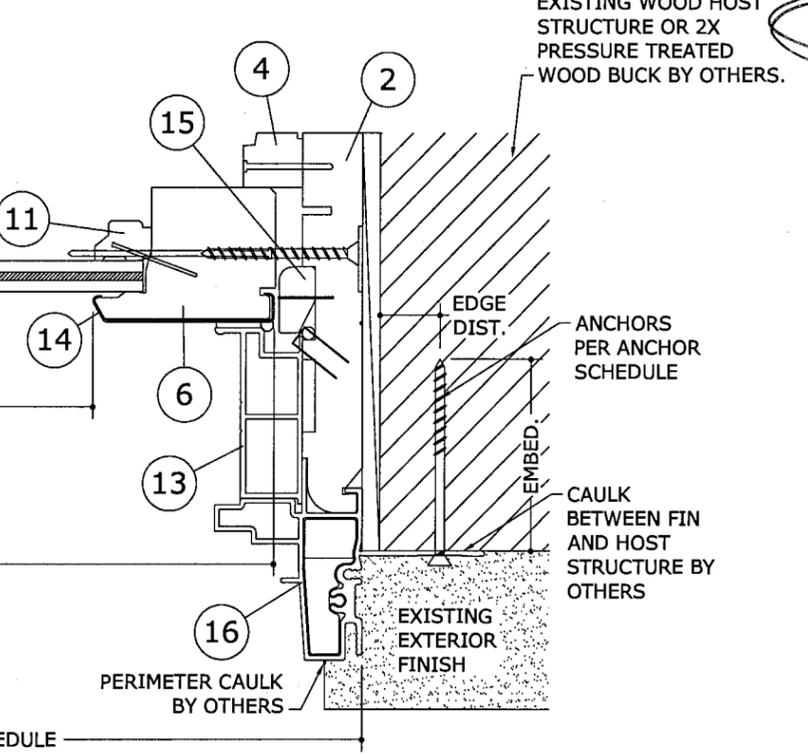

NOTE: SEE ANCHOR SCHEDULE AND ANCHOR NOTES FOR REQUIRED EDGE DISTANCES AND EMBEDMENTS.

B
5 N.T.S. VERT SECTION
INSTALLATION THROUGH NAIL FIN AT FRAME SILL

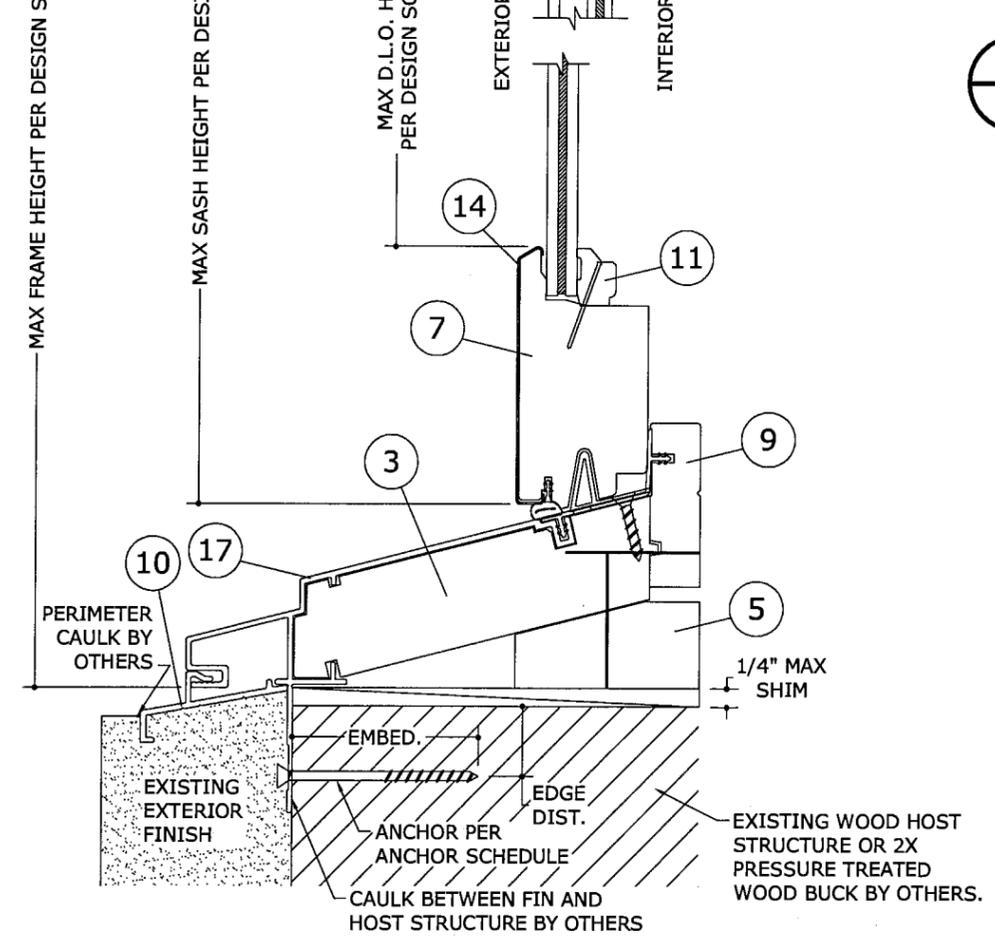

F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0013 Custom Wood - Double Hung, Fixed, LMI (NOA).dwg
08/18/2008 - 4:47pm
keith

08/18/2008 - 4:47pm keithl F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0013 Custom Wood - Double Hung, Fixed, LMI (NOA).dwg

FRANK L. BENNARDO, P.E.
PE0046549

08/18/2008

JELD-WEN ENGINEERING EXPRESS
160 SW 12th Avenue, #106
Deerfield Beach, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606
CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE



REMARKS	DRWN	CHKD	DATE
INIT ISSUE	FRB	CL	03/04/08

07-JWN-0013
SCALE: 01
PAGE DESCRIPTION:

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 08-0402.01
Miami Dade Product Control
Division
By *Manuel Perez*

6

A
6 N.T.S. VERT SECTION
INSTALLATION THROUGH FRAME AT FRAME HEAD

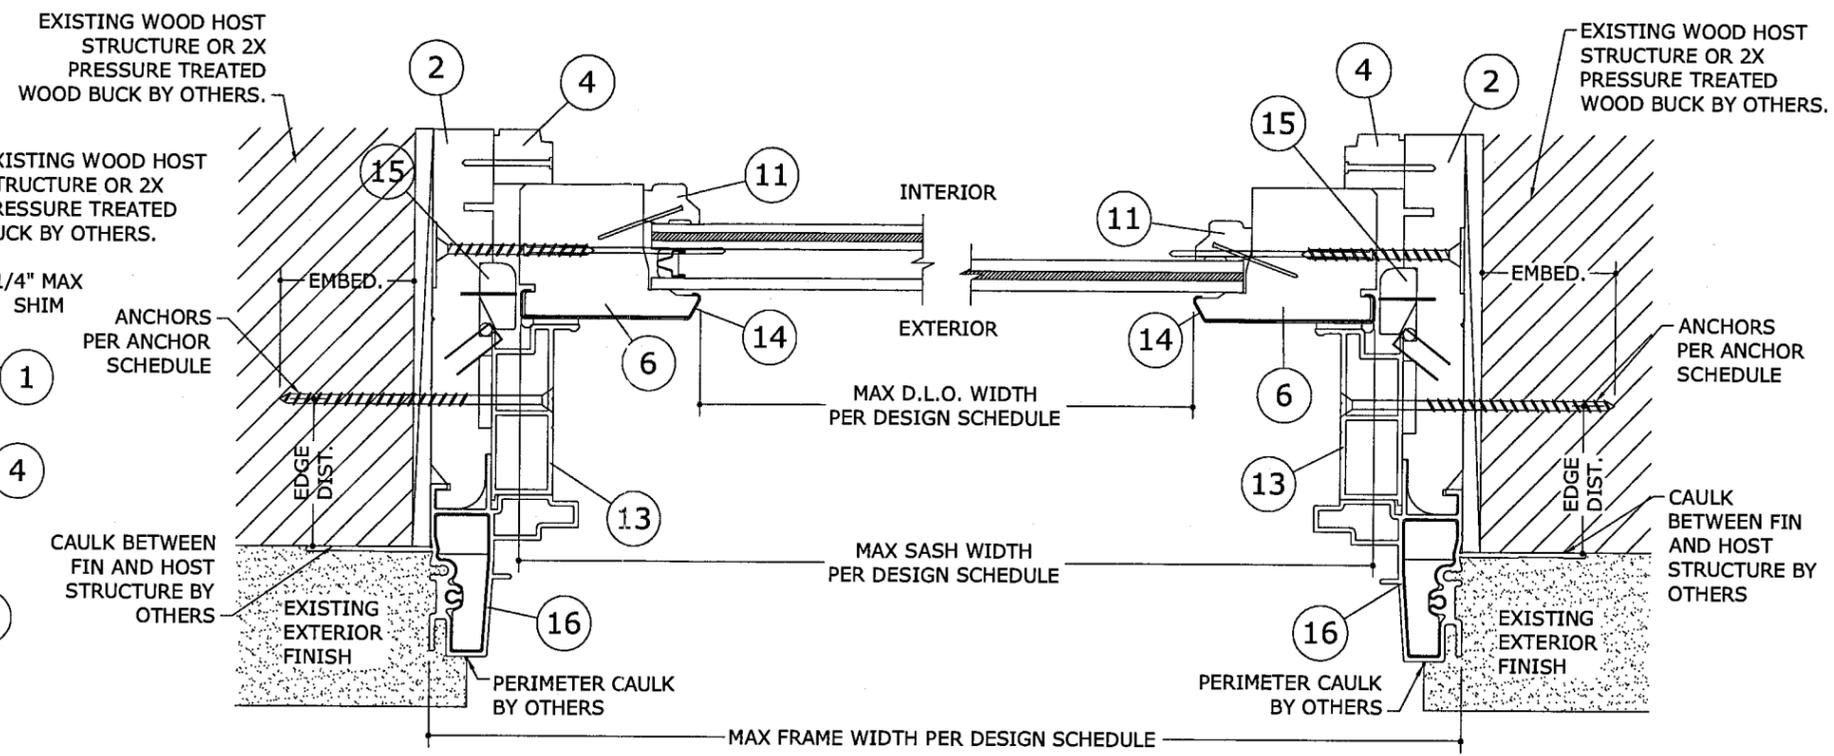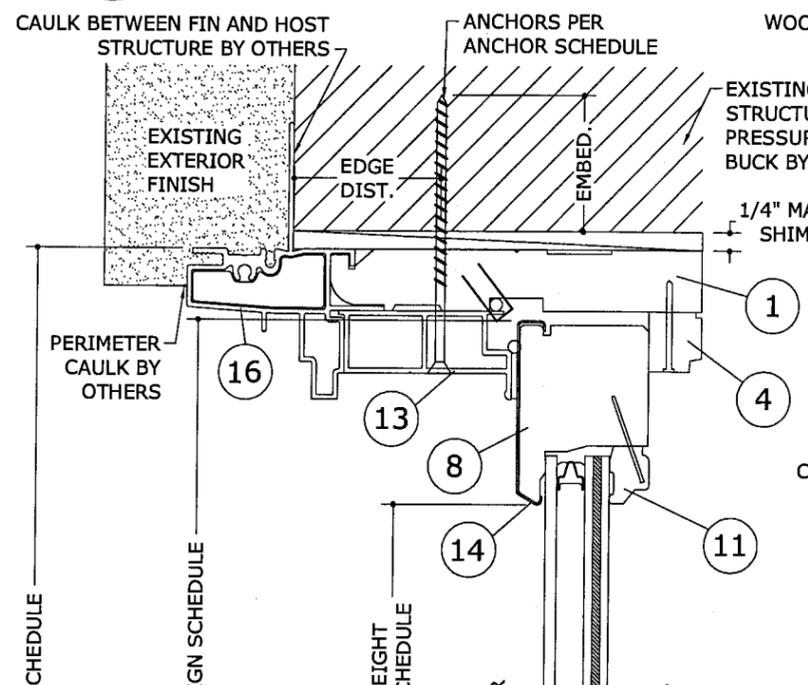


C
6 N.T.S. HORIZ SECTION
INSTALLATION THROUGH FRAME AT FRAME JAMB


D
6 N.T.S. HORIZ SECTION
INSTALLATION THROUGH FRAME AT FRAME JAMB

NOTE: SEE ANCHOR SCHEDULE AND ANCHOR NOTES FOR REQUIRED EDGE DISTANCES AND EMBEDMENTS.

B
6 N.T.S. VERT SECTION
INSTALLATION THROUGH FRAME AT FRAME SILL

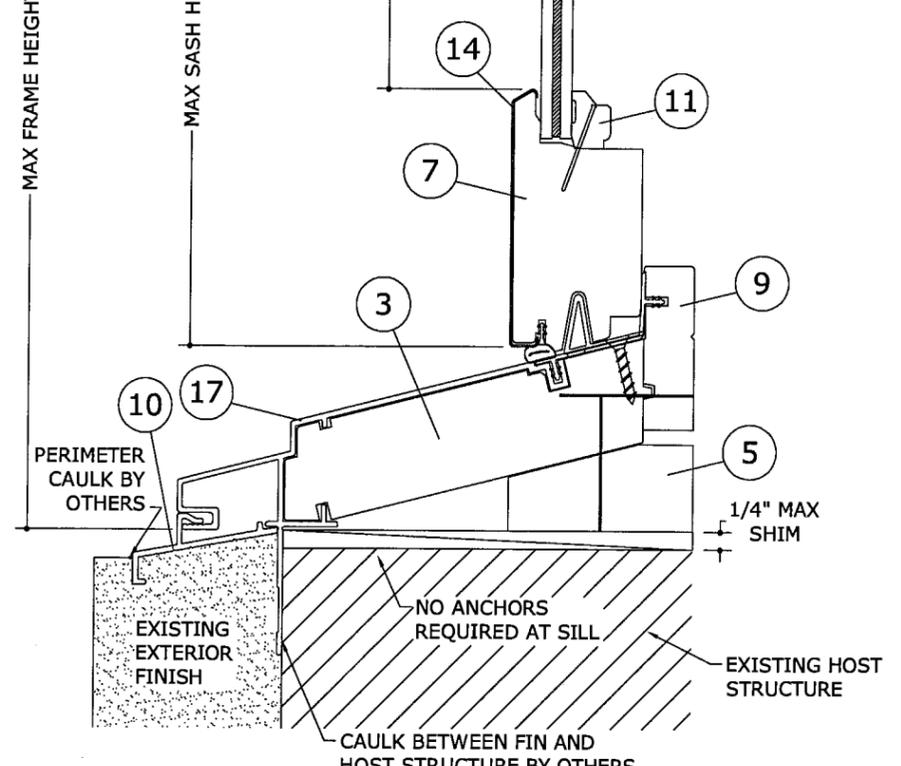

08/18/2008 - 4:47pm keithl

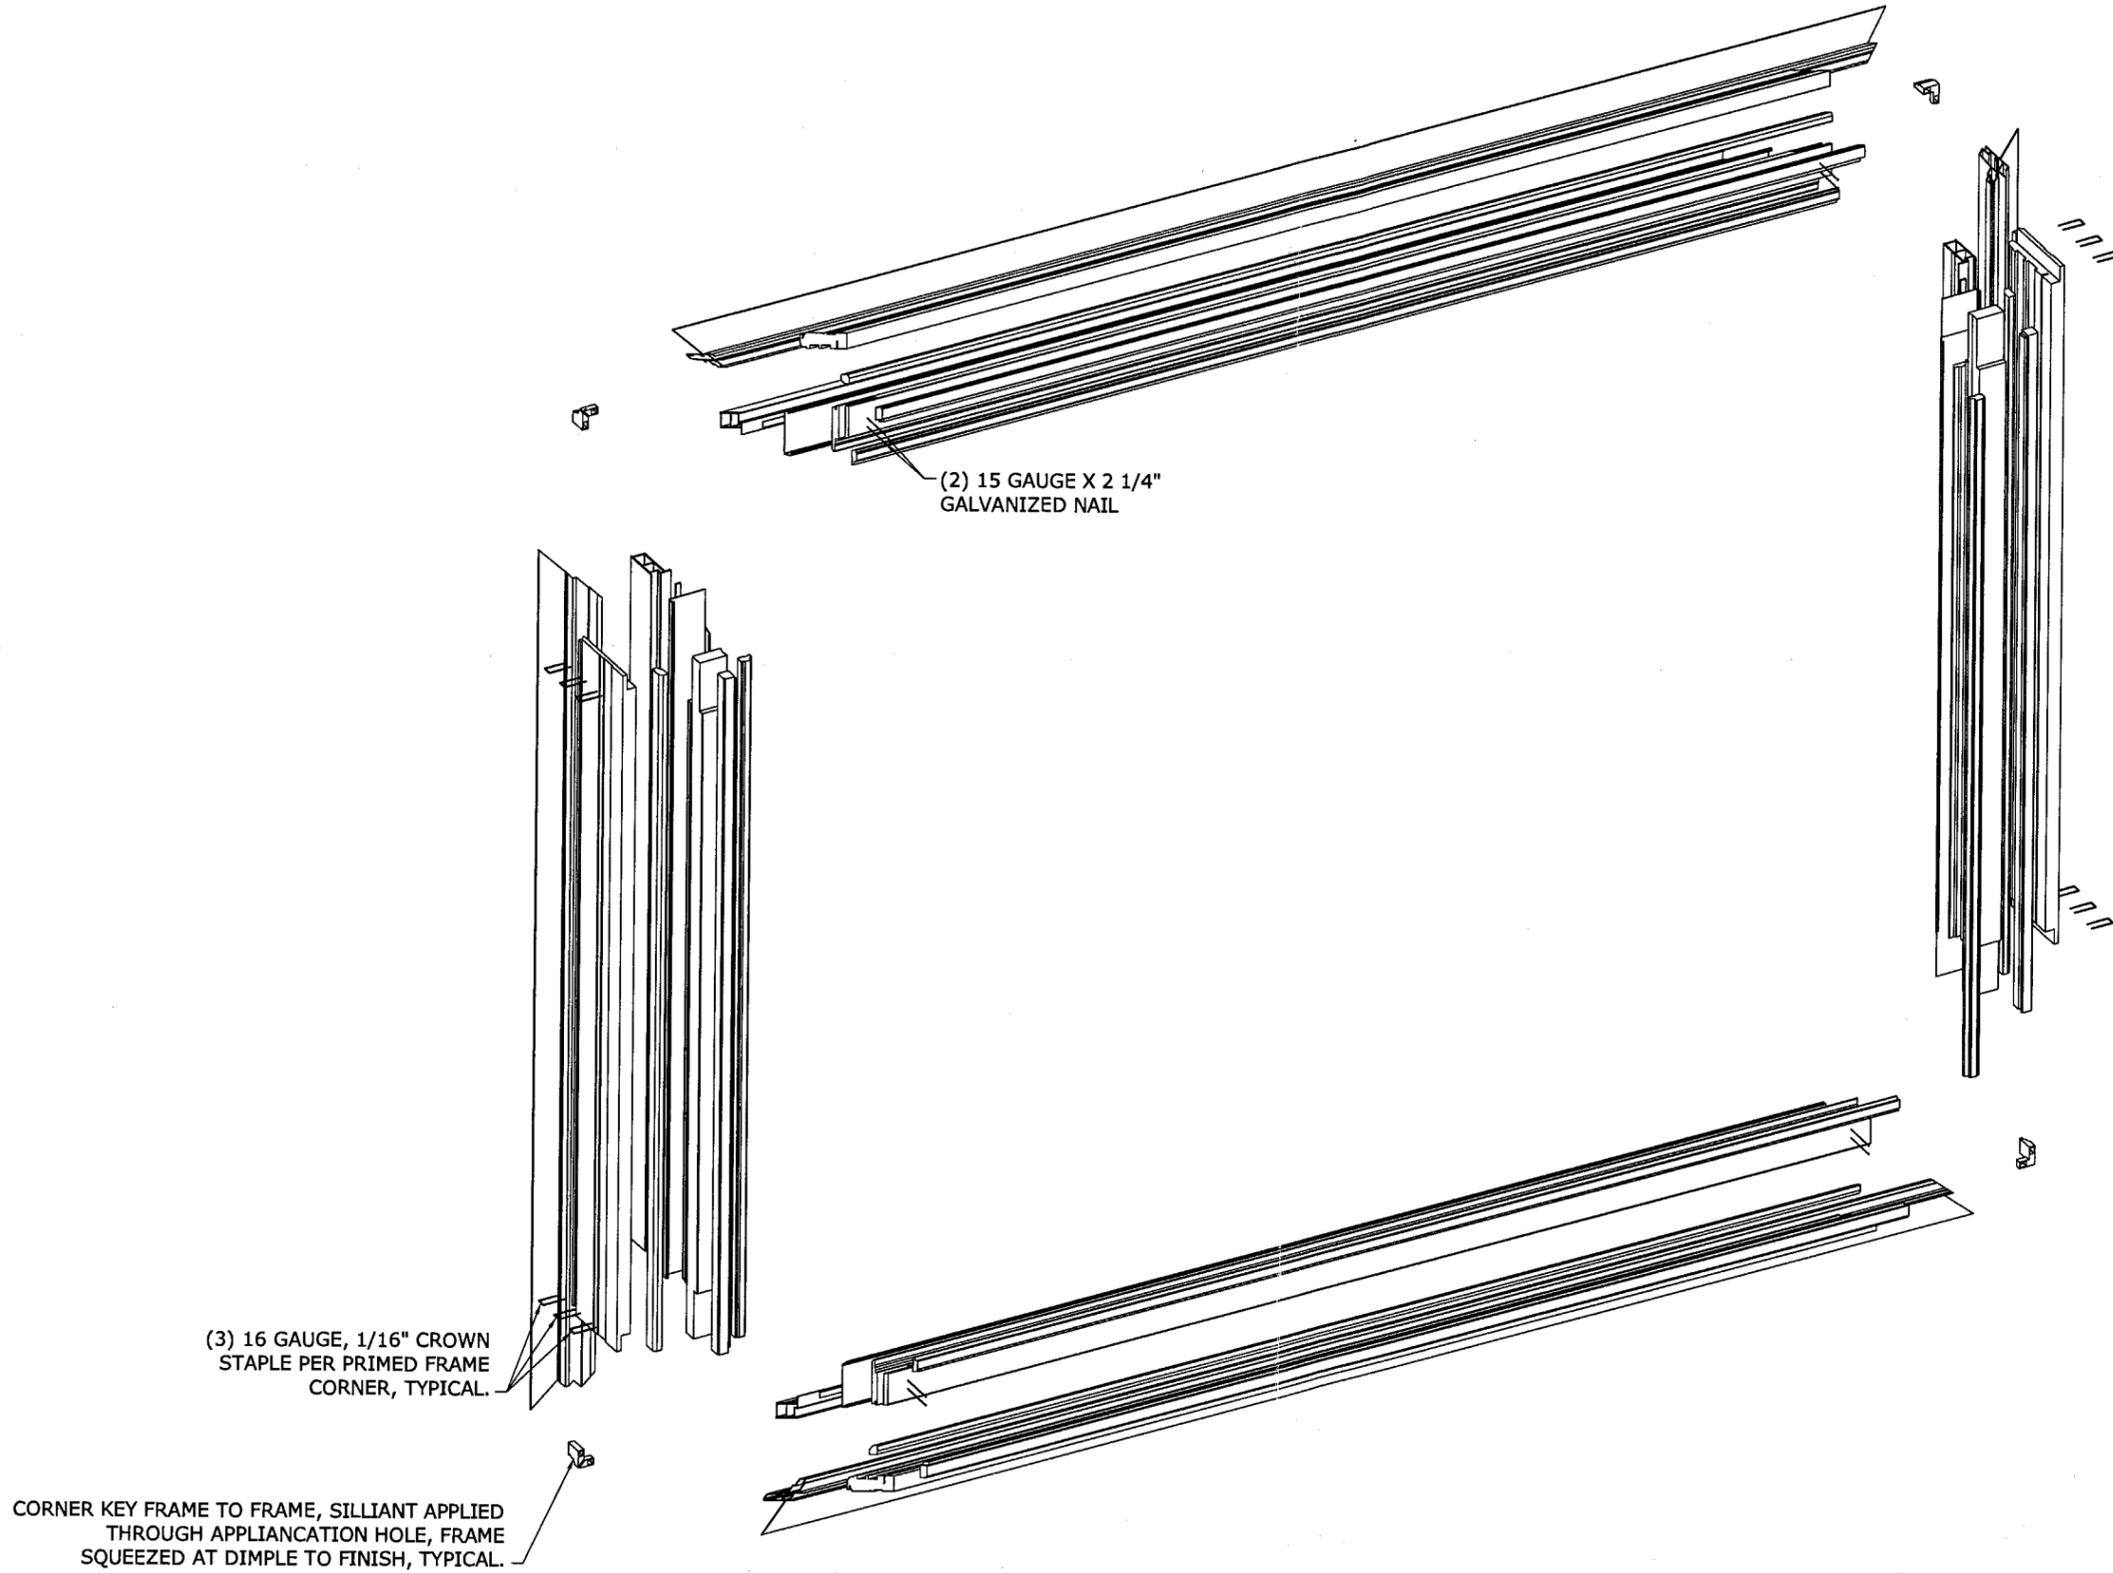

CORNER KEY FRAME TO FRAME, SILLIANT APPLIED THROUGH APPLIANCATION HOLE, FRAME SQUEEZED AT DIMPLE TO FINISH, TYPICAL.

1 ASSEMBLY DETAIL
7 N.T.S. ISOMETRIC

Approved as complying with the Florida Building Code
Date 09/18/2008
NOA# 68-0402.01
Miami Dade Product Control Division
By *Maurice Perry*

08/18/2008



ENGINEERING EXPRESS®
160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELDWEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	RKB	CL	03/04/08



07-JWN-0013
SCALE: 01

PAGE DESCRIPTION:

08/18/2008



160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION DOUBLE HUNG FIXED WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DRWN	CHKD	DATE
INIT ISSUE	IRK	CL	03/04/08

07-JWN-0013


SCALE: 1/8" = 1'-0"

PAGE DESCRIPTION:


8

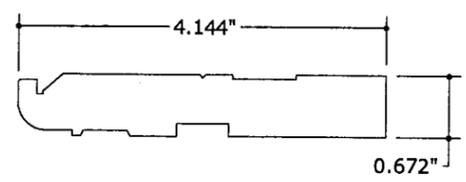


1 HEAD
6" = 1'-0" WOOD

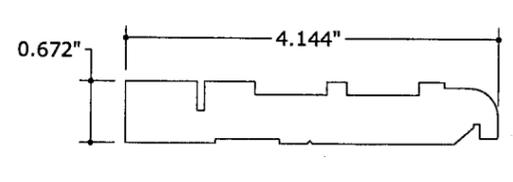


2 JAMB
6" = 1'-0" WOOD

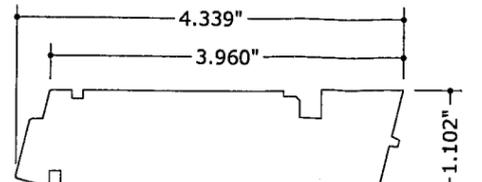


3 WOOD SILL
6" = 1'-0" WOOD

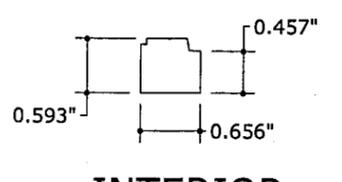


4 INTERIOR SIDE STOP
6" = 1'-0" WOOD

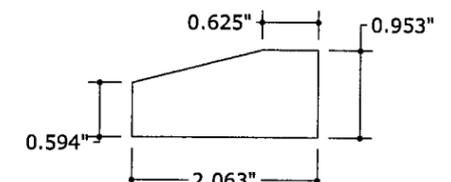


5 SILL SUPPORT
6" = 1'-0" WOOD




6 INTERIOR GLAZED STILE
6" = 1'-0" WOOD

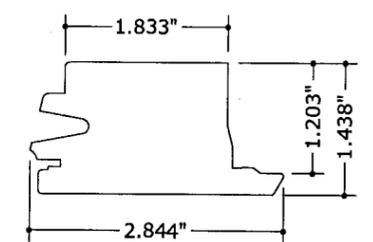


7 BOTTOM RAIL
6" = 1'-0" WOOD




8 INTERIOR GLAZED TOP RAIL
6" = 1'-0" WOOD




9 SILL STOP
6" = 1'-0" WOOD

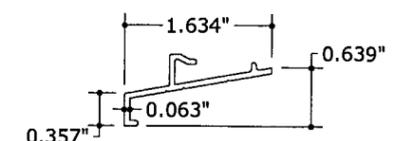


10 EXTRUDED SILL NOSE
6" = 1'-0" 6063-T5




11 INTERIOR GLAZED GLASS STOP
6" = 1'-0" WOOD

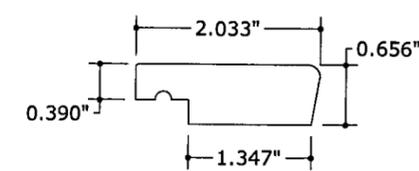


12 STOOL
6" = 1'-0" WOOD

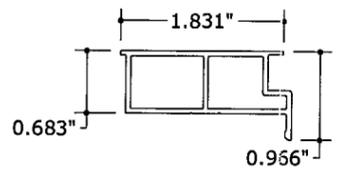

13 EXTERIOR SASH STOP
6" = 1'-0" VIEW

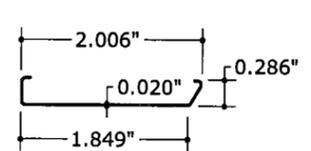


14 SASH CLADDING
6" = 1'-0" ALUM




15 CASEMENT BLOCK
6" = 1'-0" PVC

BILL OF MATERIALS

ITEM	PART #	DESCRIPTION	MATERIAL	REMARKS
1	WF0198HJ	HEAD JAMB	WOOD	PRESSURE TREATED AURALAST®
2	WF0223SJ	SIDE JAMB	WOOD	PRESSURE TREATED AURALAST®
3	WF0227SL	WOOD SILL	WOOD	PRESSURE TREATED AURALAST®
4	WF0366SP	INTERIOR SIDE STOP	WOOD	PRESSURE TREATED AURALAST®
5	WF0299MS	SILL SUPPORT	WOOD	PRESSURE TREATED AURALAST®
6	WF0254ST	INTERIOR GLAZED STILE	WOOD	PRESSURE TREATED AURALAST®
7	WF0357RA	BOTTOM RAIL	WOOD	PRESSURE TREATED AURALAST®
8	WF0339RA	INTERIOR GLAZED TOP RAIL	WOOD	PRESSURE TREATED AURALAST®
9	WF0363SP	SILL STOP	WOOD	PRESSURE TREATED AURALAST®
10	AC-909	EXTRUDED SILL NOSE	6063-T5	
11	WF0378SP	INTERIOR GLAZED GLASS STOP	WOOD	PRESSURE TREATED AURALAST®
12	WF0293MS	STOOL	WOOD	PRESSURE TREATED AURALAST®
13	-	EXTERIOR SASH STOP	ALUM	
14	-	SASH CLADDING	ALUM	ROLL FORMED BY INTEK
15	10210A	CASEMENT BLOCK	PVC	
16	JCD-300	HEAD JAMB CLADDING	6063-T5	
17	JCD-302	SILL CLADDING	6063-T5	
18	V01899	SILL LINER	PVC	BY INTEK
19	12094	FOAM FILLED BULB WEATHERSTRIP	PVC	BY AMESBURY
20	899	SILICONE SEALANT	SILICONE	BY DOW CORNING

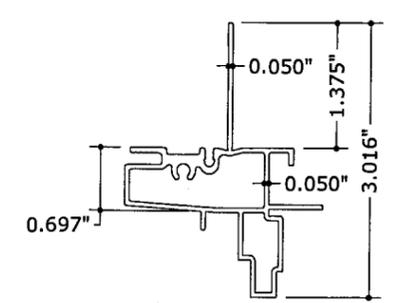

16 HEAD & JAMB CLADDING
6" = 1'-0" 6063-T5

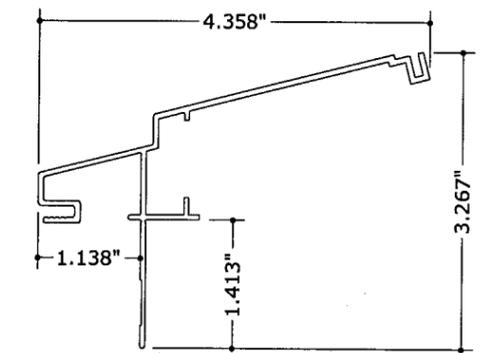

17 SILL CLADDING
6" = 1'-0" 6063-T5

Approved as complying with the Florida Building Code
Date 09/18/2008
NOA# 68-0402.01
Miami Dade Product Control Division
By *Manuel Perez*

F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0013 Custom Wood - Double Hung, Fixed, LMI (NOA).dwg
08/18/2008 - 4:47pm keith