



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339**

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

**Jeld-Wen, Inc. (OR)
3737 Lakeport Blvd.
Klamath Falls, OR 97601**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Custom Collection" Aluminum Clad Wood Awning Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **07-JWN-0011**, titled "Custom Collection Awning Window – Large Missile Impact Resistant", sheets 1 through 8 of 8, dated 03/14/08, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 08-0402.02
Expiration Date: September 18, 2013
Approval Date: September 18, 2008
Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **07-JWN-0011**, Sheets 1 through 8 of 8, titled "Custom Collection Awning Window – Large Missile Impact Resistant", dated 03/14/08, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS

1. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with marked-up drawings and installation diagram of custom collection aluminum clad wood awning window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3439-1**, dated 08/07/07, signed and sealed by Gerard J. Ferrara, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Engineering Express, dated 03/03/08, signed and sealed by Frank L. Bennardo, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont SentryGlas ® Plus**" dated 01/03/08, expiring on 01/14/12.

F. STATEMENTS

1. Statement letter of conformance, dated March 18, 2008, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of no financial interest, dated March 18, 2008, signed and sealed by Frank L. Bennardo, P.E.
3. Laboratory compliance letter for Test Report No. **NCTL- 210-3439-1**, issued by National Certified Testing Laboratories, dated 09/06/07, signed and sealed by Gerard J. Ferrara, P.E.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-0462-02
Expiration Date: September 18, 2013
Approval Date: September 18, 2008

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

4. Addendum letter of Acrylic Sealant for Test Report No. **NCTL- 210-3439-1**, issued by National Certified Testing Laboratories, dated June 25, 2008, signed and sealed by Gerard J. Ferrara, P.E.
5. Addendum letter of the Silicone Sealant for Test Report No. **NCTL- 210-3439-1**, issued by National Certified Testing Laboratories, dated July 01, 2008, signed and sealed by Harold E. Rupp, P.E.

G. OTHERS

1. None.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-0402.02
Expiration Date: September 18, 2013
Approval Date: September 18, 2008

CUSTOM COLLECTION AWNING WINDOW

LARGE MISSILE IMPACT RESISTANT

FRANK L. BENNARDO, P.E.
PE0046549

08/18/2008

ENGINEERING EXPRESS

160 SW 12th Avenue, #106
Deerfield Beach, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM

CERT OF AUTH #9885
A. FRANK L. BENNARDO, P.E., INC. INNOVATION


JELD-WEN

3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION AWNING WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE WITH 2006 SUPPLEMENTS AND THE 2007 FLORIDA BUILDING CODE, FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201 / 202 / 203 & ASTM E1300-02 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
5. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
6. ALL WOOD COMPONENTS OF THIS PRODUCT SHALL BE PRESSURE TREATED WESTERN PINE OR WESTERN WOODS WITH G=0.36 OR GREATER DENSITY, UNLESS NOTED OTHERWISE.
7. UNITS GLAZED AS SHOWN HEREIN ARE LARGE MISSILE IMPACT RESISTANT AND DO NOT REQUIRE IMPACT RESISTANT SHUTTERS.
8. PLASTIC COMPONENTS USED WITHIN THE HVHZ MUST MEET ALL APPLICABLE FIRE/SMOKE/UV PERFORMANCE REQUIREMENTS AS SET FORTH IN THE ABOVE-NOTED BUILDING CODE.
9. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.

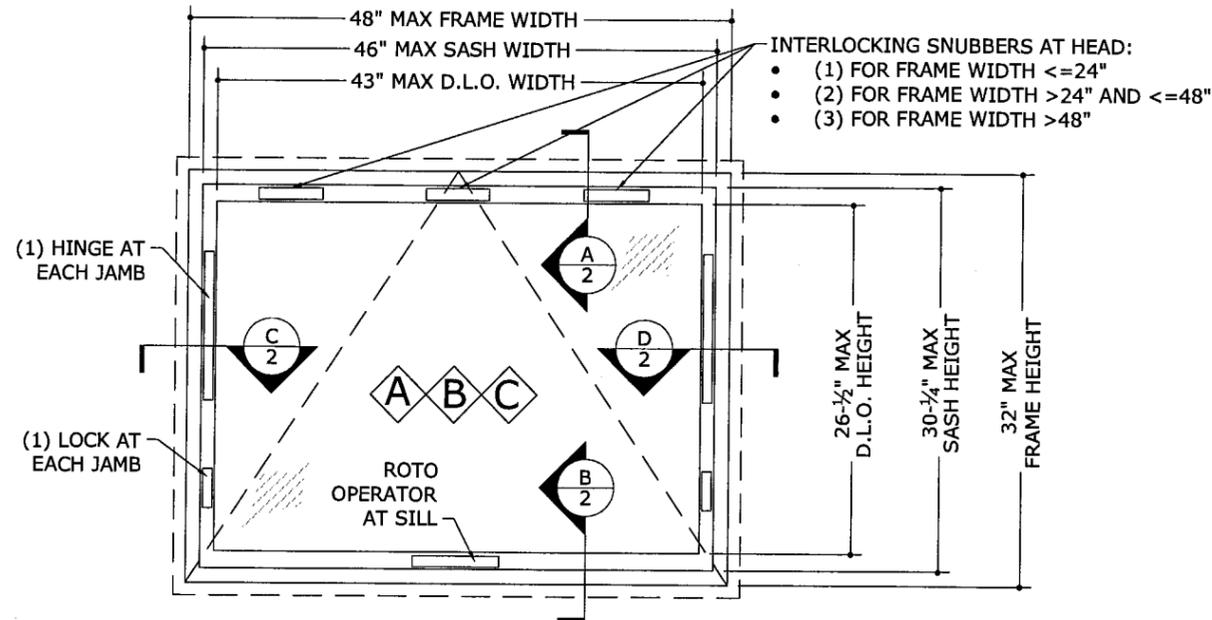

NOTE: MAXIMUM FRAME DIMENSIONS
DO NOT INCLUDE INTEGRAL NAILING FIN.

1 TYPICAL ELEVATION
1 N.T.S. EXTERIOR VIEW

**MAXIMUM ALLOWABLE
DESIGN PRESSURE: +65/-75**

REMARKS	DRWN/CHKD		DATE
	RKB	CL	
INIT ISSUE			03/14/08



07-JWN-0011
SCALE: 01
PAGE DESCRIPTION:

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 08-0402.02
Miami Dade Product Control
Division
By *Manuel Perez*

1

08/18/2008

A TYPICAL HEAD ASSEMBLY
2 N.T.S. VERT SECTION

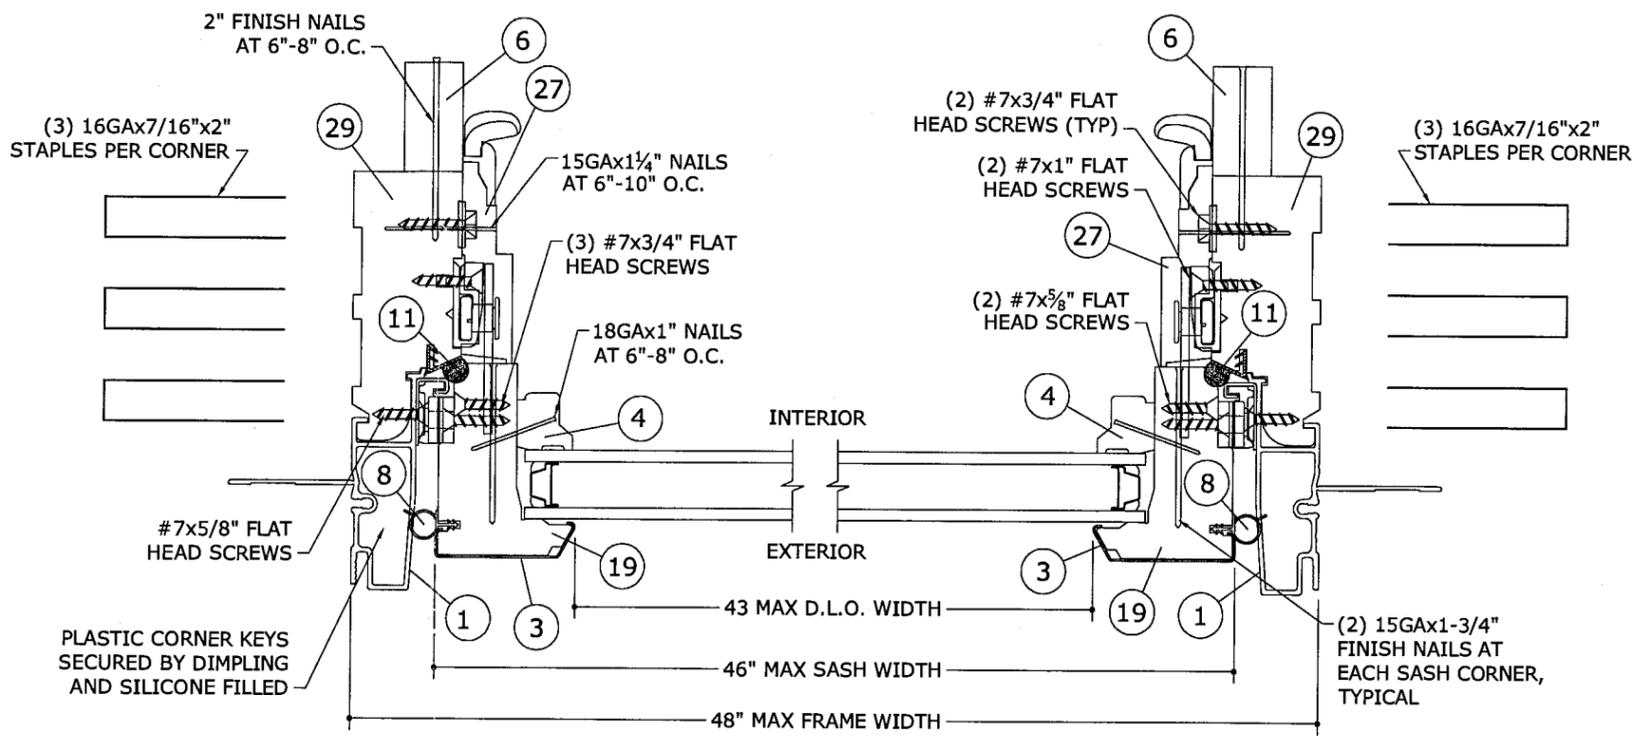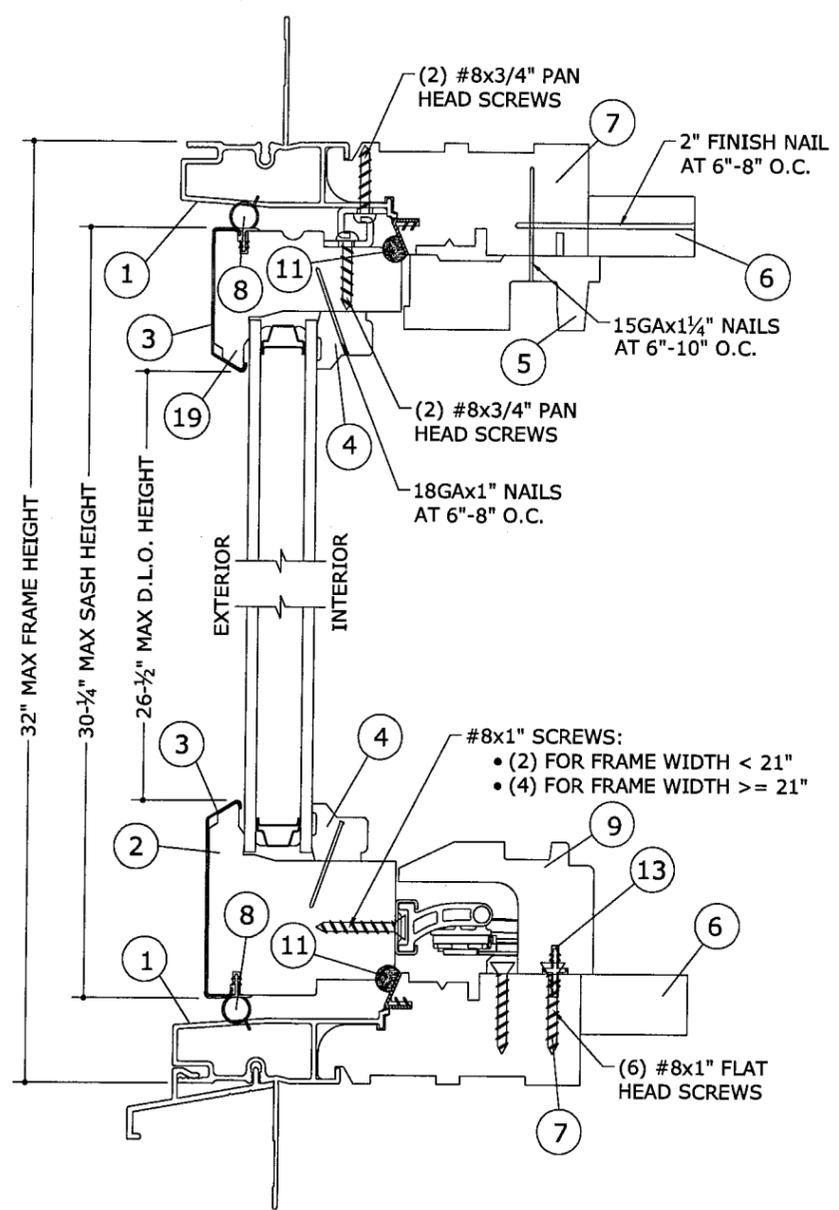


C TYPICAL JAMB ASSEMBLY
2 N.T.S. HORIZ SECTION

D TYPICAL JAMB ASSEMBLY
2 N.T.S. HORIZ SECTION

B TYPICAL SILL ASSEMBLY
2 N.T.S. VERT SECTION


GLAZING TYPE A

1" INSULATED LAMINATED, LMI
NOT FOR USE ABOVE 30' ABOVE GRADE

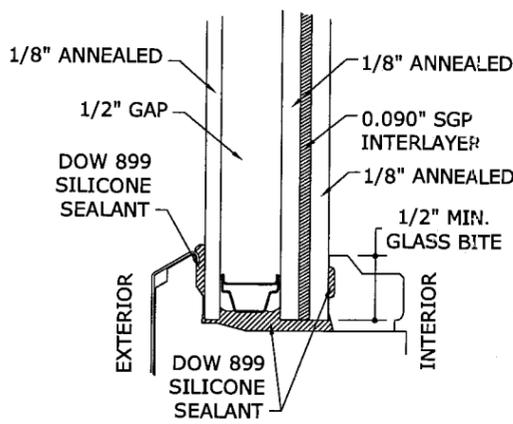


GLAZING TYPE B

1" INSULATED LAMINATED, LMI
FOR USE AT ANY HEIGHT ABOVE GRADE

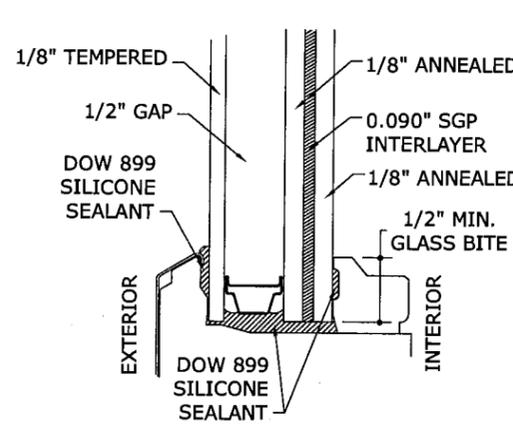

GLAZING TYPE C

5/16" LAMINATED, LMI
FOR USE AT ANY HEIGHT ABOVE GRADE

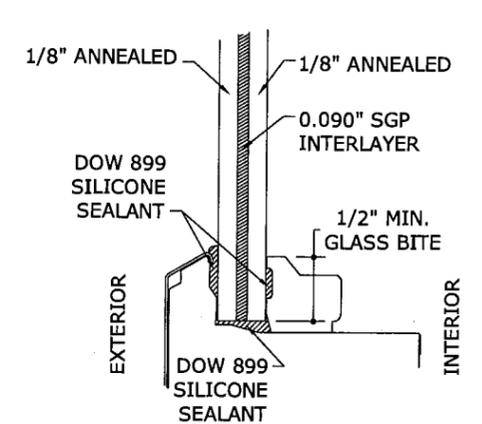

1 GLAZING DETAILS
2 N.T.S. VERT SECTION

Approved as complying with the Florida Building Code
 Date 09/18/2008
 NOA# 08-0402.02
 Miami Dade Product Control
 Drawn By *Manuel Perez*

ENGINEERING EXPRESS
 160 SW 12th AVENUE, # 106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0443
 WWW.ENGEXP.COM
 CERT OF AUTH #9885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION


JELD-WEN
 3737 LAKEPORT BOULEVARD
 KLAMATH FALLS, OREGON 97601
 PHONE: (541) 850 - 2606
 CUSTOM COLLECTION AWNING WINDOW
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

DATE	DRWN	CHKD	DATE
03/14/09 <td>FRKB</td> <td>CL</td> <td></td>	FRKB	CL	


07-JWN-0011
 SCALE: 1/8" = 1'-0"
 PAGE DESCRIPTION:

F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0011 Custom Wood - Clad Awning, LMI (NOA)\07-JWN-0011_01g Custom Wood - Clad Awning, LMI (NOA).dwg
 08/18/2008 - 4:07pm
 keith


08/18/2008 - 4:01pm keithl F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0011 Custom Wood - Clad Awning, LMI (NOA).dwg

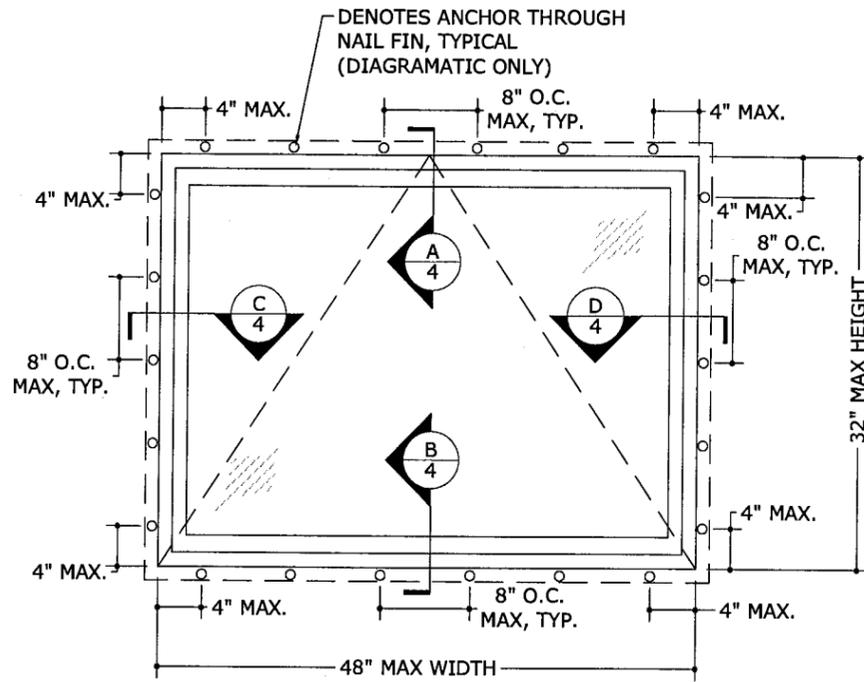

1
ANCHOR ELEVATION FOR INSTALLATION WITH NAIL FIN
3 N.T.S. EXTERIOR VIEW

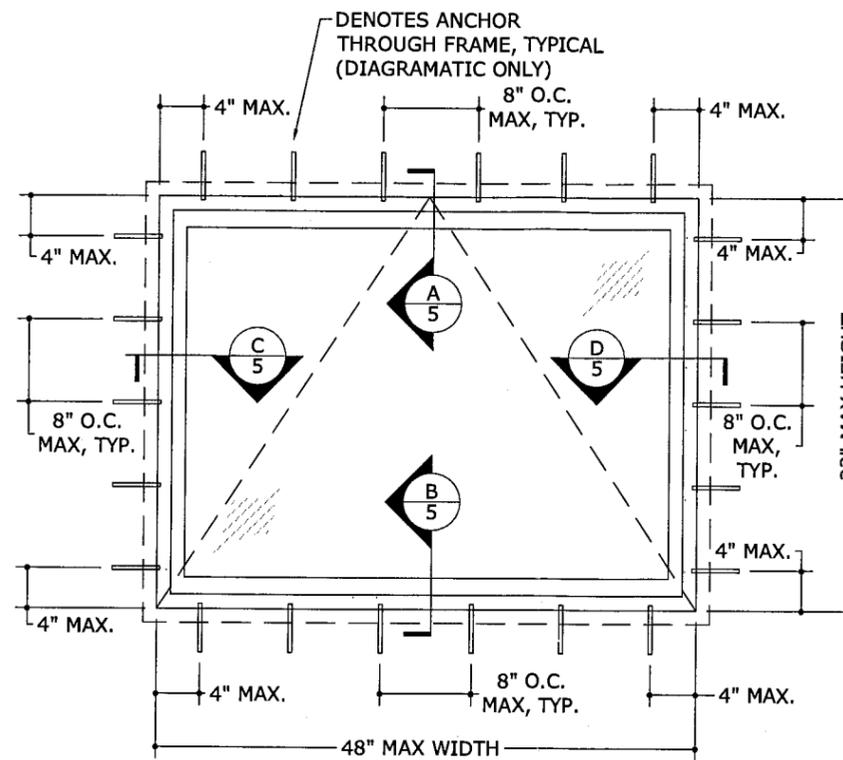

2
ANCHOR ELEVATION FOR INSTALLATION THROUGH FRAME
3 N.T.S. EXTERIOR VIEW

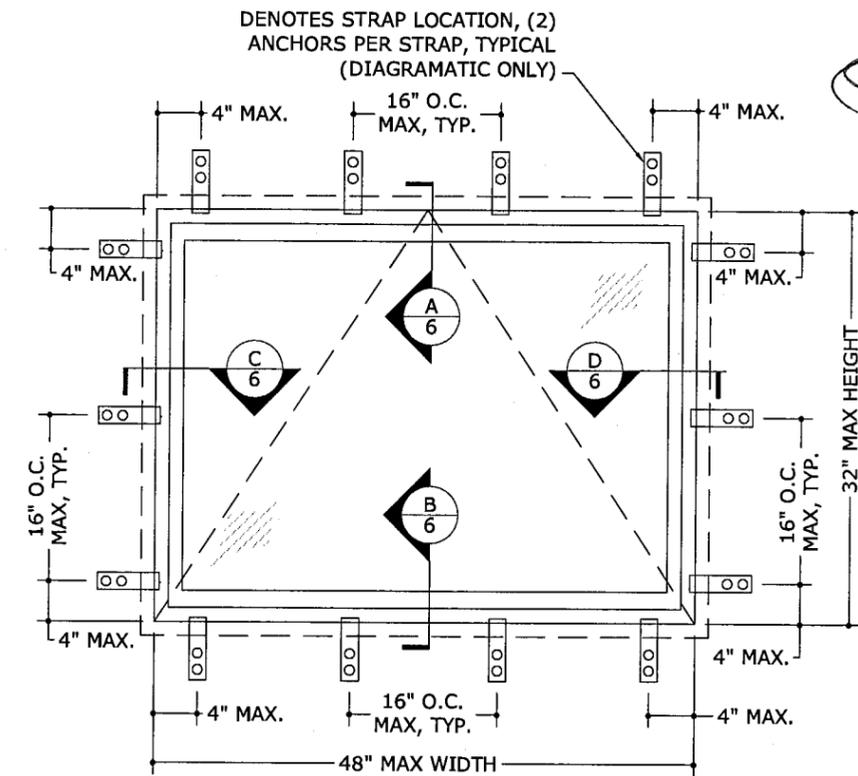

3
ANCHOR ELEVATION FOR INSTALLATION WITH STRAP
3 N.T.S. EXTERIOR VIEW

ANCHOR SCHEDULE:

TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:

- 1/4" TAPCONS (ITW) THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY / CONCRETE WITH 1-3/4" MIN. EMBEDMENT.

TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):

- 1/4" TAPCONS (ITW) WITH 1-1/2" MIN. THREAD PENETRATION.
- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION.
- 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION.

ANCHOR NOTES:

1. SEE ANCHOR ELEVATIONS FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. TAPCONS SHALL BE MANUFACTURED BY ITW.
4. ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS INTO CONCRETE AND INTO HOLLOW BLOCK.
5. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
6. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
7. MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
8. ANCHOR SCHEDULE APPLIES TO ALL PRODUCTS CERTIFIED HEREIN.
9. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
11. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

Approved as complying with
Florida Building Code
Date 09/18/2008
NOA# 08-0402.02
Miami Dade Product Control
Division
By Mauro Perez

FRANK L. BENNARDO, P.E.
PE0046549

08/18/2008

JELD-WEN ENGINEERING EXPRESS

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION AWNING WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	RKB	CL	03/14/08

07-JWN-0011

SCALE: **1/8" = 1'-0"**

PAGE DESCRIPTION:

3

08/18/2008

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION


JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606
CUSTOM COLLECTION AWNING WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
RKB	CL	03/14/08

07-JWN-0011
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION:
4


A
INSTALLATION WITH FIN AT FRAME HEAD

4 N.T.S. VERT SECTION

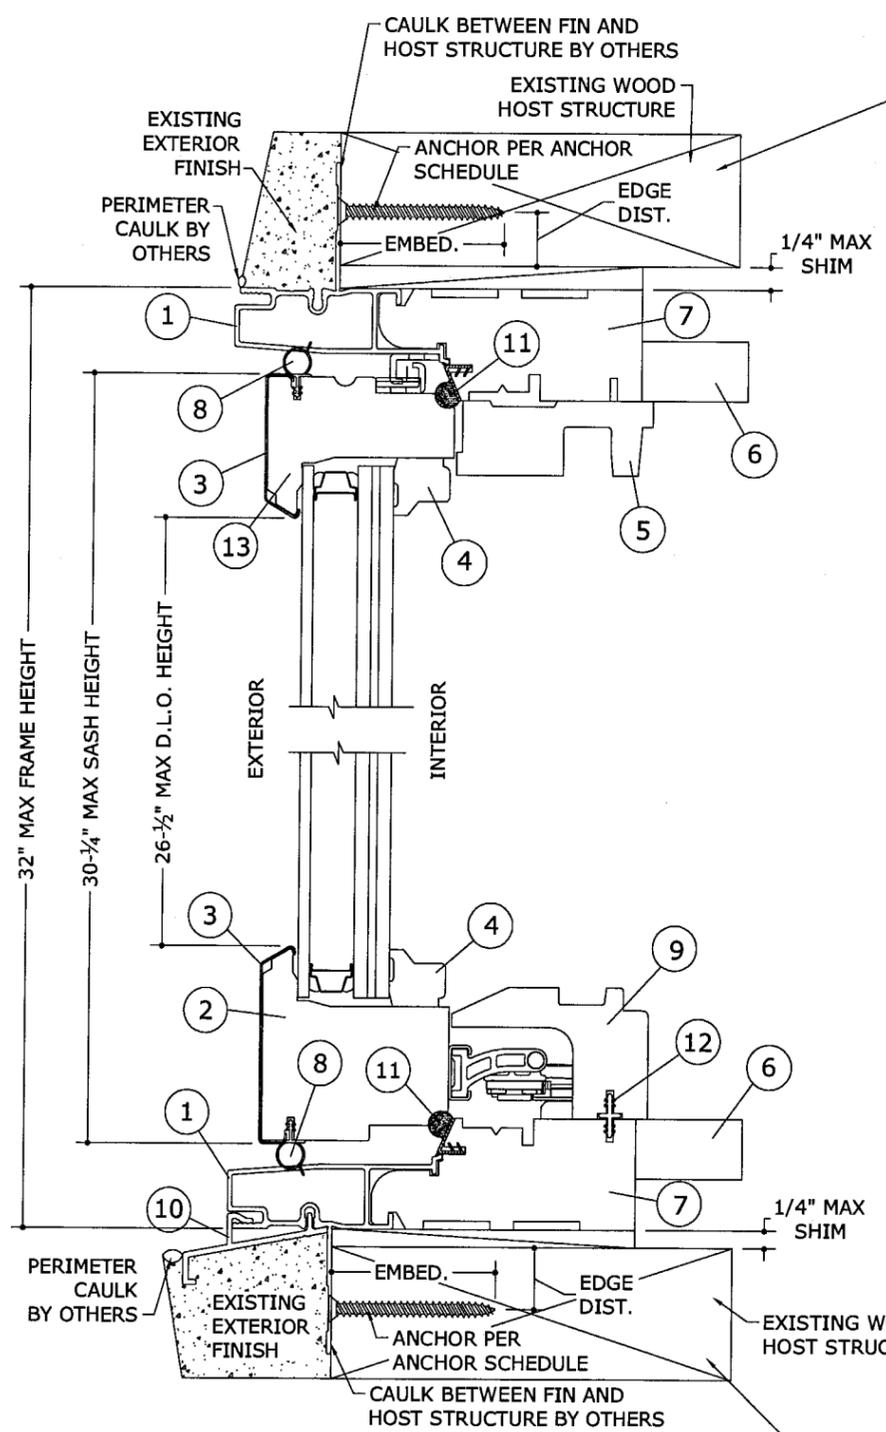

NOTE: NAIL FIN INSTALLATION REQUIRES MINIMUM 2X OR GREATER PRESSURE TREATED WOOD BUCK (BY OTHERS) IN CONCRETE AND MASONRY HOST STRUCTURE.

NOTE: NAIL FIN INSTALLATION REQUIRES MINIMUM 2X OR GREATER PRESSURE TREATED WOOD BUCK (BY OTHERS) IN CONCRETE AND MASONRY HOST STRUCTURE.

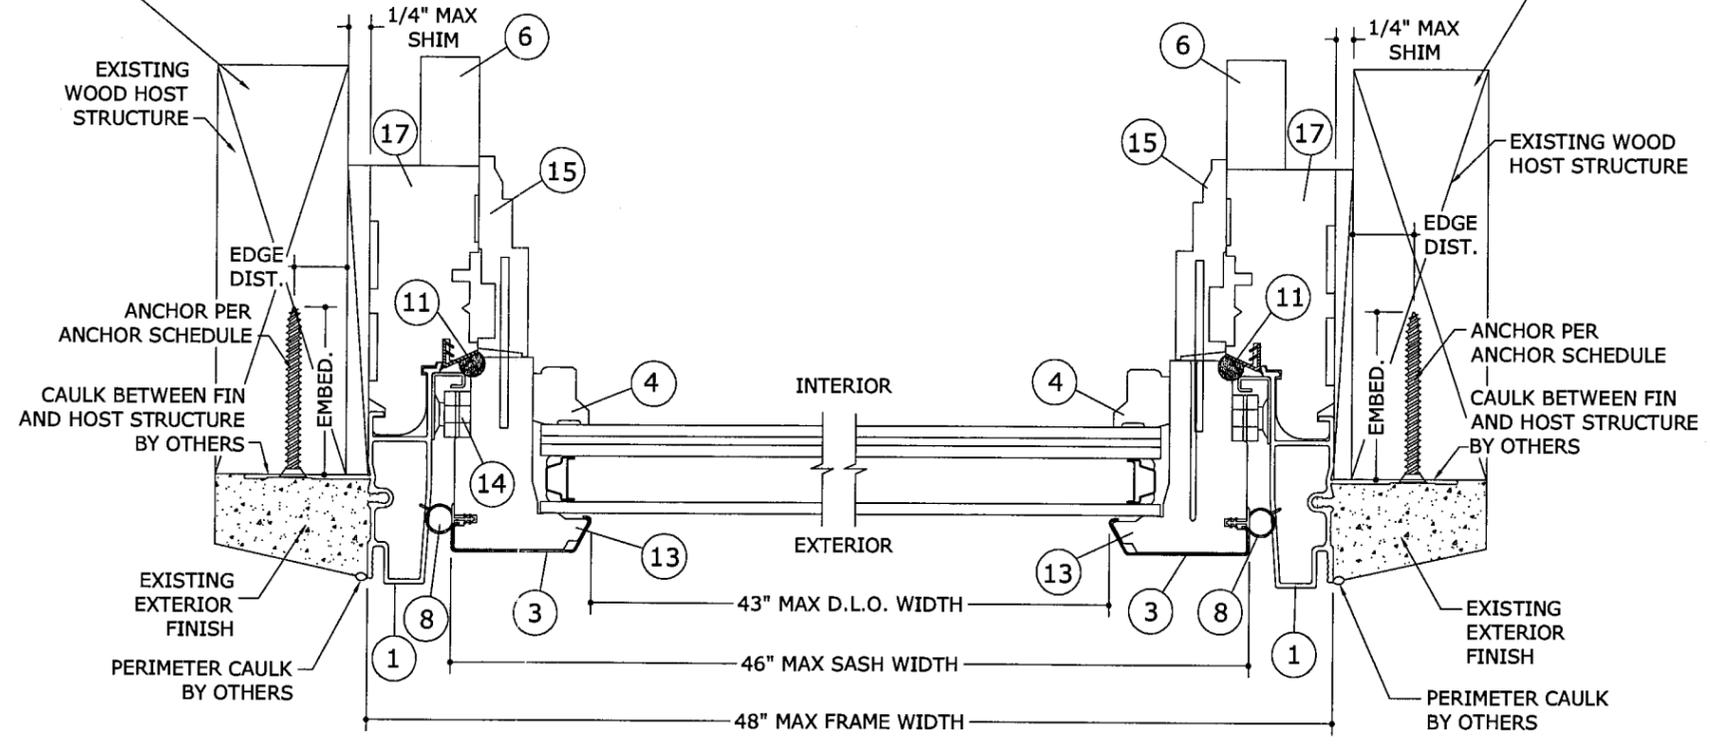

C
INSTALLATION WITH FIN AT FRAME JAMB
4 N.T.S. HORIZ SECTION

D
INSTALLATION WITH FIN AT FRAME JAMB
4 N.T.S. HORIZ SECTION

NOTE: SEE ANCHOR SCHEDULE AND ANCHOR NOTES FOR REQUIRED EDGE DISTANCES AND EMBEDMENTS.

B
INSTALLATION WITH FIN AT FRAME SILL

4 N.T.S. VERT SECTION

NOTE: NAIL FIN INSTALLATION REQUIRES MINIMUM 2X OR GREATER PRESSURE TREATED WOOD BUCK (BY OTHERS) IN CONCRETE AND MASONRY HOST STRUCTURE.



Approved as complying with the Florida Building Code
Date 09/18/2008
NOA# 08-0902.02
Miami Dade Product Control
Division
By *Manuel*

F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0011 Custom Wood - Clad Awning, LMI (NOA).dwg

08/18/2008 - 4:01pm keith

INSTALLATION THROUGH FRAME HEAD

A
5 N.T.S. VERT SECTION

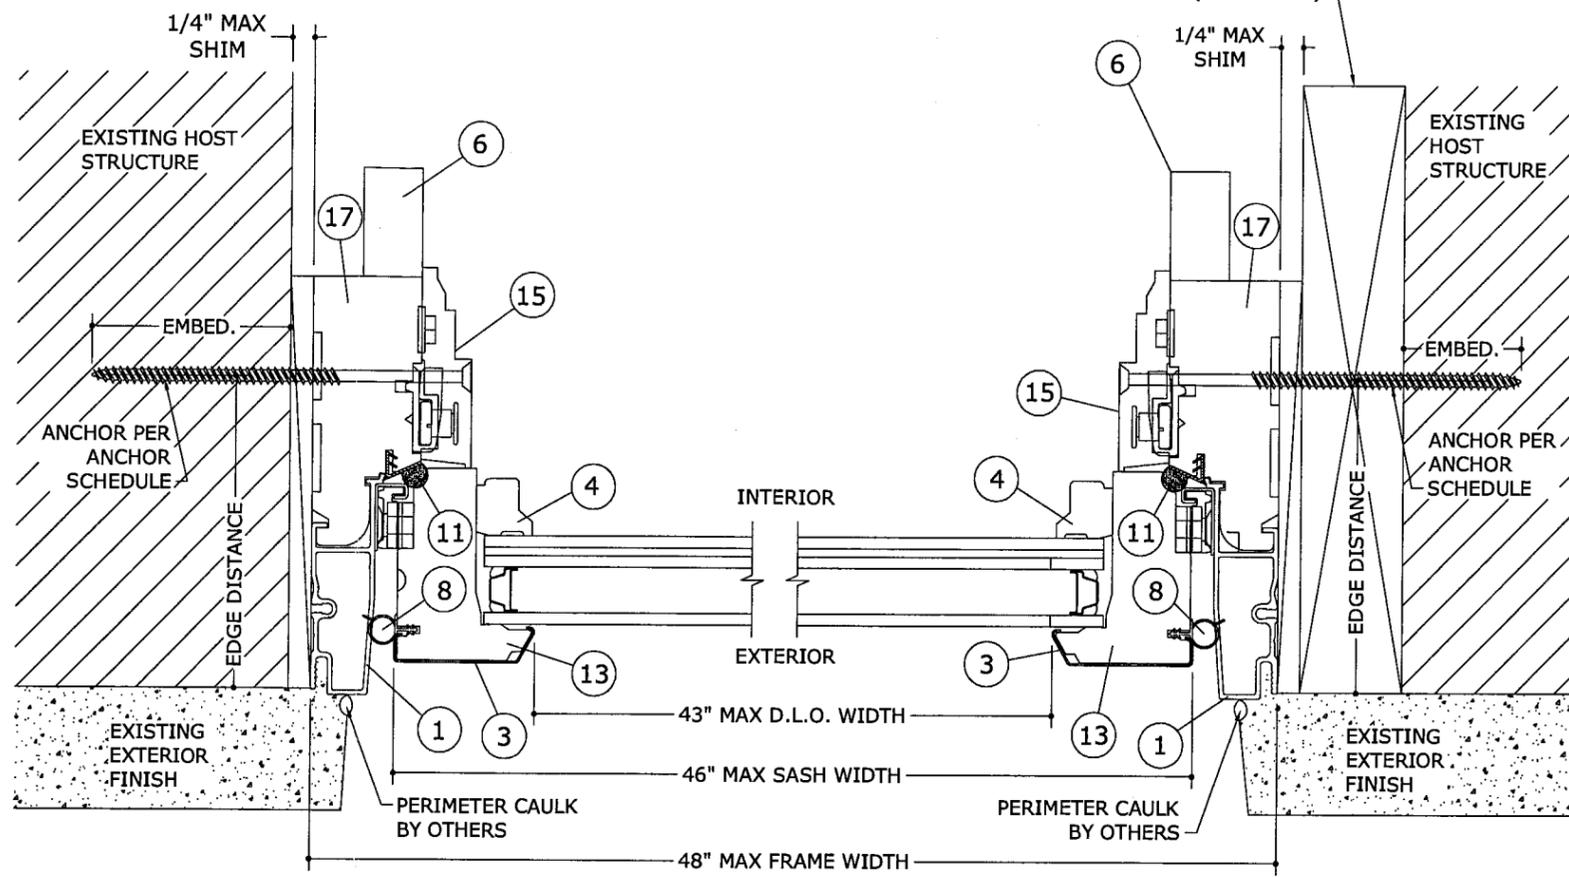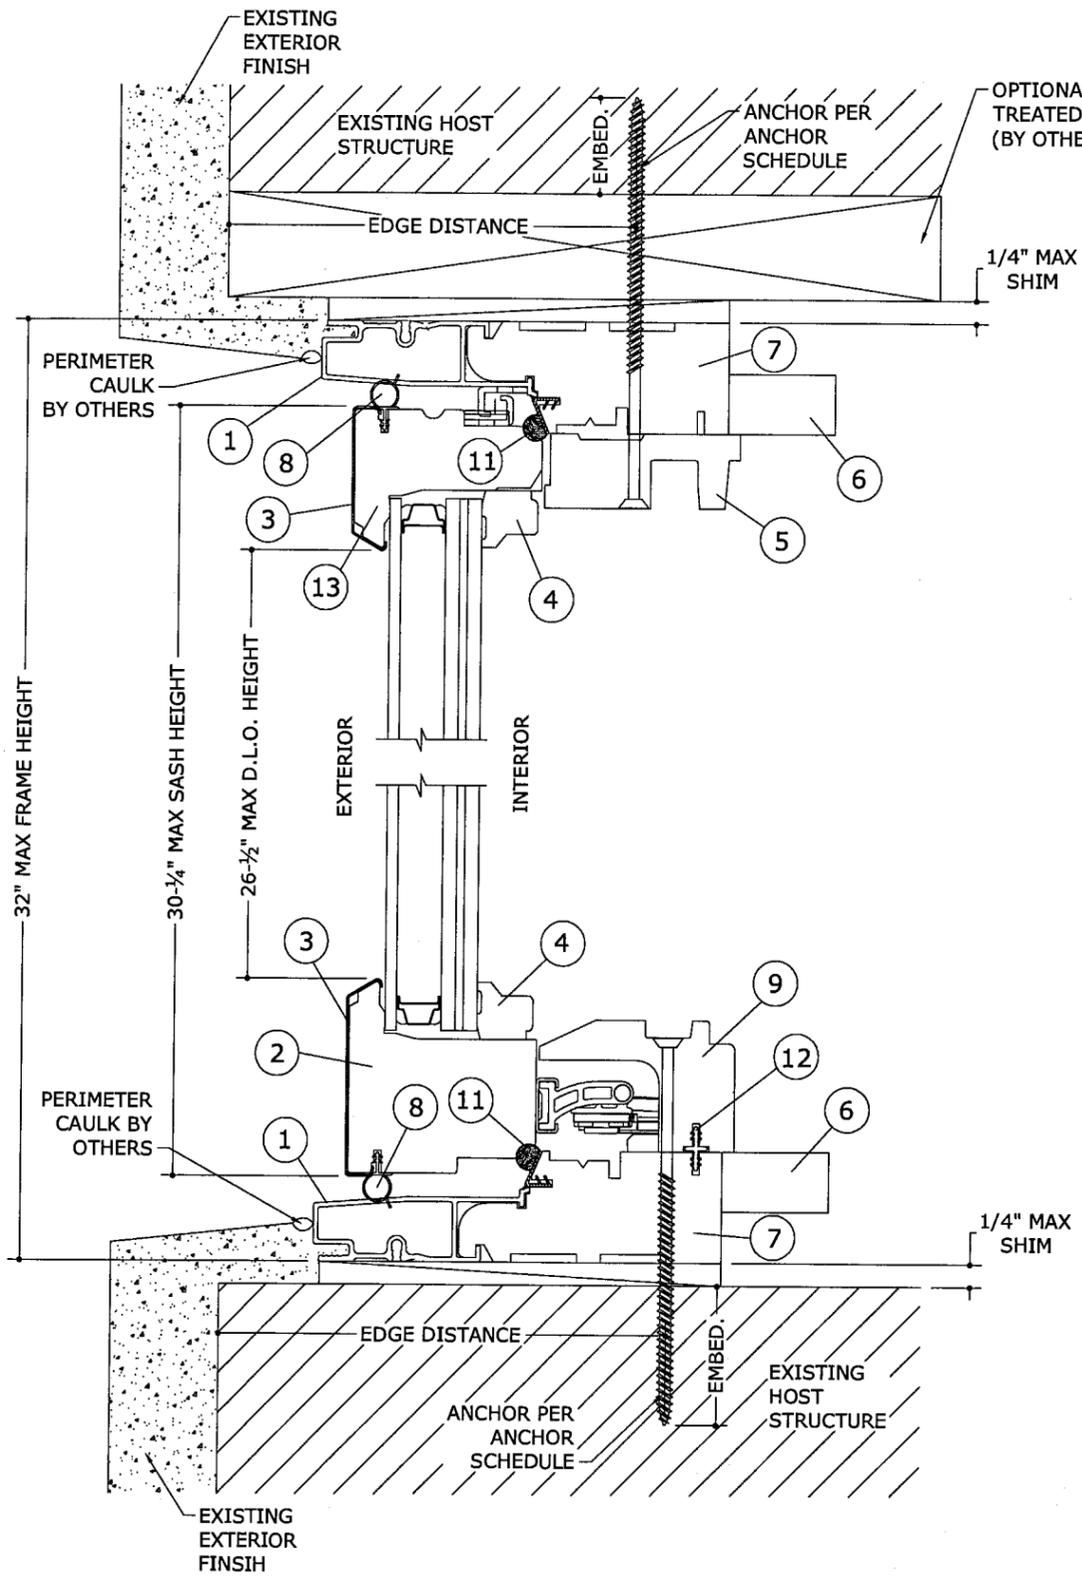


B
5 N.T.S. VERT SECTION



INSTALLATION THROUGH FRAME JAMB

C
5 N.T.S. HORIZ SECTION

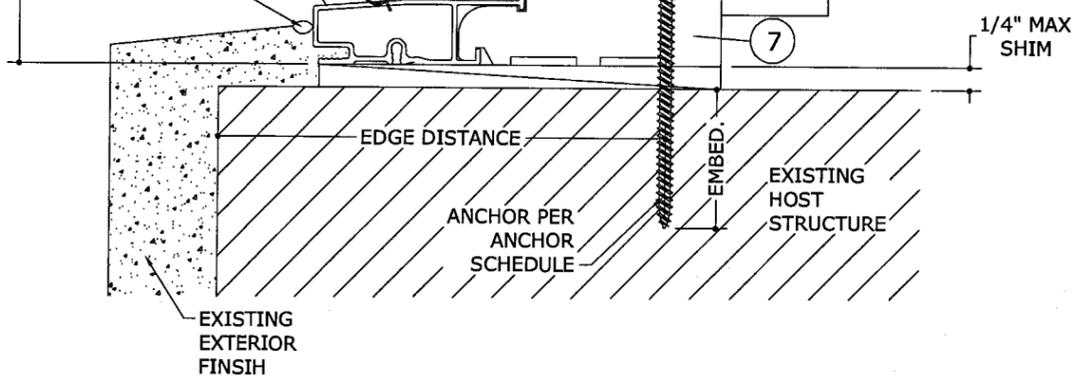

INSTALLATION THROUGH FRAME JAMB

D
5 N.T.S. HORIZ SECTION

NOTE: SEE ANCHOR SCHEDULE AND ANCHOR NOTES FOR REQUIRED EDGE DISTANCES AND EMBEDMENTS.

08/18/2008



160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION



3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606
CUSTOM COLLECTION AWNING WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
RKB	CL	03/14/08

07-JWN-0011
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION:

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 08-0402.02
Miami Dade Product Control
Division
By *Manuel Perez*


5

F:\01 Project Files\Jeld-Wen (JWN)\2007\07-JWN-0011 Custom Wood - Clad Awning, LMI (NOA).dwg
08/18/2008 - 4:01pm
keithl

INSTALLATION WITH STRAP AT FRAME HEAD

A
6



N.T.S. VERT SECTION

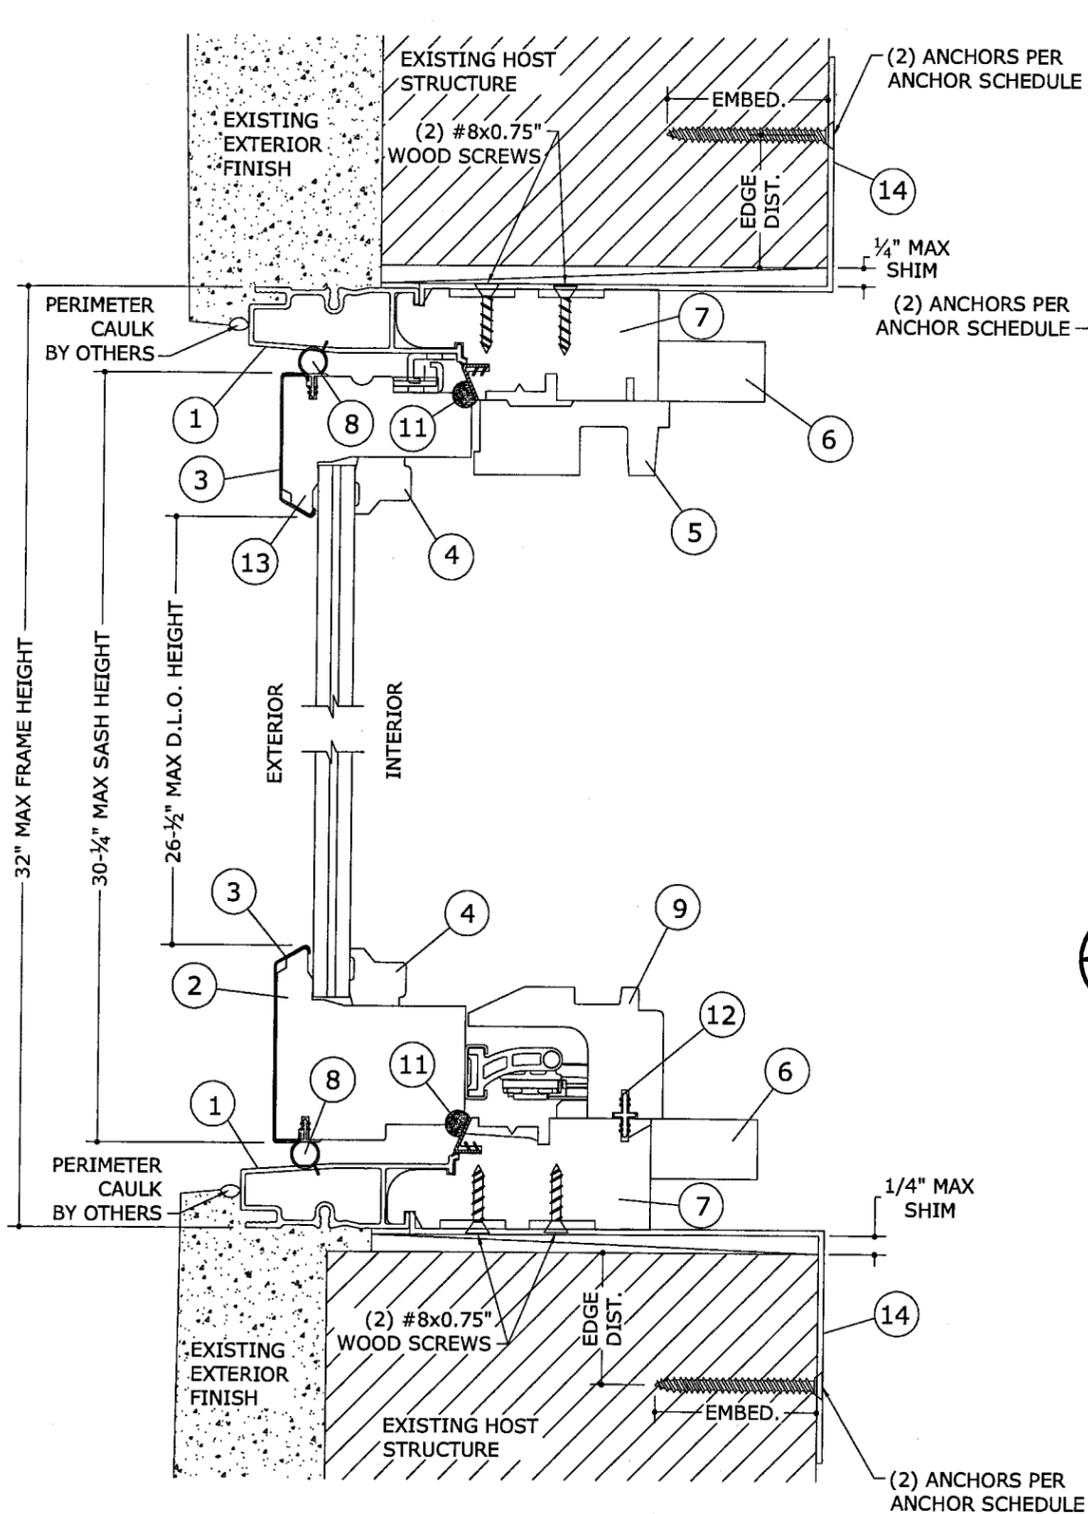

INSTALLATION WITH STRAP AT FRAME SILL

B
6


N.T.S. VERT SECTION

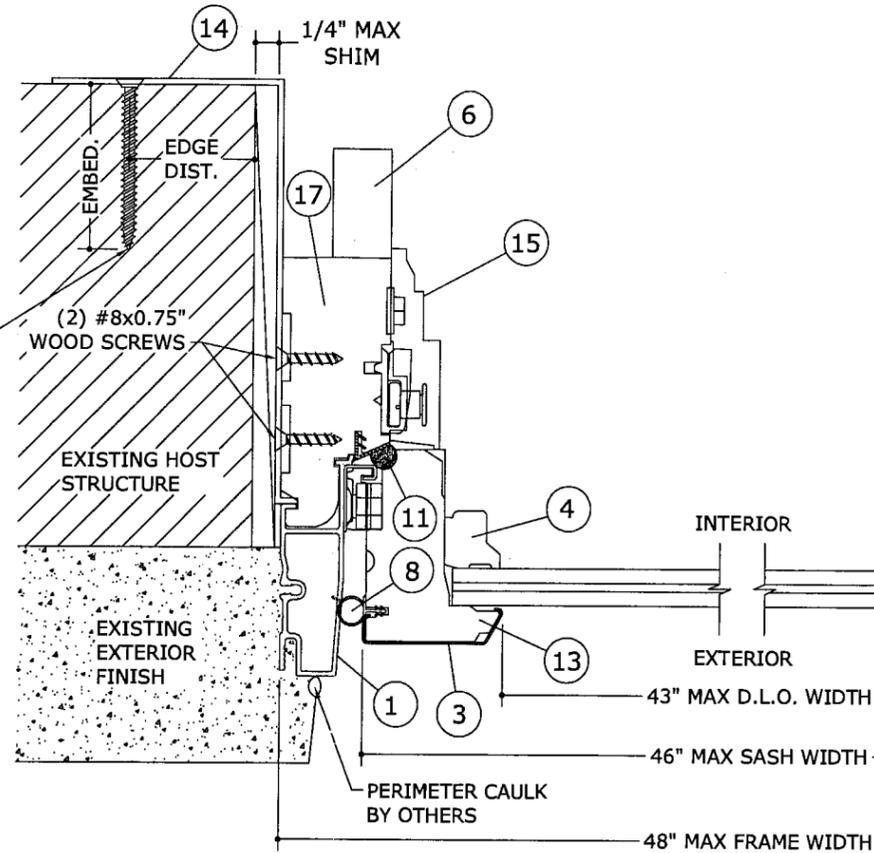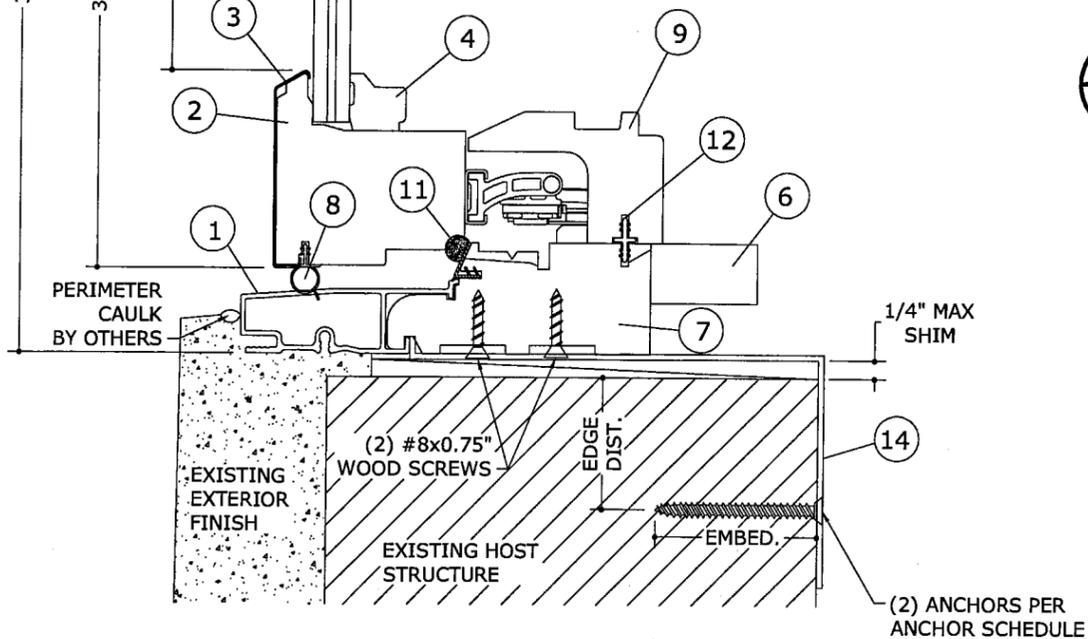

INSTALLATION WITH STRAP AT FRAME JAMB

C
6

N.T.S. HORIZ SECTION

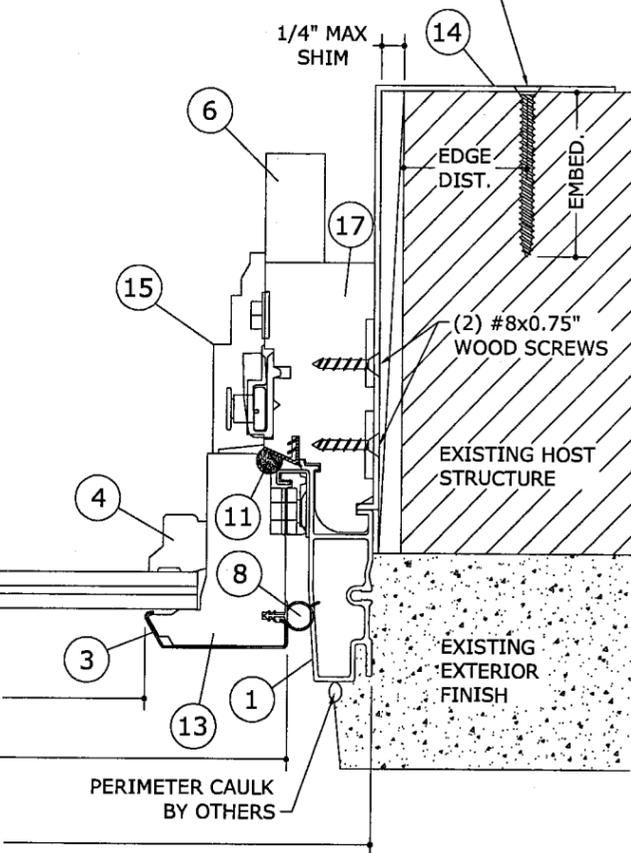

INSTALLATION WITH STRAP AT FRAME JAMB

D
6

N.T.S. HORIZ SECTION

NOTE: SEE ANCHOR SCHEDULE AND ANCHOR NOTES FOR REQUIRED EDGE DISTANCES AND EMBEDMENTS.

FRANK L. BENNARDO, P.E.
PE0046549

08/18/2008

JELD-WEN
ENGINEERING EXPRESS

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION AWNING WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
RKB	CL	03/14/08

07-JWN-0011
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION: 01

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 08-0402.02
Miami Dade Product Control
Division
By *Manuel Perez*

07


08/18/2008



160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION AWNING WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

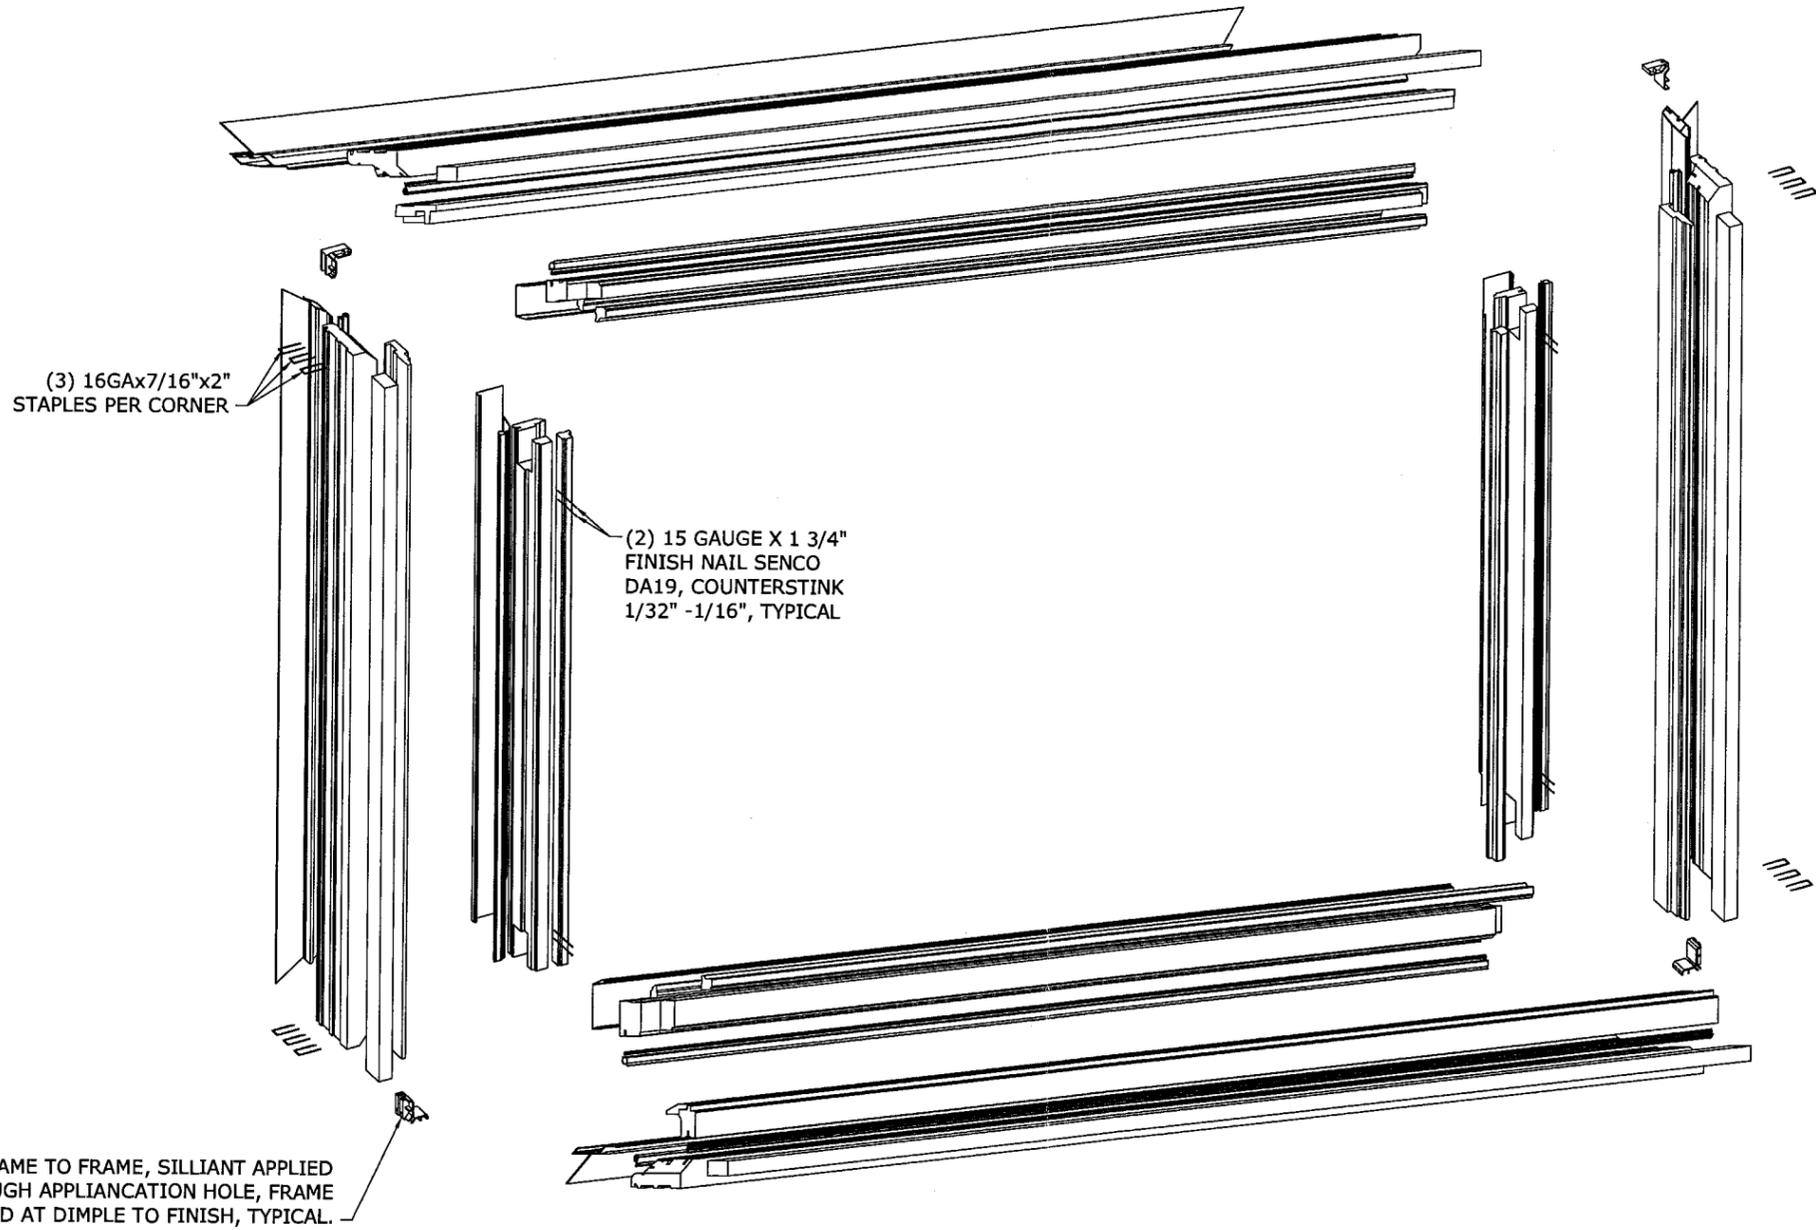

1 ASSEMBLY DETAIL
7 N.T.S. ISOMETRIC

REMARKS	DRWN/CHKD		DATE
	RKB	CL	
INIT ISSUE	-	-	03/14/08
	-	-	-
	-	-	-
	-	-	-

07-JWN-0011
SCALE: 01

PAGE DESCRIPTION:

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 08-0402.02
Miami Dade Product Control
Division
By *Manuel Perez*

08/18/2008

ENGINEERING EXPRESS

160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN


3737 LAKEPORT BOULEVARD
KLAMATH FALLS, OREGON 97601
PHONE: (541) 850 - 2606

CUSTOM COLLECTION AWNING WINDOW
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
RKB	CL	03/14/08


07-JWN-0011
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION:

8

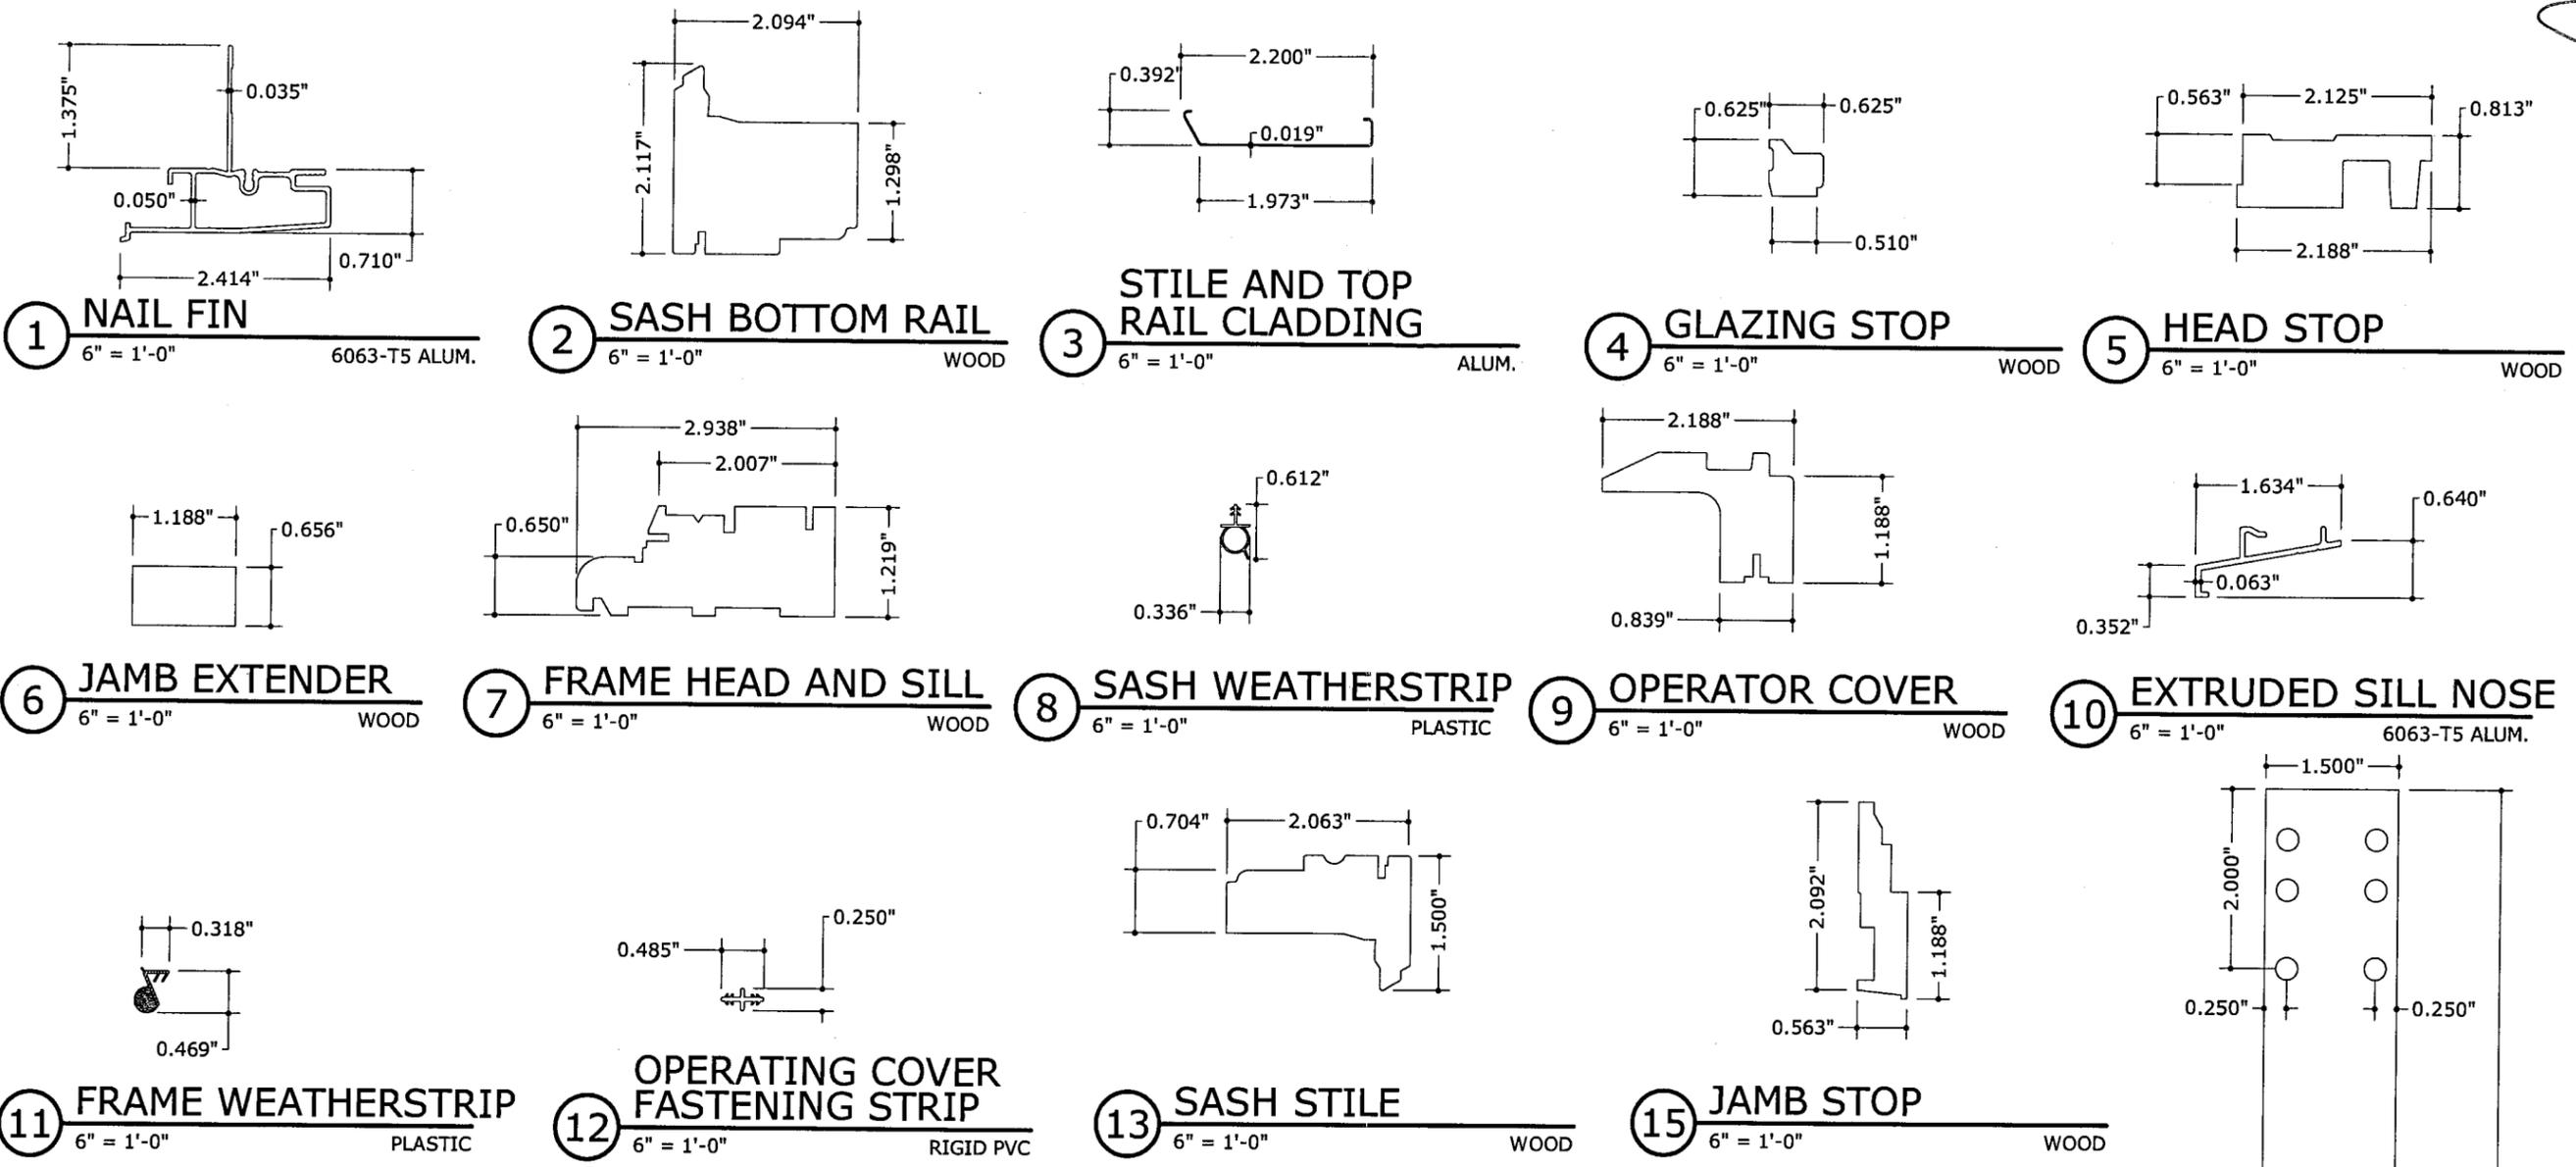

BILL OF MATERIALS

ITEM	PART #	DESCRIPTION	MATERIAL	REMARKS
1	AC-500	NAIL FIN	6063-T5	
2	CA0148RA	SASH BOTTOM RAIL	WOOD	PRESSURE TREATED AURALAST®
3	-	STILE AND TOP RAIL CLADDING	ALUMINUM	ROLL FORMED
4	CA0278SP	GLAZING STOP	WOOD	PRESSURE TREATED AURALAST®
5	CA0282SP	HEAD STOP	WOOD	PRESSURE TREATED AURALAST®
6	CA260AJE	JAMB EXTENDER	WOOD	PRESSURE TREATED AURALAST®
7	CA0151HJ	FRAME HEAD & SILL	WOOD	PRESSURE TREATED AURALAST®
8	50468A	SASH WEATHERSTRIP	PVC	BY INTEK
9	CA01420C	OPERATOR COVER	WOOD	PRESSURE TREATED AURALAST®
10	AC-909	EXTRUDED SILL NOSE	6063-T5	
11	12261	FRAME WEATHERSTRIP	PVC	BY AMESBURY
12	30263B	OPERATING COVER FASTENING STRIP	PVC	BY INTEK
13	CA0147RA	SASH STILE	WOOD	PRESSURE TREATED AURALAST®
14	-	GALVANIZED INSTALLATION STRAP	STEEL	13 GA
15	-	JAMB STOP	WOOD	PRESSURE TREATED AURALAST®
16	899	SILICONE SEALANT	SILICONE	BY DOW CORNING
17	CA0174SJ	FRAME JAMB	WOOD	PRESSURE TREATED AURALAST®

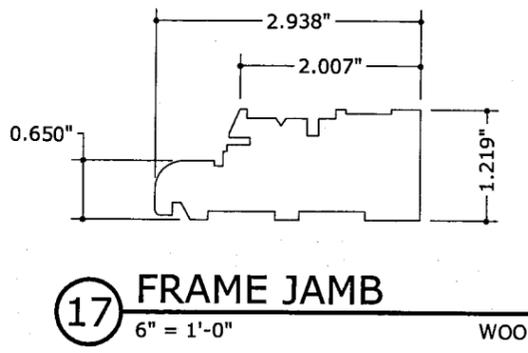

Approved as complying with the
Florida Building Code
Date 09/18/2008
NOA# 08-0402.02
Miami Dade Product Control
Division
By *Manuel Perez*

