



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

www.buldingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

TRACO Security Windows and Doors, Inc.
71 Progress Avenue
Cranberry Township, PA 16066

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 2100 Aluminum Fixed Window – N.I.

APPROVAL DOCUMENT: Drawing No. **04-113-0003**, titled "Series 2100 Aluminum Fixed Window - Non-Impact Resistant", sheets 1 through 3 of 3, dated 05/03/04 with revision dated 07/17/08, prepared by Engineer Express, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None.

LIMITATIONS: Miami-Dade County Product Control Approved Shutters Are Required.

LABELING: Each unit shall bear a permanent label with the manufacturer's name:

TRACO
71 Progress Avenue

TRACO
2304 Silverdale Road
Johnson City, TN 37601

Security (TRACO)
5100 N.W. 72nd Avenue
Miami, FL 33166

Cranberry Township, PA 16066

and the following statement: "**Miami-Dade County Product Control Approved**", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA # 07-0309.01** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 08-0416.05
Expiration Date: April 25, 2012
Approval Date: August 21, 2008
Page 1

TRACO Security Windows and Doors, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **04-113-0003**, Sheets 1 through 3 of 3, titled "Series 2100 Aluminum Fixed Window - Non-Impact Resistant", dated 05/03/04 with revision dated 07/17/08, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a series 2100 aluminum fixed window, prepared by Farabaugh Engineering and Testing, Inc., Test Report No. **FET-T113-08**, dated 1/22/08, signed and sealed by Daniel G. Farabaugh, P. E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a series 2100 aluminum fixed window, prepared by Farabaugh Engineering and Testing, Inc., Test Report No. **FET-T174-07**, dated 05/02/07, signed and sealed by Daniel G. Farabaugh, P. E.
(Submitted under NOA# 07-0309.01)
3. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with installation diagram of a series 2100 aluminum fixed window prepared by Farabaugh Engineering and Testing, Inc., Test Report No. **FET-04004**, dated 3/10/04, signed and sealed by Daniel G. Farabaugh, P.E.
(Submitted under NOA # 05-0812.03)
4. Test report on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
along with installation diagram of a series 2100 aluminum fixed window prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-1298**, dated 09/26/95, signed and sealed by Yamil Kuri, P.E. *(Submitted under NOA # 99-0330.03)*
5. Test report on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
along with installation diagram of a series 2100 aluminum fixed window prepared by Fenestration Testing Laboratory, Inc., test report No. **FTL-1228**, dated 09/27/95, signed and sealed by Yamil Kuri, P.E. *(Submitted under NOA # 99-0330.03)*

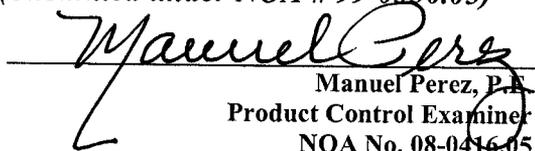
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-0416.05
Expiration Date: April 25, 2012
Approval Date: August 21, 2008

TRACO Security Windows and Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Revised Anchor Calculations, and structural analysis, complying with FBC 2004, prepared by Engineering Express, dated 07/17/08, signed and sealed by Frank L. Bennardo, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS

1. Statement letter of conformance, dated April 08, 2008, signed and sealed by Frank L. Bennardo P.E.
2. Laboratory compliance letter for Test Report no. **FET-T113-08**, issued by Farabaugh Engineering and Testing, Inc., dated January 22, 2008, signed and sealed by Daniel G. Farabaugh, P.E.

G. OTHERS

1. Notice of Acceptance No. **07-0309.01**, issued to TRACO Security Windows & Doors, Inc. for their "Series 2100 Aluminum Fixed Window", approved on 05/10/07 and expiring on 04/25/08.

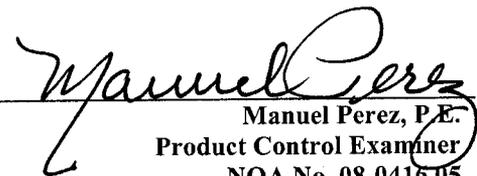
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-0416.05

Expiration Date: April 25, 2012
Approval Date: August 21, 2008


SERIES 2100 FIXED WINDOW (NON-IMPACT RESISTANT)

FRANK L. BENNARDO, P.E.
PE0046549

07/17/2008

TABLE ① DESIGN LOAD CAPACITY (PSF)

WINDOW WIDTH (in)	WINDOW HEIGHT (in)	MAX ANCHOR SPACING		NAIL FIN ANCHORAGE				THRU-FRAME ANCHORAGE						
				3/16" ANNEALED		3/16" TEMPERED		1/8" ANNEALED		3/16" ANNEALED		3/16" TEMPERED		
		HEAD/SILL (in)	JAMBS (in)	POS (psf)	NEG (psf)	POS (psf)	NEG (psf)	POS (psf)	NEG (psf)	POS (psf)	NEG (psf)	POS (psf)	NEG (psf)	
19.13	26.00	7.00	7.13	100.0	103.5	100.0	158.1	49.6	49.6	93.9	93.9	100.0	158.1	
26.50		7.00	7.25	94.4	94.4	100.0	144.3	45.3	45.3	85.7	85.7	100.0	144.3	
37.00		7.00	8.33	74.2	74.2	100.0	113.3	35.6	35.6	67.3	67.3	100.0	113.3	
53.13		7.00	8.23	63.7	63.7	97.3	97.3	27.4	27.4	57.8	57.8	97.3	97.3	
19.13	38.375	8.79	7.13	87.1	87.1	100.0	133.1	41.8	41.8	79.1	79.1	100.0	133.1	
26.50		8.79	7.25	72.1	72.1	100.0	110.2	34.6	34.6	65.5	65.5	100.0	110.2	
37.00		8.79	8.33	65.3	65.3	99.8	99.8	31.3	31.3	59.3	59.3	99.8	99.8	
53.13		8.79	8.23	51.0	51.0	78.0	78.0	24.4	24.4	46.3	46.3	78.0	78.0	
19.13	50.625	9.66	7.13	80.6	80.6	100.0	123.2	33.7	33.7	73.2	73.2	100.0	123.2	
26.50		9.66	7.25	63.9	63.9	97.7	97.7	29.3	29.3	58.1	58.1	97.7	97.7	
37.00		9.66	8.33	53.3	53.3	81.4	81.4	25.6	25.6	48.4	48.4	81.4	81.4	
53.13		9.66	8.23	47.2	47.2	72.1	72.1	19.3	19.3	42.9	42.9	72.1	72.1	
19.13	57.00	9.00	7.13	78.6	78.6	100.0	120.1	30.7	30.7	71.4	71.4	100.0	120.1	
26.50		9.00	7.25	61.5	61.5	94.0	94.0	24.9	24.9	55.8	55.8	94.0	94.0	
37.00		9.00	8.33	50.1	50.1	76.5	76.5	23.5	23.5	45.4	45.4	76.5	76.5	
53.13		9.00	8.23	44.1	44.1	67.4	67.4	17.4	17.4	40.0	40.0	67.4	67.4	
19.13	63.00	8.50	7.13	77.1	77.1	100.0	117.8	19.1	19.1	70.0	70.0	100.0	117.8	
26.50		8.50	7.25	59.8	59.8	91.3	91.3	21.6	21.6	54.3	54.3	91.3	91.3	
37.00		8.50	8.33	46.7	46.7	73.1	73.1	21.2	21.2	43.5	43.5	73.1	73.1	
53.13		8.50	8.23	40.3	40.3	62.2	62.2	15.7	15.7	37.0	37.0	62.2	62.2	
19.13	74.25	8.89	7.13	75.1	75.1	100.0	114.7	27.1	27.1	68.2	68.2	100.0	114.7	
26.50		8.89	7.25	54.5	54.5	87.8	87.8	17.7	17.7	52.2	52.2	87.8	87.8	
37.00		8.89	8.33	37.9	37.9	68.8	68.8	17.8	17.8	37.9	37.9	68.8	68.8	
24.00		24.00	6.00	6.00	100.0	104.3	100.0	159.3	50.0	50.0	94.6	94.6	100.0	159.3
36.00	6.00		8.00	78.2	78.2	100.0	119.5	37.5	37.5	71.0	71.0	100.0	119.5	
48.00	6.00		9.00	69.5	69.5	100.0	106.2	31.4	31.4	63.1	63.1	100.0	106.2	
60.00	6.00		9.60	65.2	65.2	99.6	99.6	23.5	23.5	59.2	59.2	99.6	99.6	
72.00	6.00	10.00	62.6	62.6	95.6	95.6	19.6	19.6	56.8	56.8	95.6	95.6		
24.00	36.00	8.00	6.00	78.2	78.2	100.0	119.5	37.5	37.5	71.0	71.0	100.0	119.5	
36.00		8.00	8.00	65.6	65.6	100.0	106.2	33.3	33.3	63.1	63.1	100.0	106.2	
48.00		8.00	9.00	55.6	55.6	85.0	85.0	26.7	26.7	50.5	50.5	85.0	85.0	
60.00		8.00	9.60	49.6	49.6	75.9	75.9	22.6	22.6	45.1	45.1	75.9	75.9	
72.00	8.00	10.00	39.4	39.4	70.8	70.8	18.6	18.6	39.4	39.4	70.8	70.8		
24.00	48.00	9.00	6.00	69.5	69.5	100.0	106.2	31.4	31.4	63.1	63.1	100.0	106.2	
36.00		9.00	8.00	55.6	55.6	85.0	85.0	26.7	26.7	50.5	50.5	85.0	85.0	
48.00		9.00	9.00	52.1	52.1	79.7	79.7	22.1	22.1	47.3	47.3	79.7	79.7	
60.00		9.00	9.60	43.4	43.4	66.4	66.4	18.3	18.3	39.4	39.4	66.4	66.4	
72.00	9.00	10.00	37.7	37.7	59.7	59.7	15.4	15.4	35.5	35.5	59.7	59.7		
24.00	60.00	9.60	6.00	65.2	65.2	99.6	99.6	23.5	23.5	59.2	59.2	99.6	99.6	
36.00		9.60	8.00	49.6	49.6	75.9	75.9	22.6	22.6	45.1	45.1	75.9	75.9	
48.00		9.60	9.00	43.4	43.4	66.4	66.4	18.3	18.3	39.4	39.4	66.4	66.4	
60.00		9.60	9.60	38.5	38.5	63.7	63.7	14.9	14.9	37.9	37.9	63.7	63.7	
24.00	72.00	10.00	6.00	62.6	62.6	95.6	95.6	19.6	19.6	56.8	56.8	95.6	95.6	
36.00		10.00	8.00	39.4	39.4	70.8	70.8	18.6	18.6	39.4	39.4	70.8	70.8	
48.00		10.00	9.00	37.7	37.7	59.7	59.7	15.4	15.4	35.5	35.5	59.7	59.7	
24.00		84.00	9.00	6.00	60.8	60.8	92.9	92.9	17.5	17.5	55.2	55.2	92.9	92.9
36.00	9.00		8.00	32.2	32.2	67.6	67.6	15.0	15.0	32.2	32.2	67.6	67.6	
24.00	96.00		9.33	6.00	59.6	59.6	91.0	91.0	16.2	16.2	54.1	54.1	91.0	91.0
36.00			9.33	8.00	28.3	28.3	65.4	65.4	12.6	12.6	28.3	28.3	65.4	65.4

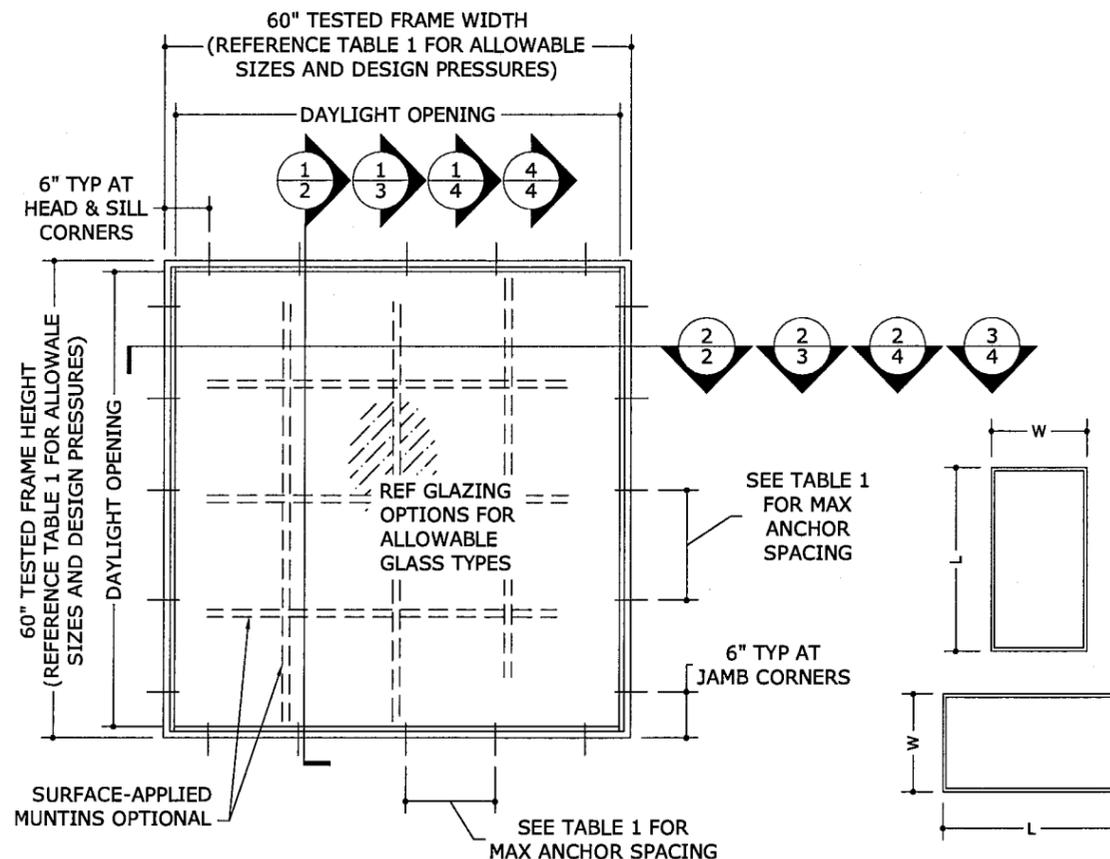

① TYPICAL EXTERIOR ELEVATION
① 3/4" = 1'-0"

NOTE: WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No 08-0416-05
Expiration Date 04/25/2012
By *Manuel Perez*
Miami Dade Product Control Division

GENERAL NOTES:

- 1) THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN COMPLIANCE WITH THE 2004 AND 2007 EDITIONS OF THE FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE) AND HVHZ TEST PROTOCOL TAS 202.
- 2) NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
- 3) POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
- 4) MULTIPLE WINDOW UNITS MUST BE INSTALLED USING MIAMI-DADE COUNTY BCCO-APPROVED STRUCTURAL MULLIONS (e.g. NOA #01-1218.01 OR #01-1218.02).
- 5) THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
- 6) PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS.
- 7) ALL WINDOWS SHALL BE PROTECTED WITH MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS FOR ALL INSTALLATIONS.
- 8) ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED IN ACCORDANCE WITH THE 2004 AND 2007 EDITIONS OF THE FLORIDA BUILDING CODE.

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

TRACO
Windows & Doors Inc.
71 Progress Avenue
Cranberry Township, PA 16166
Tel: (724) 776-7000
SERIES 2100 ALUMINUM FIXED WINDOW
NON-IMPACT RESISTANT

REMARKS	DATE	DRWN	CHKD
BCCO COMMENTS	7/17/08	KEL	CL
2004 FBC	07/13/05	CL	FLB
2007 FBC, NAIL FIN	04/02/08	CL	RKB
REV. PER BCCO COMMENT	05/14/08	KL	CL
REV. PER BCCO COMMENT	07/10/08	TSB	CL


04-113-0003
SCALE: 1/32"
PAGE DESCRIPTION:

F:\01 Project Files\Traco (TRA)\2004 Jobs\04-113-0003 2100 Fixed Window (Non-Impact)\04-113-0003_04e Traco - 2100 Fixed Window (Non-Impact).dwg 07/17/2008 - 4:47pm clangley

07/17/2008

ENGINEERING EXPRESS
160 SW 12th Avenue, # 106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGGEXP.COM
CERT OF AUTH #8685
A FRANK L. BENNARDO, P.E., INC. INNOVATION

MATERIALS LIST					
ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MFR/SUPPLIER/REMARKS
1	S-1106	4/ WINDOW	FRAME	ALUMINUM	6063-T5
2	S-1107	4/ WINDOW	GLAZING BEAD (SINGLE)	ALUMINUM	6063-T5
3	026-00-010	AS REQD.	1/8" X 1/2" GLAZING TAPE	BUTYL	BY TREMCO
4	046-16-010	-	BULB VINYL	VINYL	-
5	012-00-835	2/ CORNER	#8x1" PPH METAL SCREWS	S.S.	ASSEMBLY SCREWS
6	S-1125	4/ WINDOW	APPLIED NAIL FIN	ALUMINUM	6063-T5

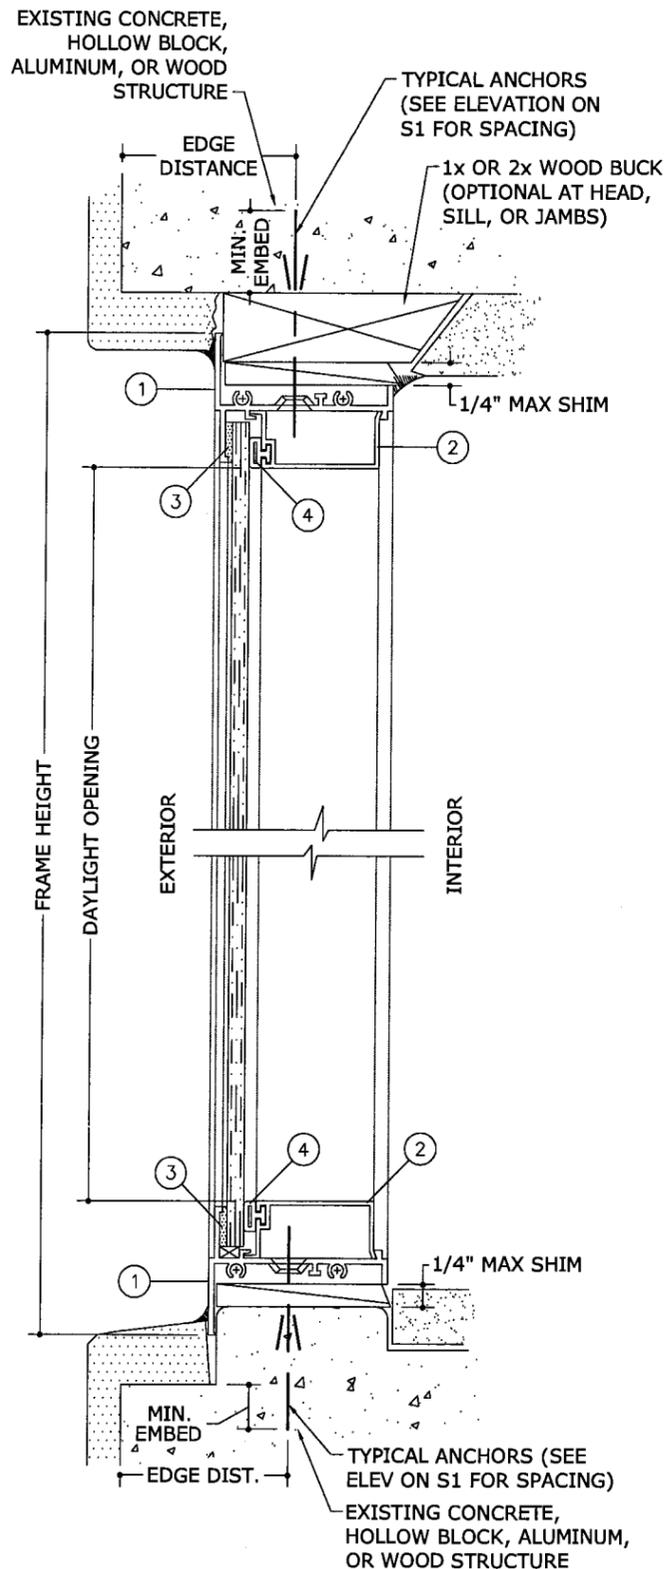

WOOD BUCKS, NOT BY TRACO, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS:


- 3/16" TAPCONS (BY ELCO OR ITW) OR EQUIV CONC ANCHOR HOLDING CURRENT NOTICE OF ACCEPTANCE.
 - INTO 2x WOOD BUCKS OR WOOD STRUCTURE (1-3/8" MIN PENETRATION INTO WOOD) WITH 1" MIN EDGE DISTANCE.
 - THRU 1x WOOD BUCKS INTO MASONRY OR DIRECTLY INTO MASONRY (1-1/4" MIN EMBED INTO CONCRETE OR MASONRY), WITH 1-1/8" MIN EDGE DISTANCE.
- #10 SAE GRADE 5 SCREW INTO 2x WOOD BUCKS OR WOOD STRUCTURE (1-3/8" MIN PENETRATION INTO WOOD) WITH 1" MIN EDGE DISTANCE.
- #14 THREAD-FORMING SAE GRADE 5 SCREW TO 6063-T5 OR 6063-T6 ALUMINUM (1/8" MIN THICKNESS).

SEALANT:


ALL FRAME AND VENT CORNERS, AND HEADS OF INSTALLATION SCREWS AT SILL TO BE SEALED WITH WHITE/ALUM COLORED SEALANT.

ANCHOR NOTES:

- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- WOOD BUCKS (NOT BY THIS MANUFACTURER) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
- WOOD BUCKS AND/OR HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN HEREIN. MINIMUM EDGE DISTANCE AND EMBEDMENT TO BASE STRUCTURE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS.

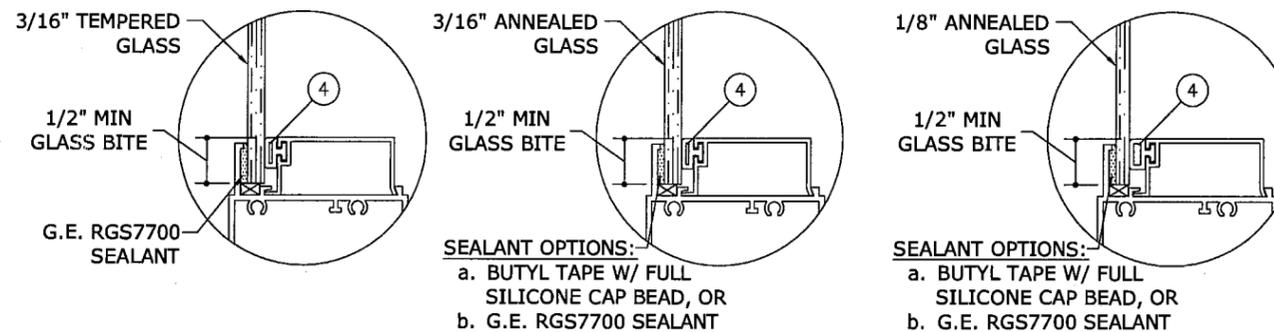

3 GLAZING DETAIL
2 6" = 1'-0"

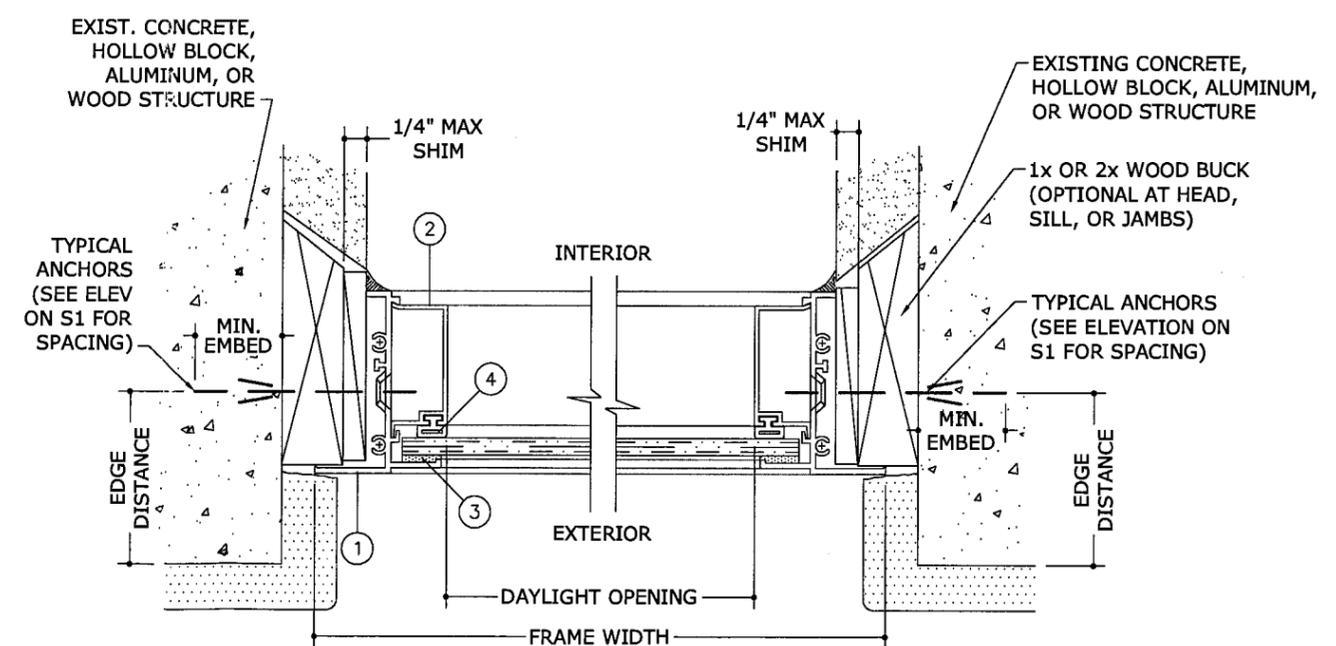

2 HORIZONTAL SECTION THRU-FRAME ANCHORAGE
2 6" = 1'-0"

1 VERTICAL SECTION THRU-FRAME ANCHORAGE
2 6" = 1'-0"

TRACO
Windows & Doors Inc.
71 Progress Avenue
Cranberry Township, PA 16166
Tel: (724) 776-7000

SERIES 2100 ALUMINUM FIXED WINDOW
NON-IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
BCCO COMMENTS	KEL	CL	7/17/08
2004 FBC	CL	FLB	07/13/05
2007 FBC, NAIL FIN	RKB	CL	04/02/08
REV. PER BCCO COMMENT	KL	CL	05/14/08
REV. PER BCCO COMMENT	TSB	CL	07/10/08

04-113-0003
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION:

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No 08-0416.05
Expiration Date 04/25/2012
By *Maureen Perry*
Miami Dade Product Control Division

07/17/2008 - 4:47pm clangley F:\01 Project Files\Traco (TRA)\2004 Jobs\04-113-0003 2100 Fixed Window (Non-Impact).dwg

FRANK L. BENNARDO, P.E.
PE0046549

07/17/2008


ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

TRACO
Windows & Doors Inc.
71 Progress Avenue
Cranberry Township, PA 16166
Tel: (724) 776-7000


SERIES 2100 ALUMINUM FIXED WINDOW
NON-IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
BCCO COMMENTS	KEL	CL	7/17/08
2004 FBC	CL	FLB	07/13/05
2007 FBC, NAIL FIN	RKB	CL	04/02/08
REV. PER BCCO COMMENT	KL	CL	05/14/08
REV. PER BCCO COMMENT	TSB	CL	07/10/08


04-113-0003
SCALE: 1/32"
PAGE DESCRIPTION:
3

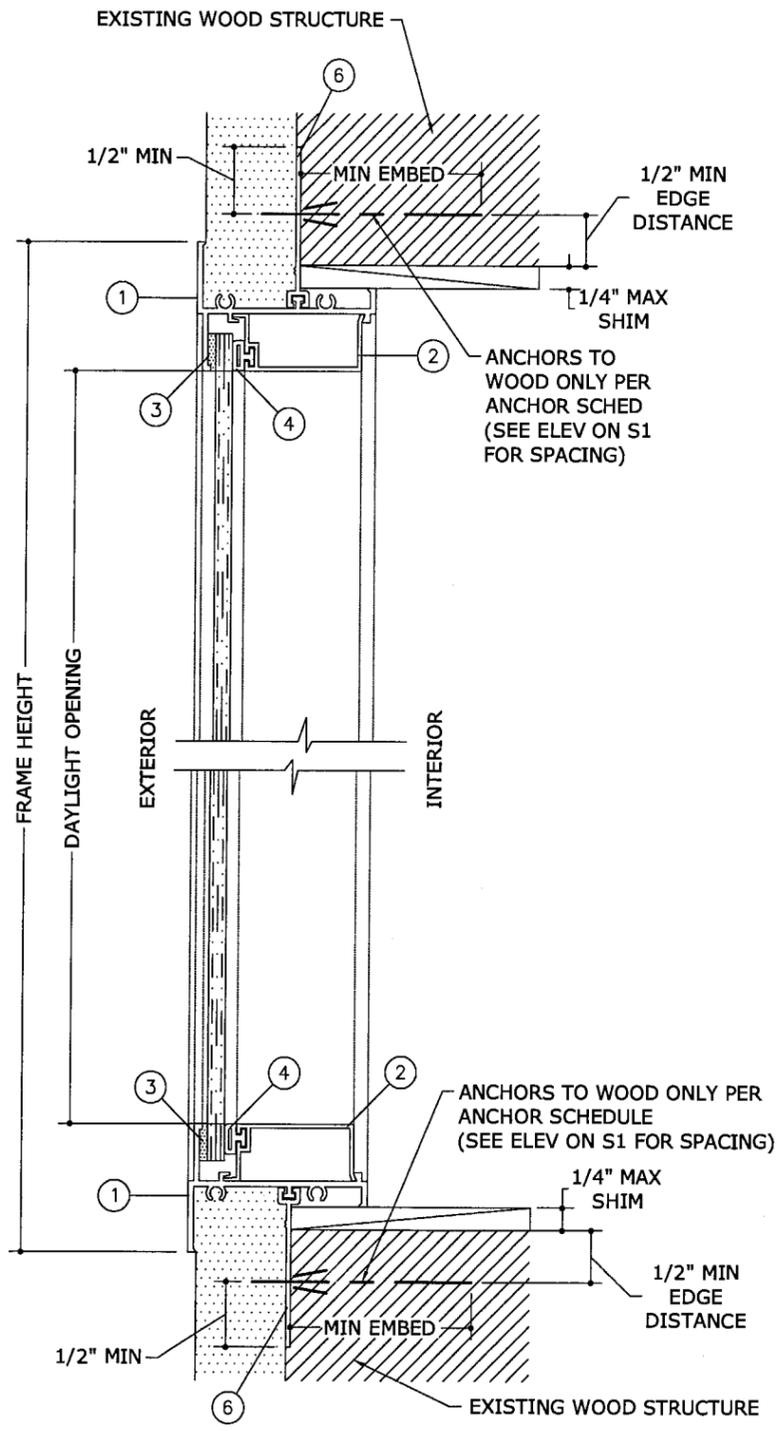


1 VERTICAL SECTION NAIL FIN ANCHORAGE
3 6" = 1'-0"

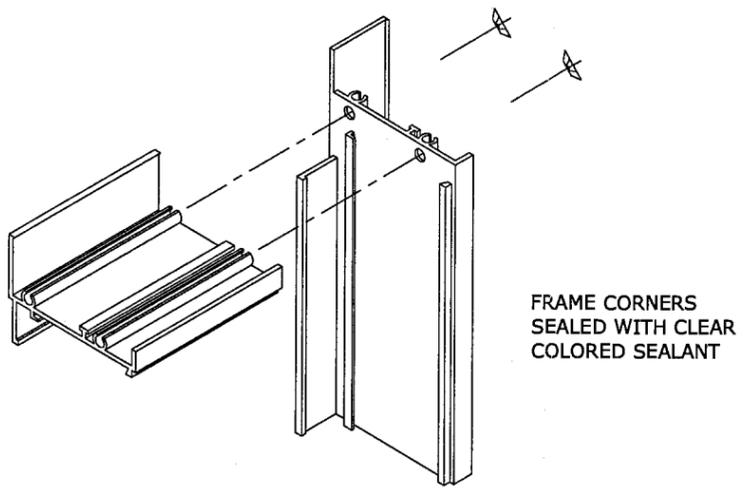

3 FRAME CORNER ASSEMBLY
3 N.T.S.

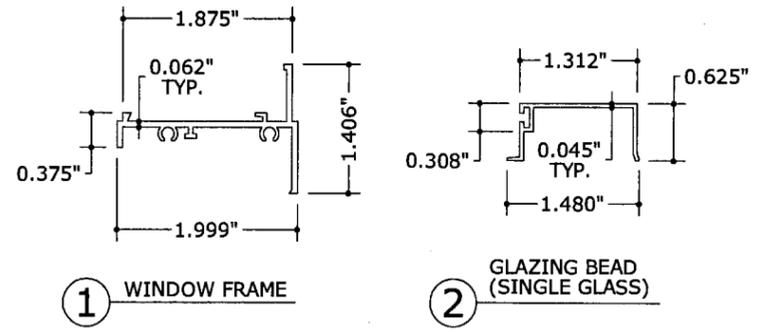


1 WINDOW FRAME
2 GLAZING BEAD (SINGLE GLASS)



6 APPLIED NAIL FIN

4 EXTRUSIONS
3 6" = 1'-0"

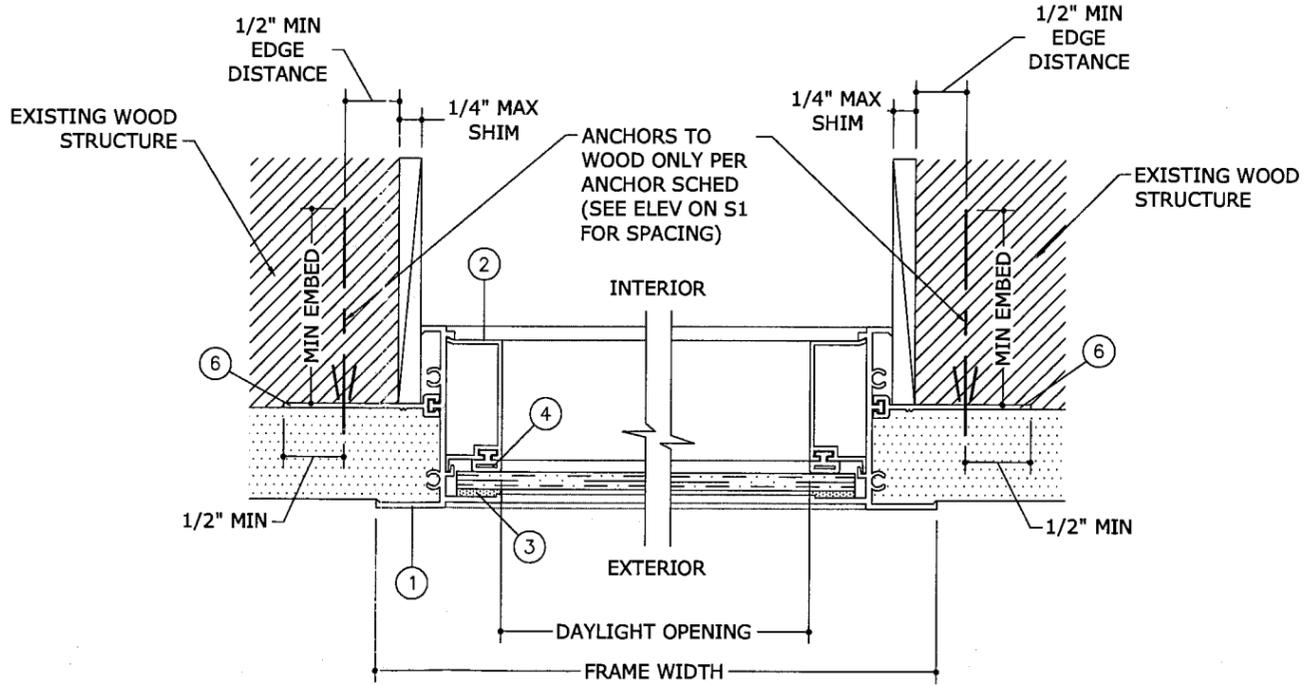

2 HORIZONTAL SECTION NAIL FIN ANCHORAGE
3 6" = 1'-0"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 08-0416.05
Expiration Date 04/25/2012
By *Manuel Torres*
Miami Dade Product Control
Division