



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
**(305) 375-2901 FAX (305) 375-2908**  
[www.buildingcodeonline.com](http://www.buildingcodeonline.com)

**NOTICE OF ACCEPTANCE (NOA)**

**Eurotech Industries, Inc.**  
**250 NE 32 Street**  
**Fort Lauderdale, FL 33334**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Aluminum Outswing Entrance Door-LMI**

**APPROVAL DOCUMENT:** Drawing No. **W04-01**, titled "Aluminum Outswing Entrance Door", sheets 1 through 5 of 5, dated 01/15/04 and last revised on Apr 28, 2008, prepared by AL-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**Limitations:**

1. Single or double doors may be mulled with approved clipped mullion or sidelites or transom (under separate approvals), lower design rating shall apply and such installation to be reviewed & approved by AHJ.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. **06-1019.06** consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



**NOA No 08-0507.10**  
**Expiration Date: June 10, 2009**  
**Approval Date: July 03, 2008**  
**Page 1**

6/19/08

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **W04-01**, titled "Aluminum Outswing Entrance Door", sheets 1 through 5 of 5, dated 01/15/04 and last revised on Apr 28, 2008, prepared by AL-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E.

**B. TESTS**

1. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test per FBC, TAS 202-94
  - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
  - 5) Large Missile Impact Test per FBC, TAS 201-94
  - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with installation diagram of aluminum outswing door, prepared by Hurricane Engineering Testing Inc., Test Report No(s). **HETI- 08-2021, 08-2022, 08-2023 and 08-2024**, all dated 03/15/08, signed and sealed by Candido Font, P.E.

2. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test per FBC, TAS 202-94
  - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
  - 5) Large Missile Impact Test per FBC, TAS 201-94
  - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with installation diagram of aluminum outswing door, prepared by Hurricane Engineering Testing Inc., Test Report No(s). **HETI- 03-1882, 08-1889, 08-18890 and 08-2024**, dated 01/15/04 thru 02/09/2004, all signed and sealed by Rafael E. Droz-Seda, P.E. (transferred from file # **06-1019.06**)

3. Tensile Test prepared by Hurricane Engineering & Testing, Test No. HETI-04-T100, dtd 01/29/04, tested per ASTM E8-01, signed & sealed by Rafael E. Droz-Seda, P.E.

**C. CALCULATIONS**

1. Anchor Calculations and structural analysis, prepared by Al-Farooq Corp., dated 04/28/08, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Complies with ASTM E1300-98 & -02

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont DeNemours for "SentryGlasPlus", expiring on 01/14/2012.
2. Notice of Acceptance No. **05-1208.02** issued to "E.I. DuPont Denemours" for "DuPont Butacite ® PVB" dated 02/15/01, expiring on 12/11/10.

**F. STATEMENTS**




1. Statement letter of conformance & no financial interest, dated April 15, 2008, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Statement letter of lab compliance, part of above test reports.

**G. OTHER**

1. This revises NOA # **06-1019.06**, expiring June 10, 2009.
2. Test proposal # 07-3527 approved by BCCO.

*Ishaq I. Chanda*

Ishaq I. Chanda, P.E.  
Product Control Examiner  
NOA No 08-0507.10  
Expiration Date: June 10, 2009  
Approval Date: July 03, 2008

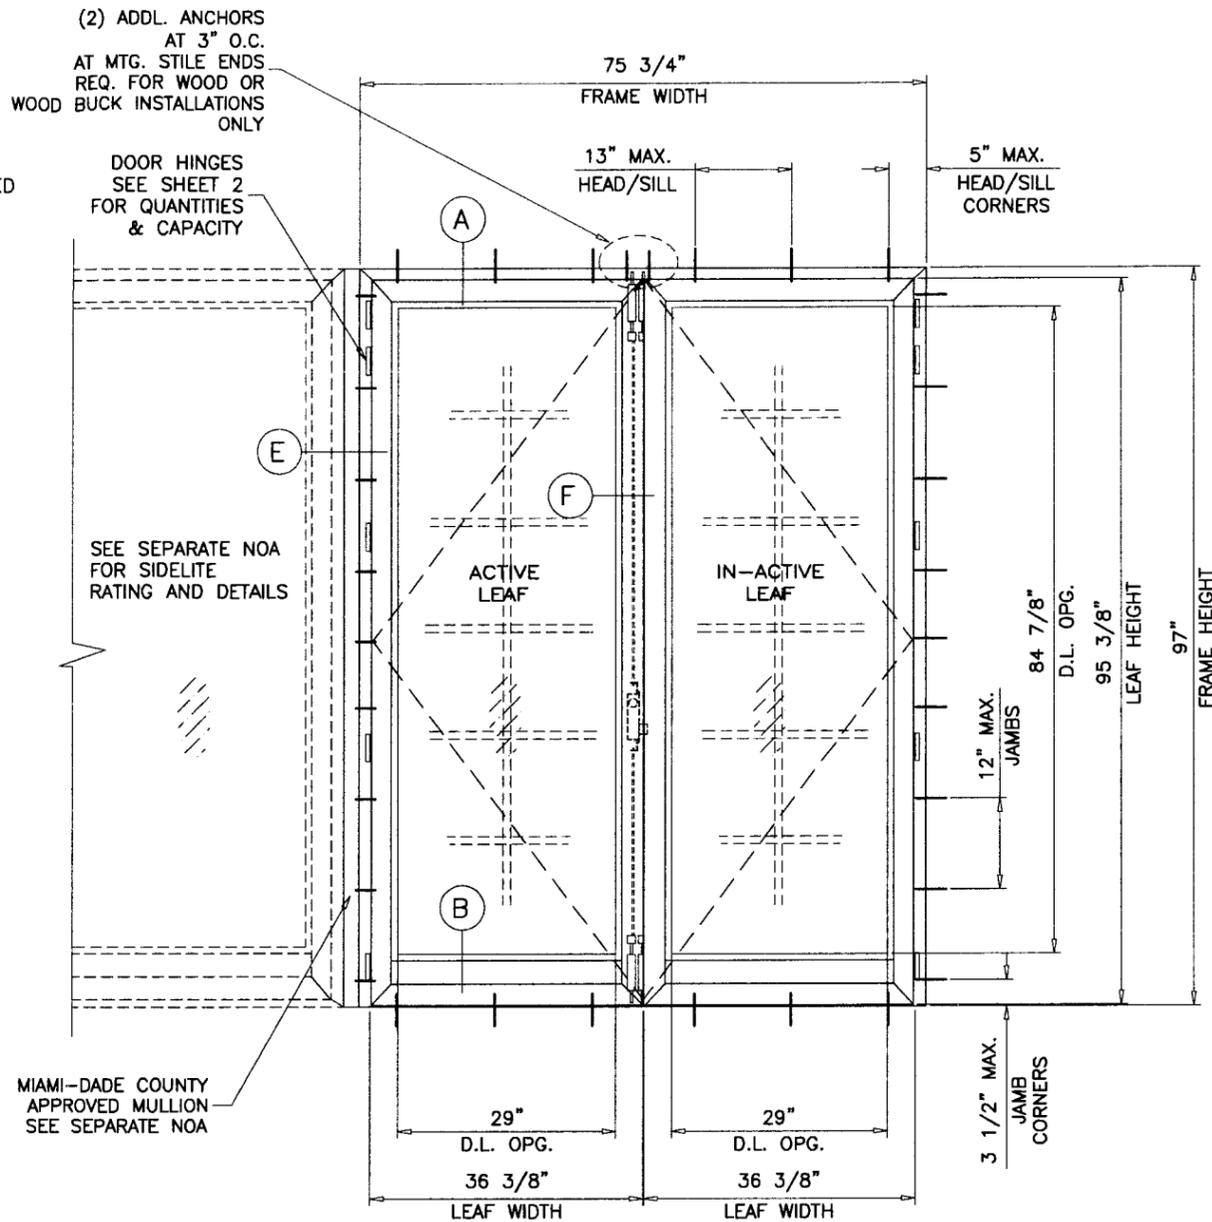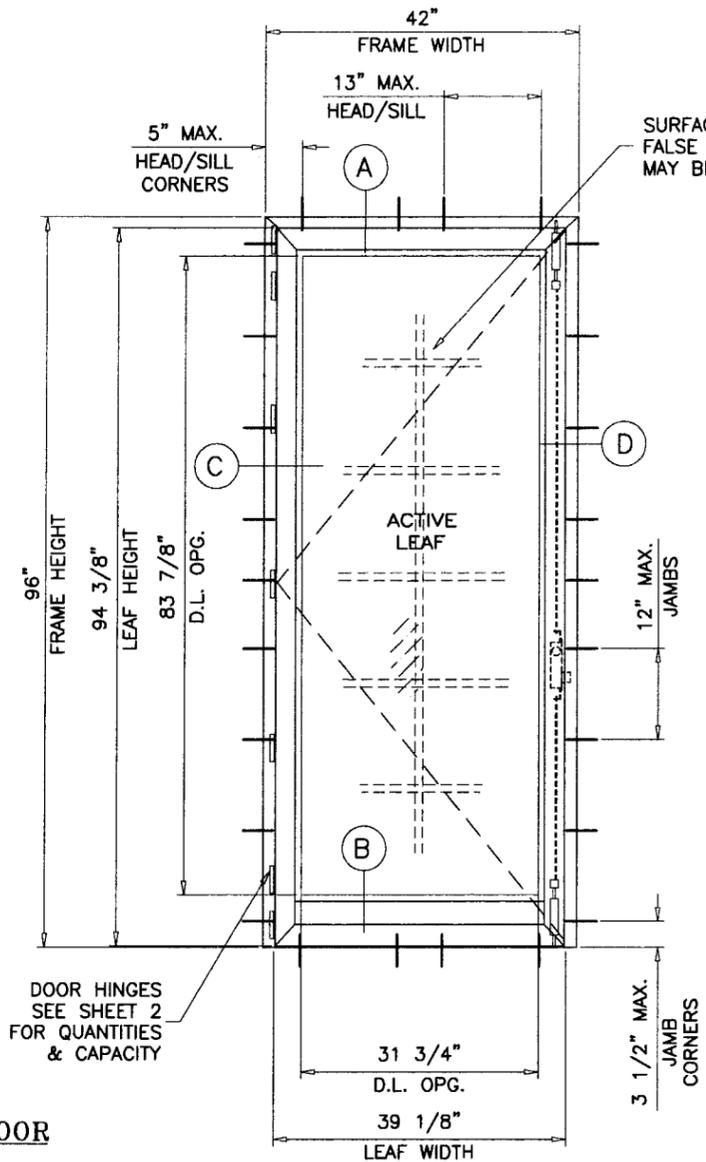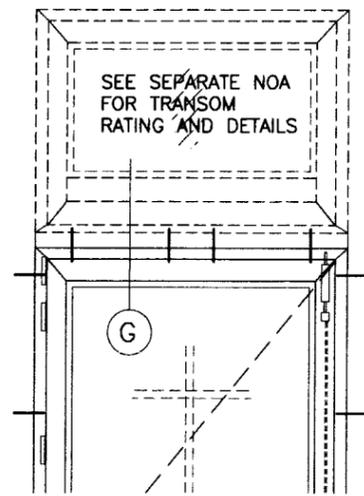

**ALUMINUM OUTSWING ENTRANCE DOOR**

APPROVAL APPLIES TO SINGLE (X) AND DOUBLE (XX) LEAF DOORS. ALSO SINGLE AND DOUBLE DOORS IN COMBINATION WITH SIDELITES USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. ALSO SINGLE AND DOUBLE DOORS WITH OR WITHOUT SIDELITES IN COMBINATION WITH TRANSOMS USING MIAMI-DADE COUNTY APPROVED MULLION IN BETWEEN. LOWER DESIGN PRESSURES FROM DOOR, SIDELITE OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).  
 WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.  
 ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.  
 ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.  
 A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.  
 MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4.

**TYPICAL ELEVATIONS**

THESE DOORS ARE RATED FOR LARGE MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538

APR 28 2008

**PRODUCT RENEWED**  
 as complying with the Florida Building Code  
 Acceptance No *08-0507-10*  
 Expiration Date *JUNE 10, 2009*  
 By *Isaac J. Lhanda*  
 Miami Dade Product Control Division

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W04-01EWD




---

**ALUM OUTSWING ENTRANCE DOOR (L.M.I.)**  
**EUROTECH WINDOWS & DOORS**  
 250 N.E. 32nd STREET  
 FT. LAUDERDALE, FL. 33334  
 TEL. (954) 630-9967 TEL. (954) 630-0217

| no | date     | description          |
|----|----------|----------------------|
| A  | 04.28.06 | UPDATED FOR 2004 FBC |
| B  | 04.11.08 | GENERAL REVISION     |

revisions:   
 date: 01-15-04  
 scale: 1/2" = 1'-0"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W04-01**  
 sheet 1 of 5

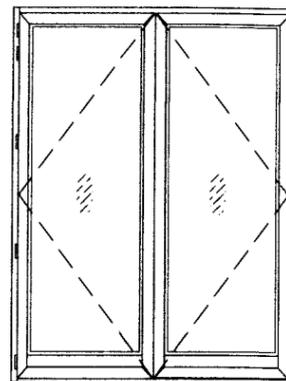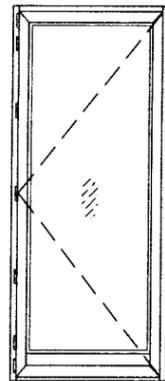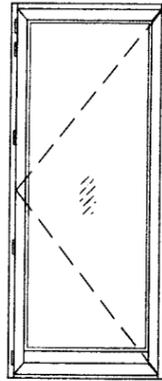

| DESIGN LOAD CAPACITY - PSF<br>SINGLE (X) DOORS |        |                |          |
|--|--------|----------------|----------|
| DOOR SIZE                                      |        | GLASS TYPE 'A' |          |
| WIDTH  | HEIGHT | EXT. (+)       | INT. (-) |
| 2/6  | 6/8    | 75.0           | 85.0     |
| 3/0  |        | 75.0           | 85.0     |
| 3/6  |        | 75.0           | 85.0     |
| 2/6  | 7/0    | 75.0           | 85.0     |
| 3/0  |        | 75.0           | 85.0     |
| 3/6  |        | 75.0           | 85.0     |
| 2/6  | 8/0    | 75.0           | 85.0     |
| 3/0  |        | 75.0           | 85.0     |
| 3/6  |        | 75.0           | 85.0     |

DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

**LOCKS SINGLE DOORS:**

3 POINT LOCK SYSTEM AT ACTIVE LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.

STRIKE PLATE  
1-1/4" X 1/4" X 16-1/4" LONG  
ATTACHED WITH (2) #8 X 3/4" SMS

**HINGES SINGLE DOORS:**

TWO-HANDED COMB HING  
EXTRUDED ALUMINUM BRIDGE 2  
BY 'GIESSE'  
(5) PER LEAF  
AT 6", 12", 35", 63-1/2" AND  
92-1/2" FROM TOP OF DOOR

| DESIGN LOAD CAPACITY - PSF<br>SINGLE (X) DOORS |        |                |          |
|--|--------|----------------|----------|
| DOOR SIZE                                      |        | GLASS TYPE 'B' |          |
| WIDTH  | HEIGHT | EXT. (+)       | INT. (-) |
| 2/6  | 6/8    | 100.0          | 140.0    |
| 3/0  |        | 100.0          | 140.0    |
| 3/3  |        | 100.0          | 140.0    |
| 2/6  | 7/0    | 100.0          | 140.0    |
| 3/0  |        | 100.0          | 140.0    |
| 3/3  |        | 100.0          | 140.0    |
| 2/6  | 8/0    | 100.0          | 140.0    |
| 3/0  |        | 100.0          | 140.0    |
| 3/3  |        | 100.0          | 140.0    |

DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

**LOCKS SINGLE DOORS:**

MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP AND BOTTOM OF ACTIVE LEAF PART #02181 ATTACHED WITH (4) #10 X 1-1/2" SMS.

3 POINT LOCK SYSTEM AT ACTIVE LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.

STRIKE PLATE  
1-1/4" X 1/4" X 16-1/4" LONG  
ATTACHED WITH (2) #8 X 3/4" SMS

**HINGES SINGLE DOORS:**

TWO-HANDED COMB HING  
EXTRUDED ALUMINUM BRIDGE 2  
BY 'GIESSE'  
(7) PER LEAF AT 7/0 AND 8/0 DOORS  
AT 3", 9" AND 26-3/8" FROM  
TOP AND BOTTOM, ONE AT MIDSPAN  
(6) PER LEAF AT 6/8 DOORS  
AT 3", 9" AND 26-3/8" FROM  
TOP AND BOTTOM

| DESIGN LOAD CAPACITY - PSF<br>DOUBLE (XX) DOORS |        |                       |          |
|---|--------|-----------------------|----------|
| DOOR SIZE                                       |        | GLASS TYPE 'A' OR 'B' |          |
| WIDTH   | HEIGHT | EXT. (+)              | INT. (-) |
| 5/0   | 6/8    | 75.0                  | 75.0     |
| 6/4   |        | 75.0                  | 75.0     |
| 5/0   | 7/0    | 75.0                  | 75.0     |
| 6/4   |        | 75.0                  | 75.0     |
| 5/0   | 8/1    | 75.0                  | 75.0     |
| 6/4   |        | 75.0                  | 75.0     |

LOADS SHOWN ABOVE ARE FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED.  
LIMIT EXTERIOR(+) LOADS TO 48 PSF FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

**LOCKS DOUBLE DOORS:**

**ACTIVE LEAF:**

MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP AND BOTTOM OF ACTIVE LEAF PART #02181 ATTACHED WITH (4) #8 X 1-1/2" SMS.

3 POINT LOCK SYSTEM AT ACTIVE LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.

**INACTIVE LEAF**


MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP AND BOTTOM OF INACTIVE LEAF PART #02168 ATTACHED WITH (4) #8 X 1-1/2" SMS.

**HINGES DOUBLE DOORS:**

TWO-HANDED COMB HING  
EXTRUDED ALUMINUM BRIDGE 2  
BY 'GIESSE'  
(5) PER LEAF  
AT 6", 12", 35", 63-1/2" AND  
92-1/2" FROM TOP OF DOOR

NOTE: TOP AND BOTTOM FLUSH BOLTS MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING.

| ITEM # | PART #       | REQD.     | DESCRIPTION               | MATERIAL | MANF./SUPPLIER/REMARKS |
|--------|--------------|-----------|---------------------------|----------|------------------------|
| 1      | ER006        | AS REQD.  | DOOR FRAME                | 6063-T6  | -                      |
| 2      | ER012        | AS REQD.  | DOOR LEAF                 | 6063-T6  | -                      |
| 3      | VZ1566       | 1/ LEAF   | DOOR BASE BOARD           | 6063-T6  | -                      |
| 4      | VZ-1483      | 1/ DOOR   | FRAME SILL                | 6063-T6  | -                      |
| 5      | -            | 1/ DOOR   | SILL BASE                 | 6063-T6  | -                      |
| 6      | VZ-1481      | AS REQD.  | ASTRAGAL STILE            | 6063-T6  | -                      |
| 7      | VZ-1535      | 4/ LEAF   | GLAZING BEAD              | 6063-T6  | -                      |
| 8      | 2801         | AS REQD.  | GLAZING GASKET            | VINYL    | -                      |
| 9      | -            | -         | -                         | -        | -                      |
| 10     | 1001/50      | 1/ CORNER | CORNER KEY                | ALUMINUM | MONTICELLO             |
| 11     | 00600X       | 4/ LEAF   | HINGES                    | ALUMINUM | GIESSE                 |
| 12     | #10 X 3/8"   | 4/ HINGE  | HINGE INSTALLATION SCREWS | -        | PH MACHINE SCREWS      |
| 13     | -            | AS REQD.  | BULB W'STRIPPING          | -        | -                      |
| 14     | #10 X 2"     | AS REQD.  | ASSEMBLY SCREWS           | -        | HH SELF DRILLING       |
| 15     | #12 X 1-1/4" | -         | FRAME ASSEMBLY SCREWS     | -        | SMS                    |
| 16     | -            | -         | -                         | -        | -                      |

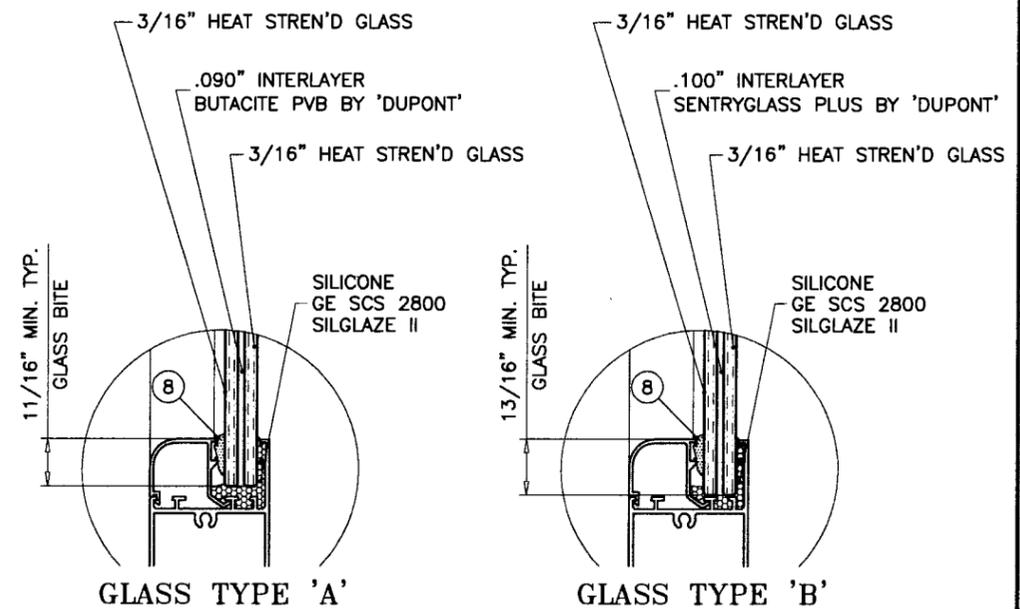

**GLAZING OPTIONS**

**PRODUCT RENEWED**  
as complying with the Florida  
Building Code  
Acceptance No. *08-0507.10*  
Expiration Date *JUNE 10, 2009*  
*(Shag). Chaudh*  
Miami Dade Product Control

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)






Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538  
*H*  
APR 28 2008

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-8978  
COMP-ANL\W04-01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)  
**EUROTECH WINDOWS & DOORS**  
250 N.E. 32nd STREET  
FT. LAUDERDALE, FL. 33334  
TEL. (954) 630-9967 TEL. (954) 630-0217

| no. | date     | by | description          |
|-----|----------|----|----------------------|
| A   | 04.28.06 |    | UPDATED FOR 2004 FBC |
| B   | 04.11.08 |    | GENERAL REVISION     |

date: 01-15-04  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:  
drawing no. **W04-01**  
sheet 2 of 5

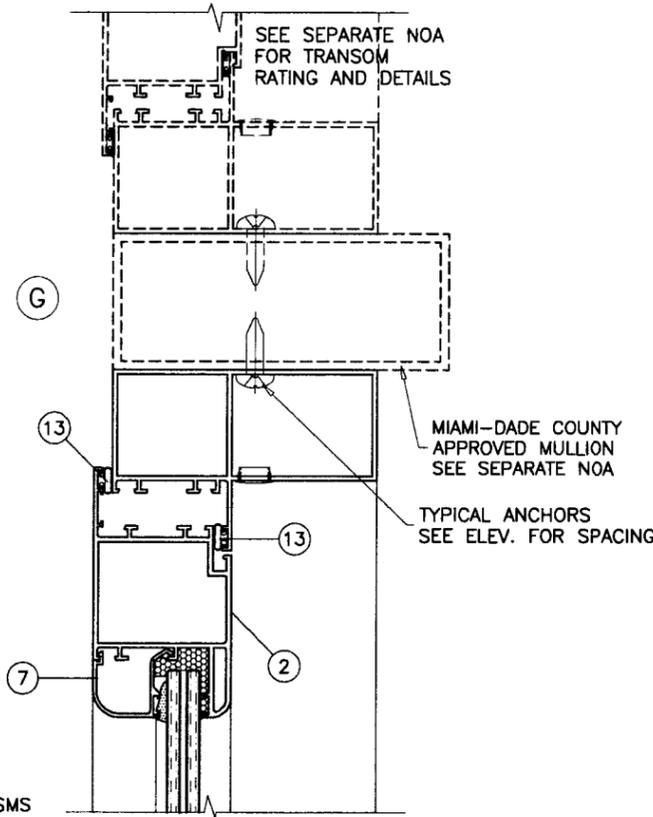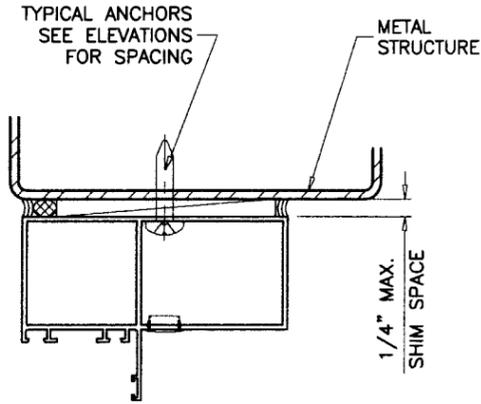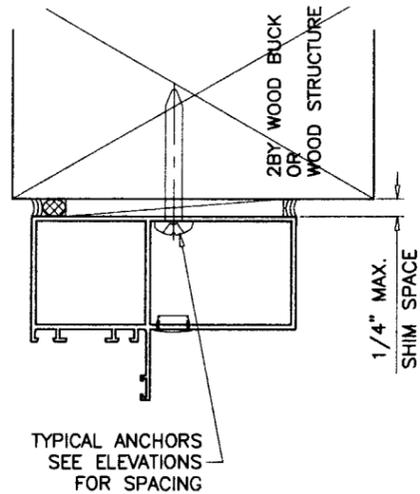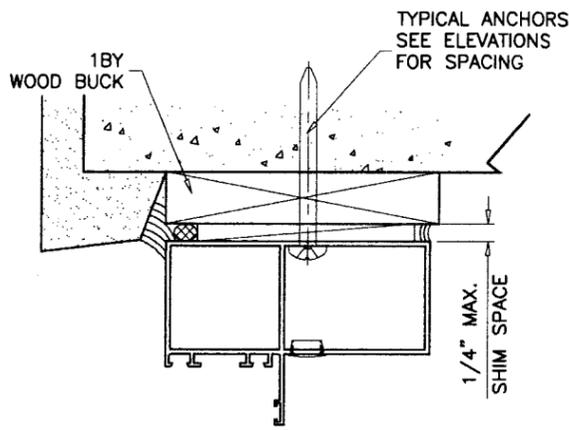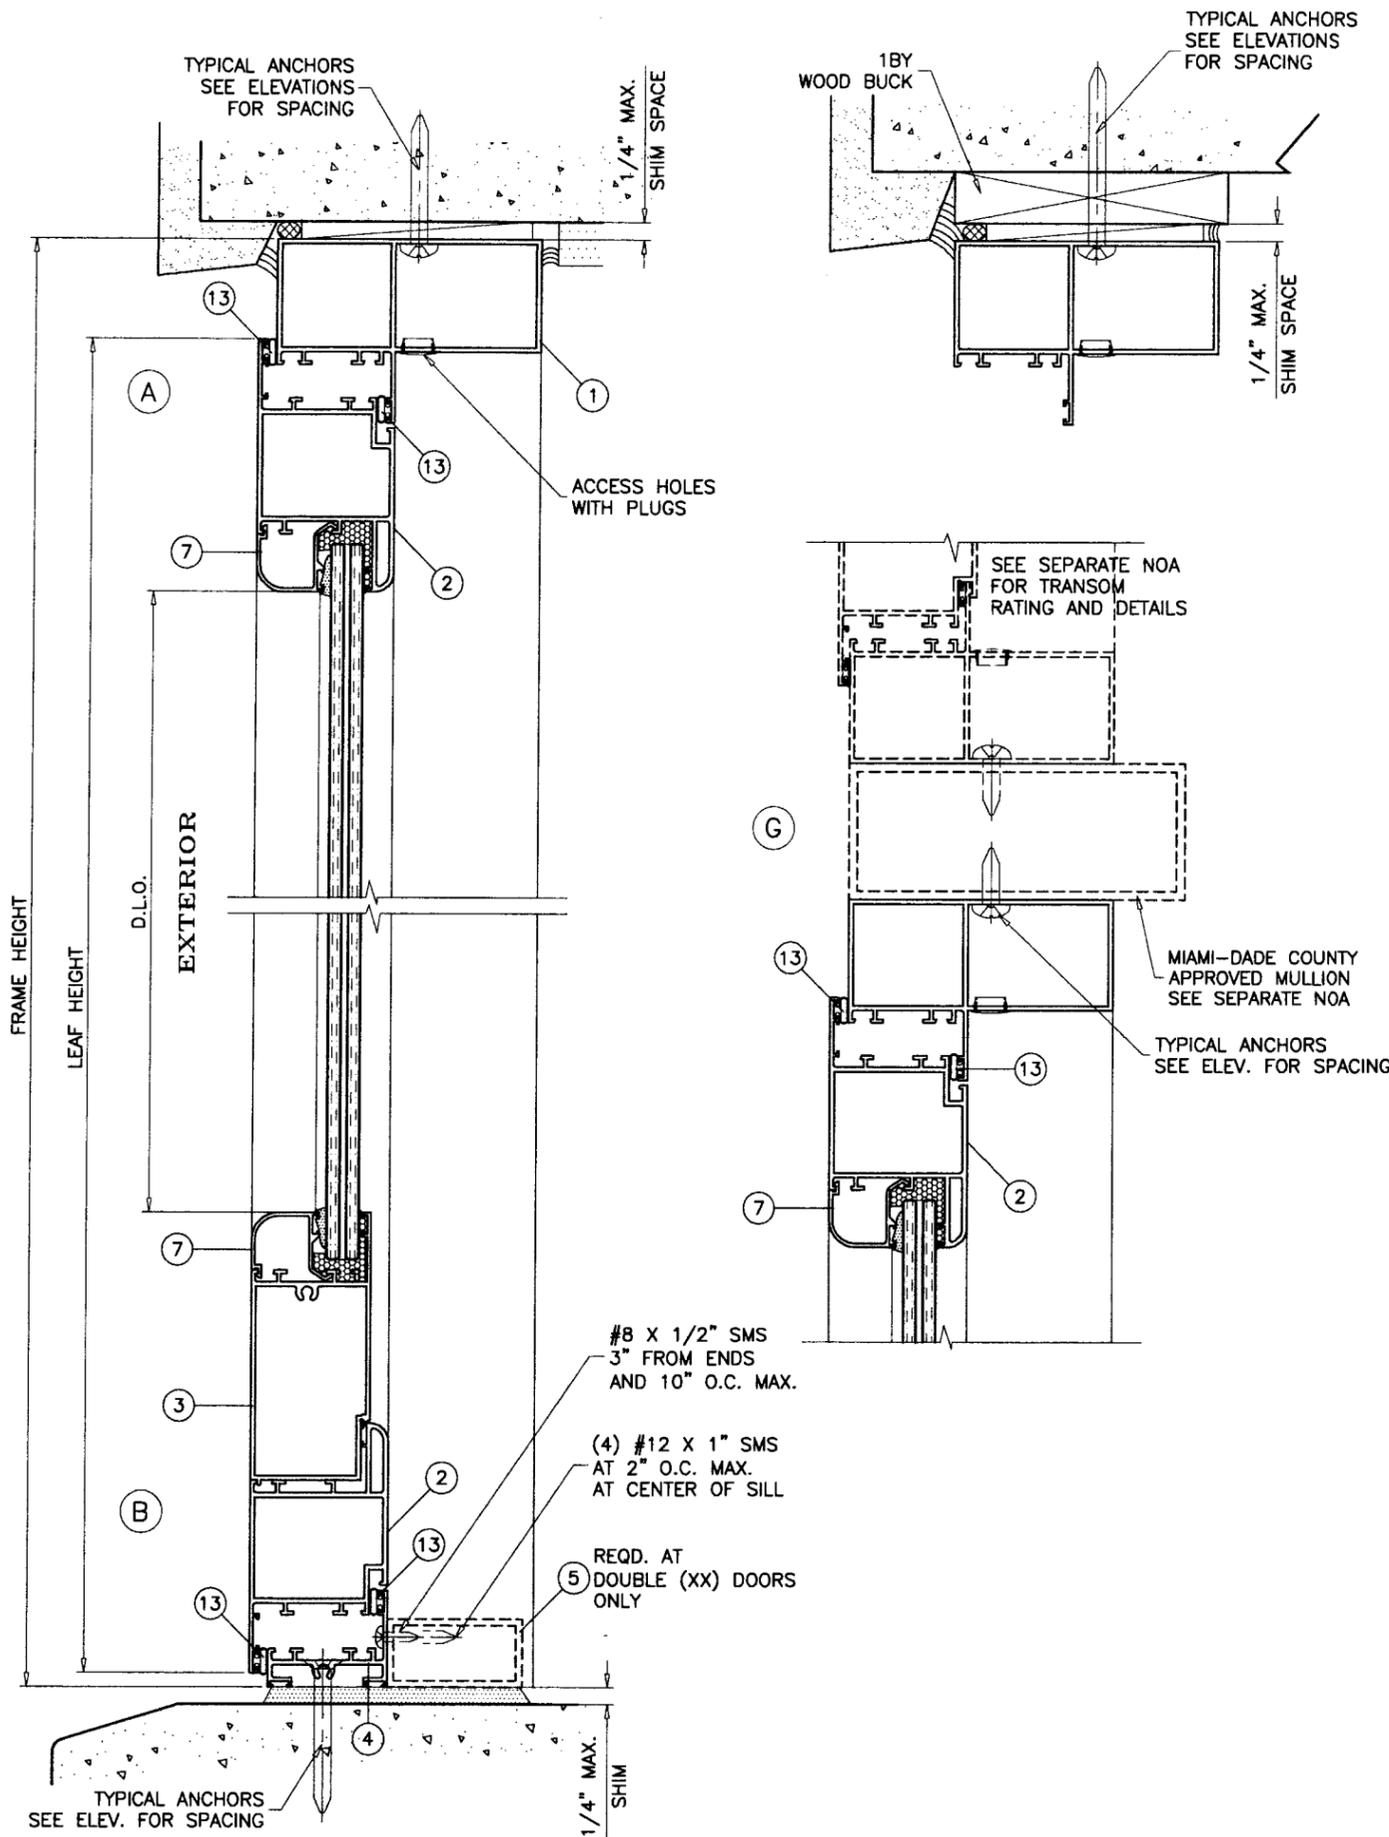

WOOD BUCKS AND METAL STRUCTURE NOT BY EUROTECH MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING  
**1/4" TAPCONS BY 'ELCO'**  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-1/2" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
**1/4" DIA. TEKS/DRIL-FLEX SELF DRILLING SCREWS (GRADE 5)**  
 INTO METAL STRUCTURES  
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**ANCHOR EDGE DISTANCES:**  
 INTO CONCRETE AND MASONRY = 2" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 3/4" MIN.

**SEALANTS:**  
 ALL FRAME AND LEAF CORNERS AND JOINTS SEALED WITH ADSEL OR TEKNA 50729 SEALANTS.

Engr. DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 15557  
 C.A.N. 3538

APR 28 2008

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 08-0567.10  
 Expiration Date JUNE 19, 2009  
 By Isqag I. Lhanda  
 Miami Dade Product Control  
 Division


**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANI\W04-01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)  
**EUROTECH WINDOWS & DOORS**  
 250 N.E. 32nd STREET  
 FT. LAUDERDALE, FL. 33334  
 TEL. (954) 630-9967 TEL. (954) 630-0217


| no | date     | by | description          |
|----|----------|----|----------------------|
| A  | 04.28.06 |    | UPDATED FOR 2004 FBC |
| B  | 04.11.08 |    | GENERAL REVISION     |

revisions:  
 date: 01-15-04  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W04-01**  
 sheet 3 of 5

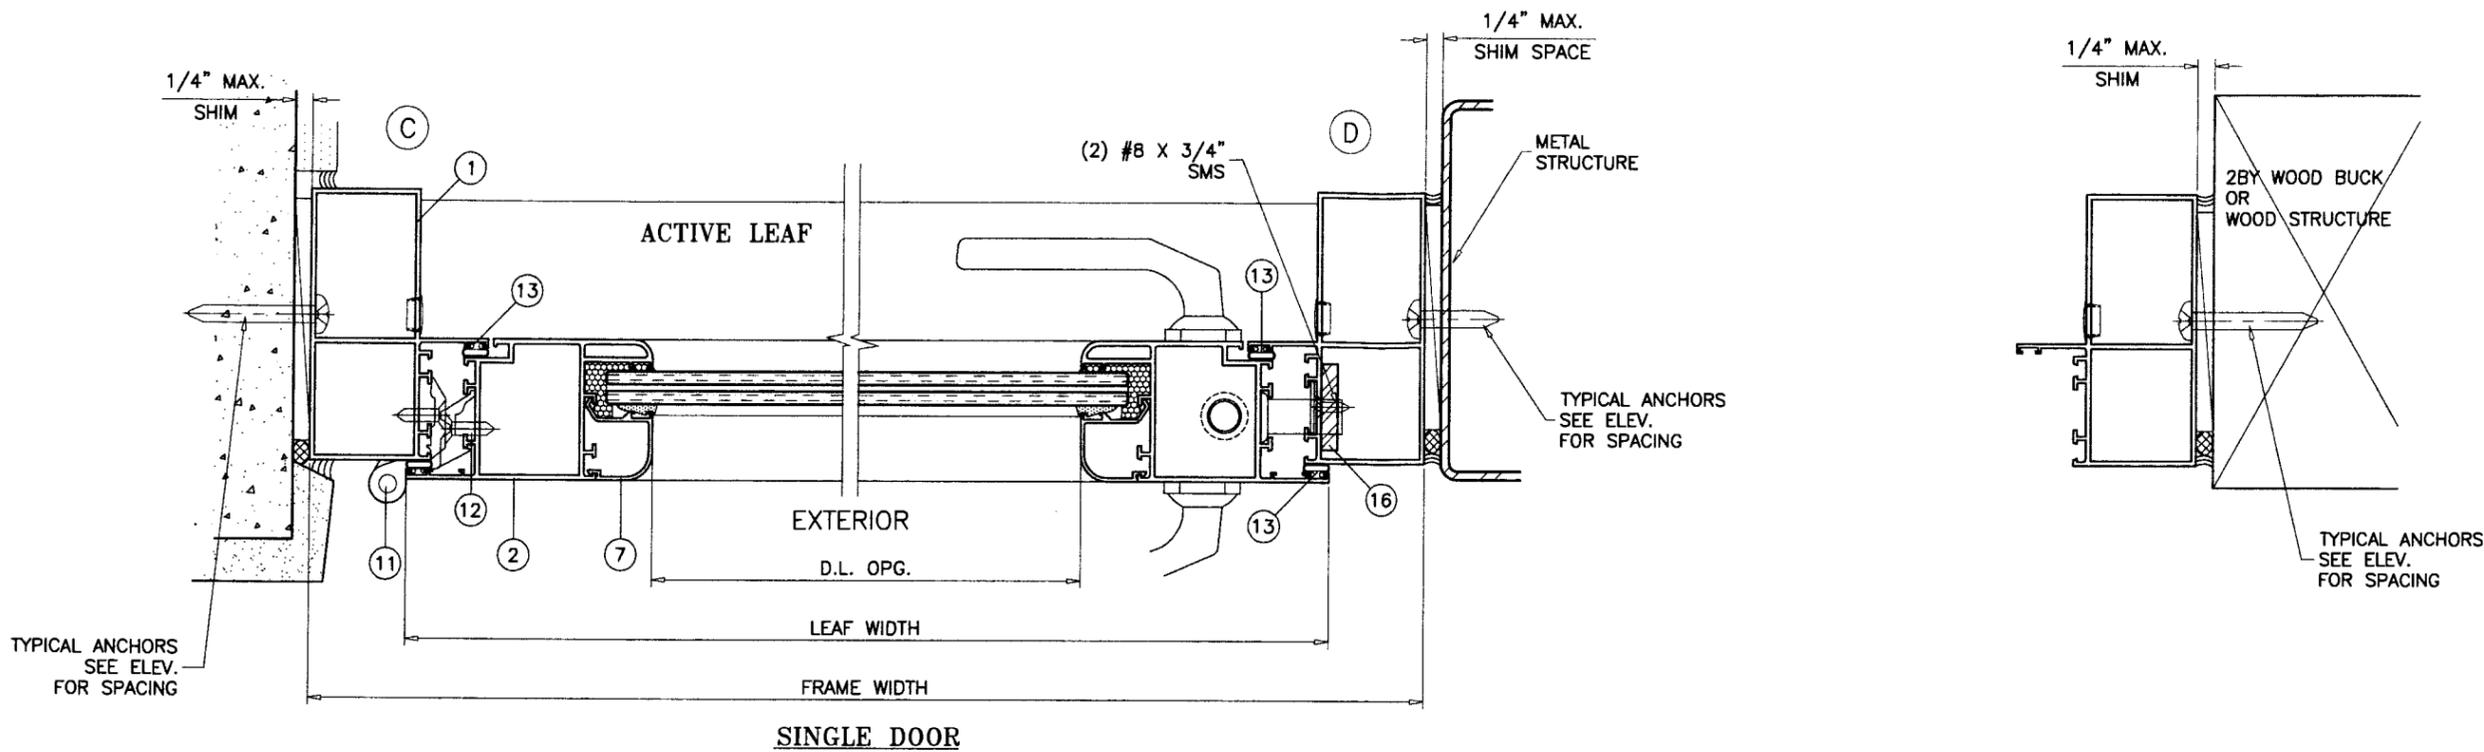

**SINGLE DOOR**

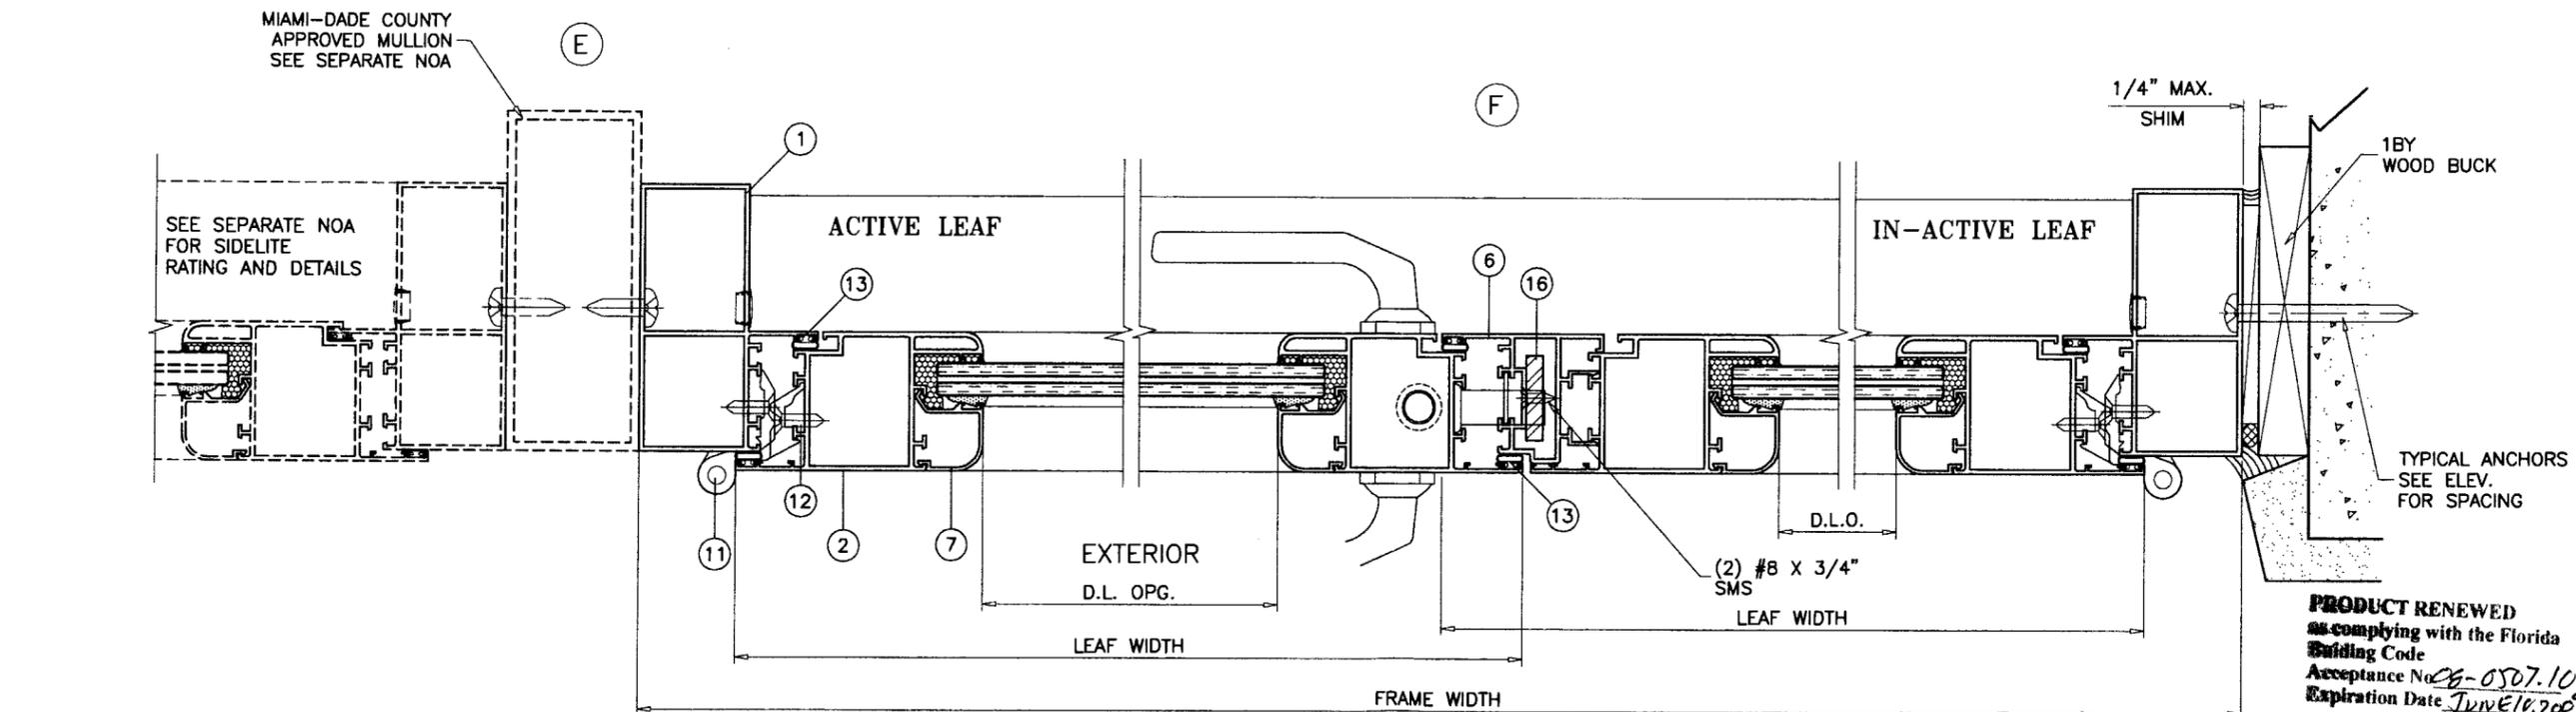

**DOUBLE DOOR**

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

APR 28 2008

**PRODUCT RENEWED**  
as complying with the Florida  
Building Code  
Acceptance No. *08-0507.10*  
Expiration Date *June 14, 2008*  
By *Israg I. Chanda*  
Miami Dade Product Control  
Division

**afc**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W04-01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)  
**EUROTECH WINDOWS & DOORS**  
250 N.E. 32nd STREET  
FT. LAUDERDALE, FL. 33334  
TEL. (954) 630-9967 TEL. (954) 630-0217


| no | date     | description          |
|----|----------|----------------------|
| A  | 04.28.06 | UPDATED FOR 2004 FBC |
| B  | 04.11.08 | GENERAL REVISION     |


|          |           |
|----------|-----------|
| date:    | 01-15-04  |
| scale:   | 3/8" = 1" |
| dr. by:  | HAMID     |
| chk. by: |           |


|             |        |
|-------------|--------|
| drawing no. | W04-01 |
| sheet       | 4 of 5 |




1 DOOR FRAME

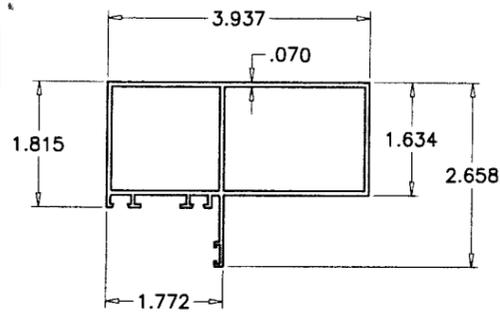

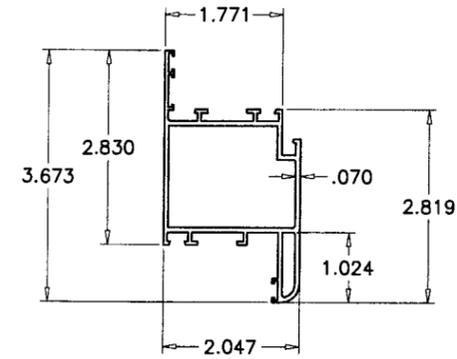
2 DOOR LEAF

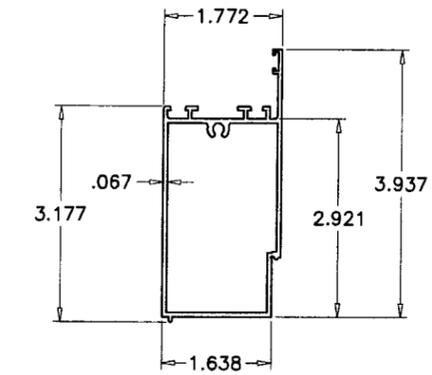


3 DOOR BASE BOARD

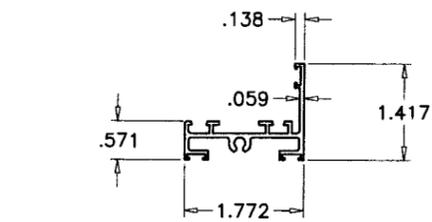


4 FRAME SILL

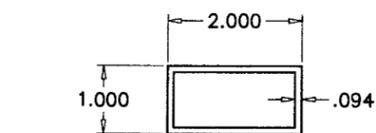



5 SILL BASE

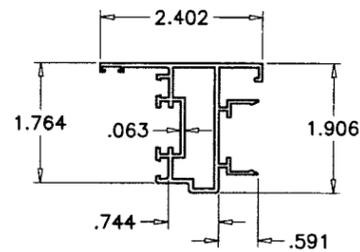


6 ASTRAGAL STILE

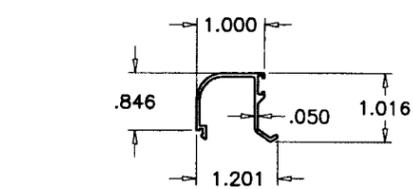


7 GLAZING BEAD

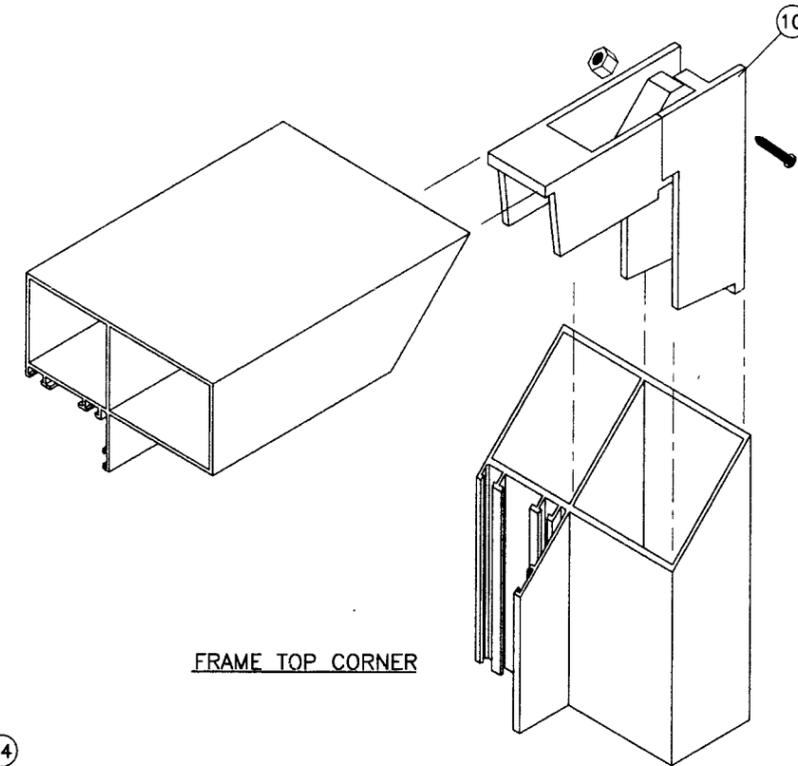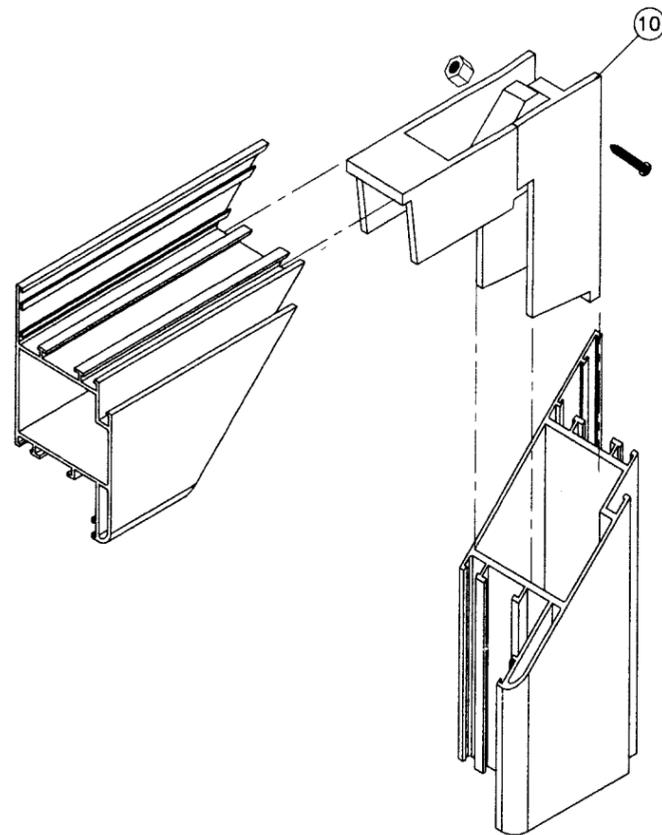

FRAME TOP CORNER

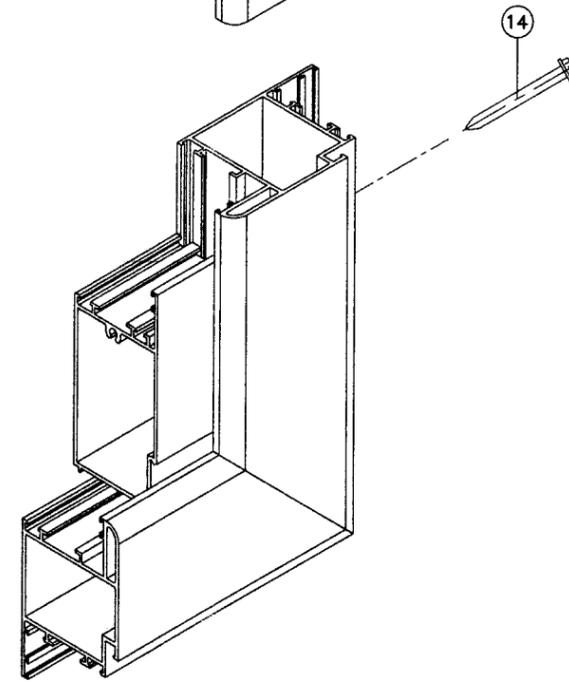

LEAF CORNERS

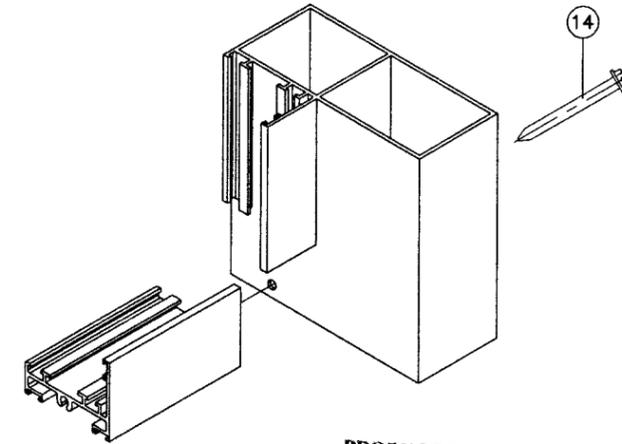

FRAME BOTTOM CORNER

PRODUCT RENEWED  
as complying with the Florida  
Building Code  
Acceptance No. 08-0507.10  
Expiration Date JUNE 10, 2009  
By: *Skye L. Chanda*  
Miami Date Product Control

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 18557  
C.A.N. 3538

APR 28 2008

**afC**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W04-01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)  
**EUROTECH WINDOWS & DOORS**  
250 N.E. 32nd STREET  
FT. LAUDERDALE, FL. 33334  
TEL. (954) 630-9967 TEL. (954) 630-0217

| no | date     | description          |
|----|----------|----------------------|
| A  | 04.28.06 | NO CHANGE THIS SHEET |
| B  | 04.11.08 | GENERAL REVISION     |

date: 01-15-04  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W04-01**  
sheet 5 of 5