



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

Weather Shield Manufacturing, Inc.
One Weather Shield Plaza
Medford, WI 54451

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Legacy" Aluminum Clad Outswing Wood French Door – L.M.I.

APPROVAL DOCUMENT: Drawing No. **1211 rev B**, titled "Legacy Alum Clad Outswing French Door", sheets 1 through 8 of 8, prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 05/28/04 and last revised on Jul 09, 2008, signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations:

1. Hinges max OC spacing must not exceed 26" for 98" or less frame height & 34" for 120" frame height.
2. Steel tube mullion required for triple or quad door units with transoms.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises & renews NOA # 04-0630.03** and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**




NOA No. 08-0602.10
Expiration Date: July 17, 2013
Approval Date: August 14, 2008
Page 1

7/25/8

Weather Shield Manufacturing, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- A. DRAWINGS** (transferred from file # 04-0630.03)
1. Manufacturer's die drawings and sections.
 2. Drawing No. **1211 rev B**, titled "Legacy Alum Clad Outswing French Door", sheets 1 through 8 of 8, prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 05/28/04 and last revised on Jul 09, 2008, signed and sealed by Warren W. Schaefer, P.E.
- B. TESTS** (transferred from file # 04-0630.03)
1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of an outswing French door, prepared along with marked-up drawings and installation diagram of a wood French door, prepared by Twin City Testing Corporation, Test Report No. **TCTCWI02016** dated 10/21/02, **TCTCWI02013** dated 8/20/02 and **TCTCWI02021** dated 11/10-13/03, all signed and sealed by Derrick Swanson, P.E.
- C. CALCULATIONS**
1. Anchor verification calculations and structural analysis, dated 5/29/08 and last revised on July 09, 2008, prepared by W.W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.
 2. Glazing Complies with ASTM E1300-02
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "Saflex IIIG Clear or colored Interlayer" dated 05/04/06, expiring on 05/21/11.
- F. STATEMENTS**
1. Statement letter of conformance and no financial interest, dated 05/29/08, signed and sealed by Warren Schaefer, P.E.
 2. Statement of compliance by lab, as part of above test reports.
- G. OTHER**
1. This NOA **revises & renews NOA # 04-0630.03**, which expired on July 17, 2008.
 2. Previous associated NOA # 03-0421.11




Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No. 08-0602.10

Expiration Date: July 17, 2013

Approval Date: August 14, 2008

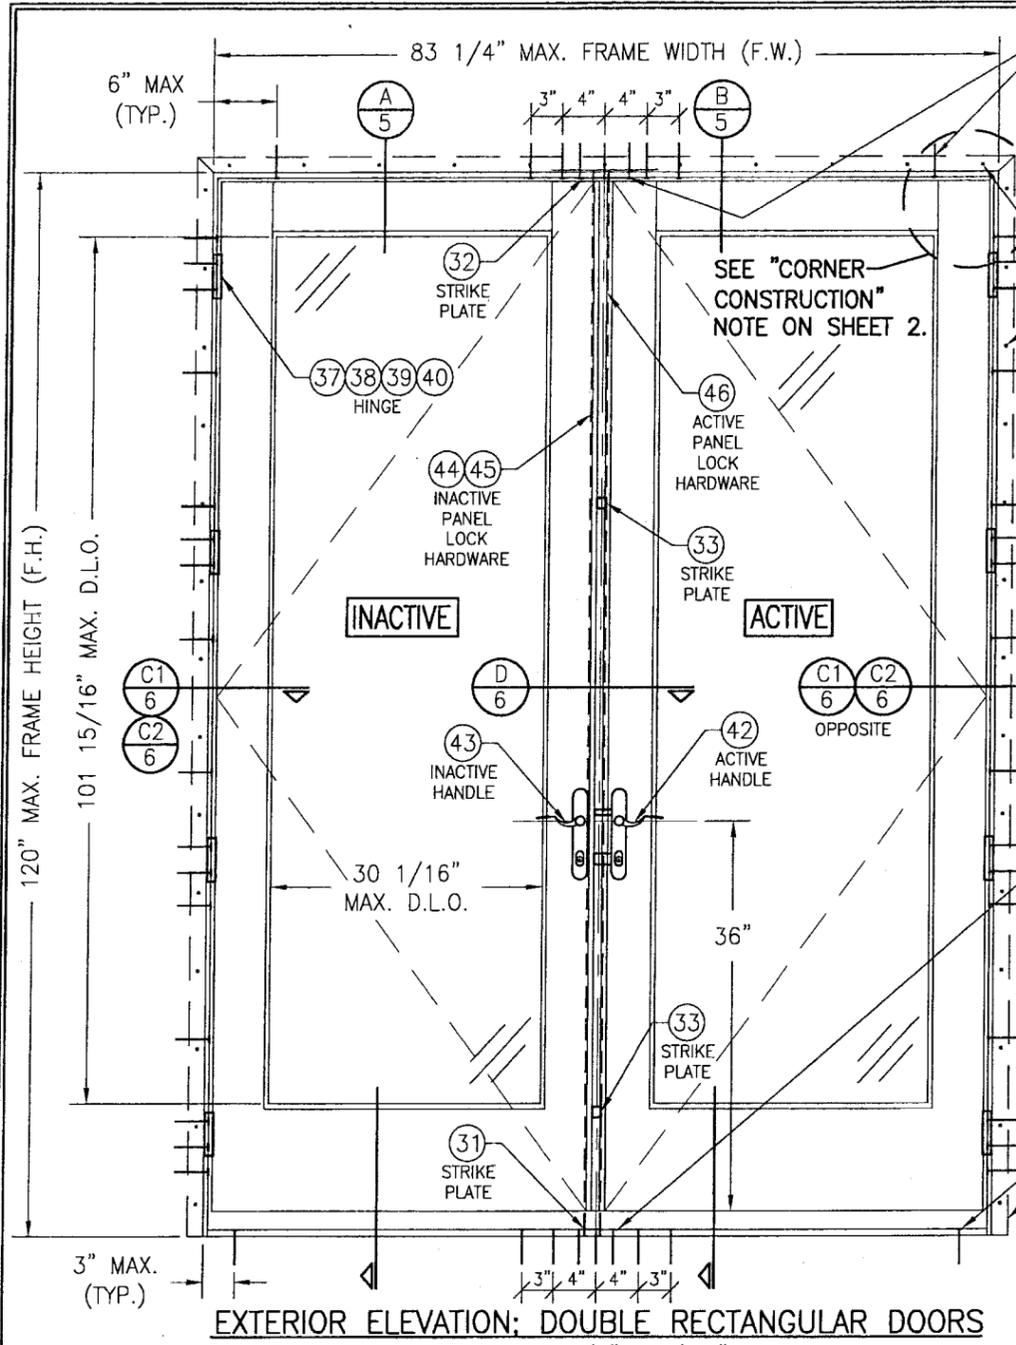

EXTERIOR ELEVATION; DOUBLE RECTANGULAR DOORS
SCALE: 3/4" = 1'-0"

TYPICAL FRAME SCREWS. PLACE ONE AT EACH HEAD JAMB CORNER, 3 AT HEAD MIDSPAN & 2 THRU STRIKE PLATE WITH DOORS 74" X 98" & SMALLER. 5 AT HEAD MIDSPAN & 2 THRU STRIKE PLATE WITH DOORS LARGER THAN 74" X 98" (50 SQ. FT.) SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON THIS SHEET FOR OTHER FASTENER REQUIREMENTS.


11 GA. X 1 1/2" ROOFING NAILS OR NO. 7 X 1 5/8" DRYWALL SCREWS SPACED AS REQUIRED TO SECURE & SEAL NAILING FIN

NO. 10 S.S. WOOD SCREW OR MIN. 3/16" CONCRETE SCREW (2 PER HINGE INTO SUPPORTING SUBSTRATE). SEE "FRAME ANCHOR REQUIREMENTS" TABLE ON THIS SHEET FOR OTHER FASTENER REQUIREMENTS.

FRAME SCREWS 6" MAX. FROM CORNERS & 12" MAX. O.C. (ONLY REQUIRED WITH DOORS TALLER THAN 98" AND/OR WIDER THAN 74")

TYPICAL FRAME SCREWS INTO SUBSTRATE. PLACE ONE AT EACH SILL CORNER, 3 AT SILL MIDSPAN & 3 THROUGH STRIKE PLATE WITH DOORS 74" X 98" & SMALLER. 5 AT SILL MIDSPAN & 3 THRU STRIKE PLATE WITH DOORS LARGER THAN 74" X 98" (50 SQ. FT.) SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON THIS SHEET FOR OTHER FASTENER REQUIREMENTS (APPLICABLE WITH BUMPER THRESHOLD. FOR ADA THRESHOLD CONDITION, SEE "ADA SILL DETAIL" ON SHEET 7).

NAILING FIN IS OPTIONAL & MAY BE SCORED AND REMOVED WHEN REQUIRED FOR A DIRECT MOUNT CONDITION. (NAIL FIN SHALL NOT ACT AS A SUBSTITUTE FOR THE FRAME SHEAR SCREWS SPECIFIED)

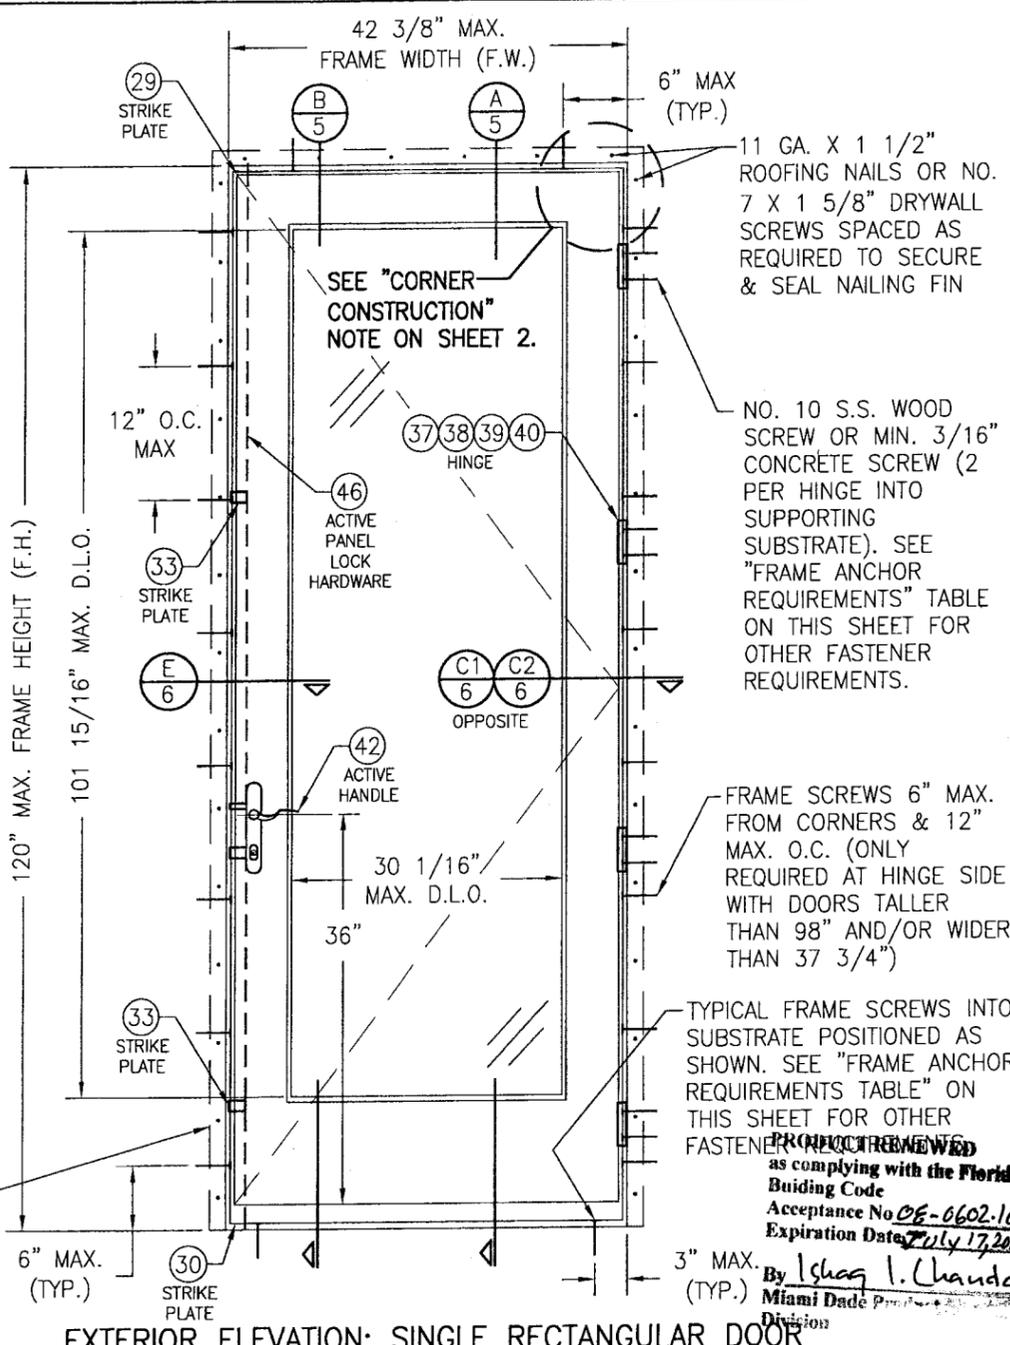

EXTERIOR ELEVATION; SINGLE RECTANGULAR DOOR
SCALE: 3/4" = 1'-0"

11 GA. X 1 1/2" ROOFING NAILS OR NO. 7 X 1 5/8" DRYWALL SCREWS SPACED AS REQUIRED TO SECURE & SEAL NAILING FIN

NO. 10 S.S. WOOD SCREW OR MIN. 3/16" CONCRETE SCREW (2 PER HINGE INTO SUPPORTING SUBSTRATE). SEE "FRAME ANCHOR REQUIREMENTS" TABLE ON THIS SHEET FOR OTHER FASTENER REQUIREMENTS.

FRAME SCREWS 6" MAX. FROM CORNERS & 12" MAX. O.C. (ONLY REQUIRED AT HINGE SIDE WITH DOORS TALLER THAN 98" AND/OR WIDER THAN 37 3/4")

TYPICAL FRAME SCREWS INTO SUBSTRATE POSITIONED AS SHOWN. SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON THIS SHEET FOR OTHER FASTENER REQUIREMENTS

GENERAL NOTES:

1. THESE DOOR SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S).
2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT DOORS.
5. THESE DOOR SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
6. IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE DOORS.
7. ALL ANCHORS SECURING DOOR FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
8. DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF $K_d = 0.85$ MAY BE APPLIED WHEN USED IN CONJUNCTION WITH LOAD COMBINATIONS SPECIFIED IN SECTION 2.0 OF THE ASCE 7 STANDARD.
9. NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR $C_d = 1.6$ WAS USED FOR WOOD SCREW ANALYSIS ONLY.
10. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.


FRAME ANCHOR REQUIREMENTS TABLE			
OPENING TYPE (SUBSTRATE)	JAMB TO OPENING FASTENER TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.
2X WOOD FRAME OR BUCK	NO. 10 SMS SCREW	1 1/4"	3/4"
(2) C-90 CMU OR MIN. 2500 PSI CONCRETE	(1) 3/16" CONCR. SCREW	1 1/4"	2"
(1) CONCRETE SCREWS SHALL BE ELCO OR ITW RAMSET/RED HEAD TAPCONS, HILTI KWIK-CON II OR POWERS RAWL TAPPER (HARDENED STEEL OR S.S.).			
(2) CMU IS NOT APPLICABLE AT THE HEAD & SILL (ONLY APPLICABLE AT SIDES)			

ALLOWABLE DESIGN LOAD	
SEE SHEET 2	

HINGE REQUIREMENTS	
DOOR HEIGHT	# HINGES REQ'D
ALL SIZES	4

***SHEAR SCREW ANCHOR NOTE:** FRAME MAY BE EITHER DIRECT MOUNTED TO THE OPENING, MOUNTED ONTO A CONTINUOUS SPACER, OR ANCHORED TO A MIN. 2x4 NO. 3 SOUTHERN PINE WOOD BUCK. WHEN ANCHORED TO A 2x4 BUCK, NO. 10 SCREWS SHALL BE USED. WHEN DIRECT MOUNTED OR MOUNTED WITH SPACER, 3/16" CONCRETE SCREW SHALL BE USED. SEE "FRAME ANCHOR REQUIREMENTS TABLE" FOR EMBED REQUIREMENTS. PROPER MATERIAL SHALL BE USED BETWEEN ALL DISIMILAR MATERIALS (BLOCK/CONCRETE & ALUMINUM).

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 02/20/03
REVISION DESCRIPTION	DATE
BY	BY
NO.	NO.
NO. 1	05/28/04
NO. 2	07/09/08
NO. 3	
NO. 4	
NO. 5	
NO. 6	
NO. 7	
NO. 8	
NO. 9	
NO. 10	
NO. 11	
NO. 12	
NO. 13	
NO. 14	
NO. 15	
NO. 16	
NO. 17	
NO. 18	
NO. 19	
NO. 20	
NO. 21	
NO. 22	
NO. 23	
NO. 24	
NO. 25	
NO. 26	
NO. 27	
NO. 28	
NO. 29	
NO. 30	
NO. 31	
NO. 32	
NO. 33	
NO. 34	
NO. 35	
NO. 36	
NO. 37	
NO. 38	
NO. 39	
NO. 40	
NO. 41	
NO. 42	
NO. 43	
NO. 44	
NO. 45	
NO. 46	
NO. 47	
NO. 48	
NO. 49	
NO. 50	
NO. 51	
NO. 52	
NO. 53	
NO. 54	
NO. 55	
NO. 56	
NO. 57	
NO. 58	
NO. 59	
NO. 60	
NO. 61	
NO. 62	
NO. 63	
NO. 64	
NO. 65	
NO. 66	
NO. 67	
NO. 68	
NO. 69	
NO. 70	
NO. 71	
NO. 72	
NO. 73	
NO. 74	
NO. 75	
NO. 76	
NO. 77	
NO. 78	
NO. 79	
NO. 80	
NO. 81	
NO. 82	
NO. 83	
NO. 84	
NO. 85	
NO. 86	
NO. 87	
NO. 88	
NO. 89	
NO. 90	
NO. 91	
NO. 92	
NO. 93	
NO. 94	
NO. 95	
NO. 96	
NO. 97	
NO. 98	
NO. 99	
NO. 100	
NO. 101	
NO. 102	
NO. 103	
NO. 104	
NO. 105	
NO. 106	
NO. 107	
NO. 108	
NO. 109	
NO. 110	
NO. 111	
NO. 112	
NO. 113	
NO. 114	
NO. 115	
NO. 116	
NO. 117	
NO. 118	
NO. 119	
NO. 120	
NO. 121	
NO. 122	
NO. 123	
NO. 124	
NO. 125	
NO. 126	
NO. 127	
NO. 128	
NO. 129	
NO. 130	
NO. 131	
NO. 132	
NO. 133	
NO. 134	
NO. 135	
NO. 136	
NO. 137	
NO. 138	
NO. 139	
NO. 140	
NO. 141	
NO. 142	
NO. 143	
NO. 144	
NO. 145	
NO. 146	
NO. 147	
NO. 148	
NO. 149	
NO. 150	
NO. 151	
NO. 152	
NO. 153	
NO. 154	
NO. 155	
NO. 156	
NO. 157	
NO. 158	
NO. 159	
NO. 160	
NO. 161	
NO. 162	
NO. 163	
NO. 164	
NO. 165	
NO. 166	
NO. 167	
NO. 168	
NO. 169	
NO. 170	
NO. 171	
NO. 172	
NO. 173	
NO. 174	
NO. 175	
NO. 176	
NO. 177	
NO. 178	
NO. 179	
NO. 180	
NO. 181	
NO. 182	
NO. 183	
NO. 184	
NO. 185	
NO. 186	
NO. 187	
NO. 188	
NO. 189	
NO. 190	
NO. 191	
NO. 192	
NO. 193	
NO. 194	
NO. 195	
NO. 196	
NO. 197	
NO. 198	
NO. 199	
NO. 200	
NO. 201	
NO. 202	
NO. 203	
NO. 204	
NO. 205	
NO. 206	
NO. 207	
NO. 208	
NO. 209	
NO. 210	
NO. 211	
NO. 212	
NO. 213	
NO. 214	
NO. 215	
NO. 216	
NO. 217	
NO. 218	
NO. 219	
NO. 220	
NO. 221	
NO. 222	
NO. 223	
NO. 224	
NO. 225	
NO. 226	
NO. 227	
NO. 228	
NO. 229	
NO. 230	
NO. 231	
NO. 232	
NO. 233	
NO. 234	
NO. 235	
NO. 236	
NO. 237	
NO. 238	
NO. 239	
NO. 240	
NO. 241	
NO. 242	
NO. 243	
NO. 244	
NO. 245	
NO. 246	
NO. 247	
NO. 248	
NO. 249	
NO. 250	
NO. 251	
NO. 252	
NO. 253	
NO. 254	
NO. 255	
NO. 256	
NO. 257	
NO. 258	
NO. 259	
NO. 260	
NO. 261	
NO. 262	
NO. 263	
NO. 264	
NO. 265	
NO. 266	
NO. 267	
NO. 268	
NO. 269	
NO. 270	
NO. 271	
NO. 272	
NO. 273	
NO. 274	
NO. 275	
NO. 276	
NO. 277	
NO. 278	
NO. 279	
NO. 280	
NO. 281	
NO. 282	
NO. 283	
NO. 284	
NO. 285	
NO. 286	
NO. 287	
NO. 288	
NO. 289	
NO. 290	
NO. 291	
NO. 292	
NO. 293	
NO. 294	
NO. 295	
NO. 296	
NO. 297	
NO. 298	
NO. 299	
NO. 300	
NO. 301	
NO. 302	
NO. 303	
NO. 304	
NO. 305	
NO. 306	
NO. 307	
NO. 308	
NO. 309	
NO. 310	
NO. 311	
NO. 312	
NO. 313	
NO. 314	
NO. 315	
NO. 316	
NO. 317	
NO. 318	
NO. 319	
NO. 320	
NO. 321	
NO. 322	
NO. 323	
NO. 324	
NO. 325	
NO. 326	
NO. 327	
NO. 328	
NO. 329	
NO. 330	
NO. 331	
NO. 332	
NO. 333	
NO. 334	
NO. 335	
NO. 336	
NO. 337	
NO. 338	
NO. 339	
NO. 340	
NO. 341	
NO. 342	
NO. 343	
NO. 344	
NO. 345	
NO. 346	
NO. 347	
NO. 348	
NO. 349	
NO. 350	
NO. 351	
NO. 352	
NO. 353	
NO. 354	
NO. 355	
NO. 356	
NO. 357	
NO. 358	
NO. 359	
NO. 360	
NO. 361	
NO. 362	
NO. 363	
NO. 364	
NO. 365	
NO. 366	
NO. 367	
NO. 368	
NO. 369	
NO. 370	
NO. 371	
NO. 372	
NO. 373	
NO. 374	
NO. 375	
NO. 376	
NO. 377	
NO. 378	
NO. 379	
NO. 380	
NO. 381	
NO. 382	
NO. 383	
NO. 384	
NO. 385	
NO. 386	
NO. 387	
NO. 388	

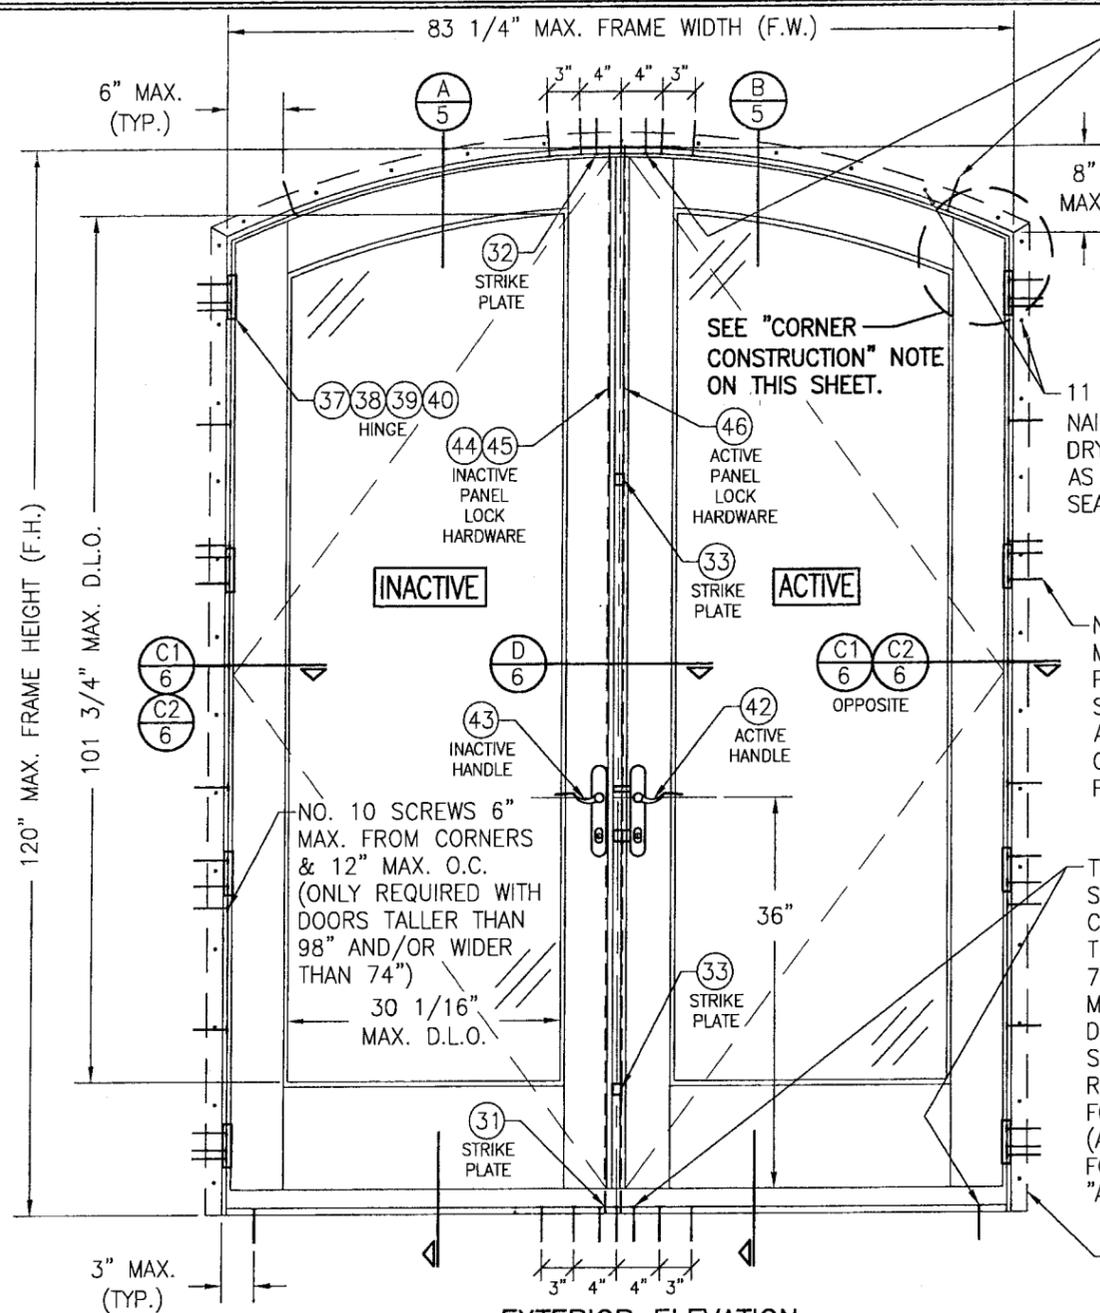

**EXTERIOR ELEVATION
DOUBLE EYEBROW TOP OUTSWING DOOR**
SCALE: 3/4" = 1'-0"


TYPICAL FRAME SCREWS. PLACE ONE AT EACH HEAD JAMB CORNER, 3 AT HEAD MIDSPAN & 2 THRU STRIKE PLATE WITH DOORS 74" X 98" & SMALLER. 5 AT HEAD MIDSPAN & 2 THRU STRIKE PLATE WITH DOORS LARGER THAN 74" X 98" (50 SQ. FT.) SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON SHEET 1 FOR OTHER FASTENER REQUIREMENTS.

11 GA. X 1 1/2" ROOFING NAILS OR NO. 7 X 1 5/8" DRYWALL SCREWS SPACED AS REQUIRED TO SECURE & SEAL NAILING FIN

NO. 10 S.S. WOOD SCREW OR MIN. 3/16" CONCRETE SCREW (2 PER HINGE INTO SUPPORTING SUBSTRATE). SEE "FRAME ANCHOR REQUIREMENTS" TABLE ON SHEET 1 FOR OTHER FASTENER REQUIREMENTS.

TYPICAL FRAME SCREWS INTO SUBSTRATE. PLACE ONE AT EACH SILL CORNER, 3 AT SILL MIDSPAN & 3 THROUGH STRIKE PLATE WITH DOORS 74" X 98" & SMALLER. 5 AT SILL MIDSPAN & 3 THRU STRIKE PLATE WITH DOORS LARGER THAN 74" X 98" (50 SQ. FT.) SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON SHEET 1 FOR OTHER FASTENER REQUIREMENTS (APPLICABLE WITH BUMPER THRESHOLD. FOR ADA THRESHOLD CONDITION, SEE "ADA SILL DETAIL" ON SHEET 7).

NAILING FIN IS OPTIONAL & MAY BE SCORED AND REMOVED WHEN REQUIRED FOR A DIRECT MOUNT CONDITION. (NAIL FIN SHALL NOT ACT AS A SUBSTITUTE FOR THE FRAME SHEAR SCREWS SPECIFIED)

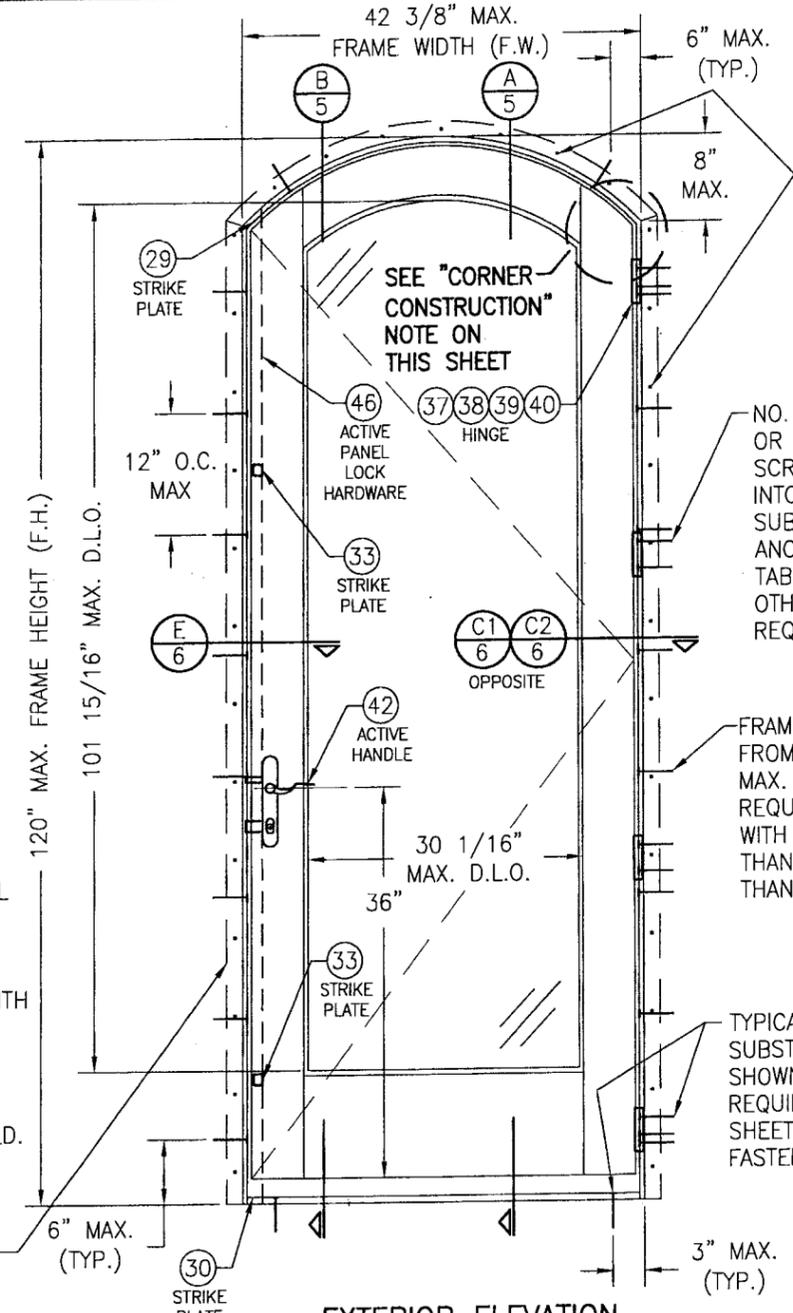

**EXTERIOR ELEVATION
SINGLE EYEBROW TOP OUTSWING DOOR**
SCALE: 3/4" = 1'-0"

11 GA. X 1 1/2" ROOFING NAILS OR NO. 7 X 1 5/8" DRYWALL SCREWS SPACED AS REQUIRED TO SECURE & SEAL NAILING FIN

NO. 10 S.S. WOOD SCREW OR MIN. 3/16" CONCRETE SCREW (2 PER HINGE INTO SUPPORTING SUBSTRATE). SEE "FRAME ANCHOR REQUIREMENTS" TABLE ON SHEET 1 FOR OTHER FASTENER REQUIREMENTS.

FRAME SCREWS 6" MAX. FROM CORNERS & 12" MAX. O.C. (ONLY REQUIRED AT HINGE SIDE WITH DOORS TALLER THAN 98" AND/OR WIDER THAN 37 3/4")

TYPICAL FRAME SCREWS INTO SUBSTRATE POSITIONED AS SHOWN. SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON SHEET 1 FOR OTHER FASTENER REQUIREMENTS.

FRAME CORNER CONSTRUCTION

AT EACH RECTANGULAR DOOR HEAD CORNER AND ALL SIDELITE CORNERS, THE WOOD FRAME MEMBERS ARE DADO CUT, GLUED, PLACED TOGETHER AND MECHANICALLY FASTENED WITH (3) #8 X 2 1/2" LONG DRYWALL SCREWS.
AT EACH DOOR SILL CORNER, THE WOOD FRAME MEMBERS ARE SQUARE CUT, SEALED WITH A GASKET & SILICONE ON THE INTERIOR AND SECURED WITH (3) 2 1/2" DRYWALL SCREWS. A 3/4" HIGH OAK THRESHOLD IS SEALED TO THE SILL WITH SILICONE BACK BEDDING AND SECURED WITH SCREWS TO THE WOOD SUB-SILL.
AT EACH DOOR SILL CORNER WITH ADA SILL, THE WOOD FRAME MEMBERS ARE SQUARE CUT AND MECHANICALLY FASTENED WITH (2) #9 X 2" LONG FLATHEAD SCREWS.
THE ALUMINUM FRAME CLADDING MEMBERS ARE MITER CUT AND MECHANICALLY FASTENED TOGETHER USING (1) 1 1/4" SCREW OR (1) #6 X 1" LONG SCREW WITH #5 HEAD AT EACH CORNER.

SASH CORNER CONSTRUCTION


AT EACH CORNER THE WOOD SASH MEMBER ENDS ARE SQUARE CUT, SEALED WITH A SINGLE BEAD OF SILICONE, WOOD GLUED TO THE WOOD JOINT SURFACES AND SECURED WITH 3/4" DIA. X 3" LONG DOWELS, (2) PER TOP CORNER & (4) PER BOTTOM CORNER.
THE ALUMINUM MEMBERS ARE SLIP FITTED TO THE ADJACENT PANEL MEMBER AT EACH CORNER.

ALLOWABLE DESIGN LOAD (PSF)

SINGLE DOORS WITH MAX. F.H. = 98" & MAX. F.W. = 37 3/4"	+60/-75
SINGLE DOORS WITH F.H. GREATER THAN 98" OR F.W. GREATER THAN 37 3/4"	+60/-60
DOUBLE DOORS WITH MAX. F.H. = 98" & MAX. F.W. = 74"	+60/-75
DOUBLE DOORS WITH F.H. GREATER THAN 98" OR F.W. GREATER THAN 74"	+60/-60

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 08-6602-10
Expiration Date July 17, 2012
By Isang I. Chaudhry
Miami Dade Product Contr.
Division

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 02/20/03
DATE	BY
REVISION DESCRIPTION	NO.
ALUMINUM CLAD FRENCH OUTSWING DOORS MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
DRAWING TITLE ALUMINUM CLAD FRENCH OUTSWING DOORS	
CERTIFICATION JUL 09 2008 W. W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1211	REV. B
SHEET NO. 2 OF 8	

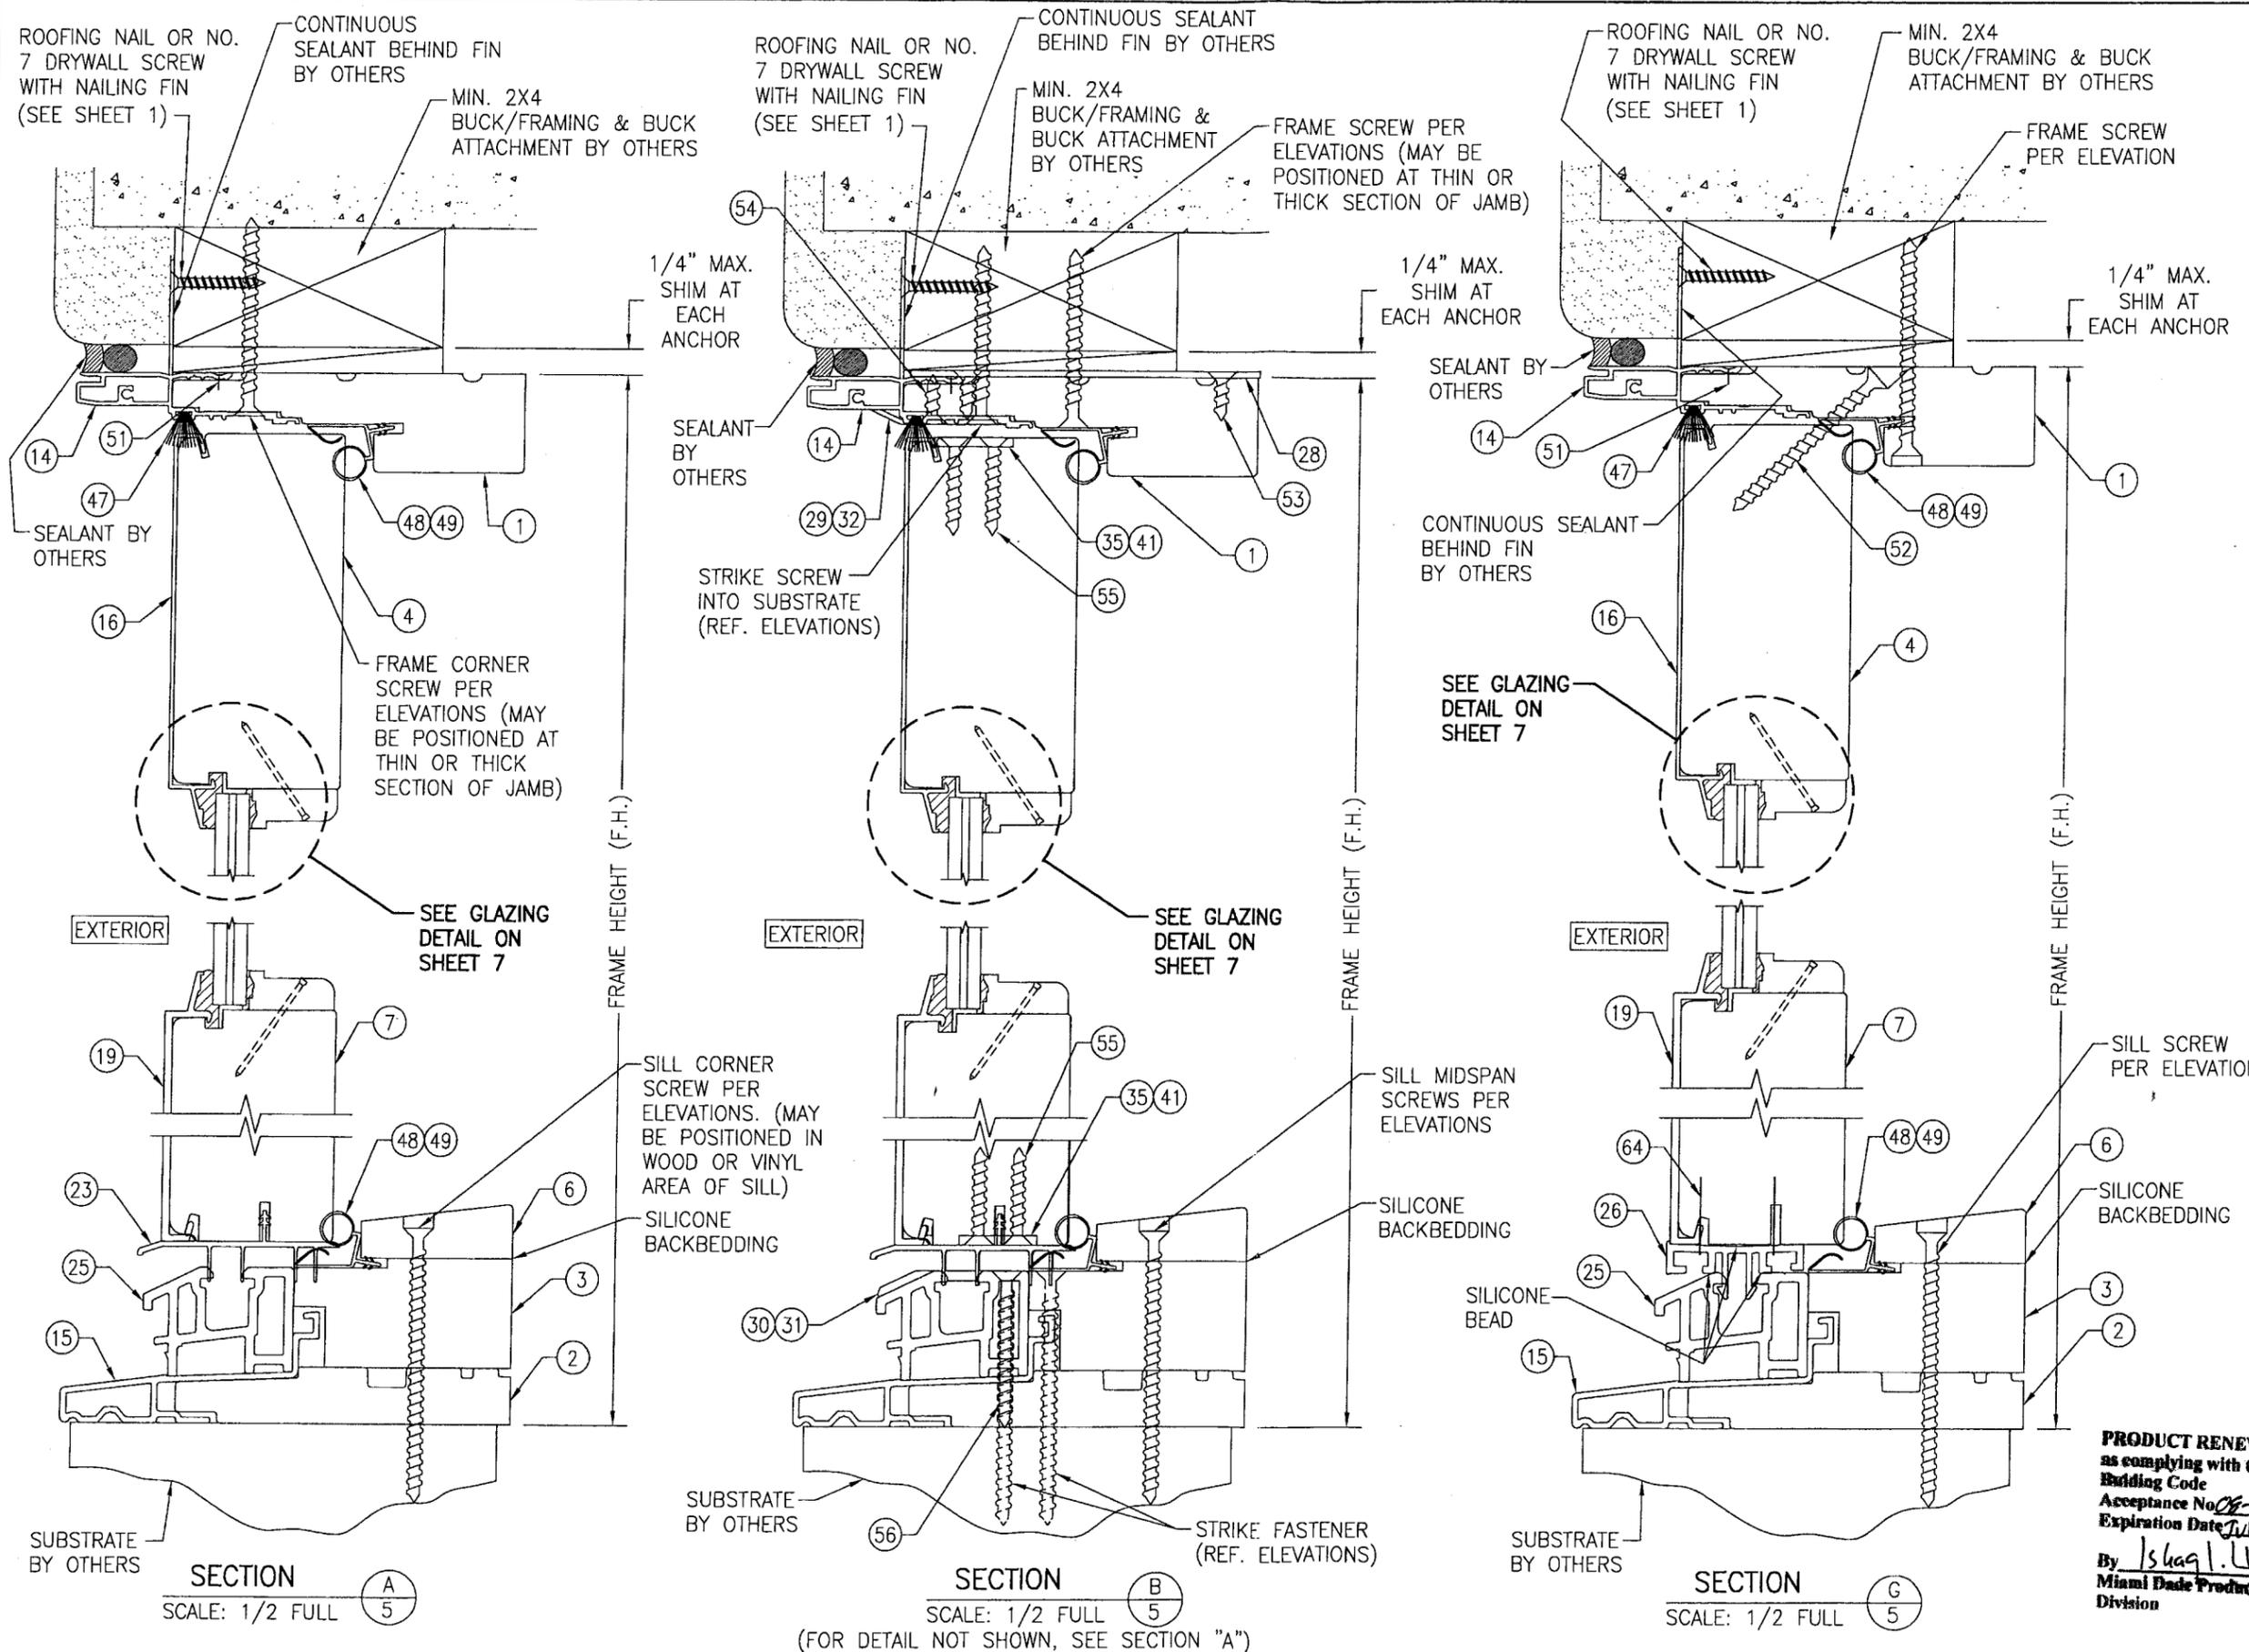

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
DATE:	DATE: 02/20/03
NO.	REVISION DESCRIPTION

ALUMINUM CLAD FRENCH OUTSWING DOORS


MANUFACTURER
WEATHER SHIELD WINDOWS & DOORS
 ONE WEATHER SHIELD PLAZA
 MEDFORD, WI 54451
 715-748-6555

CONSULTANTS
W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
 8895 N. MILITARY TRAIL, SUITE C-204
 PALM BEACH GARDENS, FL 33410
 PHONE: 561-775-4902 FAX: 561-775-4903


CERTIFICATION
 JUL 09 2008
 WARREN W. SCHAEFER, P.E.
 P.E. NO. 44135

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No. 08-0602-10
 Expiration Date July 17, 2013
 By Ishaq I. Ullah
 Miami Dade Product Control Division


DRAWING NO. 1211	REV. B
SHEET NO. 5 OF 8	

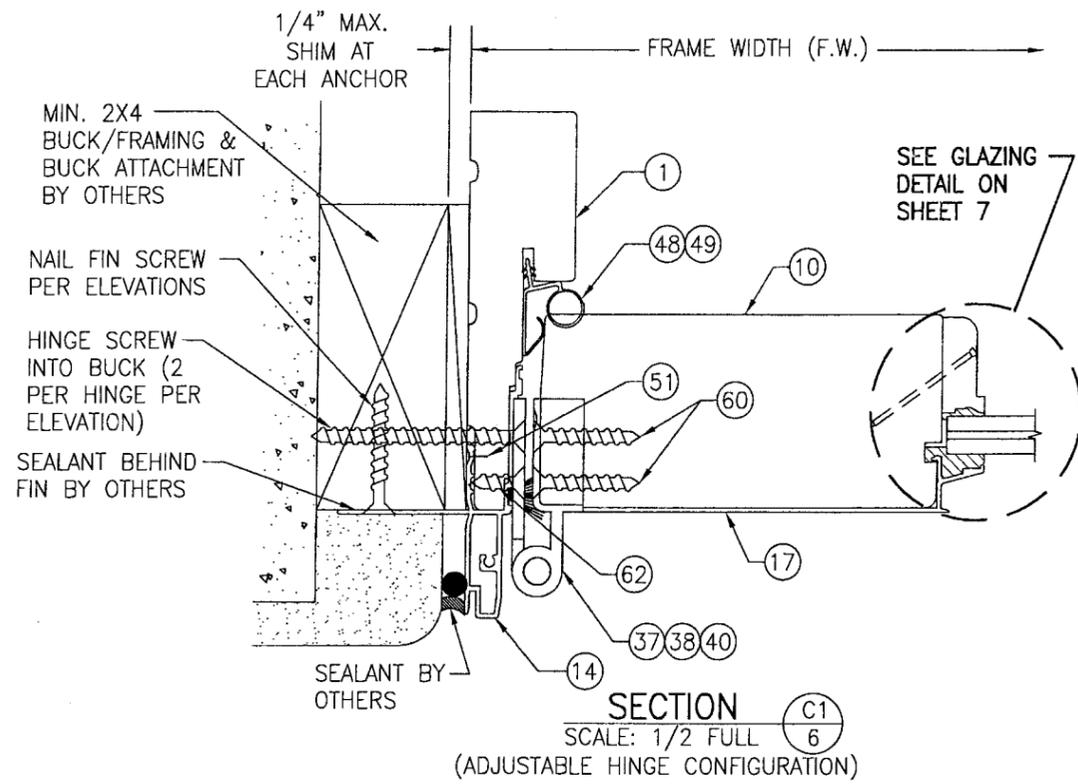


SECTION C1
SCALE: 1/2 FULL
(ADJUSTABLE HINGE CONFIGURATION)

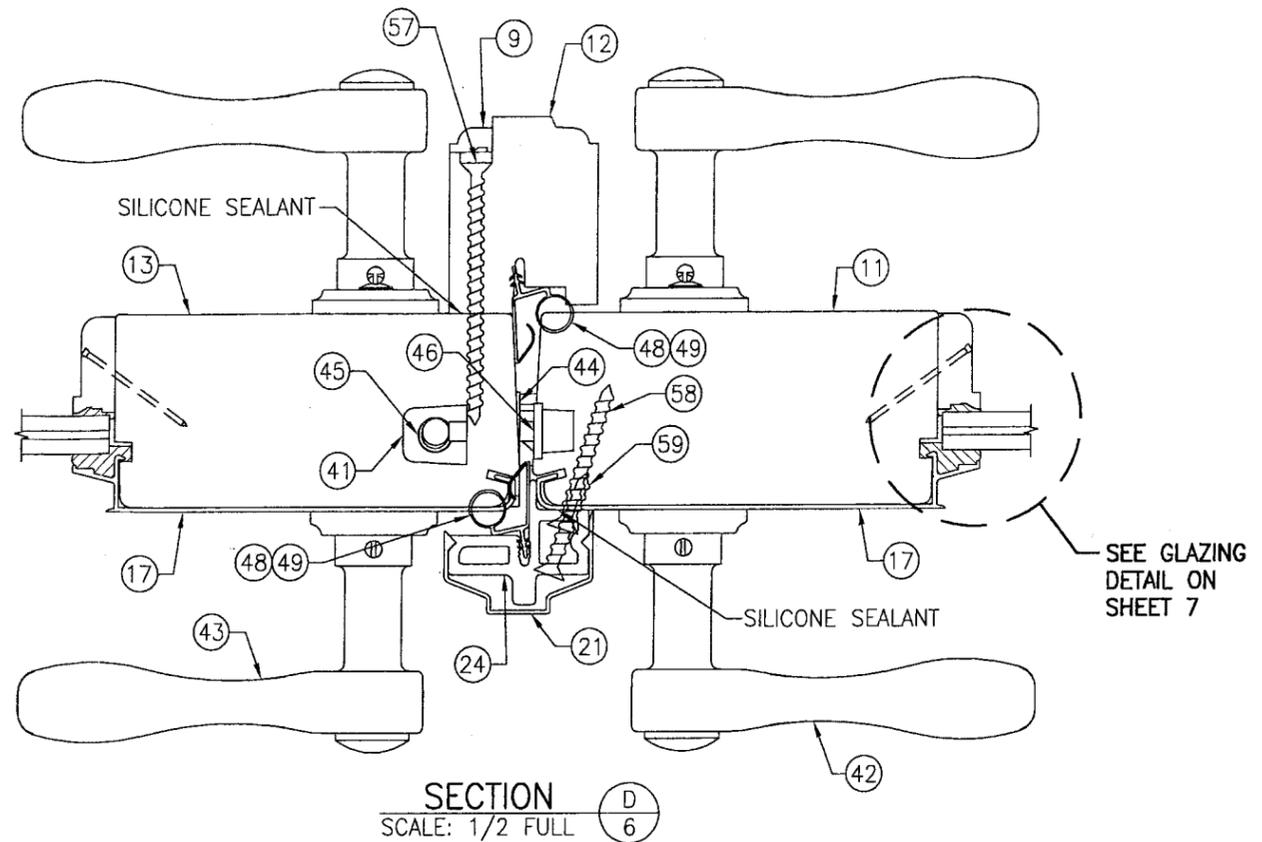

SECTION D
SCALE: 1/2 FULL

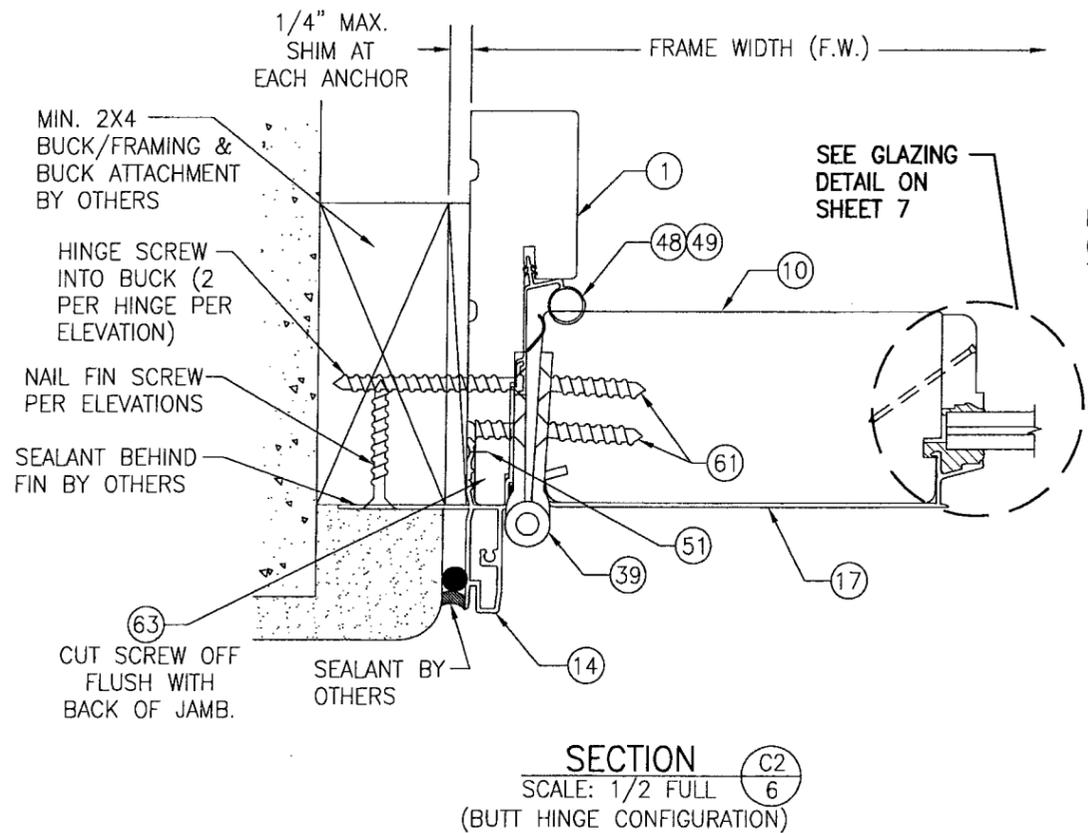


SECTION C2
SCALE: 1/2 FULL
(BUTT HINGE CONFIGURATION)

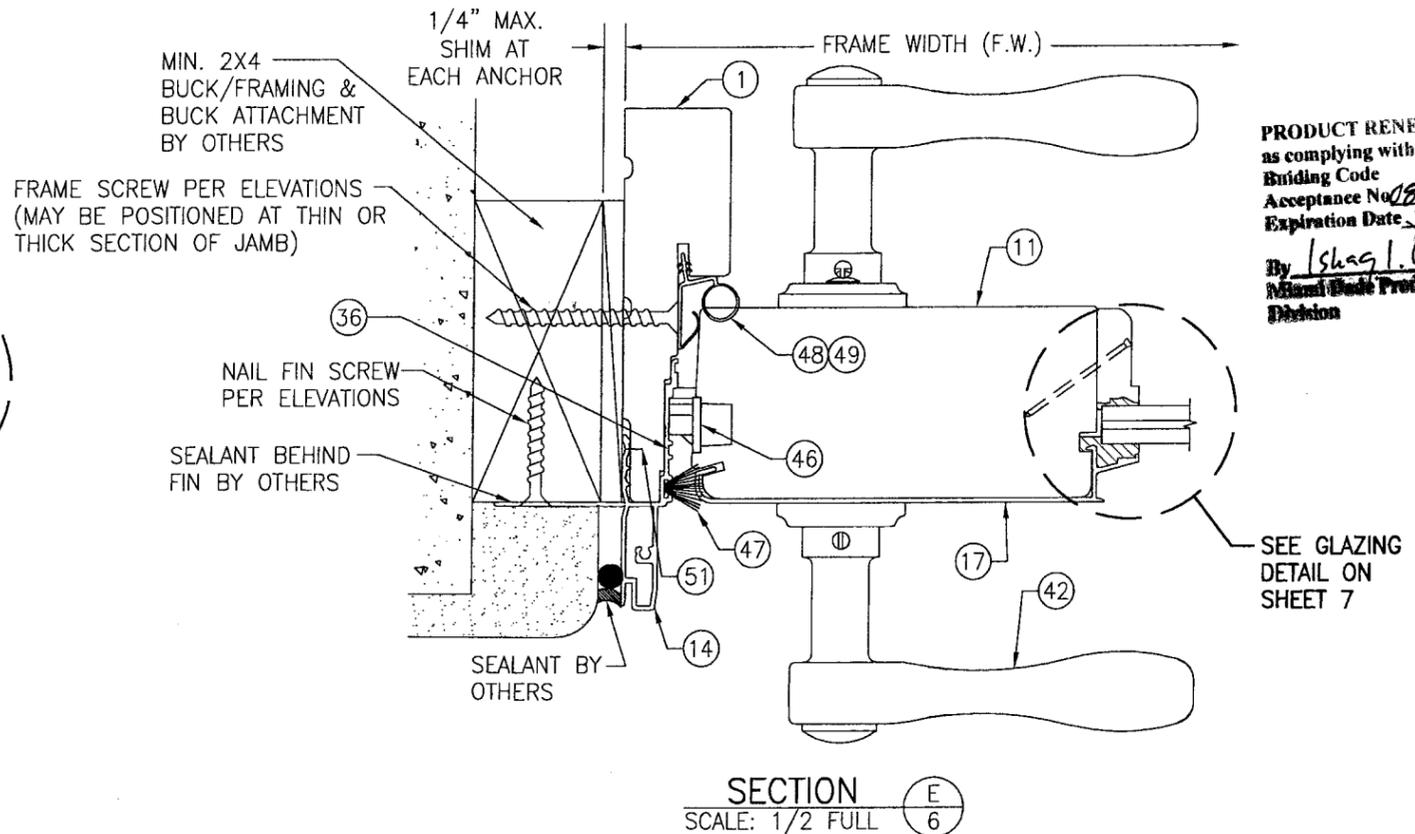

SECTION E
SCALE: 1/2 FULL

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 02/20/03
NO.	REVISION DESCRIPTION
DATE	BY
DRAWING TITLE ALUMINUM CLAD FRENCH OUTSWING DOORS	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.	MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555
PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. <u>08-0602.10</u> Expiration Date <u>July 17, 2011</u> By <u>Ishag I. Chamsa</u> Miami Code Product Control Division	
CERTIFICATION W. W. SCHAEFER, P.E. 8885 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903 P.E. NO. 44135	
DRAWING NO. 1211	REV. B
SHEET NO. 6 OF 8	

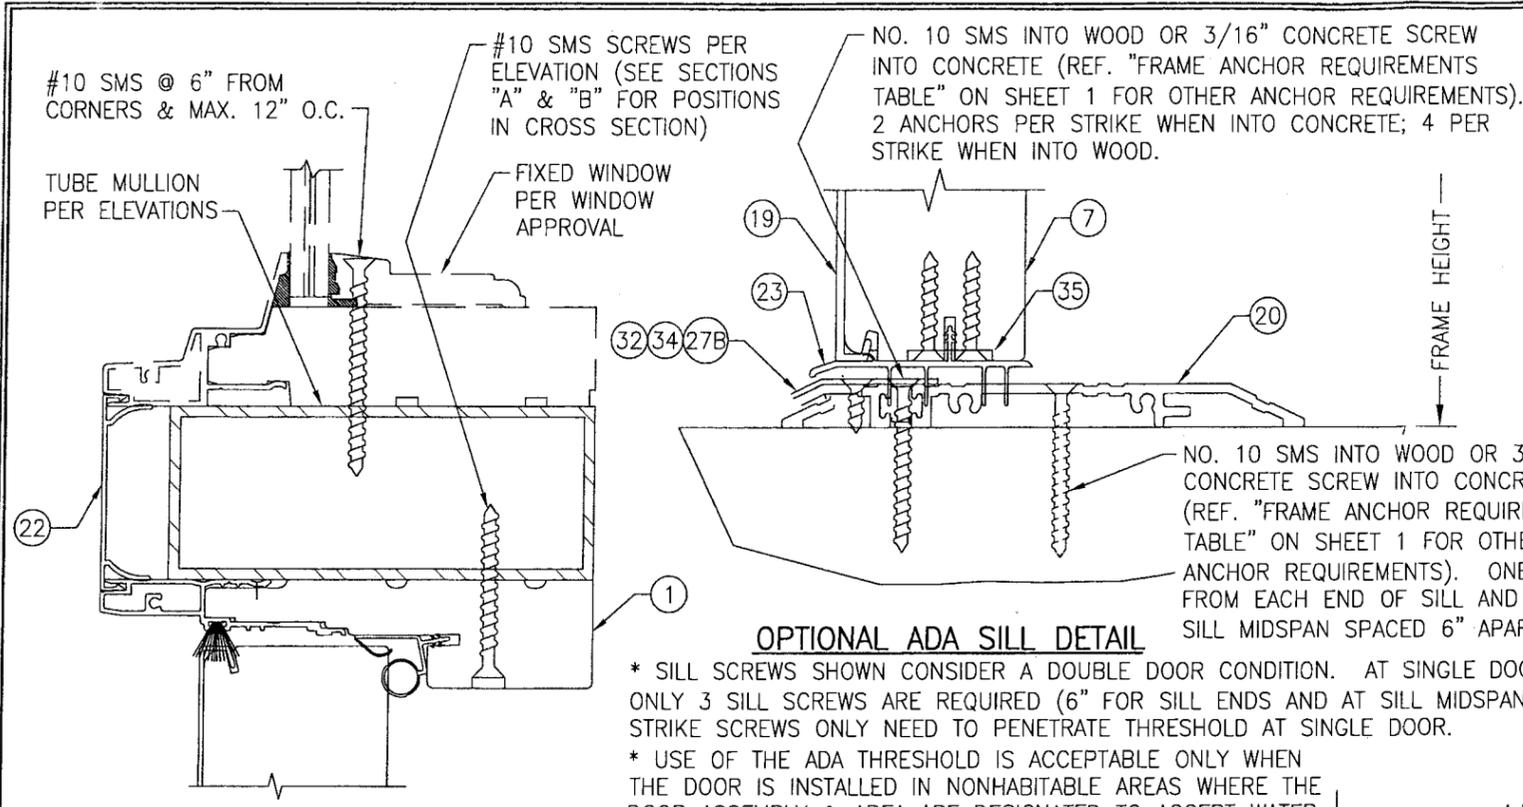


OPTIONAL ADA SILL DETAIL


* SILL SCREWS SHOWN CONSIDER A DOUBLE DOOR CONDITION. AT SINGLE DOORS, ONLY 3 SILL SCREWS ARE REQUIRED (6" FOR SILL ENDS AND AT SILL MIDSPAN). STRIKE SCREWS ONLY NEED TO PENETRATE THRESHOLD AT SINGLE DOOR.

* USE OF THE ADA THRESHOLD IS ACCEPTABLE ONLY WHEN THE DOOR IS INSTALLED IN NONHABITABLE AREAS WHERE THE DOOR ASSEMBLY & AREA ARE DESIGNATED TO ACCEPT WATER INFILTRATION OR IF INSTALLED BELOW AN OVERHANG WHERE THE OVERHANG (OH) RATIO IS EQUAL TO OR MORE THAN 1 (OH RATIO = OH LENGTH/OH HEIGHT).


SECTION F
SCALE: 1/2 FULL
(FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)

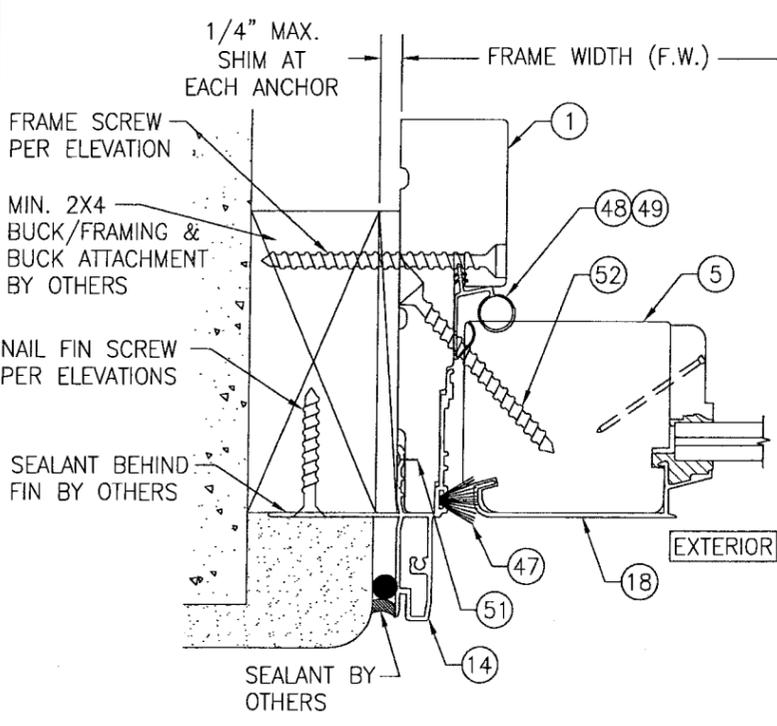

SECTION H
SCALE: 1/2 FULL

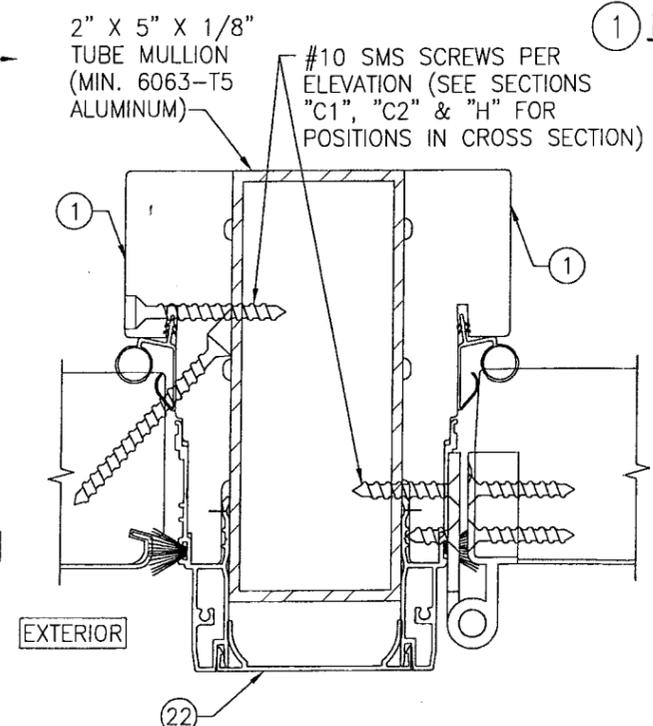


SECTION J
SCALE: 1/2 FULL
(FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)

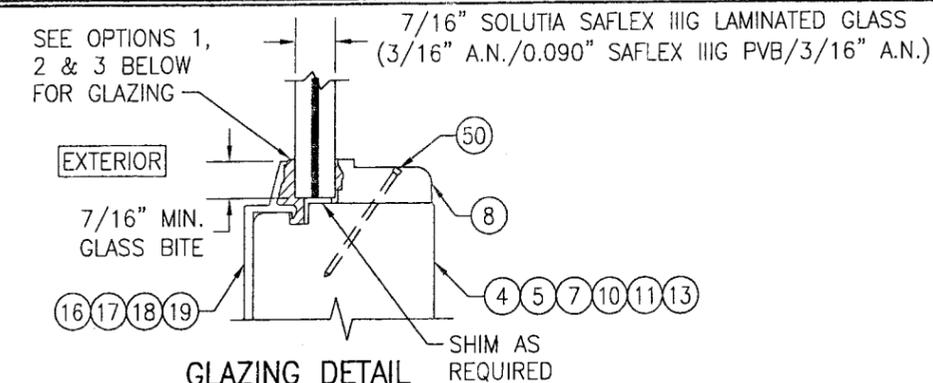

GLAZING DETAIL

- GLAZING OPTION 1) NOVA GUARD BC4-121 STRUCTURAL SILICONE @ INTERIOR & NOVA GUARD M418 STRUCTURAL SILICONE @ EXTERIOR
- GLAZING OPTION 2) GE SILGLAZE HC STRUCTURAL SILICONE @ INTERIOR & GE ULTRA GLAZE STRUCTURAL SILICONE @ EXTERIOR
- GLAZING OPTION 3) DOW CORNING 899 STRUCTURAL SILICONE @ INTERIOR & GE ULTRA GLAZE STRUCTURAL SILICONE @ EXTERIOR
- GLAZING OPTION 4) GE 1311 SILGLAZE HC STRUCTURAL SILICONE @ INTERIOR & GE RAPIDSTRENGTH SILGLAZE STRUCTURAL SILICONE @ EXTERIOR
- GLAZING OPTION 5) DOW CORNING 899 STRUCTURAL SILICONE @ INTERIOR & DOW INSTANTGLAZE STRUCTURAL SILICONE @ EXTERIOR
- GLAZING OPTION 6) SIKA SIKAFLEX 552 STRUCTURAL SILICONE @ INTERIOR & EXTERIOR


NOTE: GLAZING OPTIONS 1, 2 & 3 ONLY ALLOWABLE FOR D.L.O. 25 7/16" X 79 15/16" AND SMALLER. GLAZING OPTIONS 4, 5 & 6 ARE ALLOWABLE FOR ALL SIZES.

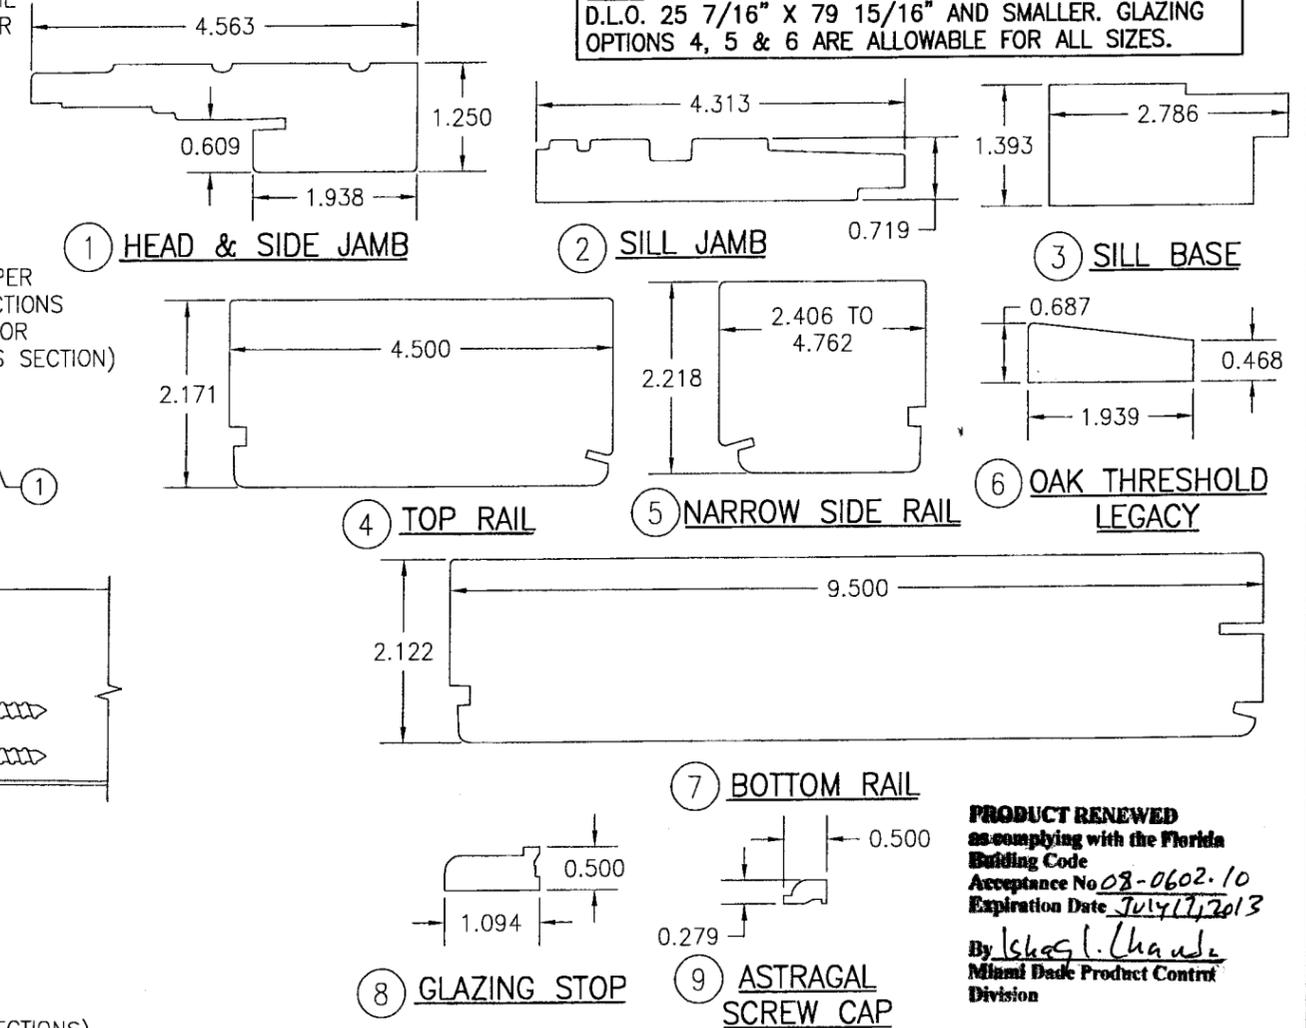

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No 08-0602-10
Expiration Date July 17, 2013
By Ishag L. Chaudhry
Miami Dade Product Control Division

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 02/20/03
REVISION DESCRIPTION	NO.
ALUMINUM CLAD FRENCH OUTSWING DOORS MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
DRAWING TITLE ALUMINUM CLAD FRENCH OUTSWING DOORS	
CERTIFICATION JUL 17 2013 W. W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1211	REV. B
SHEET NO. 7 OF 8	

ITEM #	DRAWING #	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS			
1	08-1006-C2503	HEAD & SIDE JAMB	* WOOD
2	08-0002-W2402	SILL JAMB	* WOOD
3	08-0004-W2402	SILL BASE	* WOOD
4	08-1072-W2427	TOP RAIL	* WOOD
5	08-1075-W2427	NARROW SIDE RAIL	* WOOD
6	08-W5074	OAK THRESHOLD LEGACY	* WOOD
7	08-1071-W2427	BOTTOM RAIL	* WOOD
8	08-1680-02	GLAZING STOP	* WOOD
9	08-W8075	ASTRAGAL SCREW CAP	* WOOD
10	08-1087-C2537	HINGE STILE	* WOOD
11	08-1088-C2537	LOCK STILE	* WOOD
12	08-1611-02	INTERIOR ASTRAGAL	* WOOD
13	08-1089-C2537	INACTIVE MEETING STILE	* WOOD
14	04-0004-C2403	HEAD & SIDE FRAME CLADDING	6063-T5 OR 6063-T4 ALUMINUM
15	04-0009-W2402	SILL JAMB CLADDING	6063-T5 ALUMINUM
16	04-0056-C2427	TOP RAIL PROFILE	6063-T5 ALUMINUM
17	04-0016-C2033	STILE PROFILE	6063-T5 ALUMINUM
18	04-0018-C2033	NARROW STILE PROFILE	6063-T5 ALUMINUM
19	04-0015-C2022	BOTTOM RAIL PROFILE	6063-T5 ALUMINUM
20	04-0050-W1802	HANDICAP SILL	6063-T5 ALUMINUM
21	04-0011-W2487	EXTERIOR ASTRAGAL COVER	6063-T5 ALUMINUM
22	04-A1621	MULLION COVER	6063-T5 ALUMINUM
23	02-1514-02	BOTTOM SWEEP	VINYL
24	04-0010-W2487	ASTRAGAL BASE	6063-T5 ALUMINUM
25	02-0005-W2402	THRESHOLD	VINYL
26	02-0006-W2402	STATIONARY SILL FILLER CLIP	VINYL
27A	12-0017-W2471	GROMMET	PVC
27B	12-0209-W2596	SINGLE PANEL GROMMET	PVC
28	12-1557-02	HEAD JAMB BACKER PLATE (10.125" X 4.50" X .080")	STAINLESS STEEL
29	12-0011-W2401	SINGLE DOOR TOP BOLT STRIKE PLATE (1.495" X 1.320" X .119")	304 S.S.
30	12-1463-02	SINGLE DOOR SILL BOLT STRIKE PLATE (2.853" X .800" X .120")	304 S.S.
31	12-1464-02	DOUBLE DOOR SILL STRIKE PLATE (4.000" X 2.817" X .125")	304 S.S.
32	12-1465-02	DOUBLE DOOR HEAD STRIKE PLATE (5.634" X 1.762" X .060")	304 S.S.
33	12-0013-W2403	TONGUE STIKE PLATE (5.000" X 1.000" X .059")	304 S.S.
34	12-0211-W2596	ADA SINGLE DOOR STRIKE PLATE (3.028" X 1.000" X .060")	304 S.S.
35	12-1291-02	PANEL CORNER REINFORCEMENT BAR (10.100" X 1.000" X .120")	304 S.S. - 1 PER PANEL CORNER
36	12-1286-02	SINGLE DOOR STILE LOCK STRIKE (9.331" X 1.320" X .118")	304 S.S.
HARDWARE			
37	12-0001-W2477	VERTICAL ADJUSTABLE HINGE (PLATED STEEL OR S.S.)	VARIANT HEAVY DUTY OR MILLENIUM STANDARD
38	12-0002-W2477	HORIZONTAL ADJUSTABLE HINGE (PLATED STEEL OR S.S.)	VARIANT HEAVY DUTY OR MILLENIUM STANDARD
39	12-1594-02	4" X 4" BUTT HINGE (PLATED STEEL OR S.S.)	HAGER 1191
40	12-1718-02	VARIANT HINGE (PLATED STEEL OR S.S.)	SIMONS-WERK
41	12-1601-02	10 MM SHOOT BOLT GUIDE	NYLON 6, 30% GLASS FIBER
42	12-1624-02	ACTIVE HANDLE SET WITH KEYED CYLINDER	AS REQUIRED TO OPERATE DOOR LOCKS
43	12-1625-02	INACTIVE HANDLE SET	AS REQUIRED TO OPERATE DOOR LOCKS
44	12-1607-02	2-POINT CONCEALED INACTIVE PANEL LOCK SET	HOPPE
45	12-1558-02	.38 TOP & BOTTOM EXTENSION ROD CONCEALED	HOPPE NORTH AMERICA HLS SERIES
46	12-1576-02	5-POINT ACTIVE PANEL LOCK ASSY. W/SHOOT BOLTS	HOPPE NORTH AMERICA HLS 9000 SERIES
SEALS & SEALANTS			
47	12-0050-W2463	HEAD & SIDE TFT WEATHERSTRIP	POLYPROPYLENE
48	12-0005-P2262	INTEK ARLOC WEATHERSTRIP	VINYL
49	12-1602-02	AMESBURY WEATHERSTRIP	VINYL
FASTENERS			
50	-	F16 X 1 1/2" BRAD NAIL	2" FROM ENDS & 13" MAX. O.C.
51	-	3/16" X 1 1/2" STAPLE	3" FROM ENDS & 20" MAX. O.C.
52	-	NO. 8 X 2 1/2" DRYWALL SCREW	3" FROM ENDS & 16" MAX. O.C.
53	-	NO. 7 X 5/8" FH WOOD SCREW	8 PER HEAD JAMB BACKER PLATE
54	-	NO. 7 X 5/8" FH WOOD SCREW	2 PER HEAD STRIKE PLATE
55	-	NO. 8 X 1 1/4" WOOD SCREW	4 PER CORNER REINFORCEMENT PLATE
56	-	NO. 8 X 1 1/2" FH SMS SCREW	1 PER SINGLE/2 PER DOUBLE STRIKE PLATE
57	-	NO. 8 X 3" FH WOOD SCREW	2" FROM ASTRAGAL ENDS & 6" O.C.
58	-	NO. 8 X 2" FH DRYWALL SCREW	1 1/2" & 2 1/2" FROM PANEL ENDS
59	-	NO. 8 X 1 1/4" WOOD SCREW	10" FROM ASTRAGAL ENDS & 8" O.C.
60	-	NO. 8 X 1 1/4" WOOD SCREW	4 PER ADJUSTABLE HINGE INTO STILE
61	-	NO. 12 X 1 1/4" FH WOOD SCREW	4 PER BUTT HINGE INTO STILE
62	-	NO. 8 X 5/8" FH WOOD SCREW	2 PER ADJUSTABLE HINGE INTO JAMB
63	-	NO. 12 X 1 1/4" FH WOOD SCREW	2 PER BUTT HINGE INTO JAMB
64	-	NO. 18 X 1/2" X 1" S.S. STAPLE	2" FROM ENDS & 4" TO 6" O.C.

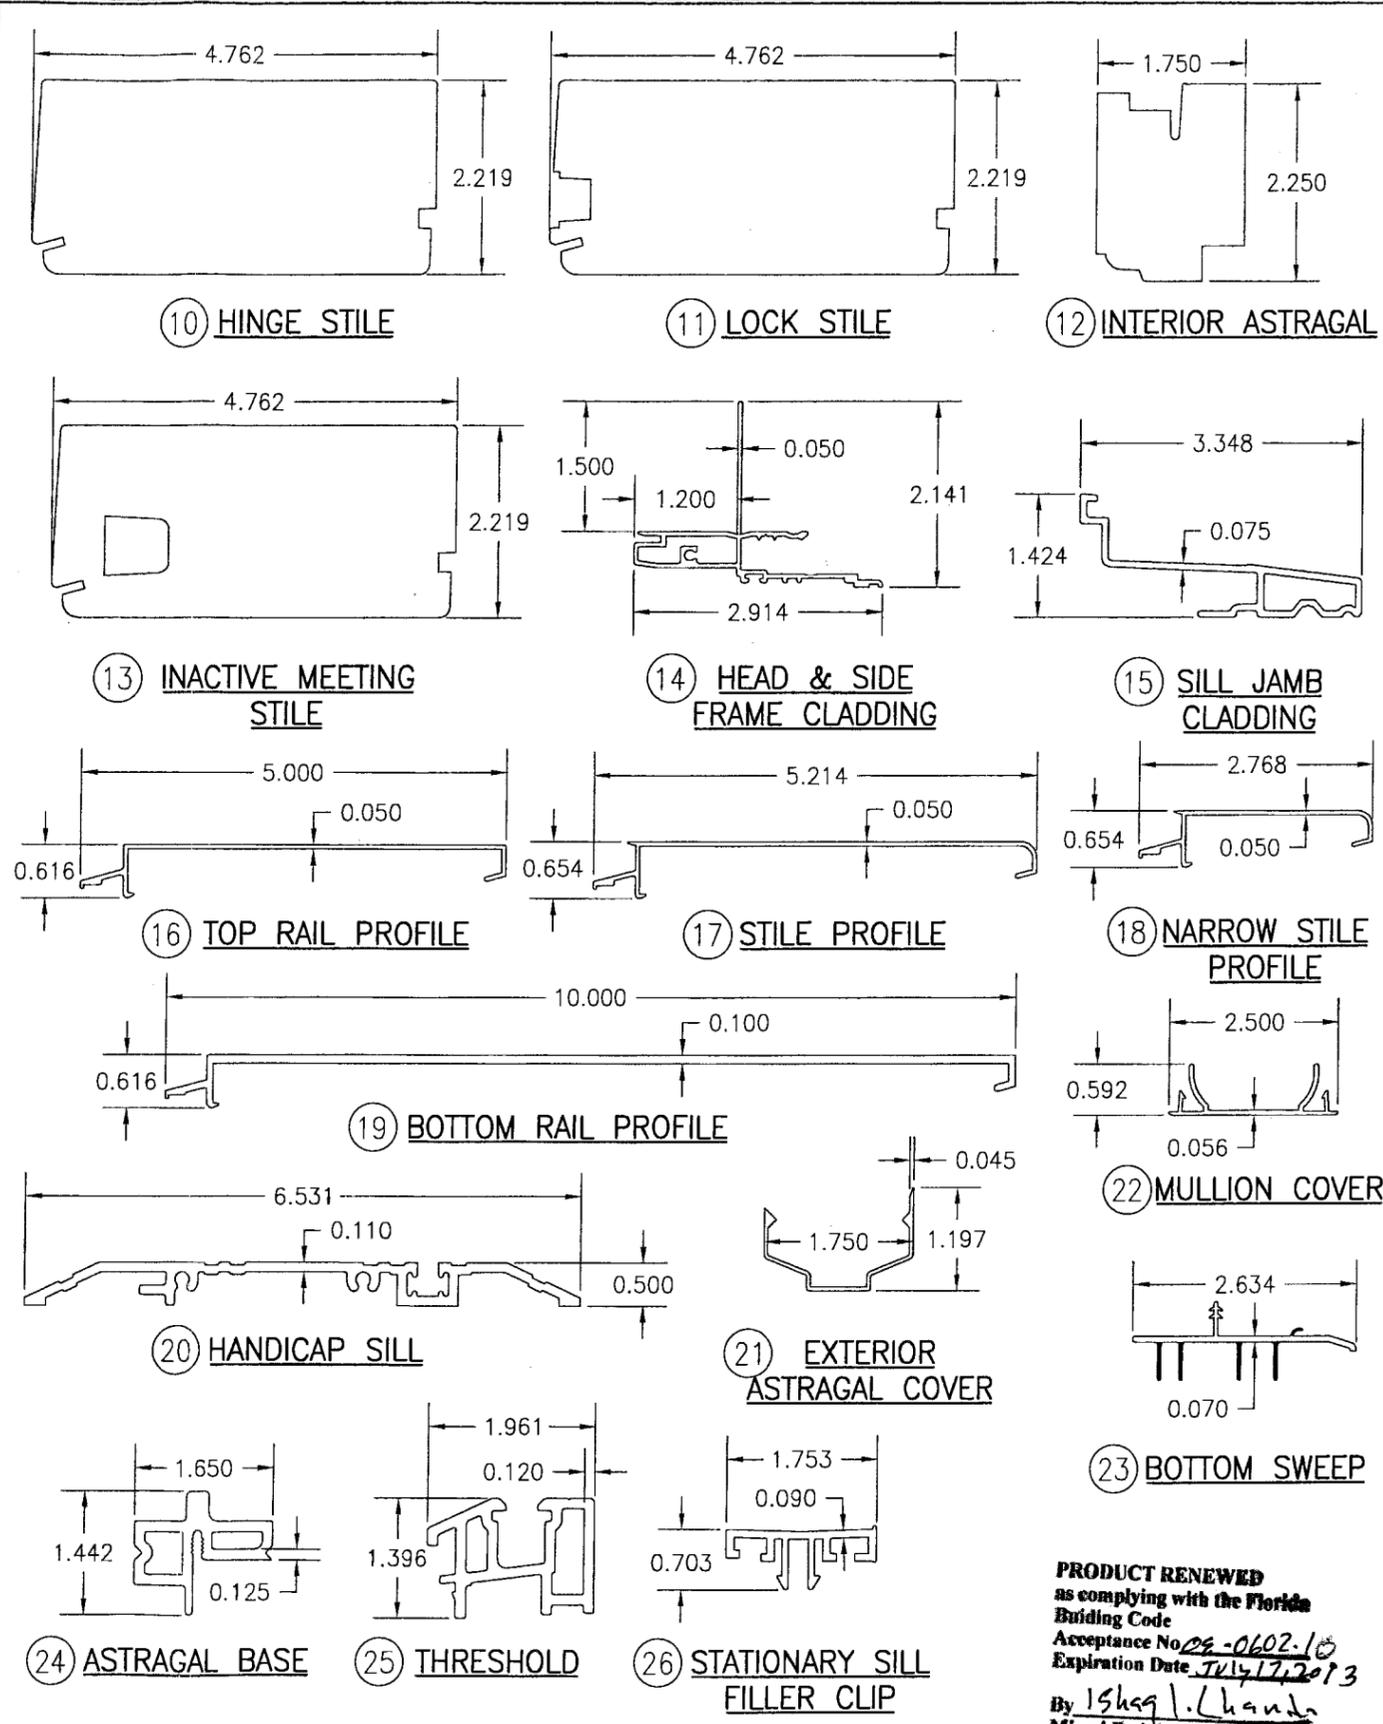

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 02/20/03
NO.	REVISION DESCRIPTION
BY	DATE
ALUMINUM CLAD FRENCH OUTSWING DOORS MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8885 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
DRAWING TITLE ALUMINUM CLAD FRENCH OUTSWING DOORS	
CERTIFICATION JUL 09 2008 WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1211	REV. B
SHEET NO. 8 OF 8	

* WOOD USED WITH TEST UNITS WAS SELECT WESTERN PINE. ALTERNATE WOOD SPECIES TO BE APPLICABLE WITH THESE WINDOWS IS MIN. SELECT MAHOGANY, SOUTHERN PINE, OAK, CHERRY, MAPLE, DOUGLAS FIR & CYPRUS.

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 02-0602-10
 Expiration Date July 17, 2013
 By Ishag L. Lhanda
 Miami Dade Product Control
 Division