



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.miamidade.gov/buildingcode

NOTICE OF ACCEPTANCE (NOA)

Andersen Corporation
100 Fourth Avenue North
Bayport, MN 55003

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Frenchwood" Wood Gliding Patio Doors

APPROVAL DOCUMENT: Drawing No **W04-18**, titled "Frenchwood" Gliding Patio Doors" Sheets 1 through 7 of 7, dated 03-03-04 and last revised on Sep 11, 2008, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Impact

Limitation: Approved configurations: O, OX or XO

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews & revises** NOA # **04-1004.01**, consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

NOA No 08-0610.05

Expiration Date: June 22, 2013
Approval Date: October 09, 2008

Page 1



9/16/08

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W04-18**, titled "Frenchwood" Gliding Patio Doors " Sheets 1 through 7 of 7, dated 03-03-04 and last revised on Sep 11, 2008, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Load Static Air Pressure Test, per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Resistance Test, per FBC, TAS 202-94
 - 5) Large Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with installation diagram of wood gliding glass door marked-up by Architectural Testing Laboratory, Inc., Test Report No. **ATI-02-46058.01** and **ATI-02-46059.01**, dated 11/26/03, both signed and sealed by Joseph A. Reed, P.E.

Note: The above test reports have been revised by an addendum letter dated 09/08/08, issued by Architectural Testing, signed and sealed by Joseph A. Reed, P.E.

2. Additional test reports on Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

Along with marked-up drawings and installation diagram of a wood sliding glass door, prepared by Architectural Testing Inc., Test Report No. **ATI-02-31214.01**, dated 04/28/99, with addendum letter dated 05/12/2000, signed and sealed by Allen N. Reeves, P.E.

C. CALCULATIONS

1. Anchor verification calculations dated 08-12-08 and last revised on Sep11, 2008, signed and sealed by Dr. Humayoun Farooq, P.E.
2. **Glazing complies with ASTM E-1300-02 & 2004**

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **05-1208.02**, issued to E.I. DuPont de Numerous & Co., Inc., for their "DuPont Butacite PVB ®", expiring on 12/11/10
2. Test reports on PVC material: Test report No.F4693 dated 03/24/99 for "South Florida outside 45 degree exposure for 5 years conducted by South Florida Testing Service (Aspen Research Corp) and tensile strength test of exposed & unexposed samples.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 08-0610.05
Expiration Date: June 22, 2013
Approval Date: October 09, 2008

Andersen Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS (continue)

2. Test reports on PVC material: Testr report No. 31005559SAT-004 for Surface Burning Characteristics of Building Materials per ASTM E 84-05, dated 08-04-06 , test report # 3100559SAT-001 for Self-Ignition Temperature per ASTM D 1929-96, dated 08-09-06 and test report # 3100559SAT-007 per ASTM D-635.03 dated Aug 08, 2006 issued by Intertek ETL Semko.

F. STATEMENTS

1. Statement letter of conformance & "No financial interest, dated 08-05-08 and 07-24-08 respectively, both signed & sealed by Dr. Humayoun Farooq, P.E.
2. Lab compliance statements as a part of the above test reports.
3. Addendum letters issued by Architectural Testing dated 09-08-08 and 05-12-2000.



G. OTHER

1. This NOA **renews & revises** NOA # **04-1004.01**, which expired on June 22, 2008.
2. Test proposal dated 03/14/03.
3. Previous associated NOA(s) are # 03-0415.17 and # 00-1011.08

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 08-0610.05

Expiration Date: June 22, 2013
Approval Date: October 09, 2008

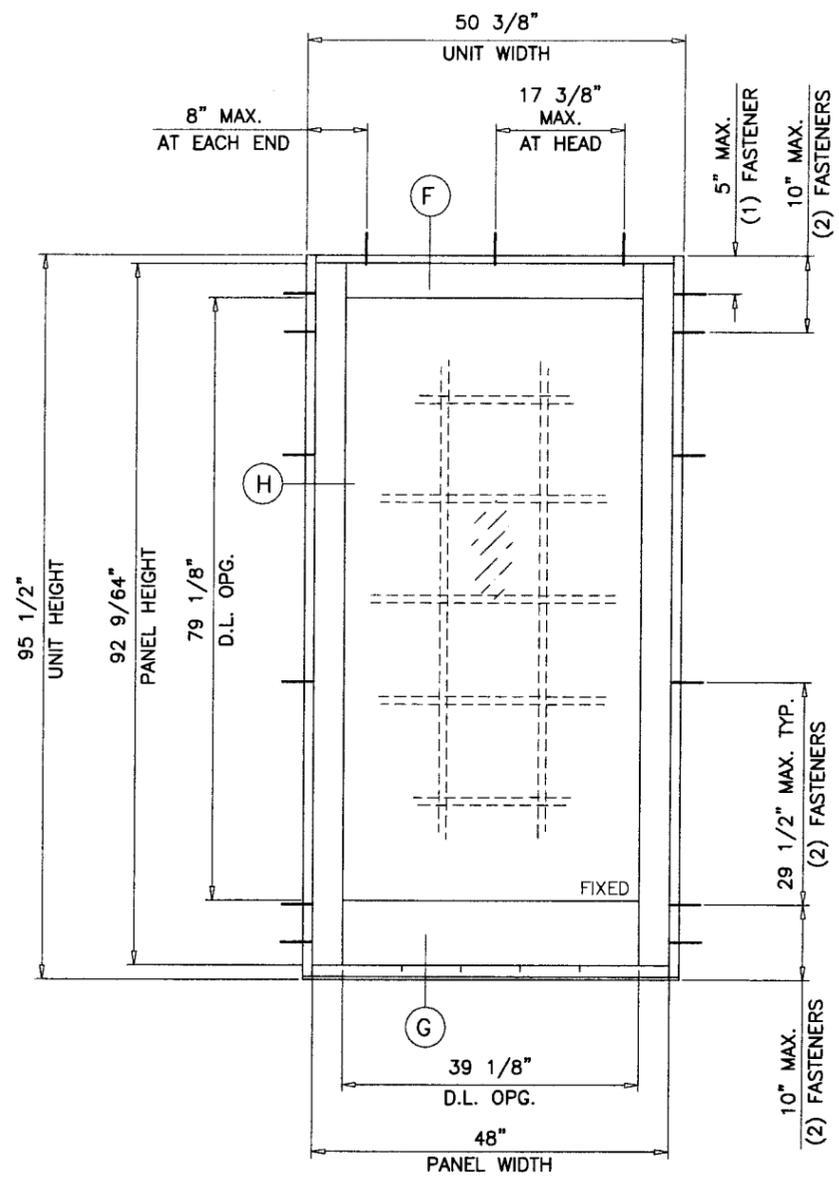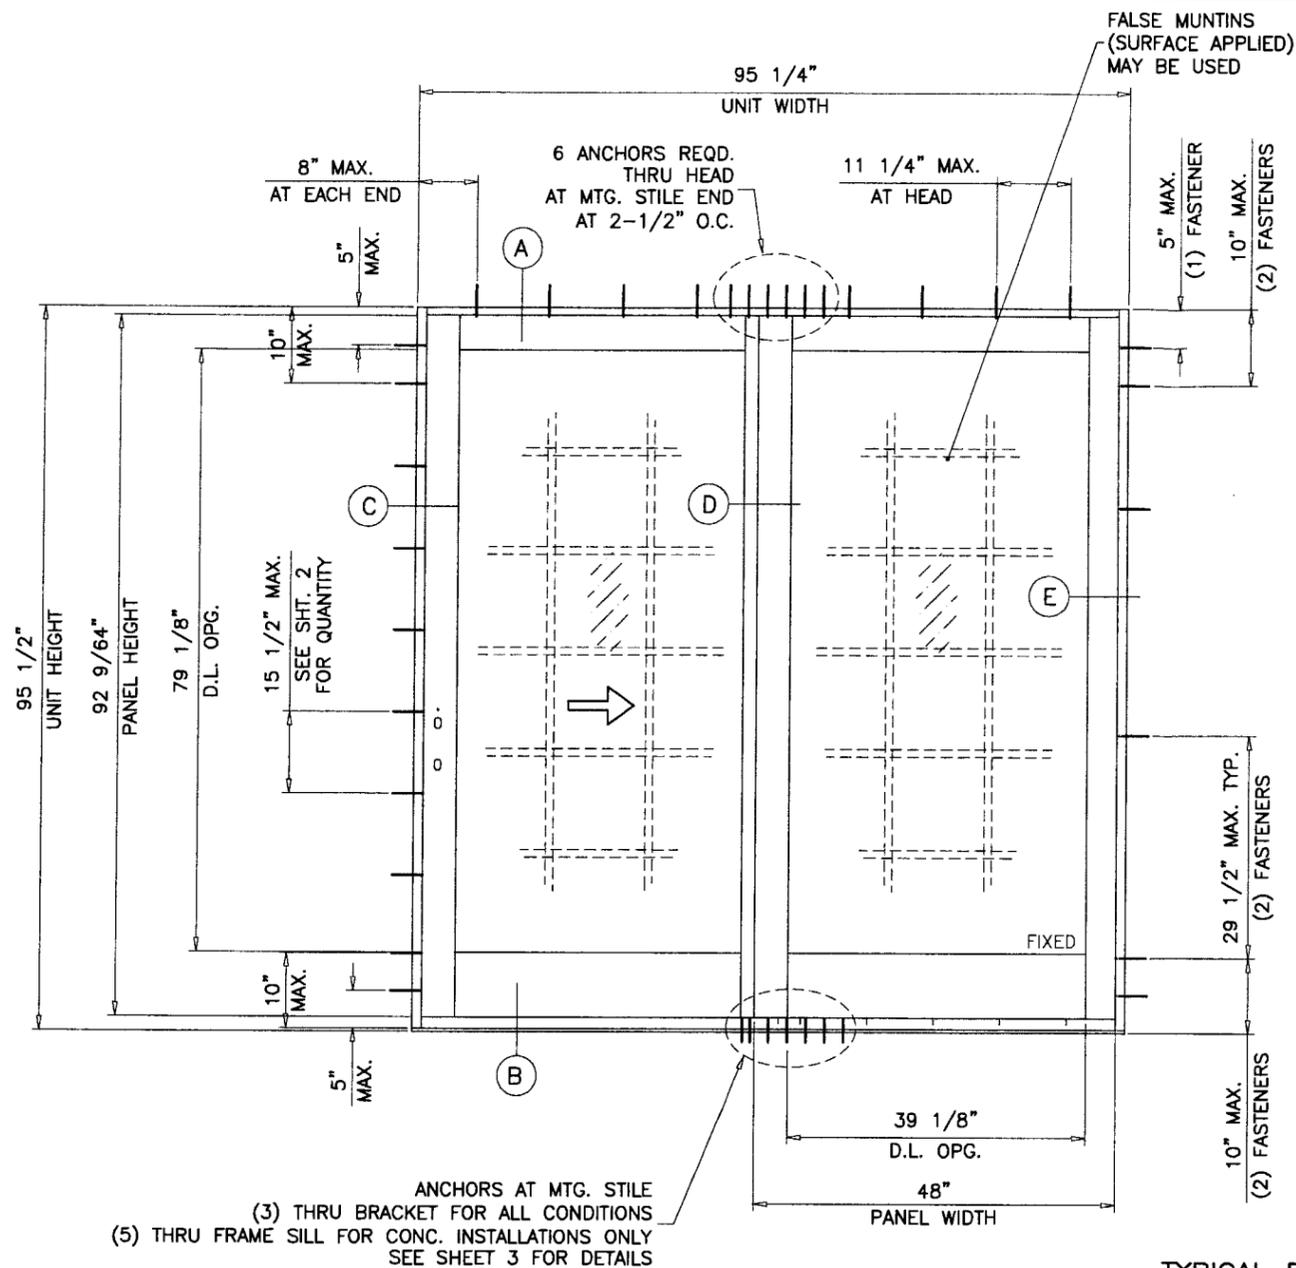


TYPICAL ELEVATION
TESTED UNIT

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 08-0610.05
Expiration Date JUNE 23, 2013
By (Signature) Chanda
Miami Dade Product Control
Division

THESE DOORS ARE RATED FOR LARGE MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

Engr: DR. HUMAYGUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 11 2008

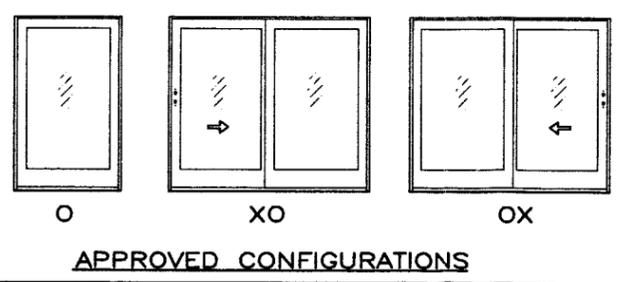

'FRENCHWOOD' GLIDDING WOOD PATIO DOOR

DESIGN LOAD RATING FOR DOORS AND SIDELITES TO BE AS PER CHART SHOWN ON SHEET 2.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-18AC

FRENCHWOOD GLIDDING WOOD PATIO DOOR (L.M.I.)
ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7691 FAX (-)


revisions:	no.	date	by	description
	A	08.06.08		UPDATED FOR 2007 FBC
	B	09.08.08		REV. PER BCCO COMMENTS

date: 03-03-04	scale: 3/8" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no.
W04-18
sheet 1 of 7

DESIGN LOAD CAPACITY - PSF								
DOOR DESCRIPTION	# OF PANELS	UNIT WIDTH INCHES	UNIT HT. INCHES	PANEL W. INCHES	PANEL HT. INCHES	LAM. ANN. GLASS		
						EXT. (+)	INT. (-)	
FWG-5068	2	59-1/4		30		50.0	65.0	
FWG-6068	2	71-1/4	79-1/2	36	76-9/64	50.0	65.0	
FWG-8068	2	95-1/4		48	*(8)	50.0	65.0	
FWG-50611	2	59-1/4		30		50.0	65.0	
FWG-60611	2	71-1/4	82-3/8	36	79-1/64	50.0	65.0	
FWG-80611	2	95-1/4		48	(8)	50.0	65.0	
FWG-5080	2	59-1/4		30		50.0	65.0	
FWG-6080	2	71-1/4	95-1/2	36	92-9/64	50.0	65.0	
FWG-8080	2	95-1/4		48	(10)	50.0	65.0	
FWG-2968S	1	32"		30		50.0	65.0	
FWG-3368S	1	38"	79-1/2	36	76-9/64	50.0	65.0	
FWG-4368S	1	50"		48	(11)	50.0	65.0	
FWG-29611S	1	32"		30		50.0	65.0	
FWG-33611S	1	38"	82-3/8"	36	79-1/16	50.0	65.0	
FWG-43611S	1	50"		48	(11)	50.0	65.0	
FWG-2980S	1	32"		30		50.0	65.0	
FWG-3380S	1	38"	95-1/2"	36	92-9/64	50.0	65.0	
FWG-4380S	1	50"		48	(11)	50.0	65.0	

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

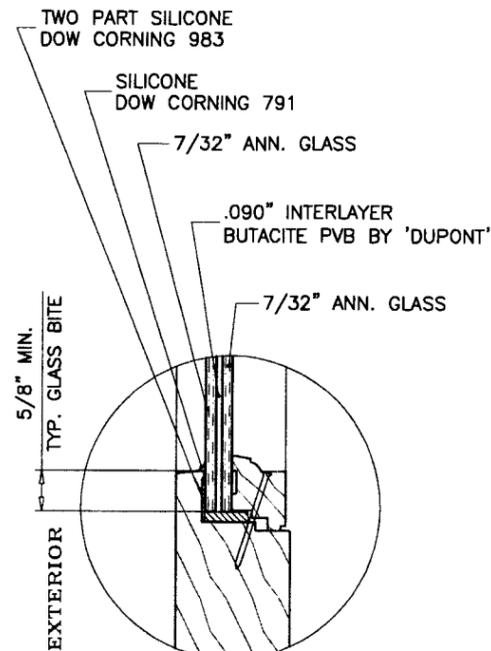

GLAZING DETAIL

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 08-0610-05
Expiration Date JUNE 22, 2013
By Ishag J. Chaudhry
Miami Dade Product Control
Division

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 11 2008

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-8978

COMP-ANL\W04-18AC

FRENCHWOOD GLIDING WOOD PATIO DOOR (L.M.I.)

ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7691 FAX (-)







revisions:	no.	date	by	description
	A	08.06.08		UPDATED FOR 2007 FBC
	B	09.08.08		REV. PER BCCO COMMENTS

date: 03-03-04
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-18

sheet 2 of 7

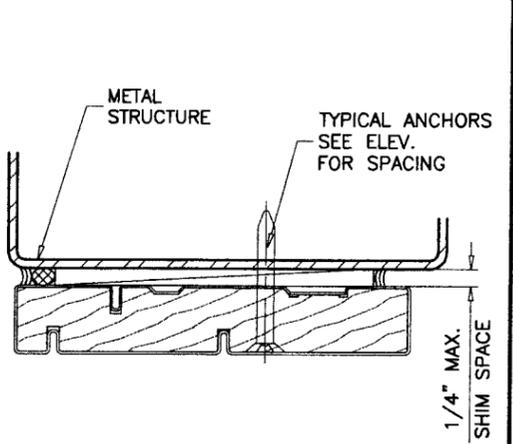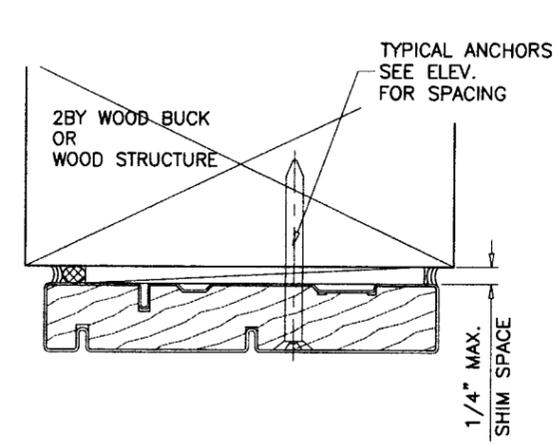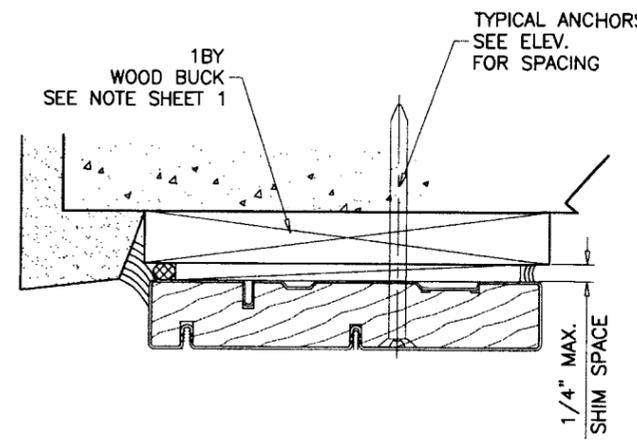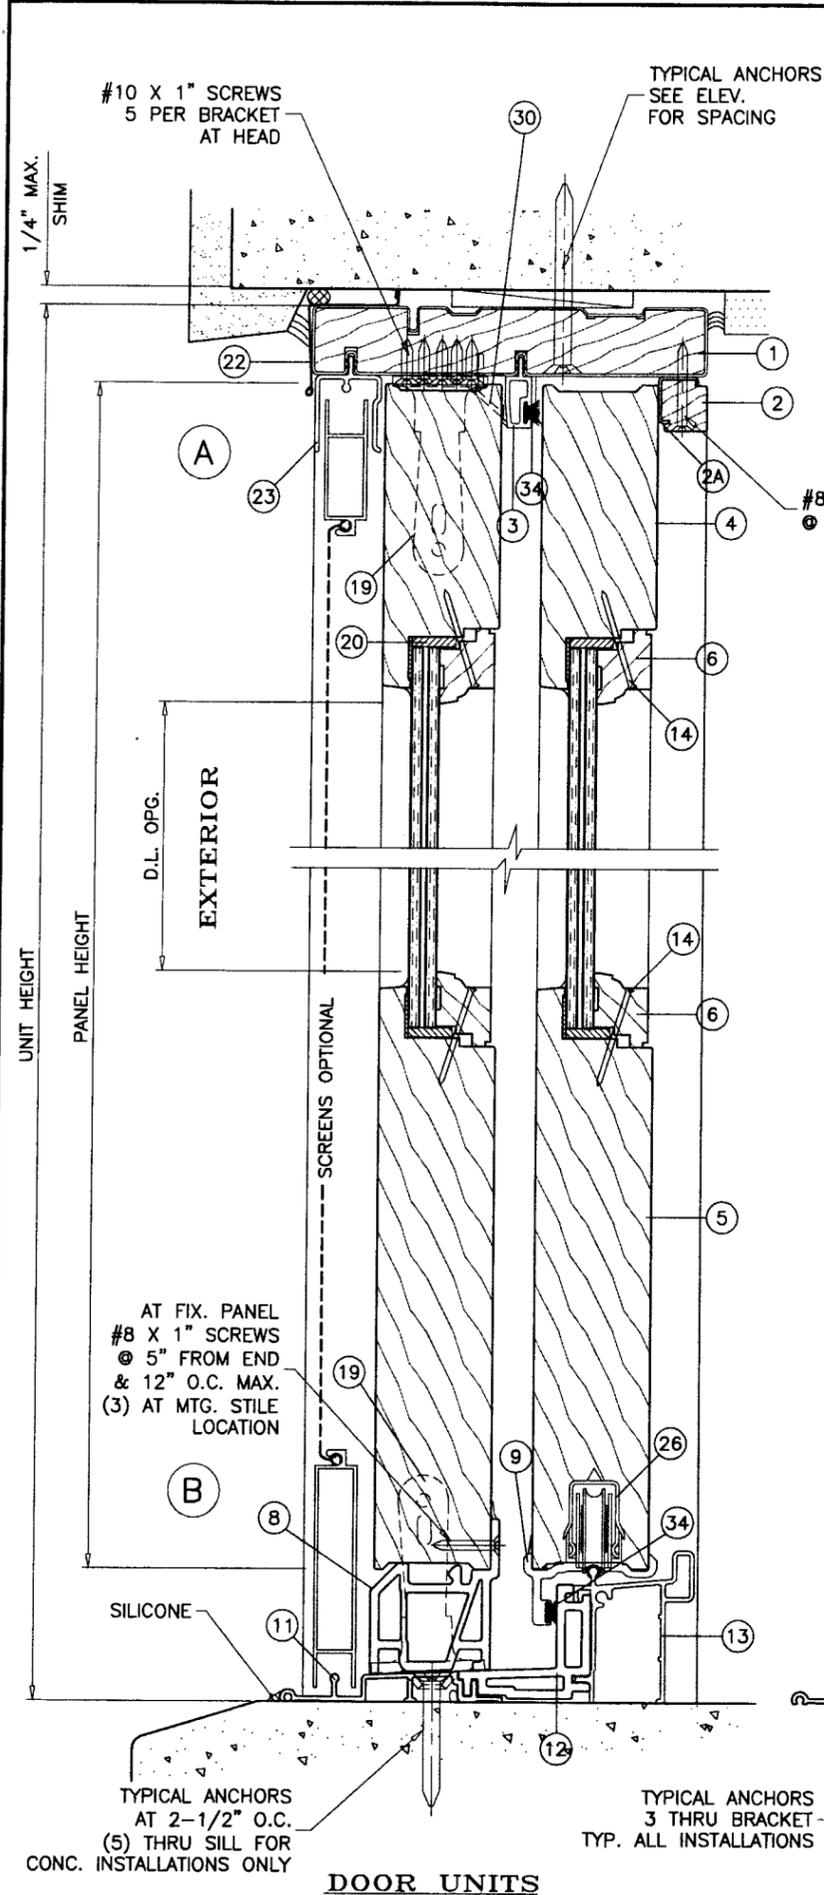

WOOD BUCKS AND METAL STRUCTURES NOT BY ANDERSEN MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING



#12 SMS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES WITH 1-3/8" MIN. PENETRATION INTO WOOD
3/16" DIA ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 THRU 1BY WOOD BUCKS INTO CONCRETE OR MASONRY WITH 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONCRETE OR MASONRY WITH 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
#12 SMS OR SELF DRILLING SCREWS
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES
 INTO CONCRETE AND MASONRY = 1-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE f'c = 3000 PSI MIN.
 MASONRY f'm = 2000 PSI MIN.

SEALANTS:
 ALL FRAME AND PANEL JOINT, INSTALLATION SCREWS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH 'SCHNEE MOREHEAD 5504' SEALANT.

LOCKS:
 LOCK AT OPERATING PANEL AT 44-1/2" FROM BOTTOM WITH ADJUSTABLE KEEPER AT FRAME, THUMBTURN AT INTERIOR, AND OPTIONAL FORGED BRASS THUMBTURN LOCKING MECHANISM WITH KEY CYLINDER AT EXTERIOR.

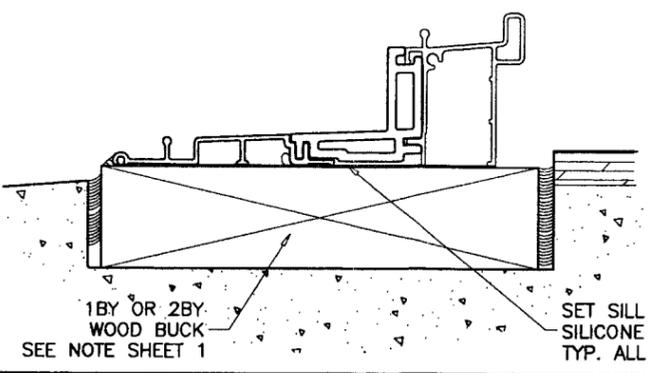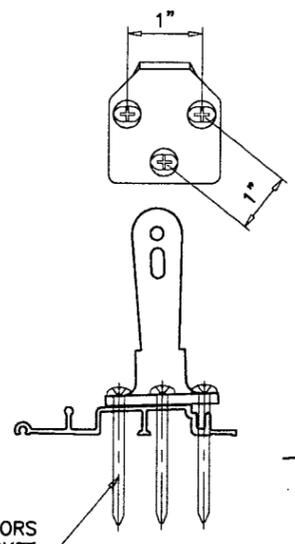

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No. 03-0610-05
 Expiration Date, JUNE 22, 2013
 By Blas J. Chauda
 Miami Dade Product Control Division

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 SEP 11 2008

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W04-18AC

FRENCHWOOD GLIDING WOOD PATIO DOOR (L.M.I.)
ANDERSEN CORPORATION
 100 FOURTH AVE. NORTH
 BAYPORT, MN. 55003-1096
 TEL. (800) 426-7691 FAX (-)


revisions:		no.	date	by	description
A	08.06.08				UPDATED FOR 2007 FBC
B	09.08.08				REV. PER BCCO COMMENTS

date:	03-03-04
scale:	3/8" = 1"
dr. by:	HAMID
chk. by:	


drawing no.	W04-18
sheet	3 of 7

DOOR UNITS


TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

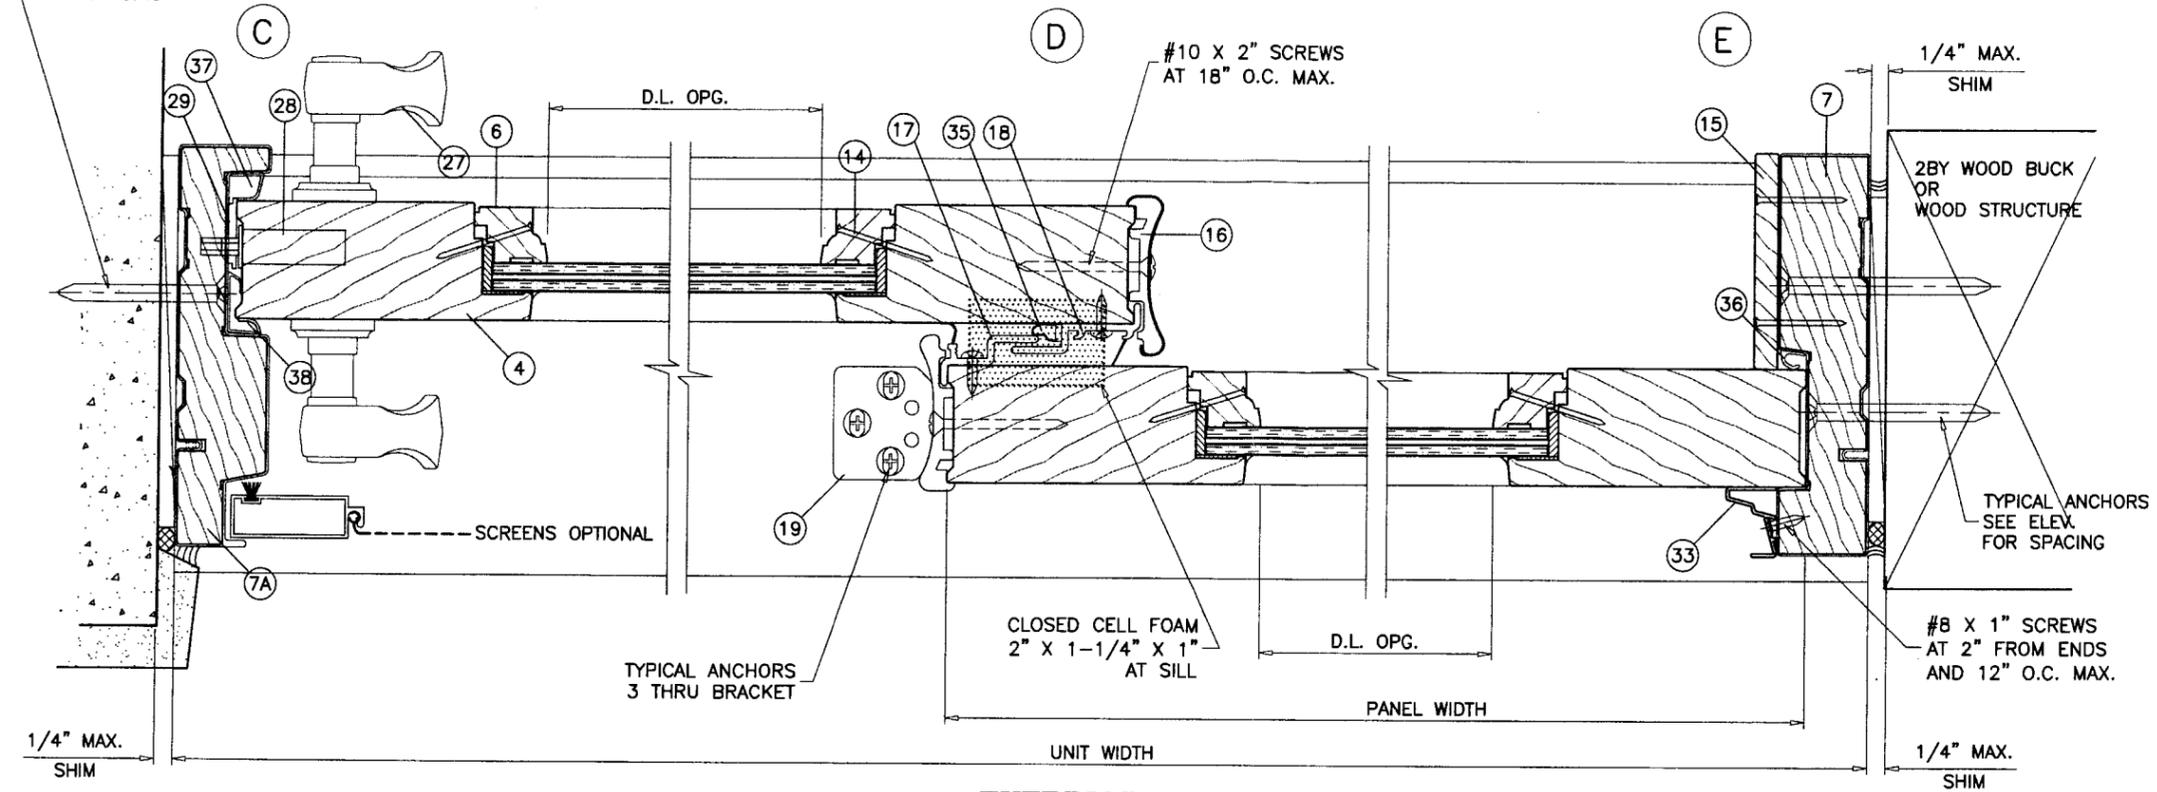

EXTERIOR

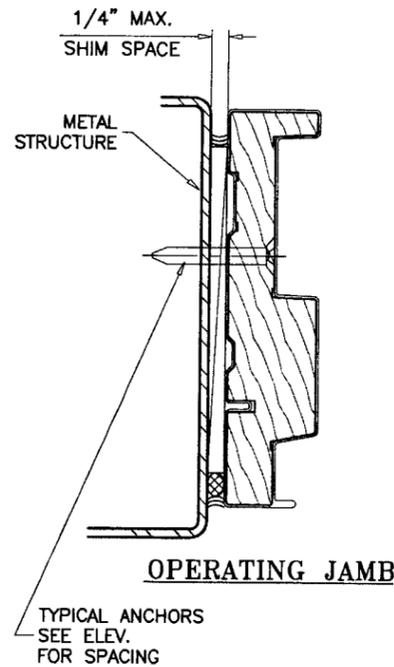

OPERATING JAMB

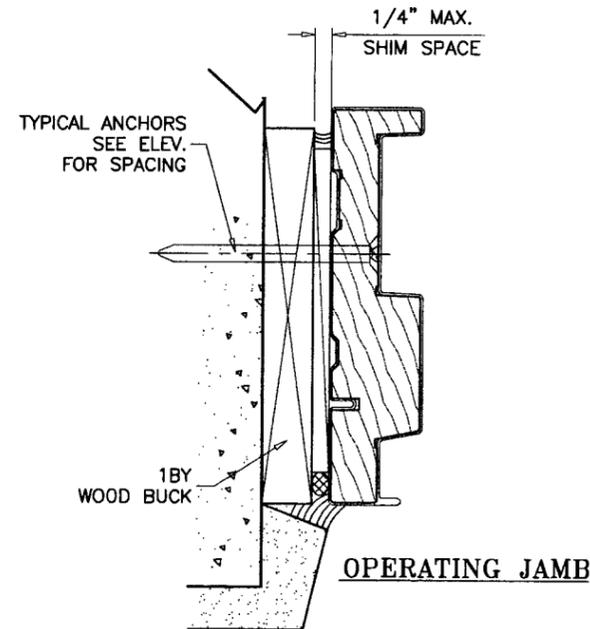

OPERATING JAMB

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 08-0610-05
Expiration Date JUNE 22, 2013
By Ishag I Chande
Miami Dade Product Control
Division

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Handwritten signature]

SEP 11 2008

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-18AC


FRENCHWOOD GLIDING WOOD PATIO DOOR (L.M.I.)
ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7691 FAX (-)


no	date	by	description
A	08.06.08		UPDATED FOR 2007 FBC
B	09.06.08		REV. PER BCCO COMMENTS


date: 03-03-04
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-18

sheet 4 of 7

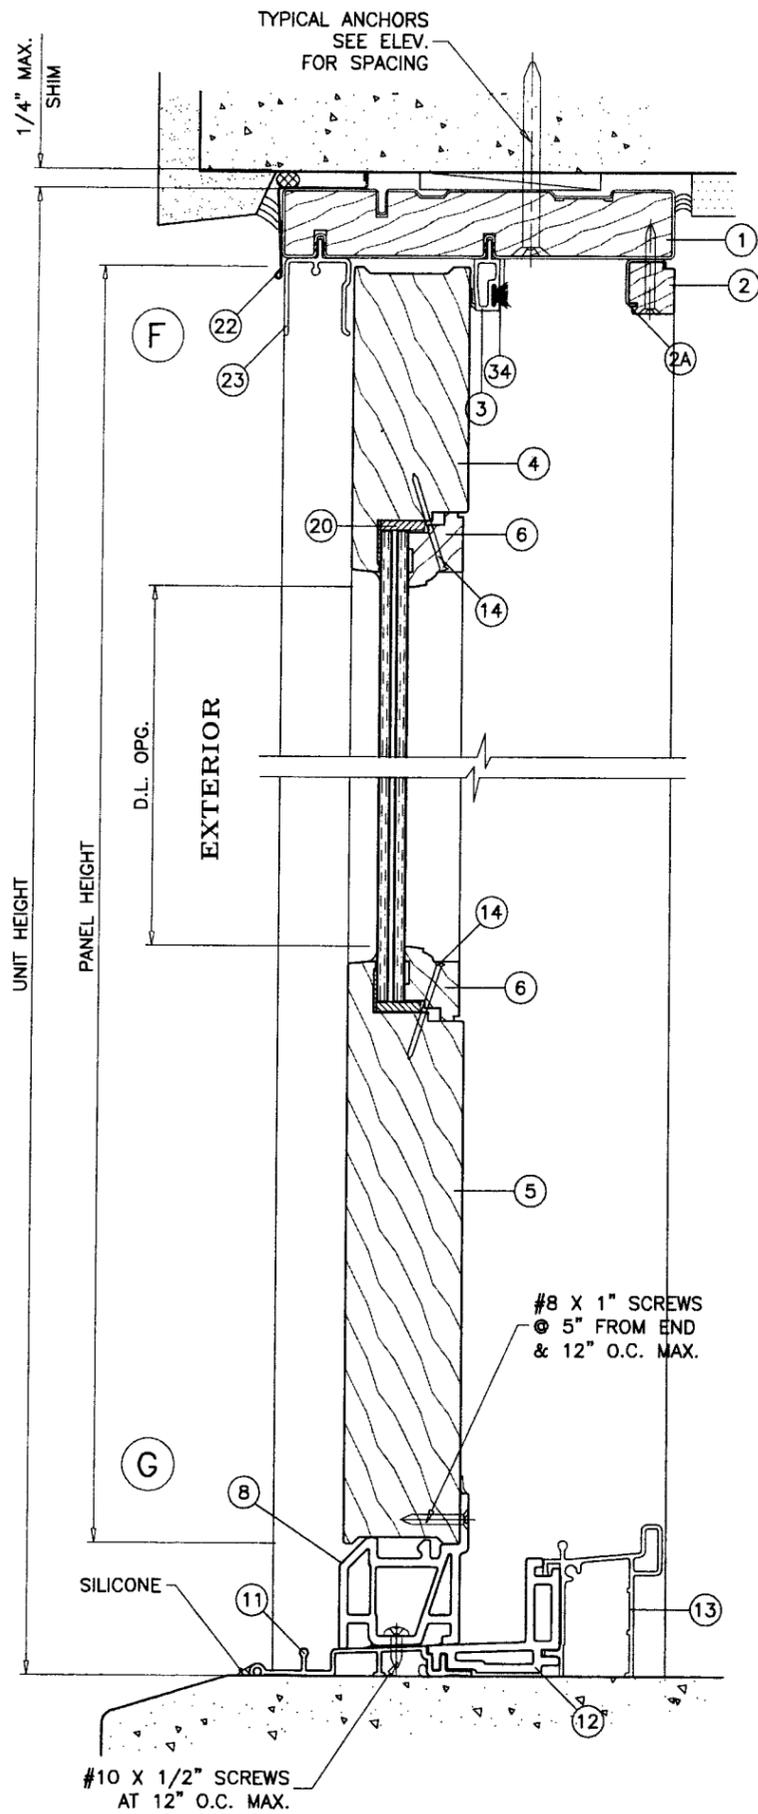

STATIONARY UNITS

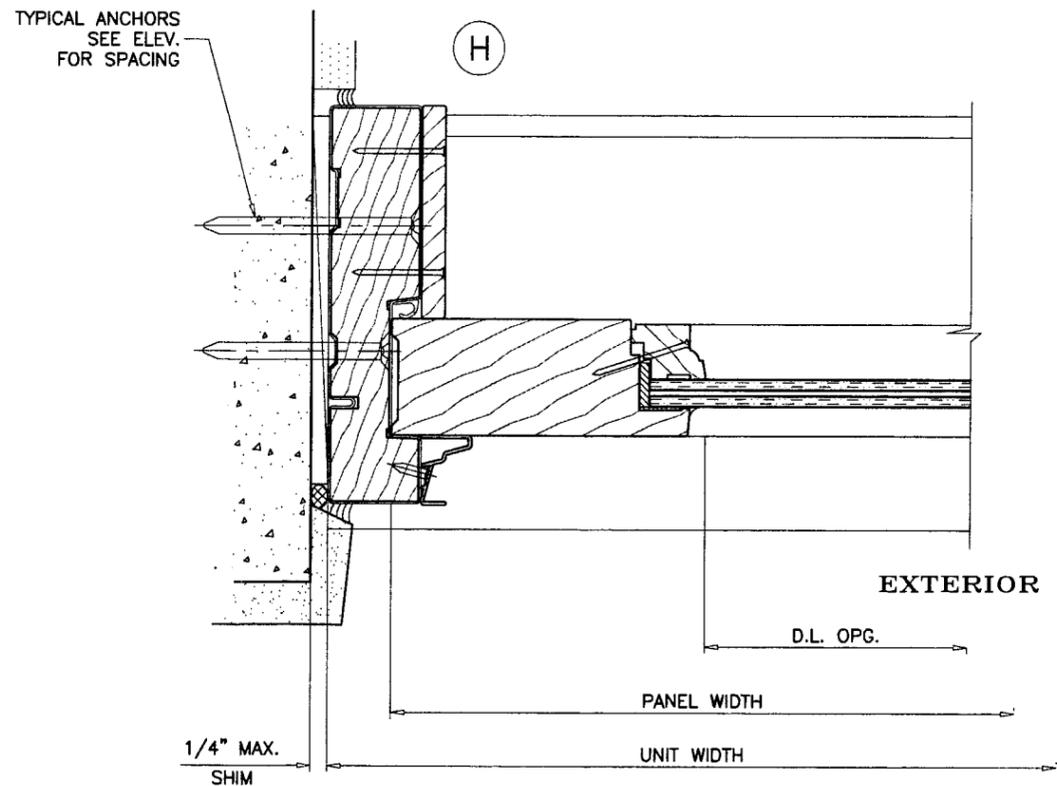

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 05-0610-05
 Expiration Date JUNE 22, 2013
 By Skeg I. Chande
 Miami Dade Product Control
 Division

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

SEP 11 2008


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W04-18AC

FRENCHWOOD GLIDING WOOD PATIO DOOR (L.M.I.)
ANDERSEN CORPORATION
 100 FOURTH AVE. NORTH
 BAYPORT, MN. 55003-1096
 TEL. (800) 426-7691 FAX (-)



revisions:	no	date	by	description
	A	08.06.08		UPDATED FOR 2007 FBC
	B	09.08.08		REV. PER BCCO COMMENTS

date:	03-03-04
scale:	3/8" = 1"
dr. by:	HAMID
chk. by:	


drawing no.	W04-18
sheet	5 of 7

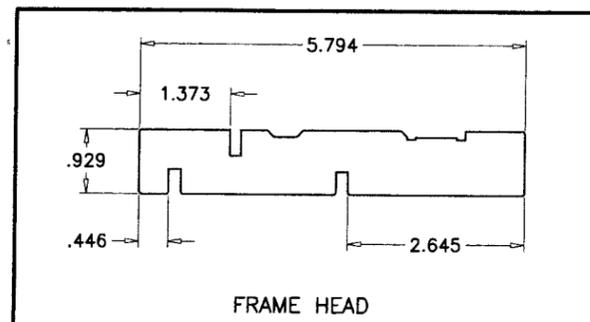


FRAME HEAD

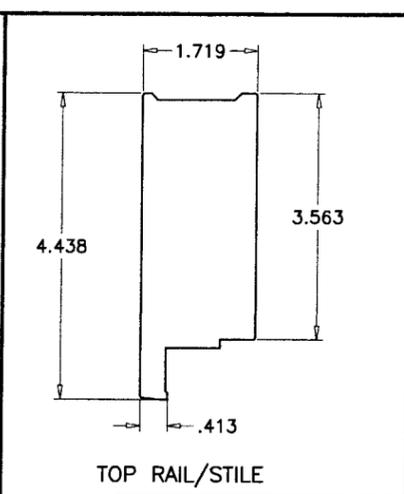


TOP RAIL/STILE

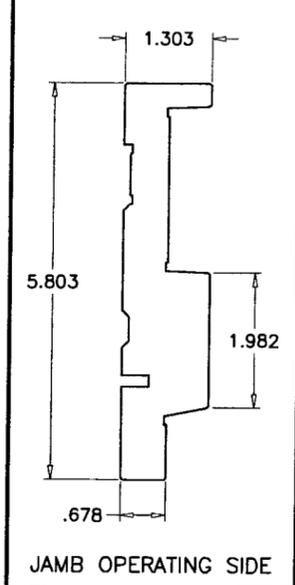


JAMB OPERATING SIDE

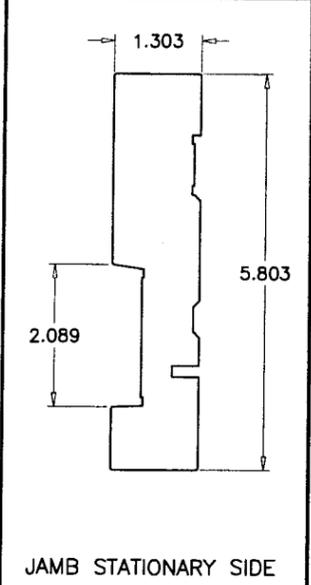


JAMB STATIONARY SIDE

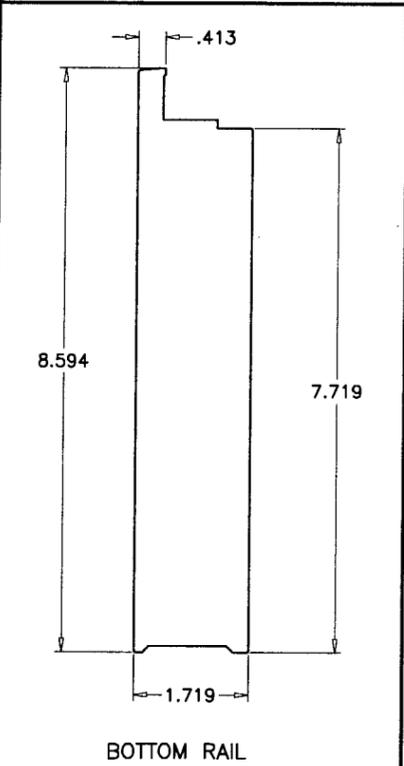


BOTTOM RAIL




INTERLOCK STATIONARY

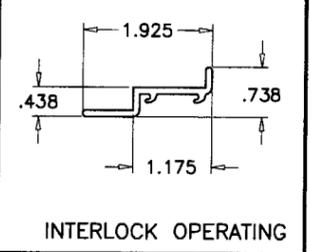


INTERLOCK OPERATING

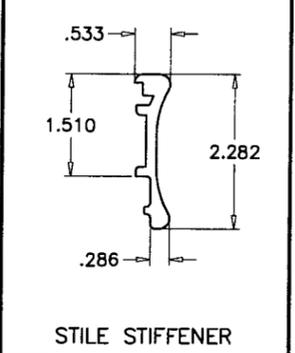


STILE STIFFENER

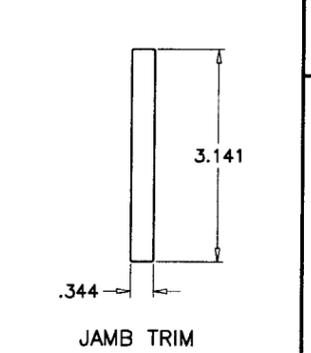

JAMB TRIM




GLAZING STOP




PANEL STOP


ITEM #	NUMBER	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	51006	1	FRAME HEAD (ENCASED WITH .036 TH. RIGID VINYL)	WOOD	ANDERSEN
2	51036	1	PANEL STOP INSIDE	WOOD	ANDERSEN
2A	51047	1	PANEL STOP INSIDE	VINYL	-
3	51039	1	PANEL STOP PARTING	VINYL	-
4	51021	-	TOP RAIL/STILE	WOOD	ANDERSEN
5	51020	1/ PANEL	BOTTOM RAIL	WOOD	ANDERSEN
6	51080	1/ SIDE	GLASS STOP	WOOD	ANDERSEN
7	50017	AS REQD.	JAMB STATIONARY (ENCASED WITH .036 TH. RIGID VINYL)	WOOD	ANDERSEN
7A	50022	AS REQD.	JAMB OPERATING (ENCASED WITH .036 TH. RIGID VINYL)	WOOD	ANDERSEN
8	50373	1	SILL FILLER	VINYL	ANDERSEN
9	51086	1/ MOV. PANEL	FILLER OPERATING BOTTOM RAIL	VINYL	-
11	50154	1	SILL OUTSIDE PIECE	ALUMINUM	-
12	50354	1	THERMAL SILL	VINYL	ANDERSEN
13	51210/51215	1	SILL INSIDE PIECE	ALUMINUM	-
14	-	AS REQD.	#6 X 1-1/2" NAILS	STEEL	AT 8" O.C.
15	51222	1/ SIDE	JAMB TRIM	WOOD	-
16	51212/51213	-	STILE TRIM	WOOD	-
17	51148	AS REQD.	INTERLOCK STATIONARY	VINYL	-
18	51019	AS REQD.	INTERLOCK OPERATING	VINYL	-
19	51209	2	BRACKET	ST. STEEL	-
20	20065	AS REQD.	GLASS SPACER	VINYL	-
21	-	1/ FIX. PANEL	1-3/4" X 1-3/4" X 1/8" ANGLE, 1-5/8" LONG	ALUMINUM	AT HEAD ONLY
22	50053	AS REQD.	FLASHING	ALUMINUM	-
23	50356	AS REQD.	SCREEN GUIDE	VINYL	ANDERSEN
24	50061	1	FLANGE HEAD	VINYL	ANDERSEN
25	50347	1/ SIDE	FLANGE SIDE	VINYL	ANDERSEN
26	51052	2/ PANEL	ROLLER ASSEMBLY WITH TANDEM WHEELS	STEEL	7-1/2" FROM STILE ENDS
27	2573514-5	AS REQD.	DOOR HANDLE AT 36" FROM BOTTOM	BRASS	-
28	2573588	AS REQD.	REACH OUT LOCK AT 44-1/2" FROM BOTTOM	STEEL	-
29	2573562	1/ LOCK	STRIKE PLATE	STEEL	-
30	51051	-	PARTING STOP BRACKET	ALUMINUM	-
31	51200	-	1" X 1/2" CLOSED CELL FOAM	-	AT HEAD ABOVE INTERLOCKS
32	51124	-	2" X 1-1/4" CLOSED CELL FOAM	-	AT SILL BELOW INTERLOCKS
33	21123	AS REQD.	STATIONARY PANEL STOP	-	-
34	50007	AS REQD.	POLYPROPYLENE PILE WITH FINSEAL W'STRIPPING	-	-
35	51019	1/ INTERLOCK	BULB W'STRIPPING	VINYL	.300 DIA.
36	51014	AS REQD.	SINGLE LEAF W'STRIPPING	VINYL	.275 LEAF
37	50065	AS REQD.	SINGLE LEAF W'STRIPPING	VINYL	.343 LEAF
38	50063	AS REQD.	SINGLE LEAF W'STRIPPING	VINYL	.430 LEAF

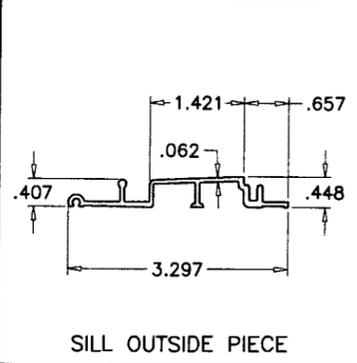


SILL OUTSIDE PIECE

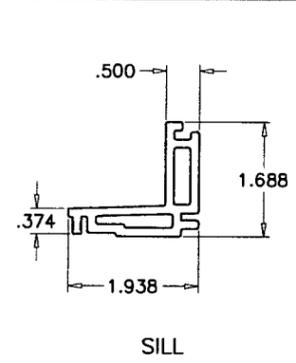


SILL

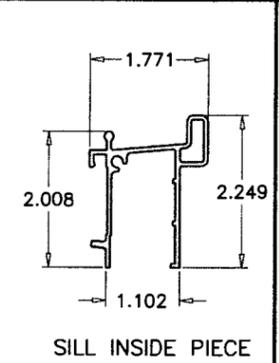


SILL INSIDE PIECE

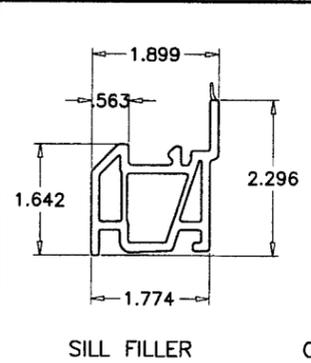

SILL FILLER

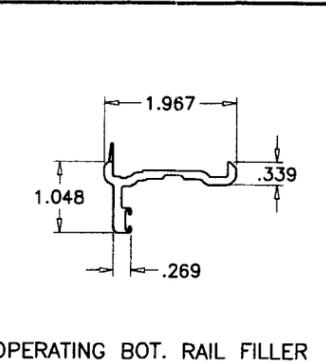

OPERATING BOT. RAIL FILLER

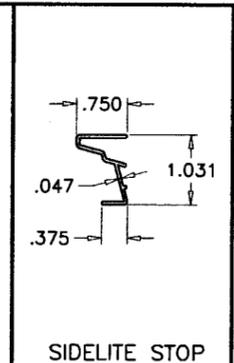

SIDELITE STOP

Engr: DR. HUMAYDUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 11 2008

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 08-0610-05
Expiration Date JUNE 22, 2013
By Iskag I. Chande
Miami Dade Product Contr
Division


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-18AC

FRENCHWOOD GLIDING WOOD PATIO DOOR (L.M.I.)
ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7691 FAX (-)

revisions:
no. date by description
A 08.06.08 UPDATED FOR 2007 FBC
B 09.08.08 REV. PER BCCO COMMENTS

date: 03-03-04
scale: 3/8" = 1"
dr. by: HAMID
chk. by:


drawing no.
W04-18
sheet 6 of 7

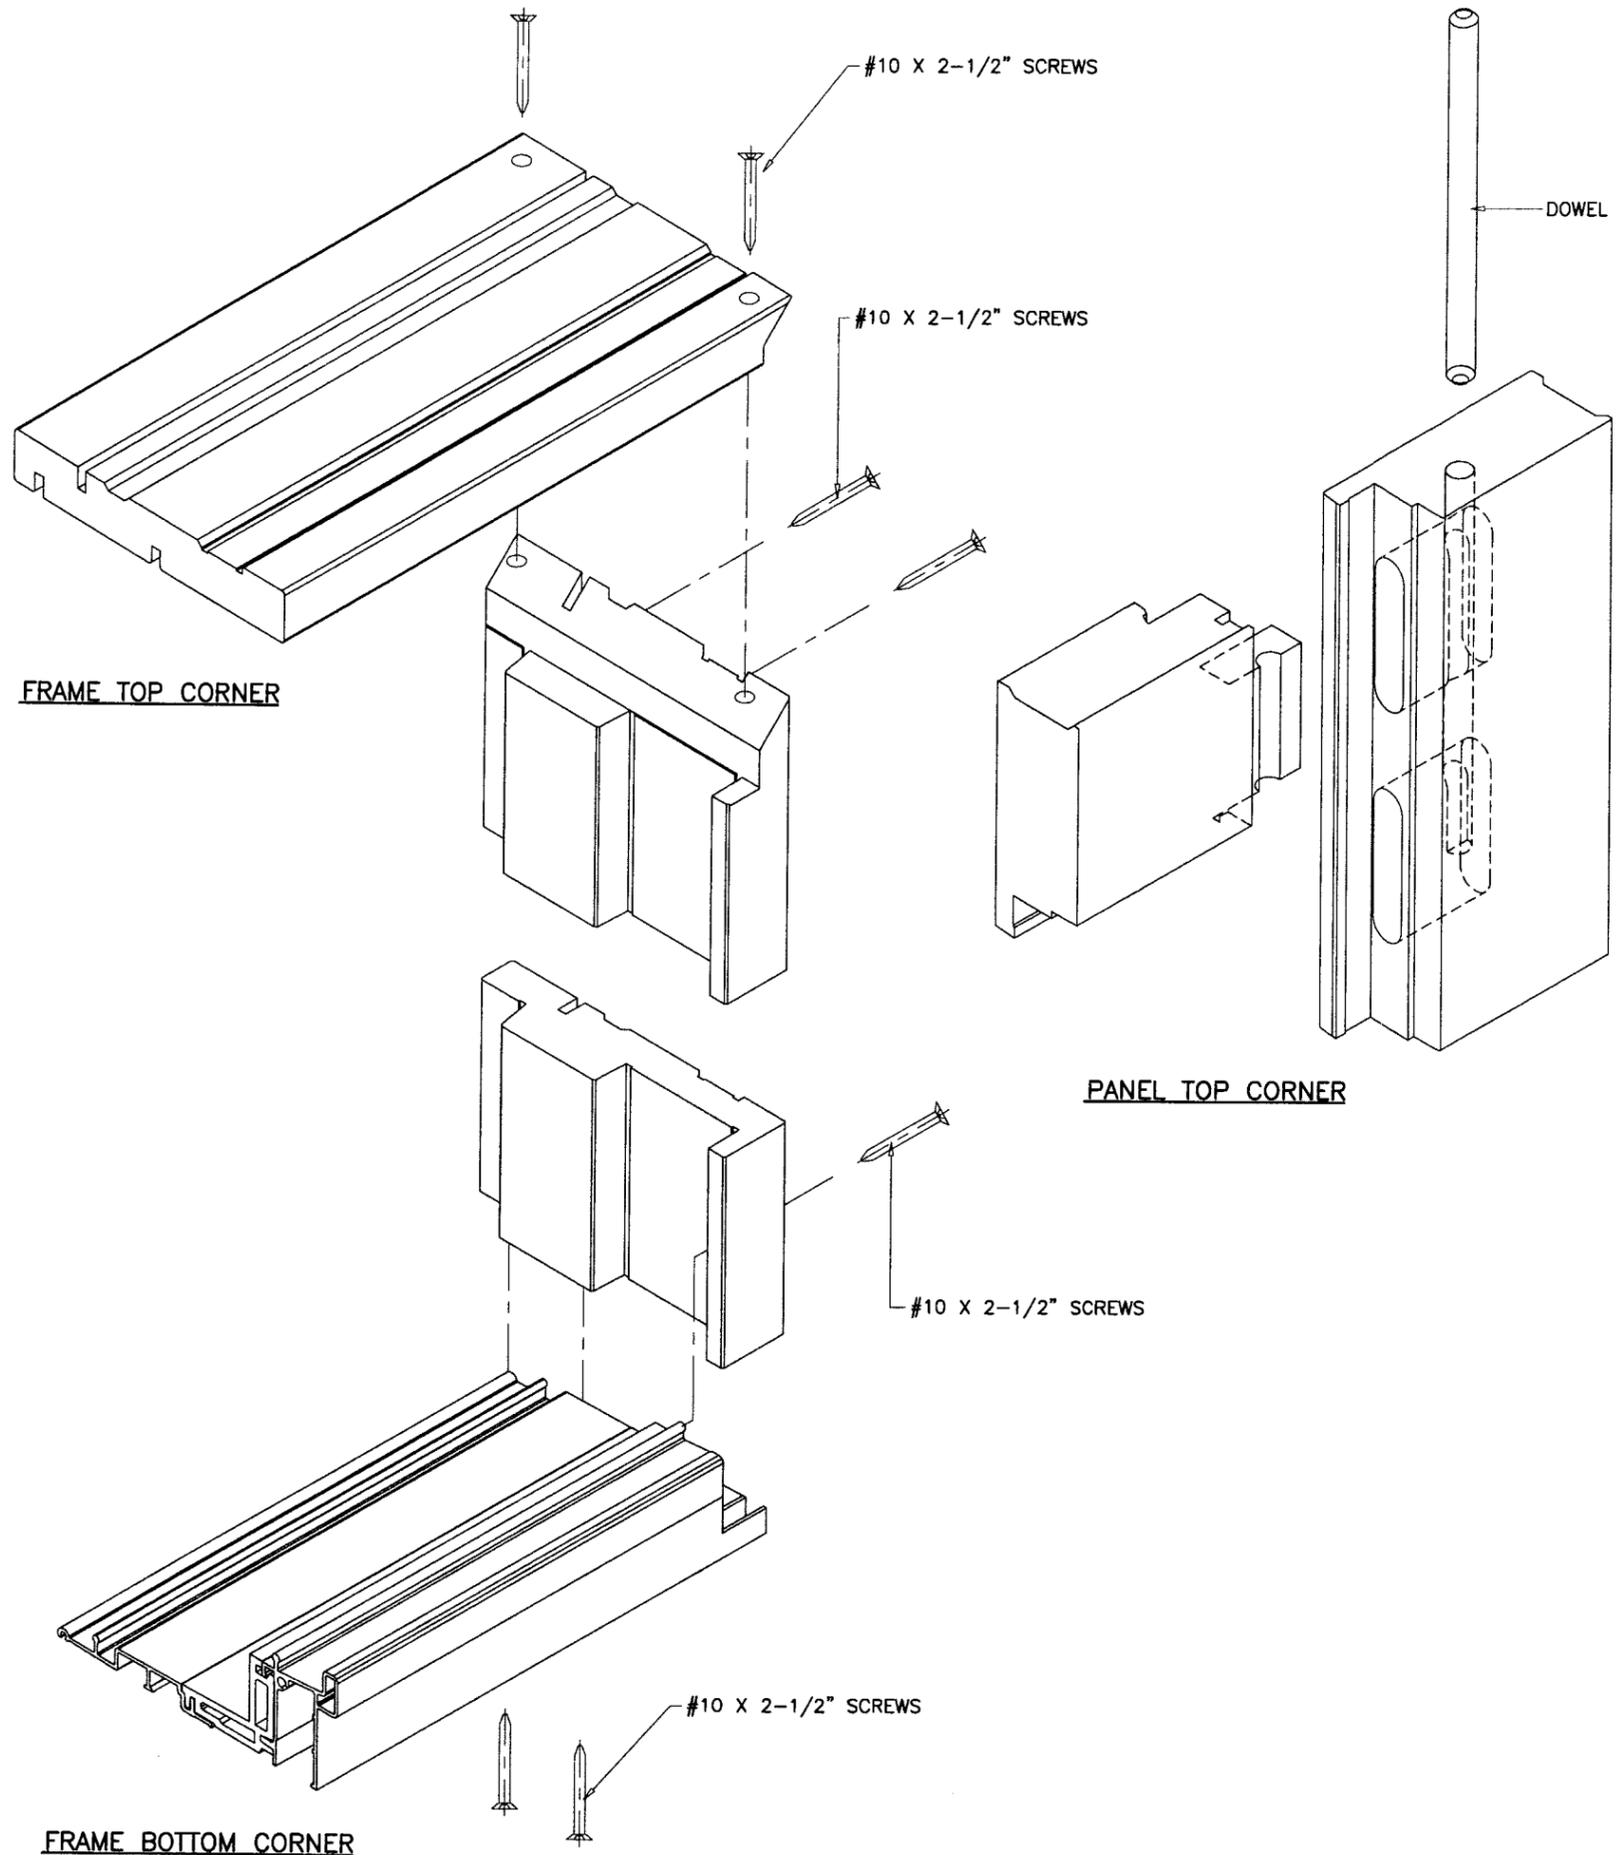

APPLY SEALANT AND INSERT DOWEL. END OF DOWEL SHOULD BE FLUSH TO 0.031 CTSK. WITH SURFACE OF STILE. USE 5.000" FOR TOP RAILS AND 6.500" FOR BOTTOM RAILS.

APPLY 0.125 DIA. ±.031 BEAD SILICONE SEALANT TO STILE-RAIL INTERFACE. BEAD MUST BE CONTINUOUS AND COVER COMPLETE LENGTH OF THE SURFACE WHERE STILE AND RAILS MEET.

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 08-0610-05
 Expiration Date JUNE 23, 2013
 By Iskhan K. Chaudhary
 Miami-Dade Product Control
 Division

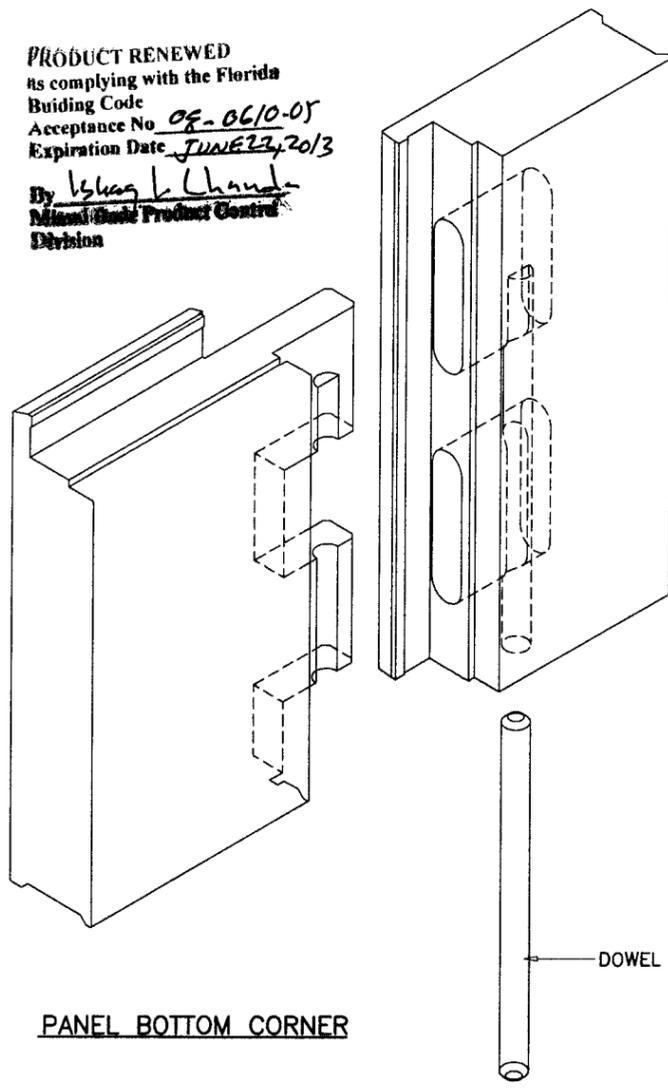

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

[Signature]
 SEP 11 2008

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 12335 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W04-18AC

FRENCHWOOD GLIDING WOOD PATIO DOOR (L.M.I.)
ANDERSEN CORPORATION
 100 FOURTH AVE. NORTH
 BAYPORT, MN. 55003-1096
 TEL. (800) 426-7691 FAX (-)

no	date	by	description
A	08.06.08		UPDATED FOR 2007 FBC
B	09.08.08		NO CHANGE THIS SHEET

date: 03-03-04	scale: 3/8" = 1"	dr. by: HAMID	chk. by:
drawing no. W04-18			
sheet 7 of 7			