



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Flexim International, BV
Buy Ballotstraat 4
NL-1704 SK Heerhogowaard
Holland**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Flexim Roof Mortar

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 7.

The submitted documentation was reviewed by Alex Tigera.



**NOA No 08-0611.14
Expiration Date: 11/14/13
Approval Date: 11/14/08
Page 1 of 7**

ROOFING COMPONENT APPROVAL:

Category: Roofing
Sub-Category: Roof Tile Adhesives

1. SCOPE

This approves Flexim Roof Mortar, as manufactured by **Flexim International, BV** and distributed by **Lifetime Building Supply, Inc.** in **Wixom, MI.** and as described in Section 2 of this Notice of Acceptance, designed to comply with the Florida Building Code and the High Velocity Hurricane Zone of the Florida Building Code, for use with approved Roof Tile Systems for the installation of ridge, hip, and trim tiles. Flexim Roof Mortar can also be used in pointing up, or sealing roof systems.

2. PRODUCT DESCRIPTION

<u>Manufactured by Applicant</u>	<u>Dimensions</u>	<u>Product Description</u>
Flexim Roof Mortar	N/A	Polystyrene impregnated linseed oil putty. Premixed prebagged roof tile mortar for used with approved roof tile systems in accordance with the Roof Tile System Notice of Acceptance.

3. LIMITATIONS

- 3.1 Fire classification is not part of this acceptance.
- 3.2 Field uplift testing shall be performed, in accordance with the test procedures set forth in Roofing Application Standard RAS 106. Testing shall be performed not prior to 28 days after installation.
- 3.3 Flexim Roof Mortar shall be placed in a 5" x 12" pad at time of application. Flexim is approved for the installation of ridge, hip, and trim tiles only. The mortar pad placement shall be in accordance with the 'Placement Details' provided herein.
- 3.4 Flexim Roof Mortar shall be applied in accordance with Flexim International, BV Construction Products Specifications.
- 3.5 Refer to Tile manufacturer's Miami-Dade County Product Control Notice of Acceptance for system approvals.
- 3.6 Flexim Roof Mortar may be used with any approved roof assembly listing Flexim Roof Mortar as a component part of an assembly in the approval.



4. EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Construction Materials	FUSA-001-02-01	SSTD 11-99	03/27/08
PRI Construction Materials	FUSA-001-02-02	TAS 123	05/16/08

5. LABELING:

All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below.



6. BUILDING PERMIT REQUIREMENTS:

Any documents required by the Building Official or applicable Building Code in order to properly evaluate the installation of this component.




7. INSTALLATION

Flexim Roof Mortar and its components shall be installed in strict compliance with Roofing Application Standard RAS 120.




PREPARATION: Ensure a clean dry foundation

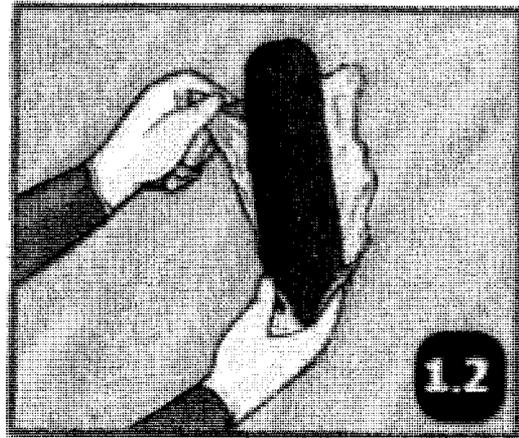


Remove the Flexim bars from the packaging.




Apply the Flexim bars to the top row of tiles and to the connecting edge of the existing ridge cap

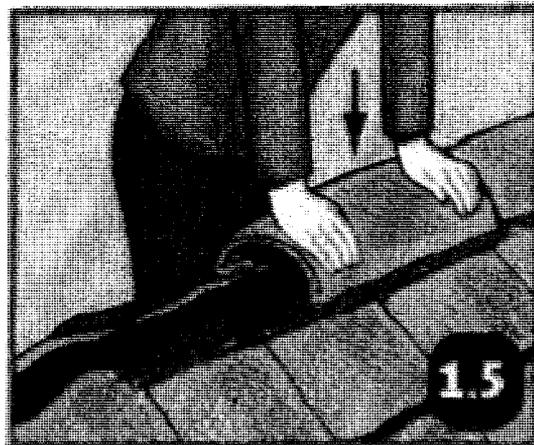

Press ridge caps firmly into Flexim

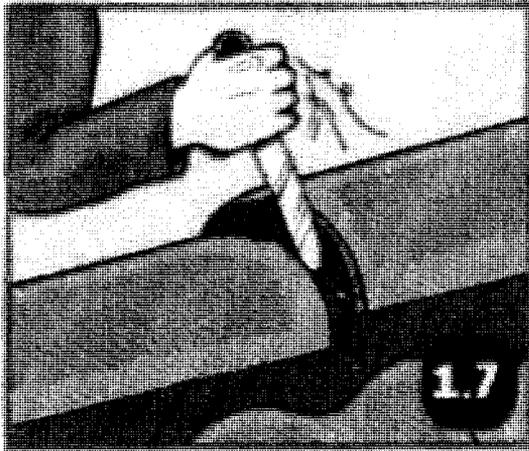


Trim smooth out the Flexim until an even finish is achieved

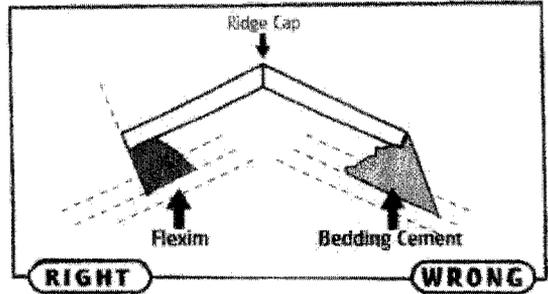


When repairing trim tiles ensure a clean dry foundation




Using the gloves provided remove the Flexim bars from the packaging and apply to the outside wall

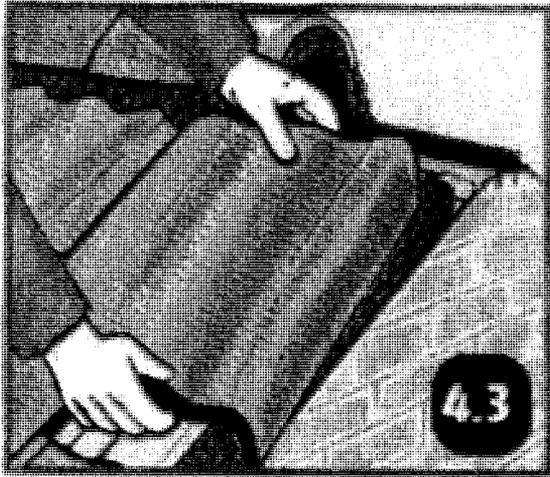


Apply the side wall tiles to the outside wall with bare hands

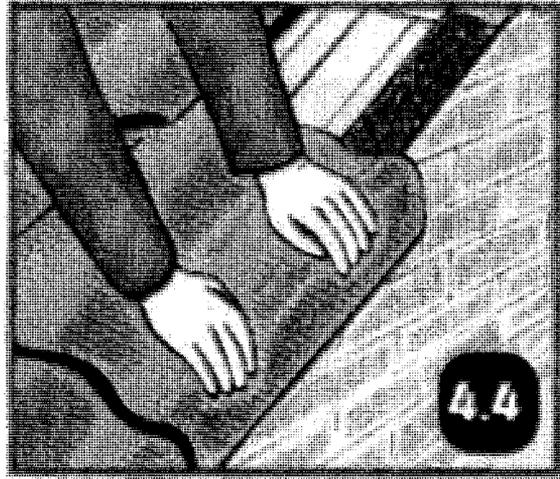


Press the side wall tile firmly down into the Flexim

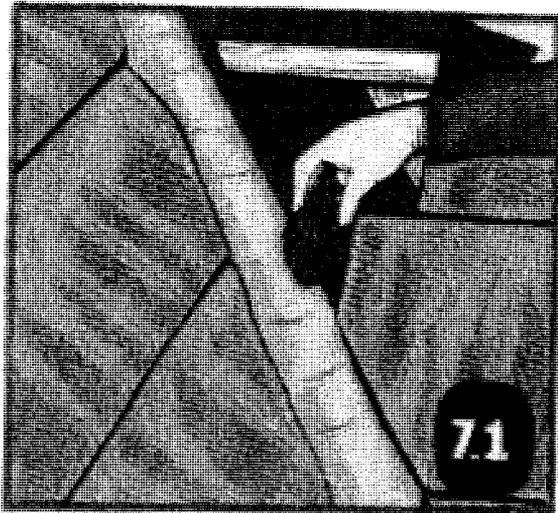


Valleys using the gloves provided, remove a Flexim bar from the packaging and apply it squarely to the place where the tile section is to be applied

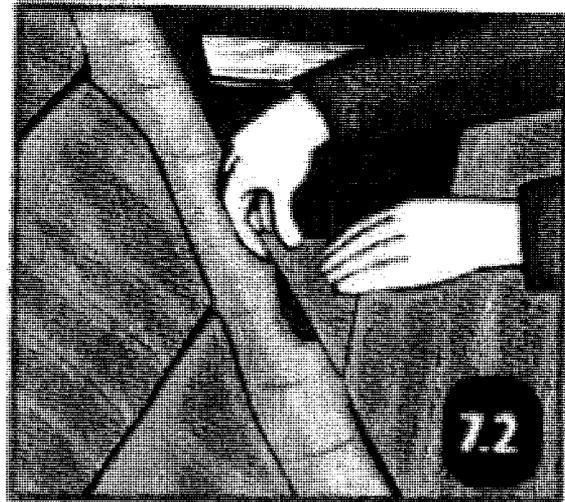

Press the tiles firmly down into the Flexim with bare hands. Smooth out the Flexim until and even finish is achieved.

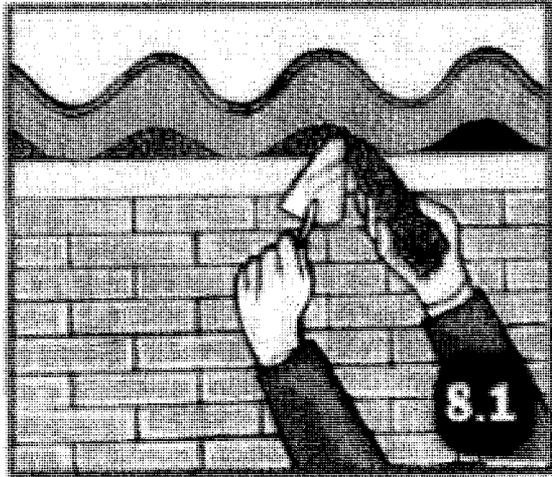

Fill up the corrugation rebates between the frame and the corrugated sheeting with Flexim.

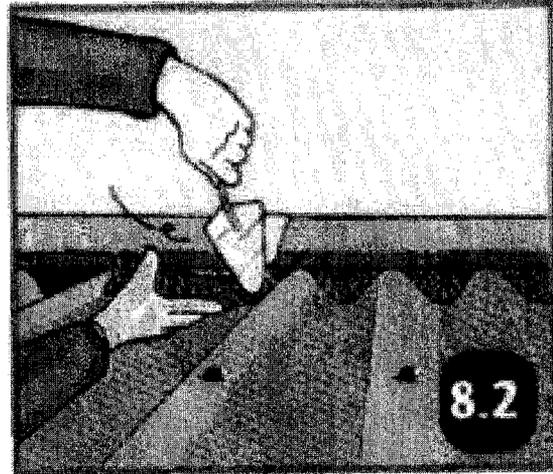

Apply the Flexim between the ridge piece and the corrugated sheeting.

END OF THIS ACCEPTANCE