



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
 (305) 375-2901 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.maimidade.gov/buildingcode](http://www.maimidade.gov/buildingcode)

**Dryvit System, Inc.**  
**One Energy Way**  
**West Warrick, RI 02893**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Dryvit Outsulation Plus (EIF) System.**

**APPROVAL DOCUMENT:** Drawing No. **OSPMDDGG58**, titled "Outsulation Plus MD-5/8" Dens-Glass Gold", sheets 1 and 2 of 2, dated 08/29/08, prepared by Wolters Engineering, signed and sealed by Scott Wolters, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 06-1004.06** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*[Signature]*  
 10/6/08

**NOA No. 08-0729.14**  
**Expiration Date: December 20, 2011**  
**Approval Date: October 30, 2008**  
 Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **OSPMDDGG58**, titled "Outsulation Plus MD-5/8" Dens-Glass Gold", sheets 1 and 2 of 2, dated 08/29/08, prepared by Wolters Engineering, signed and sealed by Scott Wolters, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of Dryvit Outsulation with Standard Plus Mesh Over Dens-Glass Gold, prepared by Hurricane Test Laboratory, LLC, Test Report No. **G387-0309-08**, dated 05/06/08, signed and sealed by Vinu J. Abraham, P.E.
2. Test report on Tensile Bond per ASTM C297 of Dryvit Primus (P) Mixture to Various Substrates, prepared by ETC Laboratories, Test Report No. **ETC-06-1059-18353.1**, dated 12/01/06, signed and sealed by Joseph L. Doldan, P.E.
3. Test report on Tensile Bond per ASTM C297 of Dryvit Genesis (G) Mixture to Various Substrates, prepared by ETC Laboratories, Test Report No. **ETC-06-1059-18355.1**, dated 12/01/06, signed and sealed by Joseph L. Doldan, P.E.
4. Test report on Tensile Bond per ASTM C297 of Dryvit Genesis DM (GDM) Mixture to Various Substrates, prepared by ETC Laboratories, Test Report No. **ETC-06-1059-18357.1**, dated 12/05/06, signed and sealed by Joseph L. Doldan, P.E.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis prepared by Wolters Engineering, complying with F.B.C 2004, dated 07/17/08, signed and sealed by Scott Wolters, P.E.

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

  
10/6/08

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 08-0729.14

Expiration Date: December 20, 2011  
Approval Date: October 30, 2008

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **06-1004.06**, issued to Dyplast Products LLC., for their EPS Block Type Insulation, approved on 11/09/06, and expiring on 12/20/11.

**F. STATEMENTS**

1. Statement letter of code conformance issued by Wolters Engineering, dated 07/17/08, signed and sealed by Scott Wolters, P.E.
2. Statement letter of no financial interest issued by Wolters Engineering, dated 07/17/08, signed and sealed by Scott Wolters, P.E.

**G. OTHER**


1. Notice of Acceptance No. **06-1004.06**, issued to Dryvit System, Inc., approved on 11/09/06 and expiring on 12/20/11.




Handwritten signature of Carlos M. Utrera, dated 10/6/08.

---


Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 08-0729.14  
Expiration Date: December 20, 2011  
Approval Date: October 30, 2008

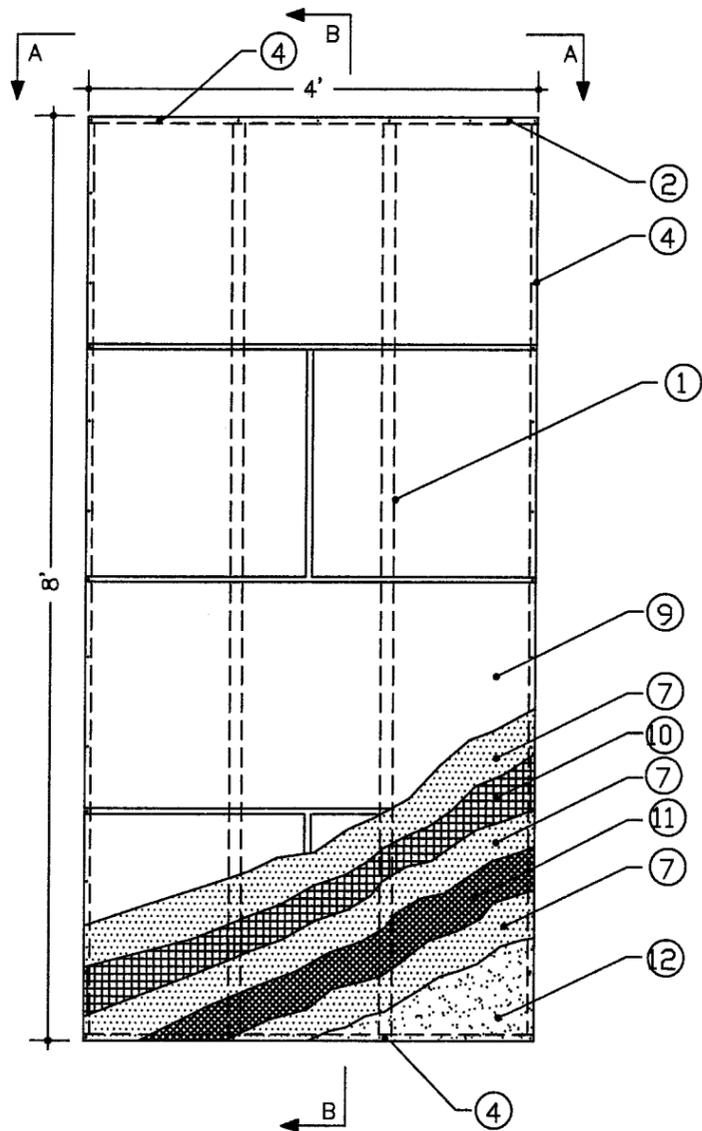

SECTION B-B

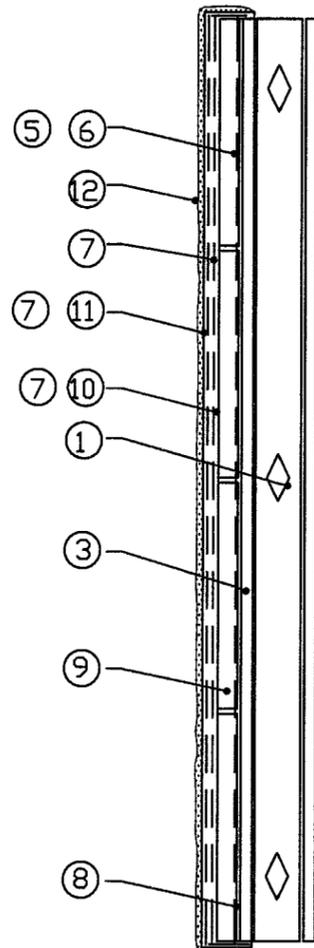

SECTION A-A

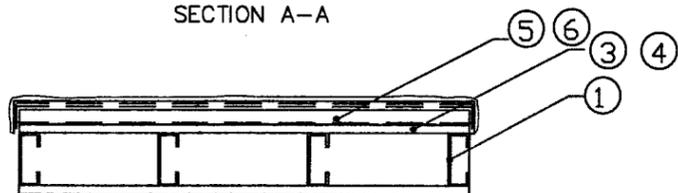

**MATERIAL LIST**

- ① 6" X 16 GAUGE STEEL STUDS AT 16" O.C.
- ② 6" X 16 GA. STEEL TRACK
- ③ 5/8" DENS-GLASS GOLD MEETING ASTM C 1177
- ④ MINIMUM NO. 6 x 1 1/4" BUGLE HEAD SCREWS SPACED AT 4" O.C. ALONG VERTICAL STUDS
- ⑤ DRYVIT BACKSTOP NT
- ⑥ DRYVIT'S STANDARD PLUS REINFORCING MESH: 6.0 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT BACKSTOP NT OVER THE 5/8" DENS-GLASS GOLD.  
THE STANDARD PLUS REINFORCING MESH SHALL BE LAPPED A MINIMUM OF 2 1/2" AT ALL EDGES.
- ⑦ DRYVIT BASE COAT: PRIMUS®, GENESIS®, OR GENESIS® DM; PRIMUS OR GENESIS IS MIXED 1:1 BY WEIGHT WITH PORTLAND CEMENT AND WATER. PRIMUS AND GENESIS ARE 100 PERCENT POLYMER-BASED PRODUCTS. GENESIS DM IS A DRY MIX THAT IS MIXED WITH WATER
- ⑧ ADHERE THE EXPANDED POLYSTYRENE (EPS) INSULATION BOARD WITH DRYVIT'S PRIMUS, GENESIS OR GENESIS DM MIXTURE. THE ADHESIVE IS APPLIED WITH A 3/8" X 1/2" NOTCHED TROWEL WITH NOTCHES SPACED A MAXIMUM OF 1 1/2" O.C. THE ADHESIVE SHALL BE APPLIED TO THE BACK SIDE OF THE EPS IN A VERTICAL ORIENTATION
- ⑨ MINIMUM 1" THICK INSULATION BOARD MEETING DRYVIT SPECIFICATION DS131. INSULATION BOARD SUPPLIER SHALL POSSESS A CURRENT NOA WITH MIAMI DADE COUNTY
- ⑩ DRYVIT PANZER 20 REINFORCING MESH: 20.5 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN DRYVIT BASE COAT. PANZER 20 MESH EDGES SHALL BE ABUTTED TIGHTLY. DO NOT OVERLAP.
- ⑪ DRYVIT'S STANDARD REINFORCING MESH: 4.3 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT BASE COAT. THE STANDARD REINFORCING MESH SHALL BE LAPPED A MINIMUM OF 2 1/2" AT ALL EDGES.
- ⑫ DRYVIT FINISH: A 100 PERCENT ACRYLIC BASED MATERIAL AVAILABLE IN VARIOUS TEXTURES.

**GENERAL NOTES**

- 1. THE SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2004 EDITION AND ITS LATEST SUPPLEMENTS.
- 2. THIS SYSTEM HAS BEEN TESTED IN ACCORDANCE WITH DADE COUNTY PROTOCOLS TAS-201, TAS-202, AND TAS-203 FOR LARGE MISSILE IMPACT, STRUCTURAL AND CYCLIC TESTING.
- 3. THIS SYSTEM SHALL BE APPLIED BY A LICENSED PLASTERING CONTRACTOR FOLLOWING THIS NOTICE OF ACCEPTANCE THE RECOMMENDATION OF DRYVIT SYSTEMS, INC. AND THE APPLICABLE SECTIONS OF THE FLORIDA BUILDING CODE.
- 4. THE ENGINEER AND/OR ARCHITECT OF RECORD FOR EACH PROJECT USING THIS SYSTEM SHALL SIZE ALL STUD FRAMING TO ENSURE CONFORMANCE WITH STUD DEFLECTION AND STRESS LIMITATIONS AS REQUIRED BY ALL GOVERNING CODES AND THIS DOCUMENT.
- 5. INSULATION BOARDS SHALL BE POSITIONED IN A RUNNING BOND PATTERN.
- 6. ALL STUDS USED WITH THIS SYSTEM SHALL BE COMPLETELY SHEATHED AT THE INTERIOR FLANGE OR BRIDGED AT A MAXIMUM OF EVERY 5' OF STUD LENGTH OR AS SPECIFIED BY THE STUD MANUFACTURER.
- 7. ALL STEEL STUDS SHALL BE STRUCTURAL WITH 1 5/8" MINIMUM FLANGE WIDTH AND HAVE A MINIMUM YIELD STRENGTH OF 33000 PSI.
- 8. DETAILS ON SHEET 2 OF 2 ARE TYPICAL AND SHOW INTENT TO PREVENT WATER INFILTRATION INTO AND BEHIND THIS SYSTEM. ALTERNATE DETAILS AND SPECIFIC CONDITIONS NOT COVERED BY THE TYPICAL DETAILS ARE THE RESPONSIBILITY OF THE LICENSED DESIGN PROFESSIONALS IN CONSULTATION WITH DRYVIT SYSTEMS, INC.

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 08-0729-14  
 Expiration Date: 12/20/2011  
 By: [Signature]  
 Miami/Dade Product Control  
 Division

DESIGN PRESSURE
±106 psf

SCOTT WOLTERS  
 FL PE# 62354  
 WOLTERS ENGINEERING  
 (COA# 27194)  
 322 BUCHANAN #609  
 HOLLYWOOD, FL 33019  
 PH/FAX: (954) 921-5828

SEAL: [Signature]  
 SEP 16 2008




DRYVIT SYSTEMS, INC.

One Energy Way  
 West Warwick, Rhode Island

DWG. NO.: Ospmddgg58  
 Issulation Plus MD-5/8" Dens-Glass Gold

SHEET NO: 1 OF 2	ISSUE DATE: 08/29/08	REV/ DATE:
---------------------	-------------------------	---------------

FLORIDA PE

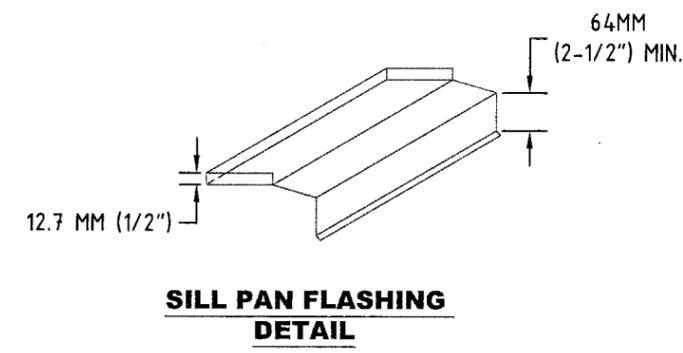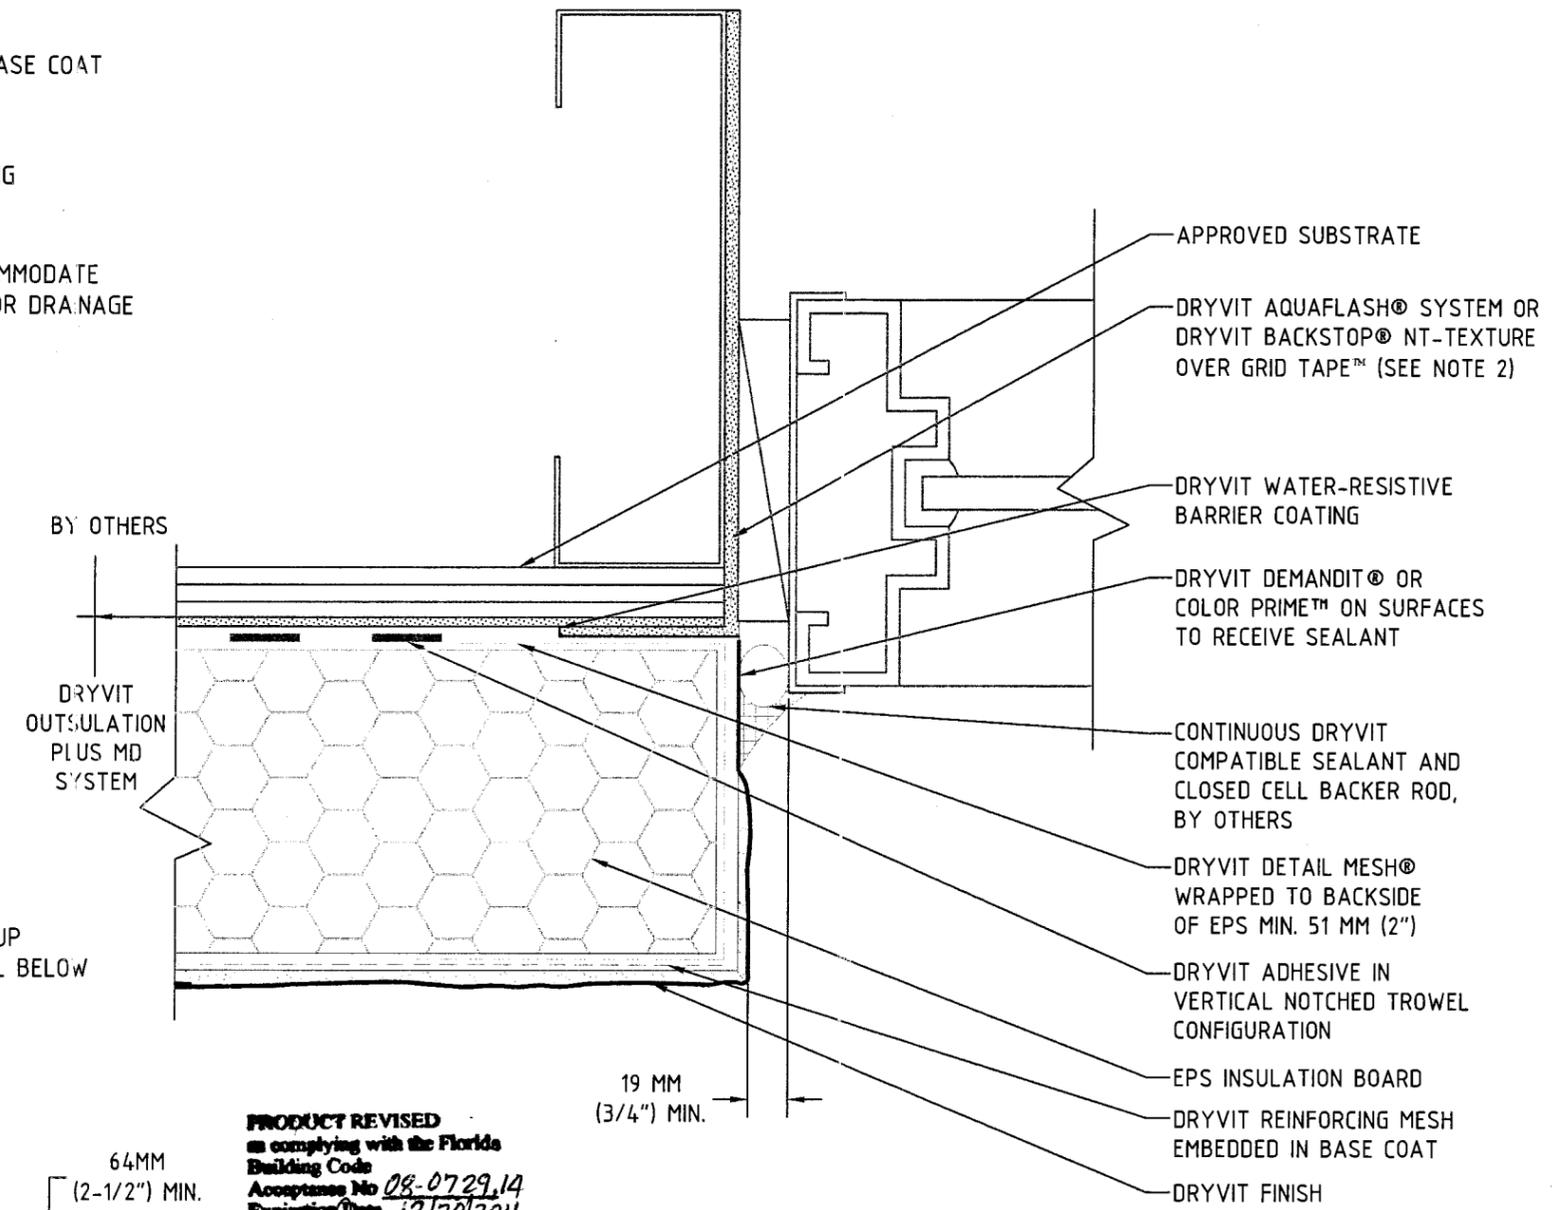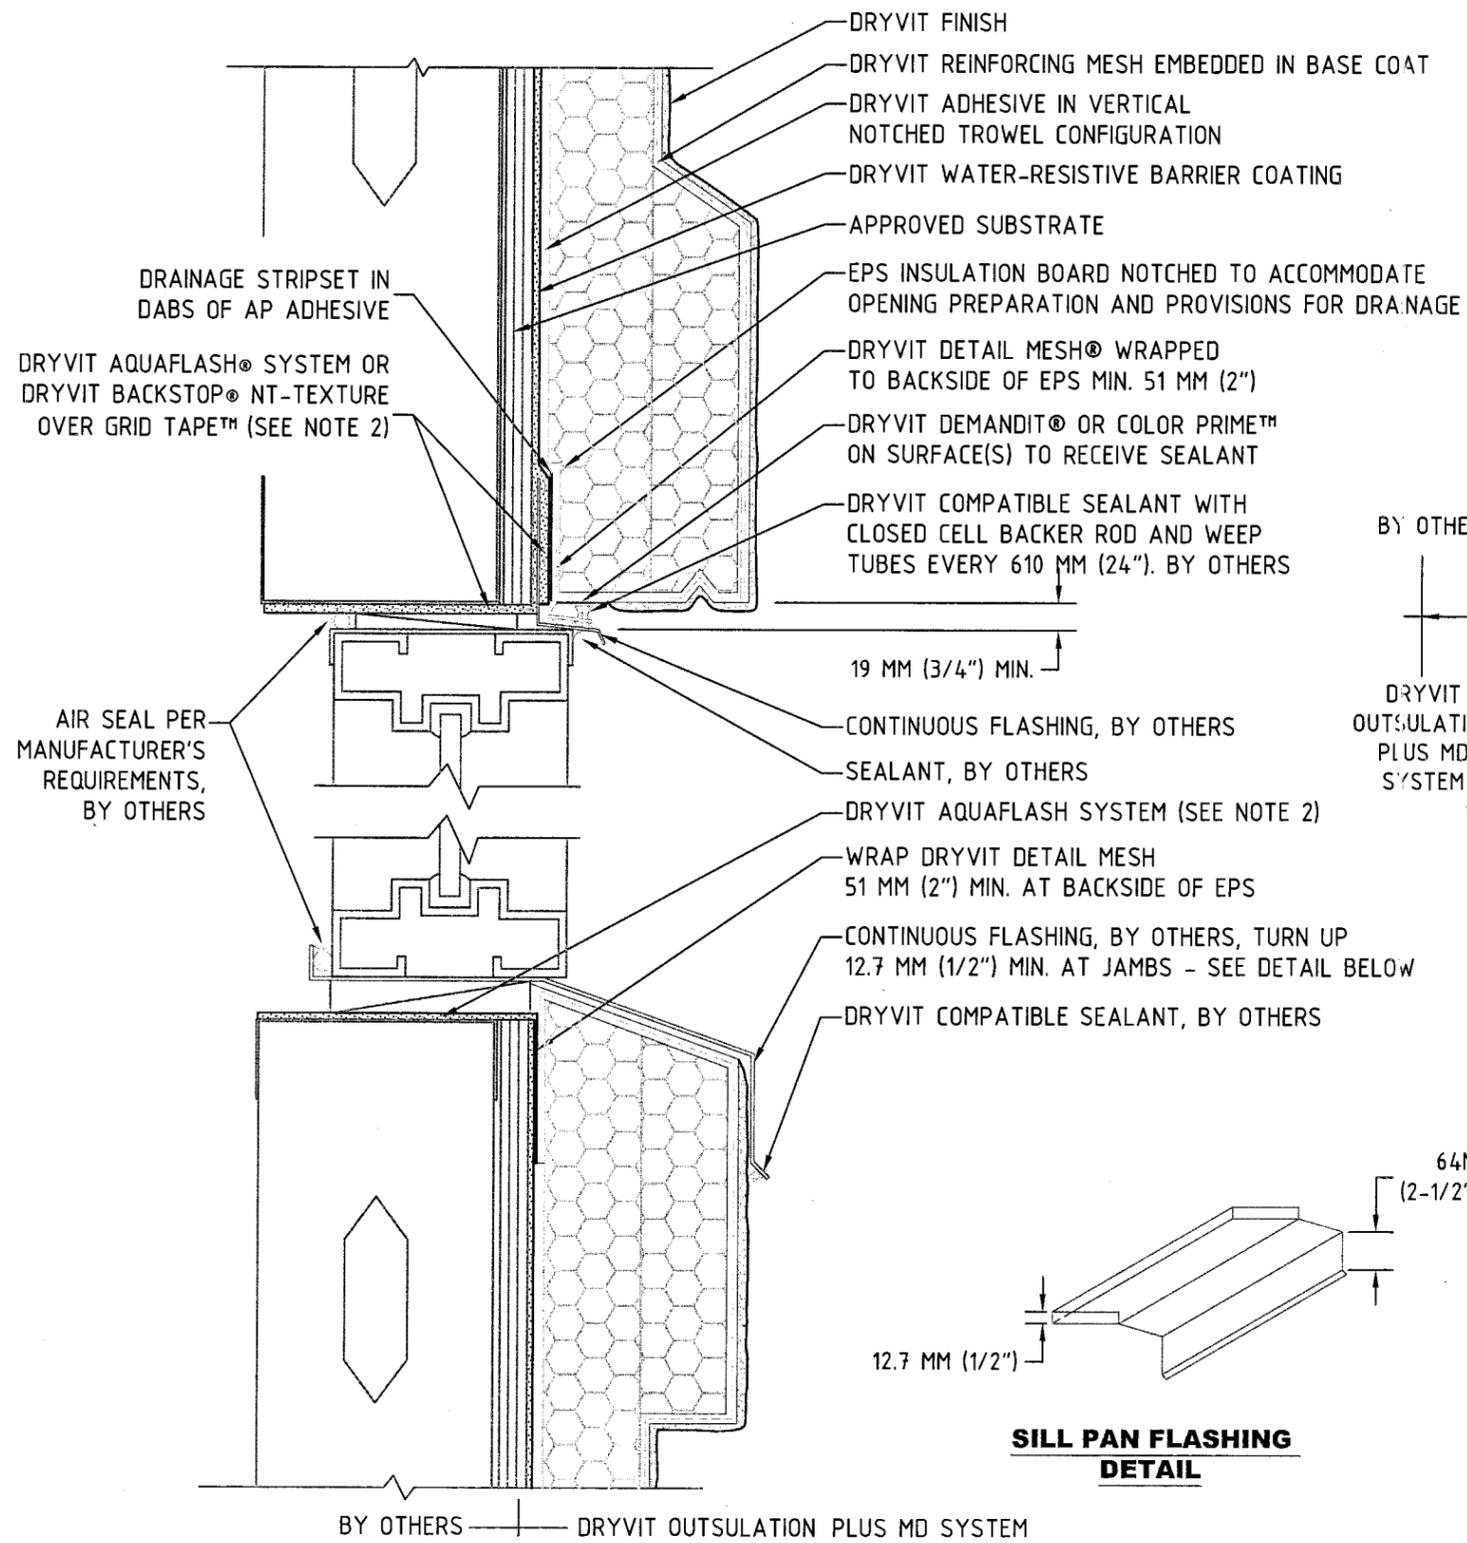

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No 08-0729.14  
 Expiration Date 12/20/2011  
 By *[Signature]*  
 Miami/Dade Product Control  
 Division

SCOTT WOLTERS  
 FL PE# 62354  
 WOLTERS ENGINEERING  
 (COA# 27194)  
 322 BUCHANAN #609  
 HOLLYWOOD, FL 33019  
 PH/FAX: (954) 921-5828  
 SEAL: *[Signature]*  
 SEP 16 2008

DRYVIT SYSTEMS, INC. One Energy Way West Warwick, Rhode Island		
DWG. NO.: OSPMDDGG58		Outsulation Plus MD- 5/8" Dens-Glass Gold
SHEET NO: 2 OF 2	ISSUE DATE: 08/29/08	REV / DATE:
FLORIDA PE		