



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
**(305) 375-2901 FAX (305) 372-6339**

**NOTICE OF ACCEPTANCE (NOA)**

[www.maimidade.gov/buildingcode](http://www.maimidade.gov/buildingcode)

**Miami Wall Systems, Inc.**  
**701 West 25<sup>th</sup> Street**  
**Hialeah, FL 33010**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series 122 Aluminum Fixed Window – S.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **122-Fixed(SM)**, titled "Fixed Window 122 Series (SMI)", sheets 1 through 5 of 5, dated 07/25/08, prepared by manufacturer, signed and sealed by Jorge E. Valdes, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA # 04-0322.10** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 08-0807.19**  
**Expiration Date: August 29, 2013**  
**Approval Date: November 13 2008**  
**Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **122-Fixed (SM)**, titled "Fixed Window 122 Series(SMI), sheets 1 thru 5 of 5, dated 07/25/08, prepared by manufacturer, signed and sealed by Jorge E. Valdes, P.E.

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5595**, dated 06/06/08, signed and sealed by Carlos Rionda, P.E.

2. Test reports on:
  - 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94along with marked-up drawings and installation diagram of a series 122 aluminum equal leg fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4225**, dated 05/06/04, signed and sealed by Edmundo Largaespada, P.E.  
*(Submitted under NOA#04-0322.10)*


3. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of a series 122 aluminum equal leg fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4091**, dated 02/20/04, signed and sealed by Edmundo Largaespada, P.E.  
*(Submitted under NOA#043-0322.09)*

4. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Small Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum single hung window muller to a fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3384**, dated 05/03/02, signed and sealed by Luis Antonio Figueredo, P.E.

*(Submitted under NOA#03-0303.02)*

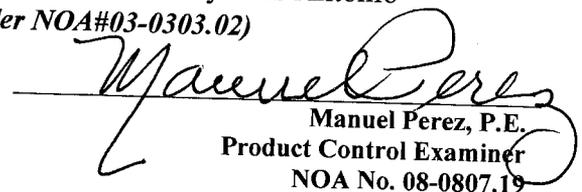  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 08-0807.19

Expiration Date: August 29, 2013  
Approval Date: November 13, 2008

Miami Wall Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Small Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum single hung window muller to a fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3383**, dated 04/30/02, signed and sealed by Luis Antonio Figueredo, P.E. *(Submitted under NOA#03-0303.02)*

6. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum single hung window muller to a fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-3385** and **FTL-3386**, dated 05/03/02 and 05/01/02, signed and sealed by Luis Antonio Figueredo, P.E. *(Submitted for reference only under NOA#03-0303.02)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2004 and 2007, dated 08/05/08, prepared, signed and sealed by Jorge E. Valdes, P.E.  
**Complies with ASTM E1300-02/03**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **05-1208.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite PVB Interlayer**" dated 01/05/06, expiring on 12/11/10.

**F. STATEMENTS**




1. Statement letter of conformance, dated August 05, 2008, signed and sealed by Jorge E. Valdes, P.E.  
2. Statement letter of no financial interest, dated August 05, 2008, signed and sealed by Jorge E. Valdes, P.E.

**G. OTHER**


1. Notice of Acceptance No. **04-0322.10**, issued to Miami Wall Systems, Inc. for their Series 122 Aluminum Fixed Window w/equal & unequal leg frames – SM Impact, approved on 07/01/04 and expiring on 08/29/08.

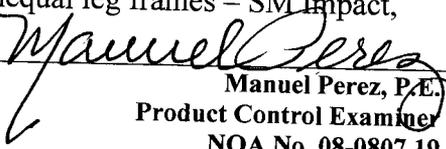  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 08-0807.19


Expiration Date: August 29, 2013  
Approval Date: November 13, 2008

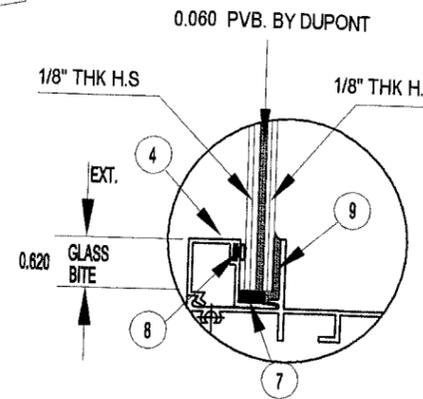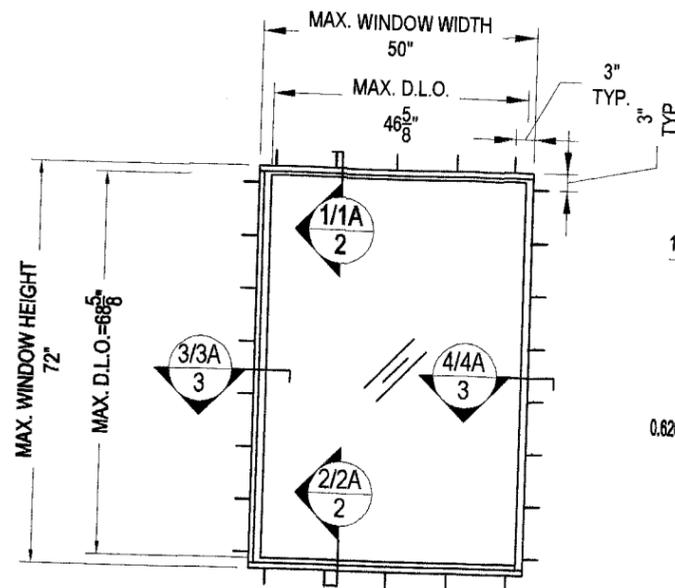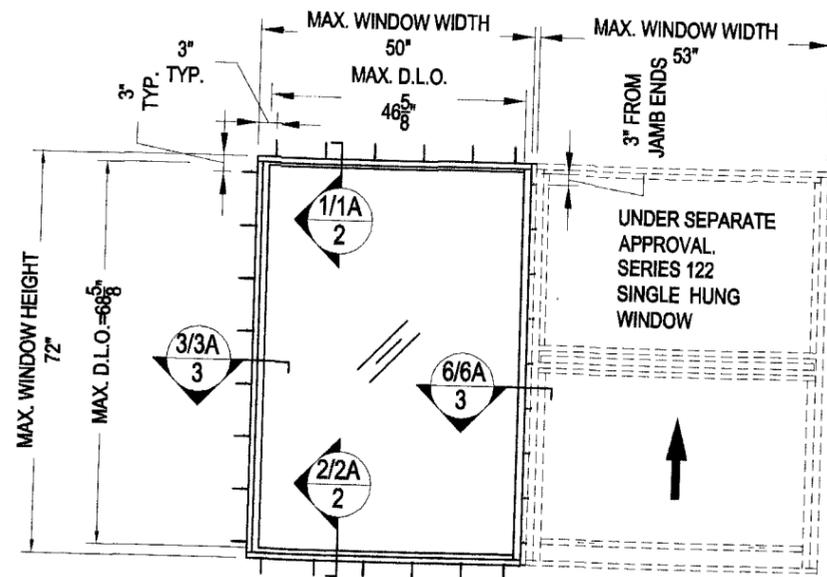

GLASS OPTION No. 1  
 $\frac{5}{16}$ " OVERALL THICKNESS LAMINATED GLASS

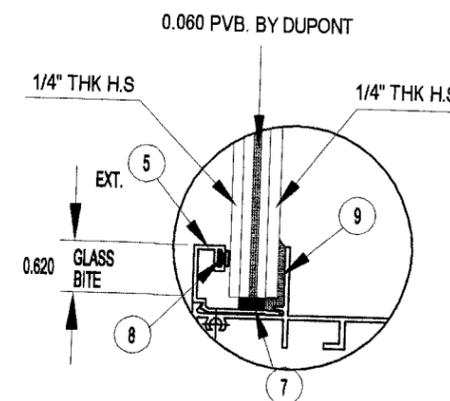


GLASS OPTION No. 2  
 $\frac{9}{16}$ " OVERALL THICKNESS LAMINATED GLASS

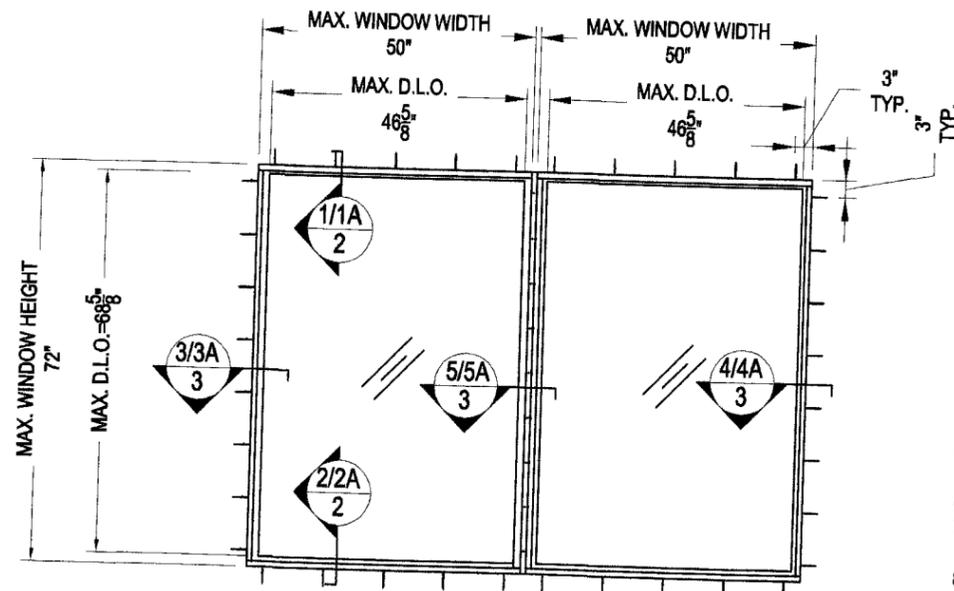

NOTES:

1. THIS PRODUCT HAS BEEN DESIGNED & TESTED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)
2. WOOD BUCKS MUST BE ENGINEERED TO TAKE THE WIND LOADS IMPOSED BY WINDOWS AND TO BE REVIEWED BY BUILDING OFFICIAL
3. FRAME CORNER, FIXED PANEL & MULLION SEALED W/ SILICONE
4. GLAZING TO BE LAMINATED BY DUPONT APPROVED LAMINATOR
5. ALL INSTALLATION FASTENERS MUST BE FACTORY PUNCHED FOR 1/4" DIAM. FLAT HEAD FASTENERS.
6. EQUAL AND UNEQUAL LEG FRAME CONDITION INCLUDED
7. UN-CLIPPED VERTICAL MULLION APPLICATION SHALL BE LIMITED TO APPROVED WINDOW DIMENSIONS, SEE LOAD CHART FOR DETAILS.
8. USE CLUSTER OF (4) @ SILL / HEAD WHERE UN-CLIPPED VERTICAL MULLIONS OCCUR ONLY

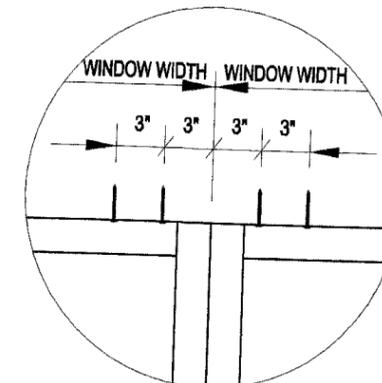

DETAIL "A".  
 CLUSTER OF 4 ANCHORS TYPICAL DETAIL  
 AT INTERLOCKS (TOP AND BOTTOM)  
 ONLY AT UN-CLIPPED MULLION CONDITION  
 (SEE GENERAL NOTES 7 & 8)

FRAME DIMENSIONS	GLASS OPTION	DESIGN PRESSURE RATING (P.S.F.)		MULLION TYPE (SEE SHEET 4)	MAX. FASTENER SPACING	
		+	-		HEAD/SILL	JAMBS
50" X 72"	1	+62.4	-62.4	1	11 $\frac{3}{4}$ "	9 $\frac{1}{2}$ "
50" X 72"	2	+120.0	-120.0	2	9"	8 $\frac{1}{2}$ "
40" X 64"				3		

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 08-0807.19  
 Expiration Date AUG. 29, 2013  
 By *Manuel Perez*  
 Miami Trade Product Control  
 Division

**Jorge E. Valdes**  
 Fla. PE# 67398

*10/15/08*  
*J. Valdes*


NO.	DATE	REVISION

DATE: 10/15/2008  
 SCALE: AS NOTED  
 DWG. BY: L.R.A.  
 CHK. BY: JV  
 DWG NO.: 122-FIXED(SM)  
 SHEET 1 OF 4

FIXED WINDOW 122 SERIES (SMI)

ELEVATIONS  
 GENERAL NOTES

Miami Wall Systems, Inc.



701 West 25th Street  
 Hialeah, Florida. 33010

Phone: (305) 888-2300 Fax: (305) 888-3058





