



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.miamidade.gov/buildingcode

NOTICE OF ACCEPTANCE (NOA)

Andersen Corporation
100 Fourth Avenue North
Bayport, MN 55003

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Frenchwood" Sidelite/Transom Wood Fixed Windows -LMI

APPROVAL DOCUMENT: Drawing No **W02-89**, titled "Frenchwood" Sidelite/Transom-LMP" Sheets 1 through 6 of 6, dated 09-03-02 and last revised on Sep 17, 2008, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews & revises** NOA # **03-0701.02**, consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



9/23/13

NOA No 08-0812.04
Expiration Date: September 11, 2013
Approval Date: October 16, 2008
Page 1

Andersen Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS(transferred from file # **03-0701.02**)

1. Manufacturer's parts drawings and sections.
2. Drawing No **W02-89**, titled "Frenchwood" Sidelite/Transom-LMI" Sheets 1 through 6 of 6, dated 09-03-02 and last revised on Sep 17, 2008, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E.

B. TESTS (transferred from file # **03-0701.02**) Original test conducted per SFC, PA 201, 202 & 203-94, now termed as FBC, TAS 201, 202 & 203-94.

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Load Static Air Pressure Test, per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Resistance Test, per FBC, TAS 202-94
 - 5) Large Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of a sidelite/transom window, prepared by Architectural Testing, Inc., Test Report No. ATI 02-34136.01 dated 5/15/02, signed and sealed by Steven Urich, P.E.

C. CALCULATIONS

1. Anchor verification calculations dated 07-31-08 and last revised on Sep17, 2008, signed and sealed by Dr. Humayoun Farooq, P.E.
2. **Glazing complies with ASTM E-1300-02 & 2004**

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **05-1208.02**, issued to E.I. DuPont de Numerous & Co., Inc., for their "DuPont Butacite PVB ®", expiring on 12/11/10
2. Test reports on PVC material: Test report No.F4693 dated 03/24/99 for "South Florida outside 45 degree exposure for 5 years conducted by South Florida Testing Service (Aspen Research Corp) and tensile strength test of exposed & unexposed samples.
3. Test reports on PVC material: Testr report No. 31005559SAT-004 for Surface Burning Characteristics of Building Materials per ASTM E 84-05, dated 08-04-06 , test report # 3100559SAT-001 for Self-Ignition Temperature per ASTM D 1929-96, dated 08-09-06 and test report # 3100559SAT-007 per ASTM D-635.03 dated Aug 08, 2006 issued by Intertek ETL Semko.

E. STATEMENTS

1. Statement letter of conformance & "No financial interest, dated 07-30-08, both signed & sealed by Dr. Humayoun Farooq, P.E.
2. Lab compliance statements as a part of the above test reports.
3. Addendum letters issued by Architectural Testing dated 09-08-08 and 05-12-2000.


G. OTHER

1. This NOA **renews & revises** NOA # **03-0701.02**, which expired on September 11, 2008.
2. Test proposal dated 03/21/03.


Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 08-0812.04


Expiration Date: September 11, 2013
Approval Date: October 16, 2008

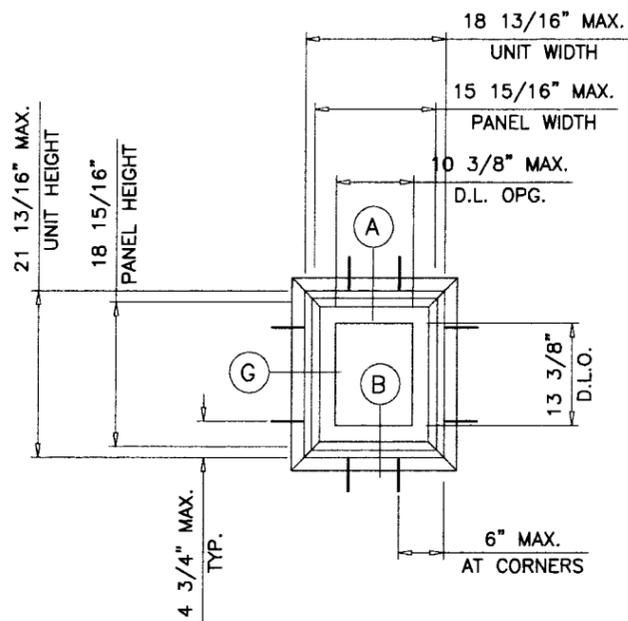

FRENCHWOOD SIDELITE TRANSOM ELEVATION
FWSLT UNITS

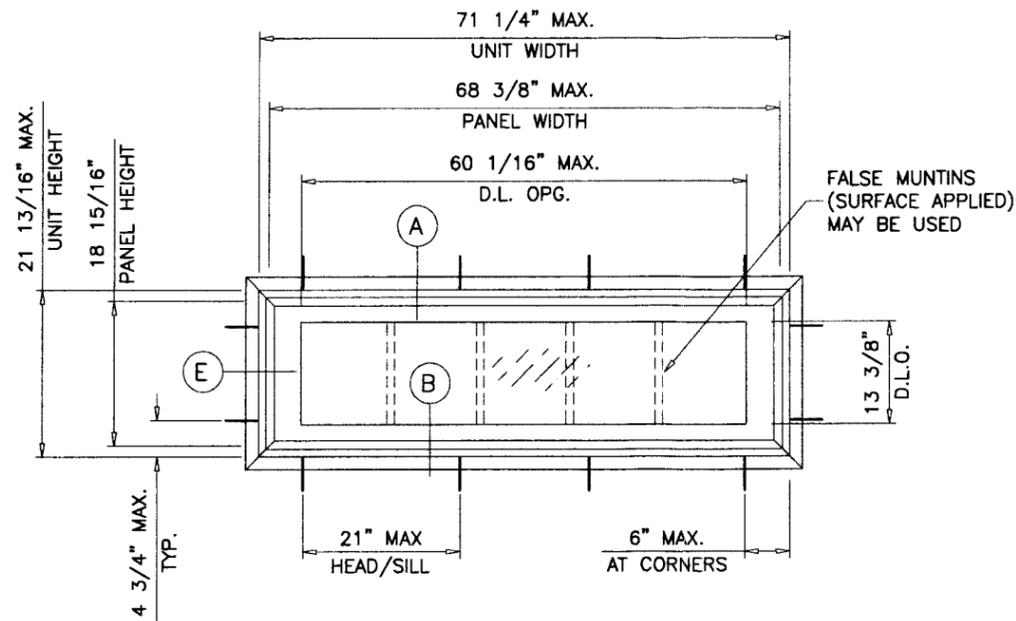

FRENCHWOOD TRANSOM ELEVATION
FWT UNITS

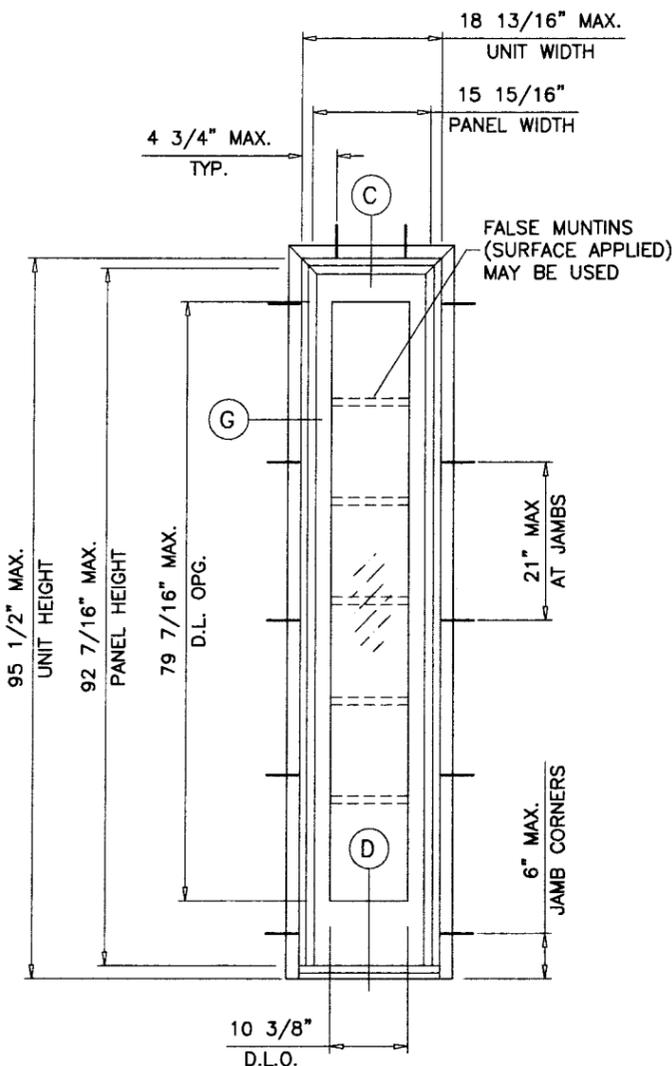

FRENCHWOOD SIDELITE ELEVATION
FWSL UNITS

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 08-0812.04
Expiration Date SEP 11, 2013
By Ishaq I. Chanda
Miami Dade Product Control
Division

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

'FRENCHWOOD' SIDELITE/TRANSOM WINDOWS

DESIGN LOAD RATING FOR SIDELITES/TRANSOMS TO BE AS PER CHARTS SHOWN ON SHEET 2.
THESE WINDOWS CAN BE INSTALLED AS SINGLE UNITS OR IN COMBINATION WITH MIAMI-DADE COUNTY APPROVED PRODUCTS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

ALL WOOD NOT SEPARATED FROM AND/OR IN DIRECT CONTACT WITH CONCRETE AND MASONRY SHALL BE TREATED IN AN APPROVED METHOD WITH AN APPROVED PRESERVATIVE OR SHALL BE AN APPROVED DURABLE SPECIES PER FBC 2004, CH 2326.2.4.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 17 2008

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-89

FRENCHWOOD SIDELITE/TRANSOM WINDOWS (L.M.I.)
ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7691 FAX (-)
AW

no.	date	description
A	07.30.08	UPDATED FOR 2007 FBC
B	09.17.08	REV. PER BECC COMMENTS


date: 09-30-02
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W02-89
sheet 1 of 6

FRENCH WOOD SIDELITE TRANSOM UNITS						
DESIGN LOAD CAPACITY - PSF						
UNIT DESCRIPTION	UNIT WIDTH INCHES	UNIT HT. INCHES	D.L.O. WD. INCHES	D.L.O. HT. INCHES	EXT. (+)	INT. (-)
FWSLT1311	14-13/16	12-13/16	6-3/8	4-3/8	62.0	77.0
FWSLT1711	18-13/16		10-3/8		62.0	77.0
FWSLT1316	14-13/16	17-13/16	6-3/8	9-3/8	62.0	77.0
FWSLT1716	18-13/16		10-3/8		62.0	77.0
FWSLT13110	14-13/16	21-13/16	6-3/8	13-3/8	62.0	77.0
FWSLT17110	18-13/16		10-3/8		62.0	77.0

FRENCH WOOD SIDELITE UNITS						
DESIGN LOAD CAPACITY - PSF						
UNIT DESCRIPTION	UNIT WIDTH INCHES	UNIT HT. INCHES	D.L.O. WD. INCHES	D.L.O. HT. INCHES	EXT. (+)	INT. (-)
FWSL1368	14-13/16	79-1/2	6-3/8	63-7/16	62.0	77.0
FWSL1768	18-13/16		10-3/8		62.0	77.0
FWSL13611	14-13/16	82-3/8	6-3/8	66-5/16	62.0	77.0
FWSL17611	18-13/16		10-3/8		62.0	77.0
FWSL1380	14-13/16	95-1/2	6-3/8	79-7/16	62.0	77.0
FWSL1780	18-13/16		10-3/8		62.0	77.0

FRENCH WOOD TRANSOM UNITS						
DESIGN LOAD CAPACITY - PSF						
UNIT DESCRIPTION	UNIT WIDTH INCHES	UNIT HT. INCHES	D.L.O. WD. INCHES	D.L.O. HT. INCHES	EXT. (+)	INT. (-)
FWT2111	24-1/2		13-5/16		62.0	77.0
FWT2711	30-1/8		18-15/16		62.0	77.0
FWT2911	32-1/8		20-15/16		62.0	77.0
FWT3111	36-1/8		24-15/16		62.0	77.0
FWT4111	48	12-13/16	36-13/16	4-3/8	62.0	77.0
FWT5011	59-1/4		48-1/16		62.0	77.0
FWT5411	63-1/4		52-1/16		62.0	77.0
FWT6011	71-1/4		60-1/16		62.0	77.0
FWT2116	24-1/2		13-5/16		62.0	77.0
FWT2716	30-1/8		18-15/16		62.0	77.0
FWT2916	32-1/8		20-15/16		62.0	77.0
FWT3116	36-1/8		24-15/16		62.0	77.0
FWT4116	48	17-13/16	36-13/16	9-3/8	62.0	77.0
FWT5016	59-1/4		48-1/16		62.0	77.0
FWT5416	63-1/4		52-1/16		62.0	77.0
FWT6016	71-1/4		60-1/16		62.0	77.0
FWT21110	24-1/2		13-5/16		62.0	77.0
FWT27110	30-1/8		18-15/16		62.0	77.0
FWT29110	32-1/8		20-15/16		62.0	77.0
FWT31110	36-1/8		24-15/16		62.0	77.0
FWT41110	48	21-13/16	36-13/16	13-3/8	62.0	77.0
FWT50110	59-1/4		48-1/16		62.0	77.0
FWT54110	63-1/4		52-1/16		62.0	77.0
FWT60110	71-1/4		60-1/16		62.0	77.0

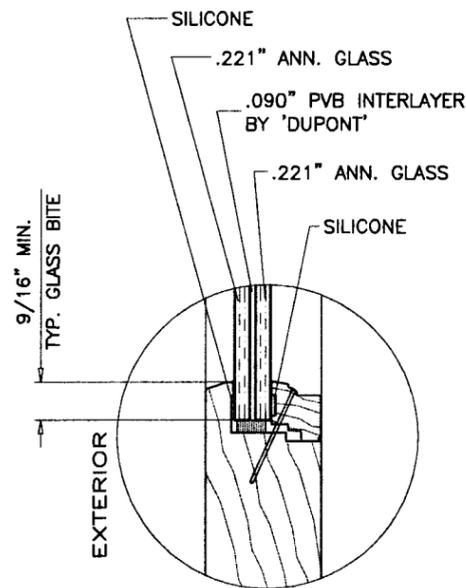


.532" OVERALL LAMINATED GLASS

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 08-0812.04
 Expiration Date SEP 11, 2013
 By Shang L. Chanda
 Miami Dade Product Control
 Division

NOTE:
 GLASS CAPACITIES ON THIS SHEET ARE
 BASED ON ASTM E1300-02/04 (3 SEC. GUSTS).

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

SEP 17 2008




AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W02-89

FRENCHWOOD SIDELITE/TRANSOM WINDOWS (L.M.I.)
ANDERSEN CORPORATION
 100 FOURTH AVE. NORTH
 BAYPORT, MN. 55003-1096
 TEL. (800) 426-7691 FAX (-)


no	date	description
A	07.30.08	UPDATED FOR 2007 FBC
B	09.17.08	REV. PER BCCO COMMENTS

date: 09-30-02
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W02-89
 sheet 2 of 6

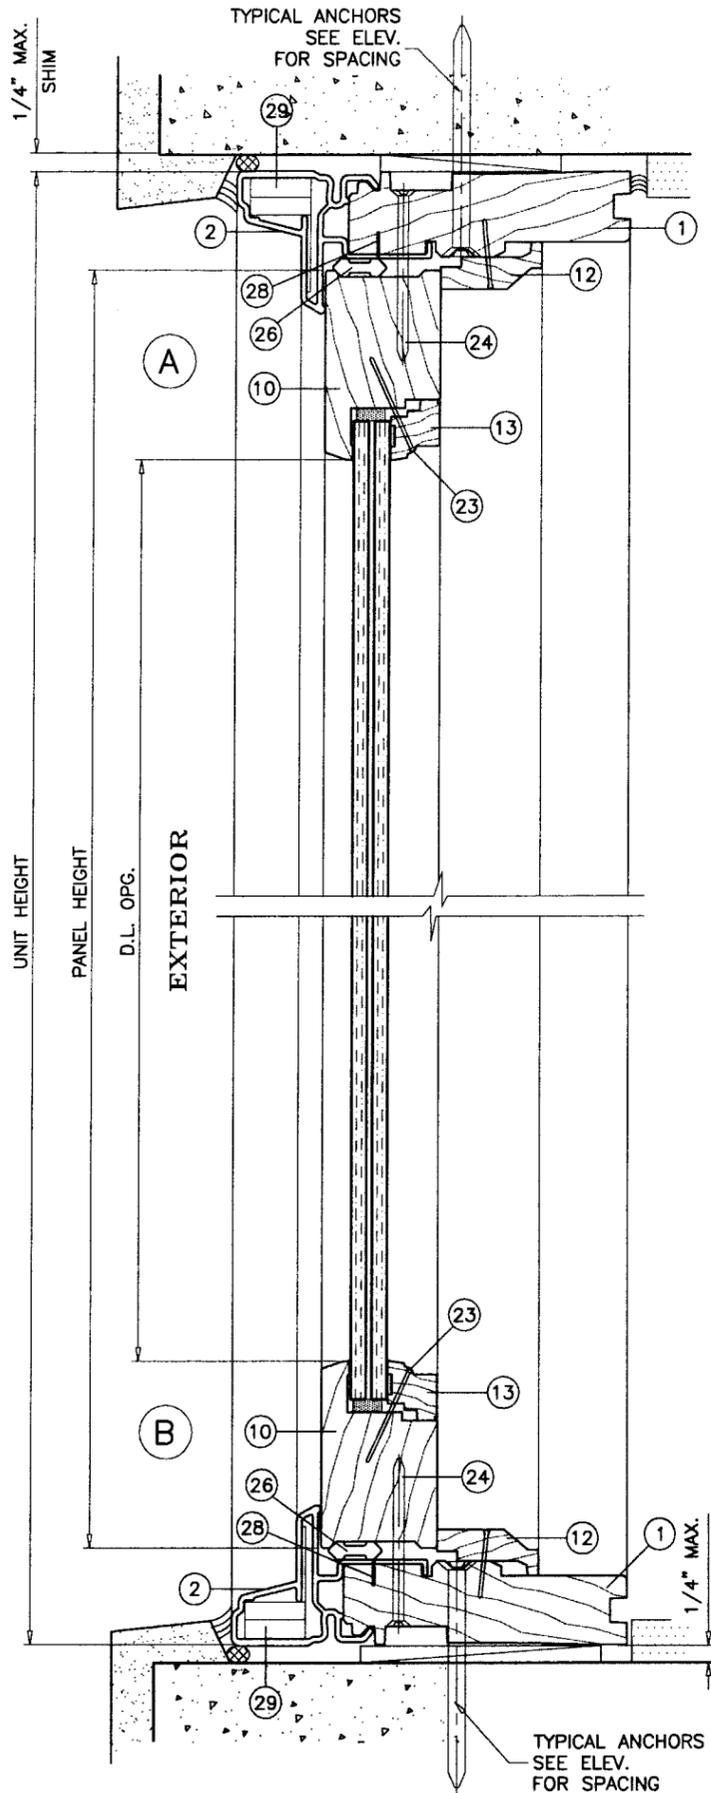

TRANSOM UNIT

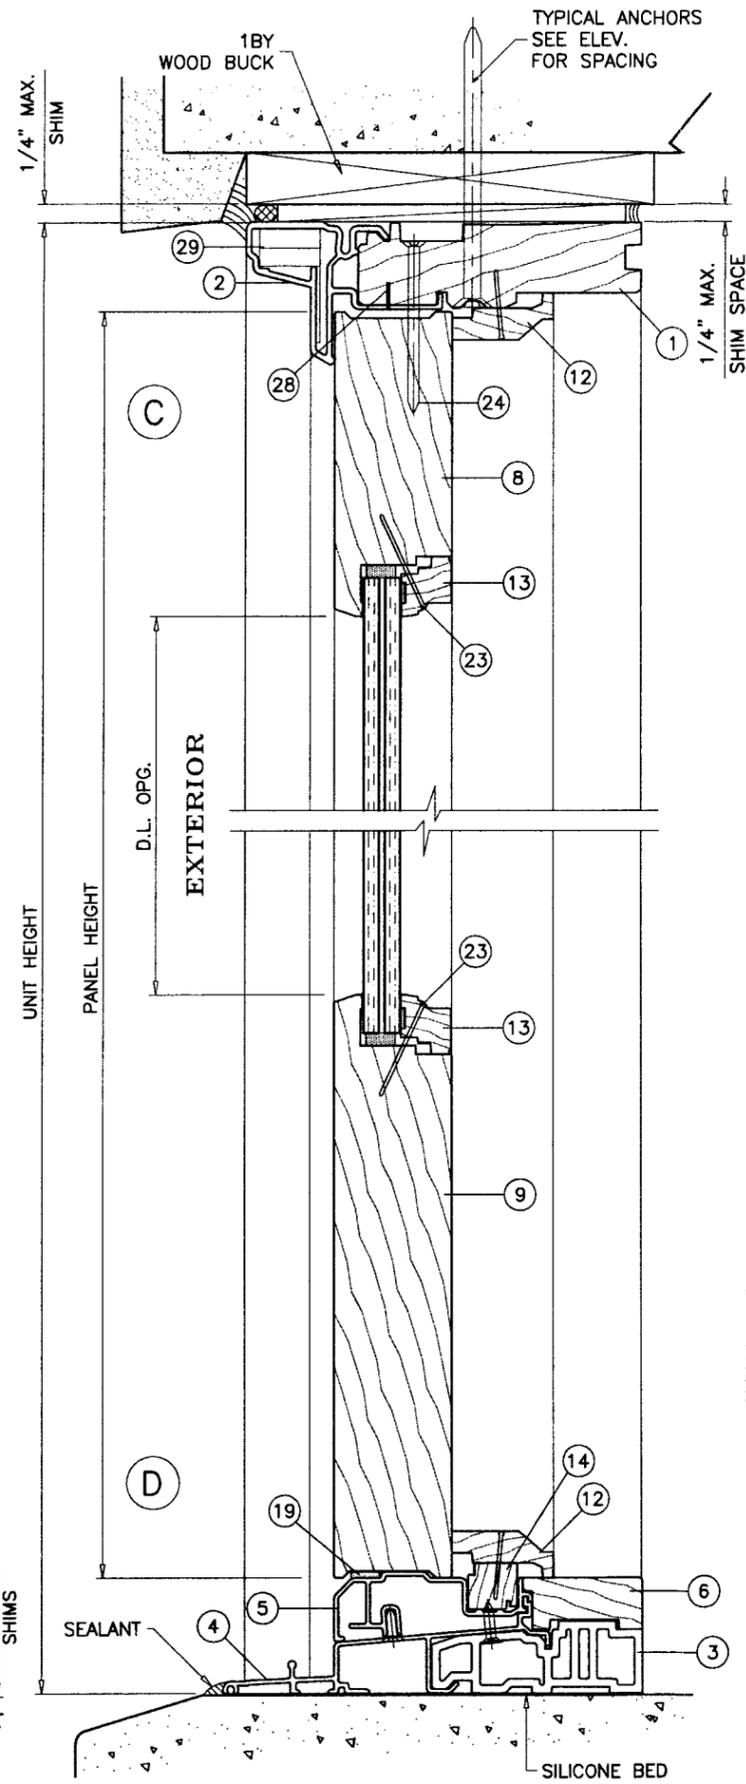

SIDELITE UNIT

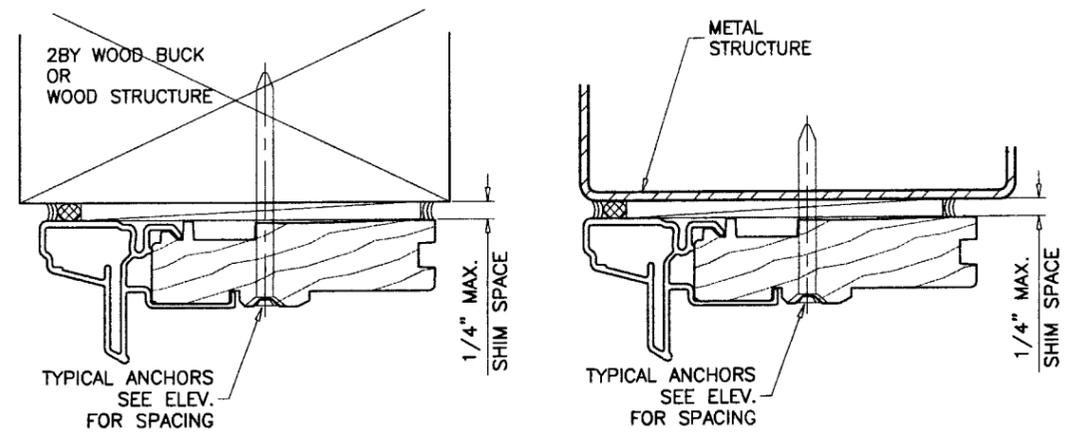

WOOD BUCKS AND METAL STRUCTURES NOT BY ANDERSEN MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

#12 SMS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES WITH 1-3/8" MIN. PENETRATION INTO WOOD
3/16" OR 1/4" DIA ULTRACON BY 'ELCO'
 THRU 1BY WOOD BUCKS INTO CONCRETE OR MASONRY WITH 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONCRETE OR MASONRY WITH 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#12 SMS OR SELF DRILLING SCREWS
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

SEALANTS:
 ALL FRAME AND PANEL JOINT, INSTALLATION SCREWS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH 'SCHNEE MOREHEAD 5504' SEALANT.

SEALANTS:
 ALL FRAME AND PANEL JOINT, INSTALLATION SCREWS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH 'SCHNEE MOREHEAD 5504' SEALANT.

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 08-0812.04
 Expiration Date SEP 14 2013
 By Ishag I. Chander
 Miami Dade Product Control
 Division

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

SEP 17 2008


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-8978
 COMP-ANL\W02-89

FRENCHWOOD SIDELITE/TRANSOM WINDOWS (L.M.I.)
ANDERSEN CORPORATION
 100 FOURTH AVE. NORTH
 BAYPORT, MN. 55003-1096
 TEL. (800) 426-7691 FAX (-)


no.	date	description
A	07.30.08	UPDATED FOR 2007 FBC
B	09.17.08	REV. PER BCCO COMMENTS

date: 09-30-02
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W02-89
 sheet 3 of 6

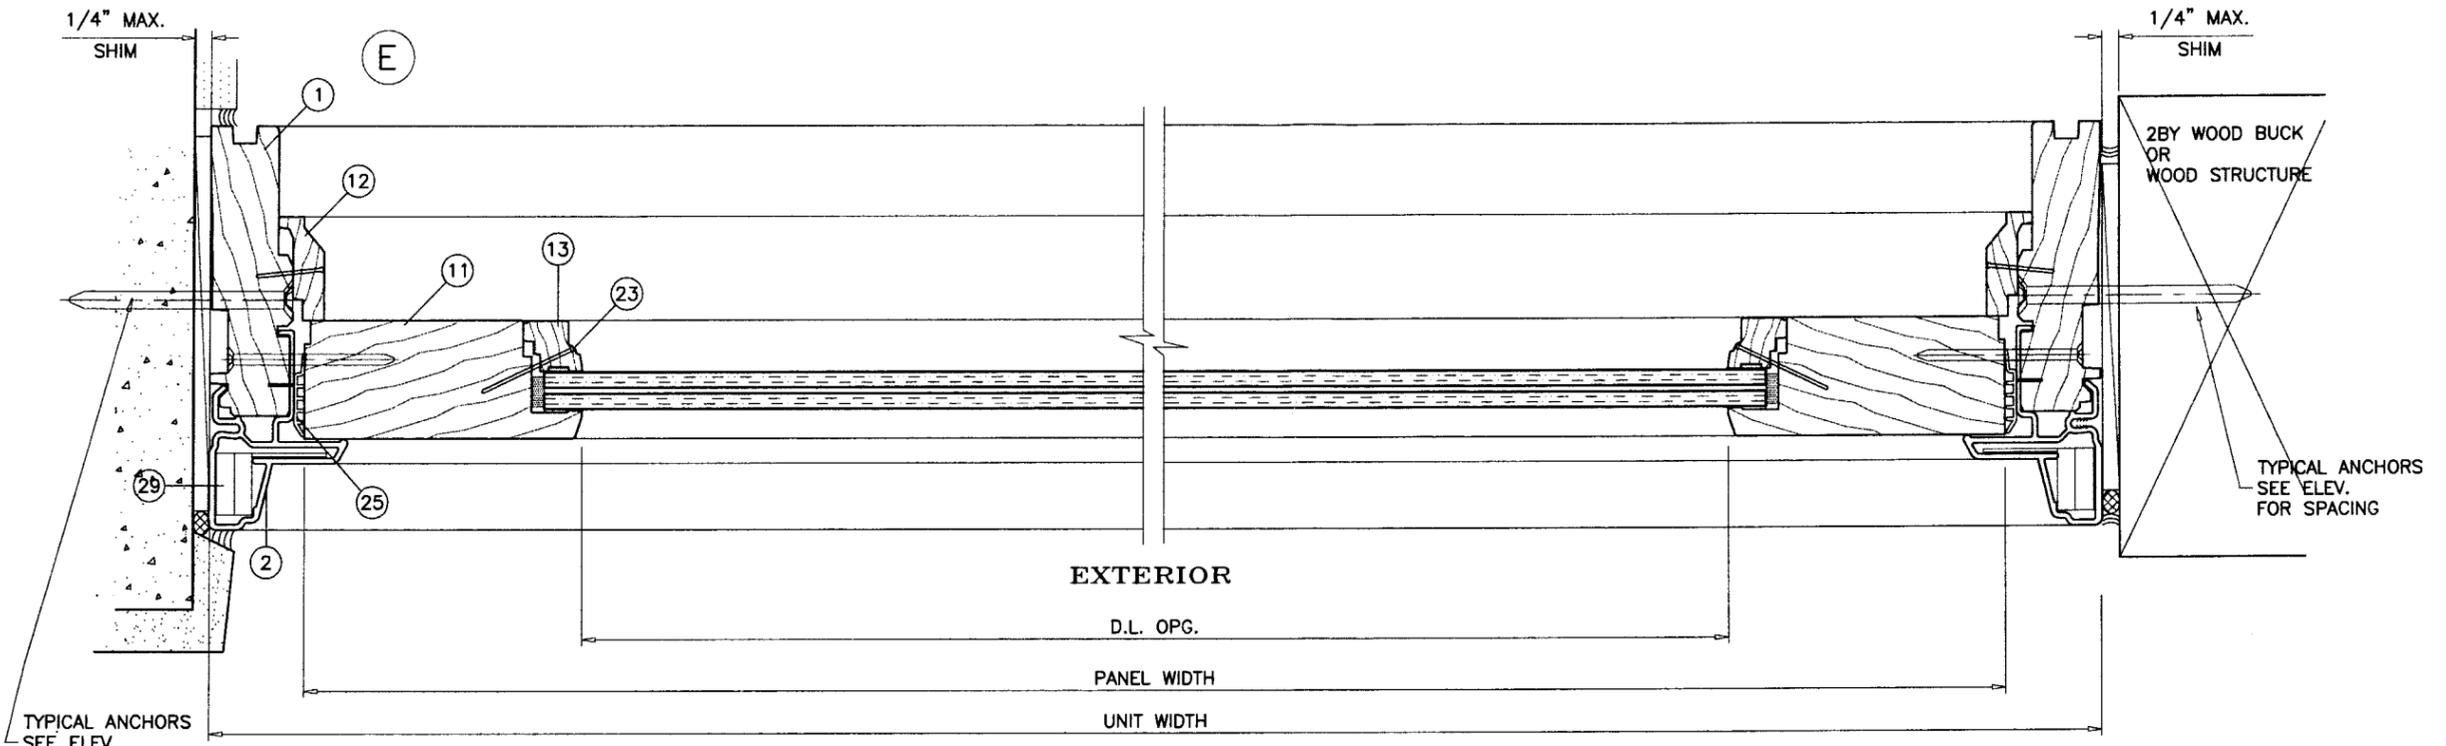

TRANSOM UNIT

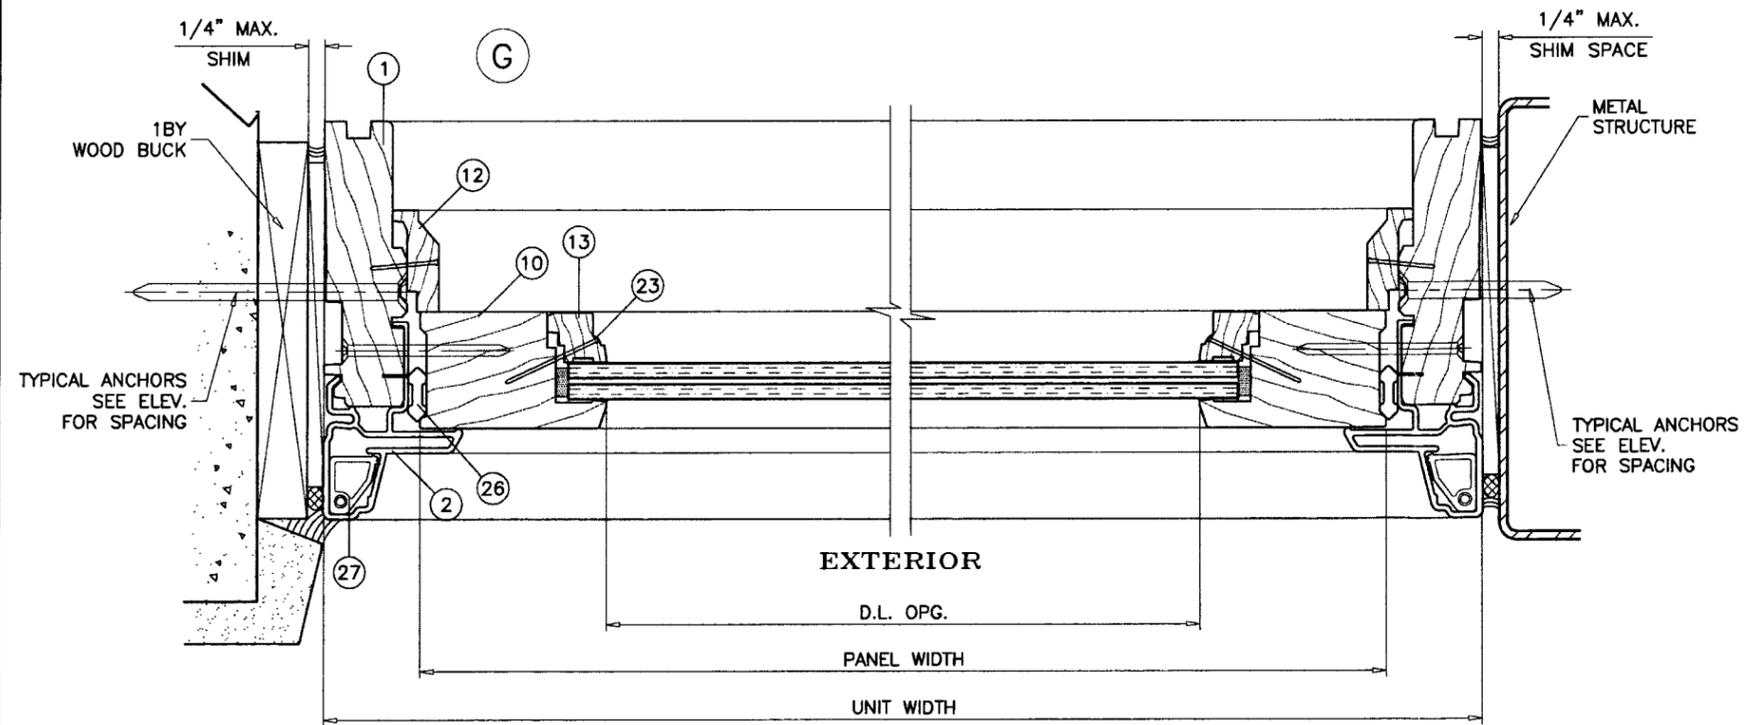

SIDELITE UNIT

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No *08-0812-04*
 Expiration Date *SEP 11, 2013*
 By *Ishag I. Chaudhry*
 Miami Dade Product Control
 Division

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
SEP 17 2008


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W02-89

FRENCHWOOD SIDELITE/TRANSOM WINDOWS (L.M.I.)
ANDERSEN CORPORATION
 100 FOURTH AVE. NORTH
 BAYPORT, MN. 55003-1096
 TEL. (800) 426-7691 FAX (-)


no	date	by	description
A	07.30.08		UPDATED FOR 2007 FBC
B	09.17.08		REV. PER BCCO COMMENTS

date:	09-30-02
scale:	3/8" = 1"
dr. by:	HAMID
chk. by:	


drawing no.	W02-89
sheet	4 of 6

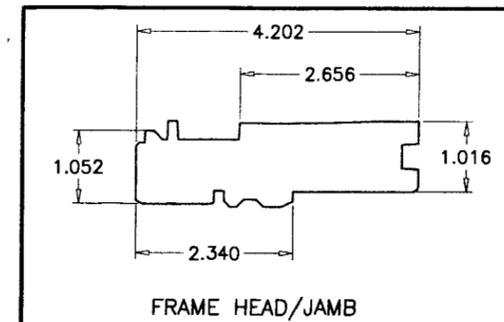


FRAME HEAD/JAMB

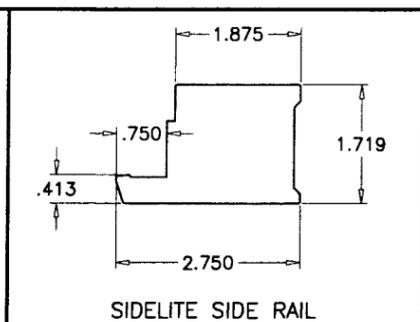


SIDELITE SIDE RAIL

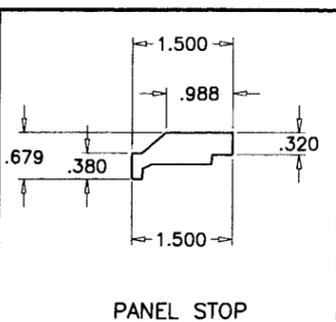


PANEL STOP

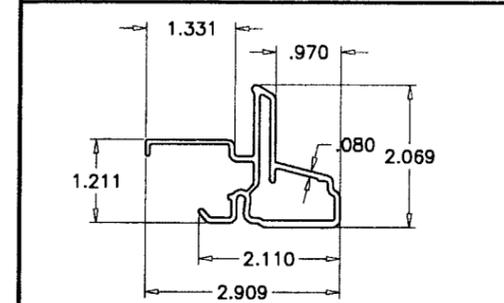


FRAME COVER

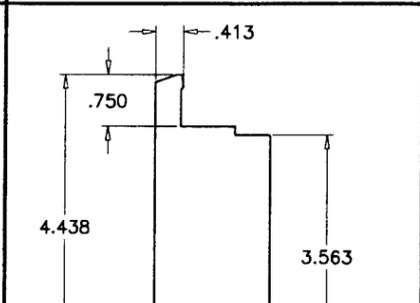


TOP RAIL

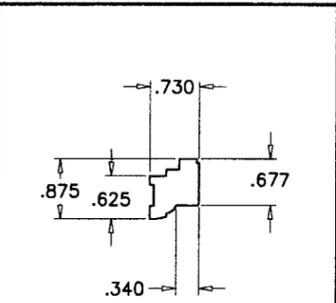


GLASS STOP

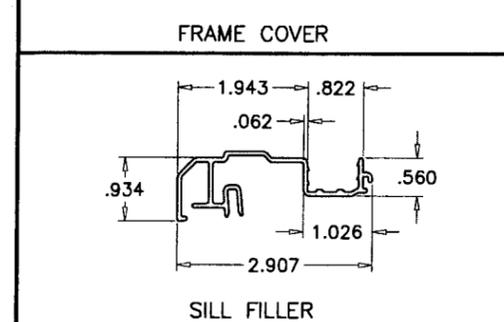


SILL FILLER

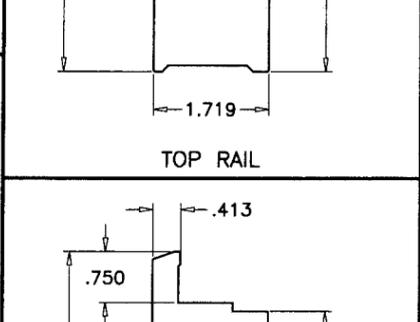


BOTTOM RAIL

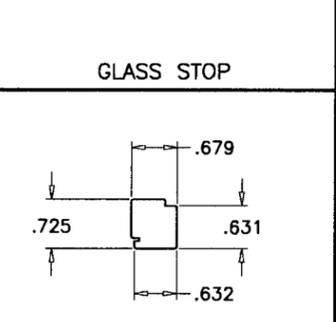


STOP INSIDE HEAD

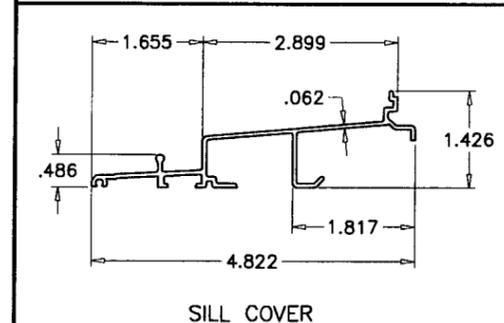


SILL COVER

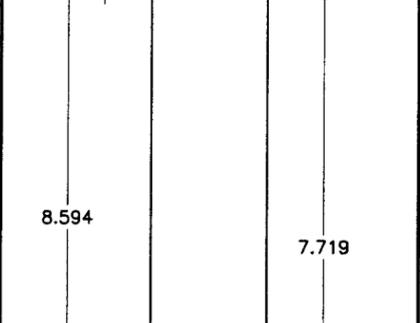


RAIL FILLER

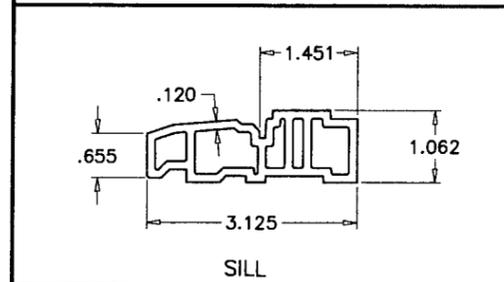


SILL

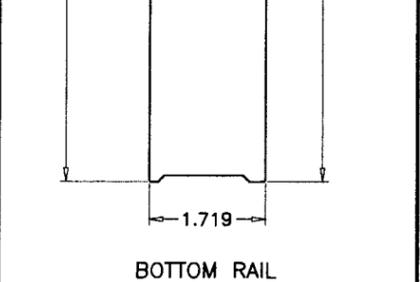

PANEL FILLER

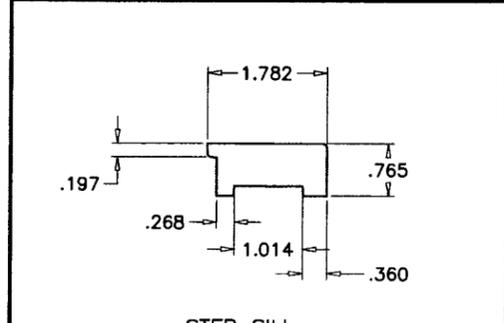

STEP SILL

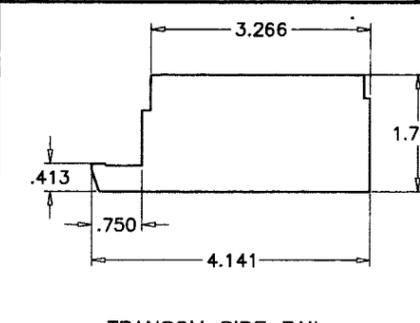

TRANSOM SIDE RAIL

ITEM #	NUMBER	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	29362	AS REQD.	FRAME HEAD/JAMB	WOOD	ANDERSEN
2	29168	AS REQD.	FRAME COVER	FIBERGLASS	-
3	52371	1	FRAME SILL	FIBREX	ANDERSEN
4	29305	1	SILL COVER	ALUMINUM	-
5	29156	1	SILL FILLER	ALUMINUM	-
6	29137	1	STEP SILL	WOOD	ANDERSEN
8	29159	1/	PANEL SIDELITE TOP RAIL/TRANSOM SIDE RAIL	WOOD	ANDERSEN
9	29158	1/	PANEL SIDELITE BOTTOM RAIL	WOOD	ANDERSEN
10	29350	2/	PANEL SIDELITE SIDE RAIL/ TRANSOM TOP & BOT. RAIL	WOOD	ANDERSEN
11	57116	2/	PANEL TRANSOM SIDE RAIL	WOOD	ANDERSEN
12	29361	4	PANEL STOP	WOOD	ANDERSEN
13	29265	4	GLASS STOP	WOOD	ANDERSEN
14	29142	1	STOP, INSIDE HEAD	WOOD	ANDERSEN
19	30172	-	FOAM TAPE	-	-
20	50347	AS REQD.	NAILING FLANGE	VINYL	ANDERSEN
21	#10 X 4-3/8"	2/	CORNER PANEL CORNER ASSEMBLY SCREWS	STEEL	-
22	#10 X 2-1/2"	AS REQD.	FRAME CORNER ASSEMBLY SCREWS	STEEL	-
23	20093	AS REQD.	NAILS AT 2" FROM ENDS & 9" O.C.	-	18 GA X 1-1/2" LONG
24	#10 X 2-1/2"	AS REQD.	PANEL SCREWS	-	AT 5" FROM ENDS & 21" O.C.
25	52472	AS REQD.	PANEL FILLER	RIGID PVC	-
26	52539	AS REQD.	RAIL FILLER	RIGID PVC	-
27	57127	AS REQD.	CORNER LOCK SIDELITE SILL	RIGID PVC	-
28	-	-	STAPLE	STEEL	7/16" X 1/2" X 16 GA.
29	52112	AS REQD.	CORNER LOCK	ALUMINUM	-
30	#7 X 5/8"	2/	CORNER ASSEMBLY SCREWS	-	-

ALL WOOD TO BE PONDEROSA PINE OR EQUAL (MIN. S.G. = 0.55)

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 17 2008

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL/W02-89

FRENCHWOOD SIDELITE/TRANSOM WINDOWS (L.M.I.)
ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7681 FAX (-)

no	date	by	description
A	07.30.08		UPDATED FOR 2007 FBC
B	09.17.08		REV. PER BCCO COMMENTS

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 05-0812.04
Expiration Date SEP 11, 2013
By [Signature]
Miami Dade Product Control
Division


date: 09-30-02
scale: 3/8" = 1"
dr. by: HAMID
chk. by:
drawing no.
W02-89
sheet 5 of 6

no	date	description
A	07.30.08	UPDATED FOR 2007 FBC
B	09.17.08	NO CHANGE THIS SHEET

date: 09-30-02	scale: 3/8" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

APPLY SILICONE SEALANT TO ENTIRE SURFACE OF EXTERIOR FRAME MEMBER END BEFORE ASSEMBLING FRAME. (TOP AND BOTTOM)

APPLY 0.125 DIA. ±.031 BEAD SILICONE SEALANT TO STILE-RAIL INTERFACE. BEAD MUST BE CONTINUOUS AND COVER COMPLETE LENGTH OF THE SURFACE WHERE STILE AND RAILS MEET.

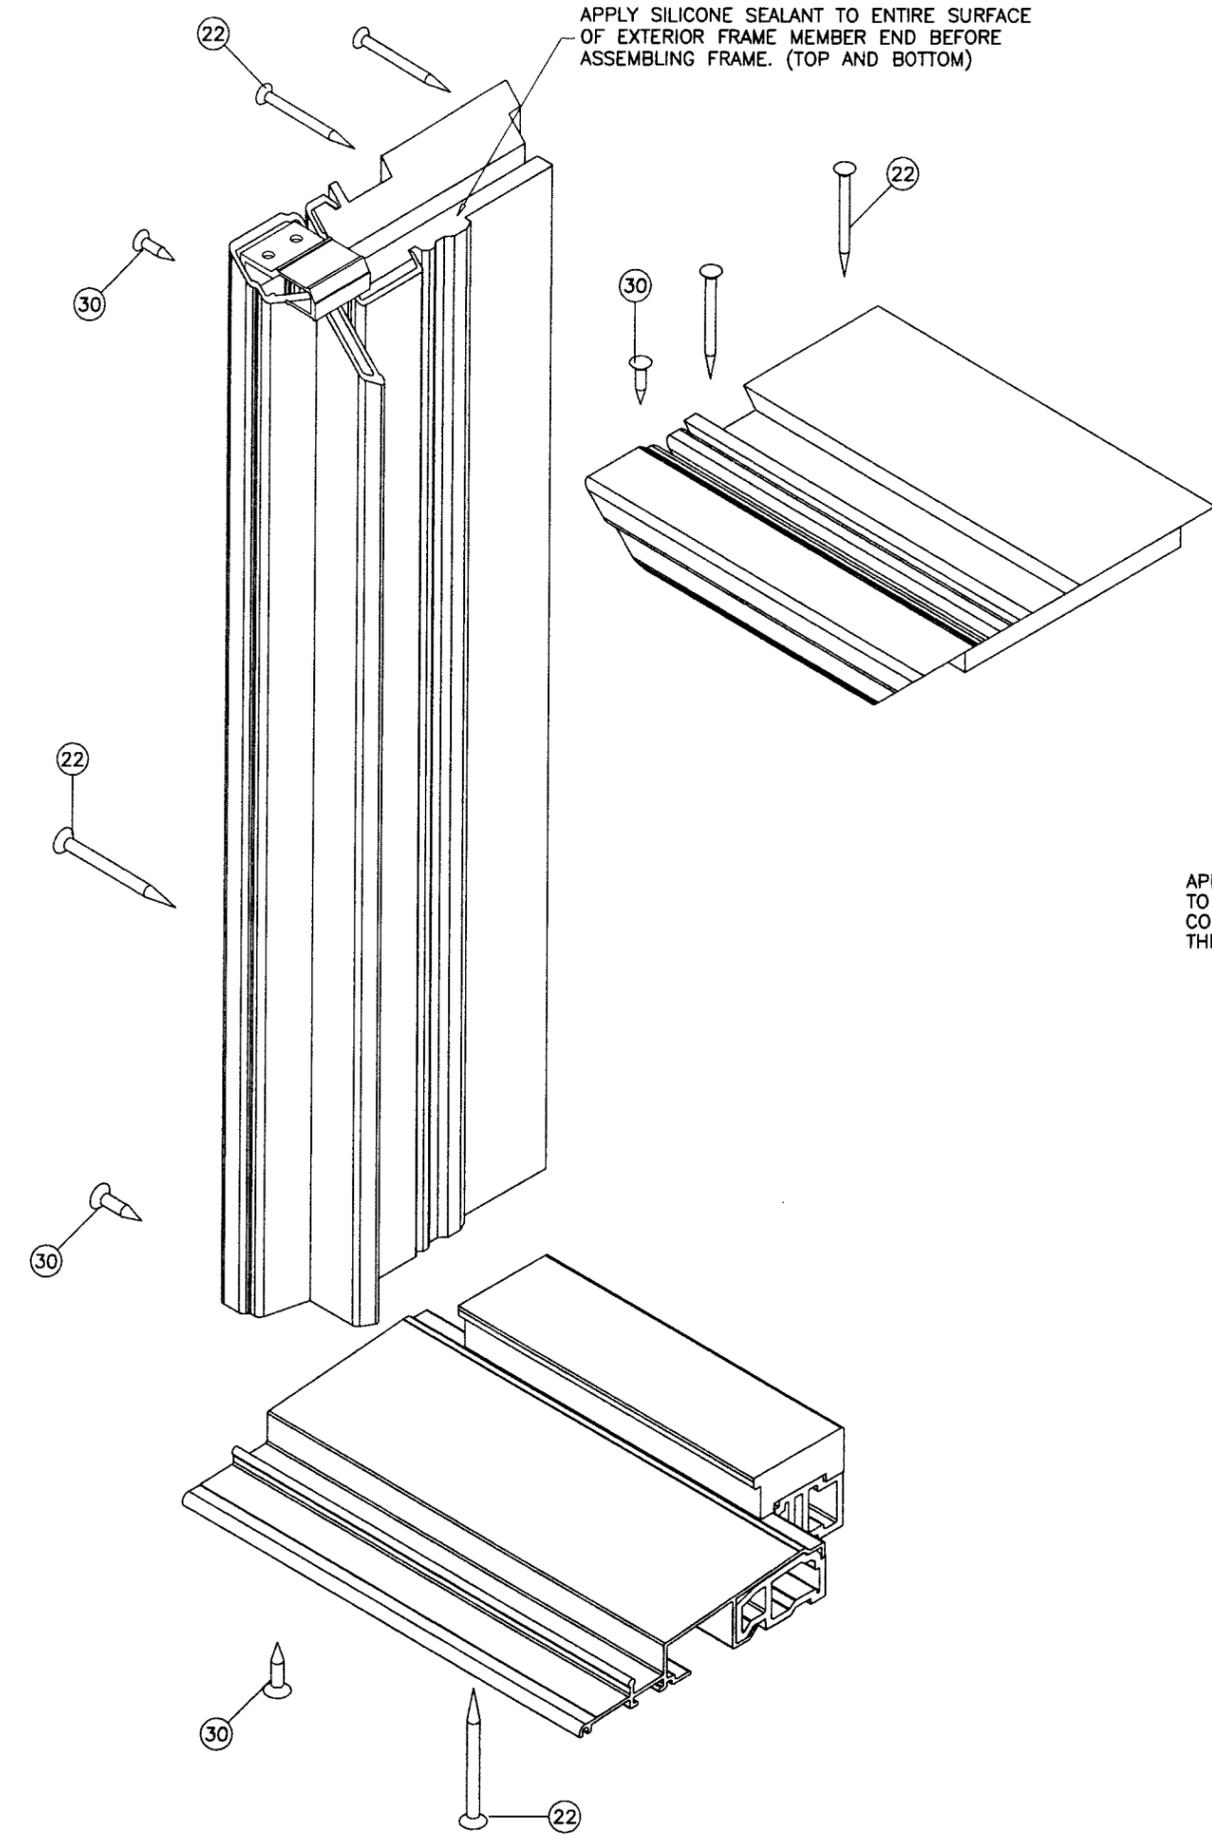

PANEL TOP CORNER

PANEL BOTTOM CORNER

FRAME CORNERS

Engr. DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

SEP 17 2008

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 08-0812.04
 Expiration Date SEP 17 2013
 By Ishaq I. Chaudhry
 Miami Dade Product Control
 Division