



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
 (305) 375-2901 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.maimidade.gov/buildingcode](http://www.maimidade.gov/buildingcode)

**Loren Cook Company**  
**P.O. Box 4047**  
**Springfield, MO 65808**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Model ASP Steel Roof Fan**

**APPROVAL DOCUMENT:** Drawing No. **SD080717-13**, titled "ASP-Supply Vent Sizes 90-200 Hurricane Rated", sheets 1 through 9 of 9, dated 07/17/08, prepared by Loren Cook Company, signed and sealed by John D. Winslow, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*[Signature]*  
 10/20/08

**NOA No. 08-0904.04**  
**Expiration Date: November 13, 2013**  
**Approval Date: November 13, 2008**  
 Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **SD080717-13**, titled "ASP-Supply Vent Sizes 90-200 Hurricane Rated", sheets 1 through 9 of 9, dated 07/17/08, prepared by Loren Cook Company, signed and sealed by John D. Winslow, P.E.

**B. TESTS**

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of Series/Model ASP, metal roof vent, prepared by Architectural Testing, Inc., Test Report No. **79143.01-801-18**, dated 03/03/08, signed and sealed by Jeffrey T. Kaminski, P.E.

**C. CALCULATIONS**

1. Wind Load and Anchor verification calculations, prepared by Tom Barrow Co., complying with FBC-2004, dated 07/18/08, signed and sealed by John D. Winslow, P.E.

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of conformance issued by Tom Barrow Co., dated 08/28/08, signed and sealed by John D. Winslow, P.E.
2. Statement letter of no financial interest issued by Tom Barrow Co., dated 08/28/08, signed and sealed by John D. Winslow, P.E.
3. Laboratory compliance letter issued by Architectural Testing, Inc., for Test Report No. **79143.01-801-18**, dated 03/04/08, signed and sealed by Jeffrey T. Kaminski, P.E.




Carlos M. Utrera, P.E.

Product Control Examiner

NOA No. 08-0904.04


Expiration Date: November 13, 2013

Approval Date: November 13, 2008

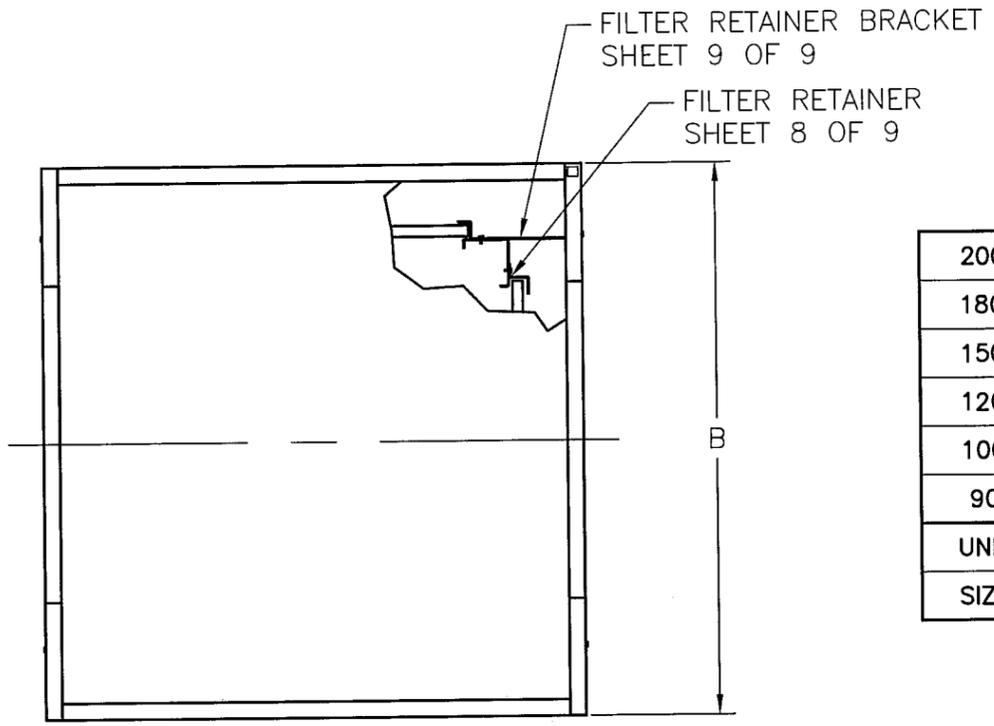


200	48-1/4	68	47-1/4	29	6
180	36-1/4	55-3/4	40-1/4	22-3/4	4
150	32-1/4	45-3/4	36-1/4	16-1/2	4
120	32-1/4	42-1/2	33-1/4	16-1/2	4
100	28-1/4	38-1/2	30	12-1/4	4
90	24-1/4	33-1/8	26-1/2	10-1/2	4
UNIT	DIM	DIM	DIM	DIM	DIM
SIZE	A	B	C	D	E

TOP VIEW

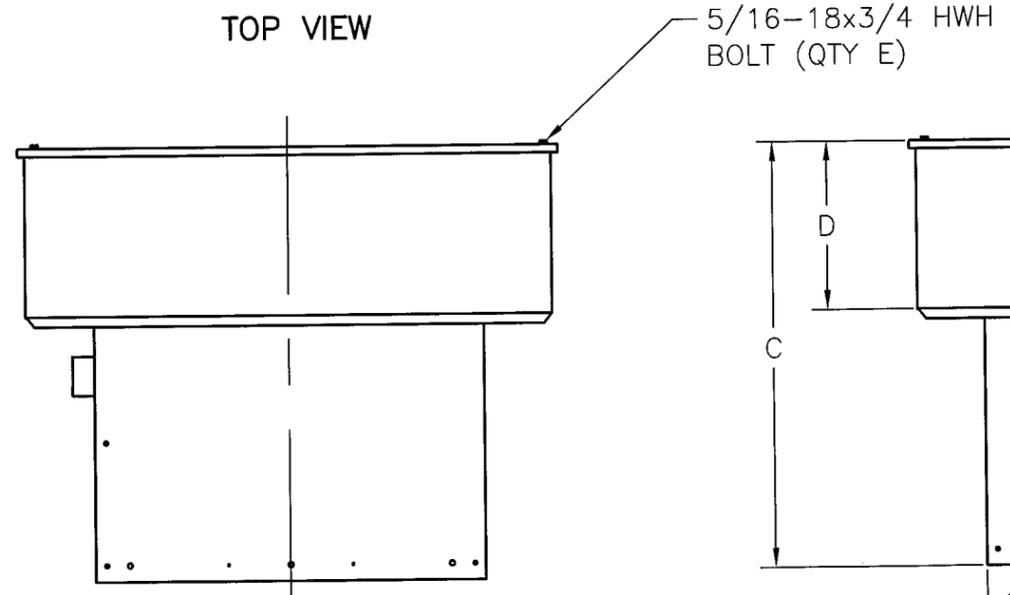

SIDE VIEW

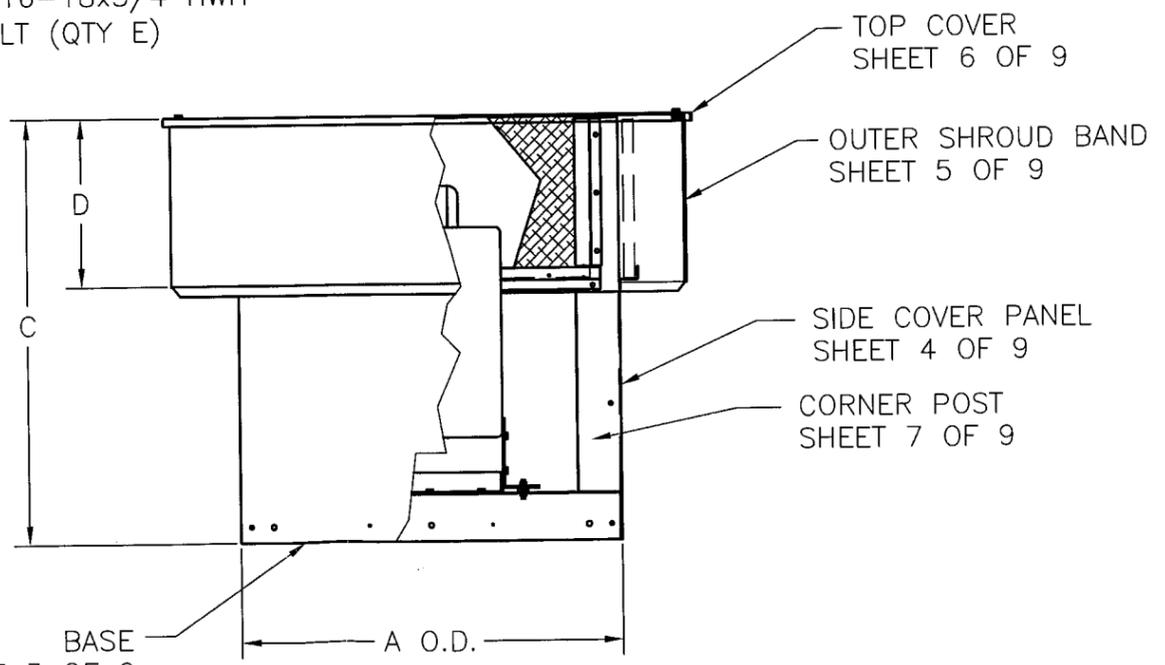

RIGHT SIDE VIEW


NOTES: DESIGN PRESSURE: +/- 70 PSF  
 IMPACT RATING: LARGE MISSILE IMPACT RESISTANT  
 ALL DIMENSIONS IN INCHES

*Handwritten signature and date: John D. Winslow, Aug 29 2008*


JOHN D. WINSLOW, P.E.  
 FL PE LIC. NO. 55841

Approved as complying with the  
 Florida Building Code  
 Date 11/13/2008  
 NDAS 08-0904.04  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

MAT'L -		 <b>LOREN COOK CO.</b> MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD 7/17/08	
DESIGNER	BFS SHEET 1 OF 9	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
<b>DECIMAL</b> .XX=±.063" .XXX=±.010" .XXXX=±.001"		<b>FRACTIONAL</b> ≤12"=±1/16" >12" THRU 96"=±1/8" >96" THRU 144"=±1/4" >144"=±3/8"
<b>ANGULAR</b> ±2'		(NC)=NO INSPECTION REQ'D
ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED		SIZE      DRAWING NO.      REV. B      SD080717-13      A

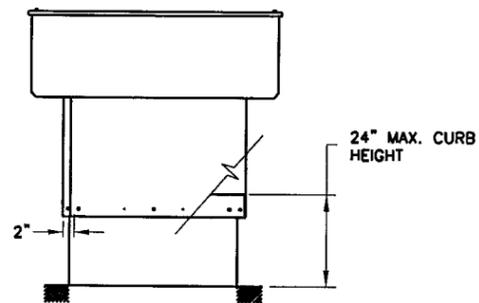

ATTACHMENT OF CURB TO ROOF STRUCTURE

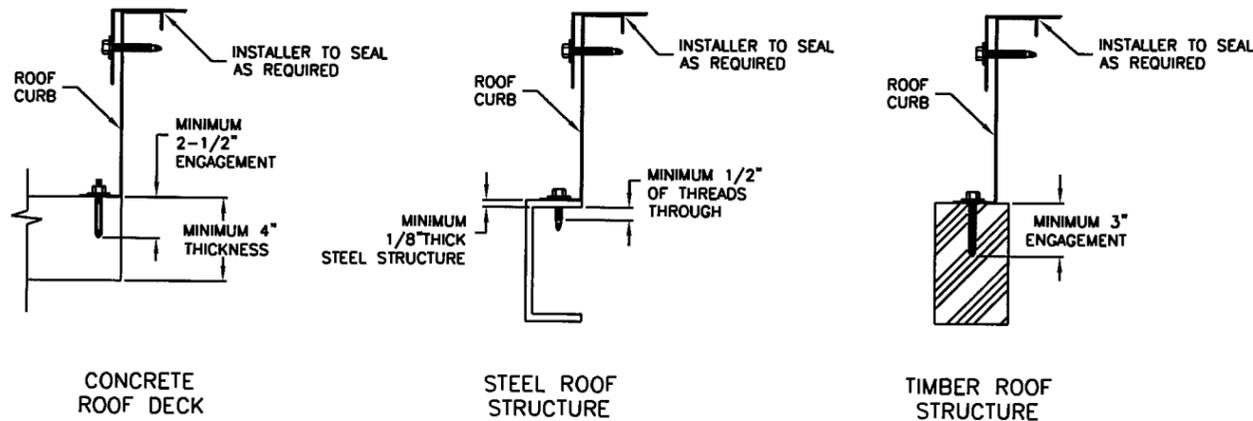

CONCRETE ROOF DECK

STEEL ROOF STRUCTURE

TIMBER ROOF STRUCTURE

FASTENER TABLE		
UNIT SIZE	MINIMUM NUMBER OF FASTENERS PER SIDE TO ATTACH UNIT TO CURB	MINIMUM NUMBER OF FASTENERS PER SIDE TO ATTACH CURB TO ROOF STRUCTURE
90	3	3
100	4	4
120	5	4
150	5	4
180	7	4
200	9	6

NOTES:

- 1) ASP POWER VENTILATOR AS REFERRED TO HEREIN REFERS TO ALL LOREN COOK MODEL ASP SUPPLY VENTILATORS INCLUDING BOTH DIRECT DRIVE AND BELT DRIVE TYPE UNITS WHICH ARE CONSTRUCTED USING THE SAME G-90 GALVANIZED STEEL OUTER HOUSING COMPONENTS.
- 2) THIS APPROVAL IS FOR THE STRUCTURAL CAPACITY OF THE EXTERIOR HOUSING ONLY, IT DOES NOT INCLUDE ANY INTERIOR MECHANISM OR ELECTRICAL PART.
- 3) THIS PRODUCT HAS NOT BEEN TESTED FOR WATER PENETRATION.
- 4) UNIT IS TO INCLUDE A CURB CAP BASE TO FACILITATE MOUNTING OF THE UNIT TO A CURB. THE CURB WILL BE ADEQUATELY ATTACHED TO THE BUILDING STRUCTURE TO SUSTAIN ALL FORCES WHICH MAY BE PRODUCED BY THE PRESCRIBED ENVIROMENTAL FORCES EXERTED ON THE FAN AND CURB. THE CURB MUST BE ATTACHED TO A STRUCTURAL MEMBER OF THE BUILDING.

CONCRETE DECK: CURB IS TO BE ATTACHED WITH WEDGE TYPE CONCRETE ANCHOR - MINIMUM 3/8" DIAMETER CARBON STEEL - HILTI KWIK BOLT 3 OR EQUAL. MINIMUM 2-1/2" OF ENGAGEMENT IN 2000 PSI MINIMUM CONCRETE. MINIMUM DECK THICKNESS IS 4" AND ANCHORS ARE MINIMUM 2" FROM EDGE. SEE TABLE FOR MINIMUM QUANTITY OF ANCHORS REQUIRED PER CURB SIDE.

STEEL ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH SELF-TAPPING STEEL SCREW OF MINIMUM NOMINAL SIZE OF 3/8" DIAMETER AND SCREW SHALL PASS THROUGH STEEL AT LEAST 1/2". THE SCREW MUST BE AT LEAST 2 SCREW DIAMETERS FROM MATERIAL EDGE. SEE TABLE FOR MINIMUM QUANTITY OF SCREWS REQUIRED PER CURB SIDE.

TIMBER ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH STEEL LAG BOLTS NOMINAL SIZE OF 3/8" DIAMETER OR LARGER. TIMBER IS TO BE 2" NOMINAL SIZE OR GREATER. THE BOLT SHALL HAVE A MINIMUM OF 3" OF THREAD ENGAGEMENT AND SHALL BE AT LEAST 1" FROM MATERIAL EDGE. SEE TABLE FOR MINIMUM QUANTITY OF BOLTS REQUIRED PER CURB SIDE.


- 5) THE CURB SHALL BE CONSTRUCTED OF 5052H-34 ALUMINUM OR G-90 GALVANIZED STEEL OR STAINLESS STEEL. THE CURB MATERIAL THICKNESS SHALL BE 18 GA (.0470") OR GREATER. THE CURB HEIGHT SHALL NOT EXCEED 24".
- 6) THE ASP POWER SUPPLY VENTILATOR SHALL BE ATTACHED TO THE CURB WITH ONE OF THE FOLLOWING METHODS INSTALLED ON ALL FOUR SIDES OF THE CURB CAP. THE FASTENERS SHALL BE 2" FROM EACH CORNER OF THE FAN BASE. THE QUANTITY OF FASTENERS INTO EACH CURB SIDE SHALL EQUAL OR EXCEED THE QUANTITY SHOWN IN THE FASTENER TABLE (AT LEFT).
  - A) #12 X 2" HEX WASHER HEAD SELF-DRILLING SCREW
  - B) ALTERNATE FASTENER - .25" HEX HEAD BOLT AND WASHER WITH COMPANION NUT INSTALLED ON THE INTERIOR OF THE CURB.
- 7) ALL FASTENERS ARE TO BE HIGH QUALITY CORROSION RESISTANT STEEL OR STAINLESS STEEL.
- 8) ANY GAP BETWEEN THE CURB AND CURB CAP SHALL BE FILLED BY THE INSTALLING CONTRACTOR WITH A SUITABLE CORROSION RESISTANT MATERIAL THAT ALLOWS THE FASTENERS TO BE INSTALLED WITHOUT CAUSING EXCESSIVE DISTORTION OF THE UNIT FLANGES.
- 9) THE INSTALLER IS RESPONSIBLE FOR CHECKING THAT ALL FASTENERS ARE PROPERLY INSTALLED AND ALL ACCESS PANELS ARE IN PLACE BEFORE PUTTING THE UNIT INTO SERVICE.
- 10) ALL FASTENERS AND ACCESS PANELS MUST BE PROPERLY INSTALLED AFTER MAINTENANCE OPERATIONS FOR UNIT TO MAINTAIN CODE COMPLIANCE.

Approved as complying with the Florida Building Code  
 Date 11/13/2008  
 NDAS 08-0909.04  
 Miami Dade Product Control Division  
 By *[Signature]*


*[Signature]*  
 AD 27, 2008

JOHN D. WINSLOW  
 FL PE LIC NO. 55841

MAT'L	-		 <b>LOREN COOK CO.</b> MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD	7/17/08	
DESIGNER	BFS	SHEET 2 OF 9	
DO NOT SCALE DRAWING			
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL		FRACTIONAL	
.XX=±.063"		≤12"=±1/16"	
.XXX=±.010"		>12" THRU 96"=±1/8"	
.XXX=±.001"		>96" THRU 144"=±1/4"	
ANGULAR		>144"=±3/8"	
±2'		(NC)=NO INSPECTION REQ'D	
ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED			REV.
SIZE	DRAWING NO.		REV.
B	SD080717-13		A

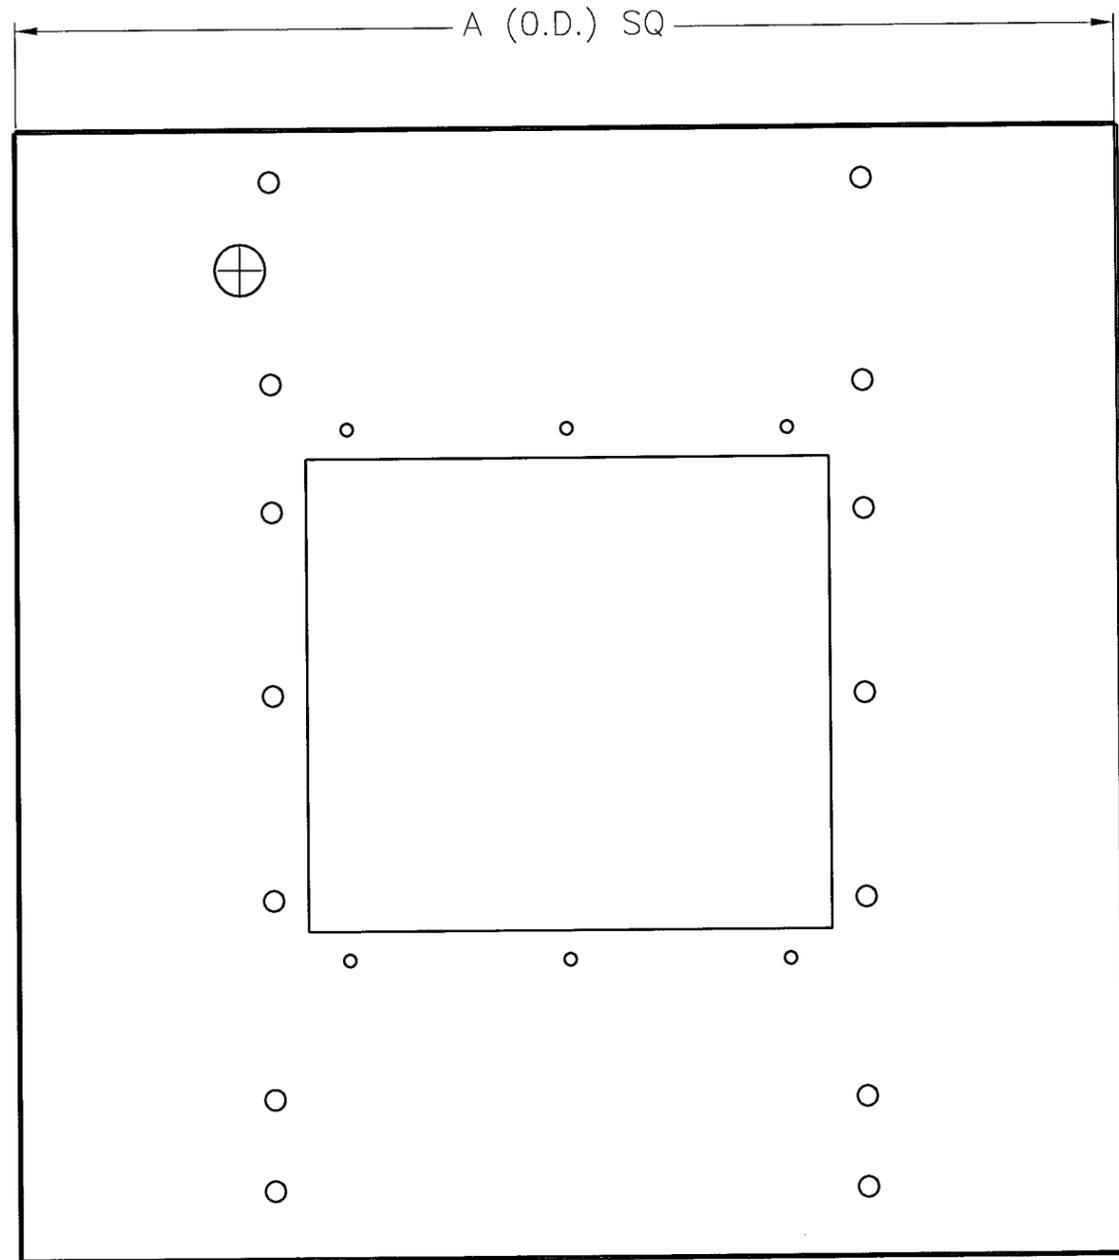

FORMED BOTTOM VIEW

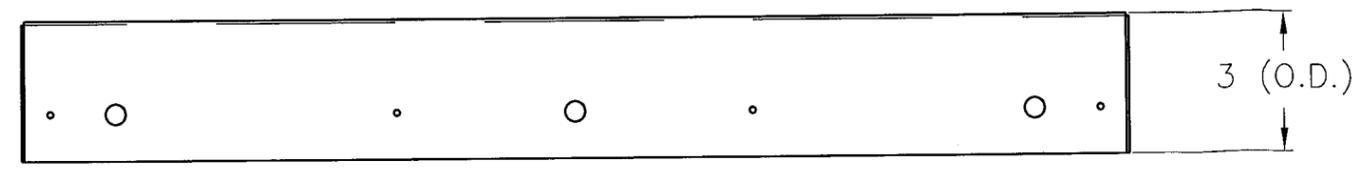

FORMED SIDE VIEW


200	48-1/4
180	36-1/4
150	32-1/4
120	32-1/4
100	28-1/4
90	24-1/4
UNIT	A
SIZE	DIM

Approved as complying with the  
 Florida Building Code  
 Date 11/13/2008  
 NOA# 08-07704-04  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

*[Handwritten Signature]*  
 Aug 29 2008

JOHN D. WINSLOW, P.E.  
 FL PE LIC. NO. 55841

MAT'L	16 GA G-90 GALV STEEL			LOREN COOK CO.	
DRAWN	JMD	7/17/08		MANUFACTURERS OF AIR MOVING EQUIPMENT	
DESIGNER	BFS	SHEET 3 OF 9		SPRINGFIELD, MISSOURI	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED					
DECIMAL		FRACTIONAL			
.XX=±.063"		≤12"=±1/16"			
.XXX=±.010"		>12" THRU 96"=±1/8"			
.XXXX=±.001"		>96" THRU 144"=±1/4"			
ANGULAR		>144"=±3/8"			
±2'		(NC)=NO INSPECTION REQ'D			
ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED			SIZE	DRAWING NO.	REV.
			B	SD080717-13	A

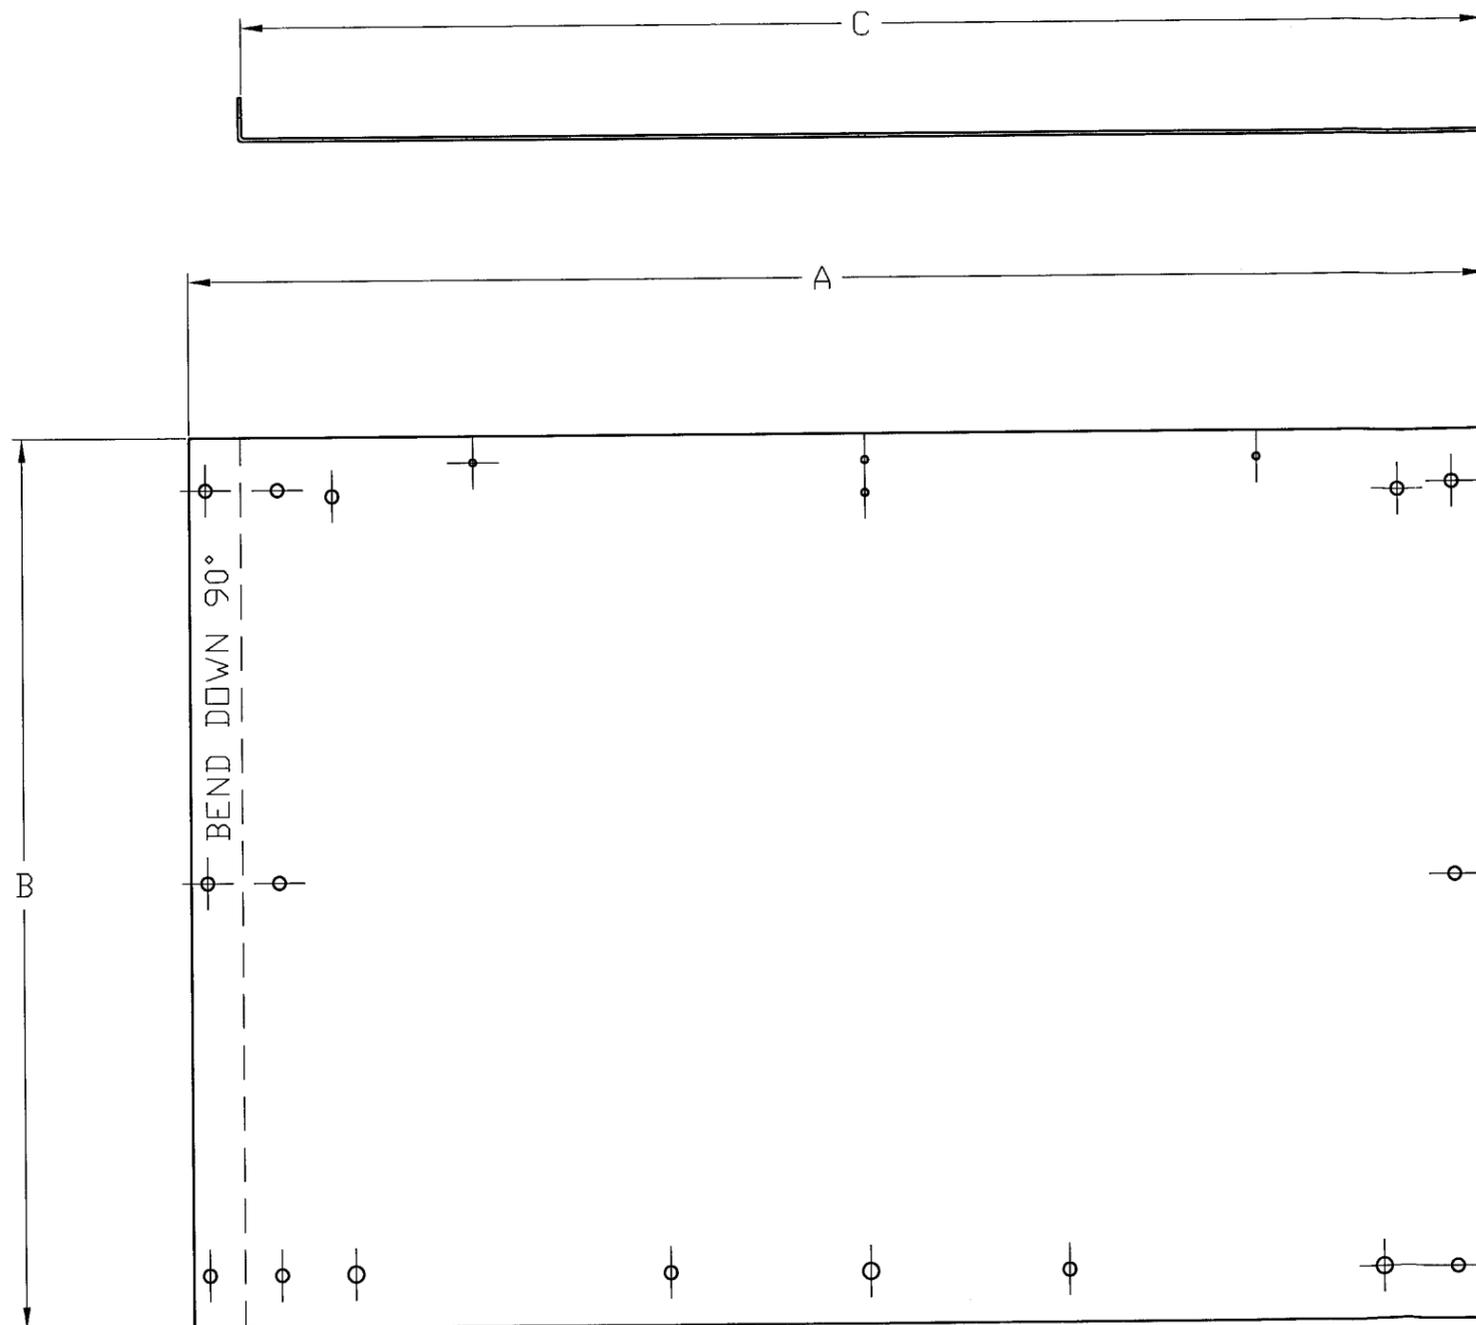

20	49-9/32	20-1/4	48-9/32
18	37-9/32	21	36-9/32
15	33-9/32	21	32-9/32
12	33-9/32	18	32-9/32
10	29-9/32	18-3/4	28-9/32
9	25-9/32	17	24-9/32
UNIT	A	B	C
SIZE	DIM	DIM	DIM


Approved as complying with the  
Florida Building Code  
Date 11/13/2008  
NOAH 02-6904.04  
Miami Dade Product Control  
Division  
By

SIZE 9 SHOWN

Aug 29, 2008

JOHN D. WINSLOW, P.E.  
FL PE LIC. NO. 55841

MAT'L	18 GA. G-90 GALV STEEL			LOREN COOK CO.	
DRAWN	JMD	7/17/08		MANUFACTURERS OF AIR MOVING EQUIPMENT	
DESIGNER	BFS	SHEET 4 OF 9		SPRINGFIELD, MISSOURI	
DO NOT SCALE DRAWING					
TOLERANCES UNLESS OTHERWISE NOTED					
DECIMAL	FRACTIONAL		ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED		
.XX=±.063"	≤12"=±1/16"				
.XXX=±.010"	>12" THRU 96"=±1/8"		SIZE	DRAWING NO.	REV.
.XXXX=±.001"	>96" THRU 144"=±1/4"		B	SD080717-13	A
ANGULAR	>144"=±3/8"				
±2'	(NC)=NO INSPECTION REQ'D				

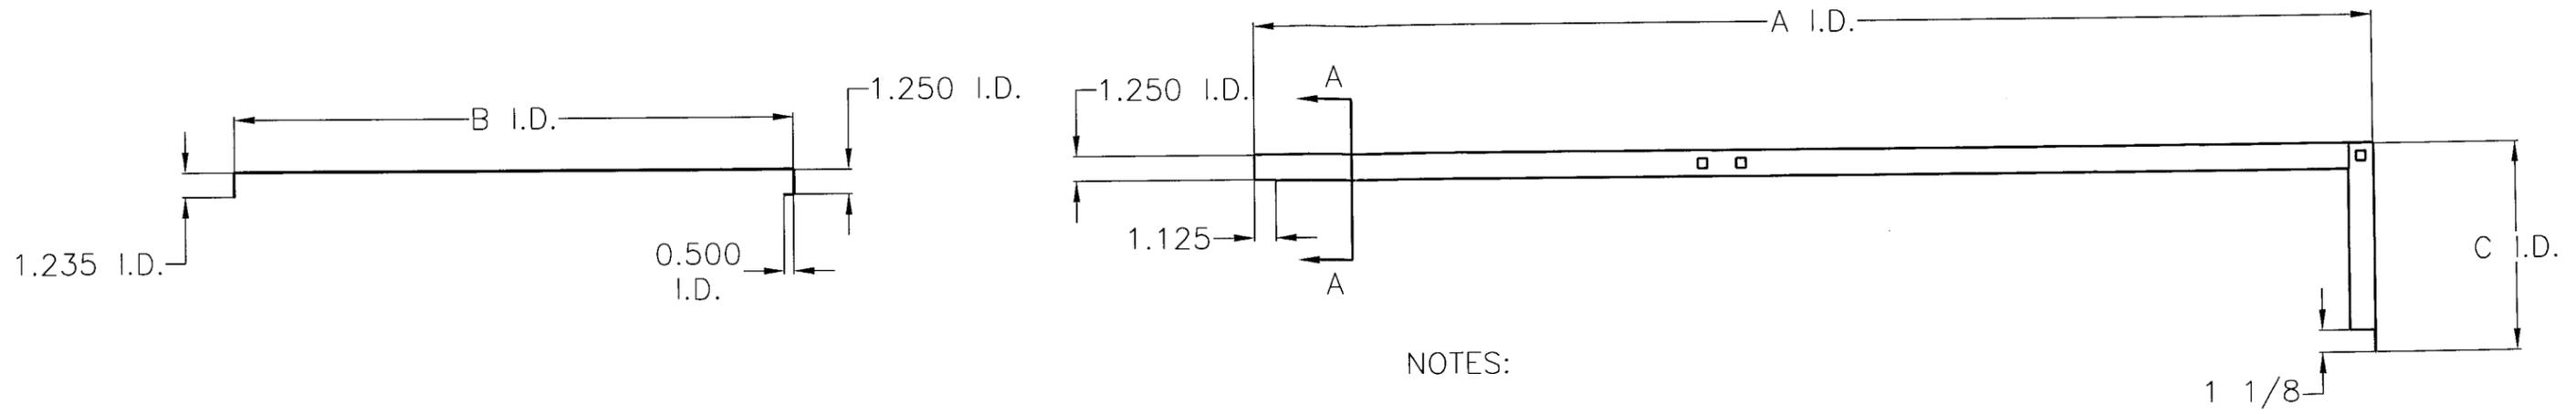

SECTION VIEW A-A

NOTES:

1 UNIT SIZE ASP-20 SHOWN


200	58-1/8	29	10-5/8
180	46-1/8	22-3/4	10-1/2
150	39-1/8	16-1/2	7-1/2
120	37	16-1/2	6-3/8
100	33	12-1/4	6-3/8
90	28-5/16	10-1/2	5-11/16
UNIT	A	B	C
SIZE	DIM	DIM	DIM

Approved as complying with the  
Florida Building Code  
Date 11/13/2008  
NOA# 08-1704-04  
Missouri State Product Control  
Division  
By *[Signature]*

*John D. Winslow*  
Aug 27, 2008


JOHN D. WINSLOW, P.E.  
FL PE LIC. NO. 55841

MAT'L	18 GA. G-90 GALV. STEEL		 <b>LOREN COOK CO.</b> <small>MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI</small>
DRAWN	JMD	7/17/08	
DESIGNER	BFS	SHEET 5 OF 9	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED			
<b>DECIMAL</b> .XX=±.063" .XXX=±.010" .XXXX=±.001"		<b>FRACTIONAL</b> ≤12"=±1/16" >12" THRU 96"=±1/8" >96" THRU 144"=±1/4" >144"=±3/8"	
<b>ANGULAR</b> ±2°		(NC)=NO INSPECTION REQ'D	
ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED			
SIZE	DRAWING NO.		REV.
B	SD080717-13		A

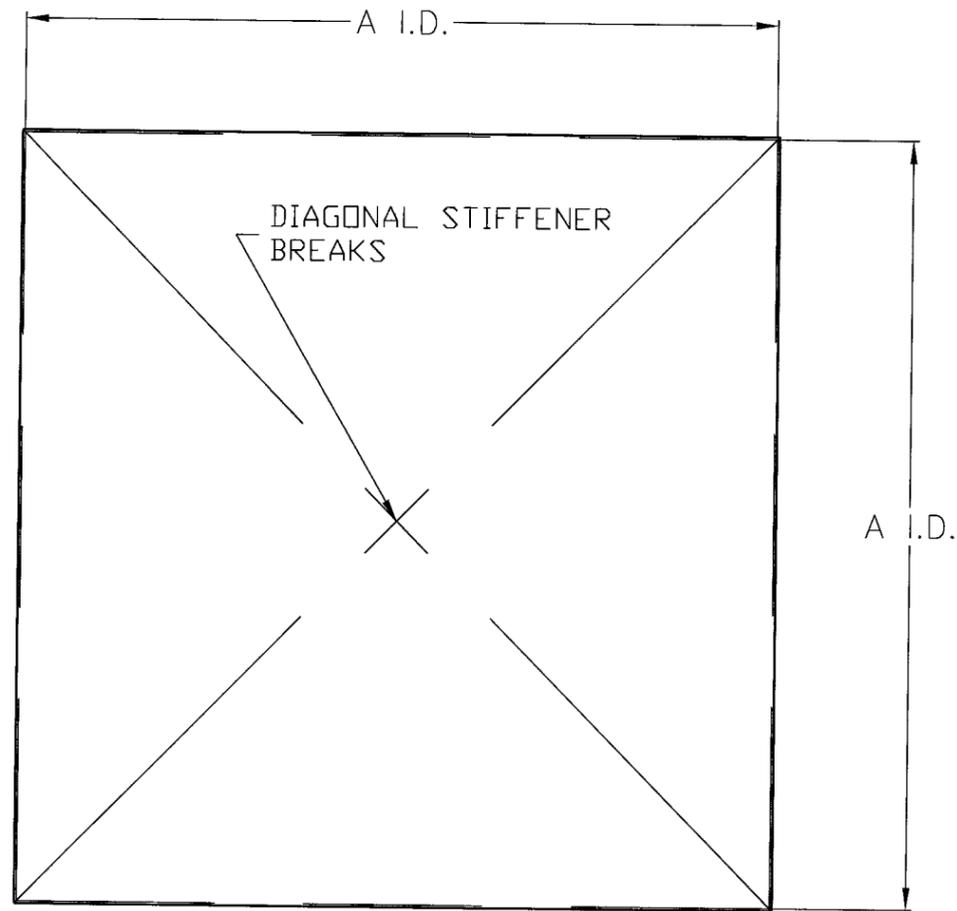

1 PIECE SIZE 90-180

200	49-3/16
180	37-3/16
120	33
100	29
90	25
UNIT	A
SIZE	DIM

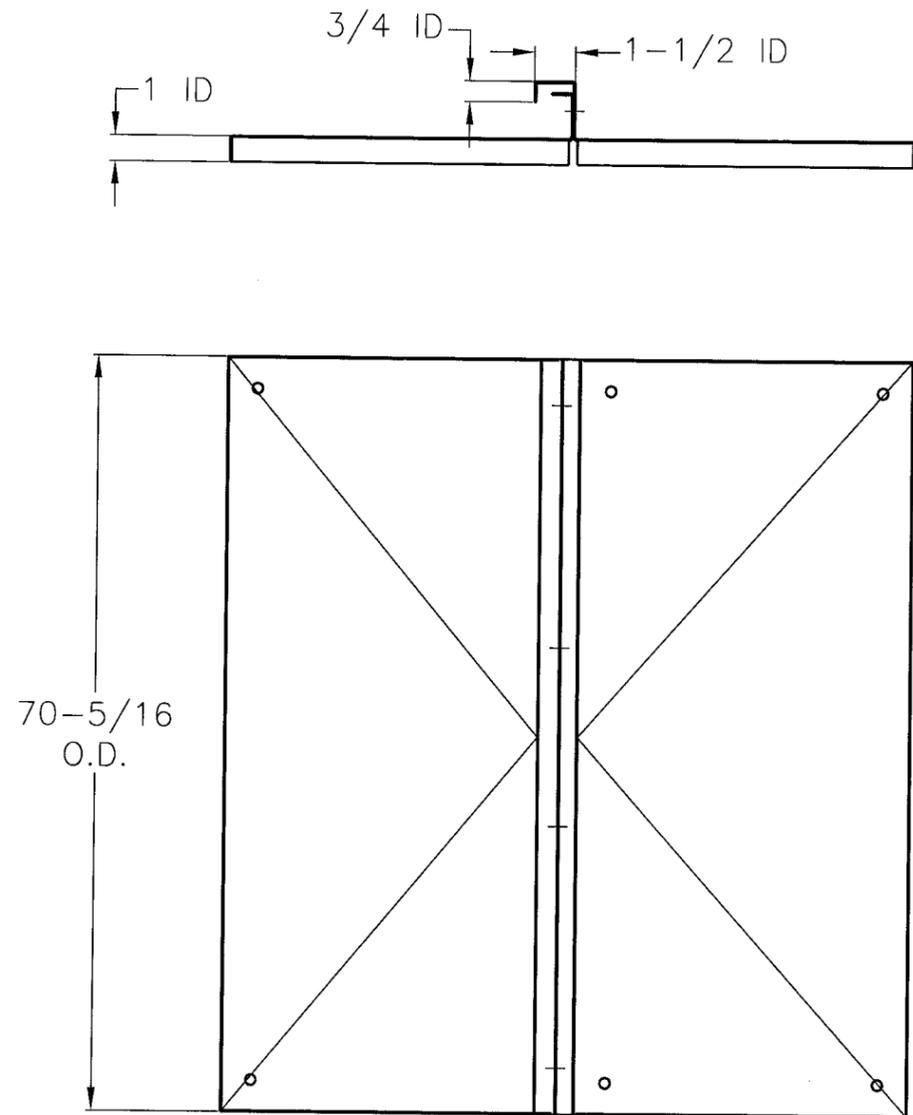





2 PIECE SIZE 200

Approved as complying with the  
 Florida Building Code  
 Date 11/13/2008  
 NOA# 08-0924.04  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

*[Signature]*  
 May 29, 2008

JOHN D. WINSLOW, P.E.  
 FL PE LIC. NO. 55841

MAT'L	18 GA. G-90 GALV STL		 <b>LOREN COOK CO.</b> MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD	7/17/08	
DESIGNER	BFS	SHEET 6 OF 9	
DO NOT SCALE DRAWING			
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL	FRACTIONAL		ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED
.XX=±.063" .XXX=±.010" .XXXX=±.001"	≤12"=±1/16" >12" THRU 96"=±1/8" >96" THRU 144"=±1/4" >144"=±3/8"		
ANGULAR	±2'		(NC)=NO INSPECTION REQ'D
SIZE	DRAWING NO.		REV.
B	SD080717-13		A

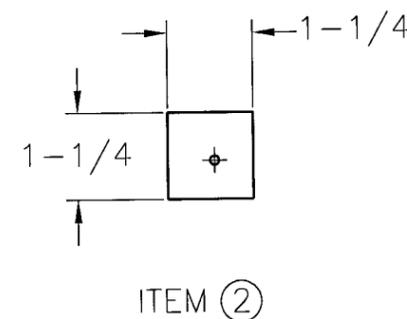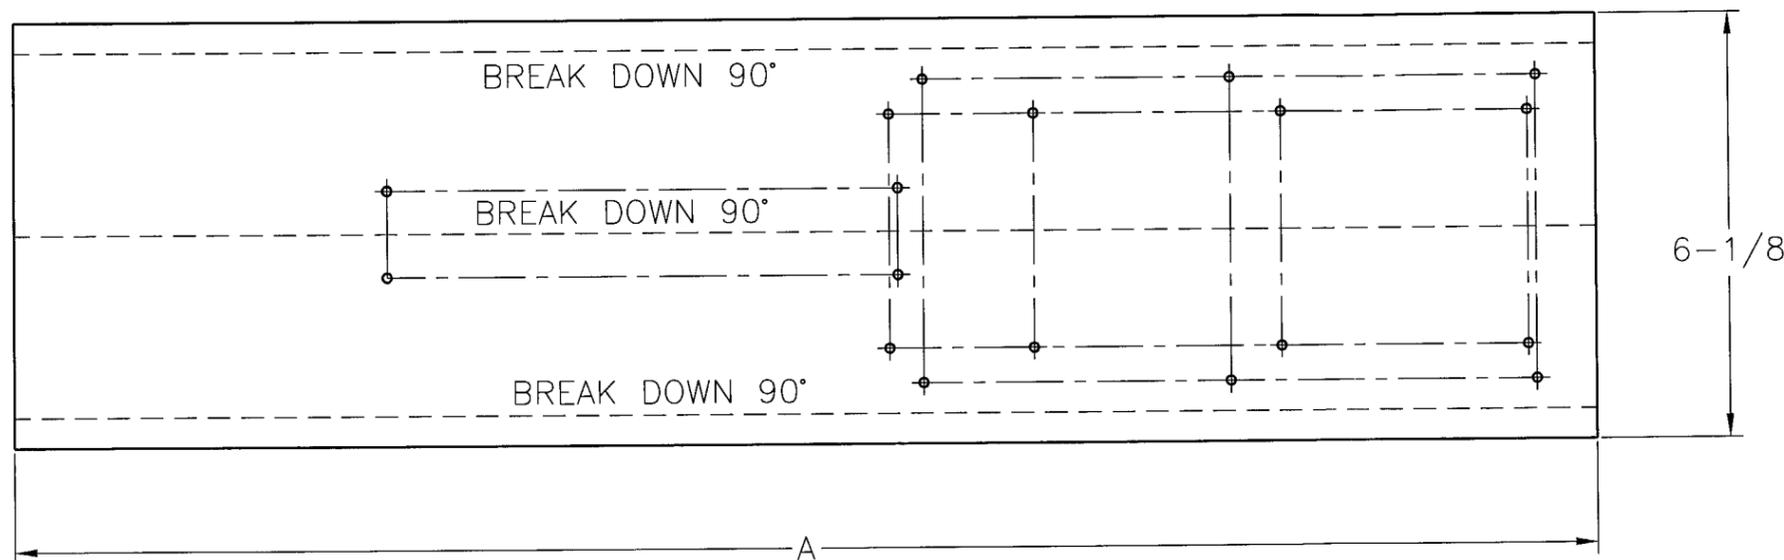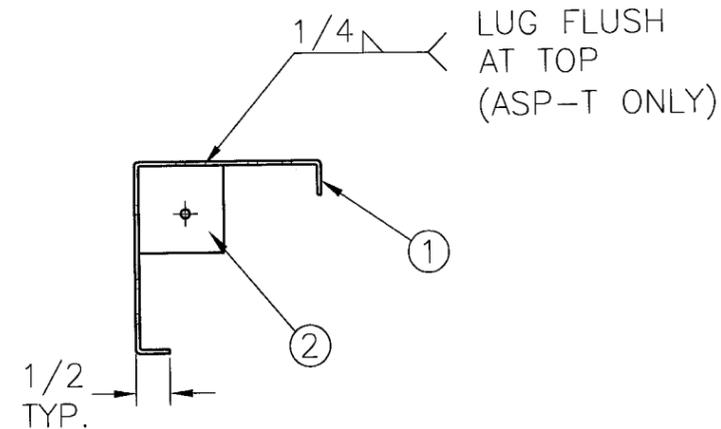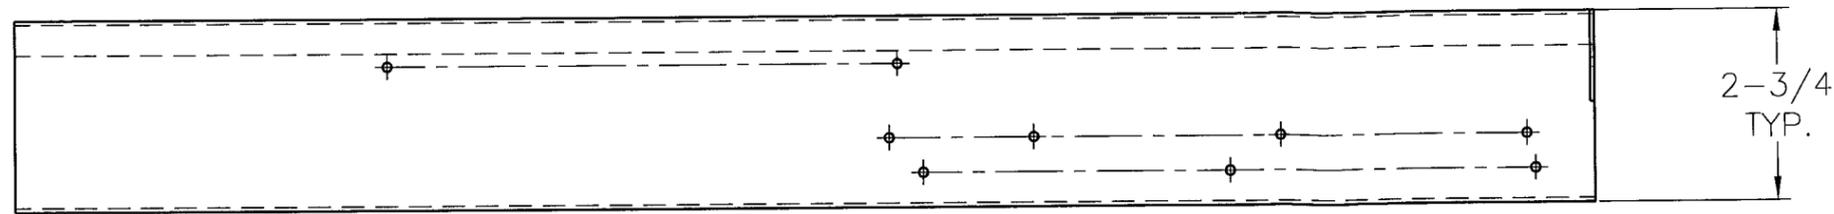

ITEM ①

200	56-3/4
180	45-3/4
150	36-1/2
120	34
100	27-3/4
90	24-1/4
UNIT	A
SIZE	DIM


NOTES:  
1. UNIT SIZE 9 SHOWN.

Approved as complying with the  
Florida Building Code  
Date 11/13/2008  
MOA# 19-0504.04  
Missouri State Product Control  
Division  
By *[Signature]*



*John D. Winslow*  
Aug 29 2008

JOHN D. WINSLOW, P.E.  
FL PE LIC. NO. 55841

MAT'L	16 GA. G-90 GALV STL		 <b>LOREN COOK CO.</b> MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD	7/17/08	
DESIGNER	BFS	SHEET 7 OF 9	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL		FRACTIONAL	
.XX=±.063"		≤12"=±1/16"	
.XXX=±.010"		>12" THRU 96"=±1/8"	
.XXXX=±.001"		>96" THRU 144"=±1/4"	
ANGULAR		>144"=±3/8"	
±2'		(NC)=NO INSPECTION REQ'D	
SIZE	DRAWING NO.		REV.
B	SD080717-13		A

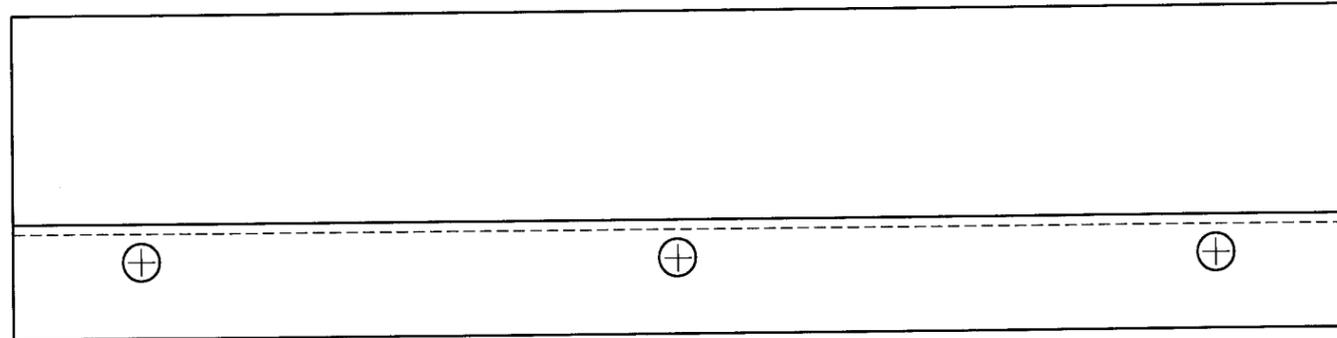

SIZE 9 SHOWN

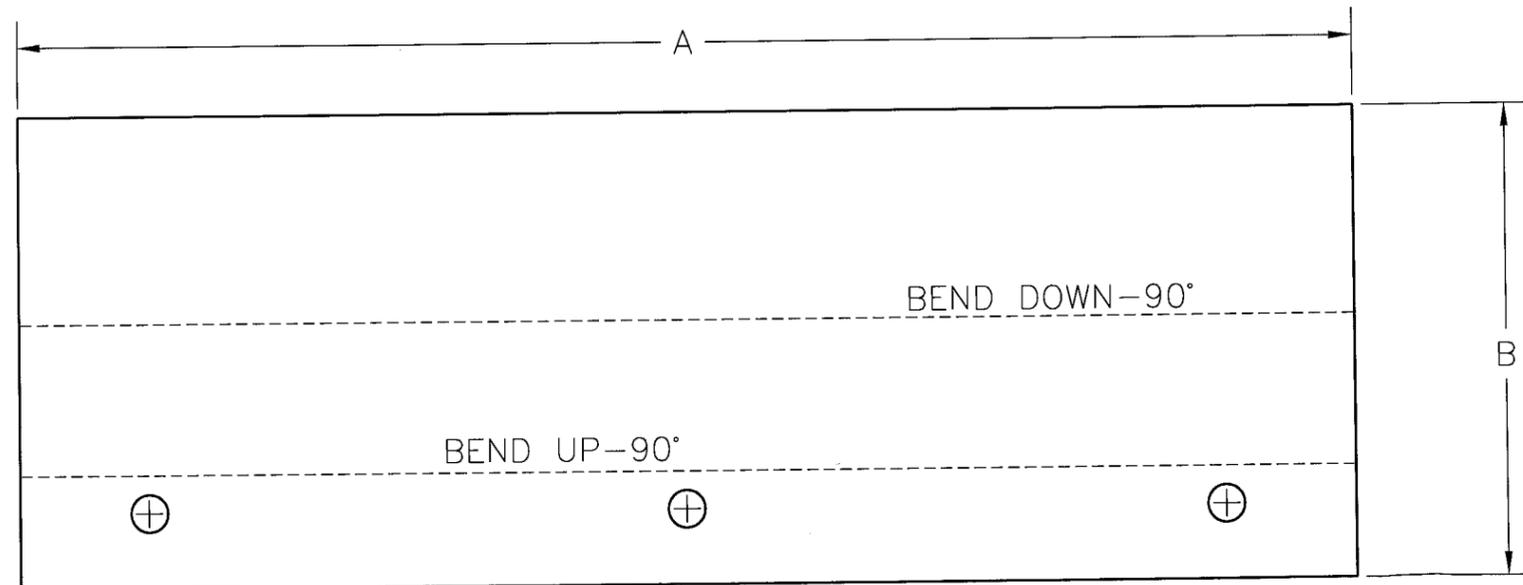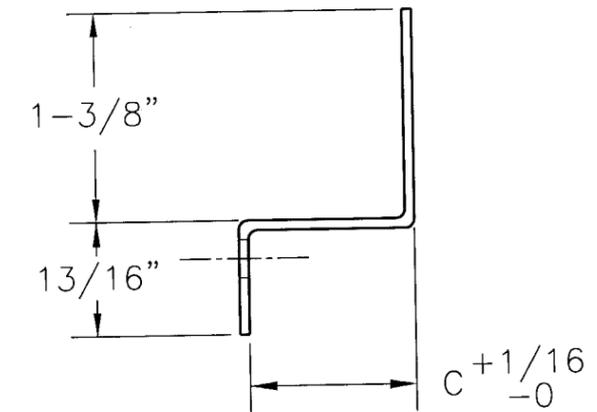



200	26-1/2	3-5/32	1-1/32	4-5/32	2-1/32
180	18-3/4	3-5/32	1-1/32	4-5/32	2-1/32
120	14-3/4	3-5/32	1-1/32	4-5/32	2-1/32
100	10-3/4	3-5/32	1-1/32	4-5/32	2-1/32
90	9	3-5/32	1-1/32	4-5/32	2-1/32
SIZE	DIM	B	C	B	C
UNIT	A	1" FILTER		2" FILTER	

Approved as complying with the Florida Building Code  
 Date 11/13/2008  
 NCAD 08-10909.04  
 Miami Dade Product Control  
 Division  
 By

Aug 27 2008

JOHN D. WINSLOW, P.E.  
 FL PE LIC. NO. 55841

MAT'L	18 GA. G-90 GALV. STL		 <b>LOREN COOK CO.</b> MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD	7/17/08	
DESIGNER	BFS	SHEET 8 OF 9	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL		FRACTIONAL	
.XX=±.063"		≤12"=±1/16"	
.XXX=±.010"		>12" THRU 96"=±1/8"	
.XXXX=±.001"		>96" THRU 144"=±1/4"	
ANGULAR		>144"=±3/8"	
±2'		(NC)=NO INSPECTION REQ'D	
ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED			REV.
SIZE	DRAWING NO.		
B	SD080717-13		A

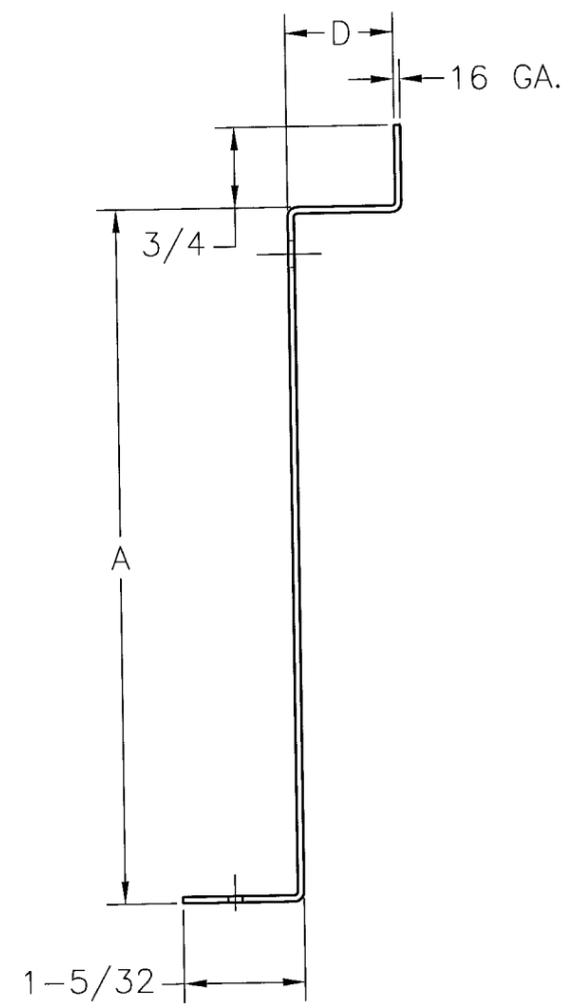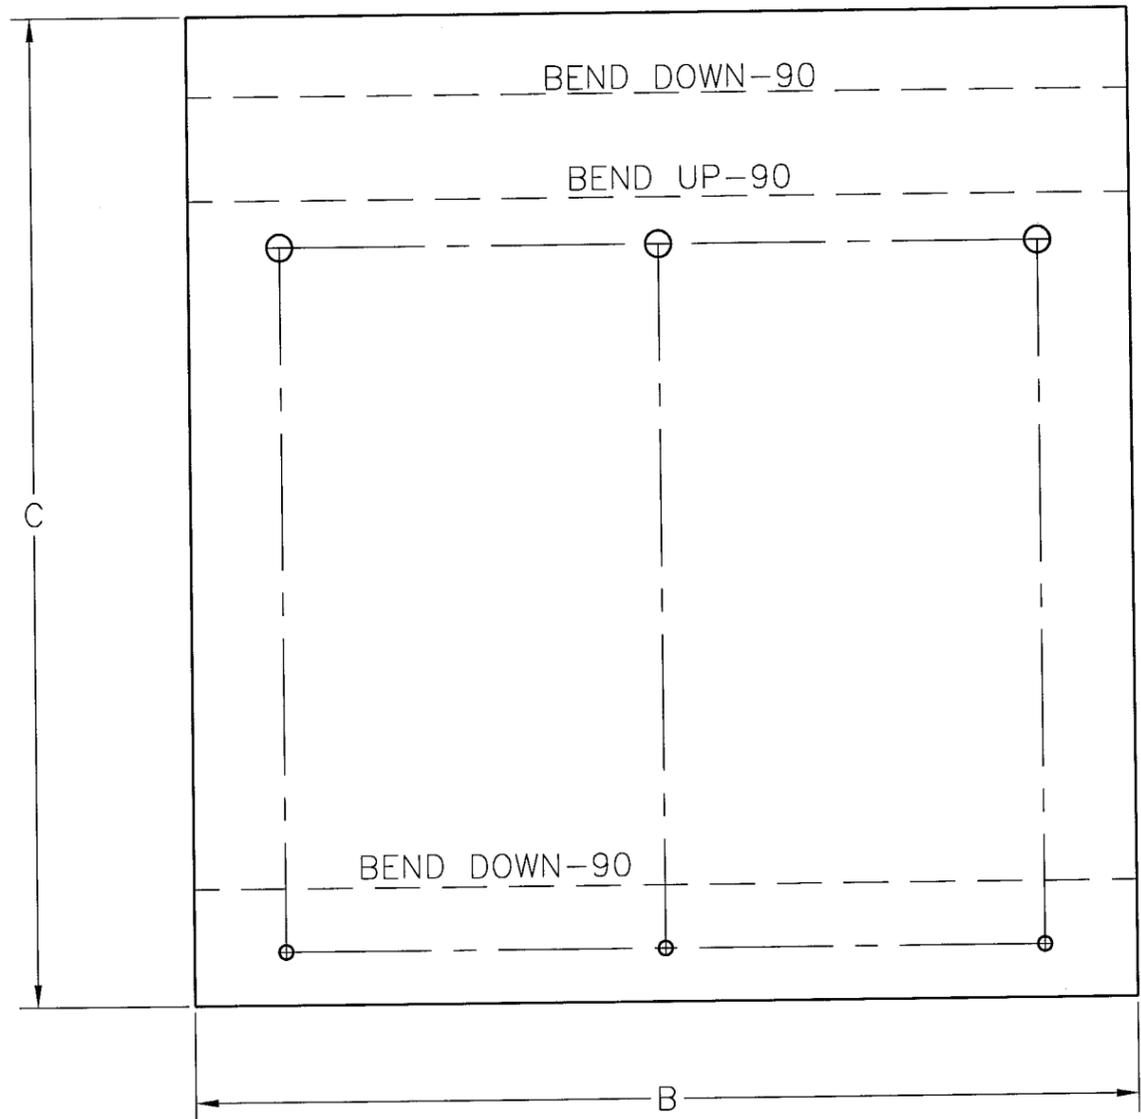

SIZE 9 SHOWN

200	11.94	26-1/2	14-5/8	15-5/8	1.03	2.03
180	11.81	18-3/4	14-1/2	15-1/2	1.03	2.03
150	8.81	14-3/4	11-1/2	12-1/2	1.03	2.03
120	7.19	14-3/4	9-7/8	10-7/8	1.03	2.03
100	7.19	10-3/4	9-7/8	10-7/8	1.03	2.03
90	6.50	9	9-3/16	10-3/16	1.03	2.03
UNIT	A	B	C	C	D	D
SIZE	DIM	DIM	1"FILTER	2"FILTER	1"FILTER	2"FILTER

Approved as complying with the Florida Building Code  
 Date: 11/13/2008  
 NOA# 02-090404  
 Miami Dade Product Control Division  
 By: *[Signature]*

*[Handwritten Signature]*  
 Aug 29, 2008

JOHN D. WINSLOW, P.E.  
 FL PE LIC. NO. 55841

MAT'L	16 GA. G-90 GALV.		 <b>LOREN COOK CO.</b> MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI		
DRAWN	JMD	7/17/08			
DESIGNER	BFS	SHEET 9 OF 9			
DO NOT SCALE DRAWING			ASP-SUPPLY VENT SIZES 90-200 HURRICANE RATED		
TOLERANCES UNLESS OTHERWISE NOTED					
DECIMAL	FRACTIONAL		SIZE	DRAWING NO.	REV.
.XX=±.063"	≤12"=±1/16"		B	SD080717-13	A
.XXX=±.010"	>12" THRU 96"=±1/8"				
.XXXX=±.001"	>96" THRU 144"=±1/4"				
ANGULAR	>144"=±3/8"				
±2'	(NC)=NO INSPECTION REQ'D				