



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

Stone Panels, Inc.  
100 S. Royal Lane  
Coppell, TX 75019

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Ultra-Lite Stone Panels.**

**APPROVAL DOCUMENT:** Drawing No. 1 of 1, titled "Ultra-Lite Stone Panels Used For Curtain Walls", prepared by Stone Panels, Inc, signed and sealed by Robert E. Williams Jr, P.E., dated 12/06/02, bearing the Miami-Dade County Product Control renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 07-1018.03, and consists of this page 1, evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*Signature*  
9/11/08

NOA No 08-0625.03  
Expiration Date: January 9, 2012  
Approval Date: September 4, 2008  
Page 1

**Stone Panels, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawings No. 1 of 1, titled "Ultra-Lite Stone Panels Used For Curtain Walls", prepared by Stone Panels, Inc, signed and sealed by Robert E. Williams Jr., P.E. *(Evidence Submitted under NOA # 02-1104.11)*

**B. TESTS**

	<u>Test Report</u>	<u>Test Name</u>	<u>Date</u>	<u>Signature</u>
1.	SWRI 01-7520-248	ASTM E84	05/21/96	W. Orrison, P.E.
2.	SWRI 01-7520-249	ASTM D1929	06/05/96	W. Orrison, P.E.
3.	SWRI 01-7520-250	ASTM D635	05/20/96	W. Orrison, P.E.

*(Evidence Submitted under NOA # 02-1104.11)*

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of Stonelite Stone Panels, prepared by Hurricane Test Laboratory, LLC. Test Report No. **T053-0401-08**, dated 04/22/08, signed and sealed by Vinu J. Abraham, P.E.

**C. CALCULATIONS**

1. Fasteners calculations sheet 1 of 1, prepared by Matsen Ford Design, dated 01/09/96. *(Evidence Submitted under NOA # 02-1104.11)*

**D. MATERIAL CERTIFICATIONS**


1. None

**E. QUALITY ASSURANCE**


1. Miami Dade Building Code Compliance Office (BCCO).

**F. STATEMENTS**

1. Code compliance letter issued by Matsen Ford Design, on 01/23/96, signed and sealed by J.P. Matsen, P.E. *(Evidence Submitted under NOA # 02-1104.11)*
2. Letter stating that product has not been affected by the FBC changes, issued by TDI Associates, Inc., dated 10/12/07, signed and sealed by Robert E. Williams, Jr., P.E. *(Evidence Submitted under NOA # 07-1018.03)*
3. No change since tested letter issued by Stone Panels, Inc., dated 06/18/08, signed by Caesar Hage.
4. Code compliance letter issued by Hurricane Test Laboratory, LLC. dated 04/22/08, signed and sealed by Vinu J. Abraham, P.E.


  
\_\_\_\_\_  
Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No 08-0625.03

Expiration Date: January 9, 2012  
Approval Date: September 4, 2008

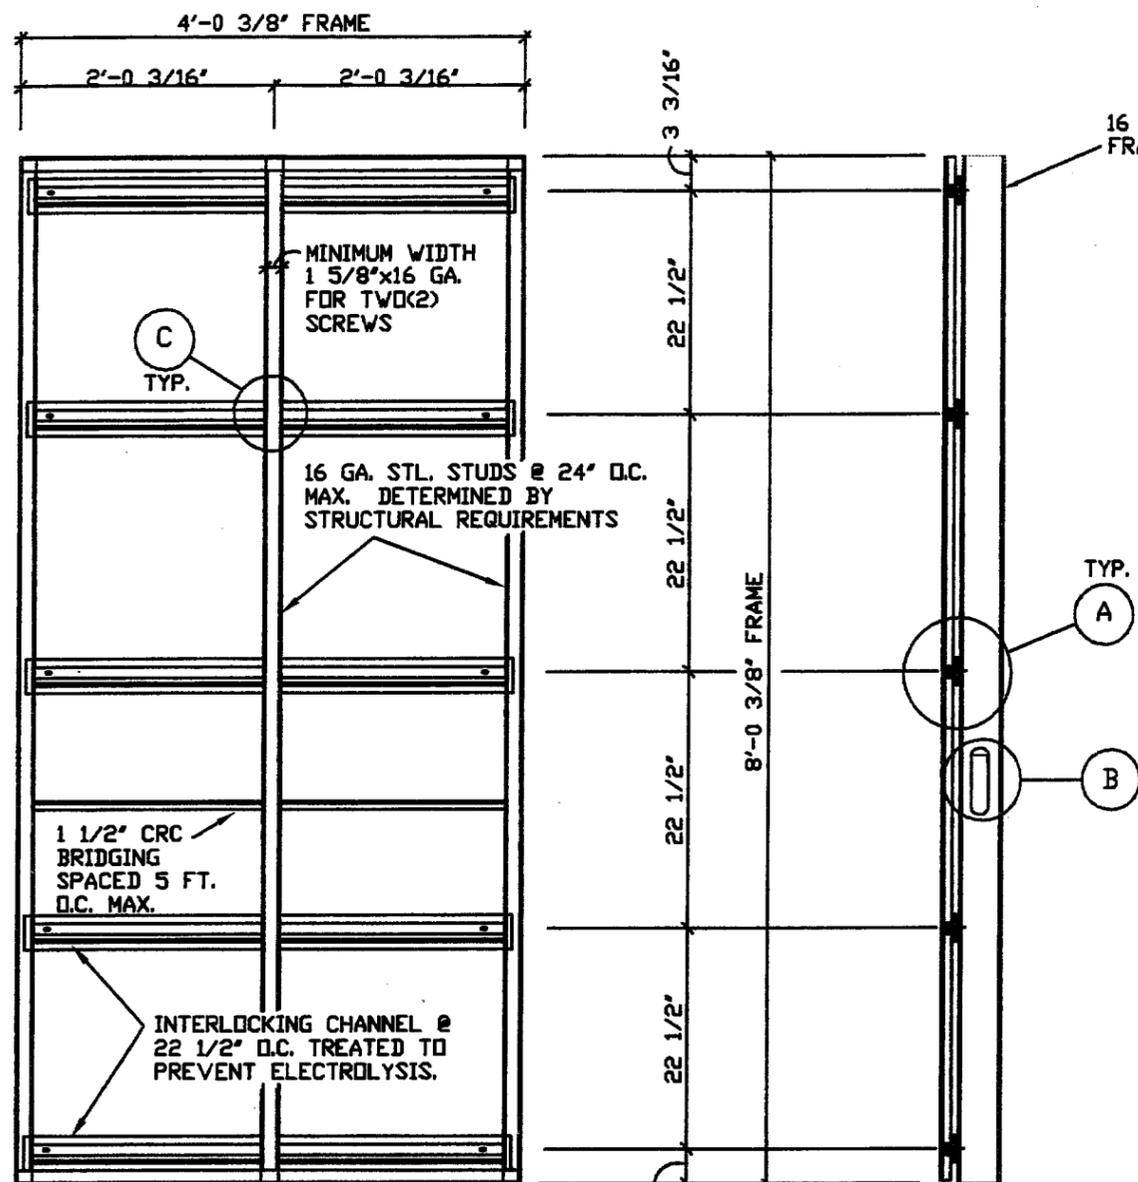


REAR ELEVATION

SECTION

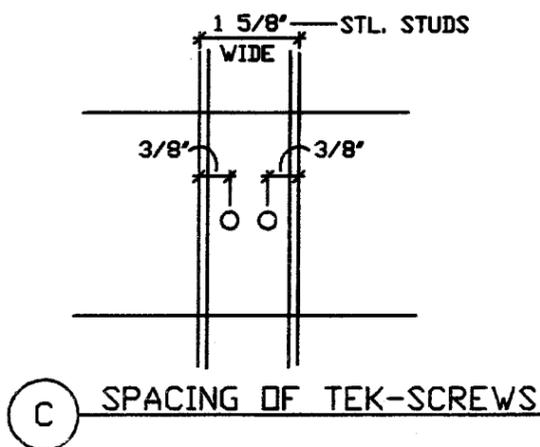


C SPACING OF TEK-SCREWS

Approved as complying with the Florida Building Code  
 Date 01/09/03  
 NOAR 02-1104.11  
 Miami Dade Product Control  
 Division

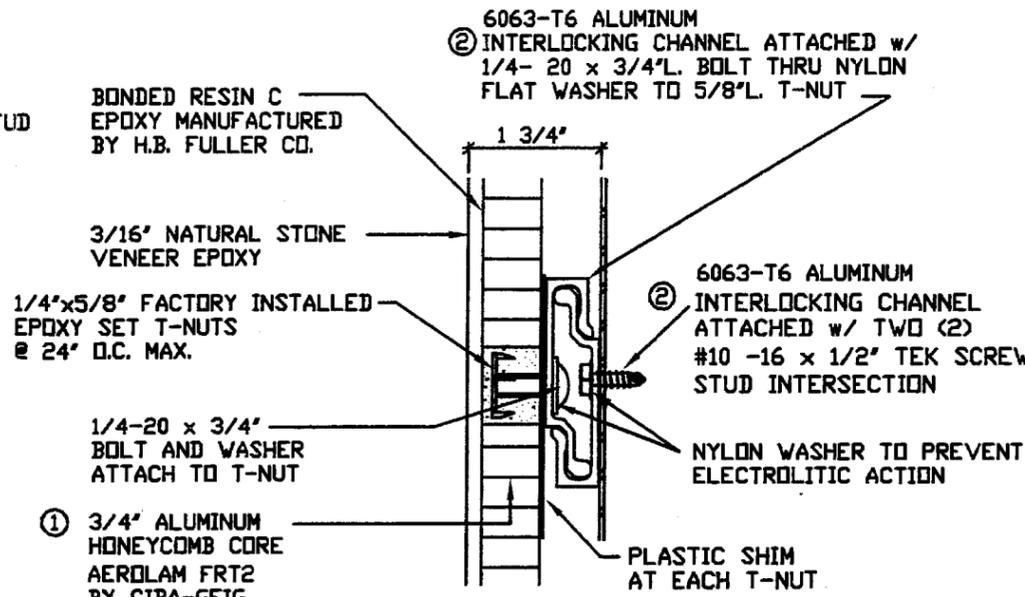

A INTERLOCKING CHANNEL DETAIL

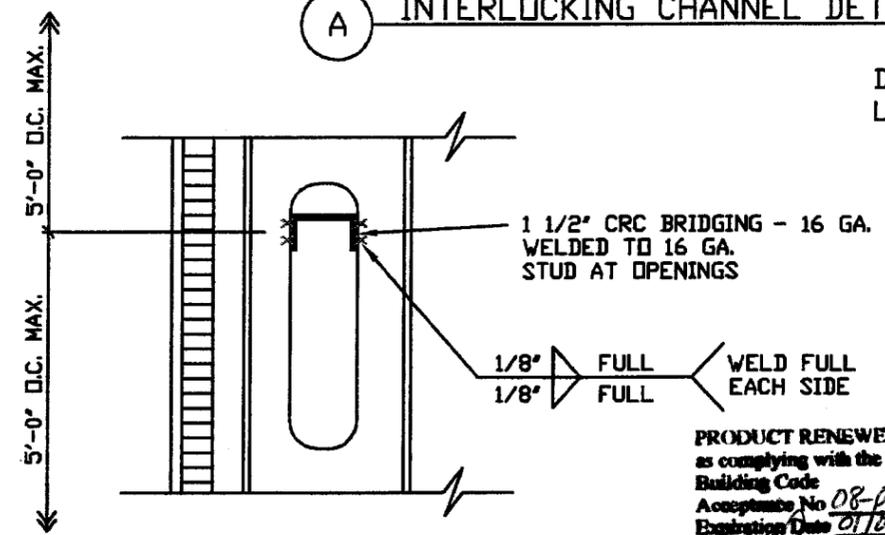

B CRC BRIDGING DETAIL

PRODUCT RENEWED as complying with the Florida Building Code  
 Acceptance No 08-0625.03  
 Expiration Date 01/09/2012  
 By Robert E. Williams  
 Miami Dade Product Control Division

- COMPONENTS
- ① HONEYCOMB CORE WITH FIBERGLASS MAT ON BOTH SIDES. FIBERGLASS STYLE 7642-S0 BY BURLINGTON GLASS CO.
  - ② 6063-T6 ALUMINUM-INTERLOCKING CHANNEL PART NO. 4970 BY INT. EXTRUSION CORPORATION

07-1018.03  
 01/09/2009  
*Robert E. Williams*

DESIGN PRESSURE RATING ± 90 PSF  
 LARGE MISSILE IMPACT RESISTANCE

ISSUED: 12/6/02 REVISED: N/A DESCRIPTION: ULTRA-LITE STONE (CONSISTING OF STONE VENEER EPOXY BONDED TO ALUMINUM HONEYCOMB REINFORCING) ANCHORED TO ALUMINUM EXTRUSIONS WHICH ARE SCREW ATTACHED TO STEEL STUD FRAMING.	DRAWING No. 1 OF 1	TITLE: ULTRA-LITE STONE PANELS USED FOR CURTAIN WALL
 PH. (972) 446-1776 FAX (972) 245-3749 1725 SANDY LAKE ROAD CARROLLTON, TEXAS 75006	Robert E. Williams FLORIDA REGISTRATION No. _____	