



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

Vistawall Architectural Products

803 Airport Road
Terrell, TX 75160

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "RW-5100 Ribbon" Aluminum Fixed Window System - S.M.I.

APPROVAL DOCUMENT: Drawing No. **RW-5100 S.M.I.**, titled "RW-5100 Insulated Impact - Ribbon Window System - Small Missile Impact", sheets 1 through 6 of 6, dated 10/01/08 with revision dated 01/27/09, prepared by manufacturer, signed and sealed by William D. Cook, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA # 03-0718.06** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 08-1015.09
Expiration Date: October 30, 2013
Approval Date: February 18, 2009
Page 1

Vistawall Architectural Products

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **RW-5100 S.M.I.**, titled "RW-5100 Insulated Impact - Ribbon Window System - Small Missile Impact", sheets 1 through 6 of 6, dated 10/01/08 with revision dated 01/27/09, prepared by manufacturer, signed and sealed by William D. Cook, P.E.

B. TESTS

1. Test reports on:
 - 1) Uniform Static Air Pressure Test, Loading per FBC,TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Small Missile Impact Test per FBC, TAS 201-94
 - 4) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of an aluminum ribbon window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL 0105-0815-02**, dated 8/20/02, signed and sealed by Vinu Abraham, P.E.
(Submitted under previous NOA #03-0718.06)
2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC,TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of an aluminum ribbon window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL 0105-0619-02**, dated 6/24/02, signed and sealed by Vinu Abraham, P.E.
(Submitted under previous NOA #03-0718.06)

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Bromley-Cook Engineering, Inc., dated 5/23/06, signed and sealed by William D. Cook, P.E.
Complies with ASTM E1300-98

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "Saflex III G Clear or colored Interlayer" dated 05/04/06, expiring on 05/21/11.
2. Notice of Acceptance No. **07-1116.11** issued to Saf-Glas, LLC for their "SAF-GLAS Polycarbonate Laminate", dated 12/27/07, expiring on 12/16/12.


Manuel Perez, P.E.
Product Control Examiner

NOA No. 08-1015.09
Expiration Date: October 30, 2013
Approval Date: February 18, 2009

Vistawall Architectural Products


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, dated October 1, 2008, signed and sealed by William D. Cook, P.E.
2. Statement letter of no financial interest, dated October 1, 2008, signed and sealed by William D. Cook, P.E.
3. Laboratory compliance letter for Test Reports No. **HTL-0105-0619-02** and **HTL-0105-0815-02**, issued by Hurricane Test Laboratory, Inc., dated March 21, 2003, signed and sealed by Vinu J. Abraham, P.E.

G. OTHER

1. Notice of Acceptance No. **03-0718.06**, issued to Vistawall Architectural Products for their Series "RW-5100" Ribbon Window System-S.M., approved on 10/30/03 and expiring on 10/30/08.

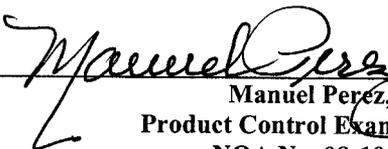

Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-1015.09


Expiration Date: October 30, 2013
Approval Date: February 18, 2009

GENERAL NOTES:

WINDOW RATED FOR SMALL MISSILE IMPACT.
 -SHUTTERS REQUIRED FOR WINDOWS INSTALLED UP TO 30' ABOVE GRADE.
 -NO SHUTTERS REQUIRED FOR WINDOWS INSTALLED OVER 30' ABOVE GRADE.

- 1.) THIS PRODUCT IS DESIGNED AND TESTED TO MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2.) WOOD BUCK BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- 3.) PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- 4.) DESIGNED PRESSURE RATING SEE TABLE, PAGE 1
- 5.) SYSTEM TESTED IN COMPLIANCE WITH TAS-201, 202, & 203.
- 6.) WIND LOAD INCREASE OF 33% WAS NOT USED IN ANALYSIS OF SYSTEM.

TYPICAL ANCHOR LOCATIONS
 AT HEAD AND SILL OF ALL UNITS
 (SEE ANCHOR SCHEDULE SHEET 4)

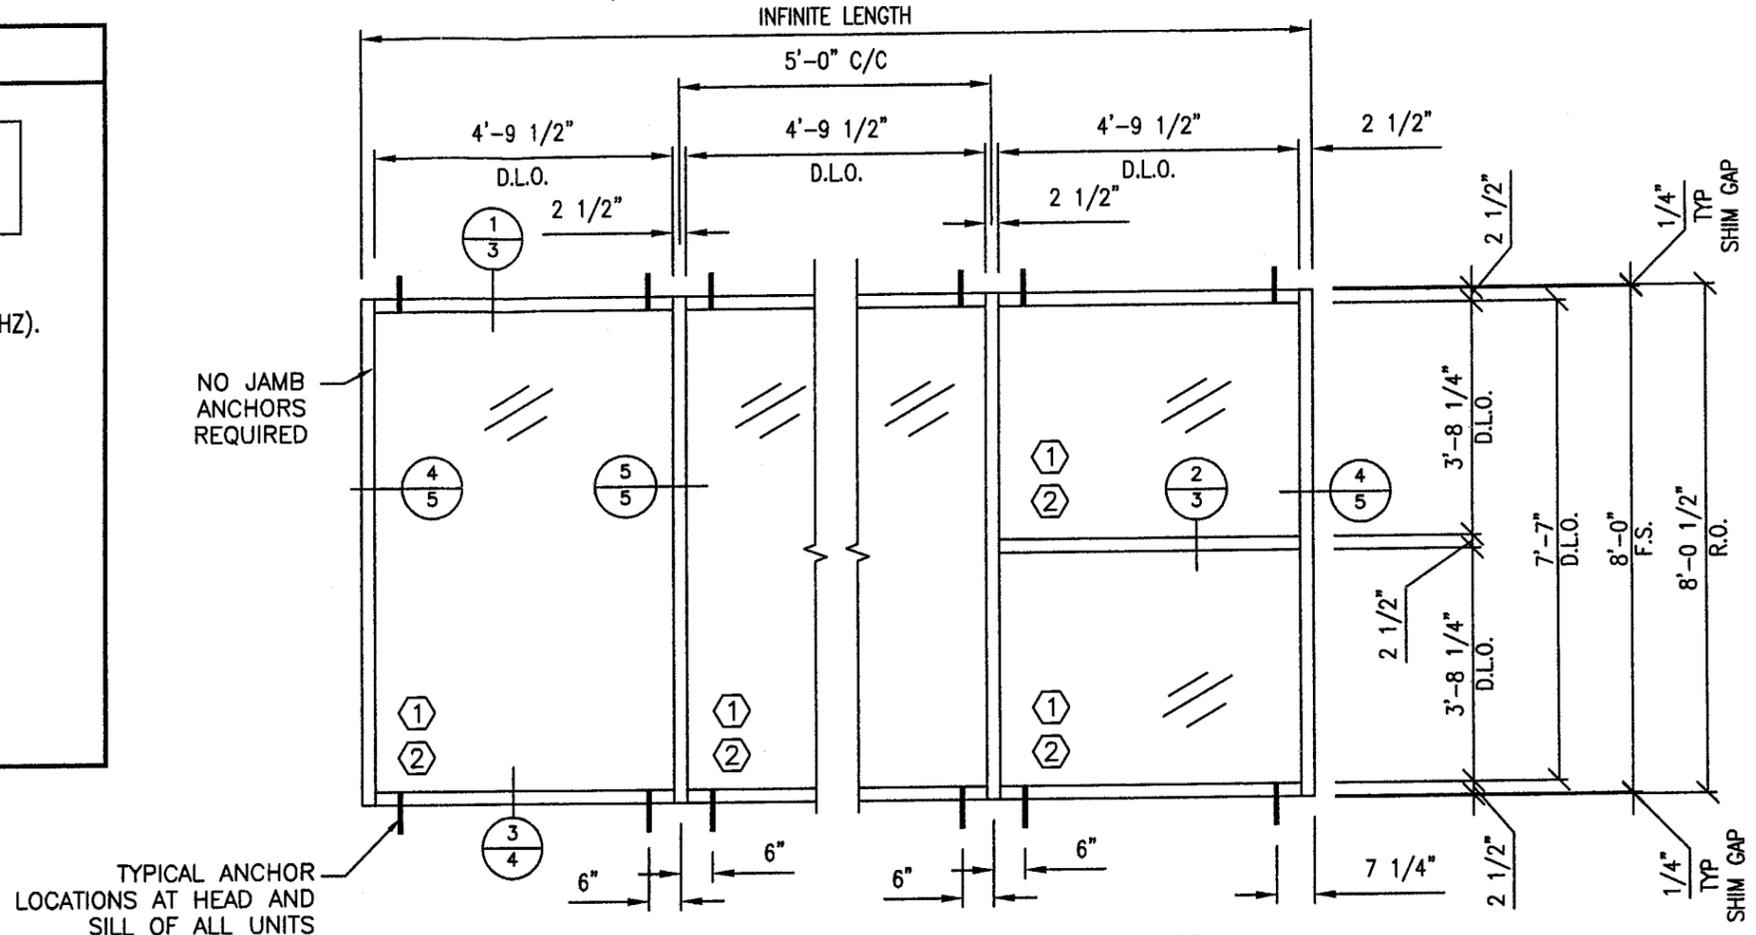

EXTERIOR ELEVATION
SMALL IMPACT

NOTE:

REFER TO SHEET 4 FOR GLAZING DETAILS

DESIGN PRESSURE	
+70 psf (15psf WATER)	POSITIVE
-80 psf	NEGATIVE

GLASS SCHEDULE			GASKETS
MANUFACTURER	DESCRIPTION		
① SECURITY IMPACT GLASS	INSULATED - LAMINATED GLASS: 1/4" TEMP., 1/2" AIRSPACE, 1/4" H.S. GLASS AT INNER AND OUTER FACES .070 POLYCARBONATE. .015 POLYURETHANE LAMINATE; TOTAL = .536		FG-5126 INT FG-5158 EXT
② SOLUTIA SAFLEX PVB	INSULATED - LAMINATED GLASS: 1/4" TEMP., 1/2" AIRSPACE, 1/4" H.S. GLASS AT INNER AND OUTER FACES, .060 SAFLEX PVB; TOTAL = .496		FG-5126 INT FG-5158 EXT

PRODUCT REVIEWED
 as complying with the Florida
 Building Code
 Approved On: 08-10-09
 Expiration Date: Oct. 30, 2013
 By: *Manuel Perez*
 Minimum Approval Duration: 30 Days

BROMLEY - COOK ENGINEERING, INC.
 5440 NW 33 RD. AVE SUITE 100
 FT. LAUDERDALE, FL 33309
 954-772-4624, FAX 954-772-4634
 CERT. OF AUTH. #00009124

JAN 28 2009
 WILLIAM D. COOK, PE, SECB
 FL P.E. # 43904 - FL S.I. # 2008

NO	REVISION	DATE	BY
	FINAL REVISIONS	27.JAN.09	LAK


VISTAWALL
 ARCHITECTURAL PRODUCTS
 803 AIRPORT RD. TERRELL TX 75160 (972) 551-6100

RW-5100 INSULATED IMPACT
 RIBBON WINDOW SYSTEM - SMALL MISSILE IMPACT

DATE 01/OCT/08
 DRAWN BY LAK
 DWG. NO. RW-5100 S.M.I.

SHEET 1 OF 6

RW-5100 INSULATED IMPACT ACCESORIES

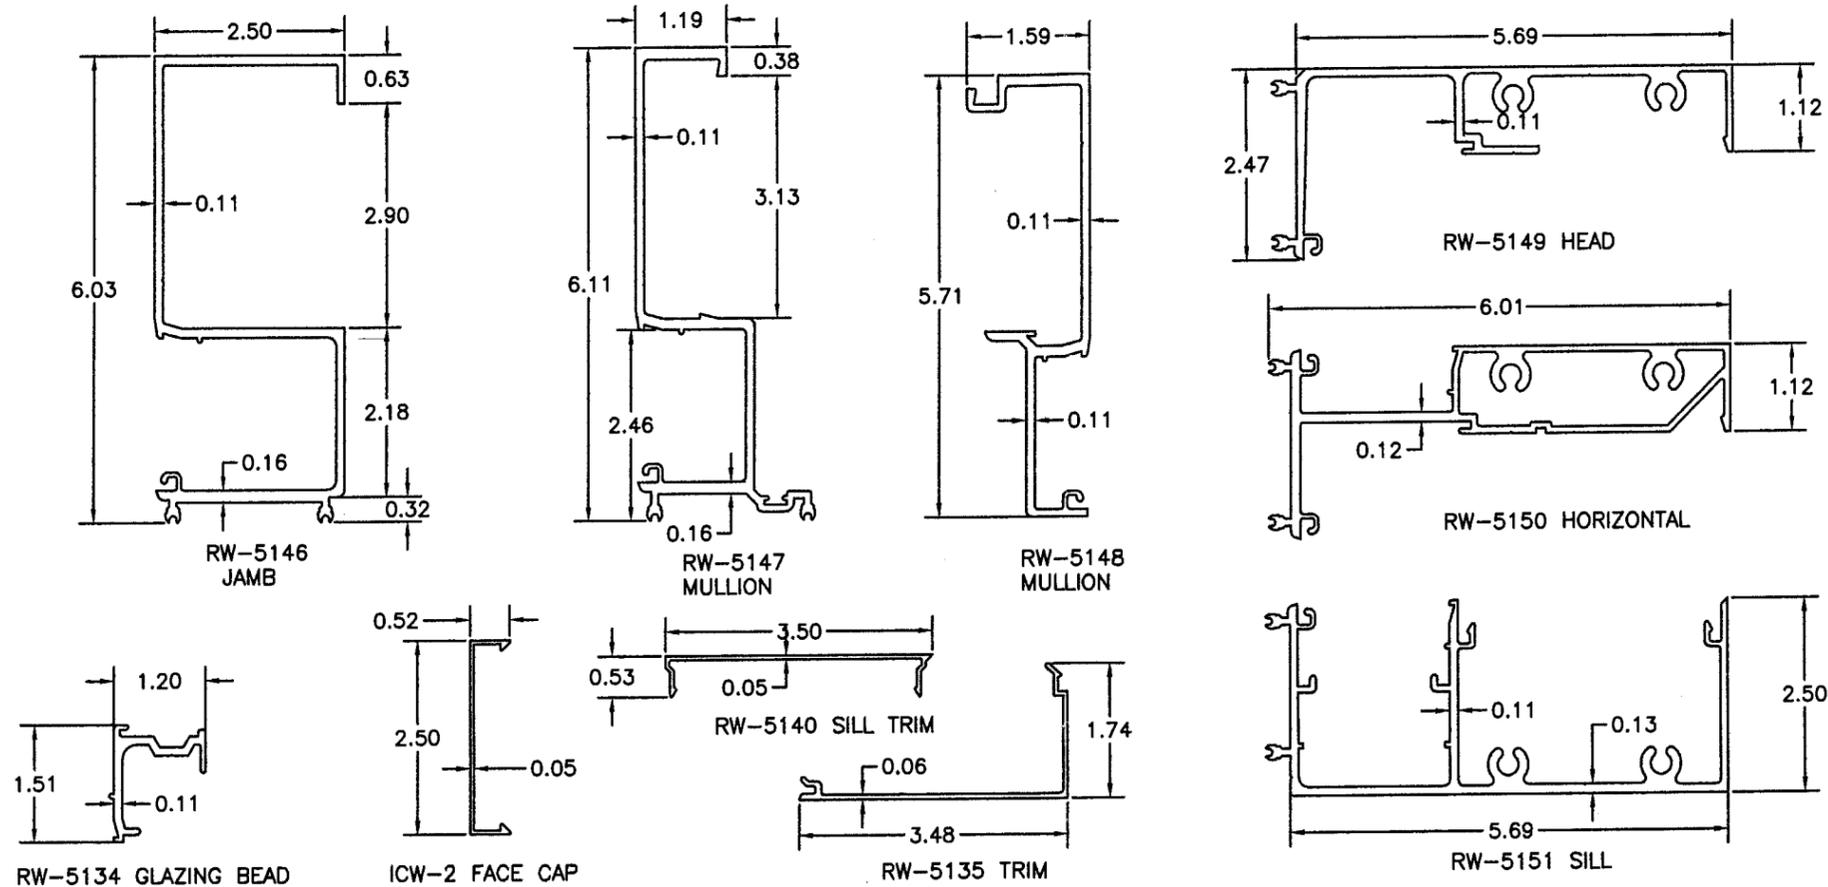

EXTRUSION SCHEDULE	
EXT. NO.	DESCRIPTION
RW-5134	GLAZING BEAD
RW-5135	HEAD/HORIZ TRIM
RW-5140	SILL TRIM
RW-5141	MULL CAP
RW-5142	JAMB CAP
RW-5146	JAMB MULL
RW-5147	MULLION
RW-5148	MULLION
RW-5149	HEAD
RW-5150	HORIZONTAL
RW-5151	SILL
RW-5153	SILL FACE CAP
RW-5161	END DAM
RW-5162	MULL CLIP
ICW-2	TYP. FACE CAP

NOTE:
ALL ALUMINUM TO BE 6063-T6

GASKETS AND HARDWARE			
PART NO	DESCRIPTION	MANUFACTURER	LOCATION
CW-998	BULB GASKET	VISTAWALL	MULLIONS
ICW-12	ISOLATOR	VISTAWALL	ALL FACES @ 12" O.C.
FG-5158	EPDM GASKET	VISTAWALL	TYPICAL EXTERIOR
FG-5126	VINYL SPACER	VISTAWALL	TYPICAL INTERIOR
FG-5159	EPDM SETTING BLOCK	VISTAWALL	SILL & HORIZONTAL
RW5000-FP-5	VINYL WATER DIVERTER	VISTAWALL	HORIZONTALS
FG-5152	ALUM. SETTING CHAIR	VISTAWALL	SILL
FG-5160	VINYL BAFFLE RETAINER	VISTAWALL	SILL
RW5000-FP-6	MULL CAP (MADE FROM RW-5141)	VISTAWALL	HEAD & SILL MULLIONS
RW5000-FP-7	JAMB CAP (MADE FROM RW-5142)	VISTAWALL	HEAD & SILL JAMBS
RW5000-FP-9	END DAM (MADE FROM RW-5161)	VISTAWALL	HEAD & SILL MULLIONS
RW5000-PP-10	BAFFLE	VISTAWALL	SILL
RW5000-FP-11	MULLION CLIP(MADE FROM RW-5162)	VISTAWALL	MULLIONS
DOW 995	STRUCTURAL SILICONE	DOW-CORNING	INTERIOR GLASS
SPECTREM 2	SILICONE SEALANT	TREMCO	INTERIOR GLASS
SM-5601	SEALANT TAPE	SCHNEE-MOREHEAD	FRAME JOINTS
931	SEALANT	TREMCO VULKEM	PERIMETER SEAL,FRAME JOINTS

FASTENER SCHEDULE		
PART NO.	DESCRIPTION	APPLICATION
FS-327	#12 X 7/8" HWHTCS	GLAZING BEADS
FS-202	#8 X 1/2" PPH	JAMB CAP
FS-45	#8 X 1/2" PFH	MULL CAP/END DAM
FS-44	5/16" X 1" HHSTS	FRAME CONNECTIONS

PRODUCT REVISED
as complying with the Florida
Building Code
Adopted By 08-1015-09
Expiration Date OCT. 30, 2013
By *William Cook*
Miami Code Product Control
Division

BROMLEY-COOK ENGINEERING, INC.
5440 NW 33 RD. AVE SUITE 100
FT. LAUDERDALE, FL 33309
954-772-4624, FAX 954-772-4634
CERT. OF AUTH. #00009124

JAN 28 2009

WILLIAM D. COOK, PE, SECB
FL P.E. # 43904 - FL S.I. # 2008


NO	REVISION	DATE	BY
	FINAL REVISIONS	27.JAN.09	LAK

VISTAWALL
ARCHITECTURAL PRODUCTS
803 AIRPORT RD. TERRELL TX 75160 (972) 551-6100


RW-5100 INSULATED IMPACT
RIBBON WINDOW SYSTEM - SMALL MISSILE IMPACT

DATE 01/OCT/08
DRAWN BY *LAK*
DWG. NO. RW-5100 S.M.I.

SHEET
2
OF 6

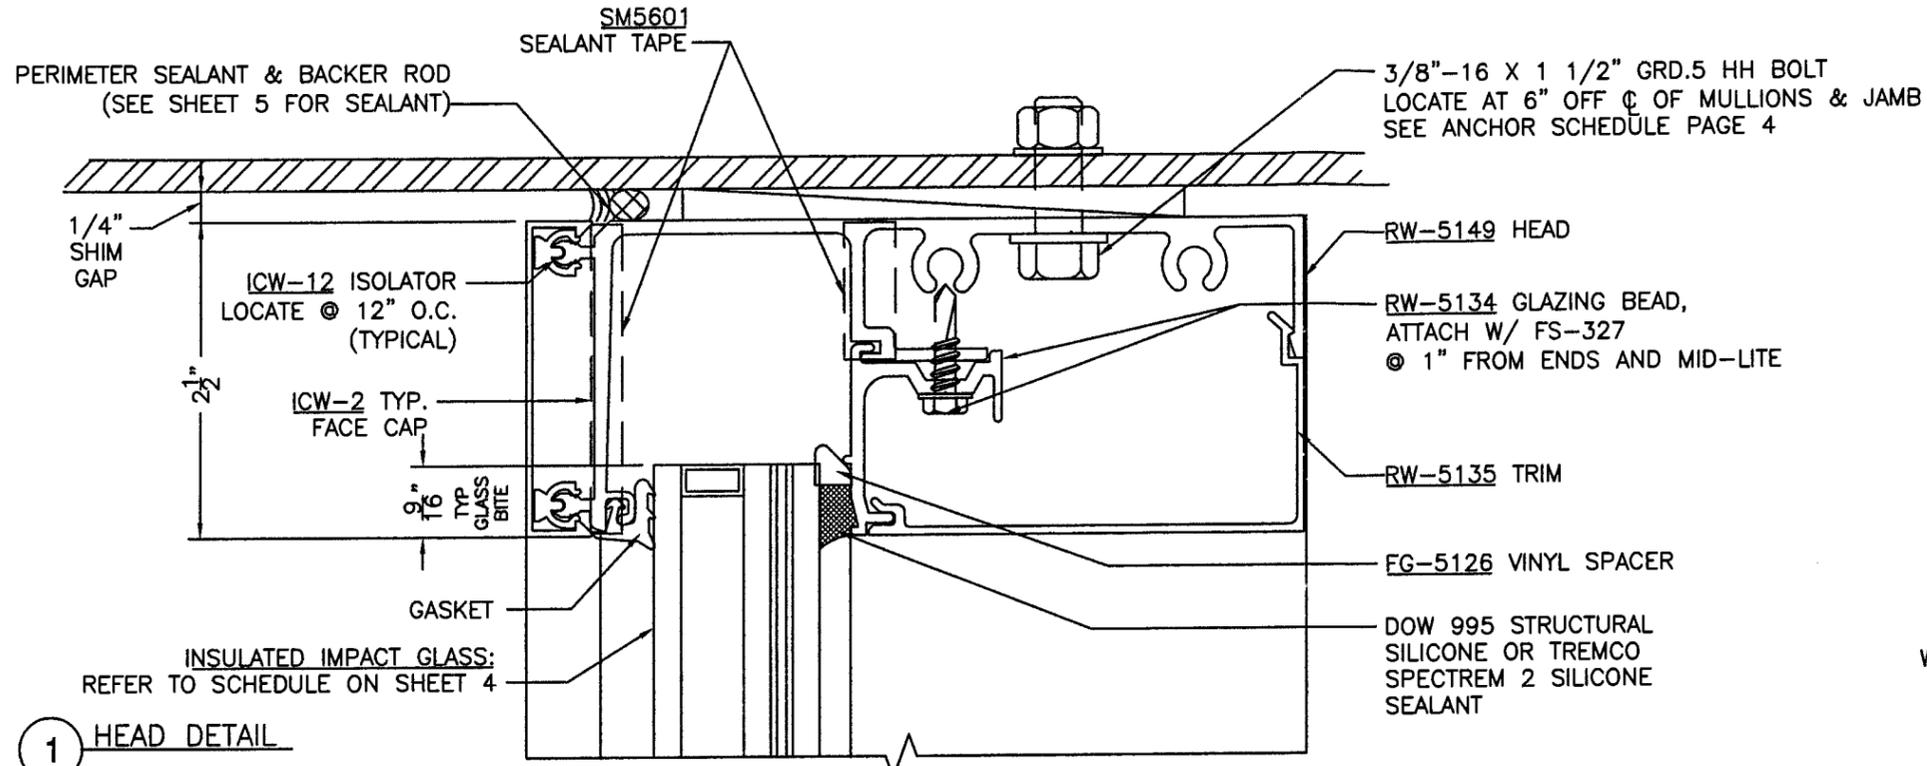


1 HEAD DETAIL

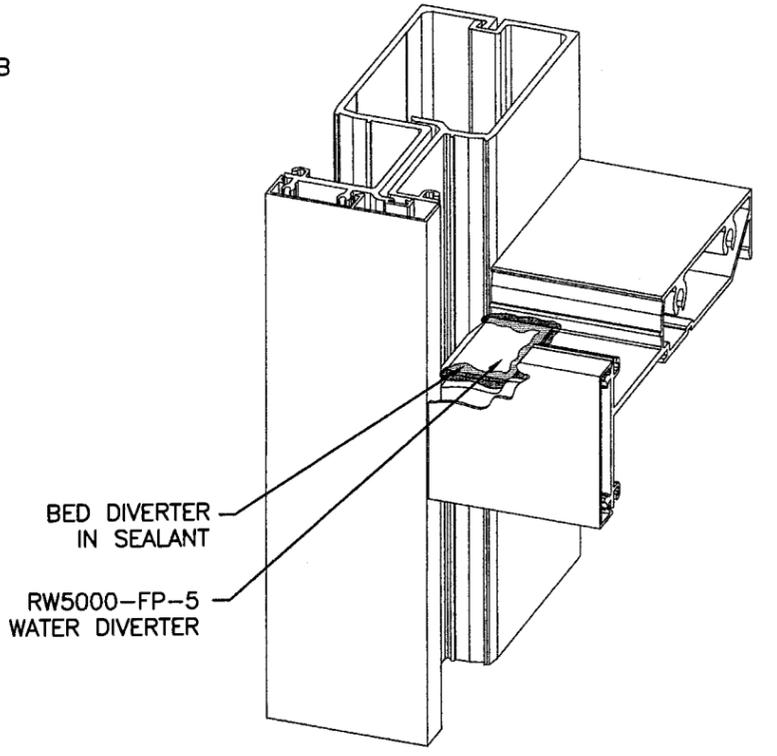

WATER DIVERTER SEALANT DETAIL
LOCATE AT EACH END OF INTERMEDIATE HORIZONTALS

GLAZING NOTE:
REFERENCE SHEET 1 FOR GLASS SCHEDULE, AND SHEET 4 FOR GASKET AND GLAZING DETAILS.
REFERENCE SHEET 6 FOR MULL CAP AND END DAM INSTALLATION.

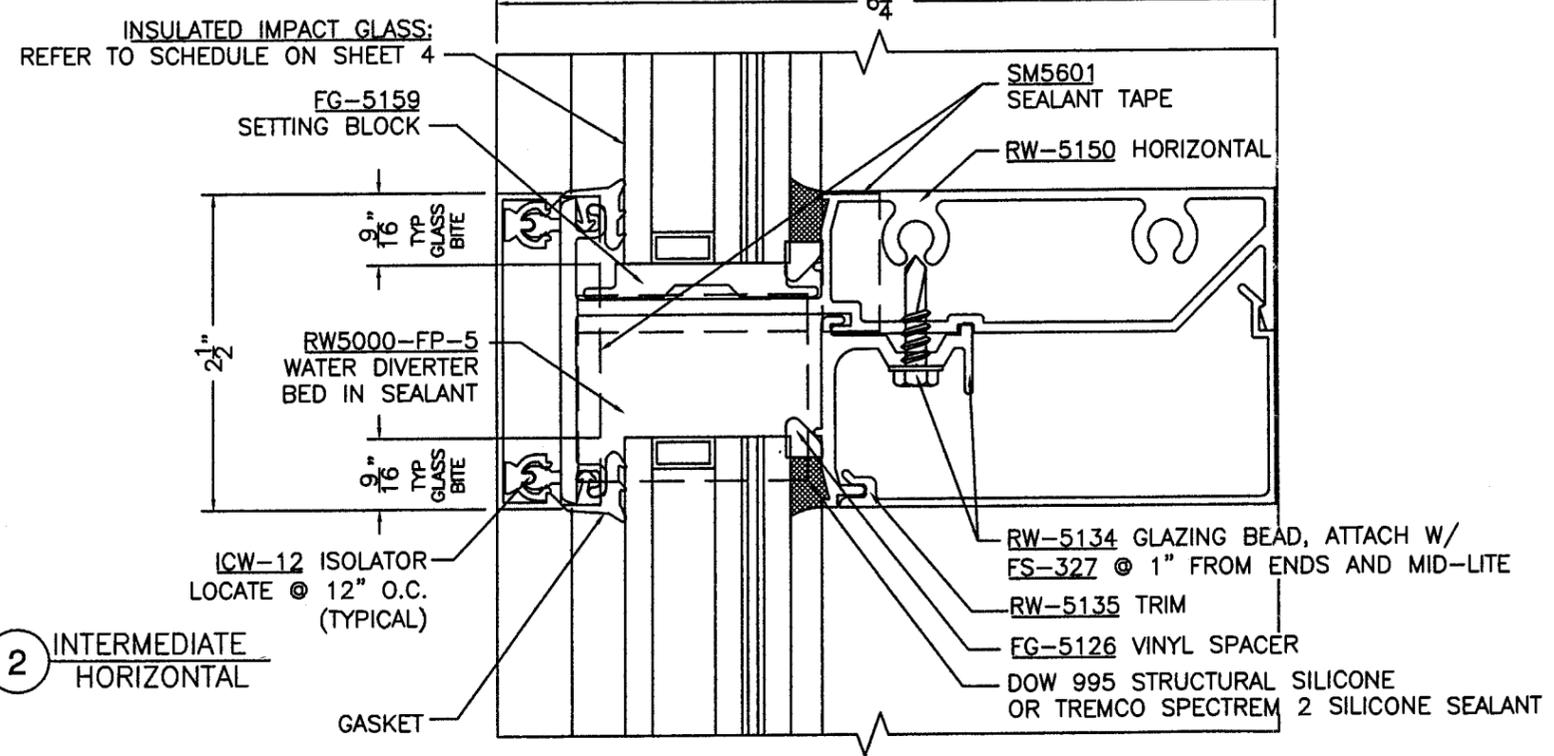

2 INTERMEDIATE HORIZONTAL

BROMLEY • COOK ENGINEERING, INC.
5440 NW 33 RD. AVE SUITE 100
FT. LAUDERDALE, FL 33309
954-772-4624, FAX 954-772-4634
CERT. OF AUTH. #00009124

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 08-1015-09
Expiration Date OCT 30, 2013
By *Maureen Perry*
Miami Code Product Control
Division



JAN 28 2009
WILLIAM D. COOK, PE, SECB
FL P.E. # 43904 - FL S.I. # 2008

NO	REVISION	DATE	BY
	FINAL REVISIONS	27.JAN.09	LAK

VISTAWALL
ARCHITECTURAL PRODUCTS
803 AIRPORT RD. TERRELL TX 75160 (972) 551-6100

RW-5100 INSULATED IMPACT
RIBBON WINDOW SYSTEM - SMALL MISSILE IMPACT

DATE	01/OCT/08	SHEET	3
DRAWN BY	<i>LAK</i>	OF	6
DWG. NO.	RW-5100 S.M.I.		

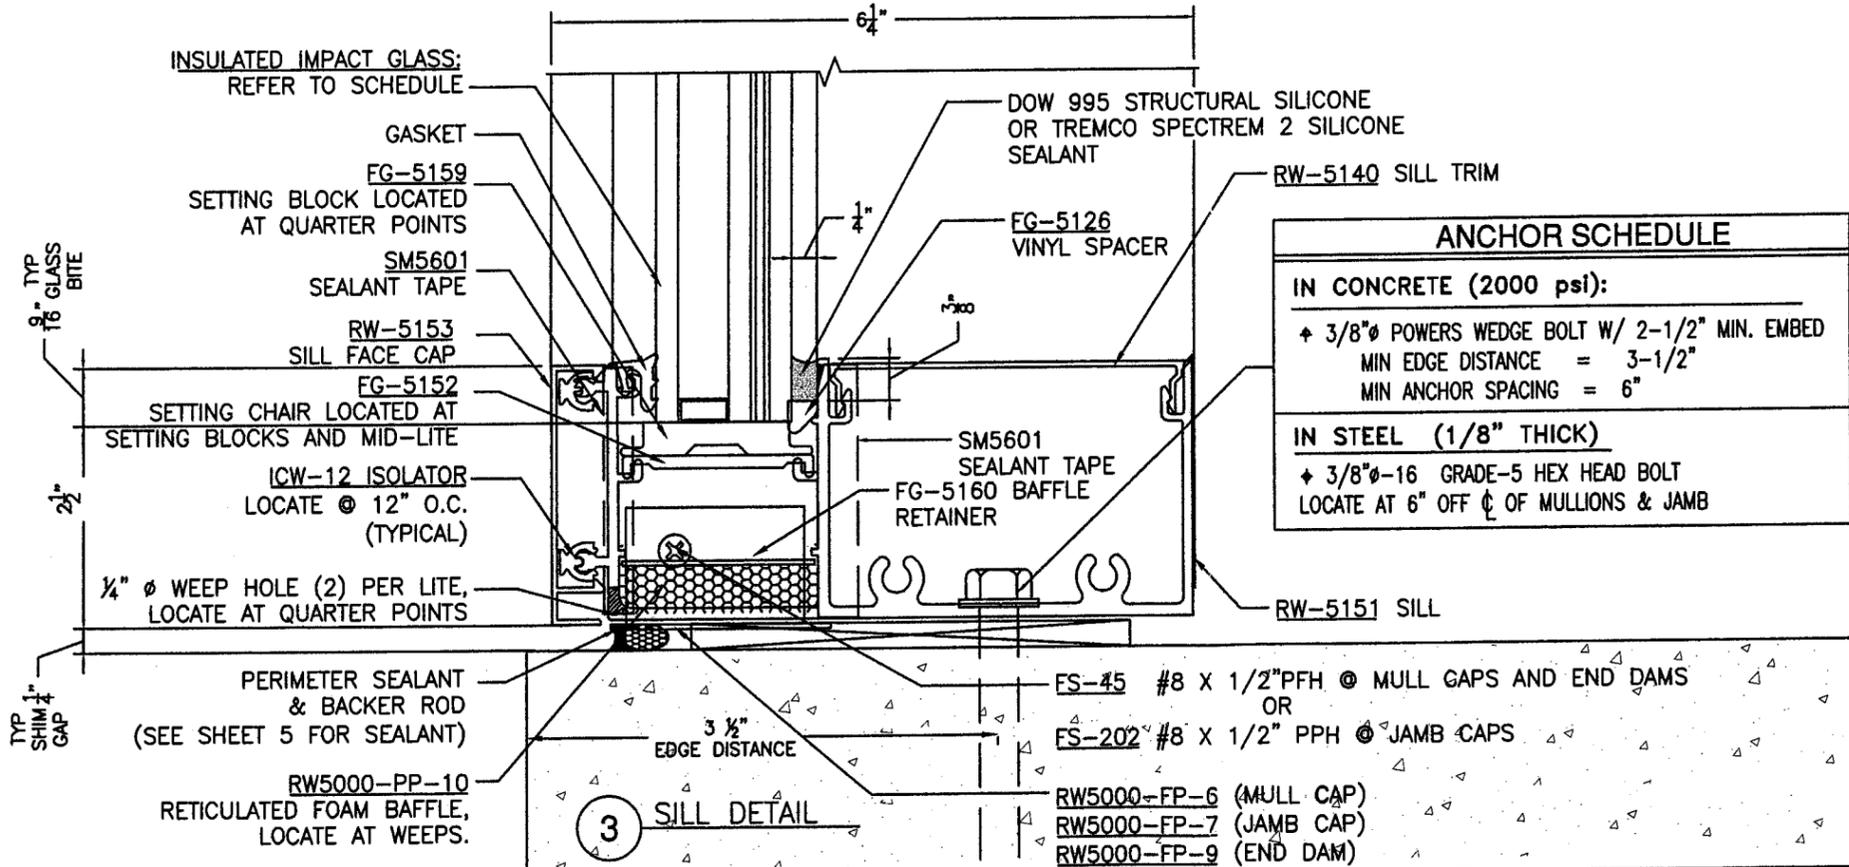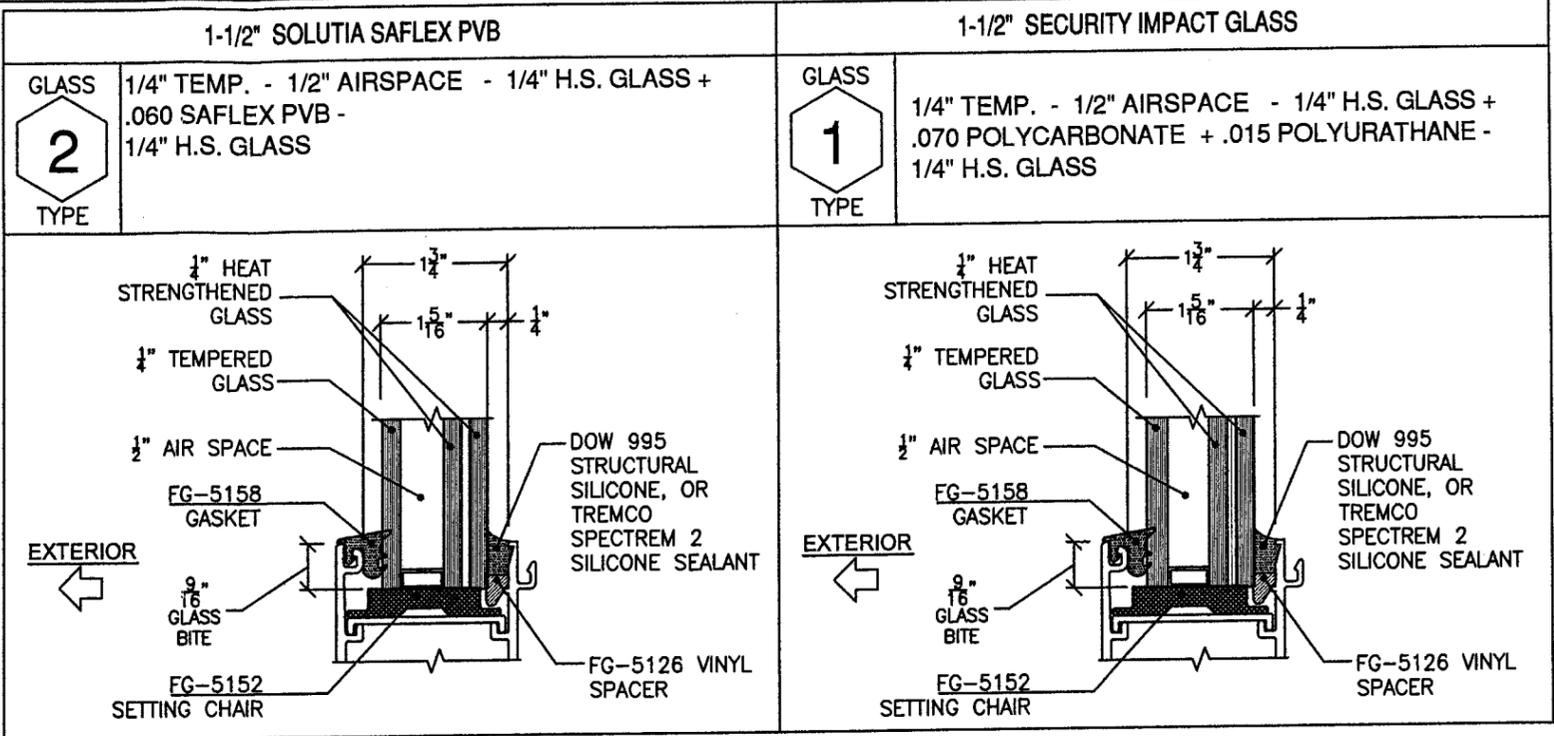

ANCHOR SCHEDULE
IN CONCRETE (2000 psi): + 3/8"Ø POWERS WEDGE BOLT W/ 2-1/2" MIN. EMBED MIN EDGE DISTANCE = 3-1/2" MIN ANCHOR SPACING = 6"
IN STEEL (1/8" THICK) + 3/8"Ø-16 GRADE-5 HEX HEAD BOLT LOCATE AT 6" OFF Ø OF MULLIONS & JAMB

PRODUCT REVISED to comply with the Florida Building Code
 Amendment No. 08-1015-09
 Explanation Date: OCT 30, 2013
 By: *Manuel Perez*
 Miami Trade Product Control Division

BROMLEY · COOK ENGINEERING, INC.
 5440 NW 33 RD. AVE SUITE 100
 FT. LAUDERDALE, FL 33309
 954-772-4624, FAX 954-772-4634
 CERT. OF AUTH. #00009124

JAN 28 2009
 WILLIAM D. COOK, PE, SECB
 FL P.E. # 43904 - FL S.I. # 2008

FINAL REVISIONS	27.JAN.09	LAK
NO REVISION	DATE	BY

VISTAWALL


ARCHITECTURAL PRODUCTS

803 AIRPORT RD. TERRELL TX 75160 (972) 551-6100

RW-5100 INSULATED IMPACT

RIBBON WINDOW SYSTEM - SMALL MISSILE IMPACT

DATE	01/OCT/08	SHEET	4
DRAWN BY	LAK	OF	6
DWG. NO. RW-5100 S.M.I.			

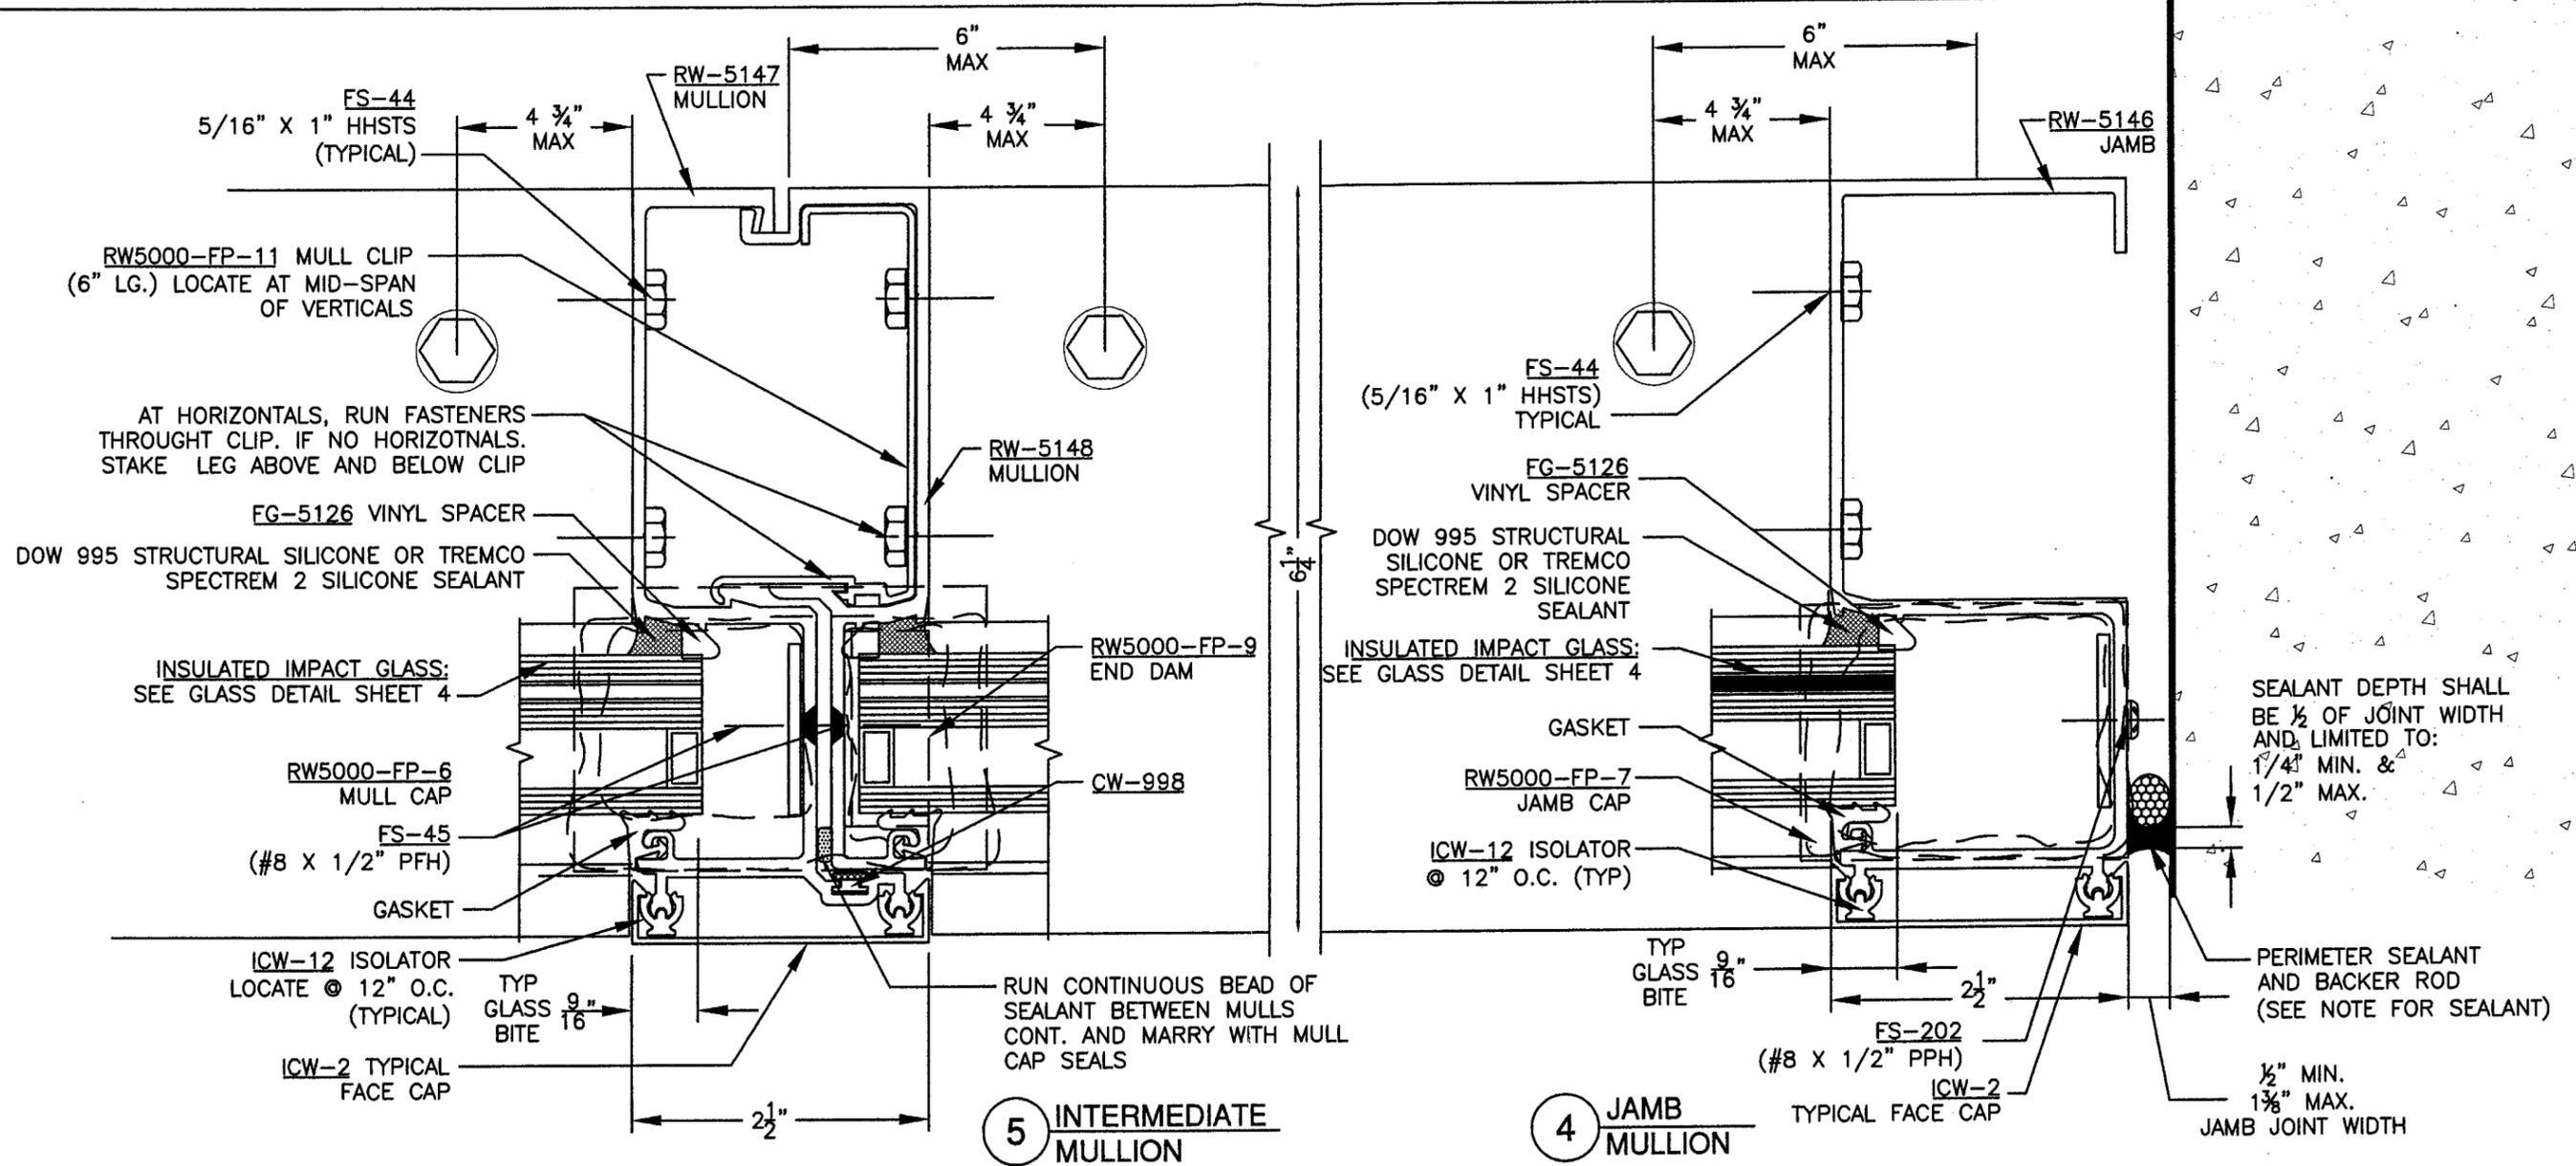

AT HORIZONTALS, RUN FASTENERS THROUGH CLIP. IF NO HORIZONTALS, STAKE LEG ABOVE AND BELOW CLIP

FG-5126 VINYL SPACER
DOW 995 STRUCTURAL SILICONE OR TREMCO SPECTREM 2 SILICONE SEALANT

INSULATED IMPACT GLASS:
SEE GLASS DETAIL SHEET 4

RW5000-FP-6 MULL CAP

FS-45 (#8 X 1/2\"/>

GASKET

ICW-12 ISOLATOR LOCATE @ 12\"/>

ICW-2 TYPICAL FACE CAP

TYP GLASS BITE 9/16"

RUN CONTINUOUS BEAD OF SEALANT BETWEEN MULLS CONT. AND MARRY WITH MULL CAP SEALS

5 INTERMEDIATE MULLION

FS-44 (5/16\"/>

FG-5126 VINYL SPACER

DOW 995 STRUCTURAL SILICONE OR TREMCO SPECTREM 2 SILICONE SEALANT

INSULATED IMPACT GLASS:
SEE GLASS DETAIL SHEET 4

GASKET

RW5000-FP-7 JAMB CAP

ICW-12 ISOLATOR @ 12\"/>

TYP GLASS BITE 9/16"

FS-202 (#8 X 1/2\"/>

ICW-2 TYPICAL FACE CAP

SEALANT DEPTH SHALL BE 1/2 OF JOINT WIDTH AND LIMITED TO: 1/4\"/>

PERIMETER SEALANT AND BACKER ROD (SEE NOTE FOR SEALANT)

1/2\"/>

SEE SHEET 6 FOR ADDITIONAL MULL CAP INSTALLATION INFORMATION

GLAZING NOTE: REFERENCE SHEET 4 FOR GLASS SCHEDULE AND GLAZING DETAILS.

JAMB SEALANT NOTES:

PERIMETER SEALANT OPTIONS:
DOW 795 (SILICONE),
TREMCO SPECTREM 2 & 3 (SILICONE)
TREMCO DYMONIC FC (URETHANE)
SONNEBORN SOLOLASTIC 150 (ELASTOMERIC)

ALTERNATE SEALANTS & ALTERNATE JAMB GAPS:
TO BE APPROVED BY DESIGN PROFESSIONAL OF RECORD AND SEALANT MANUFACTURER.

PROJECT ADVISED as existing with the Florida Building Code
Approval No. 08-1015-09
Expiration Date OCT. 30, 2013
By *William D. Cook*
Miami Radio Product Control Division

BROMLEY • COOK ENGINEERING, INC.

5440 NW 33 RD. AVE SUITE 100
FT. LAUDERDALE, FL 33309
954-772-4624, FAX 954-772-4634
CERT. OF AUTH. #00009124

JAN 28 2009

WILLIAM D. COOK, PE, SECB
FL P.E. # 43904 - FL S.I. # 2008

FINAL REVISIONS	27.JAN.09	LAK
NO REVISION	DATE	BY


VISTAWALL
ARCHITECTURAL PRODUCTS
803 AIRPORT RD. TERRELL TX 75160 (972) 551-6100

RW-5100 INSULATED IMPACT
RIBBON WINDOW SYSTEM - SMALL MISSILE IMPACT

DATE 01/OCT/08
DRAWN BY **LAK**
DWG. NO. RW-5100 S.M.I.

SHEET 5 OF 6

MULL CAP SEALANT DETAIL AND INSTALLATION INSTRUCTIONS

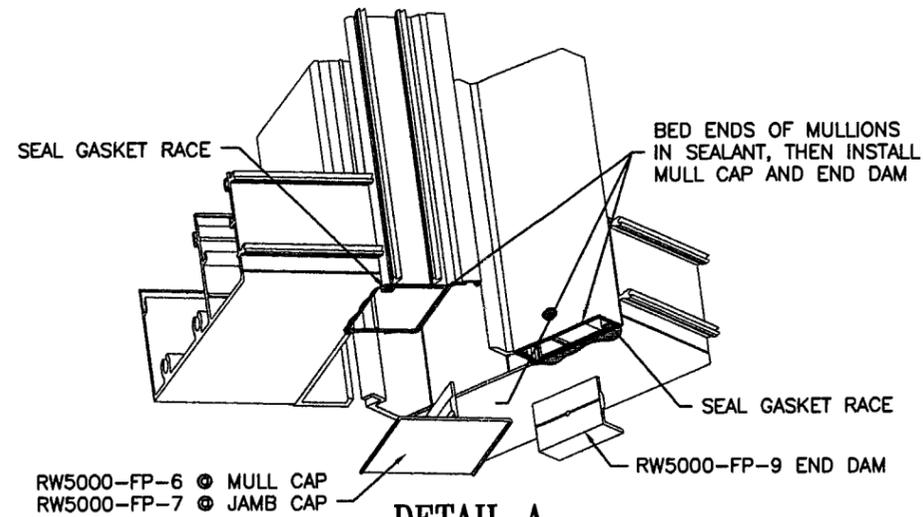


DETAIL A
MULL CAP & END DAMS REQUIRED AT HEAD AND SILL TYPICAL. (SILL SHOWN)


INSTALL MULL CAPS AND END DAMS USING FS-45 (#8 X 1/2" PFH), INSTALL JAMB CAPS USING FS-202 (#8 X 1/2" PPH). (CAP SEAL ALL FASTENERS)

TOOL THE SEALANT ALONG INTERIOR OF THE MULL DURING INSTALLATION OF THE MULL CAP.

WHEN INSTALLING THE FG5000-FP-6 MULL CAP, KEEP THIS AREA CLEAR OF SEALANT TO ALLOW FOR INSTALLATION OF NEXT UNIT.

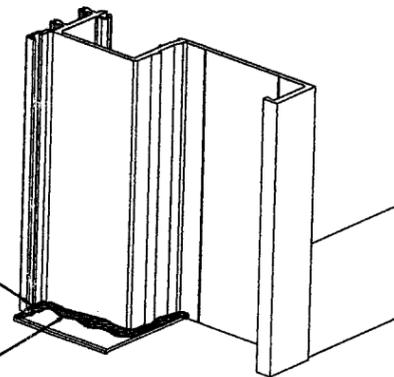


DETAIL B

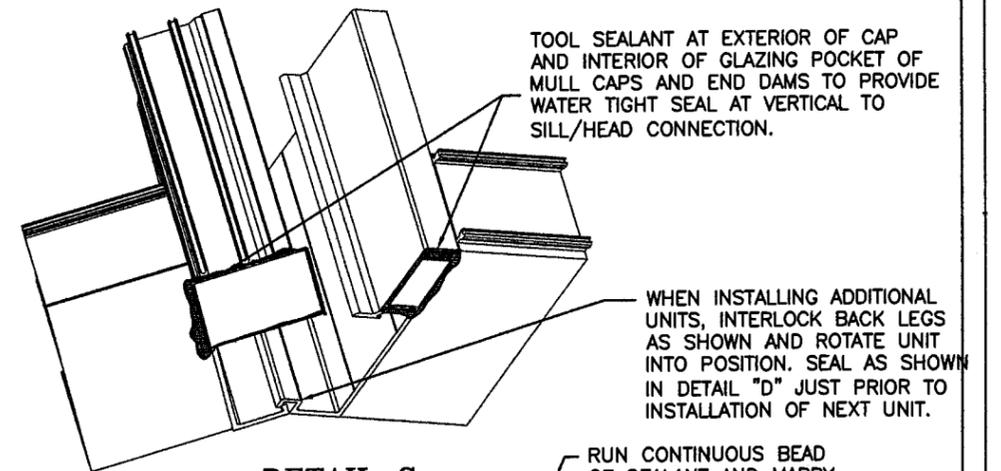

DETAIL C

RUN CONTINUOUS BEAD OF SEALANT AND MARRY WITH SEALS AT MULL CAPS JUST PRIOR TO INSTALLATION OF NEXT UNIT.

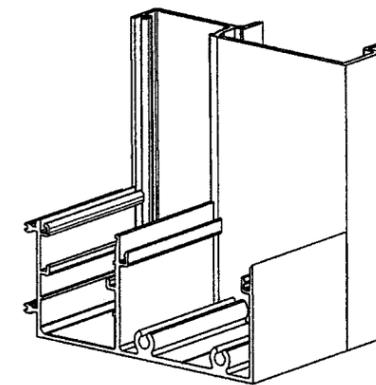

DETAIL D
BED TOP OF MULL CAP WITH SEALANT JUST PRIOR TO INSTALLING NEXT UNIT.

INSTALLATION NOTES:

- 1) ASSEMBLE UNITS AS SHOWN ON DETAIL SHEETS 3 THRU 5.
INSTALL SEALANT TAPE BETWEEN VERTICALS AND HORIZONTALS AS SHOWN.
- 2) INSTALL AND SEAL MULL CAPS AS SHOWN IN DETAILS A, B & C ABOVE.
- 3) MULL CAPS SHOULD FORM A WATER TIGHT SEAL. A TEST MAY BE CONDUCTED TO CONFIRM THIS SEAL BY BLOCKING WEEP HOLES AND FILLING SILL CAVITY WITH WATER. AFTER TEST REMOVE PLUGS FROM WEEP HOLES, DRAIN WATER, INSTALL BAFFLES AND BAFFLE RETAINERS.
- 4) INSTALL FIRST UNIT INTO OPENING
(UNITS WILL INSTALL FROM LEFT TO RIGHT AS VIEWED FROM EXTERIOR OF BUILDING), LEVEL, PLUMB AND ANCHOR FIRST UNIT. WHEN SHIMMING UNITS, SHIM AT ANCHOR POINTS UNDER SILL. DO NOT PLACE SHIMS BENEATH MULL OR MULL CAP.
- 5) RUN BEAD OF SEALANT CONTINUOUS FOR FULL HEIGHT OF MULLION AND BED MULL CAP WITH SEALANT AT HEAD AND SILL AS SHOWN IN DETAIL D.
- 6) INSTALL SECOND UNIT BY BRINGING INTO POSITION FROM INSIDE OF BUILDING, TILT HEAD OF UNIT BENEATH MULL CAP, ROTATE SILL OF UNIT OVER LOWER MULL CAP, THEN INTERLOCK BACK LEGS OF MULLION (SEE DETAIL C), PLACE APPROPRIATE SHIMS BENEATH SILL MEMBER TO ALLOW FOR BETTER ALIGNMENT, AND ROTATE UNIT INTO PLACE. PLUMB AND ANCHOR.

- 7) REPEAT STEP 6 FOR ALL ADDITIONAL UNITS. MINIMUM 1/4" CAULK JOINT AT JAMB IS REQUIRED FOR INSTALLATION OF FINAL UNIT.
- 8) SYSTEM MAY BE INSTALLED EITHER IN UN-GLAZED OR PREGLAZED FRAMES. WHEN INSTALLING UNITS AS UN-GLAZED FRAMES FOLLOW INSTRUCTIONS 4 THRU 8 AND THEN INSTALL GLASS, NEXT PLACE AN 1/8" SHIM AT MID-HEIGHT OF MULL AND CLAMP BACK OF MULL AT THE SHIM BEFORE RUNNING WEDGE TO HELP INSURE PROPER ALIGNMENT OF MULLS AT FACE OF SYSTEM. WHEN PREGLAZING FRAMES, MAKE SURE THAT UNITS ARE SQUARE AND THAT DAY LIGHT OPENINGS ARE HELD TO PROPER DIMENSIONS BEFORE RUNNING STRUCTURAL SILICONE. (REFERENCE SILICONE MANUFACTURER FOR PROPER CLEANING AND USE OF SILICONE.)

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 08-1015, 09 Expiration Date OCT. 30, 2013 By <i>Manuel Perez</i> Ministry State Product Control Division	BROMLEY · COOK ENGINEERING, INC. 5440 NW 33 RD. AVE SUITE 100 FT. LAUDERDALE, FL 33309 954-772-4624, FAX 954-772-4634 CERT. OF AUTH. #00009124
	JAN 28 2009 WILLIAM D. COOK, PE, SECB FL P.E. # 43904 - FL S.I. # 2008

NO	REVISION	DATE	BY
.	FINAL REVISIONS	27.JAN.09	LAK

VISTAWALL
ARCHITECTURAL PRODUCTS
803 AIRPORT RD. TERRELL TX 75160 (972) 551-6100

RW-5100 INSULATED IMPACT
RIBBON WINDOW SYSTEM - SMALL MISSILE IMPACT

DATE	01/OCT/08	SHEET 6 OF 6
DRAWN BY	LAK	
DWG. NO.	RW-5100 S.M.I.	