



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

Glasswall LLC
3550 NW 49th Street
Miami, FL 33142

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 101S Aluminum Window Wall System – S.M.I.

APPROVAL DOCUMENT: Drawing No. **W07-11**, titled “Series 101S Alum Window Wall System (S.M.I.)”, sheets 1 through 8 of 8, dated 02/19/07 with revision B dated 01/22/09, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and renews NOA # 07-0717.03** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 08-1021.08
Expiration Date: September 25, 2013
Approval Date: March 04, 2009
 Page 1


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W07-11**, Sheets 1 through 8 of 8, titled "Series 101S Alum Window Wall System (S.M.I.)", dated 02/19/07 with revision B dated 01/19/09, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Small Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of a single bay aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4251** dated 07/13/04, signed and sealed by Michael L. Wenzel, P.E.
(Submitted under NOA#07-0717.03)
2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Small Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of an aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3774** dated 4/4/03, signed and sealed by Joseph Chan, P.E.
(Submitted under NOA#03-0618.02)
3. Test reports on:
 - 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 2) Small Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of an aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3612** dated 11/12/02, signed and sealed by Michael L. Wenzel, P.E.
(Submitted under NOA#03-0618.02)
4. Test reports on:
 - 1) Air Infiltration Test, per SFBC, PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
 - 3) Water Resistance Test, per SFBC, PA 202-94
 - 4) Small Missile Impact Test per SFBC, PA 201-94
 - 5) Cyclic Wind Pressure Loading per SFBC, PA 203-94along with marked-up drawings and installation diagram of a series 101 aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3349**, dated February 7, 2002, signed and sealed by Michael L. Wenzel, P.E.
(Submitted under previous approval 01-0429.04)

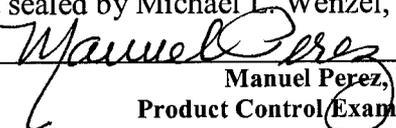
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-1021.08
Expiration Date: September 25, 2013
Approval Date: March 04, 2009

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. Test reports on:
- 1) Air Infiltration Test, per SFBC, PA 202-94
 - 2) Uniform Structural load Test, Loading per SFBC, PA 202-94
 - 3) Water Resistance Test, per SFBC, PA 202-94
 - 4) Large Missile Impact Test per SFBC, PA 201-94
 - 5) Small Missile Impact Test per SFBC, PA 201-94
 - 6) Cyclic Wind Pressure Loading per SFBC, PA 203-94

Along with marked-up drawings and installation diagram of an aluminum window wall system, prepared by Construction Testing Corporation, Test Report No. **01-002**, dated March 19, 2001, signed and sealed by Yamil G. Kuri, P.E., and additional information describing tests sequence, provided by Construction Testing Corporation and dated 1/17/01. *(Submitted under NOA#01-0402.02)*

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004 and 2007, prepared by Al-Farooq Corporation, dated 09/23/08, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated May 04, 2006, expiring on May 21, 2011.

F. STATEMENTS

1. Statement letter of conformance, dated October 8, 2008, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated October 8, 2008, signed and sealed by Humayoun Farooq, P.E.


G. OTHER

1. Notice of Acceptance No. **07-0717.03**, issued to Glasswall LLC for their Series 101S Aluminum Window Wall System – S.M.I., approved on 10/04/07 and expiring on 09/25/08.

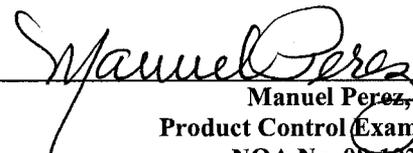

Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-1021.08
Expiration Date: September 25, 2013
Approval Date: March 04, 2009


MULLION LOAD CAPACITY - PSF WITHOUT INTERMEDIATE HORIZONTALS				
NOMINAL DIMS.		JAMB 'J1' MULLION 'M1'	JAMB 'J2' MULLION 'M2'	JAMB 'J3' MULLION 'M3'
WIDTH (W)	FRAME HEIGHT	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)
36"	96"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		110.0	140.0	140.0
57"		110.0	140.0	140.0
36"	102"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		110.0	140.0	140.0
57"		110.0	140.0	140.0
36"	108"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		110.0	140.0	140.0
57"		110.0	140.0	140.0
36"	114"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		110.0	140.0	140.0
57"		110.0	136.0	136.0
36"	120"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	133.3	133.3
54"		101.1	120.6	120.6
57"		96.7	115.4	115.4
36"	132"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	144"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	150"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	156"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	158"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0

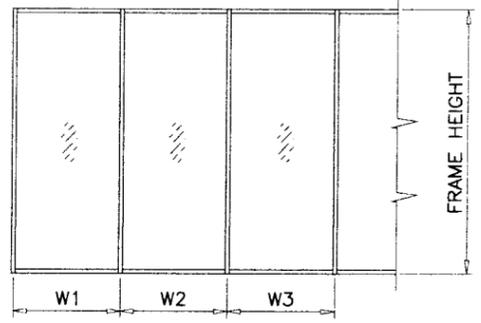

WIDTH (W) = W1
AT FRAME JAMB


WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION

MULLION LOAD CAPACITY - PSF WITH INTERMEDIATE HORIZONTALS				
NOMINAL DIMS.		JAMB 'J1' MULLION 'M1'	JAMB 'J2' MULLION 'M2'	JAMB 'J3' MULLION 'M3'
WIDTH (W)	FRAME HEIGHT	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)
36"	96"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		110.0	140.0	140.0
57"		110.0	140.0	140.0
36"	102"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		110.0	140.0	140.0
57"		110.0	140.0	140.0
36"	108"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		110.0	140.0	140.0
57"		110.0	140.0	140.0
36"	114"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		110.0	140.0	140.0
54"		108.8	129.8	129.8
57"		103.0	123.0	123.0
36"	120"	110.0	140.0	140.0
42"		110.0	140.0	140.0
48"		104.9	125.2	125.2
54"		93.2	111.3	111.3
57"		88.3	105.4	105.4
36"	132"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	144"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	150"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	156"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	110.0
36"	158"	-	-	110.0
42"		-	-	110.0
48"		-	-	110.0
54"		-	-	110.0
57"		-	-	108.9

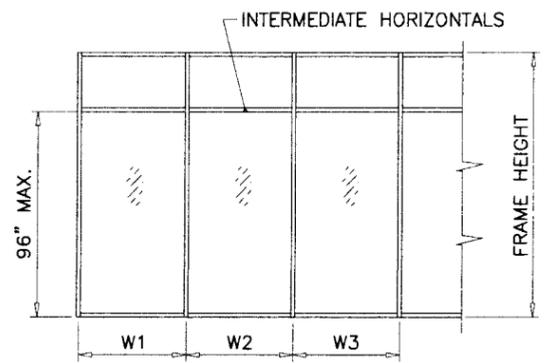


WIDTH (W) = W1
AT FRAME JAMB


WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION




JAMB 'J1'
JAMB 'J2'
W/O REINF.




JAMB 'J3'
W/ STL. REIN.



MULLION 'M1'
W/O REINF.



MULLION 'M2'
W/ ALUM REINF.



MULLION 'M3'
W/ STL. REINF.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

08-1021-08
SEPT. 25, 2013

JAN 26 2009

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE W07-11GWL

SERIES 101S ALUM WINDOW WALL SYSTEM (S.M.I.)
GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


no	date	description
A	09.24.08	UPDATED FOR 2007 FBC
B	01.22.09	NO CHANGE THIS SHEET

revisions:

date: 02-19-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-11
sheet 2 of 8

ANCHOR LOAD CAPACITY - PSF EXT.(+) & INT.(-)						
NOMINAL DIMS.		RECEPTOR ANCHORS			DIRECT MOUNT	
WIDTH (W)	FRAME HEIGHT	6/ MULL	8/ MULL	10/ MULL	6/ MULL	8/MULL
36"	96"	140.0	140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0	140.0
57"		140.0	140.0	140.0	140.0	140.0
36"	102"	140.0	140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0	140.0
54"		138.7	140.0	140.0	140.0	140.0
57"		134.0	140.0	140.0	140.0	140.0
36"	108"	140.0	140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0	140.0
48"		139.3	140.0	140.0	140.0	140.0
54"		128.4	140.0	140.0	140.0	140.0
57"		123.9	140.0	140.0	140.0	140.0
36"	114"	140.0	140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0	140.0
48"		130.0	140.0	140.0	140.0	140.0
54"		119.5	140.0	140.0	139.4	140.0
57"		115.2	140.0	140.0	134.4	140.0
36"	120"	140.0	140.0	140.0	140.0	140.0
42"		135.1	140.0	140.0	140.0	140.0
48"		121.9	140.0	140.0	140.0	140.0
54"		111.8	140.0	140.0	130.4	140.0
57"		107.7	140.0	140.0	125.6	140.0
36"	126"	110.0	110.0	110.0	110.0	110.0
42"		110.0	110.0	110.0	110.0	110.0
48"		110.0	110.0	110.0	110.0	110.0
54"		105.1	110.0	110.0	110.0	110.0
57"		101.1	110.0	110.0	110.0	110.0
36"	132"	110.0	110.0	110.0	110.0	110.0
42"		110.0	110.0	110.0	110.0	110.0
48"		108.3	110.0	110.0	110.0	110.0
54"		99.0	110.0	110.0	110.0	110.0
57"		95.2	110.0	110.0	110.0	110.0
36"	138"	110.0	110.0	110.0	110.0	110.0
42"		110.0	110.0	110.0	110.0	110.0
48"		102.6	110.0	110.0	110.0	110.0
54"		93.7	110.0	110.0	109.3	110.0
57"		90.0	110.0	110.0	104.9	110.0
36"	144"	110.0	110.0	110.0	110.0	110.0
42"		108.7	110.0	110.0	110.0	110.0
48"		97.5	110.0	110.0	110.0	110.0
54"		88.9	110.0	110.0	103.7	110.0
57"		85.3	110.0	110.0	99.5	110.0
36"	150"	110.0	110.0	110.0	110.0	110.0
42"		103.7	110.0	110.0	110.0	110.0
48"		92.9	110.0	110.0	108.3	110.0
54"		84.6	110.0	110.0	98.6	110.0
57"		81.1	108.1	110.0	94.6	110.0
36"	158"	110.0	110.0	110.0	110.0	110.0
42"		97.6	110.0	110.0	110.0	110.0
48"		87.3	110.0	110.0	101.8	110.0
54"		79.4	105.9	110.0	92.6	110.0
57"		76.1	101.4	110.0	88.7	110.0

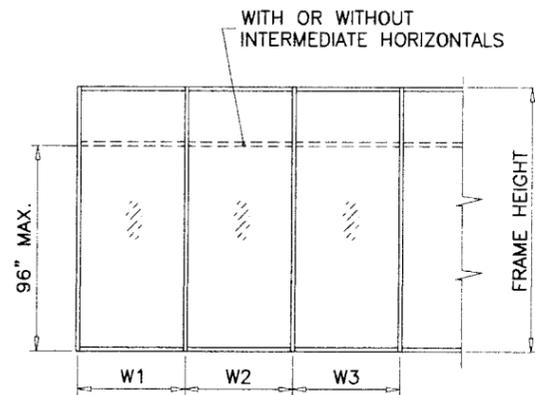

WIDTH (W) = W1
AT FRAME JAMB

WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION

HEAD & SILL ANCHORS:


CLUSTERS OF 6, 8 OR 10 ANCHORS AT MULLIONS,

WHEN USING UNSECURED JAMBS INSTALL 4 OR 6 ANCHORS RESPECTIVELY AT HEAD & SILL AT JAMB ENDS.

RECEPTOR ANCHOR COLUMNS APPLY TO MASONRY OR STEEL SUBSTRATE.

WHEN ANCHORING TO ALUMINUM STRUCTURES USE CLUSTER OF 12 ANCHORS AT MULLIONS AND 6 AT UNSECURED JAMBS.

DIRECT MOUNT OPTIONS APPLY TO MASONRY, STEEL OR ALUMINUM STRUCTURE ATTACHMENTS.

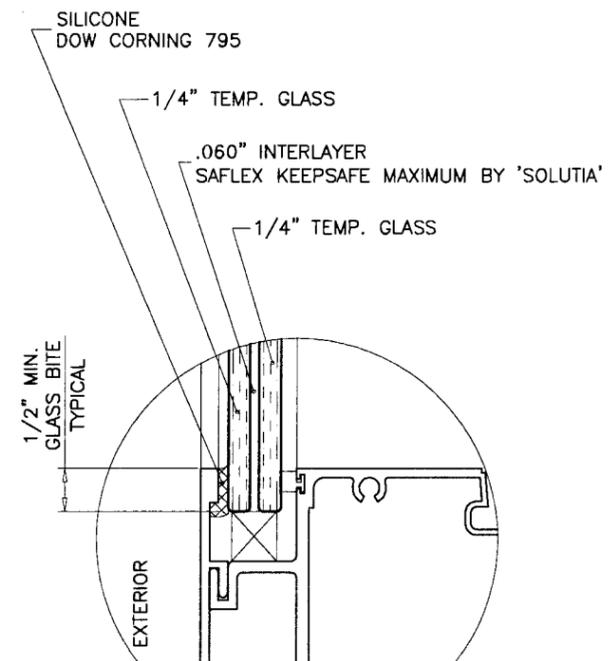

GLAZING DETAIL

Engr: DR. HUMAYGUN FAROOQ
STRUCTURES
FLA. PE # 16657
C.A.N. 3538

JAN 26 2009



08-1021-08
SEPT. 25, 2013
Manuel Perez

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE \ W07-11GWL

SERIES 101S ALUM WINDOW WALL SYSTEM (S.M.I.)
GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	description
A	09.24.08	NO CHANGE THIS SHEET
B	01.22.09	NO CHANGE THIS SHEET

revisions:
date: 02-19-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no.
W07-11
sheet 3 of 8

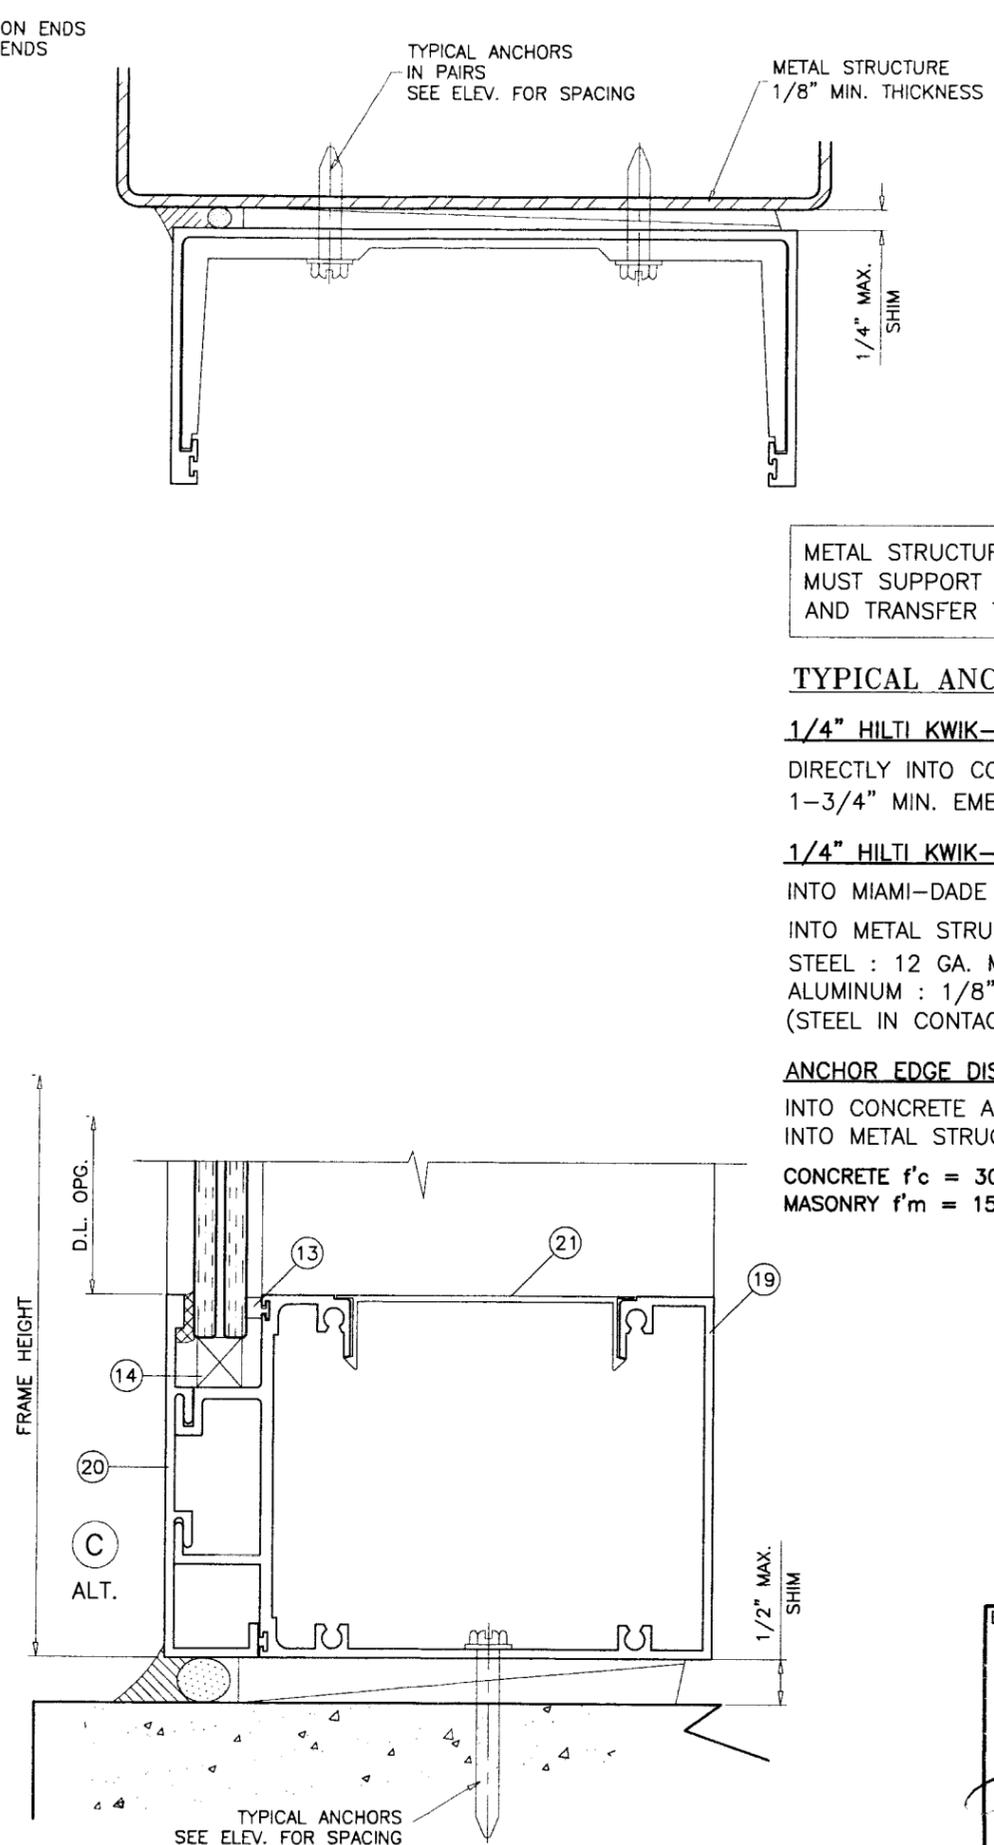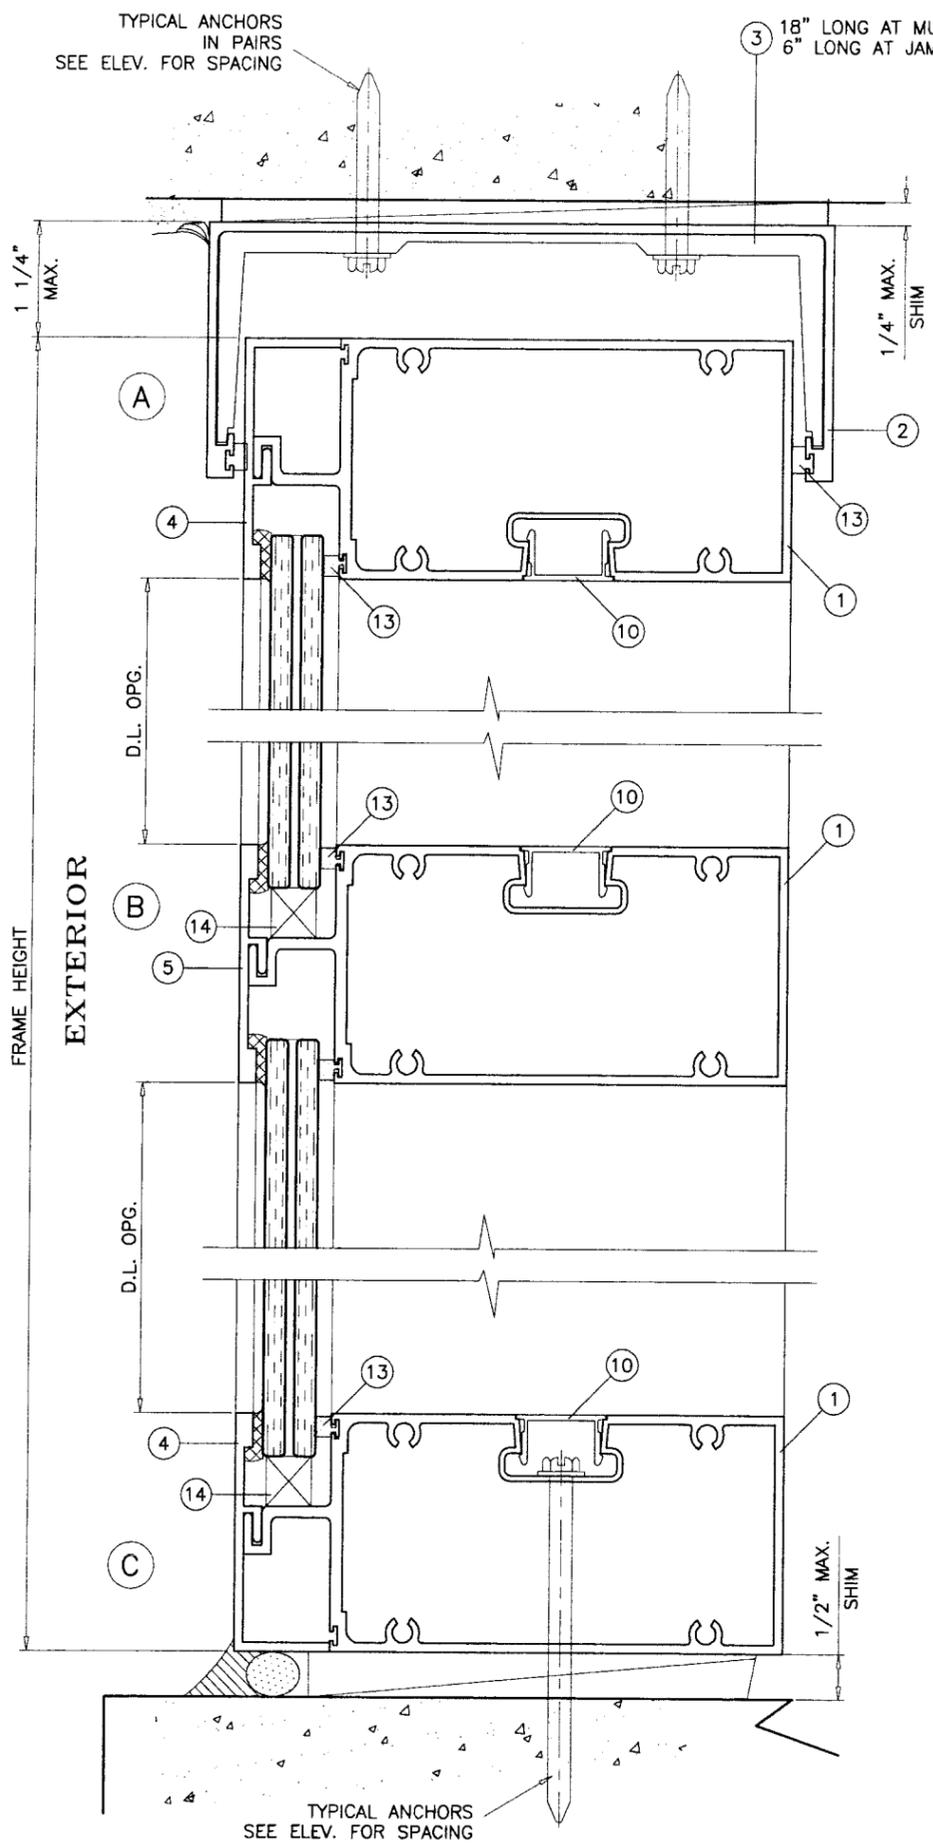

METAL STRUCTURES NOT BY GLASSWALL
MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

- TYPICAL ANCHORS:** SEE ELEV. FOR SPACING
- 1/4" HILTI KWIK-CON II** (Fu=163 KSI, Fy=157 KSI)
DIRECTLY INTO CONCRETE OR MASONRY
1-3/4" MIN. EMBED INTO CONCRETE OR MASONRY
 - 1/4" HILTI KWIK-FLEX SELF DRILLING SCREWS** (Fu=92 KSI, Fy=120 KSI)
INTO MIAMI-DADE COUNTY APPROVED MULLIONS
INTO METAL STRUCTURES
STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T6 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)
- ANCHOR EDGE DISTANCES**
- INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 - INTO METAL STRUCTURE = 3/4" MIN.
- CONCRETE f'c = 3000 PSI MIN.
MASONRY f'm = 1500 PSI MIN.

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
F.I.A. PE # 16557
C.A.N. 3538

JAN 26 2009

08-1021-08
SEPT. 25, 2013

Manuel Perez

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE/W07-11GWL

SERIES 101S ALUM WINDOW WALL SYSTEM (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	description
A	09.24.08	NO CHANGE THIS SHEET
B	01.22.09	NO CHANGE THIS SHEET





revisions:

date: 02-19-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-11

sheet 4 of 8

HEAD AND/OR SILL TYP. DETAILS

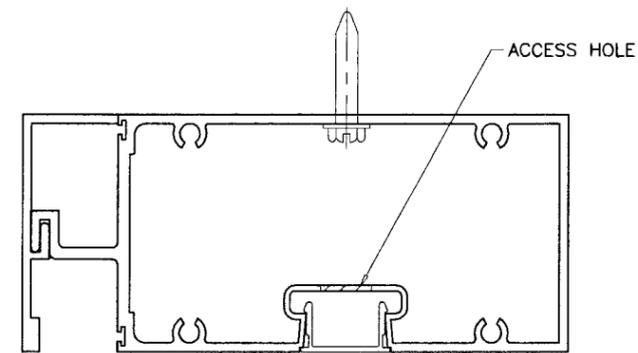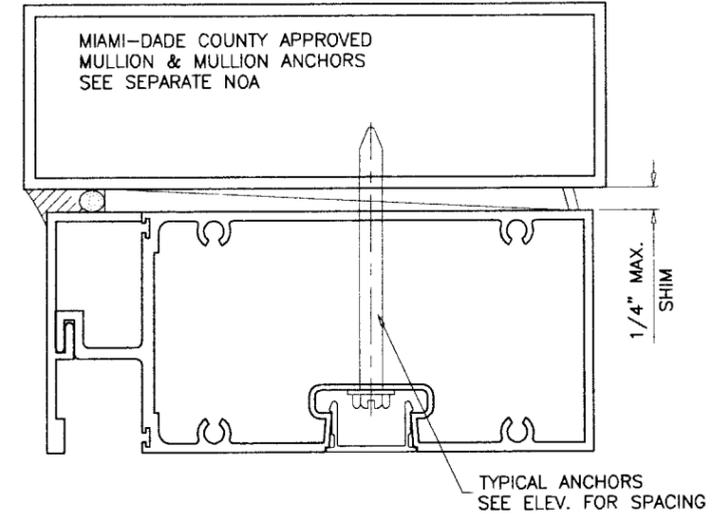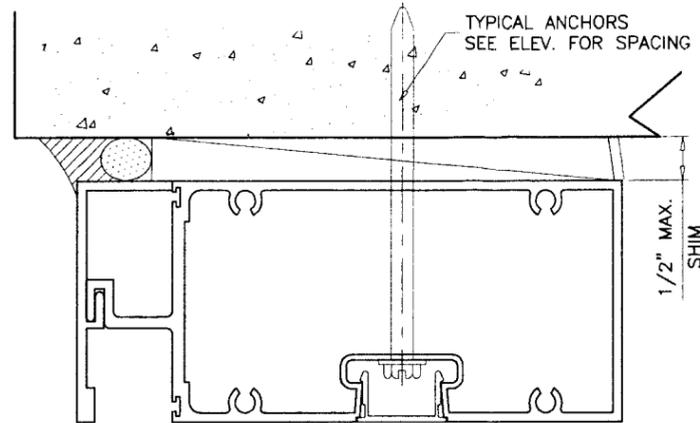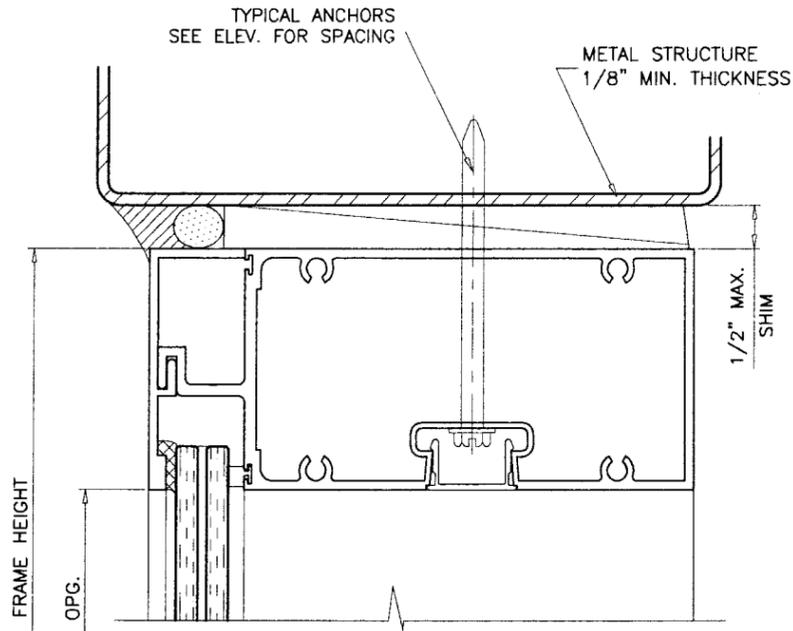

ALT. ANCHOR LOCATION
TYP. FOR ALL CONDITIONS

Engr: DR. HUMAYOUN FARCOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

JAN 26 2009

08-1021-08
SEPT. 25, 2013

Manuel Perez

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE/W07-11GWL

SERIES 101S ALUM WINDOW WALL SYSTEM (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no.	date	by	description
A	09.24.08		UPDATED FOR 2007 FBC
B	01.22.09		NO CHANGE THIS SHEET




date: 02-19-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-11

sheet 5 of 8

revisions:	no	date	description
A	09.24.08		NO CHANGE THIS SHEET
B	01.22.09		SILICONE NOTE ADDED


date:	02-19-07
scale:	1/2" = 1"
dr. by:	HAMID
chk. by:	

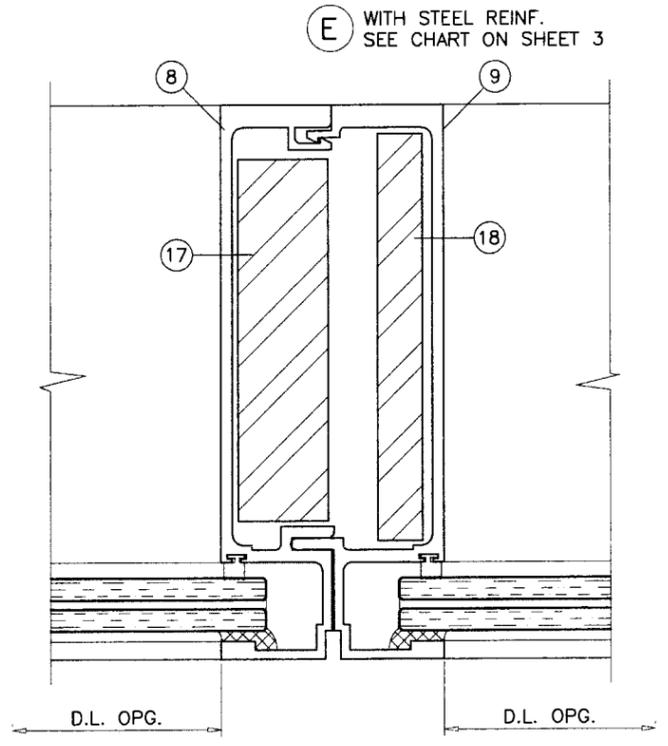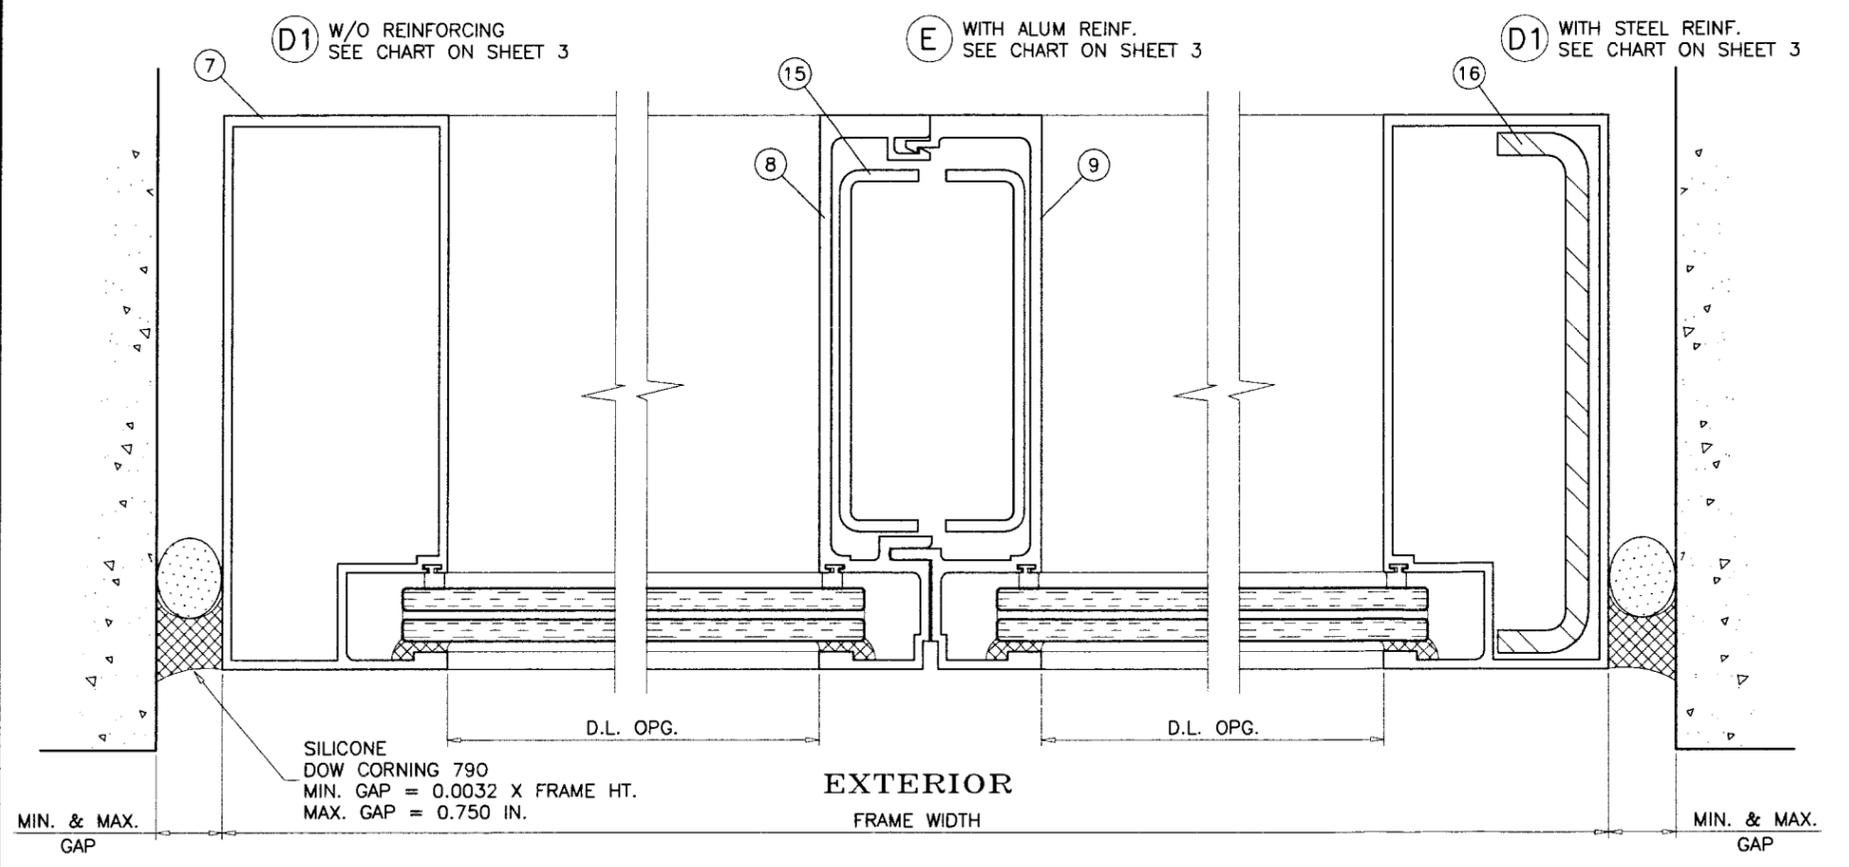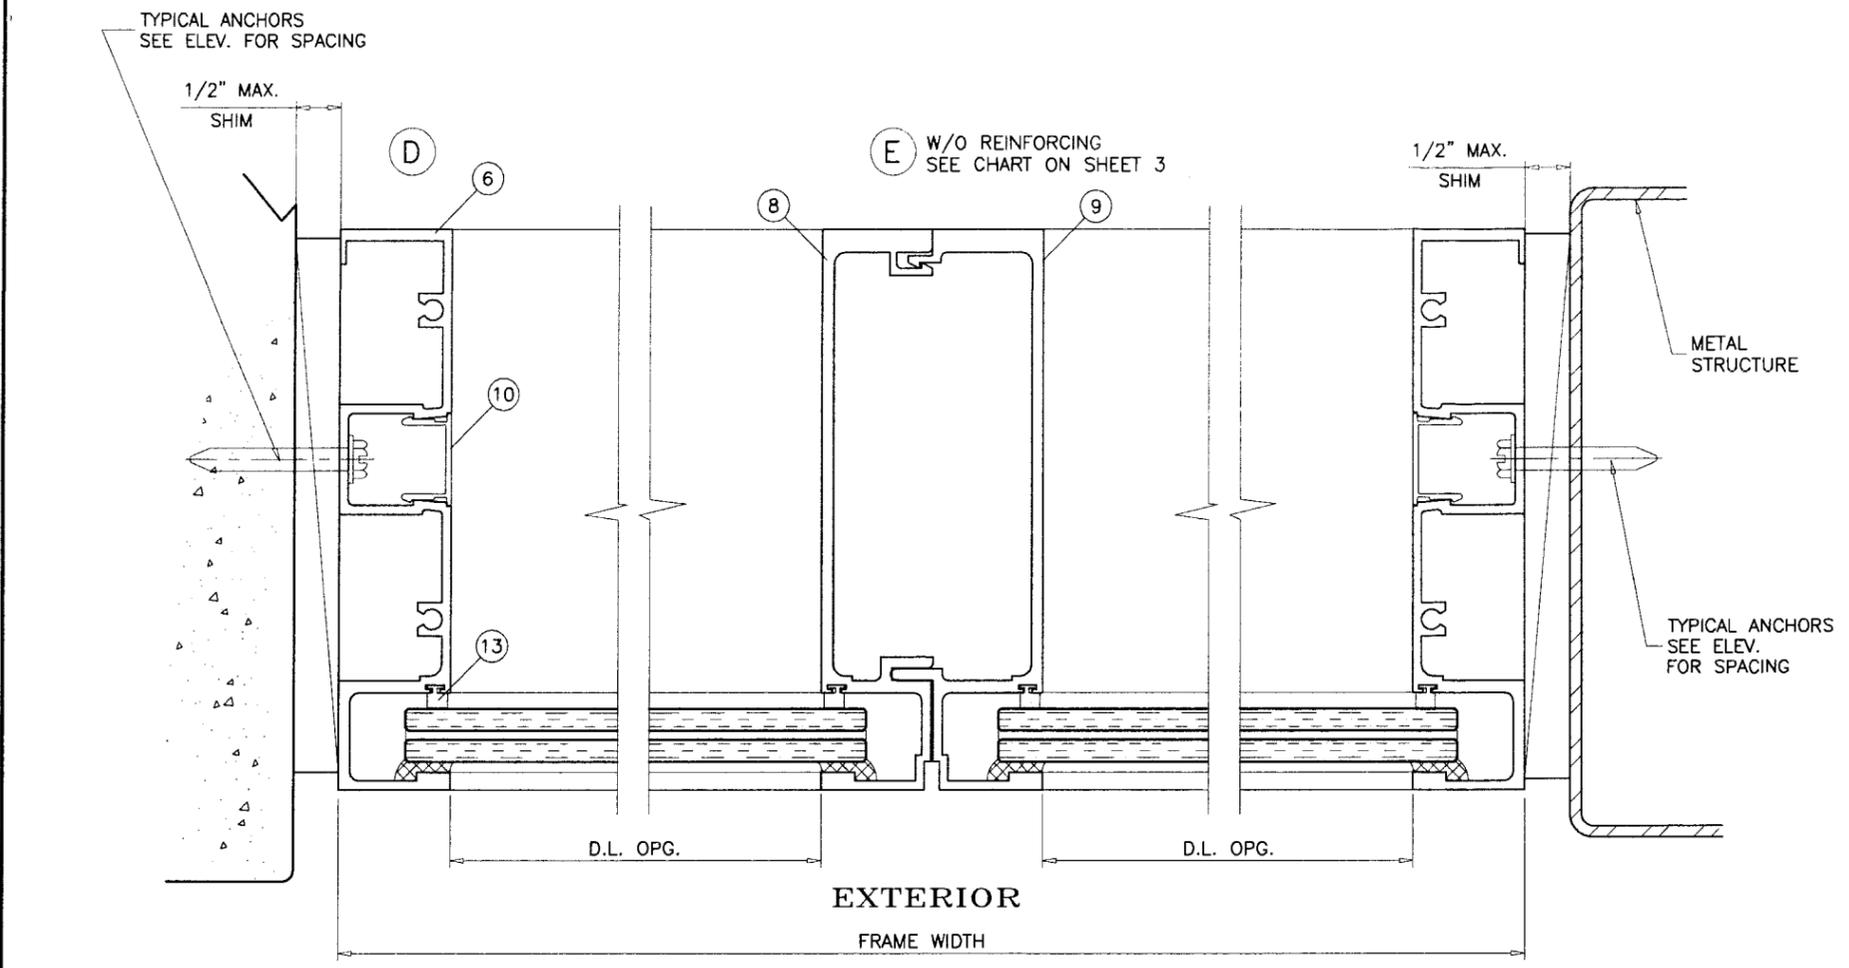


Engr. DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

JAN 26 2009


08-1021-08
 SEPT. 25, 2013
Manuel Perez

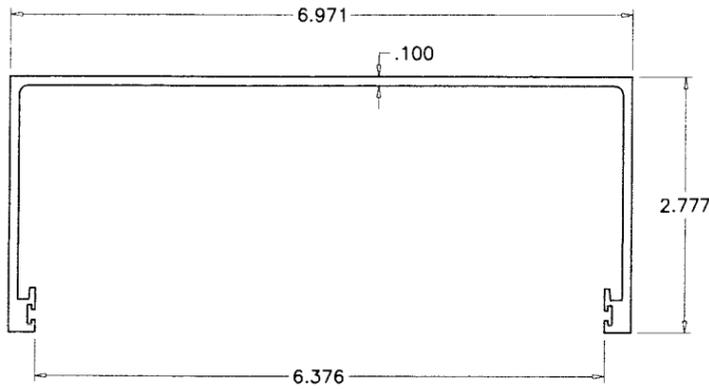


② HEAD RECEPTOR

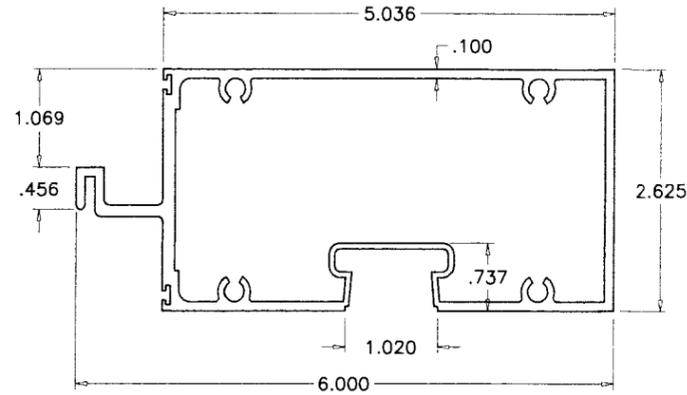


① FRAME HEAD/SILL/HORIZONTAL

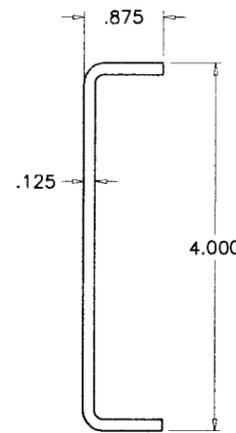


⑮ ALUM CHANNEL

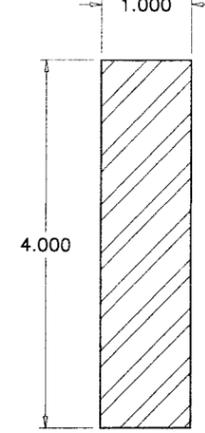


⑰ STEEL BAR

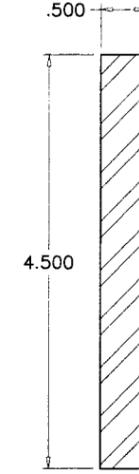


⑱ STEEL BAR

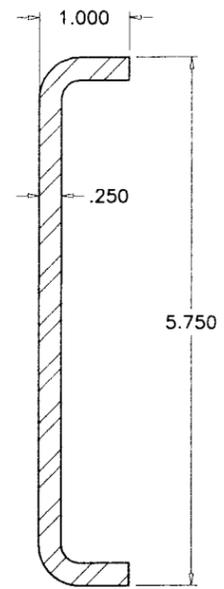


⑯ STEEL CHANNEL

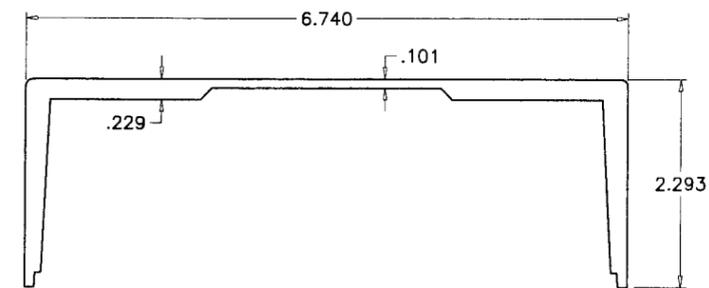


③ HEAD RECEPTOR REINFORCING

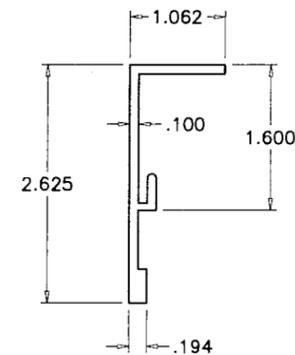


④ GLAZING BEAD HEAD/SILL




⑤ GLAZING BEAD HORIZONTAL

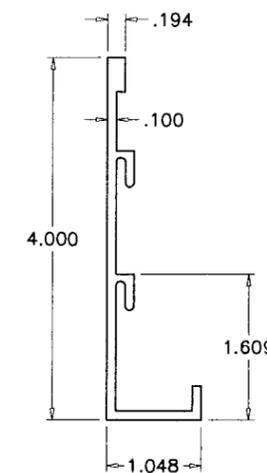


⑳ GLAZING BEAD ALT. SILL

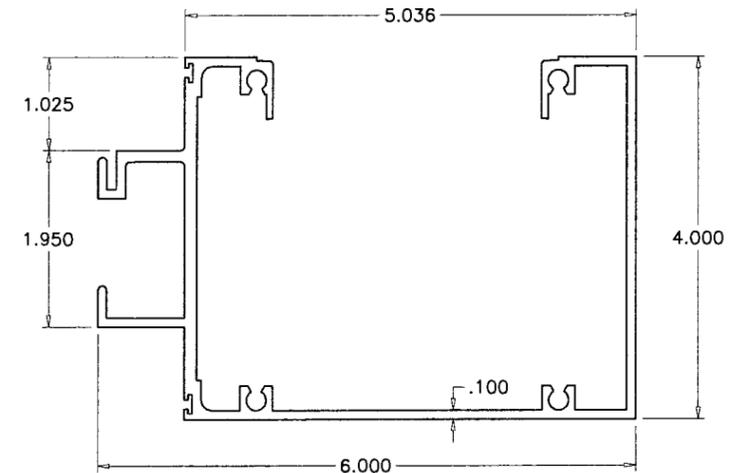


⑲ ALT. FRAME SILL

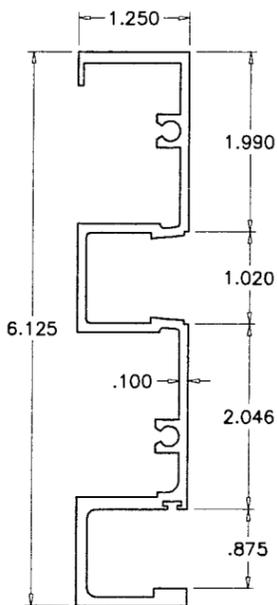


⑥ FRAME JAMB

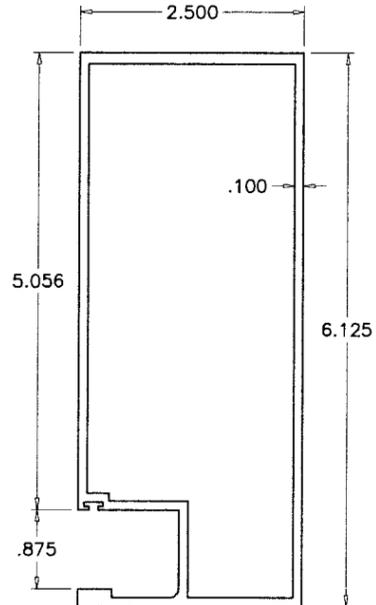


⑦ FRAME JAMB

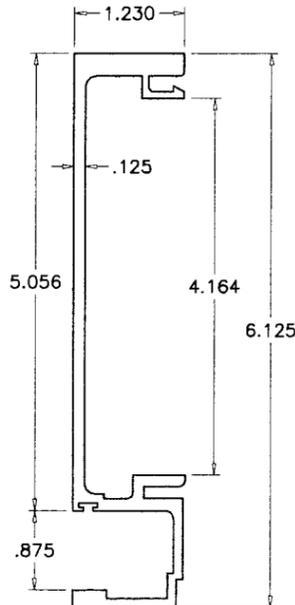


⑧ FEMALE MULLION

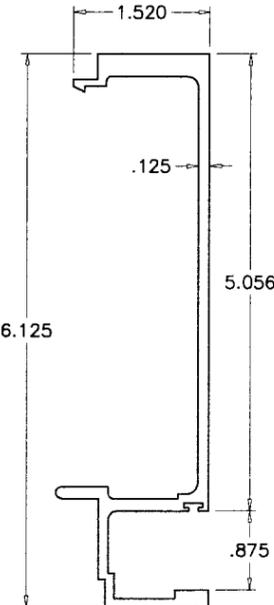

⑨ MALE MULLION

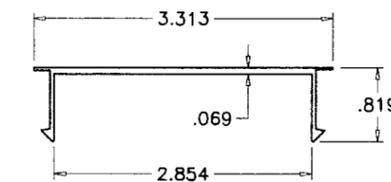

㉑ SNAP COVER ALT. SILL



⑩ SNAP COVER

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

JAN 26 2009

08-1021-08
SEPT 25, 2013
Manuel


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE/W07-11GWL

SERIES 101S ALUM WINDOW WALL SYSTEM (S.M.I.)
GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	description
A	09.24.08 NO CHANGE THIS SHEET
B	01.22.09 NO CHANGE THIS SHEET

date: 02-19-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no.
W07-11
sheet 7 of 8

ITEM No.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	101-001	AS REQD.	FRAME HEAD, SILL AND HORIZONTAL	6005-T5	-
2	100-019	AS REQD.	HEAD RECEPTOR	6063-T6	-
3	101-020	AS REQD.	HEAD RECEPTOR REINFORCING	6005-T5	-
4	101-007	AS REQD.	GLAZING BEAD HEAD/SILL	6005-T5	-
5	101-005	AS REQD.	GLAZING BEAD HORIZONTAL	6005-T5	-
6	101-002	AS REQD.	FRAME JAMB	6005-T5	-
7	101-008	AS REQD.	FRAME JAMB	6005-T5	-
8	101-004	AS REQD.	FEMALE MULLION	6005-T5	-
9	101-003	AS REQD.	MALE MULLION	6005-T5	-
10	101-006	AS REQD.	SNAP COVER	6005-T5	-
12	#14 X 1"	AS REQD.	FRAME ASSEMBLY SCREWS	ST/ST	PH PH SMS
13	7P-448	AS REQD.	GASKET	VINYL	PROTOTYPE PLASTICS
14	-	AS REQD.	SETTING BLOCKS, 1/2" X 1/2" X 6" LONG	EPDM	-
16	-	AS REQD.	JAMB REINFORCING CHANNEL	STEEL	-
17	-	AS REQD.	FEMALE MULLION REINFORCING CHANNEL	STEEL	-
18	-	AS REQD.	MALE MULLION REINFORCING CHANNEL	STEEL	-

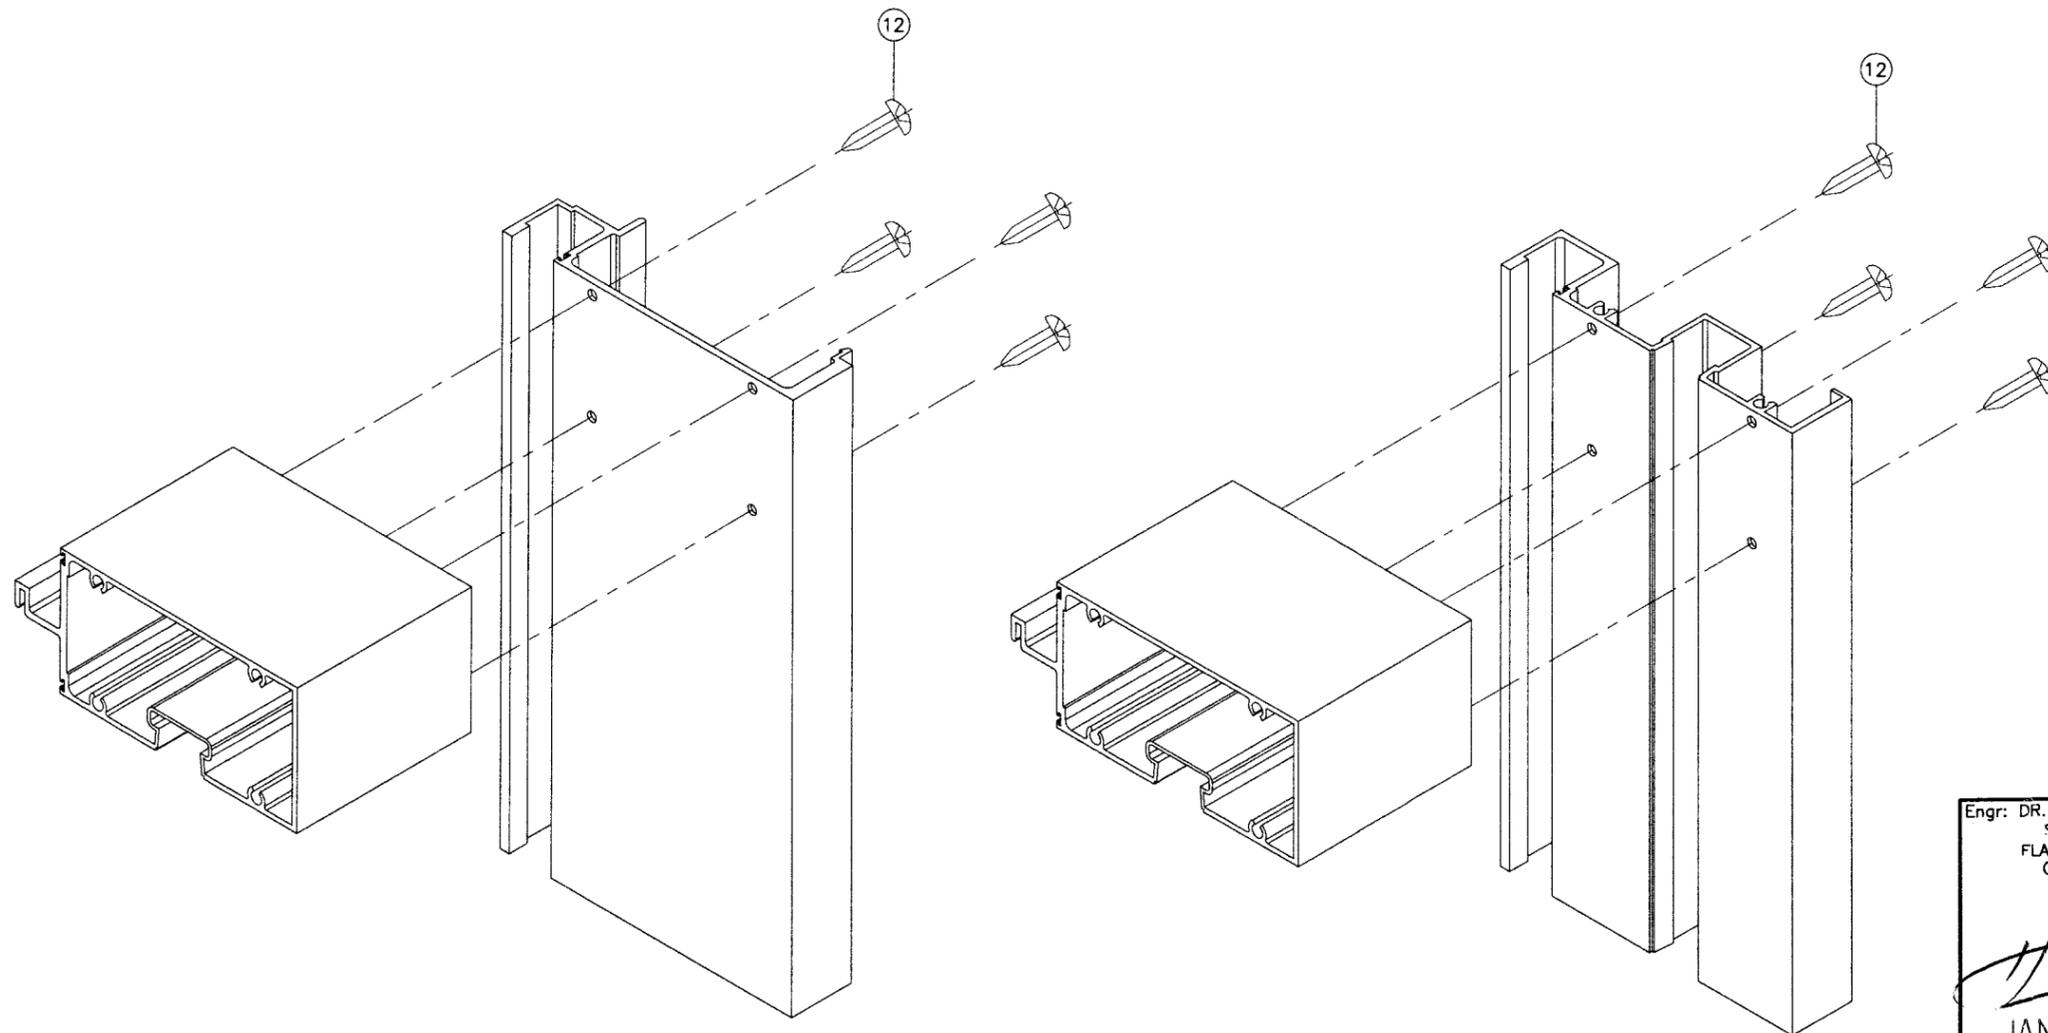

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

JAN 26 2009

08-1021.08
SEPT. 25, 2013
Mamun Bera

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE/W07-11CWL

SERIES 101S ALUM WINDOW WALL SYSTEM (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description
A	09.24.08		NO CHANGE THIS SHEET
B	01.22.09		NO CHANGE THIS SHEET

date: 02-19-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-11

sheet 8 of 8