



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

Eurotech Industries, Inc.
250 NE 32 Street
Fort Lauderdale, FL 33334

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Outswing Aluminum Casement Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W03-80**, titled “Aluminum Casement Window (L.M.I.)”, sheets 1 through 5 of 5, dated 09/05/03, with revision C dated 10/06/08, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and renews NOA # 06-1019.03** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 08-1112.08
 Expiration Date: February 05, 2014
 Approval Date: March 11, 2009
 Page 1

Eurotech Industries, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W03-80**, titled "Aluminum Casement Window (L.M.I.)", sheets 1 through 5 of 5, dated 09/05/03, with revision C dated 10/06/08, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of aluminum casement windows mulled side-by-side, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1315**, dated 05/12/03, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA # 06-1019.03)*
2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum casement windows mulled side-by-side, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1829**, dated 05/12/03, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA # 06-1019.03)*
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of a single aluminum casement window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1317**, dated 05/14/03, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA # 06-1019.03)*
4. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of single aluminum casement windows, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1822**, dated 01/23/04, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA # 06-1019.03)*

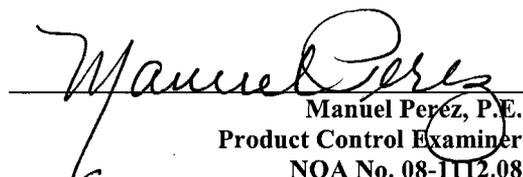
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 08-1112.08
Expiration Date: February 05, 2014
Approval Date: March 11, 2009

Eurotech Industries, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004 and 2007, prepared by Al-Farooq Corporation, dated 10/07/08, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300- 02/04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass ® Plus**" dated 01/03/08, expiring on 01/14/12.
2. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated May 04, 2006, expiring on May 21, 2011.

F. STATEMENTS




1. Statement letter of conformance, dated October 3, 2008, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated October 3, 2008, signed and sealed by Humayoun Farooq, P.E.

G. OTHER

1. Notice of Acceptance No. **06-1019.03**, issued to Eurotech Industries, Inc. for their Aluminum Casement Window – L.M.I., approved on 01/11/07 and expiring on 02/05/09.

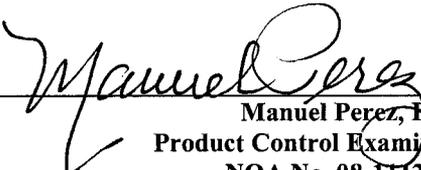
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-1112.08

Expiration Date: February 05, 2014
Approval Date: March 11, 2009

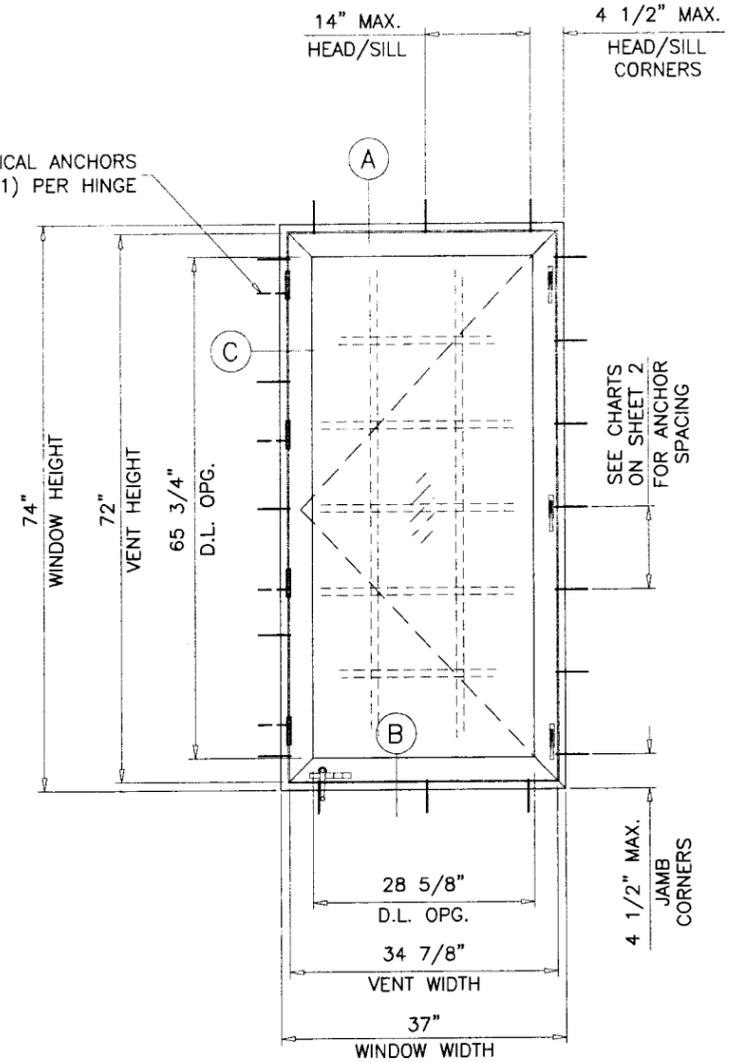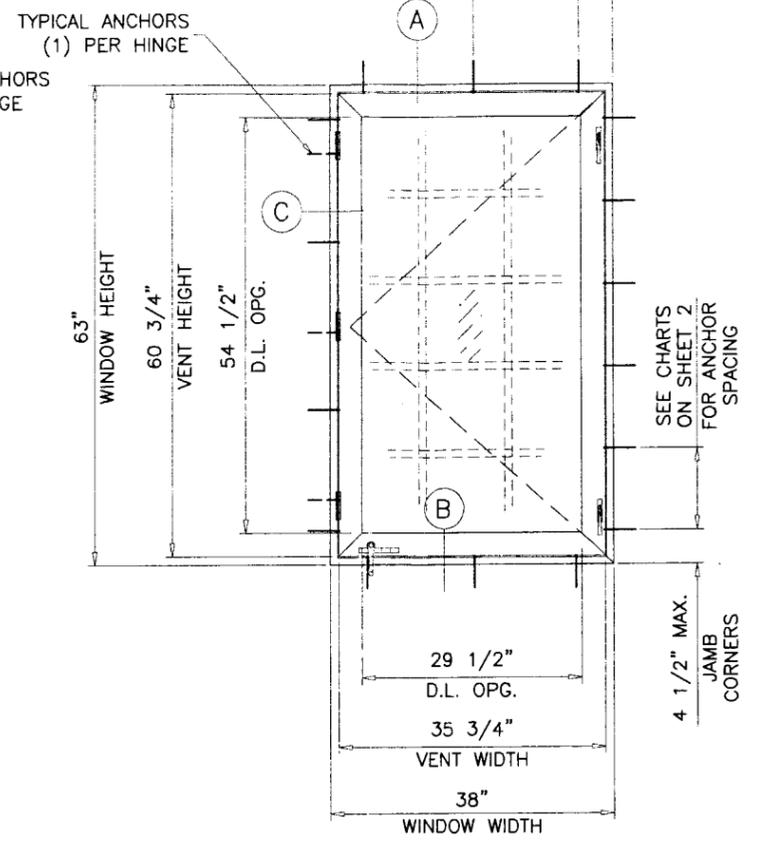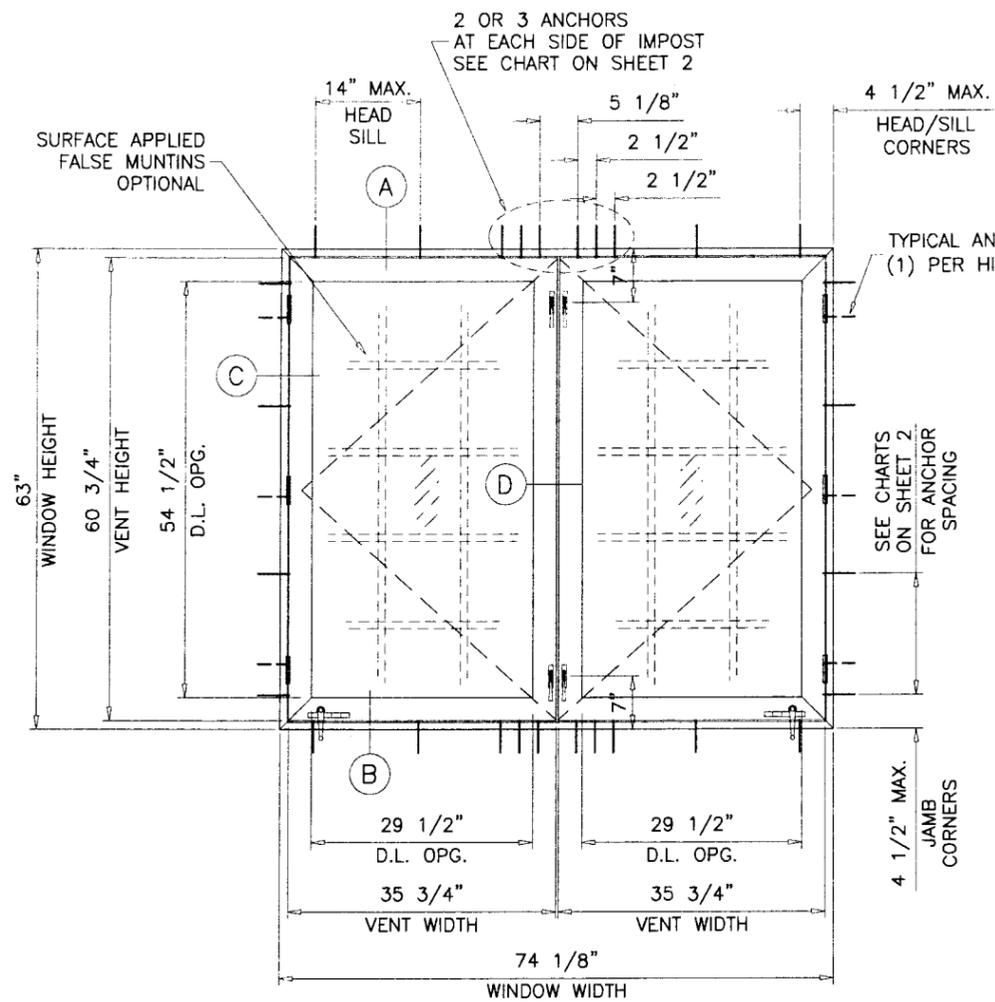


TYPICAL ELEVATIONS


ALUMINUM CASEMENT WINDOW (IMPACT)

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE VENT WINDOWS OR DUAL VENT WINDOWS USING INTEGRAL IMPOST.



ALSO SIDE BY SIDE COMBINATIONS OF CASEMENT/CASEMENT OF TWO OR MORE WINDOWS USING APPROVED MULLIONS.

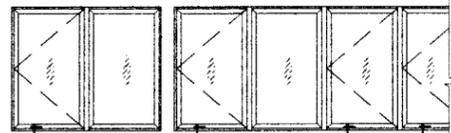

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

WINDOWS GLAZED WITH LAMINATED GLASS RATED FOR LARGE MISSILE IMPACT AND DO NOT REQUIRE SHUTTERS.

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538
OCT 10 2008

PROVIDED REVISIONS
08-1112.08
FEB 5, 2014
Mamuel Perez

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-80EWD

ALUMINUM CASEMENT WINDOW (L.M.I.)
EUROTECH WINDOWS & DOORS
250 N.E. 32nd STREET
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 FAX. (954) 630-0217


no	date	by	description
A	01.10.04		GLASS OPTION ADDED
B	05.09.06		UPDATED FOR 2004 FBC
C	10.06.08		UPDATED FOR 2007 FBC

date: 09-05-03
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:
drawing no.
W03-80
sheet 1 of 5

DESIGN LOAD CAPACITY - PSF FOR (X) SIZES									
WINDOW DIMS.		GLASS TYPE 'A'				GLASS TYPE 'B'			
		JAMB ANCHORS AT 16" O.C.		JAMB ANCHORS AT 8" O.C.		JAMB ANCHORS AT 16" O.C.		JAMB ANCHORS AT 8" O.C.	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
26-1/2"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
37"		75.0	75.0	75.0	75.0	75.0	85.3	75.0	90.0
19-1/8"	38-3/8"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
26-1/2"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
37"		75.0	75.0	75.0	75.0	75.0	77.1	75.0	90.0
19-1/8"	50-5/8"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
26-1/2"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
37"		73.0	73.0	75.0	75.0	73.0	73.0	75.0	90.0
19-1/8"	63"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
26-1/2"		75.0	75.0	75.0	75.0	75.0	81.9	75.0	90.0
37"		58.7	58.7	75.0	75.0	58.7	58.7	75.0	90.0
19-1/8"	74"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
26-1/2"		75.0	75.0	75.0	75.0	75.0	83.7	75.0	90.0
37"		-	-	-	-	60.0	60.0	75.0	90.0
18"	24"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
24"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
30"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
36"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
18"	36"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
24"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
30"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
36"		75.0	75.0	75.0	75.0	75.0	84.4	75.0	90.0
18"	48"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
24"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
30"		75.0	75.0	75.0	75.0	75.0	76.0	75.0	90.0
36"		63.3	63.3	75.0	75.0	63.3	63.3	75.0	90.0
18"	60"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
24"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
30"		75.0	75.0	75.0	75.0	75.0	76.0	75.0	90.0
36"		63.3	63.3	75.0	75.0	63.3	63.3	75.0	90.0
18"	72"	75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
24"		75.0	75.0	75.0	75.0	75.0	90.0	75.0	90.0
30"		75.0	75.0	75.0	75.0	75.0	76.0	75.0	90.0
36"		-	-	-	-	63.3	63.3	75.0	90.0

DESIGN LOAD CAPACITY - PSF FOR (XX) SIZES					
WINDOW DIMS.		GLASS TYPE 'A' & 'B'			
		JAMB ANCHORS AT 16" O.C.			
		2 ANCHOR AT EACH SIDE OF IMPOST		3 ANCHORS AT EACH SIDE OF IMPOST	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26"	75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
53-1/8"		75.0	75.0	75.0	75.0
74"		75.0	75.0	75.0	75.0
26-1/2"	38-3/8"	75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
53-1/8"		75.0	75.0	75.0	75.0
74"		75.0	75.0	75.0	75.0
26-1/2"	50-5/8"	75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
53-1/8"		75.0	75.0	75.0	75.0
74"		65.7	65.7	75.0	75.0
26-1/2"	63"	75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
53-1/8"		73.6	73.6	75.0	75.0
74"		52.8	52.8	61.0	61.0
24"	24"	75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
60"		75.0	75.0	75.0	75.0
72"	75.0	75.0	75.0	75.0	
24"	36"	75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
60"		75.0	75.0	75.0	75.0
72"	75.0	75.0	75.0	75.0	
24"	48"	75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
60"		75.0	75.0	75.0	75.0
72"	71.3	71.3	75.0	75.0	
24"	60"	75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
60"		68.4	68.4	75.0	75.0
72"	57.0	57.0	72.6	72.6	

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

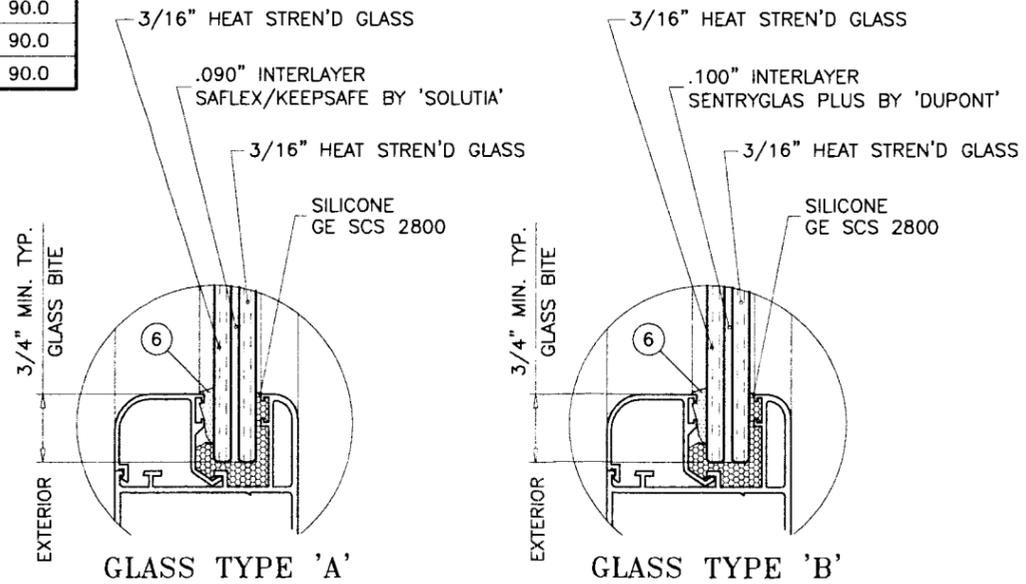

GLAZING OPTIONS

Engr: DR. HUMAYOIN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538
OCT 10 2008

PRODUCT REVISED
to comply with the Florida
Building Code
Approved by
08-1112-08
FEB. 3, 2014
By Manuel Perez
Florida State Product Control
Division

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-80EWD

ALUMINUM CASEMENT WINDOW (L.M.I.)
EUROTECH WINDOWS & DOORS
250 N.E. 32nd STREET
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 FAX. (954) 630-0217


no	date	description
A	01.10.04	GLASS OPTION ADDED
B	05.09.06	UPDATED FOR 2004 FBC
C	10.06.08	UPDATED FOR 2007 FBC

revisions:

date: 09-05-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-80

sheet 2 of 5

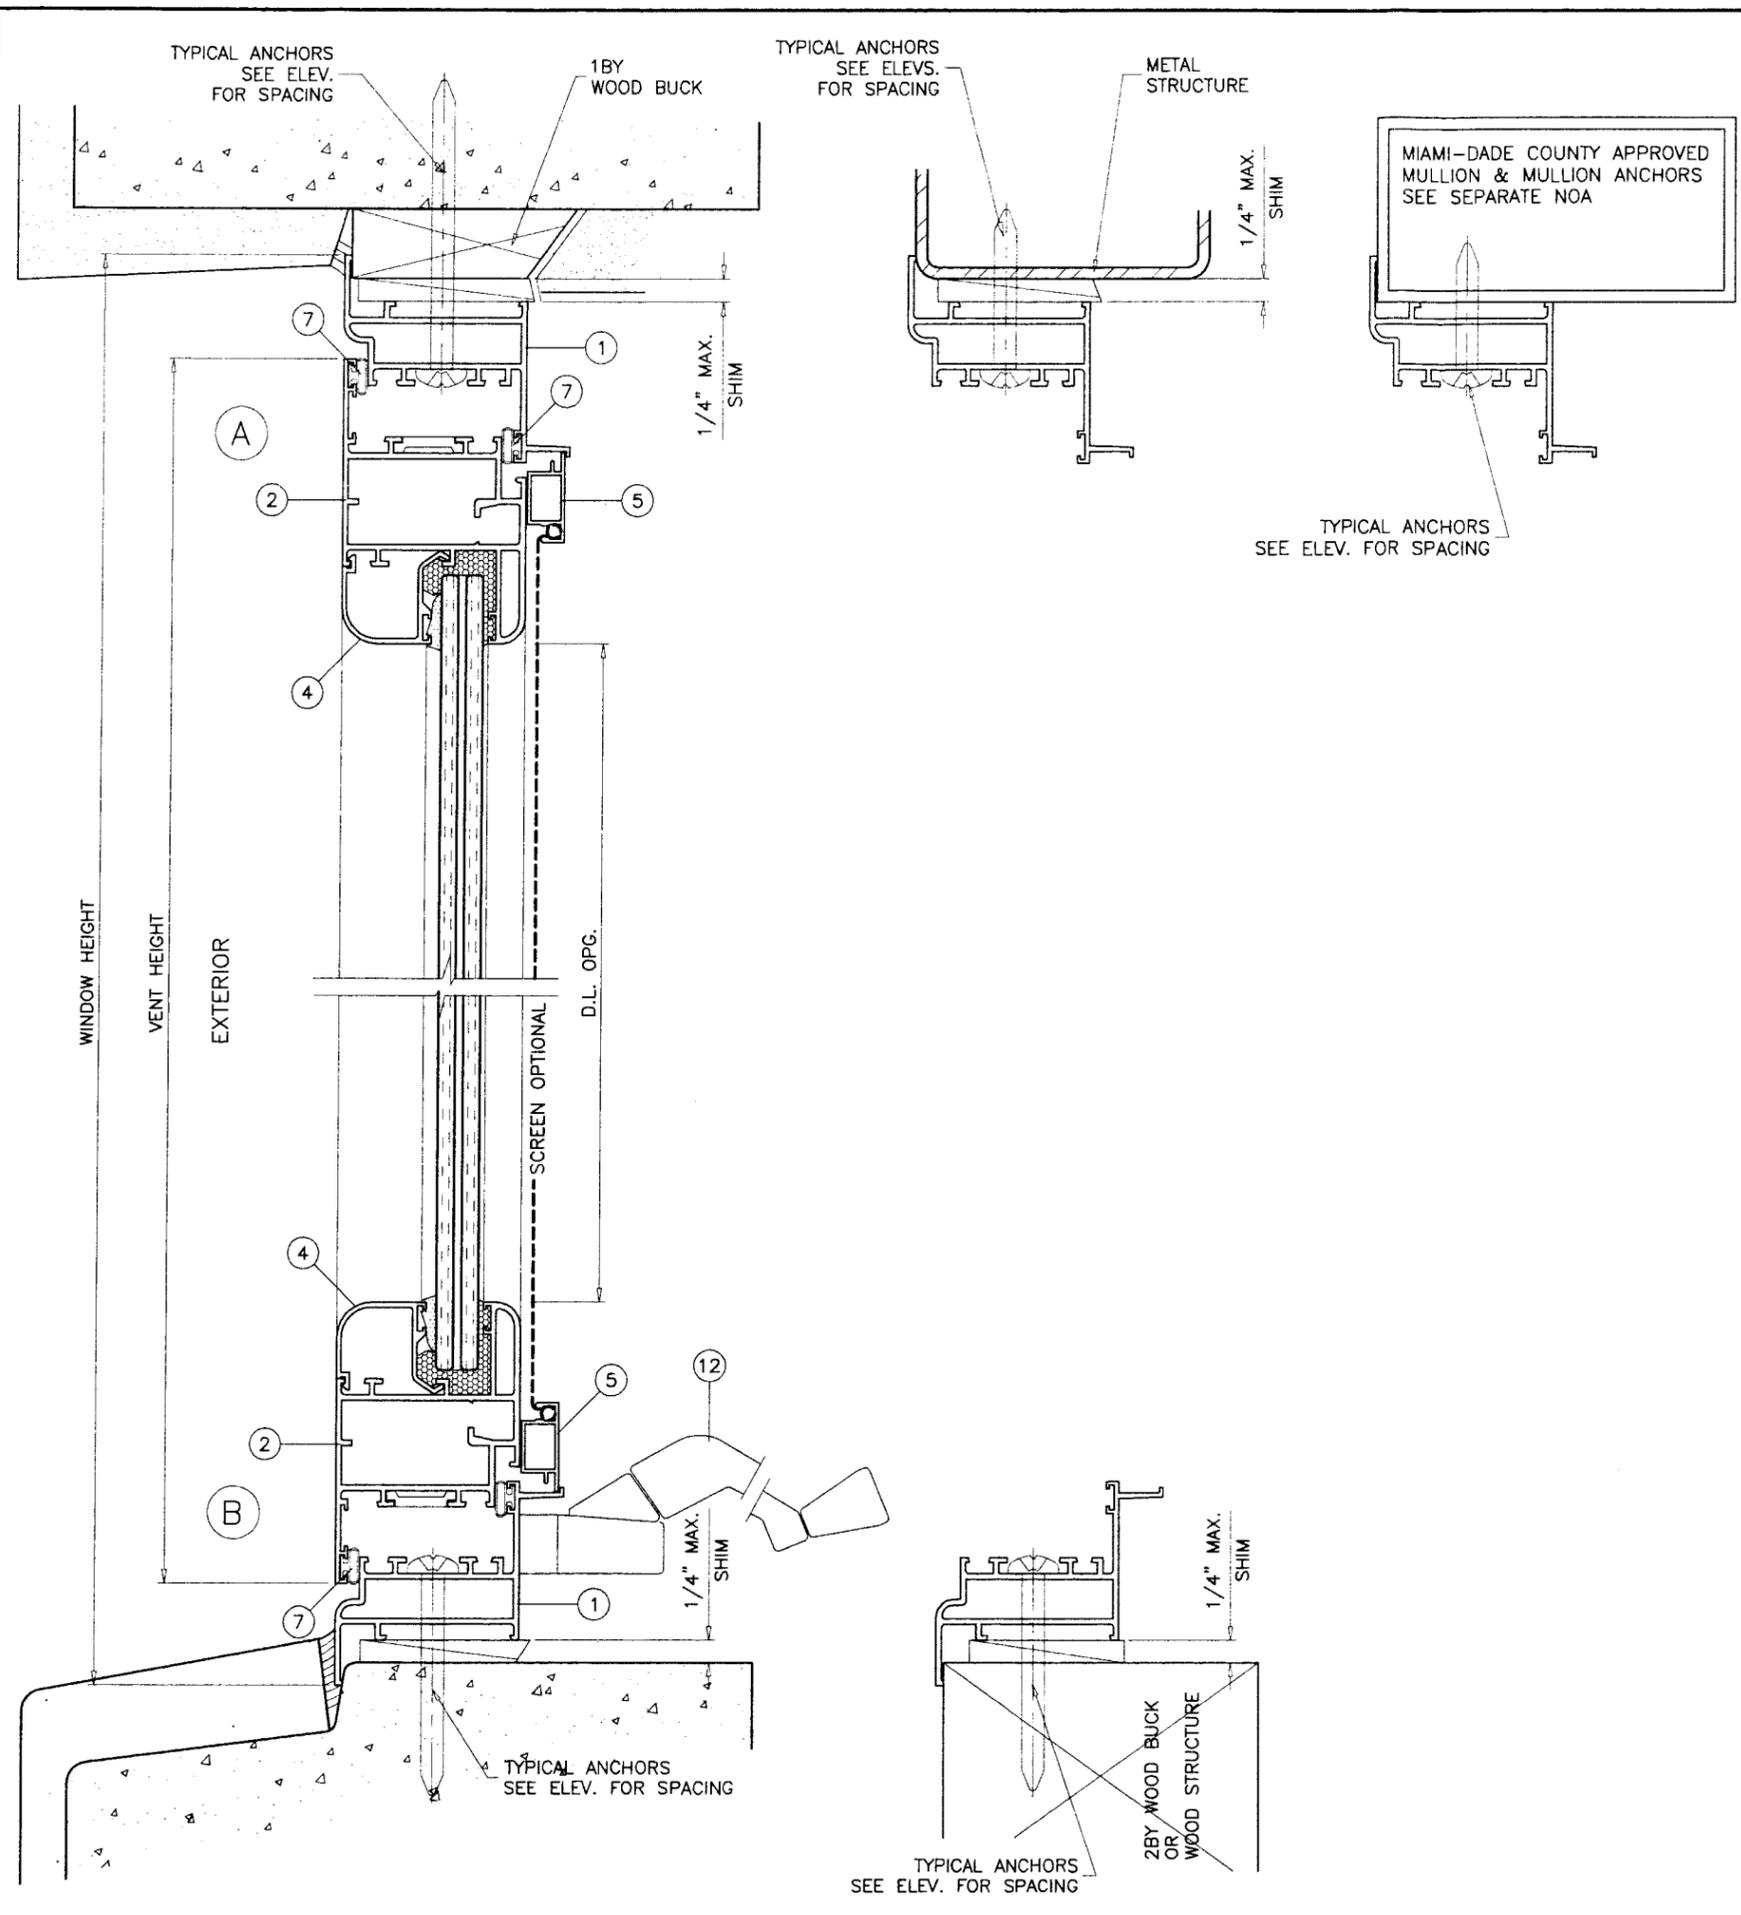

WOOD BUCKS AND METAL STRUCTURE NOT BY EUROTECH MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
1/4" TEKS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE f'c = 3000 PSI MIN.
 MASONRY f'm = 1500 PSI MIN.

SEALANTS:
 ALL FRAME AND VENT CORNERS AND INSTALLATION SCREWS
 SEALED WITH CLEAR/ALUMINUM COLORED SILICONE.

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 OCT 10 2008

PRODUCT REVISED
 AS COMPLYING WITH THE FLORIDA
 BUILDING CODE
 08-1112-08
 FEB. 3, 2014
 Manuel Perez


AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W03-80EWD

ALUMINUM CASEMENT WINDOW (L.M.I.)
EUROTECH WINDOWS & DOORS
 250 N.E. 32nd STREET
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 FAX. (954) 630-0217



no	date	by	description
A	01.10.04		NO CHANGE THIS SHEET
B	05.09.06		UPDATED FOR 2004 FBC
C	10.06.08		UPDATED FOR 2007 FBC

revisions:
 date: 09-05-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W03-80
 sheet 3 of 5

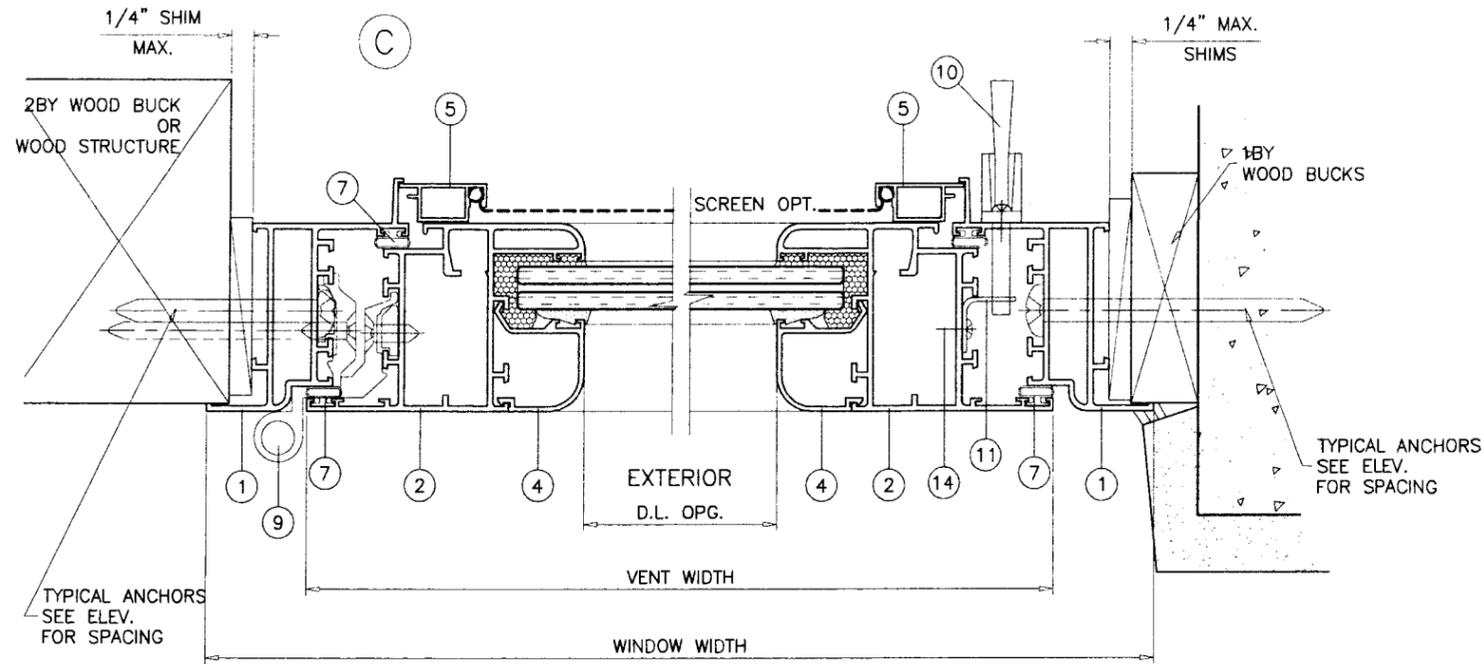

SINGLE VENT WINDOWS

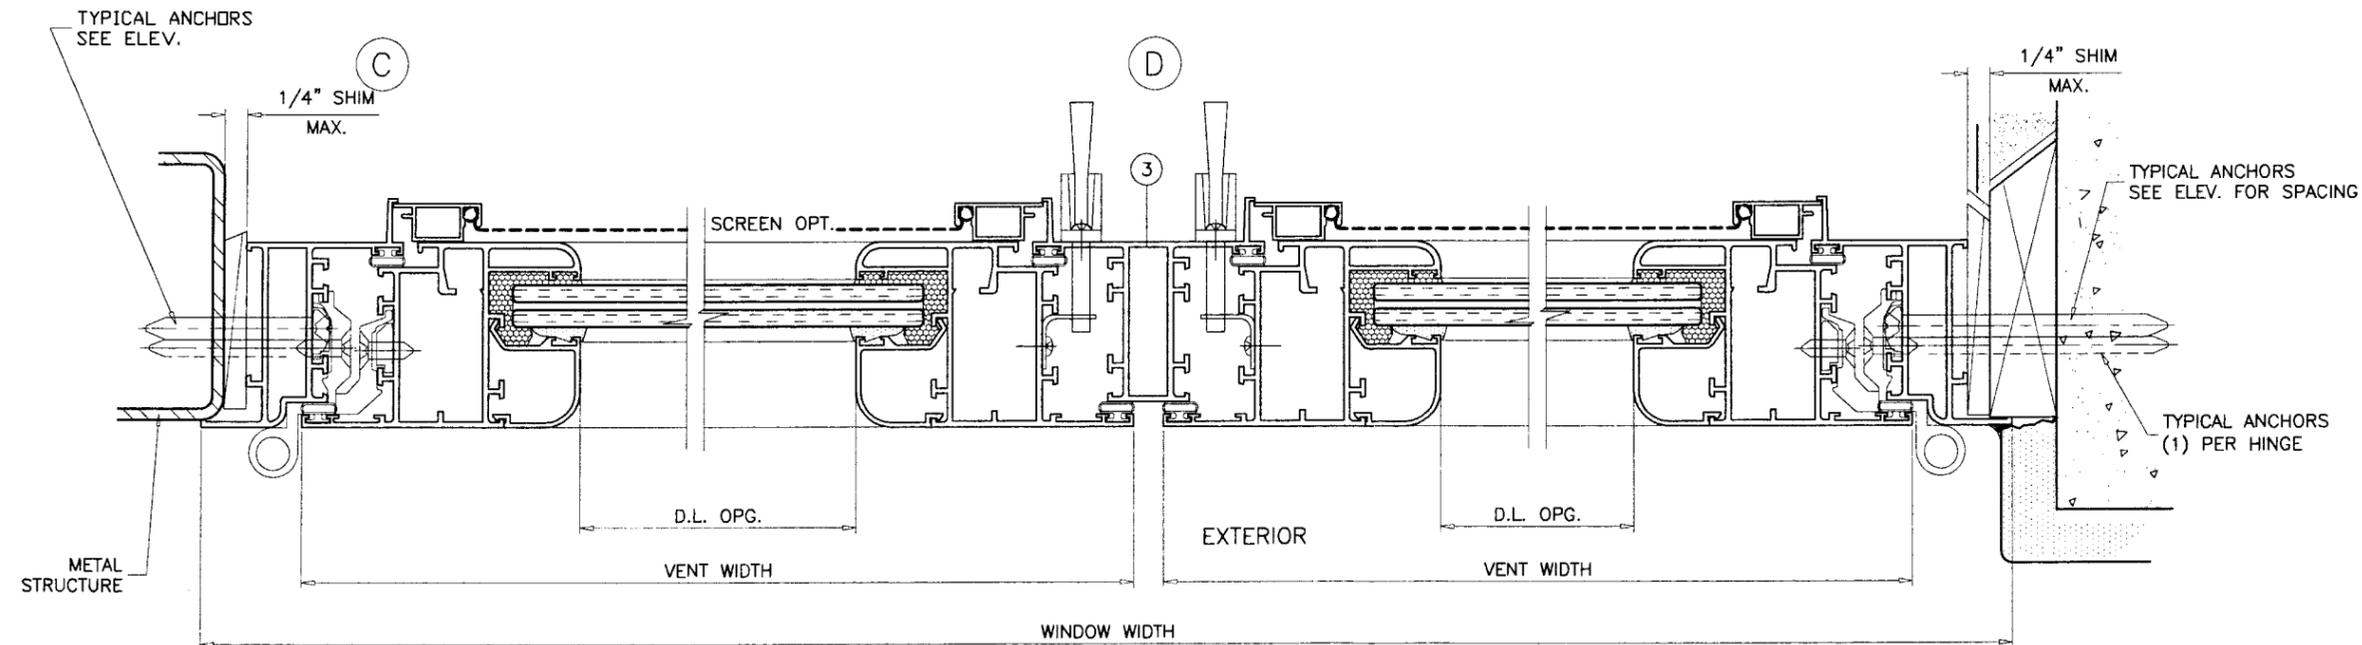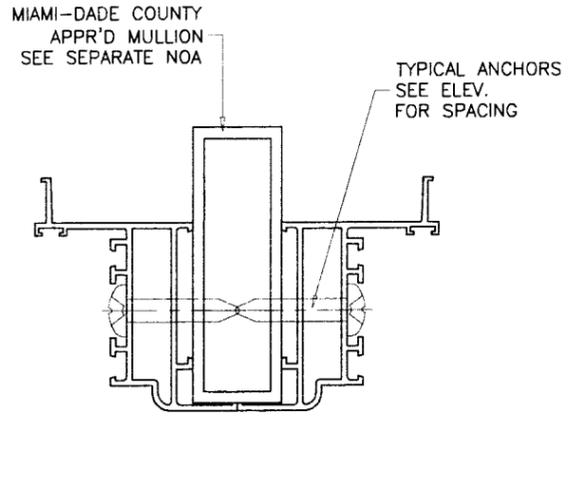

DUAL VENT WINDOWS

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

OCT 10 2008

08-1112.08
FEB. 5, 2014

Manuel Perez

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-80EWD

ALUMINUM CASEMENT WINDOW (L.M.I.)

EUROTECH WINDOWS & DOORS
250 N.E. 32nd STREET
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 FAX. (954) 630-0217


no	date	by	description
A	01.10.04		NO CHANGE THIS SHEET
B	05.09.06		UPDATED FOR 2004 FBC
C	10.06.08		UPDATED FOR 2007 FBC

date: 09-05-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


revisions:

drawing no.
W03-80


sheet 4 of 5

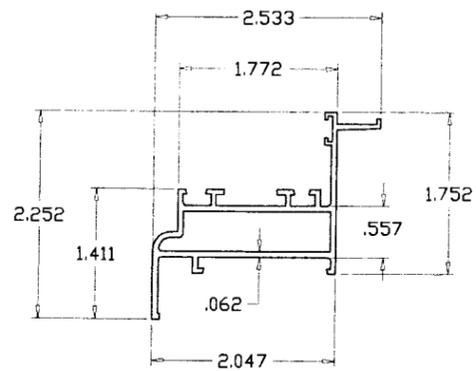


FRAME

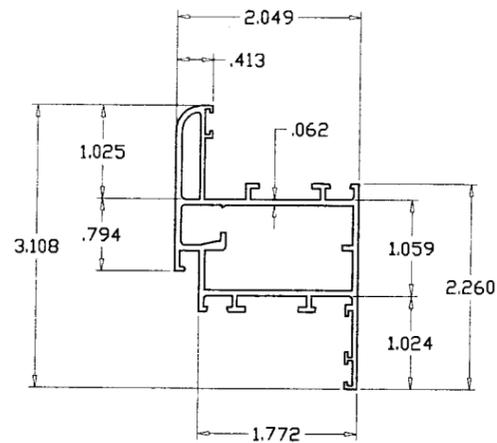


VENT

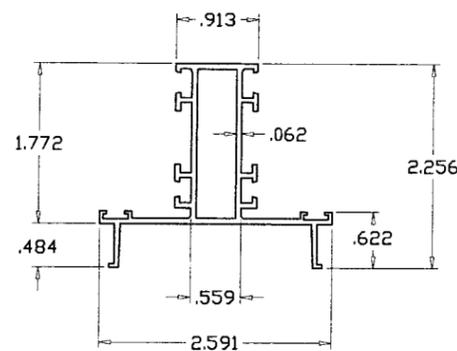


IMPOST

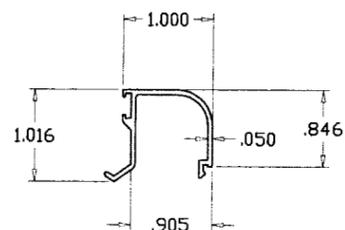


GLAZING BEAD

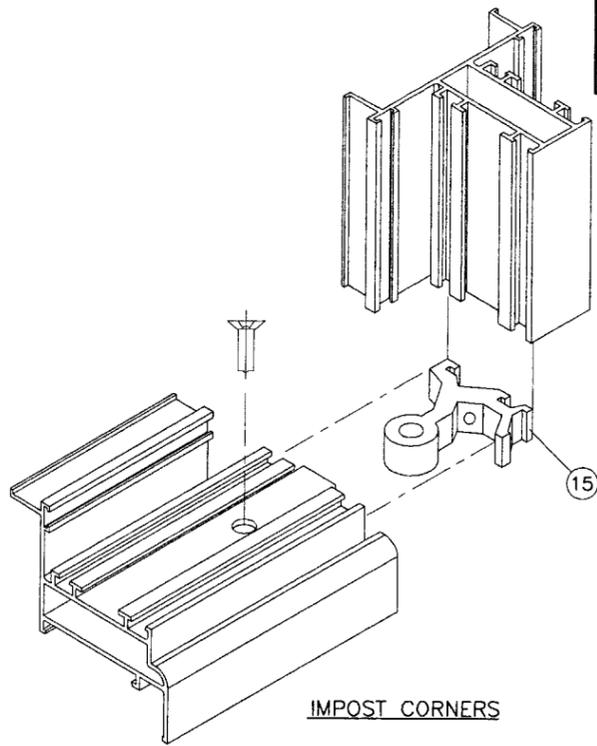


IMPOST CORNERS

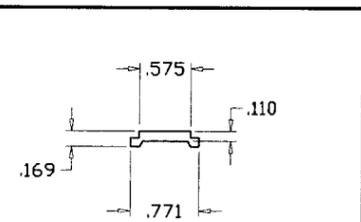


WINDOW SCREEN



ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ER001	4	WINDOW FRAME	6063-T6	-
2	ER008	4	VENT	6063-T6	-
3	ER003	1	CENTER POST	6063-T6	-
4	ER002	AS REQD.	GLAZING BEAD	6063-T6	-
5	ER004	OPTIONAL	WINDOW SCREEN	6063-T6	-
6	2801	AS REQD.	WEDGE GASKET	-	-
7	-	AS REQD.	FRAME WEATHERSTRIPPING	VINYL	-
8	-	-	-	-	-
9	0150X	3/ VENT	HINGES	-	GIESSE, ATTACHED W/ (3) #12 X 7/16" MS
10	24.25.32.300	2/ VENT	LEVER TYPE FACE MOUNT LOCK, 7" FROM TOP & BOTTOM	STEEL	TRUTH, ATTACHED W/ (2) #8 X 3/8" PH SMS
11	-	2/ VENT	LOCK KEEPERS, AT VENT STILE FACING LOCK	STEEL	ATTACHED W/ (2) #8 X 3/4" PH SDS
12	10579.32	1	ROTO OPERATOR	STEEL	TRUTH, ATTACHED W/ (2) #10 X 1/2" SS SMS
13	1103	1/ CORNER	CLIP-ON CORNER JOINT	ALUMINUM	GIESSE
14	-	2/ LOCK	LOCK INSTALLATION SCREWS	-	#8 X 3/8" PH SMS
15	485	AS REQD.	T-POST CONNECTOR	-	GIESSE

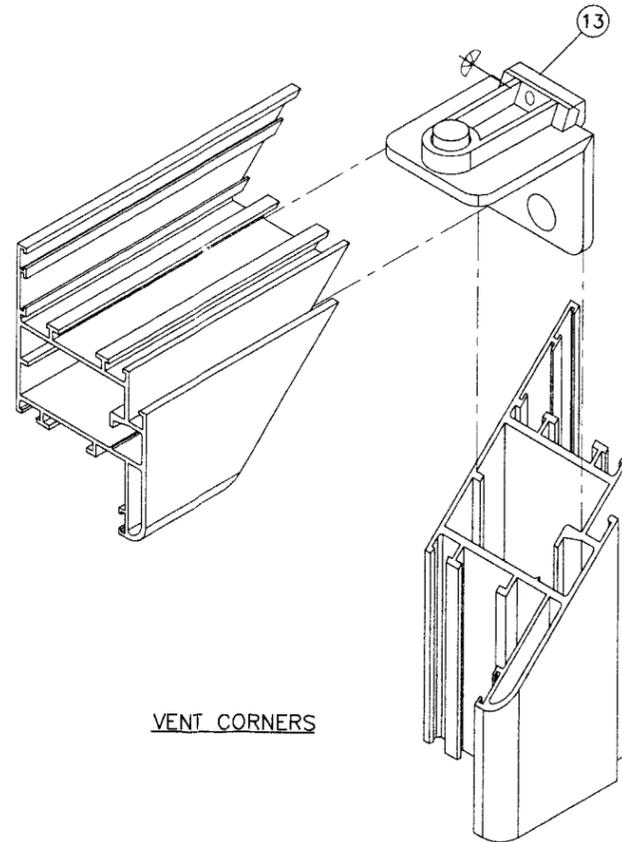

VENT CORNERS

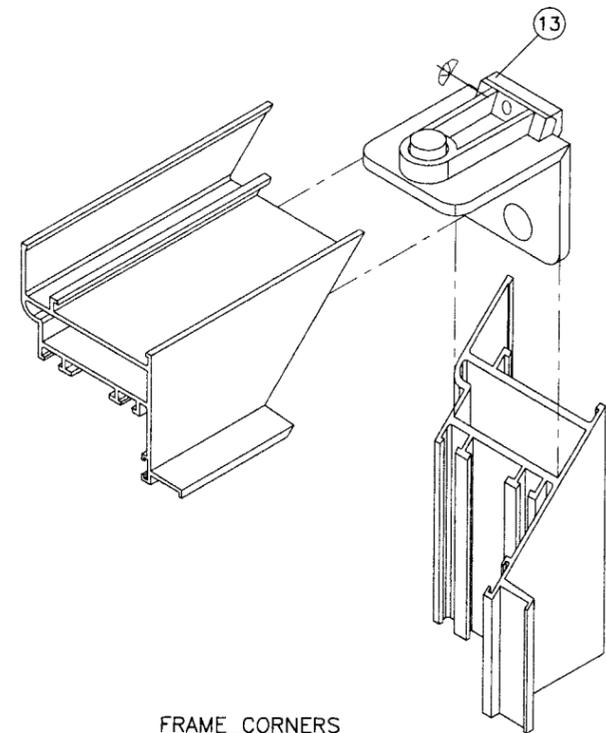

FRAME CORNERS

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

10 OCT 10 2008

PRODUCT REVISED
as complying with the Florida
Building Code
08-1112.08
FEB. 5, 2014
Manuel Perez

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
12335 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-80EWD

ALUMINUM CASEMENT WINDOW (L.M.I.)
EUROTECH WINDOWS & DOORS
250 N.E. 32nd STREET
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 FAX. (954) 630-0217

no	date	description
A	01.10.04	NO CHANGE THIS SHEET
B	05.09.06	NO CHANGE THIS SHEET
C	10.06.08	UPDATED FOR 2007 FBC

revisions:
date: 09-05-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-80
sheet 5 of 5