



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

TRACO Security Windows & Doors, Inc.
71 Progress Avenue
Cranberry Township, PA 16166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 8000 Aluminum Sliding Glass Door – S. M. I.

APPROVAL DOCUMENT: Drawing No.02-TRA-1045, titled “Series 8000 Aluminum Sliding Glass Door”, sheets 1 through 6 of 6, prepared by Engineering Express, dated 03/27/2009, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

Limitation: 1. Doors to meet the egress requirements as applicable, per FBC.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises & supersedes NOA # 06-1121.13 (05-0725.08) and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**



NOA No 08-1114.15
Expiration Date: November 09, 2012
Approval Date: May 20, 2009
Page 1

7/2/09

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (transferred from file # 06-1121.13)

1. Manufacturer's die drawings and sections.
2. Drawing No. **02-TRA-1045**, titled "Series 8000 Aluminum Sliding Glass Door", sheets 1 through 6 of 6, prepared by Engineering Express, dated 03/27/2009, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS (transferred from file # 06-1121.13)

1. Additional Reference Test reports on
 - 1) Small Missile Impact Test per FBC, TAS 201-94
 - 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of a SGD, prepared by Farabaugh Engineering & Testing, Inc., Test Report No. T236-06, dated 10/23/06, signed and sealed by Daneil G. Farabaugh, P.E.
2. Test reports (transferred from file # **06-1121.13**) Original test conducted per SFBC, PA 202-94, now termed as FBC, TAS 202-94
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 6) Forced Entry Test, per FBC and TAS 202-94along with installation diagram and marked-up drawings of an aluminum sliding glass door prepared by American Test Lab of South Florida, No. **ATL-0608.03-00**, dated 06/21/2000, signed and sealed by William R. Mehner, P.E.
3. Test reports on
 - 1) Small Missile Impact Test per FBC, TAS 201-94
 - 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with installation diagram and marked-up drawings of an aluminum sliding glass door prepared by Fenestration Testing Laboratory, Inc., No. **FTL-2296**, dated July 19, 1999, signed and sealed by Jose D. Mitrani, P.E. and Gilbert Diamond, P.E. (transferred from file # **06-1121.13**) Original test conducted per SFBC, PA 201/203-94, now termed as FBC 201/203-94.

C. CALCULATIONS

1. Anchor Calculations and structural analysis complying w/ FBC 2007, dated 10/28/08 and last revised on 03/27/09, prepared, signed and sealed by Frank Bennardo, P.E.
2. Glazing compliew w/ ASTME-1300-04

D. QUALITY ASSURANCE

1. Miami-Dade County Building Code Compliance Office.

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. 06-0216.06 issued to Solutia, Inc. for "Saflex III interlayer" expiring on 5/21/11.

F. STATEMENTS

1. Statement letter of conformance, dated 10/28/08, signed and sealed by Frank Bennardo, P.E.
2. Laboratory compliance letters as part of above referenced test reports.

G. OTHER

1. This NOA **revises & supersedes** NOA # **06-1112.13 (05-0725.08)**, expiring 11/09/12.




Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 08-1114.15
Expiration Date: November 09, 2012
Approval Date: May 20, 2009

SERIES 8000 ALUMINUM SLIDING GLASS DOOR

SMALL MISSILE IMPACT RESISTANT

FRANK L. BENNARDO, P.E.
#PE0046549

03/27/2009

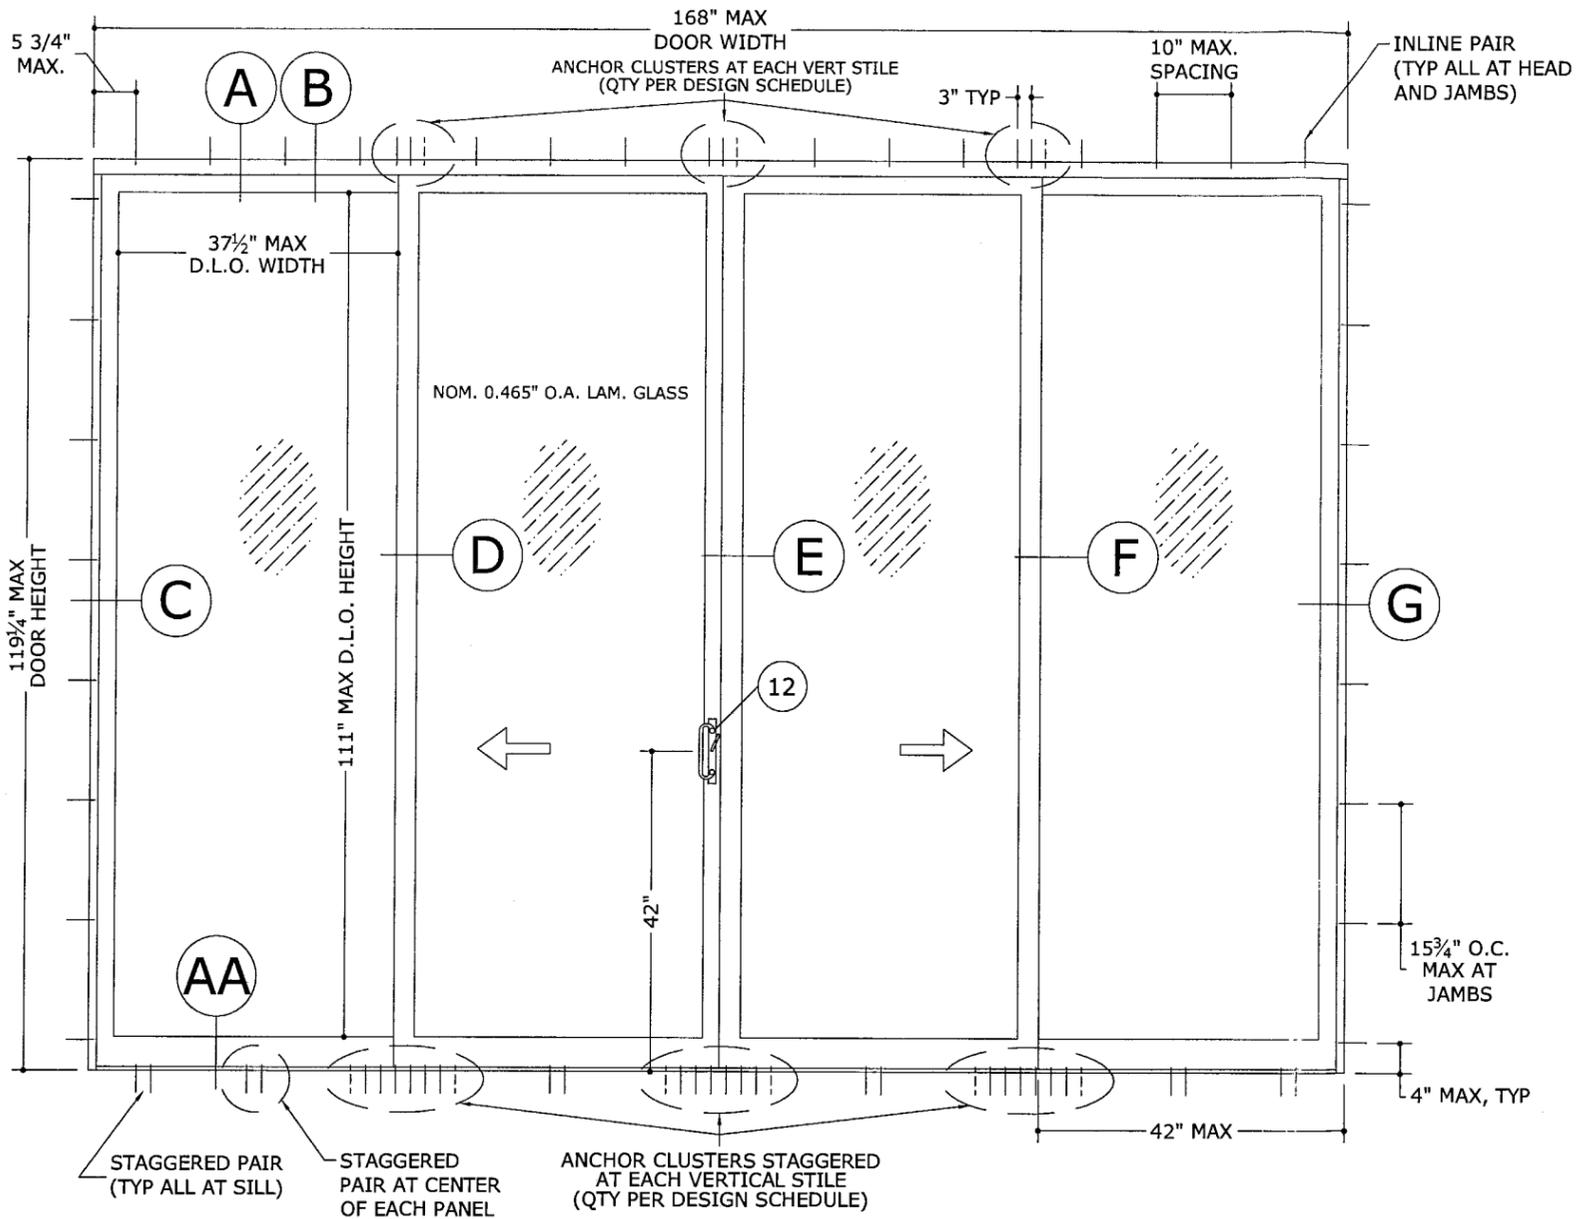


GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE, FOR USE WITHIN THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201 / 202 / 203 & ASTM E1300-98 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT OUTSIDE THE HVHZ. WITHIN THE HVHZ, DEVIATION FROM THIS NOA REQUIRES A ONE TIME NOA FROM THE MIAMI-DADE COUNTY BUILDING CODE COMPLIANCE OFFICE.
5. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
6. PRODUCT SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE LABEL PER DOOR CONTAINING THE FOLLOWING:
TRACO
JOHNSON CITY, TN
7. DOORS PANELS GLAZED WITH NOMINAL 0.465" O.A. LAMINATED GLASS (SEE DETAIL SHEET 2) ARE SMALL MISSILE IMPACT APPROVED AND SHALL BE PROTECTED WITH MIAMI-DADE COUNTY IMPACT RESISTANT SHUTTERS FOR INSTALLATIONS UP TO 30 FEET ABOVE GRADE. NO PROTECTION REQUIRED FOR INSTALLATIONS ABOVE 30 FEET ABOVE GRADE.
8. DOORS MAY BE INSTALLED WITH OR WITHOUT HEAD RECEPTORS.
9. DOORS MAY HAVE TWO, THREE OR FOUR PANELS IN OX, XO, OXO OR OXXO CONFIGURATIONS.
10. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI.
11. PLASTIC COMPONENTS USED WITHIN THE HVHZ MUST MEET ALL APPLICABLE FIRE/SMOKE/UV PERFORMANCE REQUIREMENTS AS SET FORTH IN THE ABOVE-NOTED BUILDING CODE.
12. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.

TYPICAL ELEVATION

MAX D.L.O WIDTH = PANEL WIDTH - 6.25"
MAX D.L.O HEIGHT = PANEL HEIGHT - 7.5"

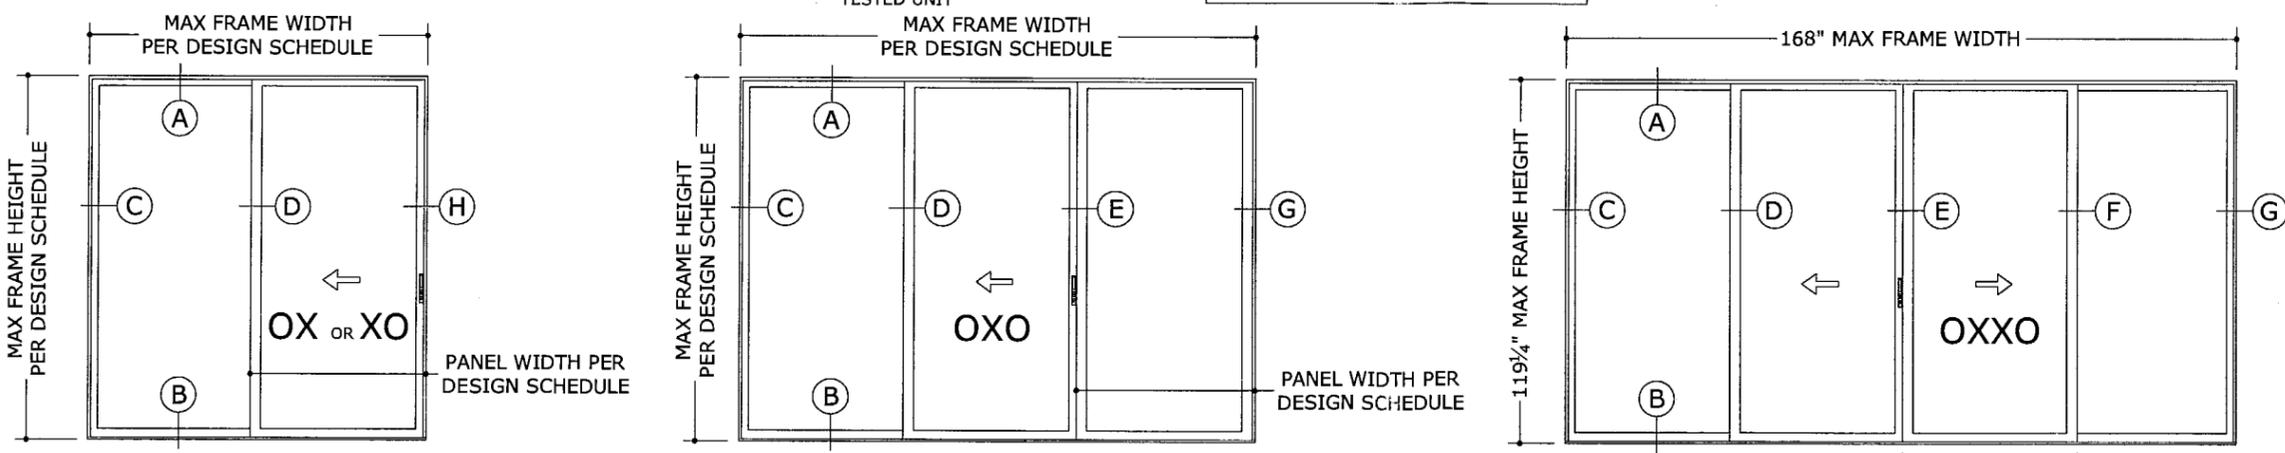

ALLOWABLE PANEL CONFIGURATIONS (2, 3, OR 4-PANEL MAX)

ENGINEERING EXPRESS

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM

TRACO
Windows & Doors Inc.
71 PROGRESS AVENUE
CRANBURY TOWNSHIP, PA 16166
PHONE: (724) 776-7000

SERIES 8000 ALUMINUM SLIDING GLASS DOOR
SMALL MISSILE IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
COUNTY COMMENTS	RKB	CL	06/04/07
BCCO COMMENTS	MEH	CL	08/29/07
2007 FBC REV.	RKB	CL	09/30/08
COUNTY COMMENT	RKB	CL	03/24/09
GE SILICONE ADDITION	CL	FLB	11/14/06

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 03-1114.15
Expiration Date Nov 09, 2012
By Ishag J. Chaudh
Miami Dade Product Control Division

02-TRA-1045
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION:

03/27/2009 - 10:37am rbarlett F:\01 Project Files\Traco (TRA)\2002 Jobs\02-TRA-1045 Traco 8000 SGD, SMI (NOA)\02-TRA-1045_06b_8000 SGD (SMI).dwg

03/27/2009 - 10:37am rbartlett F:\01 Project Files\Traco (TRA)\2002 Jobs\02-TRA-1045 Traco 8000 SGD, SMI (NOA)\02-TRA-1045_06b 8000 SGD (SMI).dwg


03/27/2009

ENGINEERING EXPRESS®
160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

DESIGN SCHEDULE:

PANEL WIDTH NOMINAL FT./IN.	DOOR HEIGHT FT./IN.	ALLOWABLE PRESSURES (PSF)					
		WOOD OR GROUT FILLED BLOCK		CONCRETE			
		ANCHOR CLUSTERS 6 @ SILL / 6 @ HEAD		ANCHOR CLUSTERS 6 @ SILL / 4 @ HEAD		ANCHOR CLUSTERS 8 @ SILL / 6 @ HEAD	
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
2'-0"	6'-8"	96.7	96.7	96.7	96.7	96.7	96.7
2'-6"		96.7	96.7	96.7	96.7	96.7	96.7
3'-0"		96.7	96.7	96.7	96.7	96.7	96.7
3'-6"		96.7	96.7	93.4	93.4	93.4	93.4
4'-0"		82.7	82.7	71.5	71.5	71.5	71.5
4'-6"	65.4	65.4	56.5	56.5	56.5	56.5	
4'-8"	52.9	52.9	45.8	45.8	45.8	45.8	
2'-0"	8'-0"	96.7	96.7	96.7	96.7	96.7	96.7
2'-6"		96.7	96.7	96.7	96.7	96.7	96.7
3'-0"		96.7	96.7	88.0	88.0	96.7	96.7
3'-6"		90.8	90.8	78.4	78.4	93.4	93.4
4'-0"		82.7	82.7	71.5	71.5	71.5	71.5
2'-0"	9'-0"	96.7	96.7	96.7	96.7	96.7	96.7
2'-6"		96.7	96.7	88.6	88.6	96.7	96.7
3'-0"		88.2	88.2	76.3	76.3	96.7	96.7
3'-6"		78.2	78.2	67.6	67.6	90.2	90.2
4'-0"		67.6	67.6	56.5	56.5	56.5	56.5
2'-0"	9'-11 1/4"	96.7	96.7	96.0	96.0	96.7	96.7
2'-6"		91.4	91.4	79.0	79.0	96.7	96.7
3'-0"		78.4	78.4	67.8	67.8	86.8	86.8
3'-6"		69.3	69.3	59.9	59.9	75.4	75.4
4'-0"		59.9	59.9	48.7	48.7	48.7	48.7

NOTE:
FIND ALLOWABLE DESIGN LOAD FOR THE CORRESPONDING
SUBSTRATE BASED ON PANEL WIDTH AND DOOR HEIGHT.

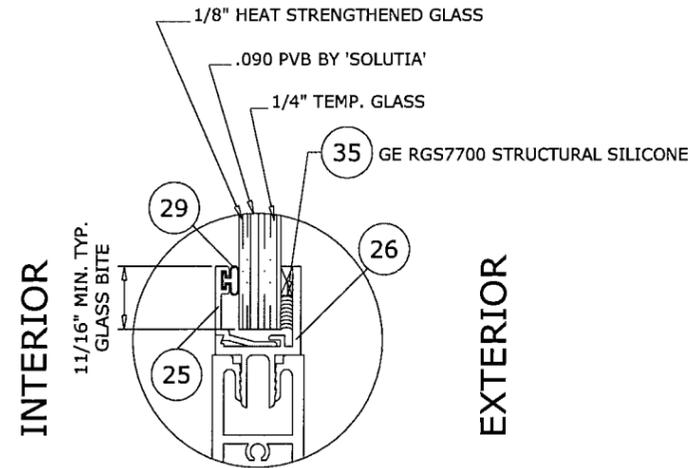

**SMALL MISSILE IMPACT RESISTANT
NOMINAL 0.465" O.A. LAMINATED GLASS
GLAZING DETAIL**

SEALANTS:

INSTALLATION SCREWS, FRAME AND PANEL
CORNER SEAMS SEALED WITH ALUM/CLEAR
COLORED SEALANT. FIXED PANEL BOTTOM RAIL,
FIXED PANEL JAMBS AND THRESHOLD INSERTS
SEALED TO THE FRAME WITH SILICONE.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 06-1114.15
Expiration Date Nov 09, 2012
By Ishag I. Chaudhry
Miami Dade Product Control
Division




TRACO
Windows & Doors Inc.
71 PROGRESS AVENUE
CRANBERRY TOWNSHIP, PA 16166
PHONE: (724) 776-7000

SERIES 8000 ALUMINUM SLIDING GLASS DOOR
SMALL MISSILE IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
COUNTY COMMENTS	RKB	CL	06/04/07
BCCO COMMENTS	MEH	CL	08/29/07
2007 FBC REV.	RKB	CL	09/30/08
COUNTY COMMENT	RKB	CL	03/24/09
GE SILICONE ADDITION	CL	FLB	11/14/06

02-TRA-1045
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION:

03/27/2009 - 10:37am rbartlett F:\01 Project Files\Traco (TRA)\2002 Jobs\02-TRA-1045 Traco 8000 SGD, SMI (NOA)\02-TRA-1045_06b 8000 SGD (SMI).dwg

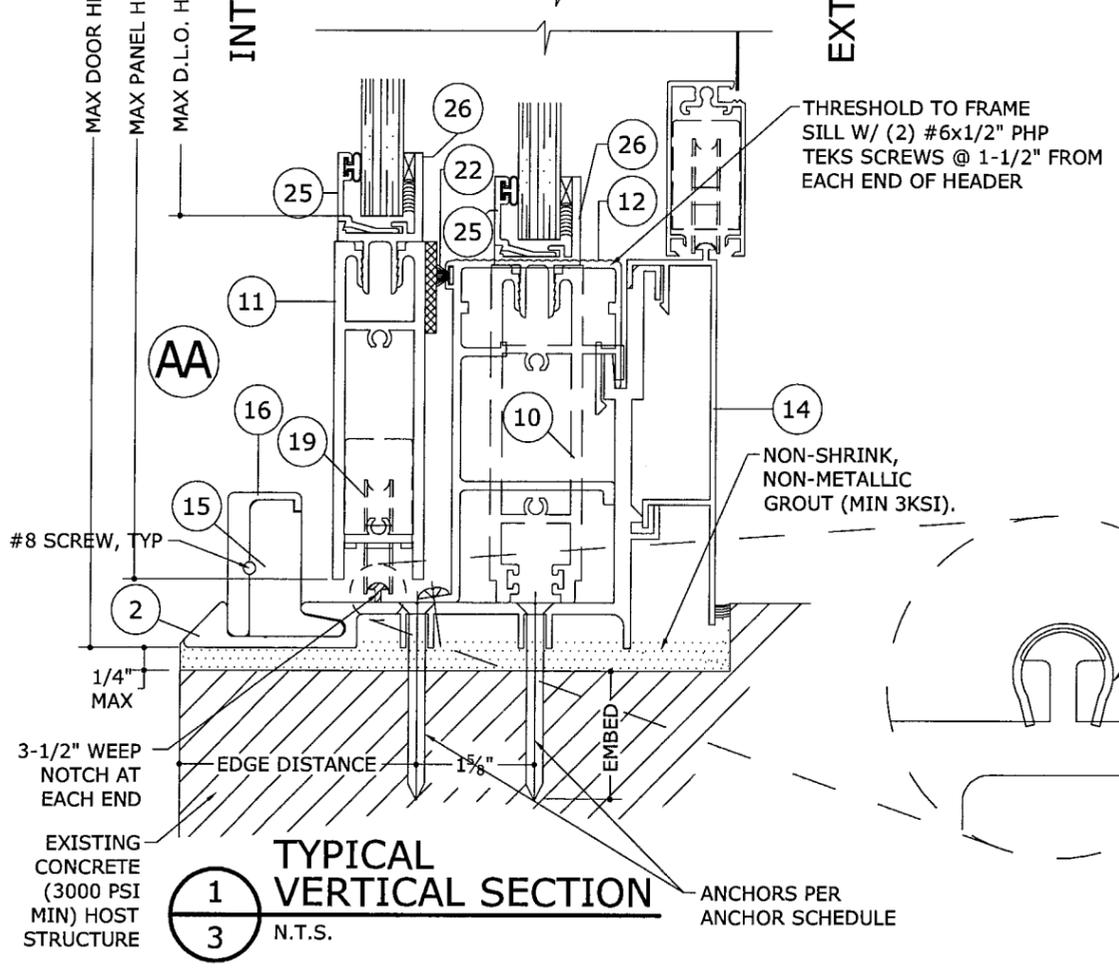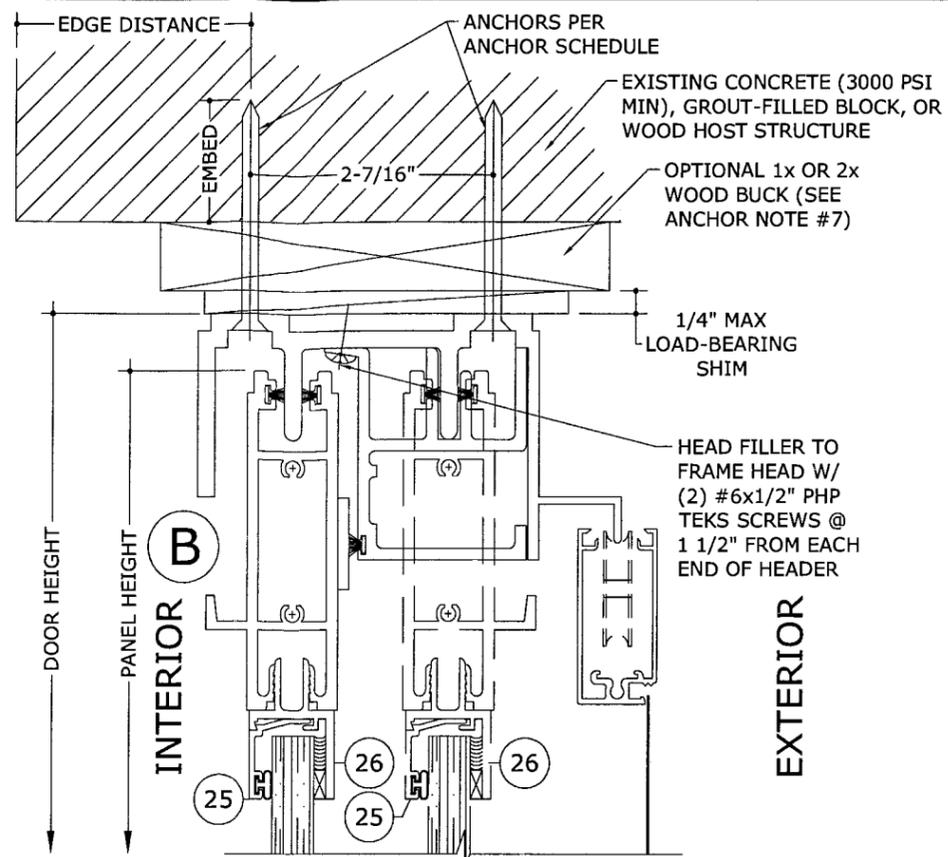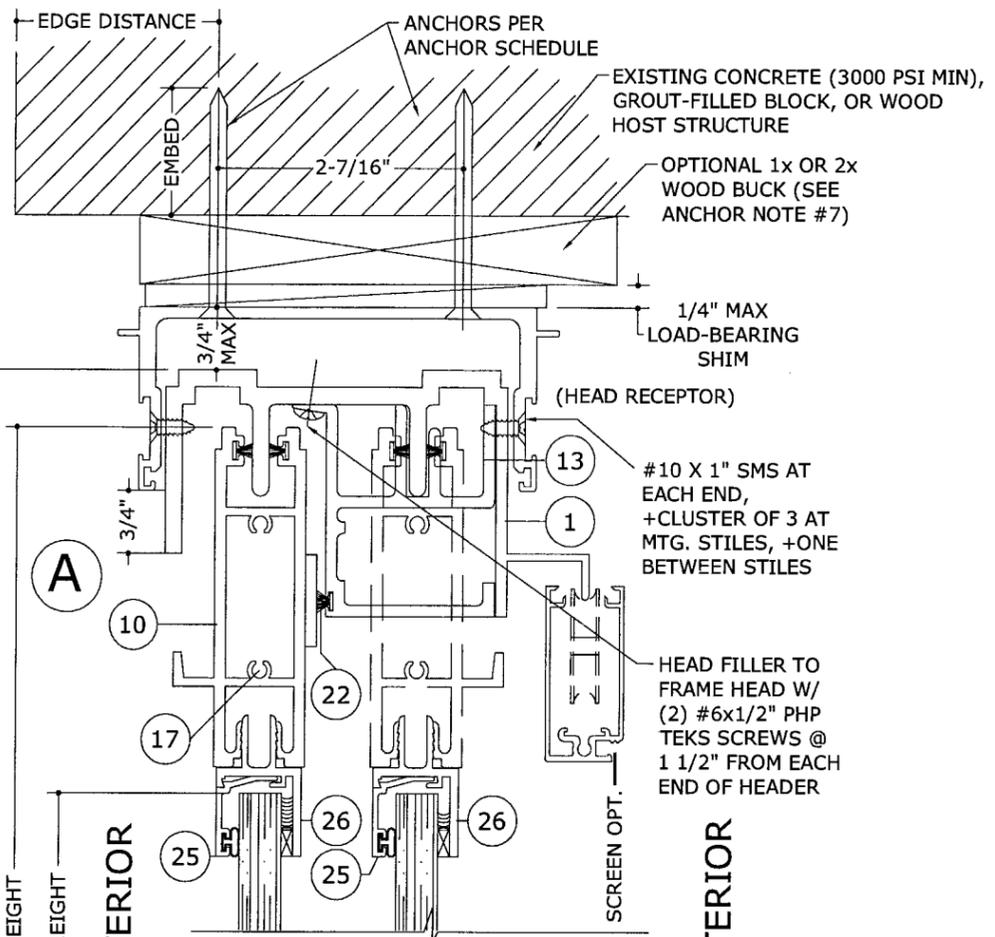

ANCHOR SCHEDULE:


TO GROUT-FILLED BLOCK OR CONCRETE:

- 1/4" ITW TAPCONS THRU WOOD BUCKS OR DIRECTLY INTO MASONRY/CONCRETE WITH 1-3/4" MIN EMBED AND 2-1/2" MIN EDGE DISTANCE.

TO 2x WOOD BUCK OR WOOD HOST STRUCTURE (EXCLUDES 1x WOOD BUCK):

- 1/4" ITW TAPCONS WITH 1-1/2" MIN THREAD PENETRATION AND 1" MIN EDGE DISTANCE.

- ANCHOR NOTES:**
- SEE EXTERIOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
 - ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
 - ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
 - WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
 - MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
 - WHERE EXISTING STRUCTURE IS WOOD FRAMING (MIN 2x), EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
 - 1x OR 2x WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

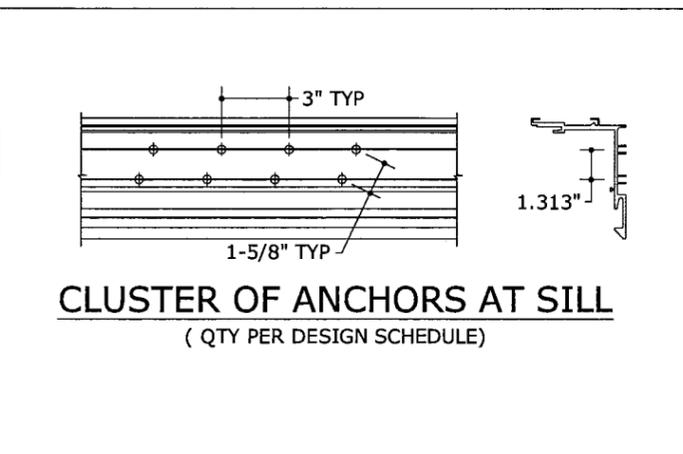

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 08-1114.15
Expiration Date Nov 09, 2012
By *Iskay I. Chanda*
Miami Dade Product Control Division

FRANK L. BENNARDO, P.E.
#PE0046549

03/27/2009

ENGINEERING EXPRESS

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

TRACO
Windows & Doors Inc.
71 PROGRESS AVENUE
CRANBERRY TOWNSHIP, PA 16166
PHONE: (724) 776-7000

SERIES 8000 ALUMINUM SLIDING GLASS DOOR
SMALL MISSILE IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
COUNTY COMMENTS	RKB	CL	06/04/07
ECCO COMMENTS	MEH	CL	08/29/07
2007 FBC REV.	RKB	CL	09/30/08
COUNTY COMMENT	RKB	CL	03/24/09
GE SILICONE ADDITION	CL	FLB	11/14/09

02-TRA-1045

SCALE: 1/8" = 1'-0"


PAGE DESCRIPTION: 06

3

03/27/2009 - 10:37am rbarthelet F:\01 Project Files\Traco (TRA)\2002 Jobs\02-TRA-1045 Traco 8000 SGD, SMI (NOA)\02-TRA-1045_06b 8000 SGD (SMI).dwg

FRANK L. BENNARDO, P.E.
#PE0046549

03/27/2009

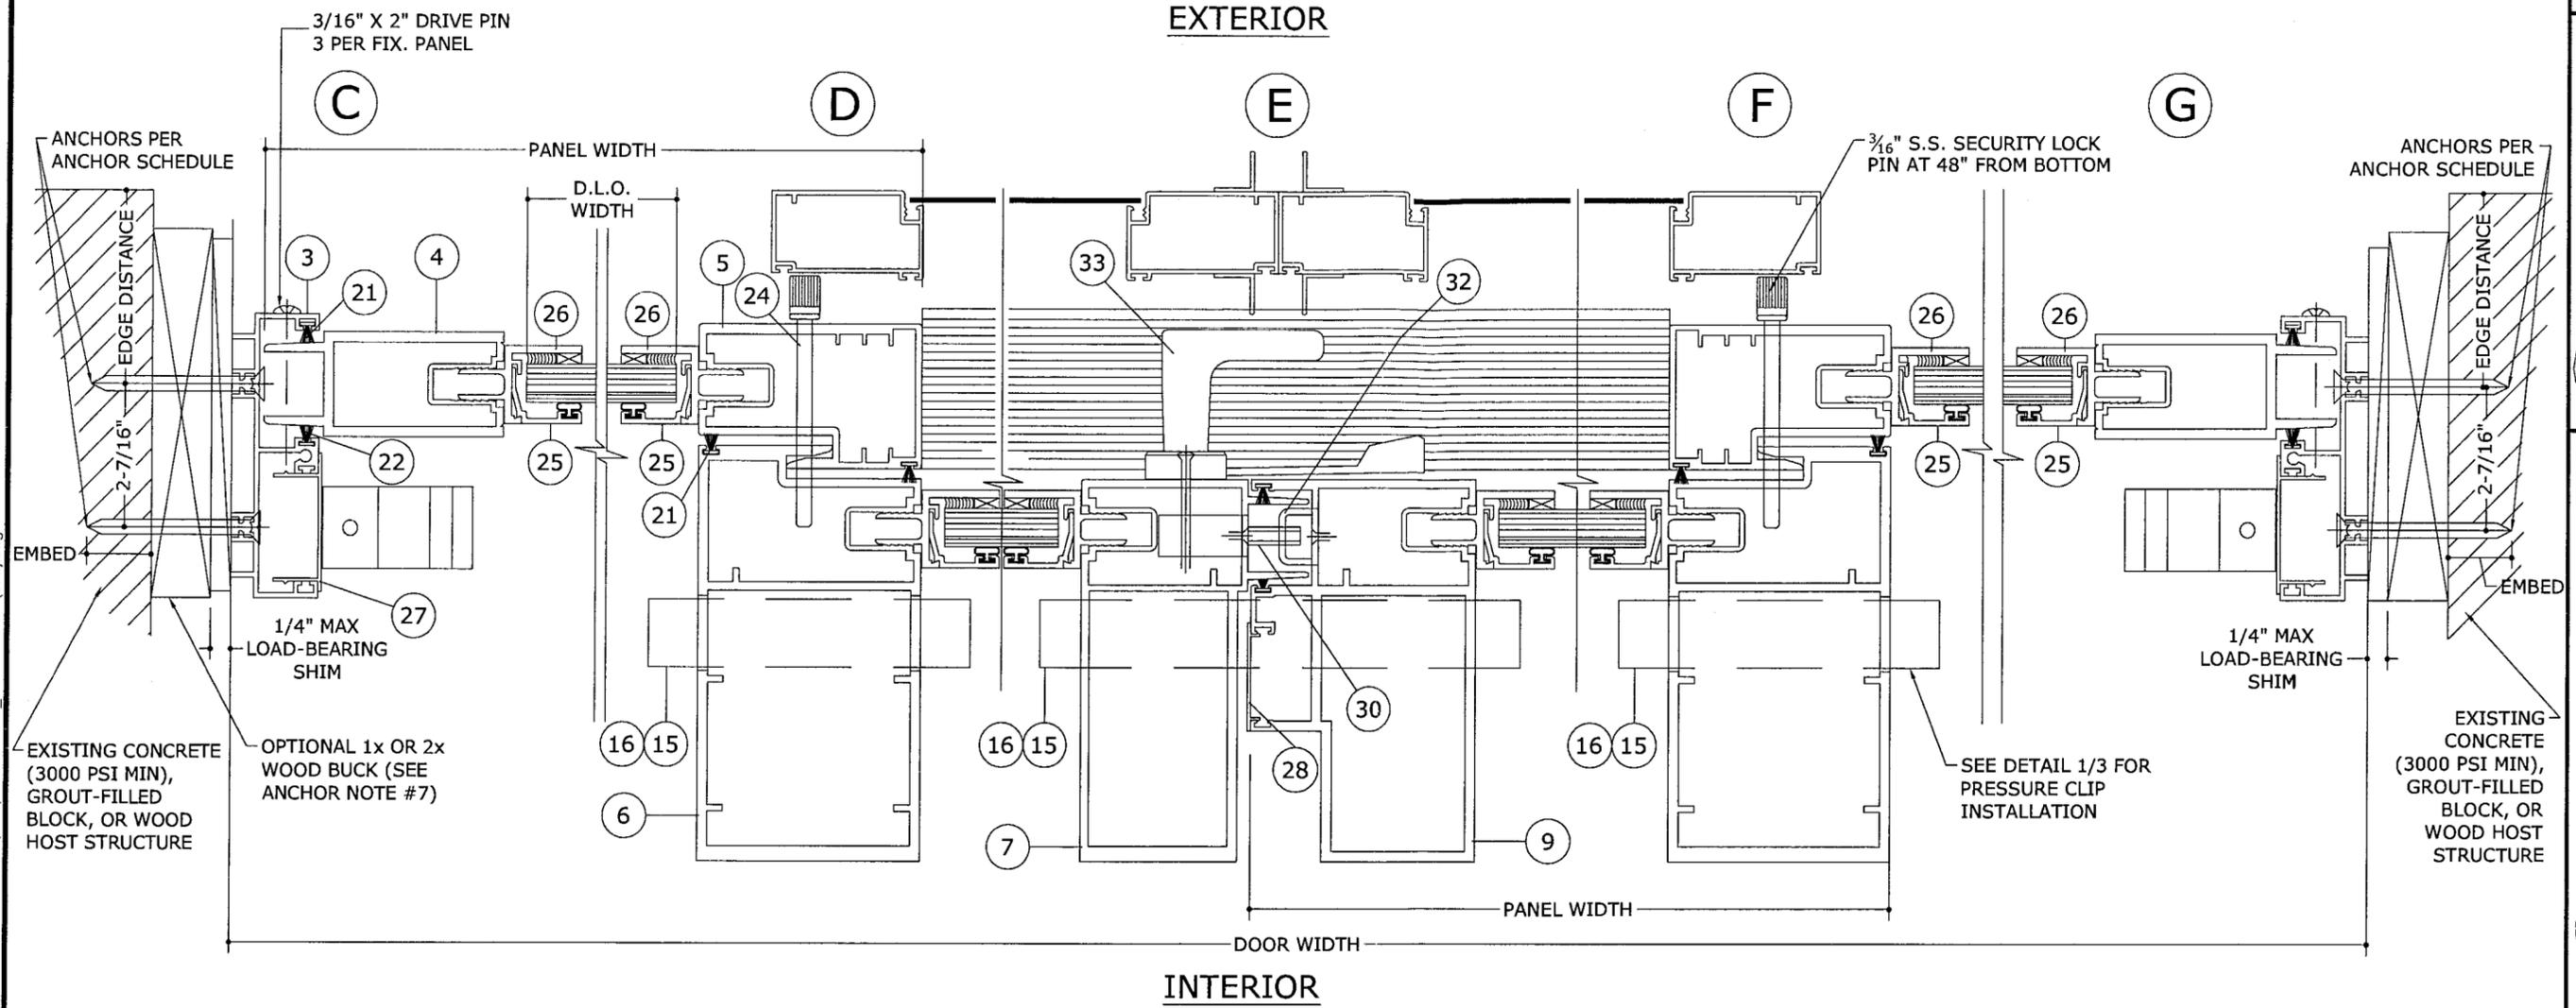

3/16" X 2" DRIVE PIN
3 PER FIX. PANEL

3/16" S.S. SECURITY LOCK
PIN AT 48" FROM BOTTOM

ANCHORS PER
ANCHOR SCHEDULE

ANCHORS PER
ANCHOR SCHEDULE

EXISTING CONCRETE
(3000 PSI MIN),
GROUT-FILLED
BLOCK, OR WOOD
HOST STRUCTURE

EXISTING
CONCRETE
(3000 PSI MIN),
GROUT-FILLED
BLOCK, OR
WOOD
HOST STRUCTURE


SEE DETAIL 1/3 FOR
PRESSURE CLIP
INSTALLATION

OPTIONAL 1x OR 2x
WOOD BUCK (SEE
ANCHOR NOTE #7)

1/4" MAX
LOAD-BEARING
SHIM

1/4" MAX
LOAD-BEARING
SHIM

EXTERIOR

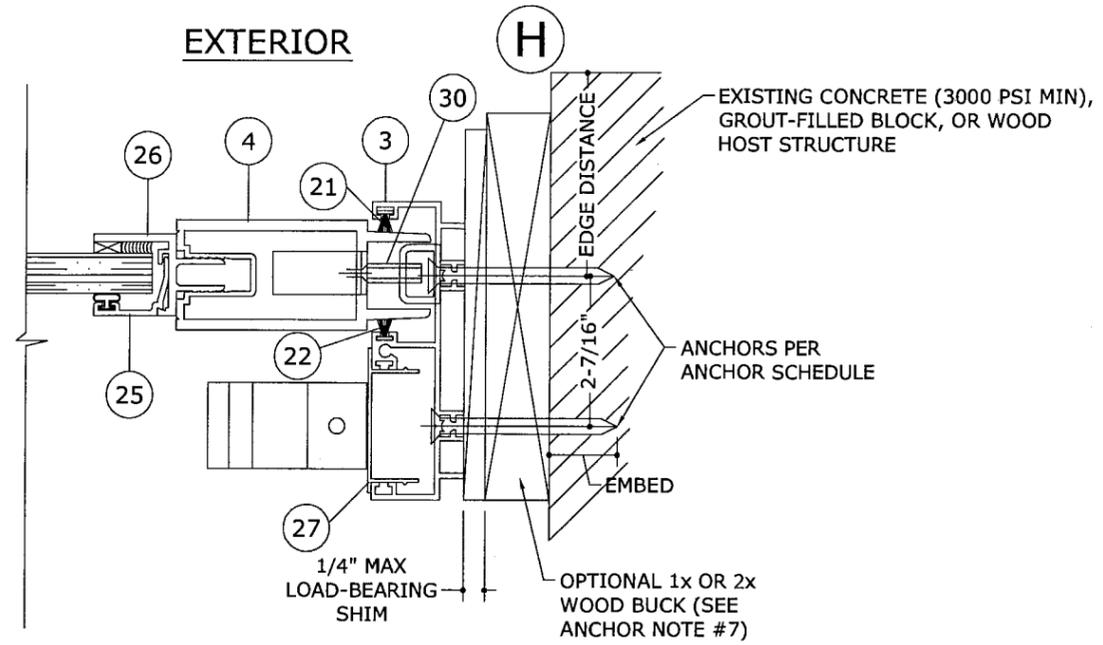

EXISTING CONCRETE (3000 PSI MIN),
GROUT-FILLED BLOCK, OR WOOD
HOST STRUCTURE

ANCHORS PER
ANCHOR SCHEDULE

1/4" MAX
LOAD-BEARING
SHIM

OPTIONAL 1x OR 2x
WOOD BUCK (SEE
ANCHOR NOTE #7)

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION




TRACO
Windows & Doors Inc.
71 PROGRESS AVENUE
CRANBERRY TOWNSHIP, PA 16166
PHONE: (724) 776-7000
SERIES 8000 ALUMINUM SLIDING GLASS DOOR
SMALL MISSILE IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
COUNTY COMMENTS	RKB	CL	06/04/07
BCCO COMMENTS	MEH	CL	08/29/07
2007 FBC REV.	RKB	CL	09/30/08
COUNTY COMMENT	RKB	CL	03/24/09
GE SILICONE ADDITION	CL	FLB	11/14/06

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 06-1114.15
Expiration Date NOV 09, 2012
By Isaac J. Chanda
Miami Dade Product Control
Division

02-TRA-1045
SCALE: 06
PAGE DESCRIPTION:

03/27/2009 - 10:37am rbarlett F:\01 Project Files\Traco (TRA)\2002 Jobs\02-TRA-1045 Traco 8000 SGD, SMI (NOA)\02-TRA-1045_06b_8000 SGD (SM).dwg

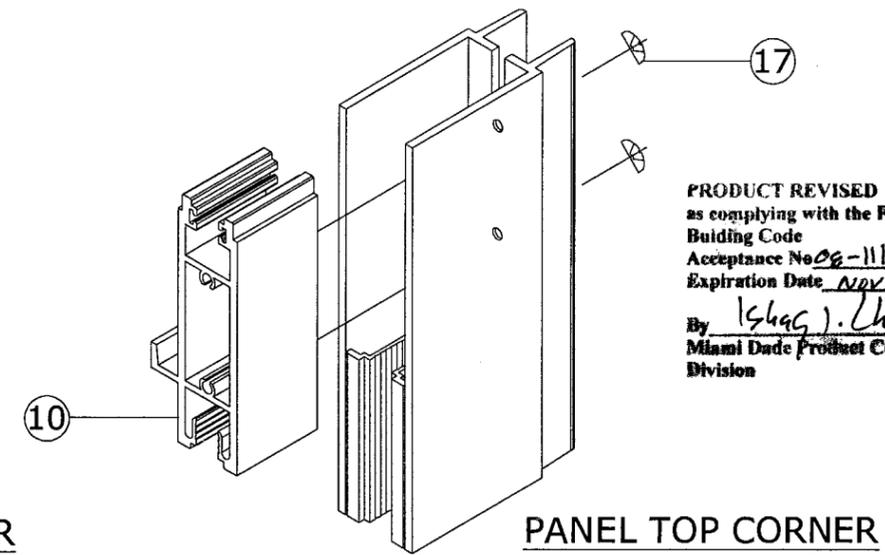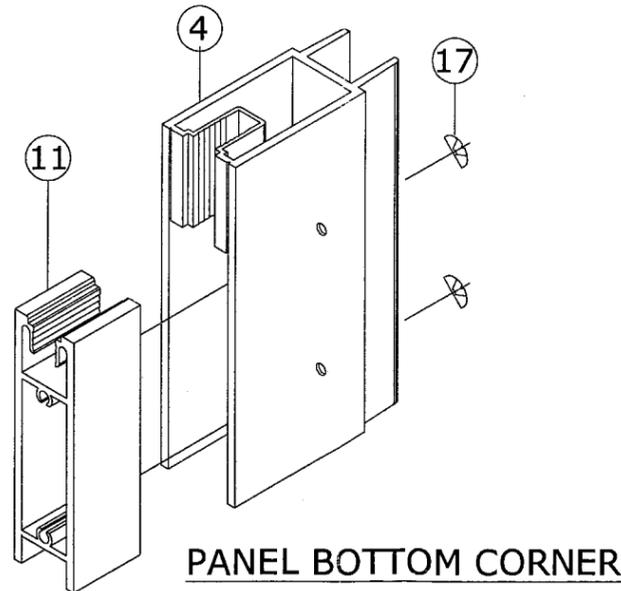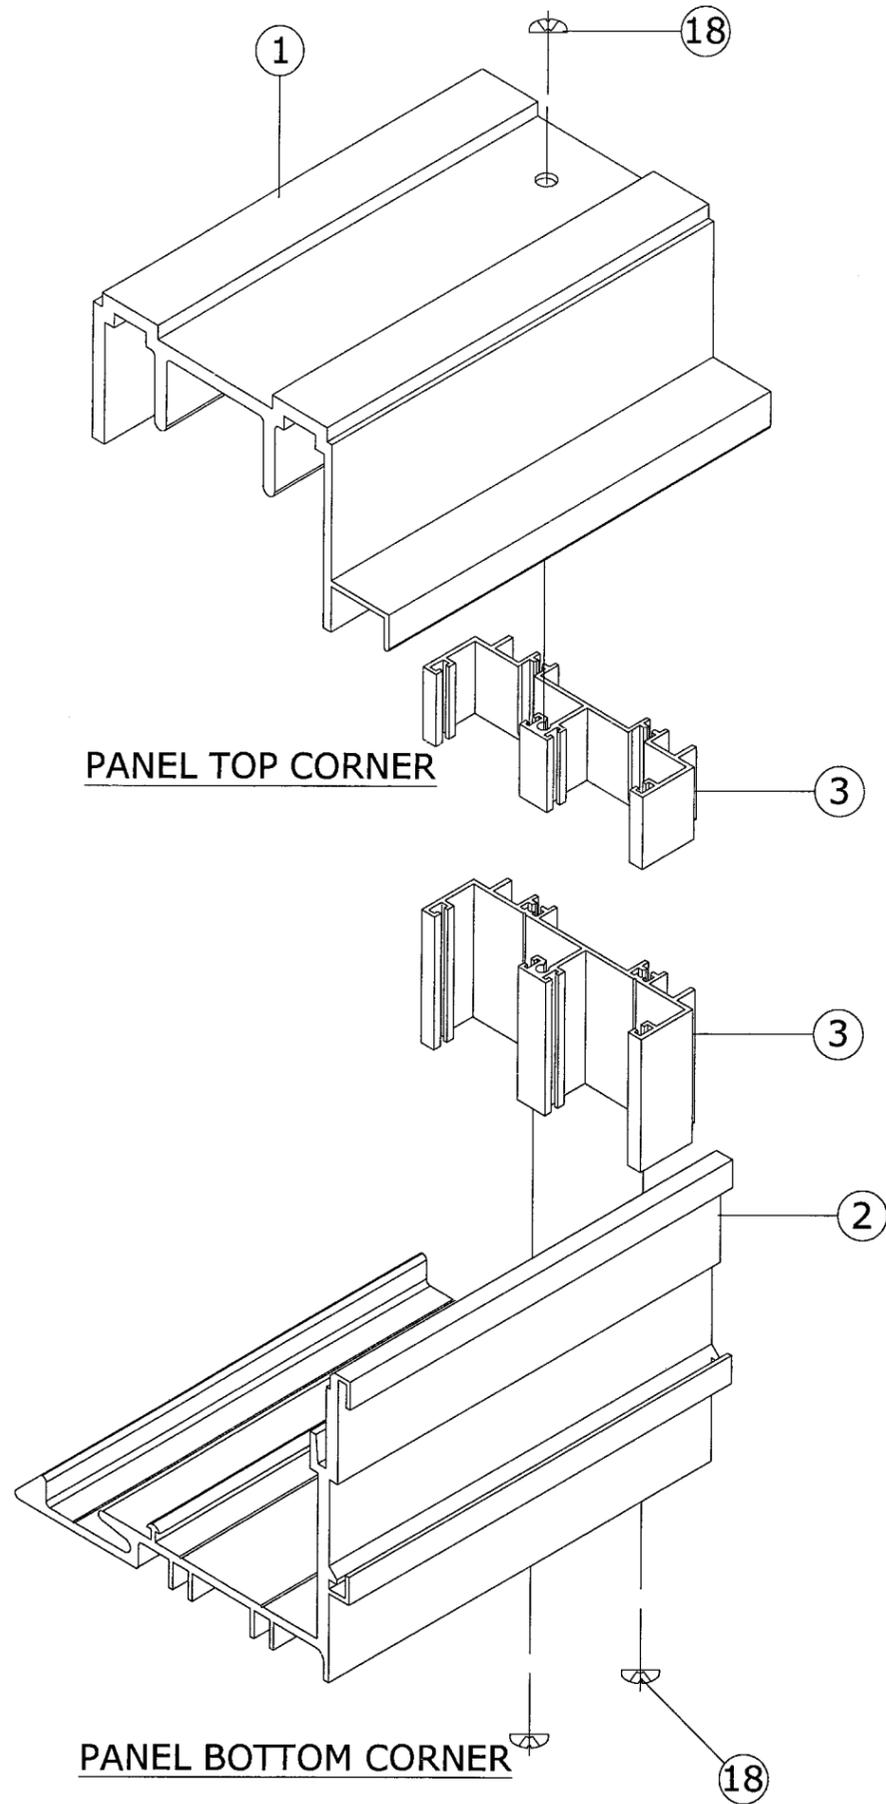

MATERIALS LIST

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	050-633	1	FRAME HEAD	6063-T6	-
2	050-630	1	FRAME SILL	6063-T6	-
3	050-608	2	FRAME JAMB	6063-T6	-
4	051-643	AS REQD.	JAMB STILE	6063-T6	-
5	052-647	AS REQD.	INT. INTERLOCK	6063-T6	-
6	052-646	AS REQD.	EXT. INTERLOCK	6063-T6	-
7	052-644	AS REQD.	LOCK STILE	6063-T6	-
8	050-609	AS REQD.	HEAD RECEPTOR	6063-T6	-
9	052-654	AS REQD.	FEMALE MEETING STILE	6063-T6	-
10	051-632	1/ PANEL	TOP RAIL	6005-T5	-
11	051-631	1/ PANEL	BOTTOM RAIL	6005-T5	-
12	050-635	1	THRESHOLD	6005-T5	-
13	050-636	1	HEAD FILLER	6005-T5	-
14	050-611	1	SCREEN TRACK ADAPTER	6063-T6	-
15	050-648	AS REQD.	PRESSURE CLIP	6063-T6	7-7/8" LONG
16	050-649	AS REQD.	PRESSURE CLIP COVER	6063-T6	7-7/8" LONG
17	012-02-130	1/CORNER	PANEL ASSEMBLY SCREW	CRS	#10 X 1" PHPH SMS
18	012-02-131	-	FRAME ASSEMBLY SCREWS	CRS	#10 X 1" FH SMS
19	037-02-003	2/ MOV. PANEL	TANDEM STEEL WHEEL ASSEMBLY	-	TRUTH OR EQUIV.
21	047-40-014	AS REQD.	PILE W'STRIPPING WITH PLASTIC FIN	SOFT VINYL	BY AMESBURY OR EQUIV.
22	047-40-014	AS REQD.	PILE W'STRIPPING WITH PLASTIC FIN	SOFT VINYL	BY AMESBURY OR EQUIV.
23	-	1	FLUSH MOUNT HOOK LOCK WITH KEEPER	-	AT 42" FROM BOTTOM
24	-	-	3/16" DIA. SECURITY PIN	ST. STEEL	AT 48" FROM BOTTOM
25	050-749	AS REQD.	GLAZING BEAD (7/16" GLASS)	6063-T5	-
26	050-752	AS REQD.	ADAPTER (7/16" GLASS)	6063-T5	-
27	050-529	AS REQD.	JAMB COVER	6063-T5	-
28	050-660	AS REQD.	SNAP COVER	6063-T6	-
29	046-00-010	AS REQD.	BULB VINYL	-	WIBORG WV-3134
30	-	007-084	DEAD LOCK & LATCH	-	ADAMS RITE
31	013-00-033	-	3/16" X 2" DRIVE PIN	-	RAWL
32	007-00-115	-	KEEPER	-	TRUTH
33	007-10-114	-	HANDLE	-	TRUTH
35	05-0127-10 05-0128-16	AS REQ'D	2-PART STRUCTURAL GLAZING COMPOUND	SILICONE	G.E. RGS770

FRANK L. BENNARDO, P.E.
PE0046549

03/27/2009

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION


TRACO
Windows & Doors Inc.
71 PROGRESS AVENUE
CRANBERRY TOWNSHIP, PA 16166
PHONE: (724) 776-7000
SERIES 8000 ALUMINUM SLIDING GLASS DOOR
SMALL MISSILE IMPACT RESISTANT

REMARKS	DATE	DRWN	CHKD
COUNTY COMMENTS	06/04/07	RKB	CL
ECCO COMMENTS	08/29/07	MEH	CL
2007 FBC REV.	09/30/08	RKB	CL
COUNTY COMMENT	03/24/09	RKB	CL
GE SILICONE ADDITION	11/14/08	CL	FLB


PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 06-1114-15
Expiration Date NOV 09, 2012
By (Signature)
Miami Dade Product Control Division

02-TRA-1045
SCALE: - 06
PAGE DESCRIPTION:


EXTRUSION SPECIFICATIONS

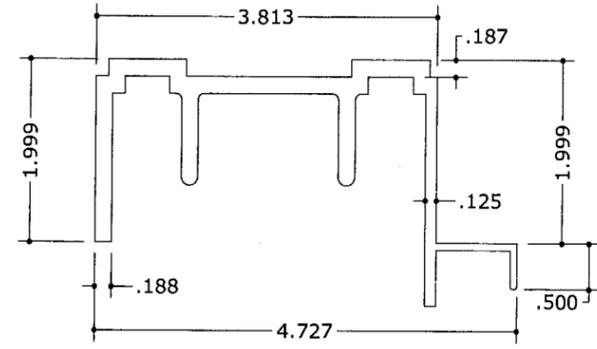


① FRAME HEAD

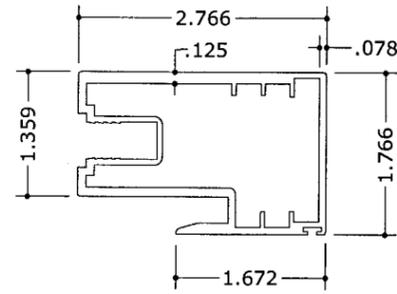


⑤ INT. INTERLOCK

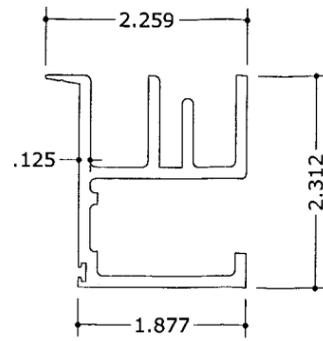


⑬ HEAD FILLER

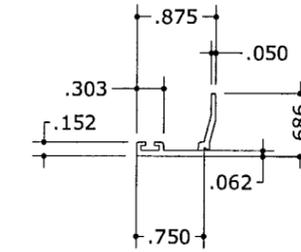


⑫ GLAZING BEAD
7/16" GLASS

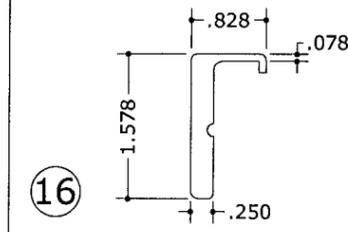


⑯ PRESSURE CLIP
COVER




⑮ PRESSURE CLIP

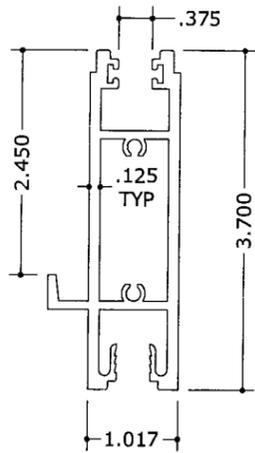


⑩ TOP RAIL

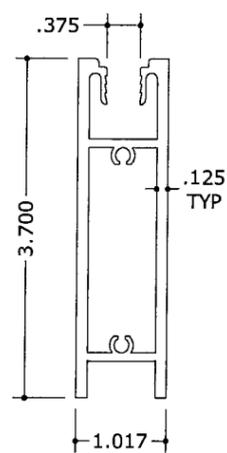


⑪ BOTTOM RAIL

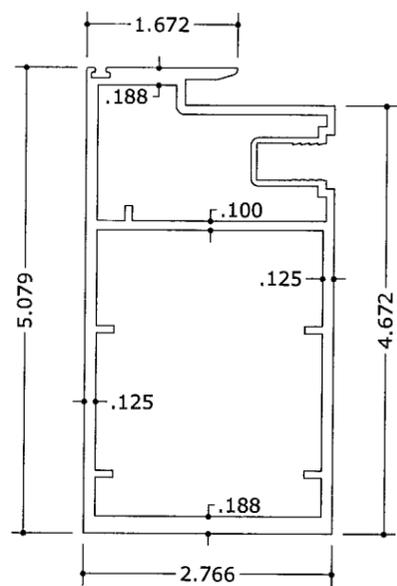


⑥ EXT. INTERLOCK

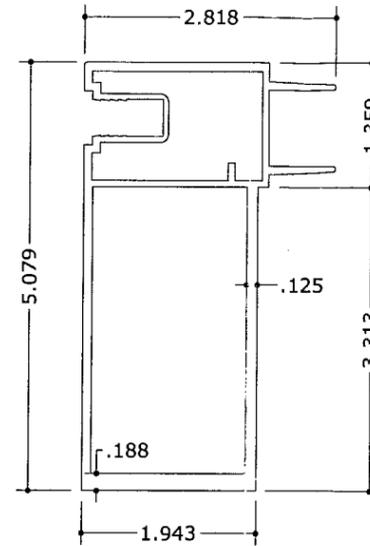


⑦ LOCK MALE STILE

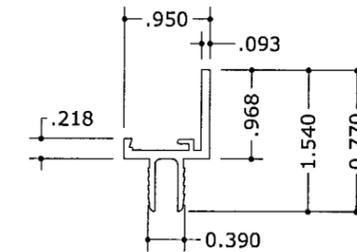


⑫ ADAPTER
7/16" GLASS




⑫ JAMB COVER




⑫ SNAP COVER

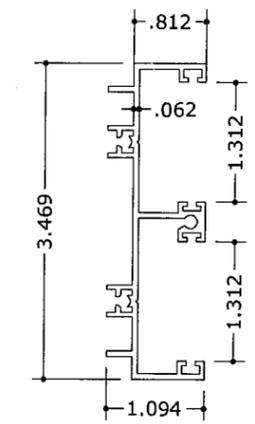


③ FRAME JAMB

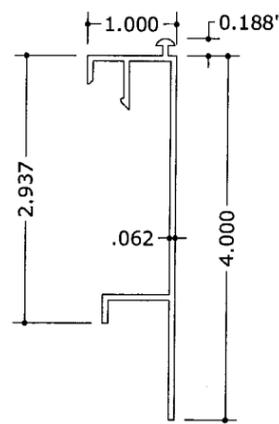


⑭ SCREEN TRACK

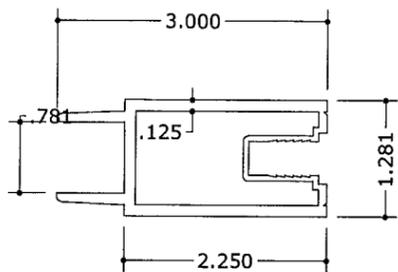


④ EXT. JAMB STILE

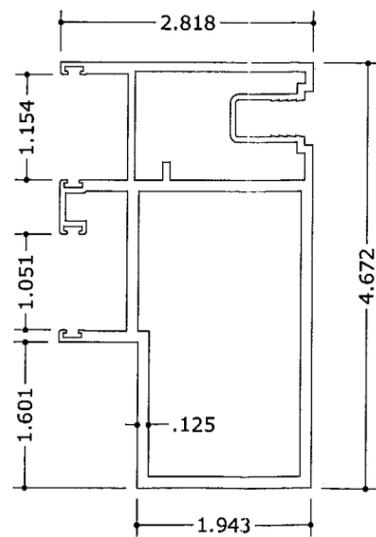


⑨ MEETING STILE

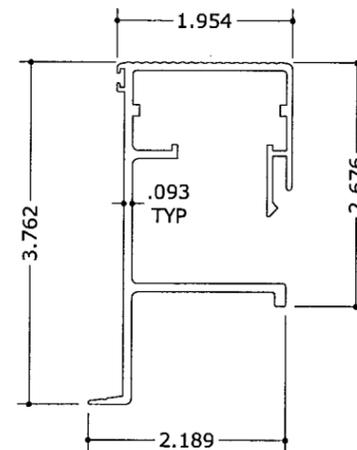

⑫ THRESHOLD

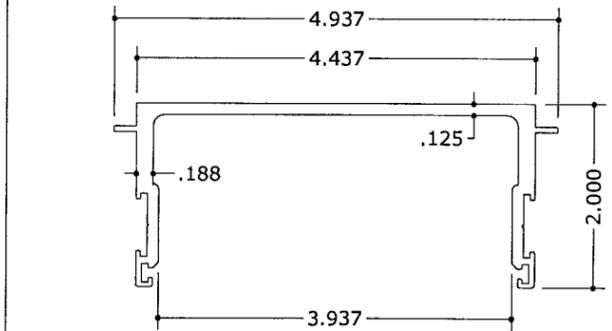

⑧ HEAD RECEPTOR

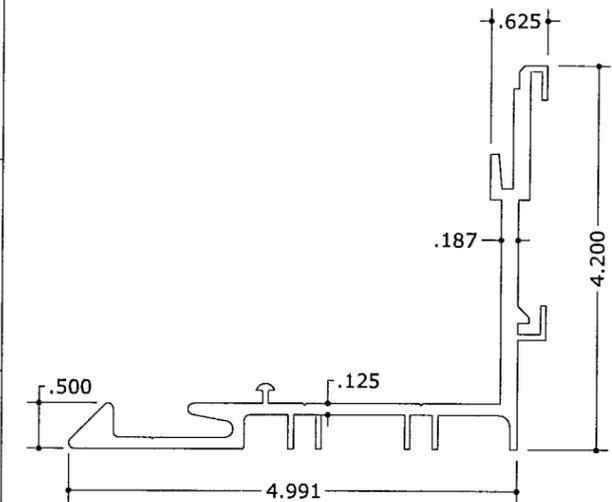

② FRAME SILL

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 08-1114.15
Expiration Date Nov 09, 2012
By Ishag I. Chaudhry
Miami Dade Product Control
Division

FRANK L. BENNARDO, P.E.
PE0046549

03/27/2009

EX EXPRESS
160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

TRACO
Windows & Doors Inc.
71 PROGRESS AVENUE
CRANBERRY TOWNSHIP, PA 16166
PHONE: (724) 776-7000
SERIES 8000 ALUMINUM SLIDING GLASS DOOR
SMALL MISSILE IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
COUNTY COMMENTS	RKB	CL	06/04/07
BCCO COMMENTS	MEH	CL	08/29/07
2007 FBC REV.	RKB	CL	09/30/08
COUNTY COMMENT	RKB	CL	03/24/09
GE SILICONE ADDITION	CL	FLB	11/14/06

02-TRA-1045

SCALE: 1/8" = 1'-0"

PAGE DESCRIPTION: 06

6

03/27/2009 - 10:37am rbarlett F:\01 Project Files\Traco (TRA)\2002 Jobs\02-TRA-1045 Traco 8000 SGD_SMI (NCA)\02-TRA-1045_06b 8000 SGD (SMI).dwg