



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1107
MIAMI, FLORIDA 33130-1563
 (305) 375-2902 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

La Finestra, L.C.
2790 N.W. 104 Court
Miami, FL 33172

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "EKU-53" 8'0" Outswing Glazed Aluminum French Door - L.M.I.

APPROVAL DOCUMENT: Drawing No. **FIN-B16/ 05R2**, titled "EKU-53 Aluminum Outswing Entrance Door", sheets 1 through 8 of 8, dated 11/04/08 with the latest revision dated 04/12/10, prepared by Bromley-Cook Engineering, Inc., signed and sealed by William D. Cook, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 07-1107.04** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 4/21/10

NOA No. 08-1126.02
Expiration Date: February 27, 2013
Approval Date: May 12, 2010
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **FIN-B16/ 05R2**, titled "EKU-53 Aluminum Outswing Entrance Door", sheets 1 through 8 of 8, dated 11/04/08 with the latest revision dated 04/12/10, prepared by Bromley-Cook Engineering, Inc., signed and sealed by William D. Cook, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of an Aluminum Out-Swinging Entrance Door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4531**, dated 06/01/05, witnessed by Edmundo Largaespada, P. E.
(Submitted under NOA No. 05-0725.03)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of an out swing wood door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3881**, dated 08/23/04, witnessed by Edmundo Largaespada, P. E.
(Submitted under NOA No. 05-0203.02)

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with FBC-2007, dated 03/16/09 and 04/15/10, prepared by Bromley-Cook Engineering, Inc, both signed and sealed by William D. Cook, P. E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 05/13/09, expiring on 12/11/10.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 08-1126.02
Expiration Date: February 27, 2013
Approval Date: May 12, 2010

La Finestra, L.C.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, dated November 21, 2008, signed and sealed by William D. Cook, P. E.
2. Statement letter of no financial interest, dated November 21, 2008, signed and sealed by William D. Cook, P. E.
3. Laboratory compliance letter for Test Report No. **FTL-4531**, issued by Fenestration Testing Laboratory, Inc., dated July 11, 2005, signed and sealed by Edmundo Largaespada, P. E.
(Submitted under NOA No. 05-0725.03)
4. Laboratory compliance letter for Test Report No. **FTL-3881**, issued by Fenestration Testing Laboratory, Inc., dated October 18, 2004, signed and sealed by Edmundo Largaespada, P. E.
(Submitted under NOA No. 05-0203.02)

G. OTHERS


1. Notice of Acceptance No. **07-1107.04**, issued to **La Finestra** for their "**Series EKU-53 Outswing Aluminum French Door - L.M.I.**", approved on 01/17/08 and expiring on 02/27/13.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 08-1126.02
Expiration Date: February 27, 2013
Approval Date: May 12, 2010

LA FINESTRA, LC


SERIES: EKU 53 OUTSWING ENTRANCE DOOR (HIGH LOAD)

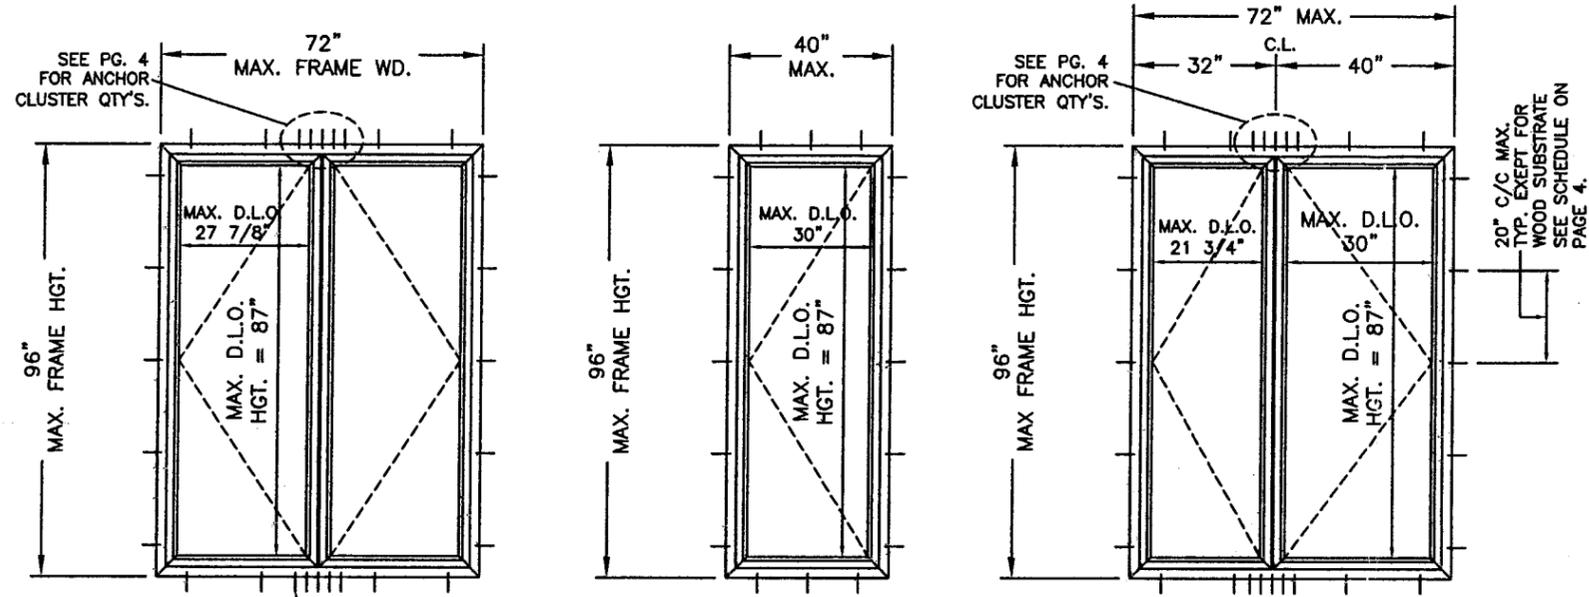

TYPICAL CONFIGURATIONS

MAX. WINDOW SIZES SHOWN

MULTIPLE UNITS STACKED SIDE BY SIDE MUST HAVE APPROVED MULLIONS BETWEEN EACH DOOR FRAME (SEE ALTERNATE CONFIGURATIONS BELOW)

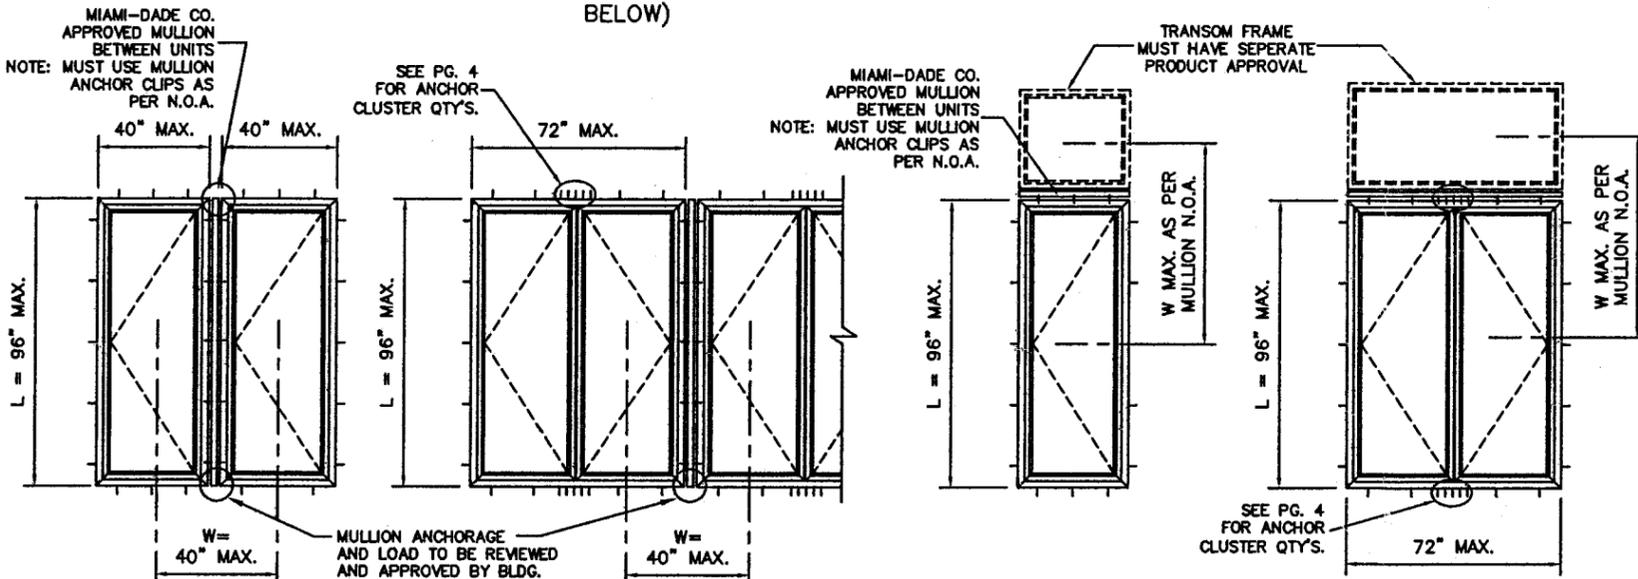

ALTERNATE CONFIGURATIONS

UNITS MAY BE INSTALLED WITH A MIAMI-DADE COUNTY APPROVED MULLION BETWEEN EACH DOOR AND/OR FRAME. THE LOWEST DESIGN PRESSURE FOR THE DOOR, TRANSOM OR MULLION WILL CONTROL.

GLASS SCHEDULE

LARGE MISSILE IMPACT RESISTANT

GL-1 = 7/16" (.454") LAMINATED
3/16" (.182") ANNEALED - .090" P.V.B.
INTERLAYER (DUPONT BUTACITE)-
3/16" (.182") ANNEALED.

GL-2 = 7/16" (.454") LAMINATED
3/16" HEAT STRENGTHENED- .090" P.V.B.
INTERLAYER (DUPONT BUTACITE)-
3/16" HEAT STRENGTHENED

GLASS CHART

TYPE	MAX. D.L.O.	MAX. DESIGN PRESSURE
GL-1	21 3/4" X 87"	+110.0, -110.0 P.S.F.
	30" X 87"	+98.9, -98.9 P.S.F.
GL-2	30" X 87"	+110.0, -110.0 P.S.F.

WATER INFILTRATION TEST PRESSURE = 16.5 P.S.F.
WITH STANDARD THRESHOLD ONLY - A.D.A. COMPLIANT
THRESHOLD NOT APPROVED FOR WATER INFILTRATION

NOTES:


1. THIS SYSTEM HAS BEEN DESIGNED TO COMPLY WITH THE REQUIREMENTS OF THE HIGH VELOCITY HURRICANE ZONE AS DESCRIBED IN THE "2007 FLORIDA BUILDING CODE"
2. THIS ENTRANCE DOOR SYSTEM HAS BEEN TESTED, ENGINEERED AND APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN SCHEDULE.
3. BUCK, OPENINGS & BUCK FASTENERS MUST BE DESIGNED & INSTALLED TO WITHSTAND WIND LOADS FOR EACH APPLICATION. THE DESIGN & ENGINEERING OF BUCKS SHALL BE PROVIDED BY "THE ENGINEER OF RECORD"
4. BUCK FASTENERS MAY NOT EXCEED 16" O.C. SPACING AROUND OPENINGS.
5. THE SYSTEM SHOWN HEREIN WAS TESTED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH DADE COUNTY PROTOCOLS PA-201, 202 & 203.
6. ONE-THIRD INCREASE IN ALLOWABLE MATERIAL STRESS LIMITS FOR SHORT DURATION WIND LOAD NOT USED IN THE DESIGN CALCULATIONS.

PRODUCT REVISED

as complying with the Florida Building Code
Acceptance No. 08-1126-02
Expiration Date 02/27/2013

By: *[Signature]*
Miami Dade Product Control Division

LA FINESTRA, L.C.
ITALIAN WINDOWS & DOORS
2790 N.W. 104 Court
Miami, FL 33172
Phone (305) 599-8093
Fax (305) 592-4671





PRODUCT:
SERIES EKU 53
ALUMINUM OUTSWING
ENTRANCE DOOR

REVISIONS	DATE	DESCRIPTION
No. 1	4/12/2010	FINAL REVISIONS

DATE: 11/04/2008	SCALE: AS NOTED	DWG. BY: R.C.	CHK. BY:
------------------	-----------------	---------------	----------

DRAWING No.:
FIN-B16/05R2
SHEET 1 OF 8

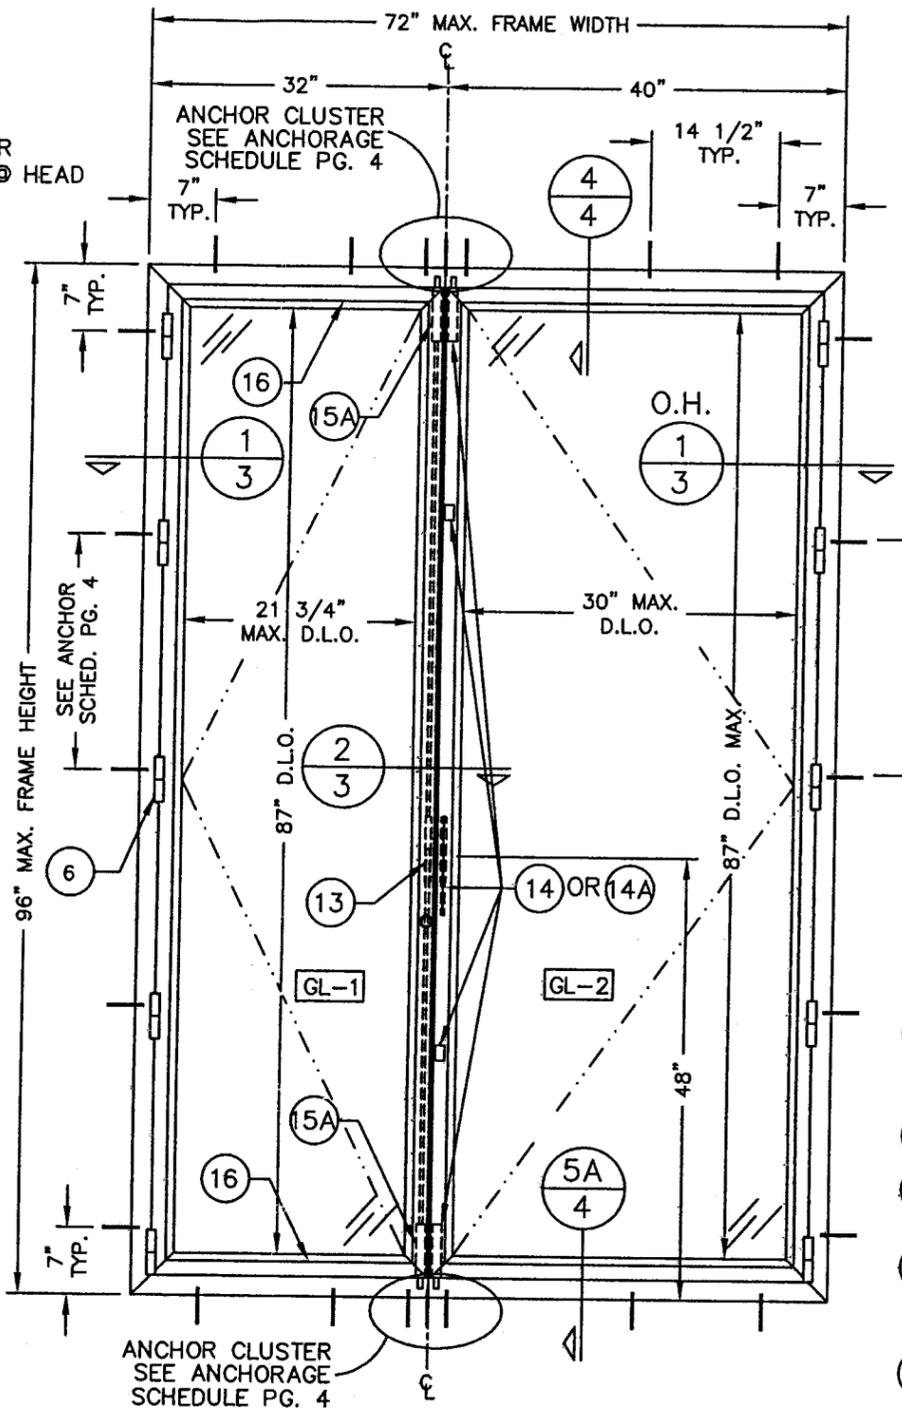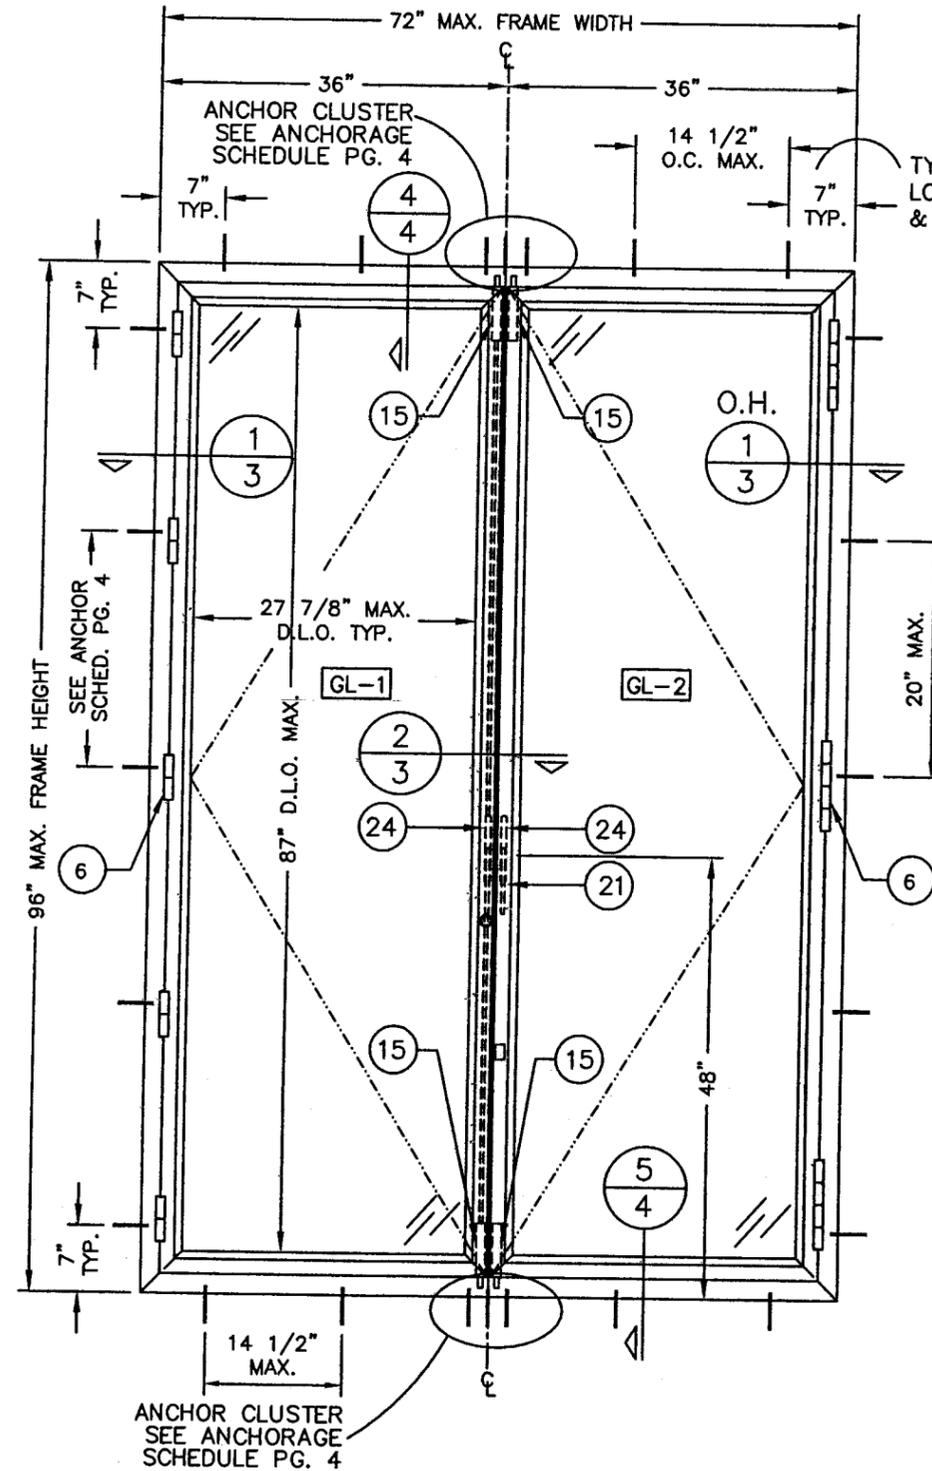

HARDWARE OPTION #1:

- HINGES:**
- ⑥ 100-120X 4" LG. TWO PIECE HINGE ASS'Y. MAY BE INSTALLED CLUSTERED OR SEPARATED.
- TRANSMISSION:**
- ②④ AT ACTIVE/INACTIVE LEAF-01SX-02DX TWO POINT LOCK TRANSMISSION DEVICE. BY ELLEGI
- LOCKING:**
- ②① AT ACTIVE LEAF-SINGLE POINT LOCK BY K.F.V.
 - ①⑤ AT ACTIVE/INACTIVE LEAF-HEAVY DUTY FLUSH BOLT BY LAFIN

HARDWARE OPTION #2:

- HINGES:**
- ⑥ 100-120X 4" LG. TWO PIECE HINGE ASS'Y. MAY BE INSTALLED CLUSTERED OR SEPARATED.
- TRANSMISSION:**
- ①③ 1025 TRANSMISSION MOVEMENT DEVICE
- LOCKING:**
- ①④ AT ACTIVE LEAF-5-POINT LOCK SYSTEM
 - ①④A KVF OR AMESBURY
 - ①⑤A AT INACTIVE LEAF-FLUSH BOLTS AT TOP & BOTTOM OF DOOR LEAF
 - ①⑥ AT INACTIVE LEAF-MULTIPOINT LOCK SYSTEM ALUMINUM S.S. MUSHROOM

SERIES EKU 53 ALUMINUM OUTSWING ENTRANCE DOOR
 (UNIT ELEVATIONS VIEWED FROM EXTERIOR)
 SCALE: N.T.S.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **08-1126.02**
 Expiration Date **02/27/2015**
 By *[Signature]*
 Miami Dade Product Control
 Division


L.A. FINESTRA, L.C.
 ITALIAN WINDOWS & DOORS
 2790 N.W. 104 Court
 Miami, FL 33172
 Phone (305) 599-8093
 Fax (305) 592-4671

WILLIAM D. COOK ENGINEERING, INC.
 LICENSE NO. 11000
 STRUCTURAL ENGINEERING SERVICES
 5440 N.W. 35RD AVENUE SUITE 200
 FORT LAUDERDALE, FL 33309
 STATE OF FLORIDA
 WILLIAM D. COOK, P.E.
 PROFESSIONAL ENGINEER

PRODUCT:
**SERIES EKU 53
 ALUMINUM OUTSWING
 ENTRANCE DOOR**

REVISIONS	No.	DATE	DESCRIPTION
	1	4/12/2010	FINAL REVISIONS


DATE: 11/04/2008	SCALE: AS NOTED	DWG. BY: R.C.	CHK. BY:
DRAWING No.: FIN-B16/05R2			
SHEET 2 OF 8			

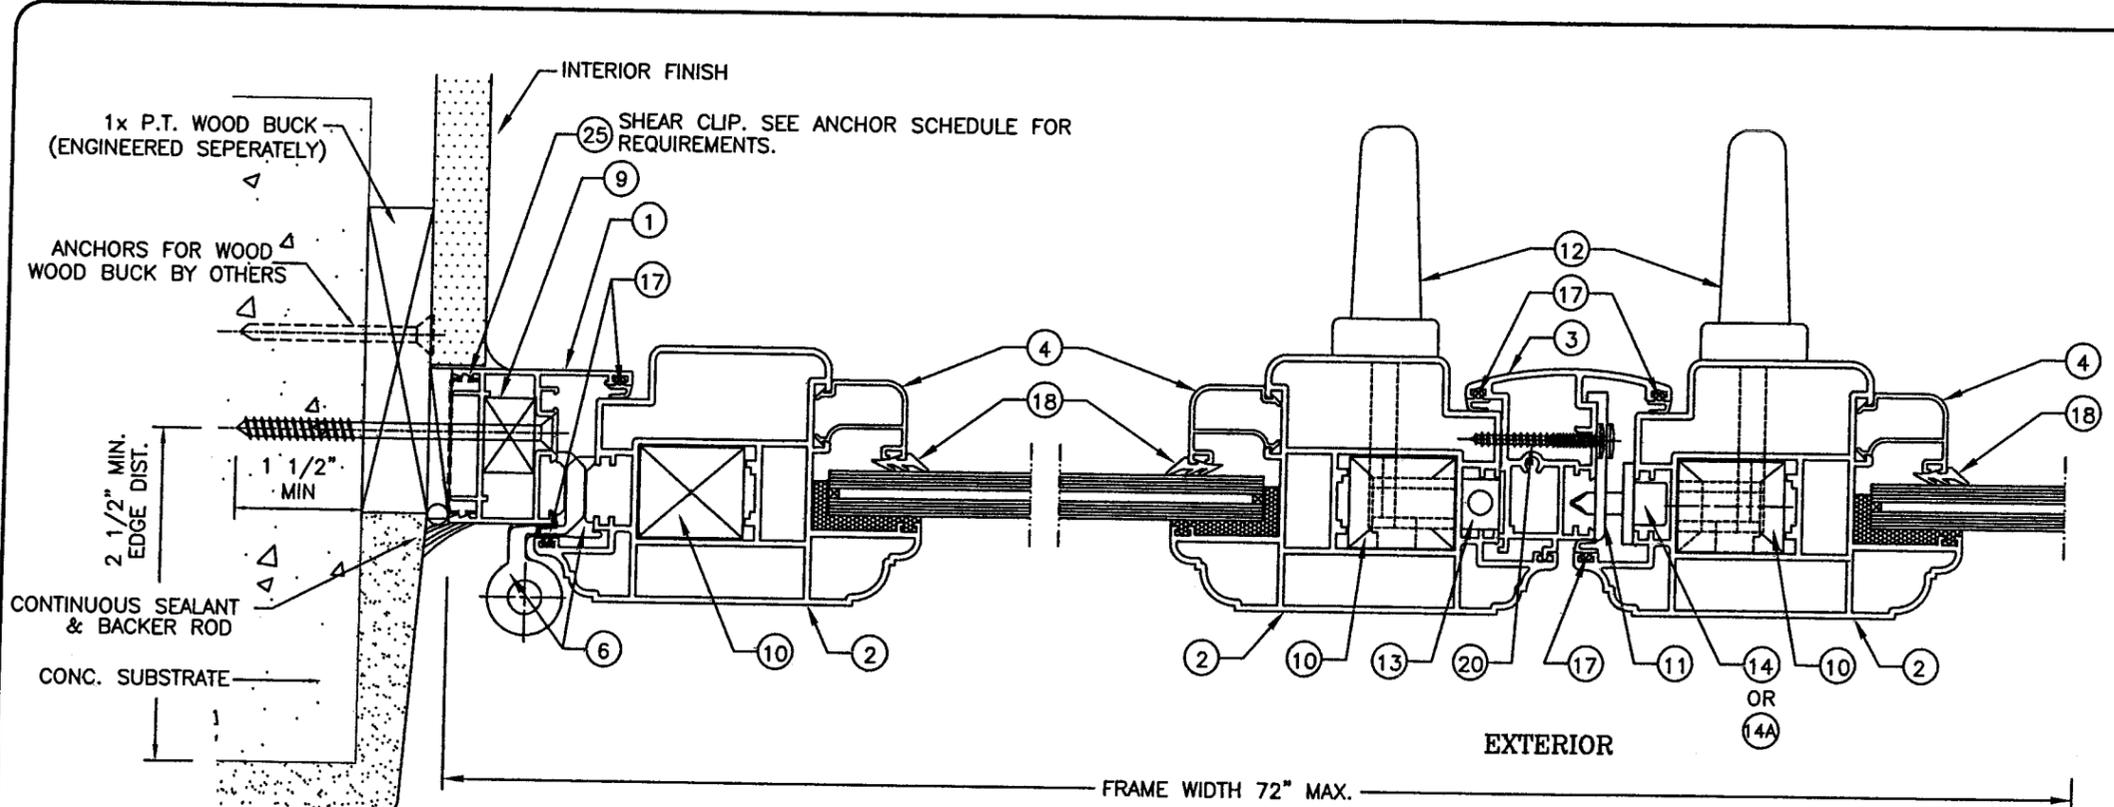


1 JAMB DETAIL
3 (CONC. SUBSTRATE)

2 ASTRAGAL DETAIL
3


HORIZONTAL SECTION (1/2"=1" SCALE)

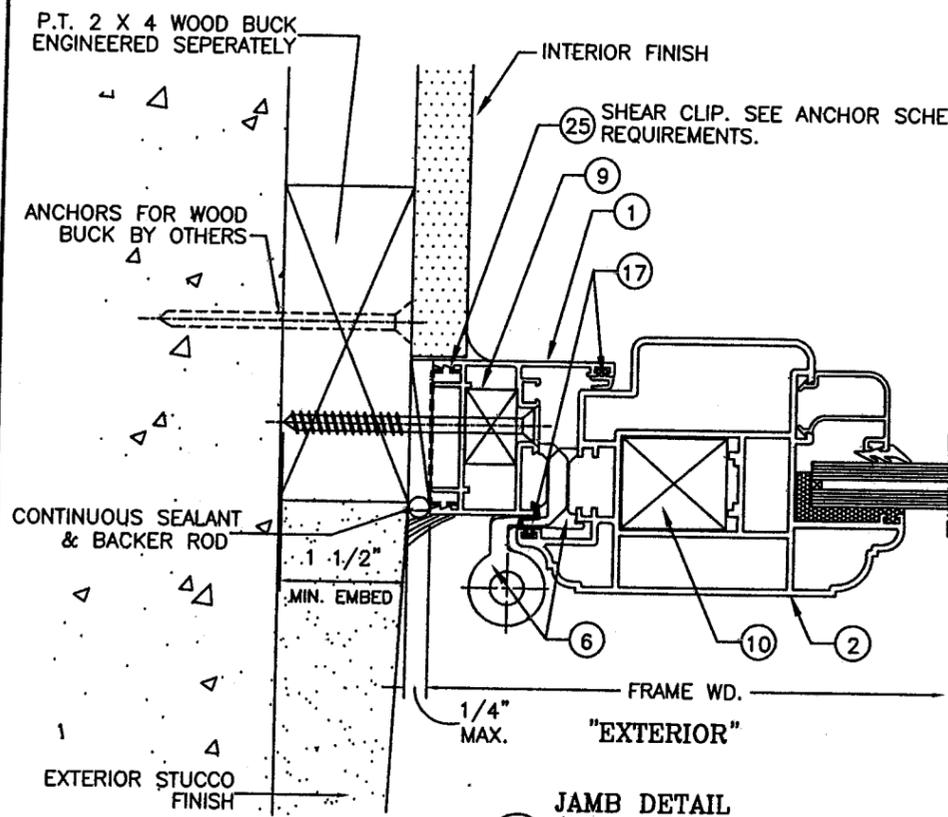

JAMB DETAIL
1A (HEAD SIMILAR)
3 (WOOD SUBSTRATE)

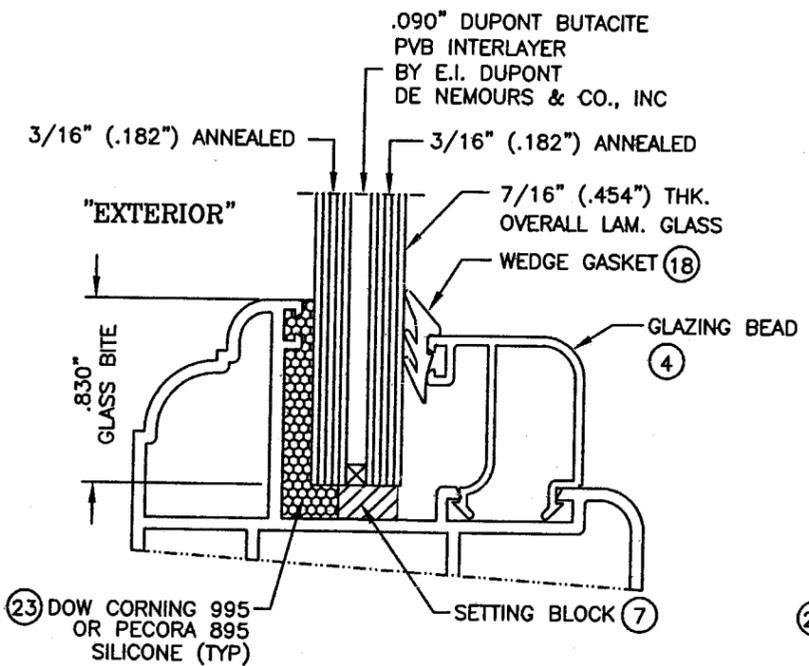


GLAZING DETAIL GL-1
SCALE: FULL SIZE

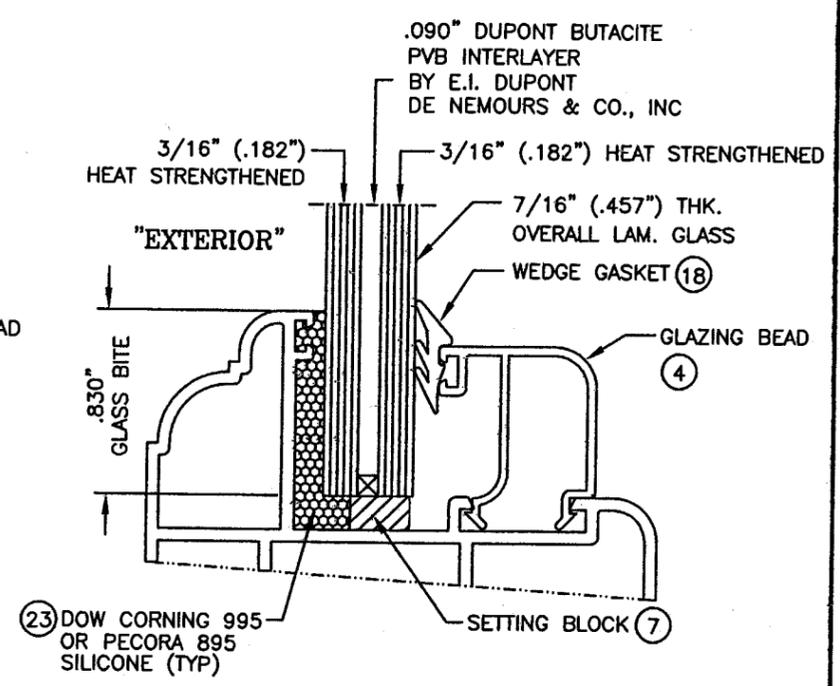

GLAZING DETAIL GL-2
SCALE: FULL SIZE

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 08-1126.02
Expiration Date 02/27/2013
By [Signature]
Miami Dade Product Control
Division

LA FINESTRA, L.C.
ITALIAN WINDOWS & DOORS
2790 N.W. 104 Court
Miami, FL 33172
Phone (305) 599-8093
Fax (305) 592-4671

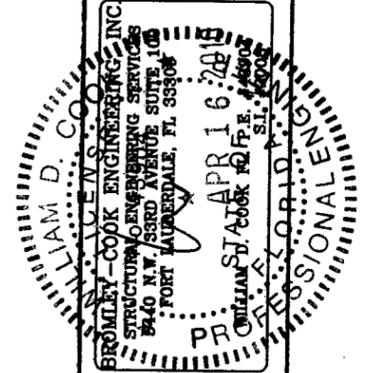


PRODUCT:
SERIES EKU-53
ALUMINUM OUTSWING
ENTRANCE DOOR

REVISIONS	DATE	DESCRIPTION
No.	4/12/2010	FINAL REVISIONS

DATE: 11/04/2008
SCALE: AS NOTED
DWG. BY: R.C.
CHK. BY:

DRAWING No.:
FIN-B16/05R2

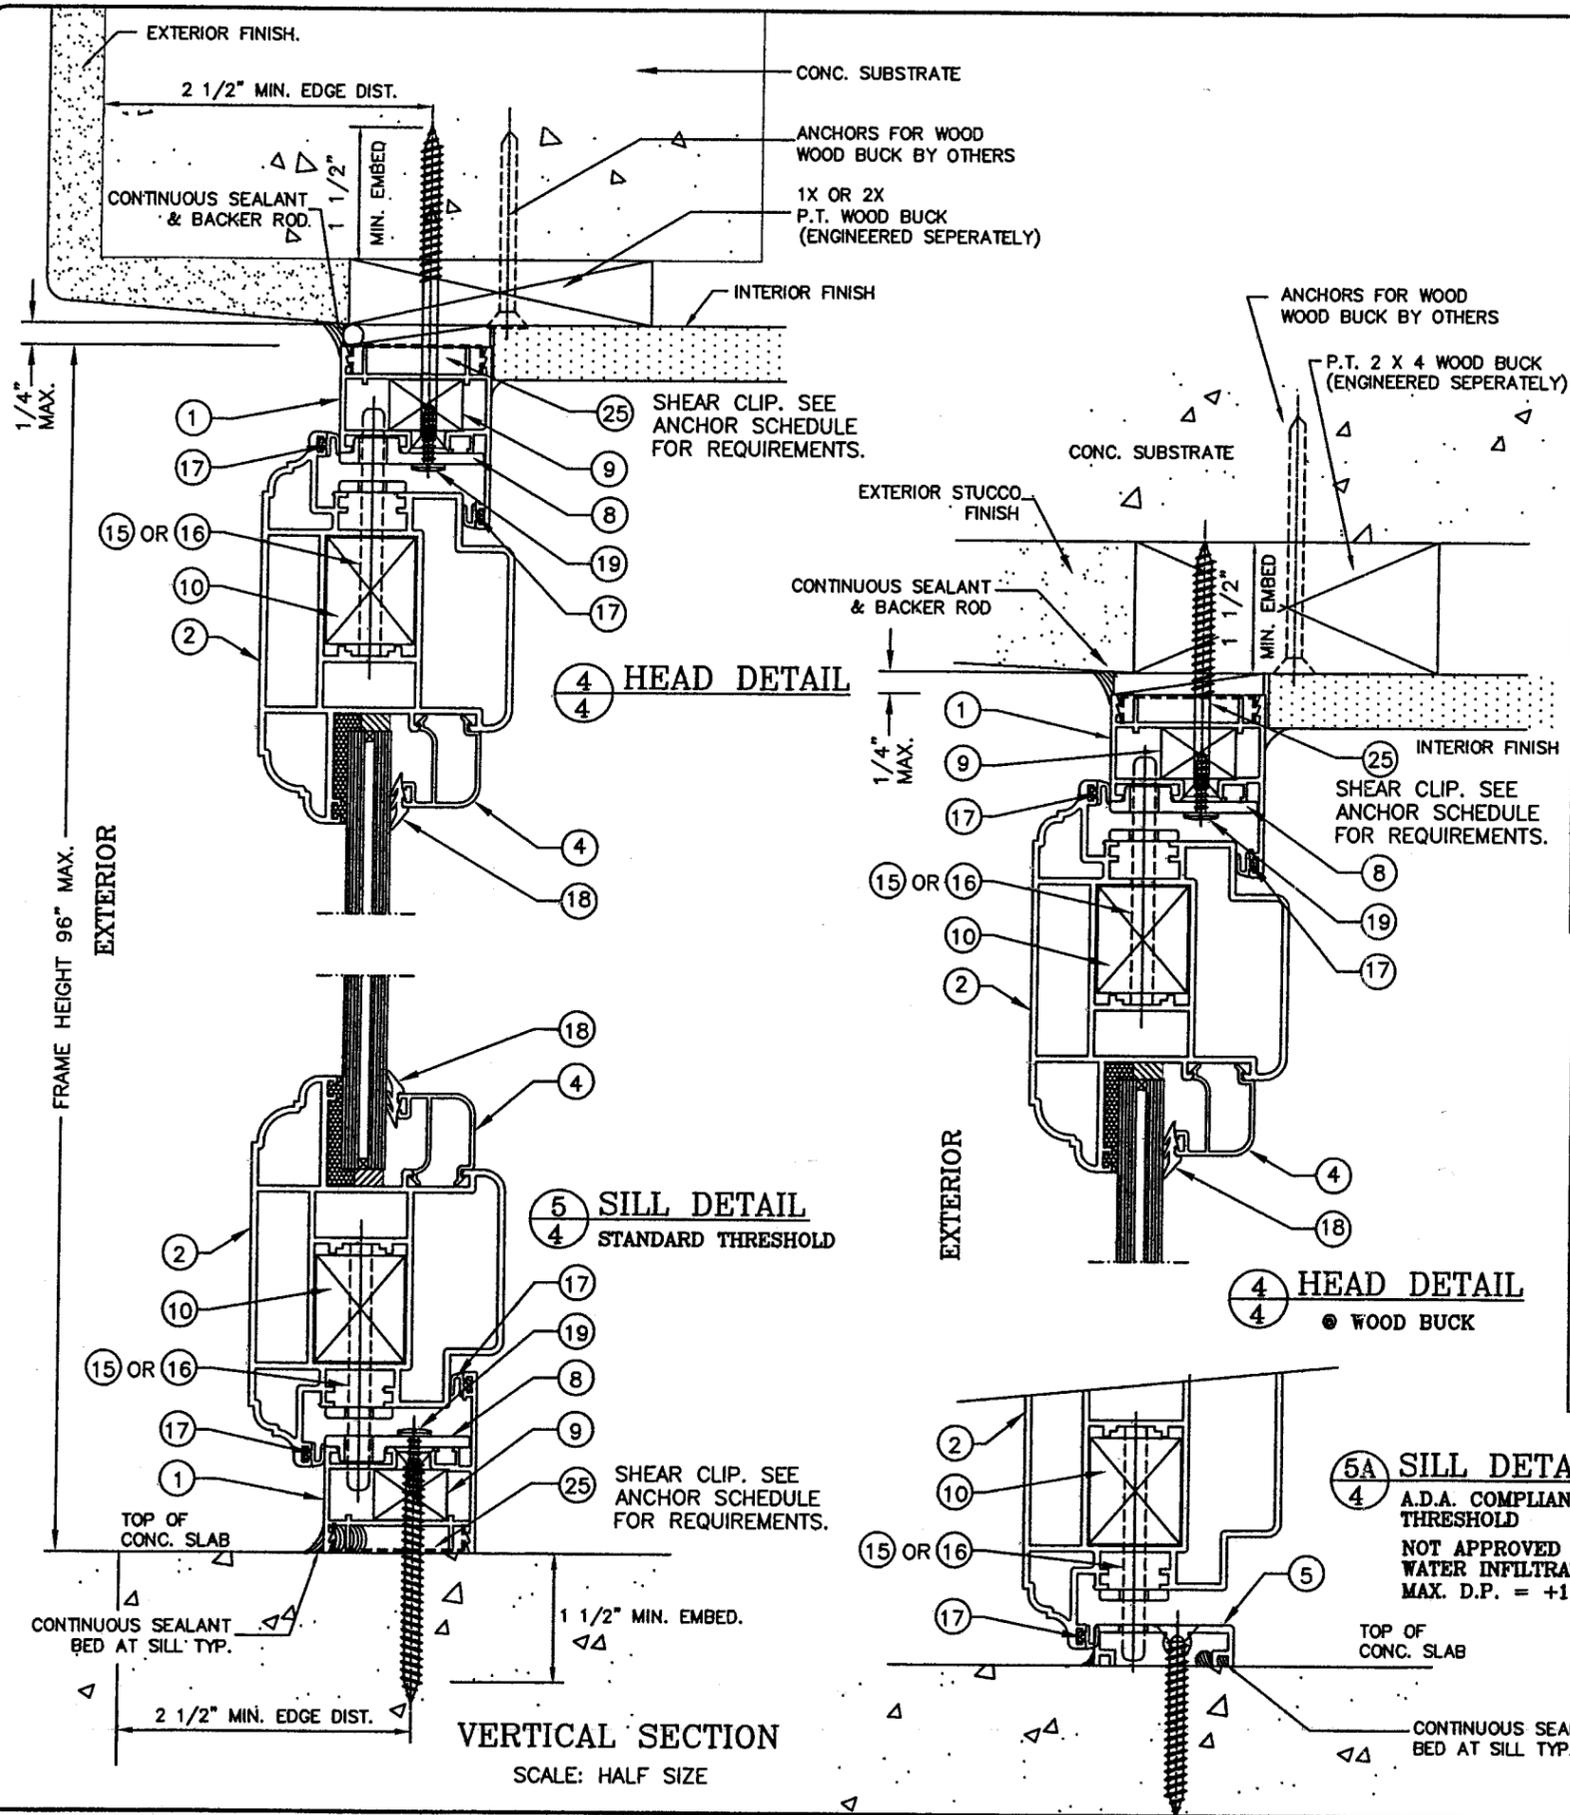

ANCHOR CAPACITY CHART (CONCRETE SUBSTRATE)

1/4" DIA. TAPCON
EDGE DIST. 2 1/2" MIN.
SPACING 2 1/2" MIN.
EMBED 1 3/4" MIN. INTO GROUT FILLED MASONRY
OR
EMBED 1 1/2" MIN. INTO 3000 PSI CONC.
START 7" FROM ENDS, BALANCE PER CHART.

MAXIMUM ALLOWABLE DESIGN PRESSURE	ANCHORS AT JAMBS		QTY. ANCHORS AT INTERLOCK	
	(W/O SHEAR CLIP)	(W/ SHEAR CLIP)	(W/O SHEAR CLIP)	(W/SHEAR CLIP)
≤ 50 P.S.F.	20" C/C	20" C/C	3	2
≤ 60 P.S.F.	16" C/C	20" C/C	4	2
≤ 70 P.S.F.	16" C/C	20" C/C	4	2
≤ 80 P.S.F.	16" C/C	20" C/C	--	3
≤ 90 P.S.F.	12" C/C	20" C/C	--	3
>90-110 P.S.F.	10" C/C	20" C/C	--	3

SPACED 2 1/2" APART

ANCHOR CAPACITY CHART (STEEL SUBSTRATE)

#14 P.H.S.M.S. OR #14 SELF DRILLING
INTO 1/8" THK. ASTM A36
START 7" FROM ENDS, BALANCE PER CHART.

MAXIMUM ALLOWABLE DESIGN PRESSURE	ANCHORS AT JAMBS		QTY. ANCHORS AT INTERLOCK	
	(W/O SHEAR CLIP)	(W/ SHEAR CLIP)	(W/O SHEAR CLIP)	(W/SHEAR CLIP)
≤ 50 P.S.F.	12" C/C	20" C/C	4	2
≤ 60 P.S.F.	12" C/C	20" C/C	5	2
≤ 70 P.S.F.	10" C/C	20" C/C	6	2
≤ 80 P.S.F.	9" C/C	20" C/C	--	3
≤ 90 P.S.F.	8" C/C	20" C/C	--	3
>90-110 P.S.F.	6.5" C/C	20" C/C	--	3

SPACED 2 1/2" APART


ANCHOR CAPACITY CHART (WOOD SUBSTRATE)

#14 P.H.S.M.S. OR #14 WOOD SCREW
EMBED 1 1/2" MIN. INTO NO. 2 SYP.
START 7" FROM ENDS, BALANCE PER CHART.

MAXIMUM ALLOWABLE DESIGN PRESSURE	ANCHORS AT JAMBS		QTY. ANCHORS AT INTERLOCK	
	(W/O SHEAR CLIP)	(W/ SHEAR CLIP)	(W/O SHEAR CLIP)	(W/SHEAR CLIP)
≤ 50 P.S.F.	12" C/C	12" C/C	4	2
≤ 60 P.S.F.	12" C/C	12" C/C	5	2
≤ 70 P.S.F.	10" C/C	12" C/C	6	2
≤ 80 P.S.F.	9" C/C	12" C/C	--	3
≤ 90 P.S.F.	8" C/C	12" C/C	--	3
>90-110 P.S.F.	6.5" C/C	12" C/C	--	3

SPACED 2 1/2" APART

LA FINESTRA, L.C.
ITALIAN WINDOWS & DOORS
2790 N.W. 104 Court
Miami, FL 33172
Phone (305) 599-8093
Fax (305) 592-4671



BROMLEY-COOK ENGINEERING, INC.
STRUCTURAL ENGINEERING SERVICES
8440 N.W. 53RD AVENUE, SUITE 190
FORT LAUDERDALE, FL 33309
STATE OF FLORIDA
REGISTERED PROFESSIONAL ENGINEER
NO. 12510
WILLIAM D. COOK, P.E.
PROFESSIONAL ENGINEER

PRODUCT:
**SERIES EKU-53
ALUMINUM OUTSWING
ENTRANCE DOOR**


REVISIONS

No.	DATE	DESCRIPTION
	4/12/2010	FINAL REVISIONS


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **08-1126.02**
Expiration Date **02/27/2013**
By *[Signature]*
Miami Dade Product Control
Division

DATE: 11/04/2008
SCALE: AS NOTED
DWG. BY: R.C.
CHK. BY:
DRAWING No.:
FIN-B16/05R2
SHEET 4 OF 8

PROFILE COMBINATIONS

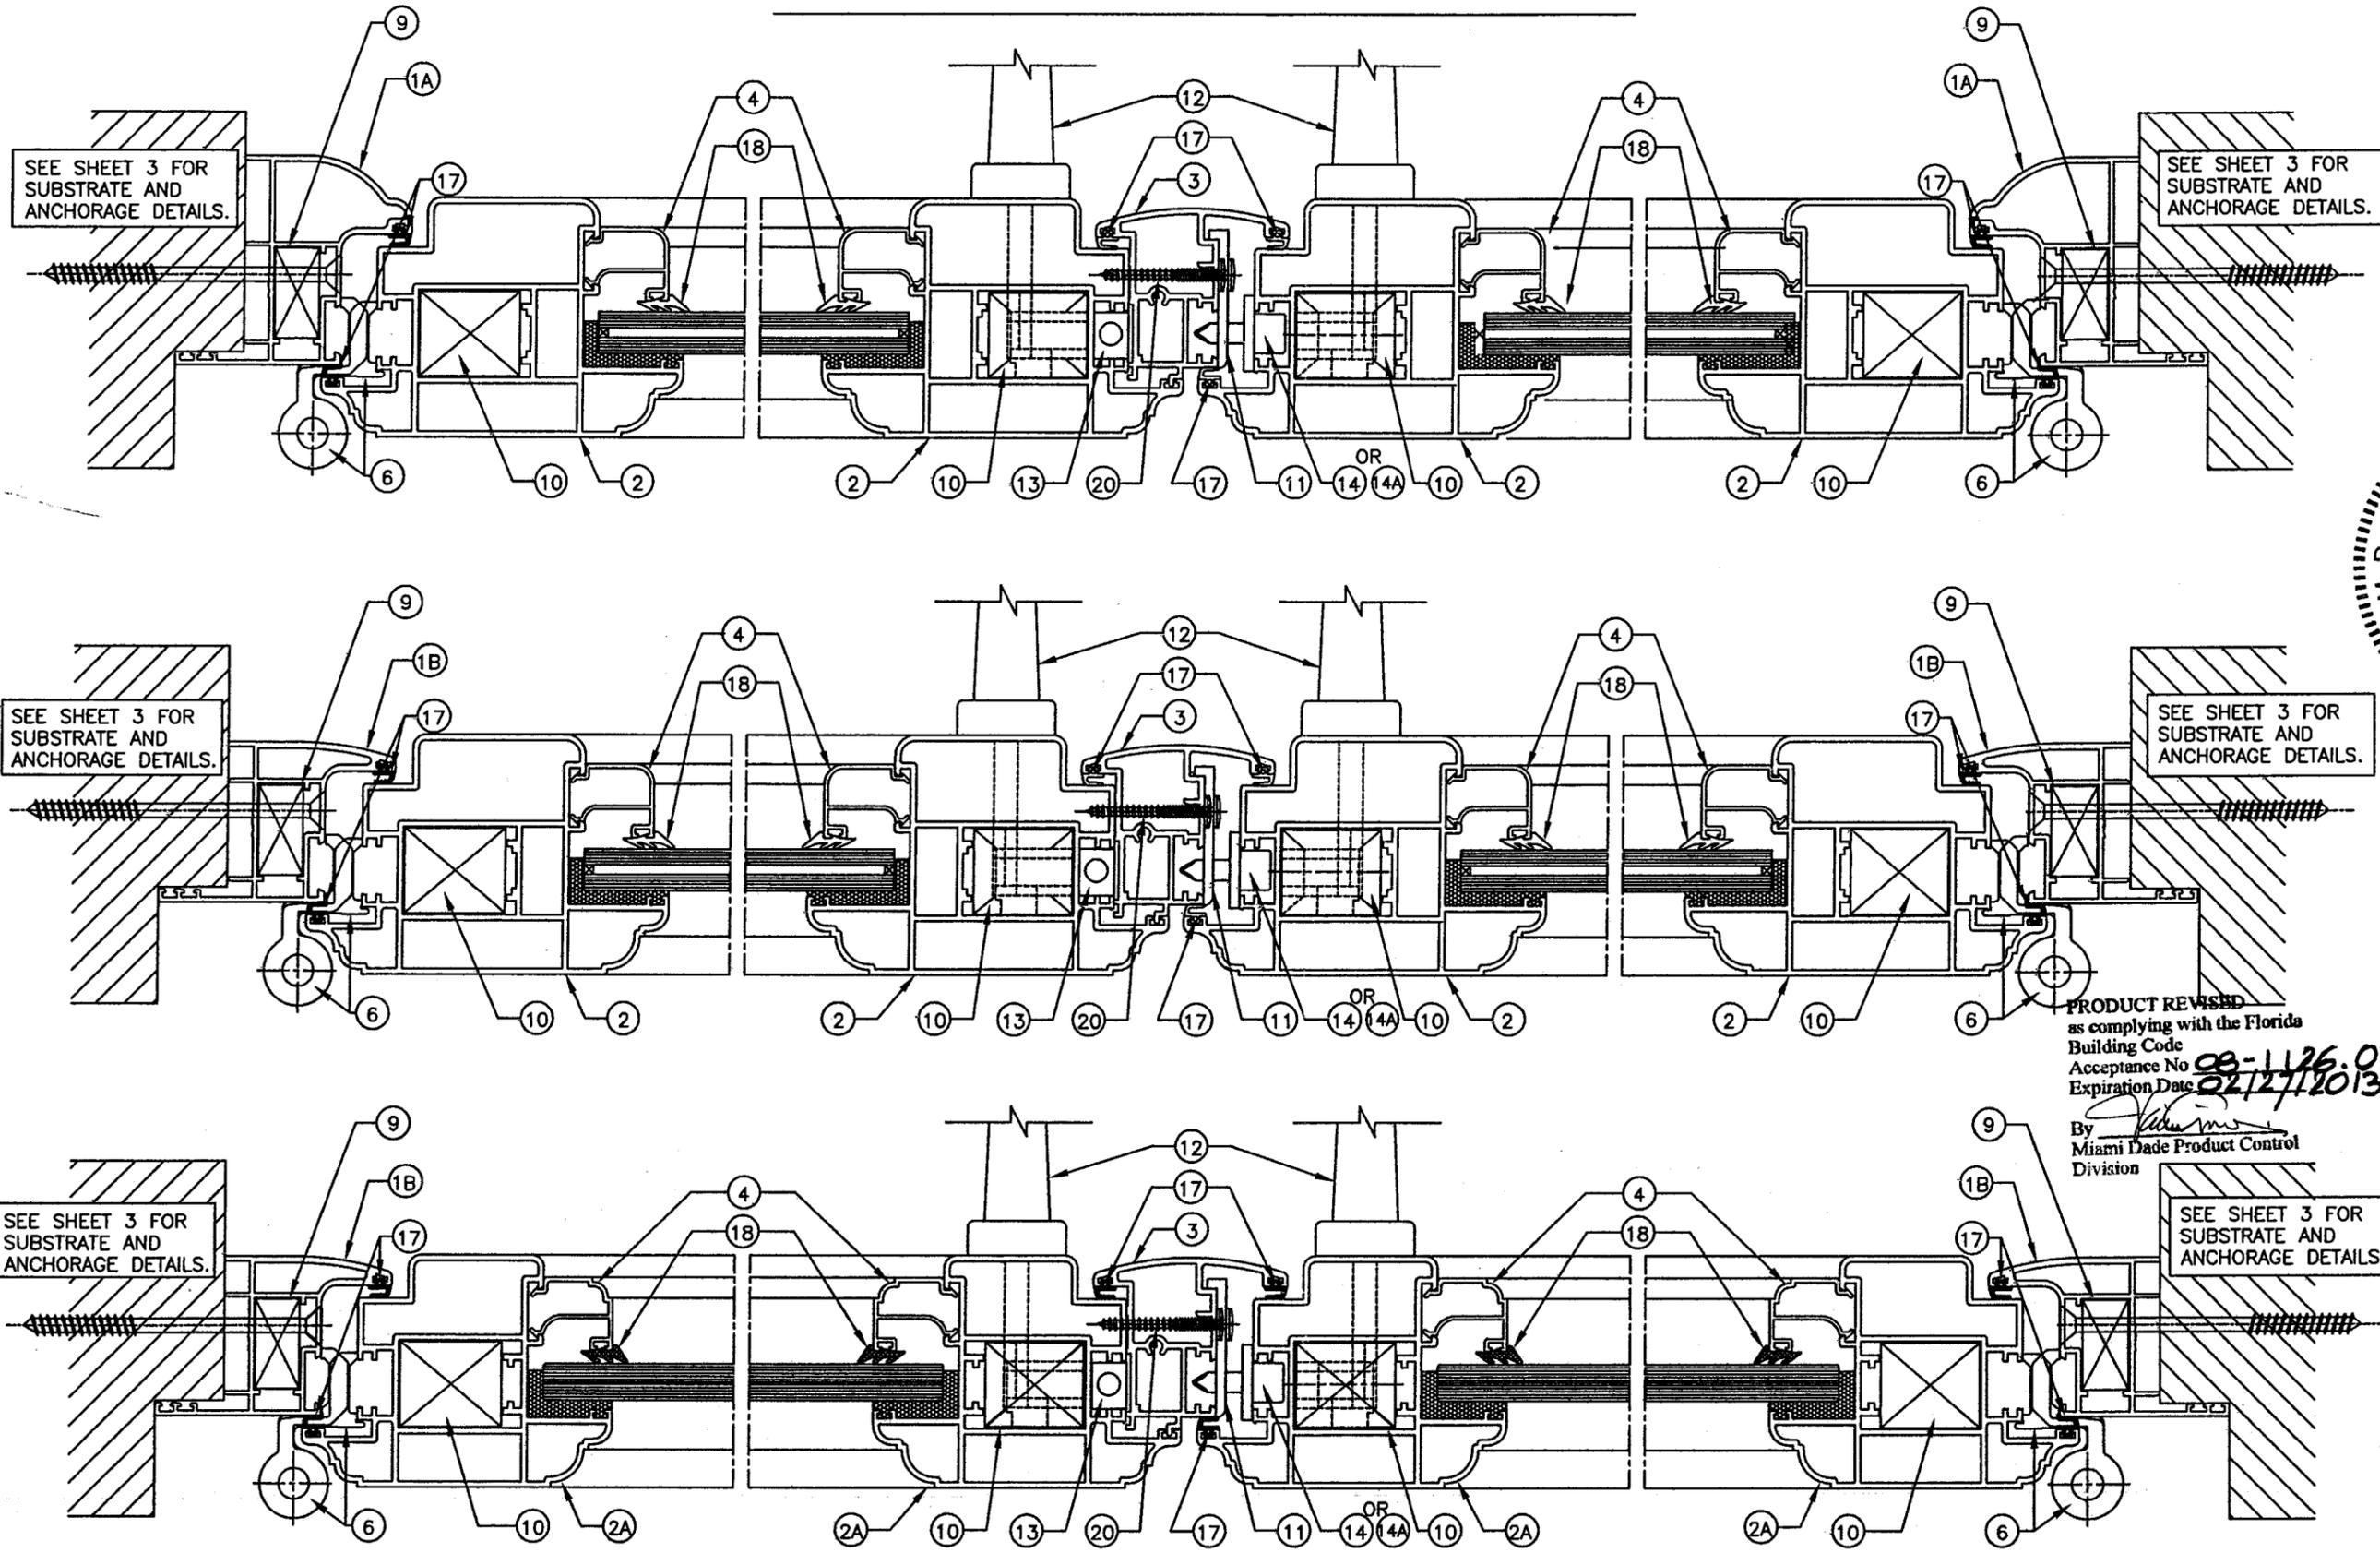

L.A. FINESTRA, L.C.
 ITALIAN WINDOWS & DOORS
 2790 N.W. 104 Court
 Miami, FL 33172
 Phone (305) 599-8093
 Fax (305) 592-4671



PROFESSIONAL ENGINEERING, INC.
 STRUCTURAL ENGINEERING SERVICES
 8440 N.W. 43RD AVENUE, SUITE 100
 FORT LAUDERDALE, FL 33308
 APR 15 2010
 WILLIAM D. COOK P.E. 15804
 PROFESSIONAL SEAL



PRODUCT:
**SERIES EKU-53
 ALUMINUM OUTSWING
 ENTRANCE DOOR**

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **08-1126.02**
 Expiration Date **02/27/2013**
 By *[Signature]*
 Miami Dade Product Control
 Division


REVISIONS	DATE	DESCRIPTION
No.	4/12/2010	FINAL REVISIONS

DATE: 11/04/2008
 SCALE: AS NOTED
 DWG. BY: R.C.
 CHK. BY:

DRAWING No.:
FIN-B16/05R2
 SHEET 5 OF 8

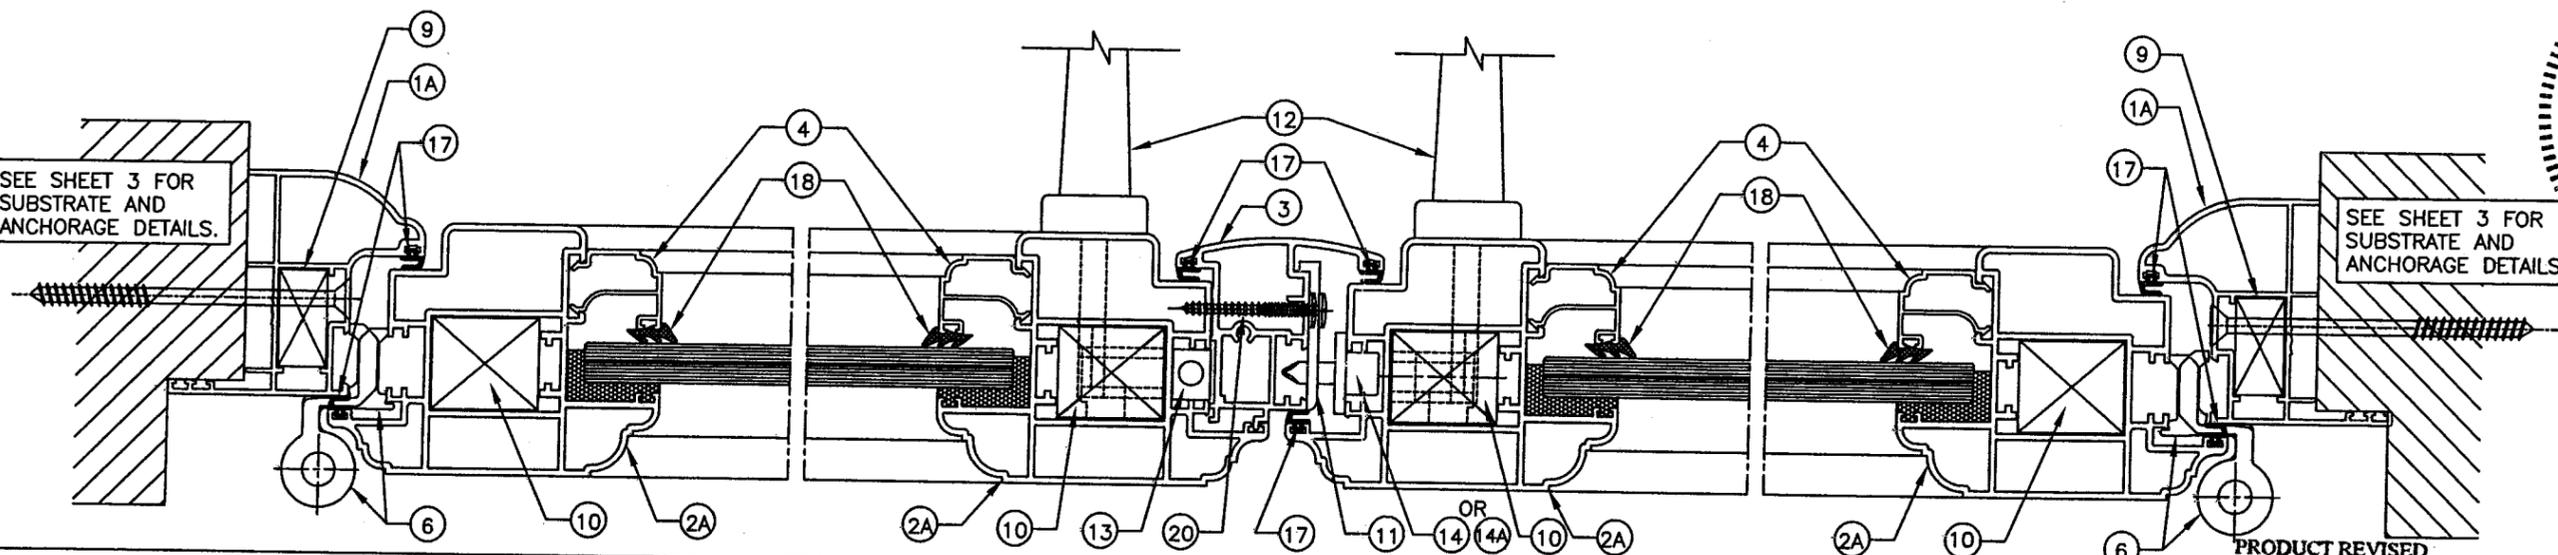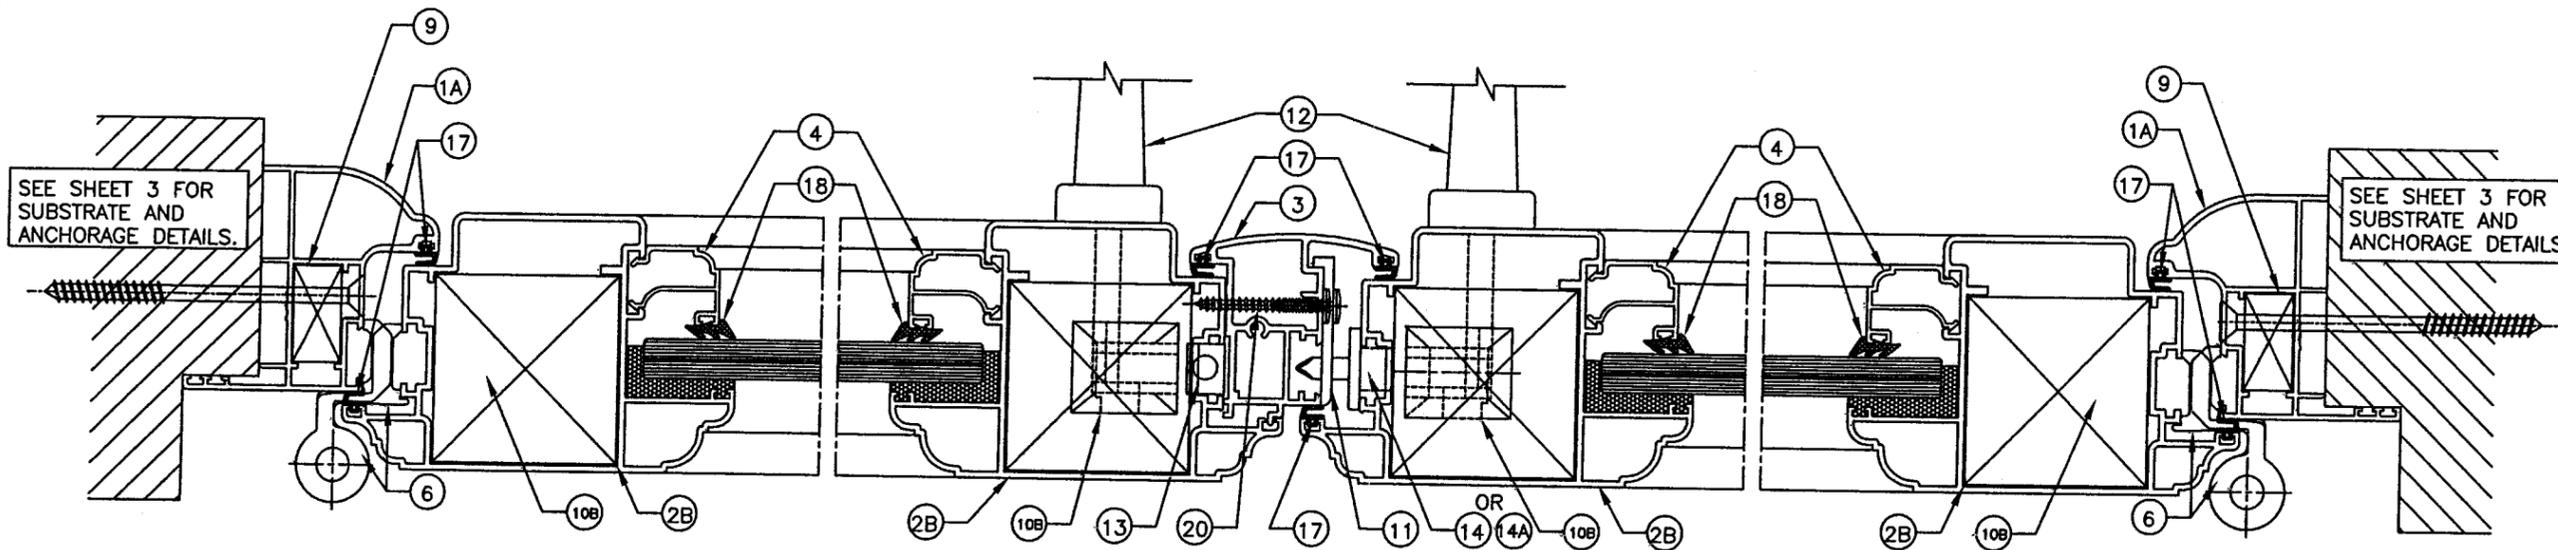

MAXIMUM P.S.F. +90.00 -90.00 DESIGN PRESSURE - WATER INFILTRATION TEST PRESSURE = 13.5 PSF

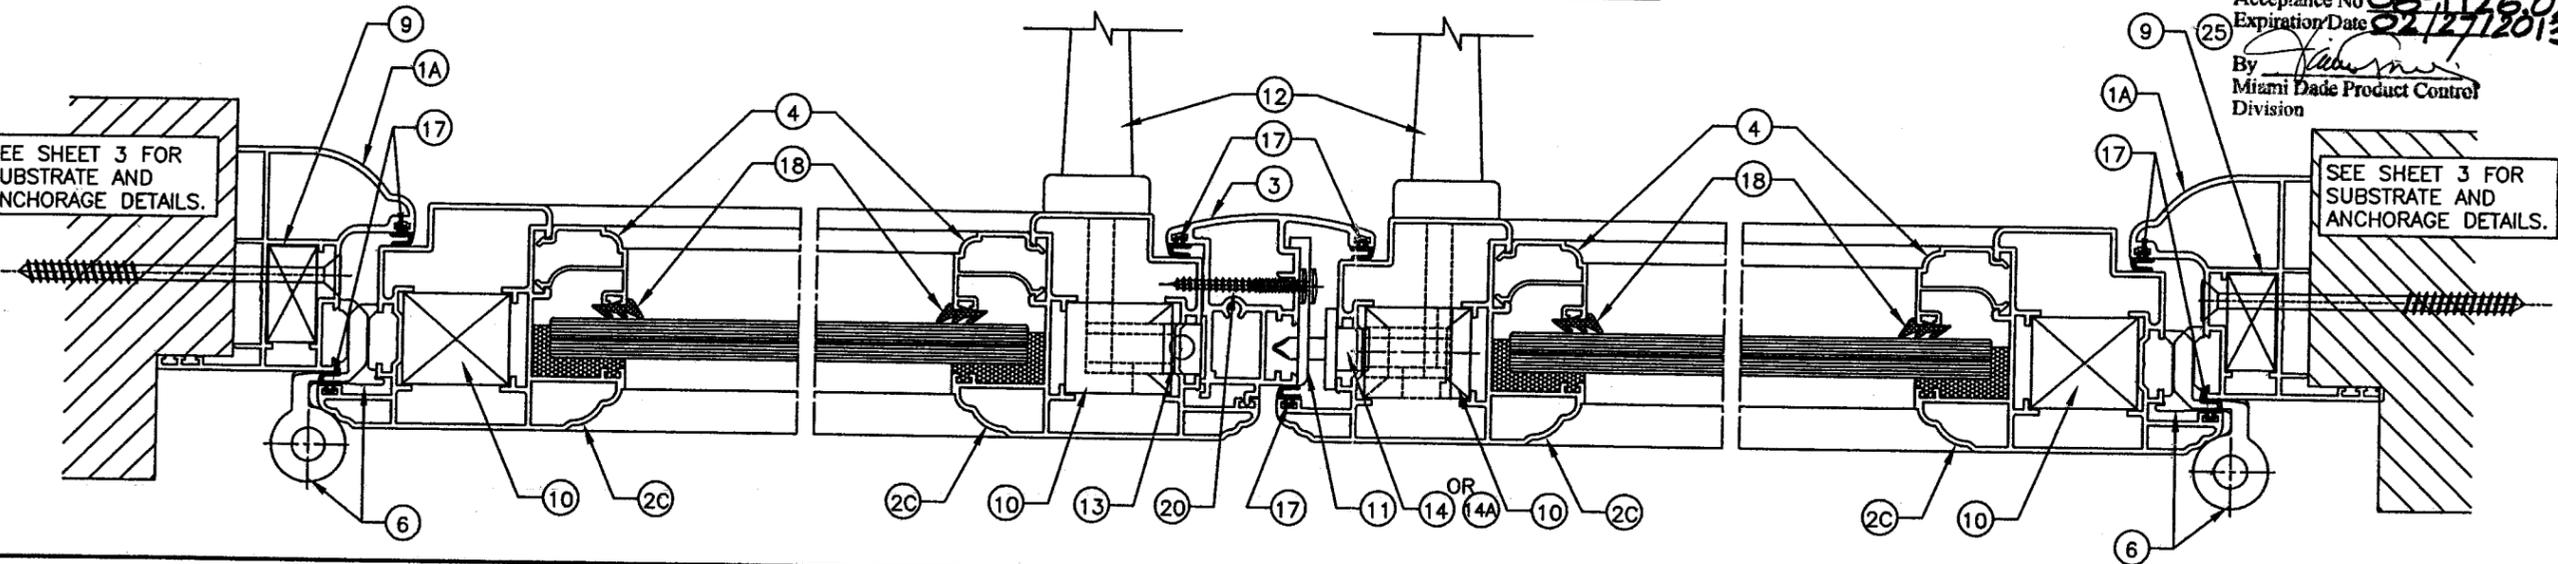

LA FINESTRA, L.C.
 ITALIAN WINDOWS & DOORS
 2790 N.W. 104 Court
 Miami, FL 33172
 Phone (305) 599-8093
 Fax (305) 592-4671


WILLIAM D. COOK
 PROFESSIONAL ENGINEER
 STATE OF FLORIDA
 APR 16 2010
 PROJECT: COOK ENGINEERING, INC.
 STRUCTURAL/ENGINEERING SERVICES
 5440 N.W. 132nd AVENUE SUITE 400
 FORT LAUDERDALE, FL 33306

PRODUCT:
SERIES EKU 53
ALUMINUM OUTSWING
ENTRANCE DOOR


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **08-1126.02**
 Expiration Date **02/27/2013**
 By *[Signature]*
 Miami Dade Product Control
 Division

REVISIONS	DATE	DESCRIPTION	FINAL REVISIONS
No.	4/12/2010		

DATE: 11/04/2008
 SCALE: AS NOTED
 DWG. BY: R.C.
 CHK. BY:
 DRAWING No.:
FIN-B16/05R2
 SHEET 6 OF 8

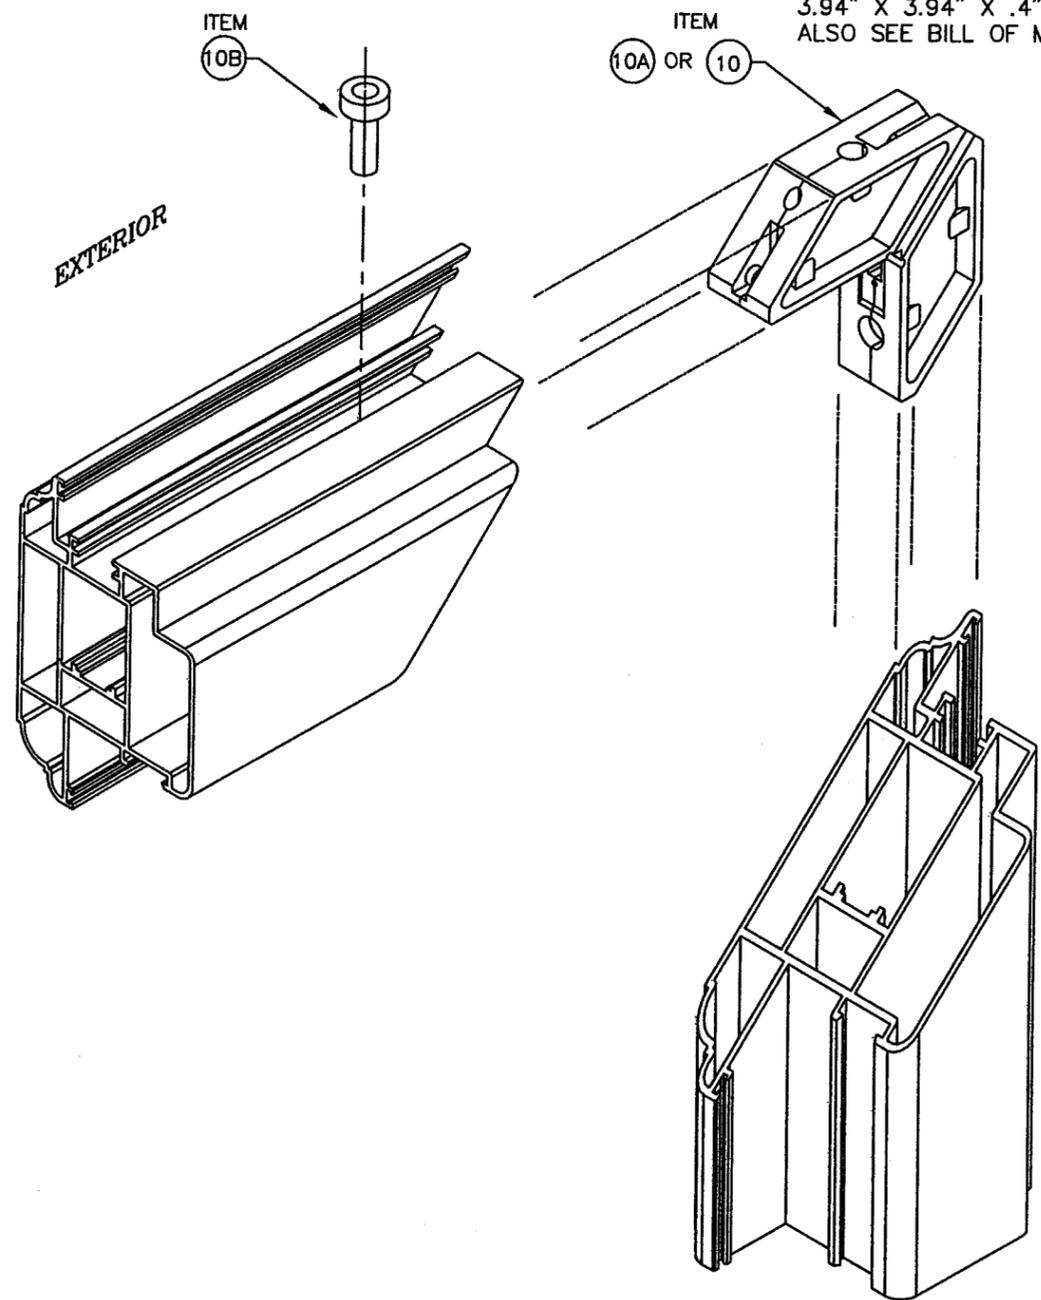

DOOR PANEL CORNER DETAIL

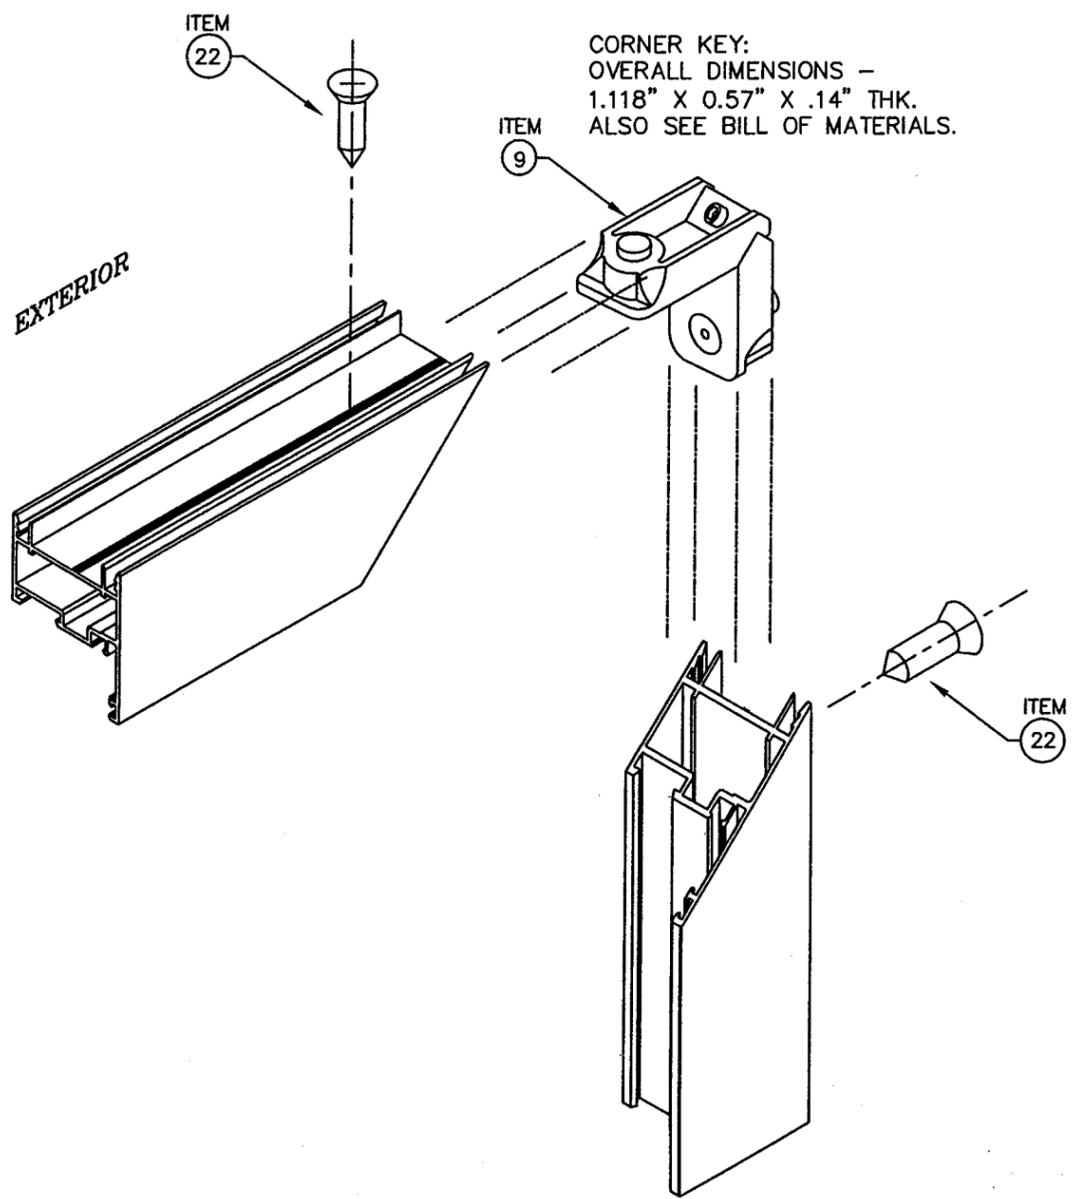

DOOR FRAME CORNER DETAIL

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **08-1126-02**
 Expiration Date **02/27/2013**
 By *[Signature]*
 Miami Dade Product Control
 Division

LA FINESTRA, L.C.
 ITALIAN WINDOWS & DOORS
 2790 N.W. 104 Court
 Miami, FL 33172
 Phone (305) 599-8093
 Fax (305) 592-4671

WILLIAM D. COOK ENGINEERING, INC.
 STRUCTURAL/ENGINEERING SERVICES
 5440 N.W. 36th Avenue, Suite 100
 Fort Lauderdale, FL 33304
 APR 16 2010
 WILLIAM D. COOK, P.E. #5804
 STATE OF FLORIDA

PRODUCT:
**SERIES EKU 53
 ALUMINUM OUTSWING
 ENTRANCE DOOR**


REVISIONS	DESCRIPTION	DATE	FINAL REVISIONS
No.		4/12/2010	

DATE: 11/04/2008
 SCALE: AS NOTED
 DWG. BY: R.C.
 CHK. BY:
 DRAWING No.:
FIN-B16/05R2
 SHEET 7 OF 8


BILL OF MATERIALS

ITEM	PART No.	QUANTITY	DESCRIPTION	MATERIAL	LOCATION	MANUFACTURER
1	7011	4	FRAME HEAD/JAMB/RESIDENTIAL SILL	AL.AL. -6060-T5	DOOR FRAME	PROFILATI SpA
1A	17948	4	FRAME HEAD/JAMB/RESIDENTIAL SILL	AL.AL. -6063-T5	DOOR FRAME	PROFILATI SpA
1B	17949	4	FRAME HEAD/JAMB/RESIDENTIAL SILL	AL.AL. -6063-T5	DOOR FRAME	PROFILATI SpA
2	Z16012	4	PANEL HEAD/JAMB/SILL	AL.AL. -6060-T5	DOOR PANEL	PROFILATI SpA
2A	Z16013	4	PANEL HEAD/JAMB/SILL	AL.AL. -6063-T5	DOOR PANEL	PROFILATI SpA
2B	Z19678	4	PANEL HEAD/JAMB/SILL	AL.AL. -6063-T5	DOOR PANEL	PROFILATI SpA
2C	Z18853	4	PANEL HEAD/JAMB/SILL	AL.AL. -6063-T5	DOOR PANEL	PROFILATI SpA
3	Z16014	1	ASTRAGAL	AL.AL. -6060-T5	INACTIVE LEAF PANEL JAMB	PROFILATI SpA
4	4195	4/VENT	GLAZING BEAD	AL.AL. -6060-T5	PANEL PERIMETER	PROFILATI SpA
5	6009	1	COMMERCIAL THRESHOLD	AL.AL. -6060-T5	FRAME BOTTOM	PROFILATI SpA
6	100-120X	5/VENT	4" LG. TWO-PIECE HINGE ASSY.	AL.AL. -6060-T5	PANEL AND FRAME JAMBS	GSG
6A	100	6/VENT	4" BUTTINGS (3 PAIR)	AL.AL. -6060-T5	PANEL AND FRAME JAMBS	CASALI
7	N/A	2 EA. LITE OF GLASS	1/4" X 1/2" X 3" LG. SETTING BLOCK	EXTRUDED SILICONE	6" FROM ENDS	GENERIC
8	2509	2	FLUSHBOLT STRIKE PLATE (4" LONG)	AL.AL. -6060-T5	FLUSHBOLTS (TOP/BOTTOM)	PROFILATI SpA
8A	003	2	FLUSHBOLT STRIKE PLATE (4" LONG)	S.S.	FLUSHBOLT STRIKE PLATE	LAFIN
9	0409	1 EA. CORNER	FRAME CORNER KEY	CAST ALUMINUM	FRAME CORNERS	MONTICELLI
10	5004	1 EA. CORNER	PANEL CORNER KEY	CAST ALUMINUM	PANEL CORNERS	MONTICELLI
10A	001	1 EA. CORNER	PANEL CORNER KEY	EXT. ALUMINUM	PANEL CORNERS	PROFILATI SpA
10B	002	1 EA. CORNER	#14 x 3/4" CORNER KEY SET SCREW	CAST ALUMINUM	PANEL CORNERS	PROFILATI SpA
11	Z17173	1	STRIKE PLATE FOR LOCK SYSTEM	AL.AL. -6060-T5	ASTRAGAL	PROFILATI SpA
11A	Z004	1	STRIKE PLATE FOR LOCK SYSTEM	AL.AL. -6060-T5	ASTRAGAL	LAFIN
12	SERIES 800	1/VENT	OPERATING HANDLE	ALUMINUM	EACH PANEL JAMB	PASINI
13	1025	1	TRANSMISSION MOVEMENT DEVISE	ZAMA/S.S.	PANEL JAMB ASTRAGAL SIDE ONLY	GSG
14	AS 6570	1/VENT	FIVE POINT LOCK SYSTEM	ZINC/IRON/S.S.	PANEL JAMB	KFV
14A	AM	1/VENT	FIVE POINT LOCK SYSTEM	ZINC/IRON/S.S.	PANEL JAMB	AMESBURY
15	03	2/VENT	FLUSH BOLT (HEAVY DUTY)	S.S.	PANEL JAMB AT TOP & BOTTOM	LAFIN
15A	2167	2/VENT	FLUSH BOLT	S.S./ALUMINUM/ZAMA	INACTIVE PANEL JAMB TOP & BOTTOM	GSG
16	4031	2/VENT	MUSHROOM HEAD AND KEEPERS	S.S./ALUMINUM	PANEL JAMB AT TOP & BOTTOM	GSG/LAFIN
17	2666	AS REQ'D.	WEATHERSTRIP GASKET	EPDM	FRAME JAMB/ASTRAGAL/FRAME PANEL	PROFILATI SpA
18	2195	AS REQ'D.	WEDGE GASKET	EPDM	PANEL GLAZING PERIM. (INTERIOR)	PROFILATI SpA
19	---	2/EACH	# 10 x 2 1/2" FH.SMS. (ASSEMBLY)	PLATED STEEL	FLUSHBOLT STRIKE PLATE	---
20	---	SEE ELEV.	# 8 x 1 1/2" FH.SMS. (ASSEMBLY)	PLATED STEEL	ASTRAGAL (SINGLE ROW)	---
21	28PZW	1	SINGLE POINT LOCK	IRON ZINC	ACTIVE LEAF PANEL	KFV
22	---	2 EA. CORNER	#14 X 3/4" FH. SMS. (PANEL ASS'Y)	PLATED STEEL	PANEL CORNERS	---
23	895/995	CONTINUOUS	STRUCTURAL SILICONE	SILICONE	PERIMETER GLASS TO METAL	PECORA OR DOW CORNING
24	01SX-02DX	2/VENT	TRANSMISSION DEVICE	S.S./ZINC/IRON	PANEL JAMB TOP & BOTTOM	ELLEGI
25	---	AS REQ'D.	.059 SHEAR CLIP X 2.5" LONG.	AL.AL.-6063-T5	LA FINESTRA	---


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **08-1126.02**
Expiration Date **02/27/2013**
By *[Signature]*
Miami Dade Product Control
Division




① 7011 - FRAME HEAD-JAMB-SILL

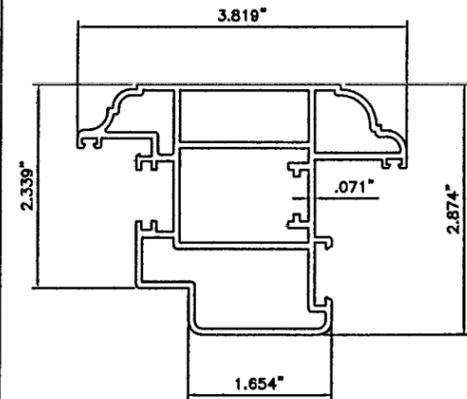


②A Z16013 PANEL HEAD/JAMB/SILL

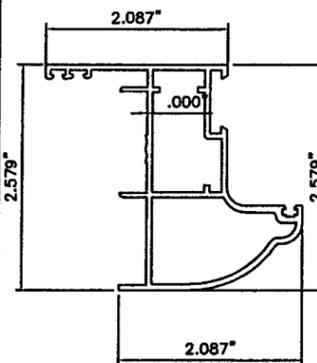


①A 17948 - FRAME HEAD-JAMB-SILL

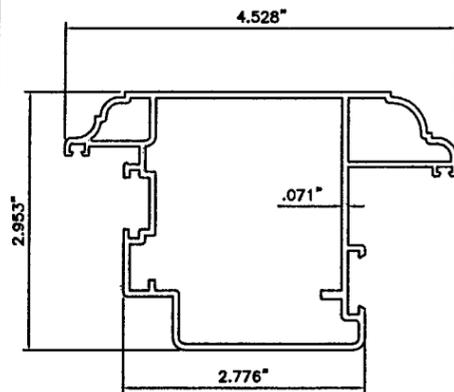


②B Z19678 PANEL HEAD/JAMB/SILL

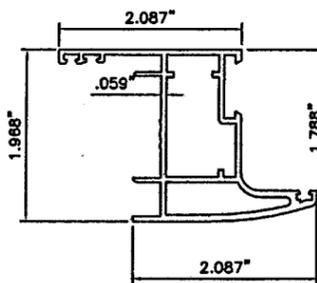


①B 17949 - FRAME HEAD-JAMB-SILL

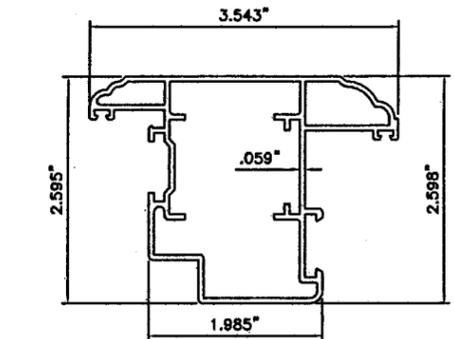


②C Z18853 PANEL HEAD/JAMB/SILL




④ 4195 GLAZING BEAD

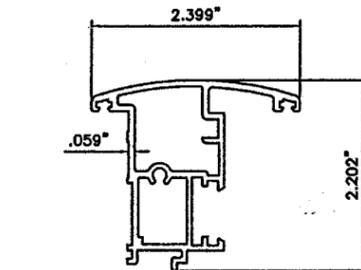


③ Z16014 ASTRAGAL

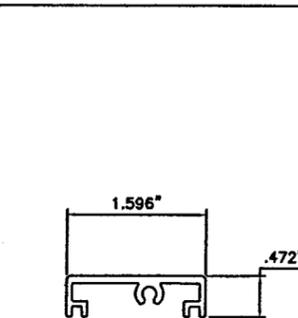


⑤ 6009 COMMERCIAL THRESHOLD

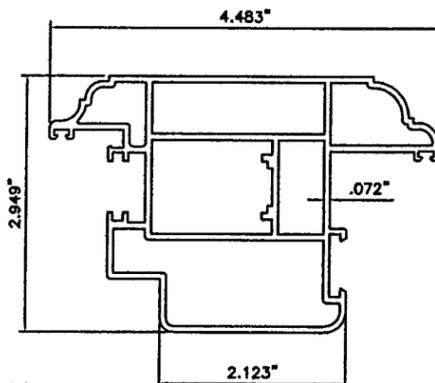


② Z16012 PANEL HEAD/JAMB/SILL

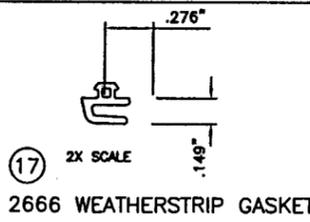

①⑦ 2X SCALE
2666 WEATHERSTRIP GASKET




①⑧ 2X SCALE
2195 WEDGE GASKET



②⑤ ANCHOR SHEAR CLIP

LA FINESTRA, L.C.
ITALIAN WINDOWS & DOORS
2790 N.W. 104 Court
Miami, FL 33172
Phone (305) 599-8093
Fax (305) 592-4671



BROMBERG ENGINEERING INC.
STRUCTURAL ENGINEERING SERVICES
5340 N.W. 33RD AVENUE, SUITE 100
FORT LAUDERDALE, FL 33309
APR 16 2010
WILLIAM D. COOK P.E. #43902
STATE OF FLORIDA
PROFESSIONAL ENGINEER

PRODUCT:
**SERIES EKU 53
ALUMINUM OUTSWING
ENTRANCE DOOR**

REVISIONS	DATE	DESCRIPTION	FINAL REVISIONS
No.	4/12/2010		

DATE: 11/0/08
SCALE: AS NOTED
DWG. BY: R.C.
CHK. BY:

DRAWING No.:
FIN-B16/05R2
8 OF 8