



BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

Atrium Florida, Inc.
 9001 Ambassador Row
 Dallas, TX 75247

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "MPSGD" Aluminum Sliding Glass Door w/ reinforcements

APPROVAL DOCUMENT: Drawing No. **W04-10**, titled "Series MPSGD Alum Sliding Glass Door", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 02/11/04 and last revised on May 21, 2009, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Jacksonville, Florida and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews & replaces** NOA # **04-0302.02 (Kinco, LTD)** consists of this page 1 and evidence sheets E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

NOA No 08-1216.04

Expiration Date: May 20, 2014

Approval Date: June 10, 2009

Page 1



5/26/09

Atrium Florida, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Original documents transferred from Kinco file # **04-0304.02**)
2. Drawing No. **W04-10**, titled "Series MPSGD Alum Sliding Glass Door", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 02/11/04 and last revised on May 21, 2009, signed and sealed by Arshad Viqar, P.E.

B. TESTS (Original documents transferred from Kinco file # **04-0304.02**)

1. Test reports on
 - 1) Air Infiltration Test, per TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per TAS 202-94
 - 3) Water Resistance Test, per TAS 202-94.
 - 4) Forced Entry Test per FBC 2411.3.2.1 and TAS202-94.
 - 5) Large Missile Impact Test, per TAS 201-94
 - 6) Cyclic Wind Pressure Loading, per TAS 203-94

Along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Certified Testing Laboratories, Test Report No. **CTLA 1206W** dated 12/23/03, **CTLA 1206W-1** dated 01/28/04 and **CTLA 1229W** dated 07/13/04, all signed and sealed by Ramesh Patel, P.E.

C. CALCULATIONS

1. Comparative analysis and structural analysis, complying w/ FBC 2007, prepared by Al-Farooq Corporation, dated 03-29-09, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Statement letter of compliance dated May 21, 2009 to FBC 2007, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.
3. Glazing complies w/ASTME-1300-02 and-04.

D. QUALITY ASSURANCE BY:


1. Miami-Dade Building Code Compliance Office.

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont De Nemours & CO., Inc. for "DuPont SentryGlas® Plus", expiring on 01/14/2012.
2. Notice of Acceptance No. **08-0520.08** issued to Solutia, Inc. for "Vanceva Composites", expiring on 12/11/13.
3. Notice of Acceptance No. **08-0709.04** issued to Nebula Glass Int'l. dba Glasslam for "Safety Plus-II laminated Glass", expiring on 08/17/2013.

F. STATEMENTS

1. Asset purchase agreement dated July 27, 2005 between Simonton Building Products Florida Inc. (seller) and Atrium Companies Inc. (Delaware corp) (Buyer) signed by Greg, Schorr, CFO (Simonton) and Mark Blanchat, E.V.P. (Atrium).
2. Statement letter dated Feb. 16, 2006 issued by Simonton Windows for transfer of NOA(s) by Simonton Building Products to Atrium Windows and requesting BCCO to rescind the referenced NOA(s), signed by Rick Keup, President Simonton Windows, the letter notarized on June 04, 2007.



Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 08-1216.04
Expiration Date: May 20, 2014
Approval Date: June 10, 2009

Atrium Florida, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (Continue:)


- 3 Statement letter dated April 17, 2008 issued by Atrium Companies Inc authorizing Atrium Florida, Inc. (dba Atrium Windows & Doors) to use test report purchased by Atrium Inc from Simonton Building Products of Florida to acquire Notice of Acceptances NOA.
4. Statement letter of conformance and "No financial interest", dated 05/21/09, prepared by Al-Farooq Corporation, signed and sealed by Asrhad Viqar, P.E.
5. Statement of compliance, issued as part of above referenced test report by Certified Testing laboratories.

G. OTHER

1. This NOA # **08-1216.04** revises renews & replaces NOA # **04-0302.02 (Kinco, LTD)**.
2. Sales & Purchase agreement between Simonton Building Products and Atrium Companies Inc.
3. Letter of Authorization of purchased test reports by Atrium Companies Inc to Atrium Florida Inc. to obtain NOA(s) from Miami-Dade County.
4. Various correspondences and e-mails between BCCO and Atrium Companies Inc.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 08-1216.04
Expiration Date: May 20, 2014
Approval Date: June 10, 2009

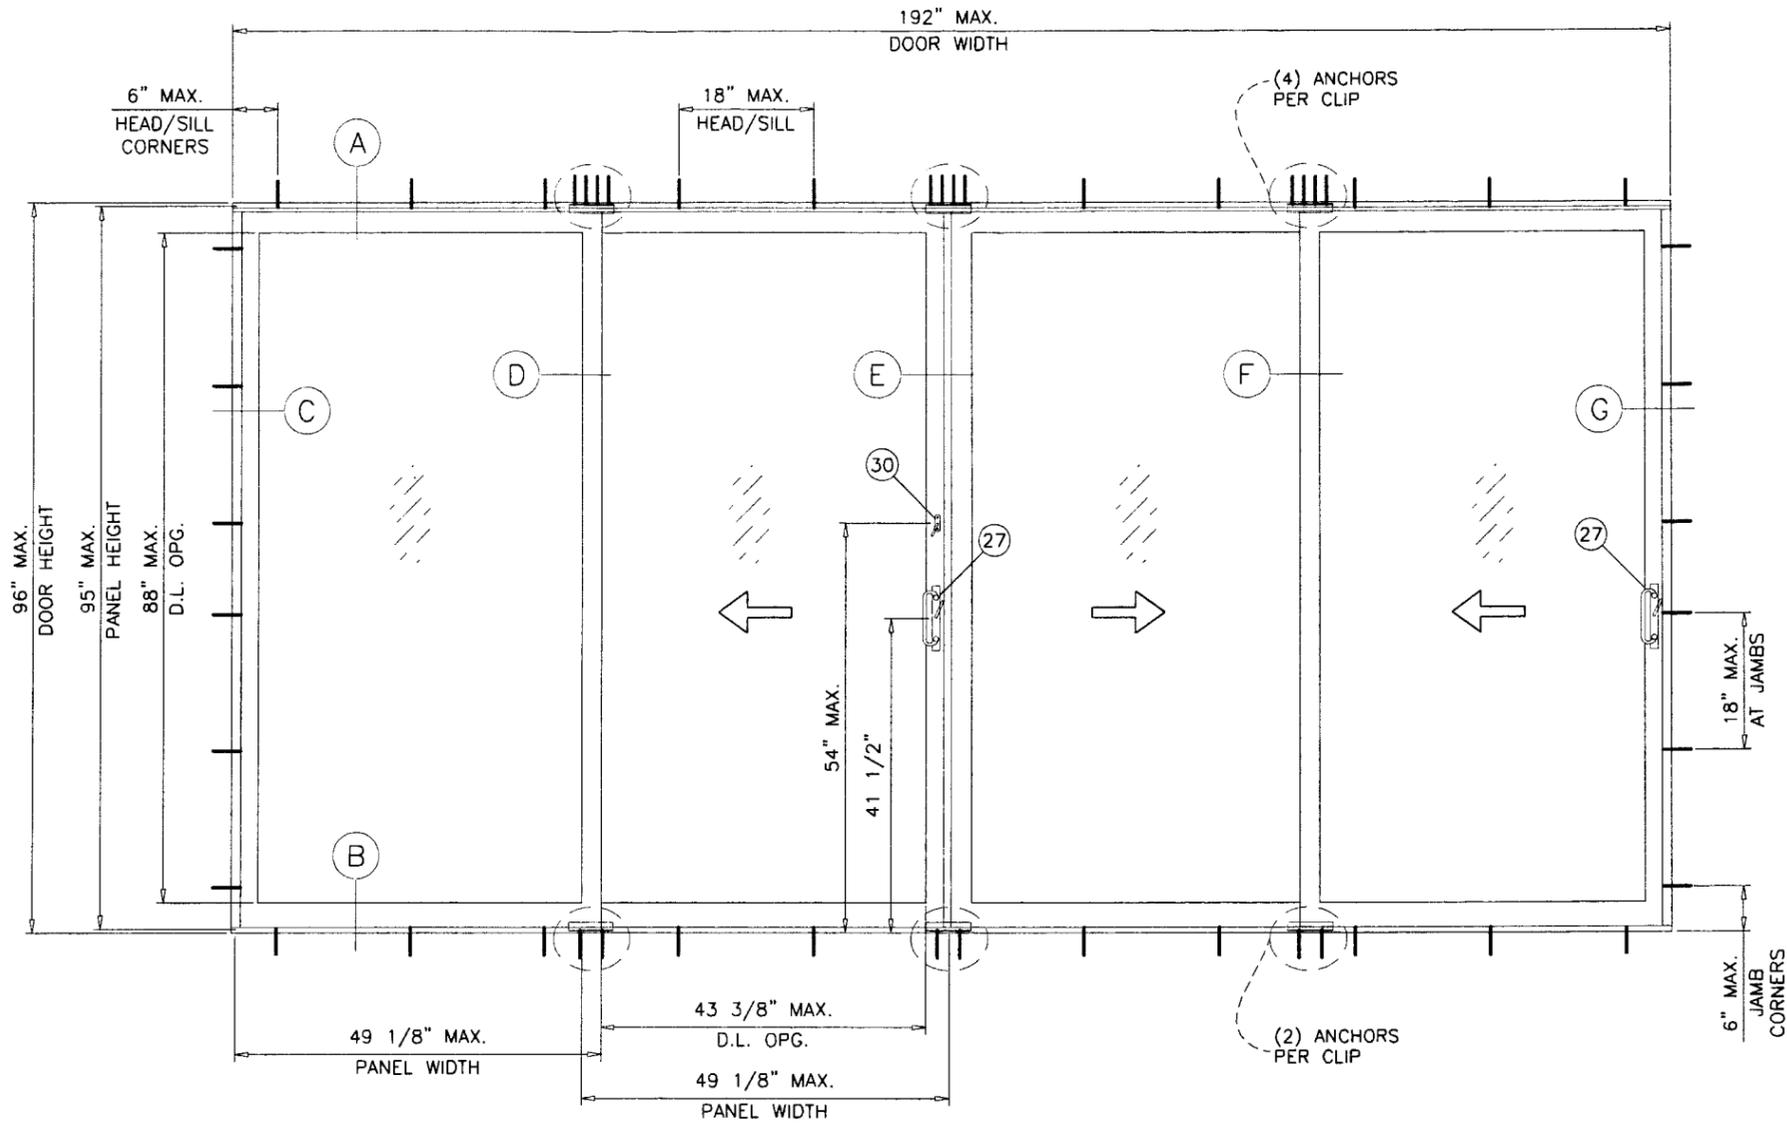

TYPICAL ELEVATION
TESTED UNIT

SERIES-MPSGD ALUM SLIDING GLASS DOOR (L.M.I. & S.M.I.)

DESIGN LOAD RATING FOR DOORS TO BE AS PER CHART SHOWN ON SHEET 2.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

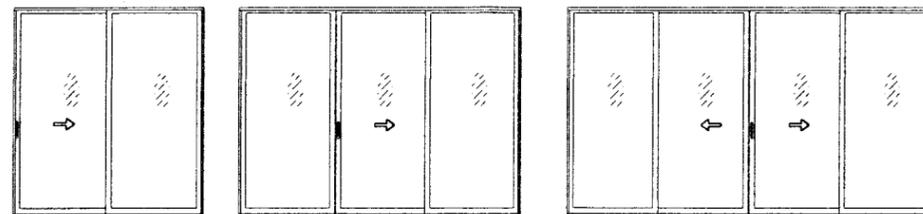

XO (SHOWN)
OX
XX

OXO (SHOWN)

OXXO

APPROVED CONFIGURATIONS

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
Arshad Viqar
MAY 21 2009

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 08-1216-04
Expiration Date MAY 20, 2014
By: *Shag I. Chand*
Miami-Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-10KL

SERIES-MPSGD ALUM SLIDING GLASS DOOR (L.M.I./S.M.I.)
TRIUM FLORIDA, INC.
3600 PORT JACKSONVILLE PARKWAY
JACKSONVILLE, FL. 32226
TEL. (904) 355-1476 FAX. (904) 353-0689

no	date	description
A	03.19.04	REV. PER BCCO COMMENTS
B	02.19.09	GENERAL REVISION

revisions:


date: 02-11-04
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W04-10


sheet 1 of 6

DESIGN LOAD CAPACITY - PSF GLASS TYPES 'A', 'A1', 'B', 'B1' OR 'C', 'C1'					
PANEL WIDTH NOMINAL	DOOR HEIGHT	2-1/2" SILL		3-1/4" SILL	
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
36"	80"	50.0	80.0	70.0	80.0
40"		50.0	80.0	70.0	80.0
44"		50.0	80.0	70.0	80.0
48"		50.0	80.0	70.0	80.0
52"		50.0	80.0	70.0	80.0
56"		50.0	80.0	70.0	80.0
36"	96"	50.0	80.0	70.0	80.0
40"		50.0	80.0	70.0	80.0
44"		50.0	80.0	70.0	80.0
48"		50.0	80.0	70.0	80.0


ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	KCO-295	1	FRAME HEAD	6063-T6	-
2	KCO-317	1	FRAME SILL (2-1/2" LEG)	6063-T6	-
2A	KCO-318	1	FRAME SILL (3-1/4" LEG)	6063-T6	-
3	KCO-304	1	FRAME JAMB	6063-T6	-
4	KCO-313	1/ PANEL	TOP RAIL	6063-T6	-
5	-	-	-	-	-
6	KCO-312	1/ PANEL	BOTTOM RAIL	6063-T6	-
7	KCO-302	AS REQD.	LOCK STILE	6063-T6	-
8	KCO-305	AS REQD.	INNER INTERLOCK	6063-T6	-
9	KCO-308	AS REQD.	OUTER INTERLOCK	6063-T6	-
10	KCO-310	AS REQD.	ASTRAGAL STILE	6063-T6	-
11	RP-931	AS REQD.	GLASS STOP (LAM. GLASS)	RIGID PVC	-
11A	RP-930	AS REQD.	GLASS STOP (INSUL. GLASS)	RIGID PVC	-
12	KCO-303	AS REQD.	INNER INTERLOCK STIFFENER	6063-T6	-
13	KCO-306	AS REQD.	OUTER INTERLOCK STIFFENER	6063-T6	-
14	KCO-300	AS REQD.	ASTRAGAL STIFFENER	6063-T6	-
16	KCO-309	AS REQD.	HEAD/SILL RETAINING CLIP	6063-T6	6" LONG
17	KCO-020	2/ FIX. PANEL	FIX. PANEL SKATE	DELTRIN	2-1/2" LONG
18	KCO-019	4/ PANEL	PANEL TOP GUIDE	DELTRIN	AT TOP RAIL CORNERS
19	KCO-319	1/ FIX. PANEL	FIX. PANEL CLIP	6063-T6	FULL LENGTH
20	-	-	-	-	-
21	-	AS REQD.	PILE WITH FIN W'STRIPPING	-	.380" X .187"
22	-	2/ PANEL	BOTTOM RAIL W'STRIPPING	VINYL	.030" X .700"
23	#10 X 1"	8/ PANEL	PANEL ASSY SCREWS	-	PH SMS
25	-	-	-	-	-
26	-	2/ MOV. PANEL	ROLLER ASSEMBLY	-	-
27	SL-3182B	1/ MOV. PANEL	LATCH ASSEMBLY	-	BY MBC
28	-	1/ LOCK	KEEPER	-	-
30	SL-3182B	*	UPPER LATCH	-	BY MBC
31	-	AS REQD.	SELF ADHESIVE PILE PAD	WOOL	AT HEAD AND SILL

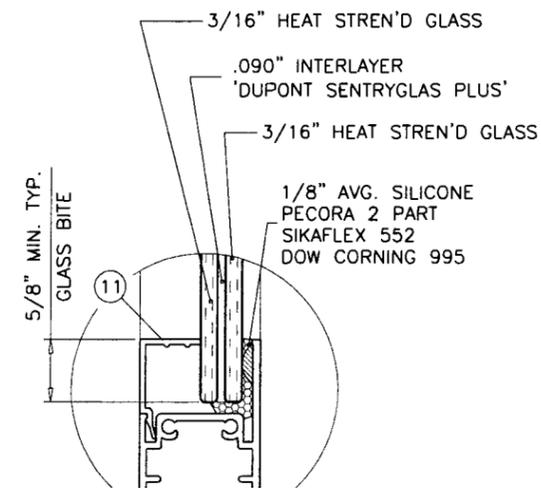


GLASS TYPE 'A'

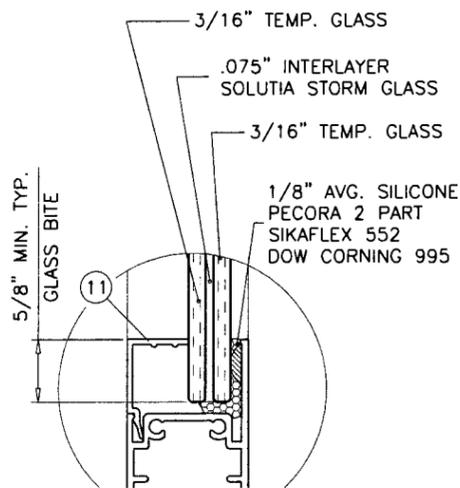


GLASS TYPE 'B'

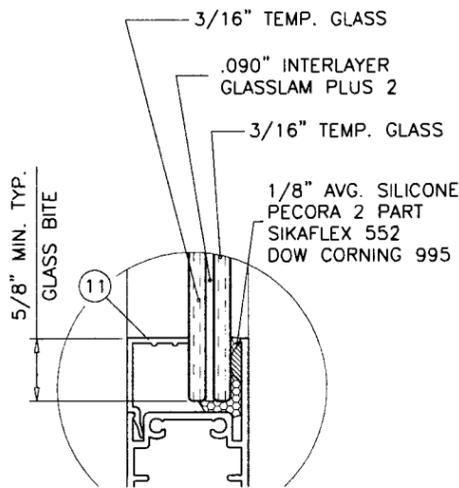


GLASS TYPE 'C'

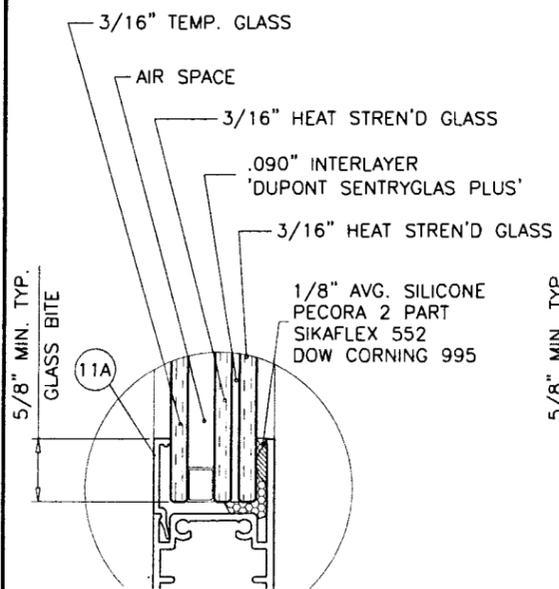

GLASS TYPE 'A1'

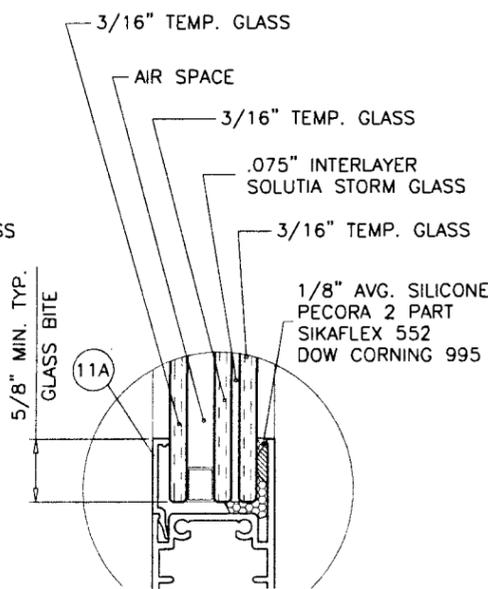

GLASS TYPE 'B1'

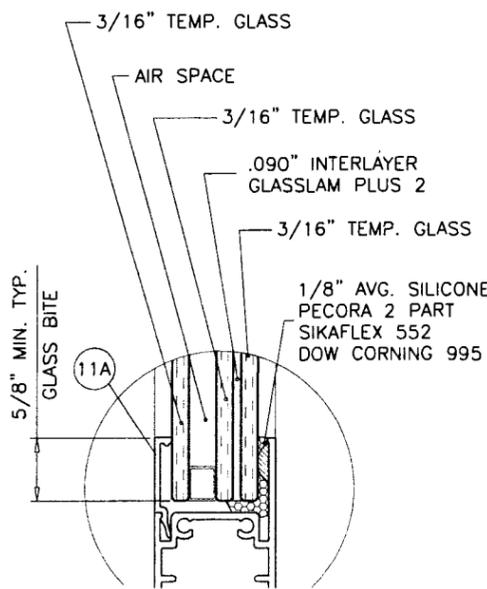

GLASS TYPE 'C1'

* AT MALE ASTRAGAL ONLY
USE LEVER #SL-3181S ON INSIDE FACE OF STILE ONLY
AND NO EXTERIOR OR INTERIOR PULL HANDLES.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 08-1216-04
Expiration Date MAY 20, 2014
By Ishag I. Chande
Miami Date Product Control
Division

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
Arja
MAY 21 2009

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-10KL

SERIES-MPSGD ALUM SLIDING GLASS DOOR (L.M.I./S.M.I.)

TRIUM FLORIDA, INC.
3600 PORT JACKSONVILLE PARKWAY
JACKSONVILLE, FL. 32226
TEL. (904) 355-1476 FAX. (904) 353-0689




no.	date	description	REV. PER BCCO COMMENTS	GENERAL REVISION
A	03.19.04			
B	02.19.09			

revisions:

date: 02-11-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-10

sheet 2 of 6

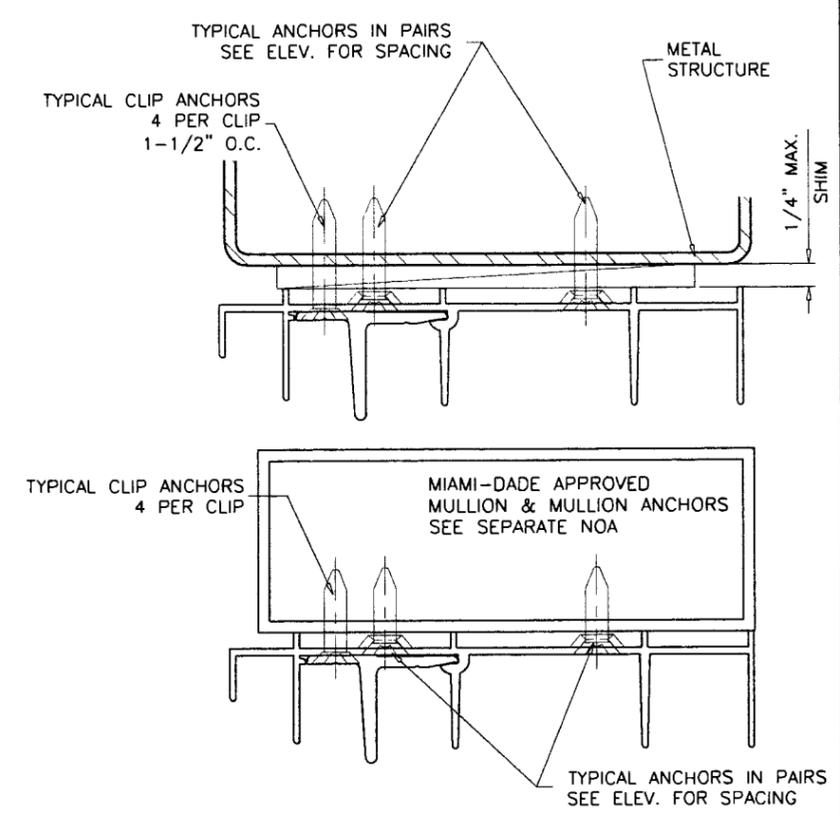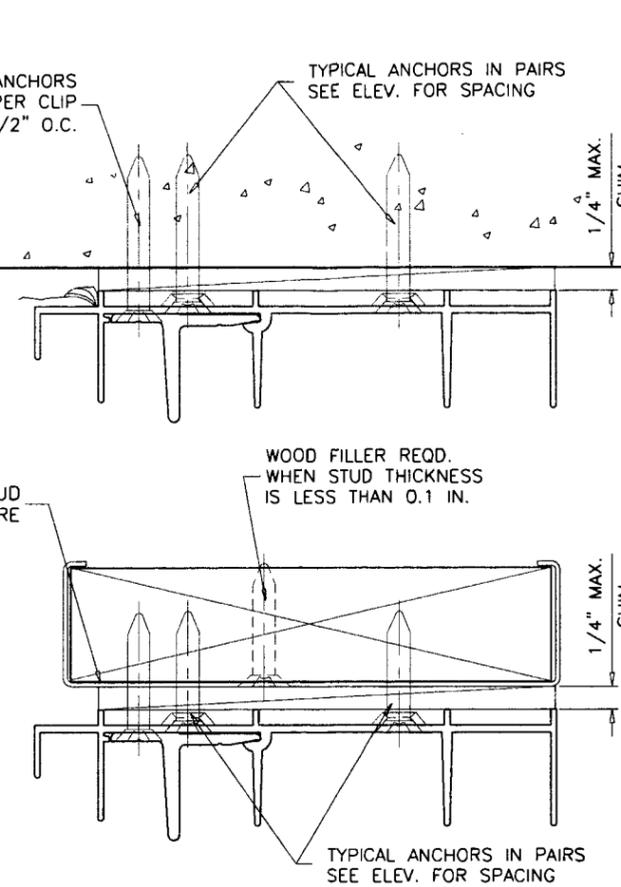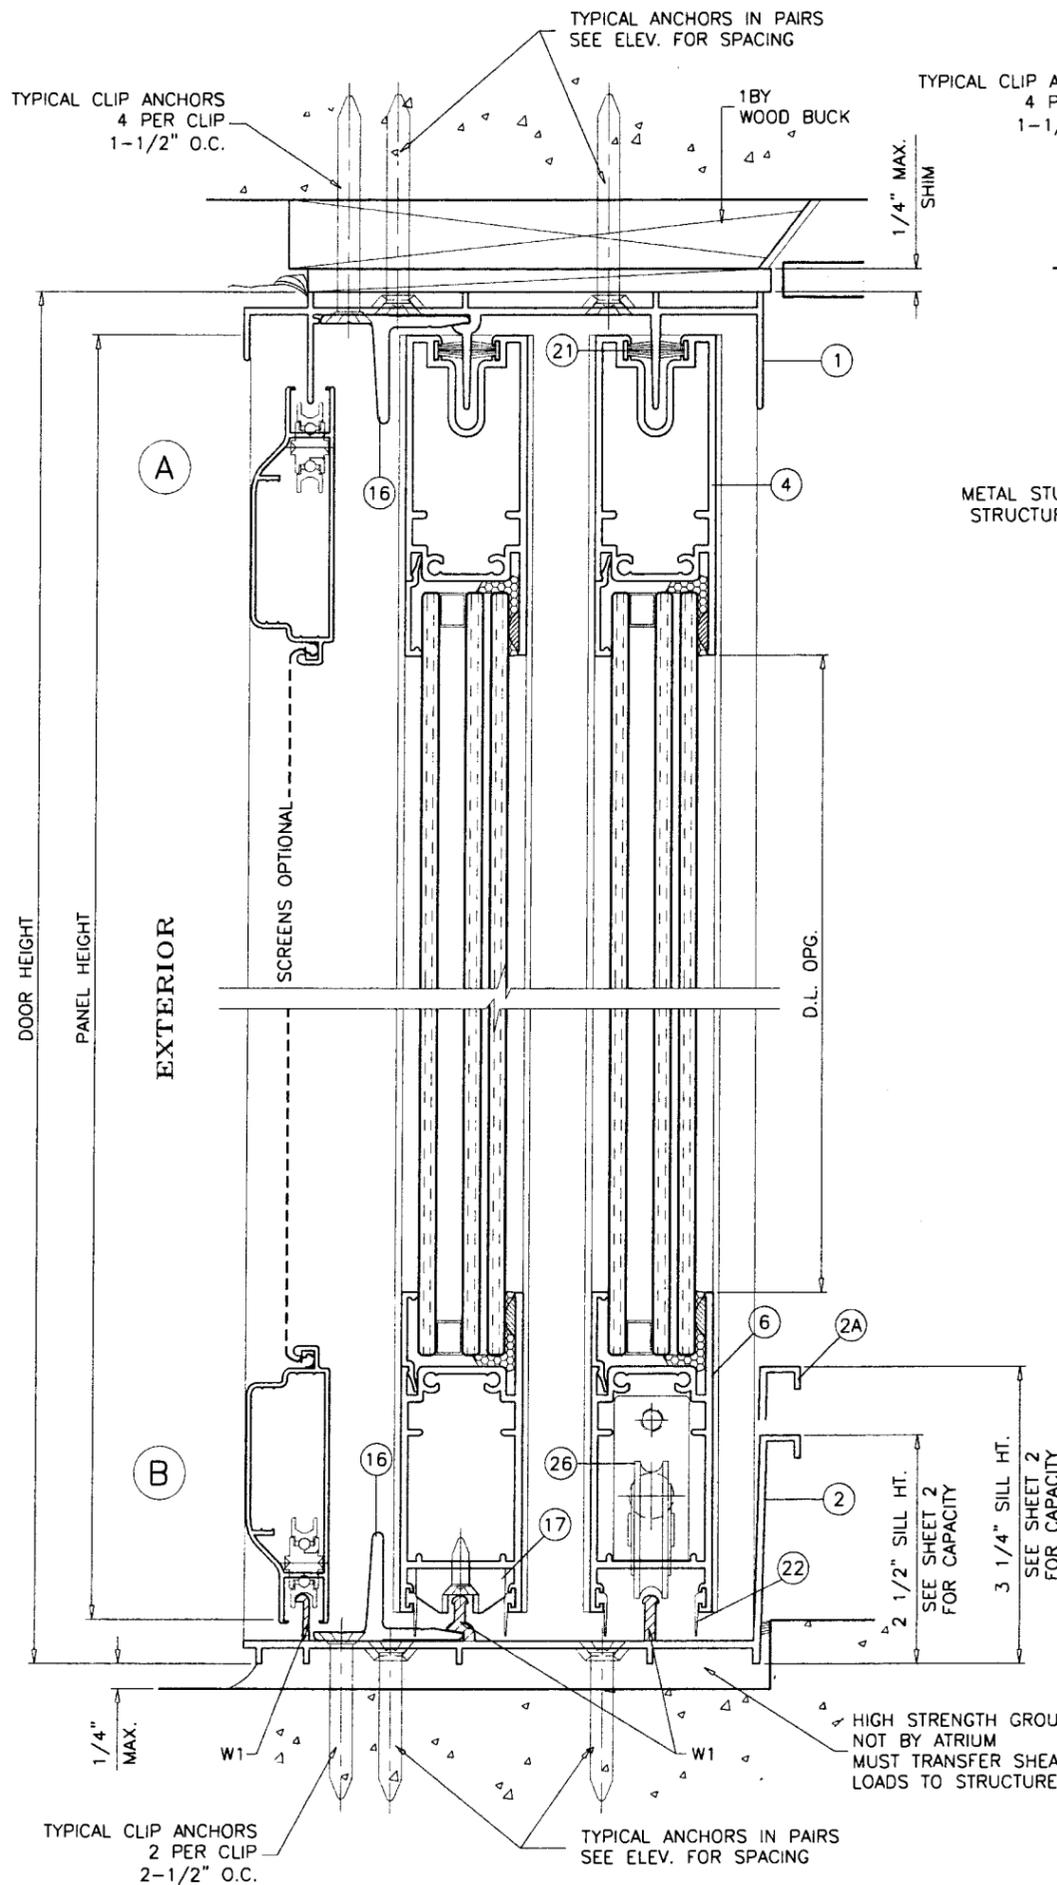

WOOD BUCKS, METAL STUDS AND METAL STRUCTURE NOT BY ATRIUM
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- 1/4" DIA. TAPCON BY 'ITW'**
- 1/4" DIA. ULTRACON BY 'ELCO'** (Fu=177 KSI, Fy=155 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-3/8" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

SEALANT:
ALL JOINTS AND FRAME CONNECTIONS SEALED WITH
WHITE/ALUMINUM COLORED SEALANT.

WEEPHOLES:
W1 = 2-5/8" WEEP NOTCH AT EACH END

- #14 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)
INTO METAL STRUCTURES
STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 08-1216-04
Expiration Date MAY 20, 2014
By Ishag I. Chaudhry
Miami Dade Product Control
Division

- #10 SMS OR SELF DRILLING SCREWS**
INTO MIAMI-DADE COUNTY APPROVED MULLIONS (1/8" THK. MIN.)
(NO SHIM SPACE)

TYPICAL EDGE DISTANCE
INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
MASONRY f'm = 1500 PSI MIN.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
Arj
MAY 21 2009


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-10KL

SERIES-MPSGD ALUM SLIDING GLASS DOOR (L.M.I./S.M.I.)
ATRIUM FLORIDA, INC.
3600 PORT JACKSONVILLE PARKWAY
JACKSONVILLE, FL. 32226
TEL. (904) 355-1476 FAX. (904) 353-0689

no.	date	description
A	03.19.04	NO CHANGE THIS SHEET
B	02.19.09	GENERAL REVISION




date: 02-11-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-10
sheet 3 of 6

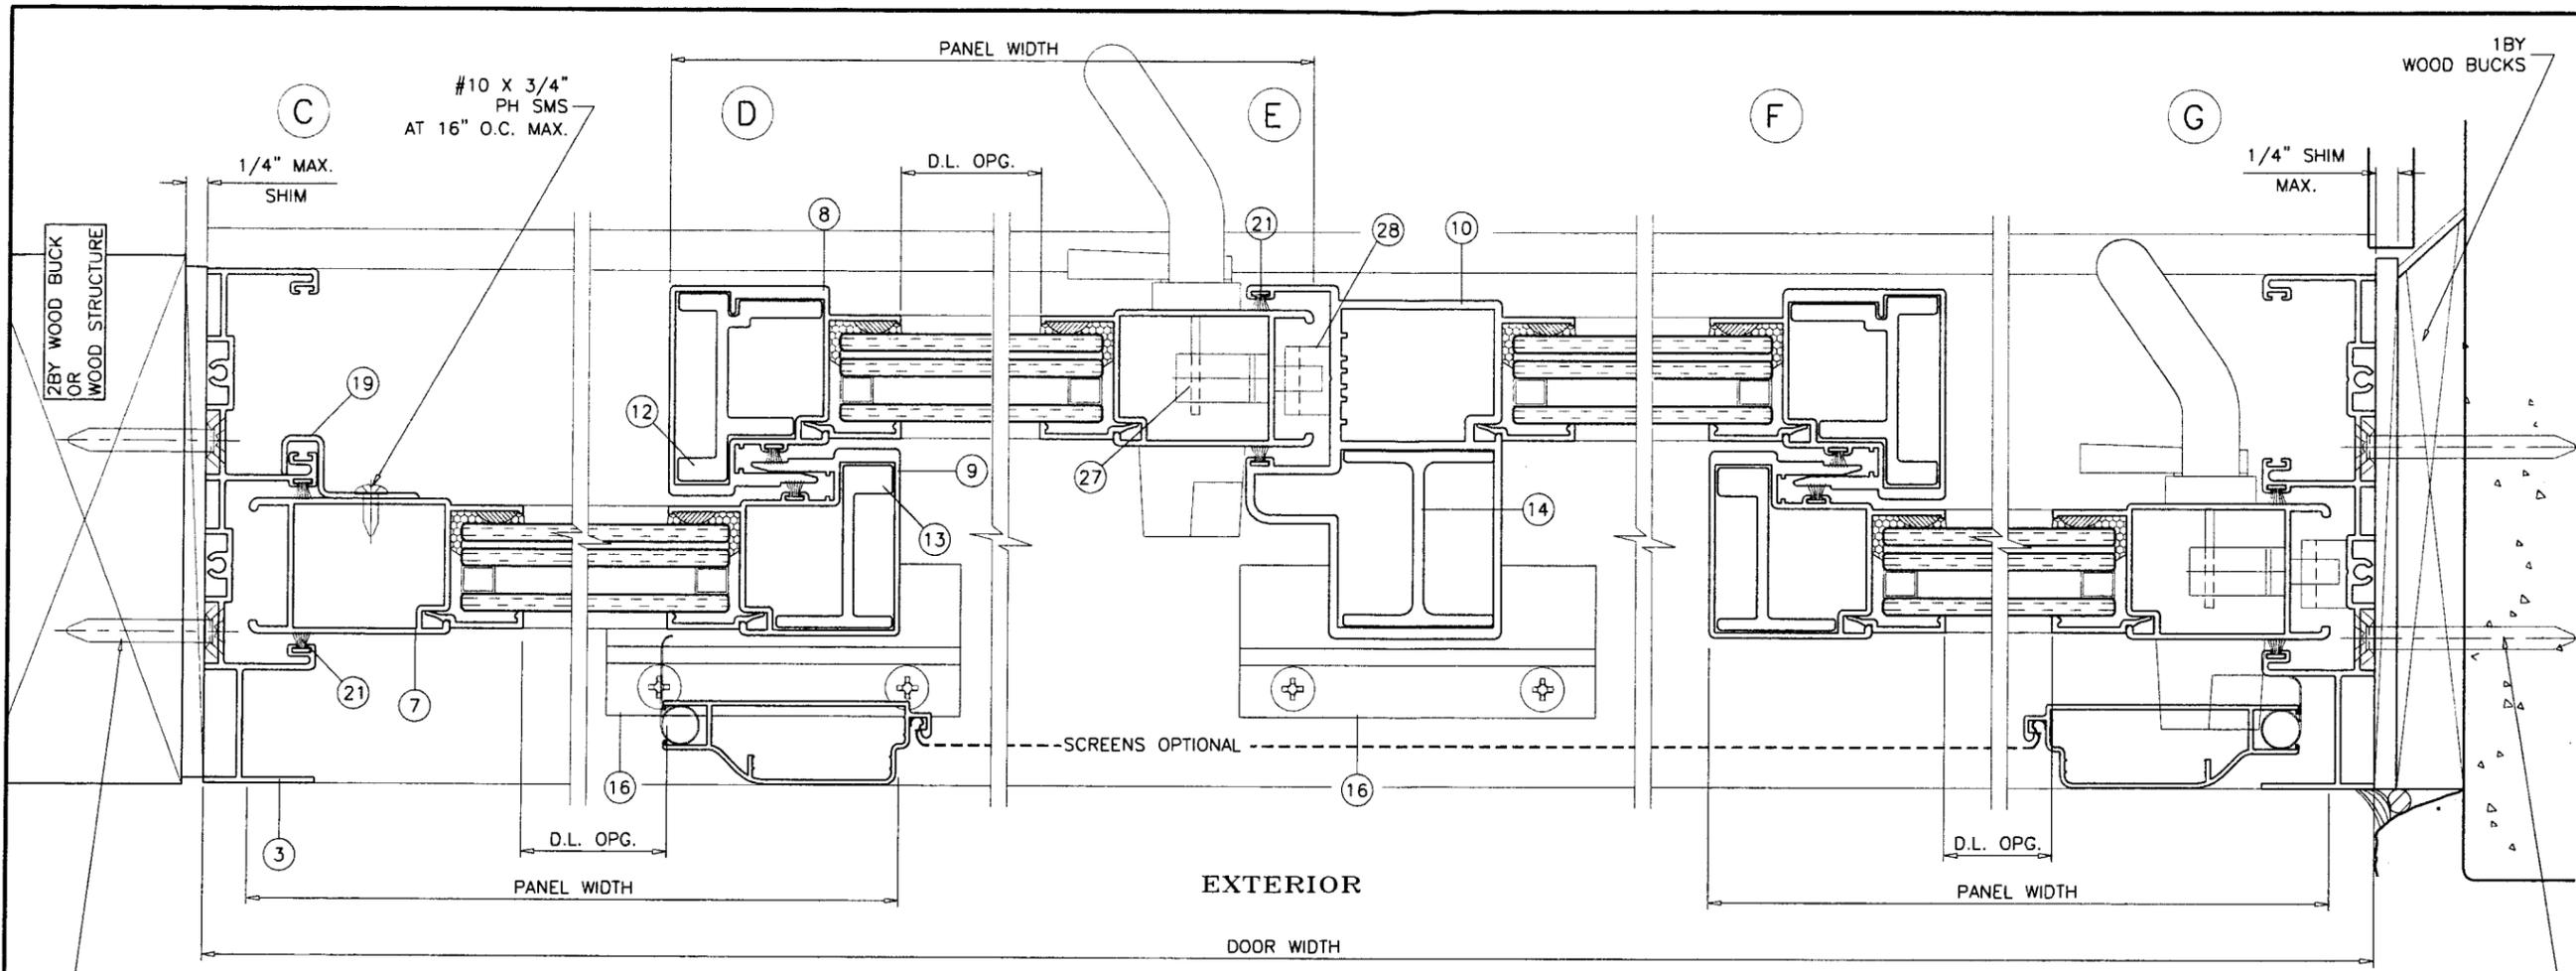

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

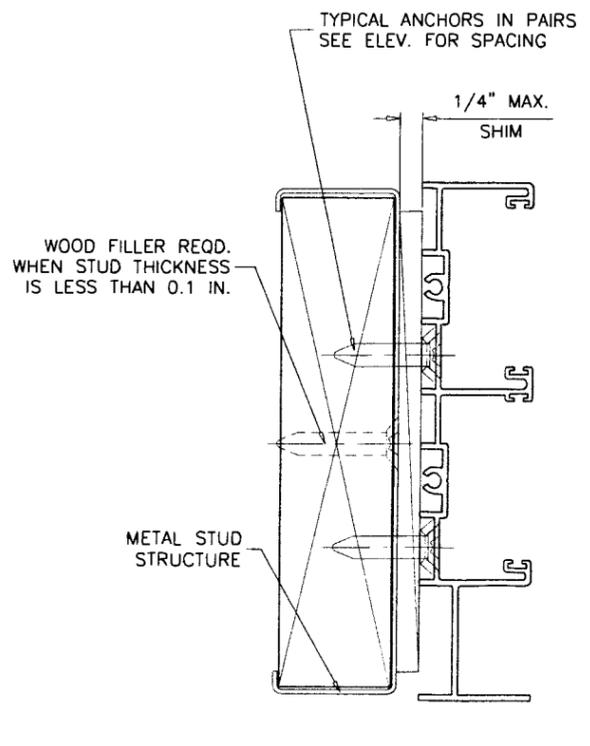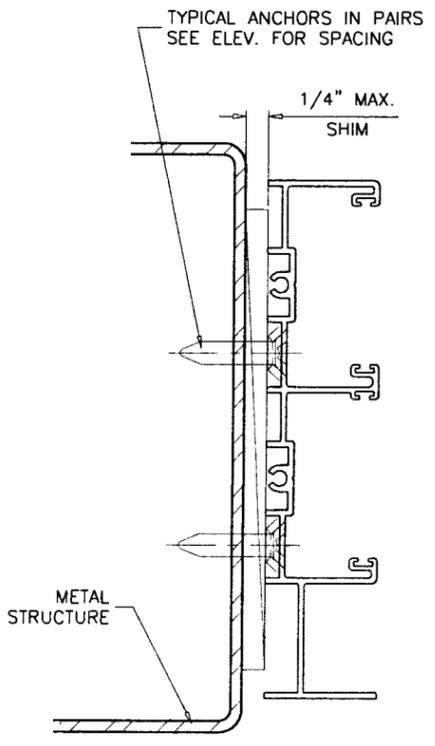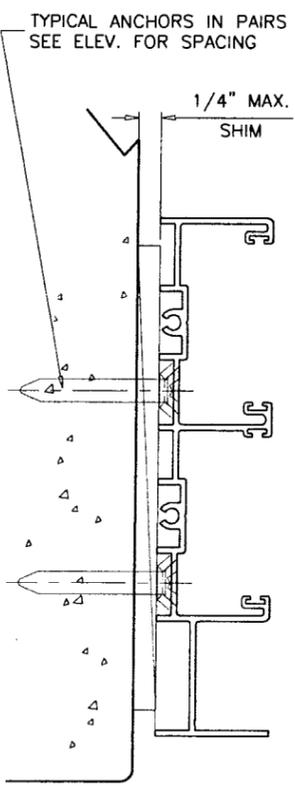

WOOD FILLER REQD.
WHEN STUD THICKNESS
IS LESS THAN 0.1 IN.

METAL
STRUCTURE

METAL STUD
STRUCTURE

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. *08-1216-04*
Expiration Date *MAY 20, 2014*
By *Sheng L. Chung*
Miami Dade Product Control
Division

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
Ar
MAY 21 2009


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-10KL

SERIES-MPSGD ALUM SLIDING GLASS DOOR (L.M.I./S.M.I.)
ATRIUM FLORIDA, INC.
3600 PORT JACKSONVILLE PARKWAY
JACKSONVILLE, FL. 32226
TEL. (904) 355-1476 FAX. (904) 353-0689


no	date	by	description
A	03.19.04		NO CHANGE THIS SHEET
B	02.19.09		GENERAL REVISION

date: 02-11-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W04-10
sheet 4 of 6

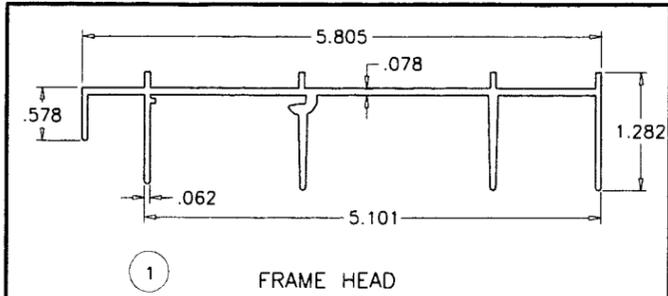


1 FRAME HEAD

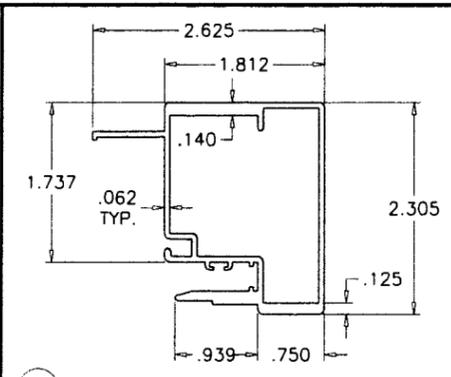


8 INNER INTERLOCK

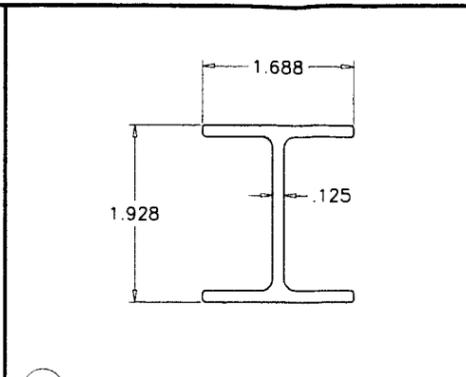


14 FEMALE ASTRAGAL STIFFENER

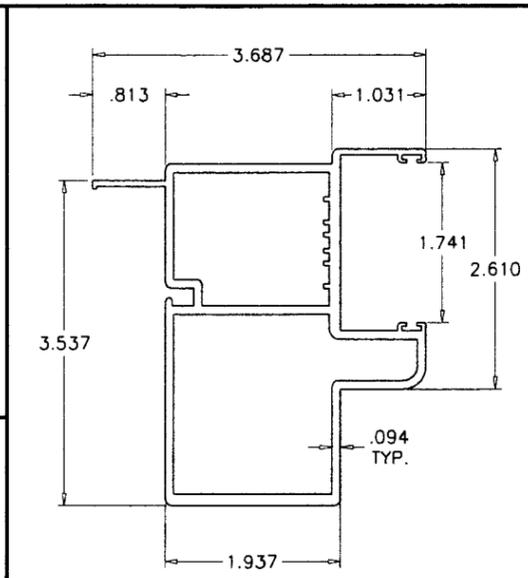


10 ASTRAGAL STILE

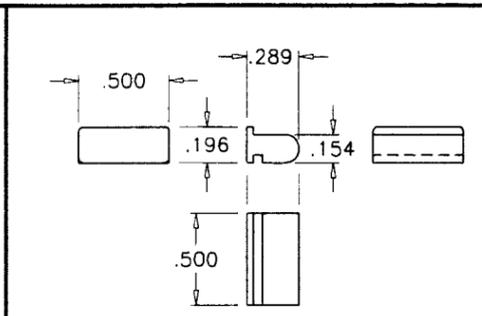


18 PANEL TOP GUIDE
SCALE 1:1

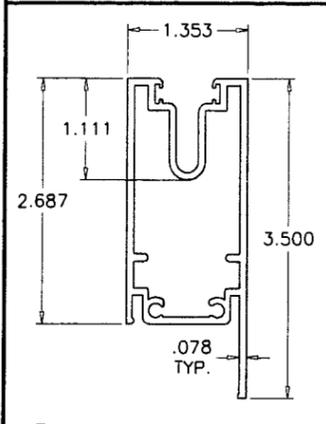


4 PANEL TOP RAIL

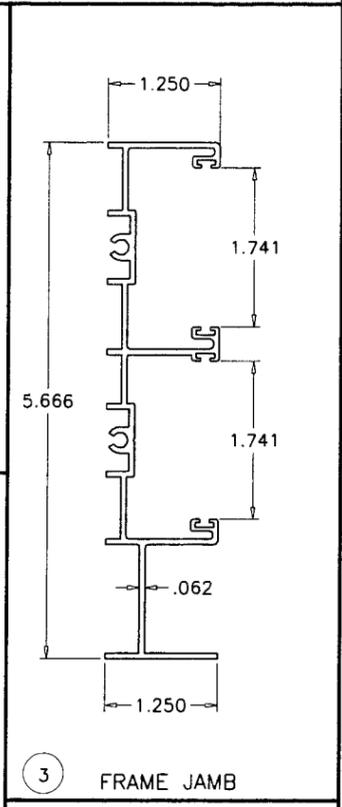


3 FRAME JAMB

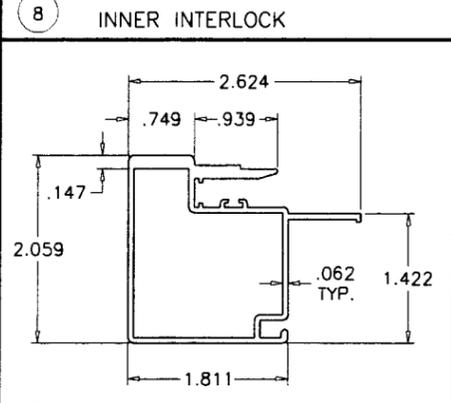


9 OUTER INTERLOCK

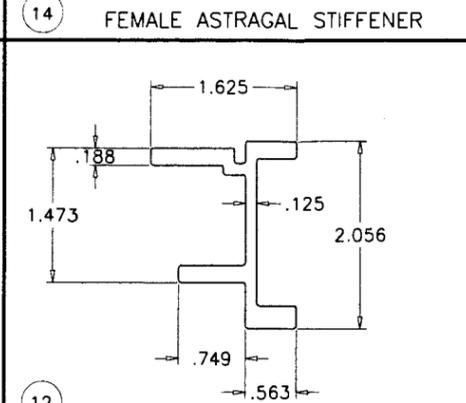


12 INNER INTERLOCK STIFFENER

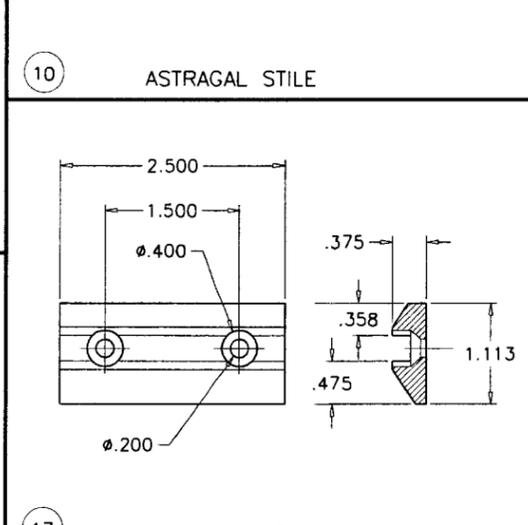


17 FIX. PANEL SKATE

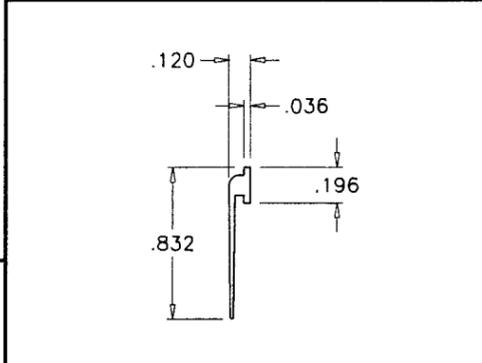


22 BOTTOM RAIL W'STRIPPING
SCALE 1:1

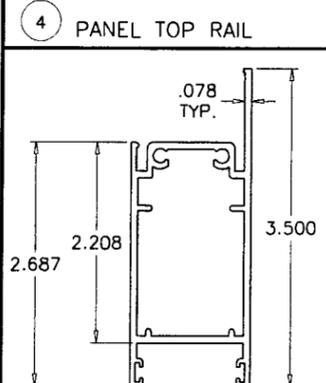


6 PANEL BOTTOM RAIL

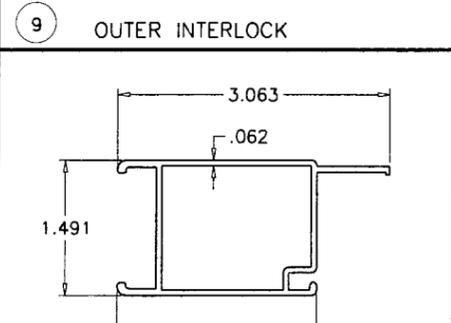


7 LOCK STILE

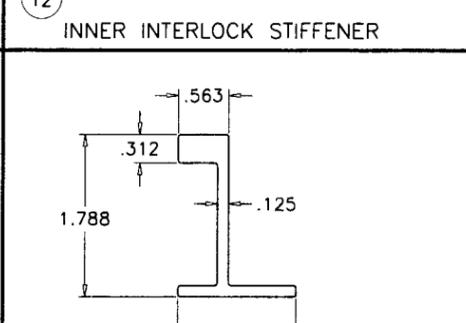


13 OUTER INTERLOCK STIFFENER

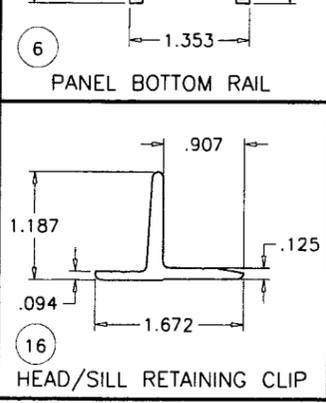


16 HEAD/SILL RETAINING CLIP

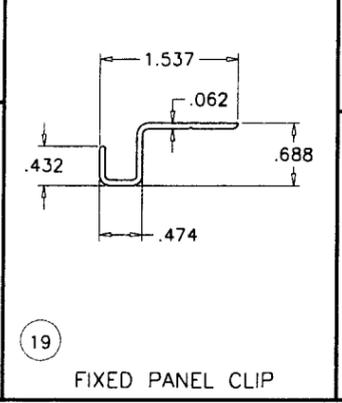


19 FIXED PANEL CLIP

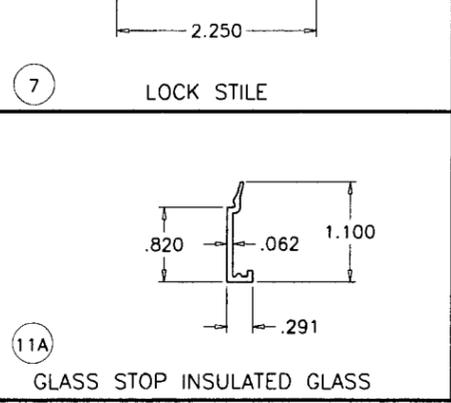


11A GLASS STOP INSULATED GLASS

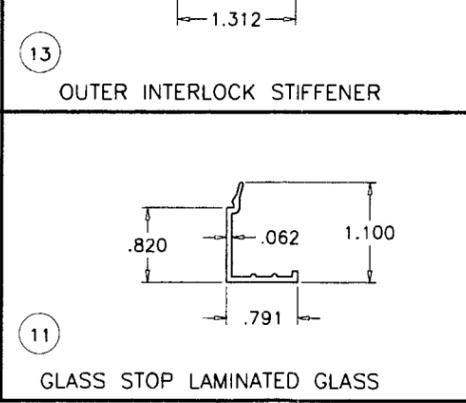

11 GLASS STOP LAMINATED GLASS

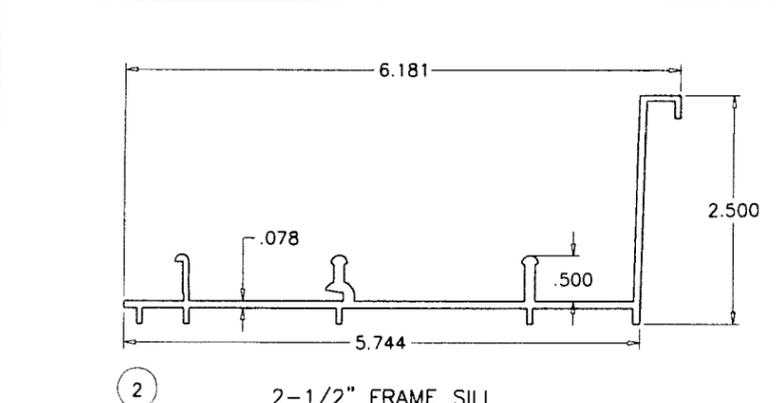

2 2-1/2" FRAME SILL

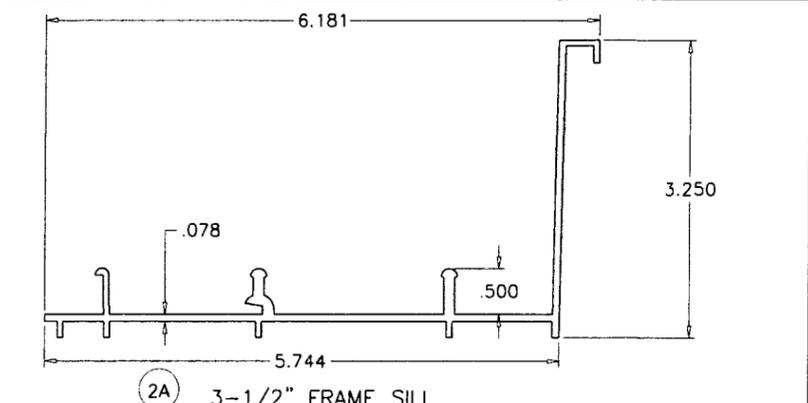

2A 3-1/2" FRAME SILL

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
Ar
MAY 21 2009

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 08-1216-04
Expiration Date May 20, 2014
By Isaac I. Chaudhry
Miami Dade Product Control
Division


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
12335 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-10KL

SERIES-MPSGD ALUM SLIDING GLASS DOOR (L.M.I./S.M.I.)
ATRIUM FLORIDA, INC.
3600 PORT JACKSONVILLE PARKWAY
JACKSONVILLE, FL. 32226
TEL. (904) 355-1476 FAX. (904) 353-0689




no.	date	description	by
A	03.19.04	REV. PER BCCO COMMENTS	
B	02.19.09	GENERAL REVISION	

date: 02-11-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W04-10
sheet 5 of 6

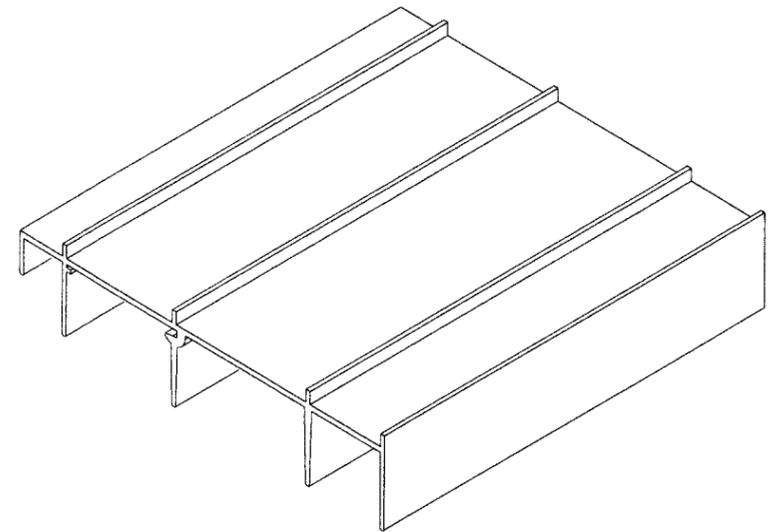



FRAME TOP CORNER

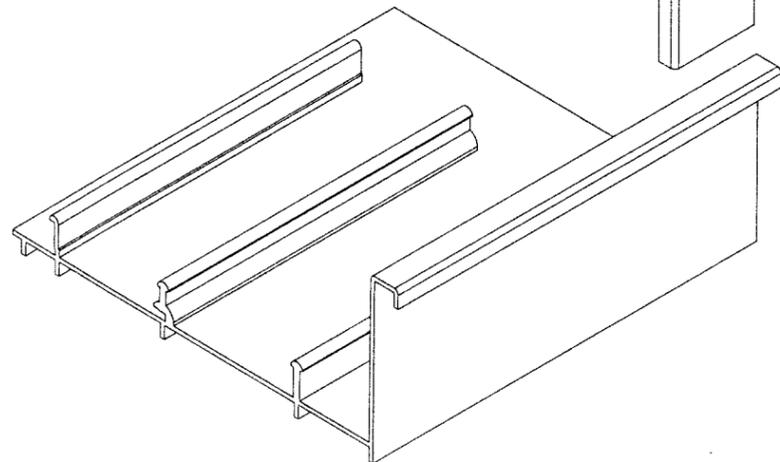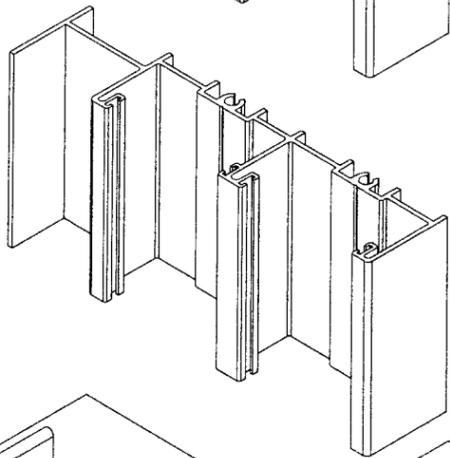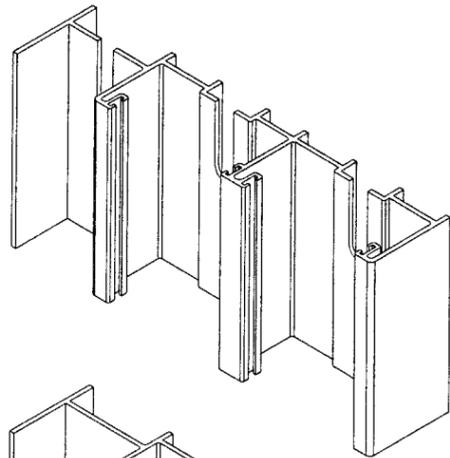


FRAME BOTTOM CORNER

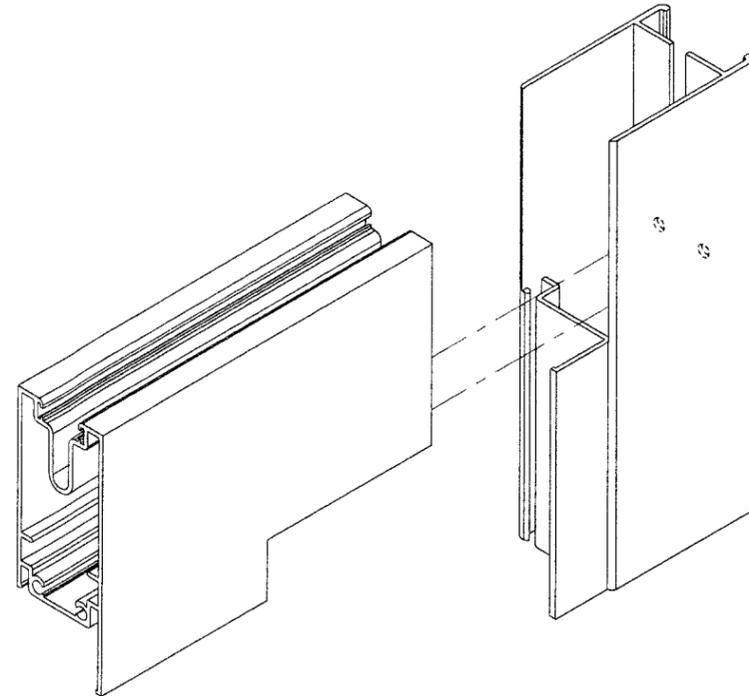

PANEL TOP CORNER

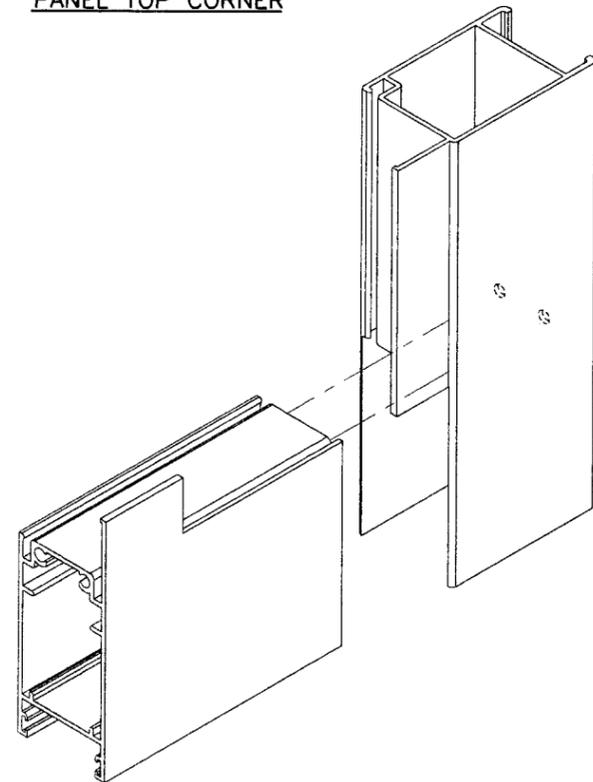

PANEL BOTTOM CORNER



PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 08-1216-04
 Expiration Date MAY 20, 2014
 By Isaac J. Chand
 Miami Dade Product Control
 Division

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 MAY 21 2009

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \W04 - 10KL

SERIES-MPSGD ALUM SLIDING GLASS DOOR (L.M.I./S.M.I.)
ATRIUM FLORIDA, INC.
 3600 PORT JACKSONVILLE PARKWAY
 JACKSONVILLE, FL. 32226
 TEL. (904) 355-1476 FAX. (904) 353-0689

revisions:	
no.	description
A	03.19.04 NO CHANGE THIS SHEET
B	02.19.09 GENERAL REVISION

date: 02-11-04
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W04-10
 sheet 6 of 6