



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Traco Security Windows & Doors, Inc.
71 Progress Avenue
Cranberry Township, PA 16066

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 5758 Aluminum Fixed Window – S.M.I.

APPROVAL DOCUMENT: Drawing No. **03-0810-113b**, titled "Series 5758 Fixed Window Small Missile Impact Resistant", sheets 1 through 3 of 3, dated 11/04/08 with revision 9 dated 10/09/08, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name:

TRACO
71 Progress Avenue
Cranberry Township, PA 16066

TRACO
2304 Silverdale Road
Johnson City, TN 37601

Security (TRACO)
5100 N.W. 72nd Avenue
Miami, FL 33166

and the following statement: "**Miami-Dade County Product Control Approved**".

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # **06-1121.12** and consists of this page 1 and evidence pages E-1 and E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 08-1219.04
Expiration Date: December 15, 2011
Approval Date: June 24, 2009
Page 1


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **03-0810-113b**, Sheets 1 through 3 of 3, titled "Series 5758 Fixed Window Small Missile Impact Resistant", dated 11/04/08 with revision 9 dated 10/09/08, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS

1. Test report on: 1) Small Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, glazed with 1/4" tempered glass, prepared by Farabaugh Engineering and Testing, Inc., Test Report No. **FET-T193-06**, dated 08/24/07, signed and sealed by Daniel G. Farabaugh and addendum letter dated 08/24/07, signed by Paul G. Farabaugh, Director of Operations. *(Submitted under previous NOA#06-1121.12)*
2. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, glazed with 3/8" Lexan, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-1792**, dated 08/08/97, signed and sealed by Gilbert Diamond, P.E. *(Submitted under NOA# 05-0729.04)*
3. Test report on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, glazed with 1/4" Lexan, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-1801**, dated 08/28/97, signed and sealed by Gilbert Diamond, P.E. *(Submitted under NOA# 05-0729.04)*
4. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, glazed with 1/4" tempered glass, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-1712**, dated 06/23/97 and 06/17/97, signed and sealed by Gilbert Diamond, P.E. *(Submitted under NOA# 05-0729.04)*

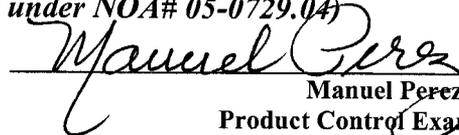
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-1219.04

Expiration Date: December 15, 2011

Approval Date: June 24, 2009

Traco Security Windows & Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. Test report on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Small Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, glazed with 3/8" tempered glass, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-1851**, dated 11/21/97, signed and sealed by Gilbert Diamond, P.E. *(Submitted under NOA# 05-0729.04)*
6. Test report on: 1) Small Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, prepared by American Test Lab of South Florida, Test Report No. **ATL-0608.01-00**, dated 06/21/00, signed and sealed by William R. Mehner, P.E. *(Submitted under NOA# 05-0729.04)*

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Engineering Express, dated 10/09/08, signed and sealed by Frank L. Bennardo, P.E.
Complies with ASTM E1300-98/02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **08-0206.01** issued to Solutia Inc. for their "**Saflex HP Glass Interlayer**" dated 04/17/08, expiring on 04/17/13.

F. STATEMENTS

1. Statement letter of conformance, dated November 4, 2008, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of no financial interest, dated November 4, 2008, signed and sealed by Frank L. Bennardo, P.E.

G. OTHERS

1. Notice of Acceptance No. **06-1121.12**, issued to Traco Security Windows & Doors, Inc. for their Series 5758 Aluminum Fixed Window S.M.I., approved on 10/04/07 and expiring on 12/15/11.

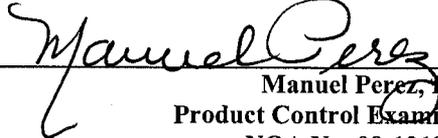
Manuel Perez, P.E.
Product Control Examiner
NOA No. 08-1219.04

Expiration Date: December 15, 2011
Approval Date: June 24, 2009

SERIES 5758 FIXED WINDOW

SMALL MISSILE IMPACT RESISTANT


FRANK L. BENNARDO, P.E.
PE0046549

11/04/2008


ENGINEERING EXPRESS®

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM


CERT. OF AUTH. #9885
A FRANK L. BENNARDO, P.E., INC. INNOVA ION

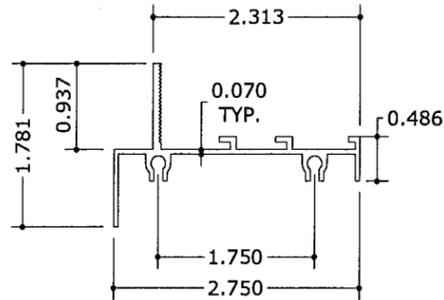


FRAME
6063-T6

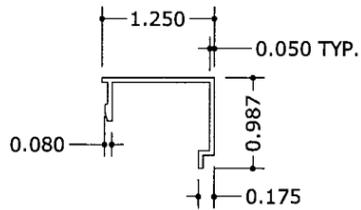

FRAME COVER
6063-T6
(7/16" GLAZING)

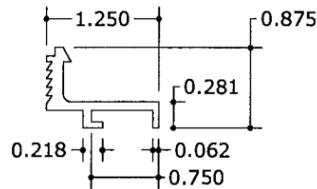

GLAZING STOP
6063-T6
(7/16" GLAZING)

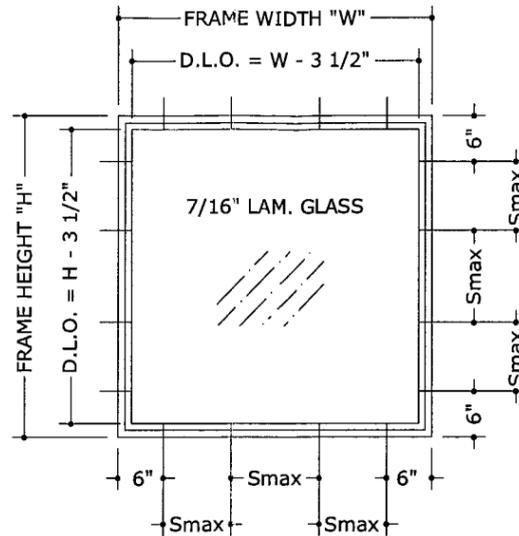

TYPICAL ELEVATIONS
SCALE 1/2" = 1'

ANCHORS:

1. FIRST ANCHOR AT 6" FROM CORNERS.
2. ALL OTHER INTERMEDIATE ANCHORS SPACED AT MAXIMUM ANCHOR SPACING ("Smax") SPECIFIED FOR EACH RESPECTIVE SIZE IN DESIGN LOAD CAPACITY TABLES (REF SHEET 3). LIMIT Smax TO 7½" O.C. FOR HEADS/SILLS. LIMIT Smax TO 8½" O.C. FOR JAMBS.

PRODUCT REVISED

as complying with the Florida
Building Code
Acceptance No 08-1219.04
Expiration Date DEC. 15, 2011

By *Manuel Perez*
Miami Dade Product Control
Division

GENERAL NOTES:

1. THE FIXED (i.e. NON-OPERABLE) WINDOW SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN COMPLIANCE WITH THE 2007 FLORIDA BUILDING CODE, HIGH VELOCITY HURRICANE ZONES, AND MIAMI-DADE COUNTY PROTOCOLS TAS 201, 202 & 203.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS WINDOW SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE WINDOW SYSTEM DETAILED HEREIN HAS BEEN TESTED PER MIAMI-DADE COUNTY PROTOCOLS TAS-201, TAS-202, & TAS-203 AS REFERENCED IN TEST REPORTS BY FENESTRATION TESTING LABORATORIES (FTL) AND FARABAUGH ENGINEERING & TESTING, INC (FET). MULTIPLE WINDOW UNITS MUST BE INSTALLED USING MIAMI-DADE COUNTY BCCO-APPROVED STRUCTURAL MULLIONS.
5. THE WINDOW SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
6. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (NOT BY TRACO) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
7. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO
8. WINDOW PANELS GLAZED WITH 7/16" LAMINATED GLASS ARE SMALL MISSILE IMPACT RESISTANT AND SHALL BE PROTECTED WITH MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS FOR INSTALLATIONS UP TO 30 FEET ABOVE GRADE. NO PROTECTION REQUIRED FOR INSTALLATIONS WITH 7/16" LAMINATED GLAZING ABOVE 30 FEET ABOVE GRADE.
9. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED.

GLAZING:

THIS N.O.A. QUALIFIES WINDOWS FOR THE FOLLOWING CONDITIONS:

7/16" OVERALL
LAMINATED GLASS (SMALL MISSILE IMPACT RESISTANT)

71 Progress Avenue,
Cranberry Township, PA 16166
Tel. (724) 776-7000

TRACO
Windows & Doors Inc.



SERIES 5758 FIXED WINDOW
SMALL MISSILE IMPACT RESISTANT


REMARKS	DRWN	CHKD	DATE
REV 7 - COUNTY COMMENT CTS	CL	CL	06/29/07
REV 8 - BCCO COMMENTS MEH	CL	CL	8/27/07
REV 9 - 2007 FBC	KL	CL	10/09/08
REV 3 - 2004 FBC	CL	FLB	06/20/05
REV 4 - COUNTY COMMENT AMI	CL	FLB	08/25/05
REV 6 - GE SILICONE	KL	CL	10/25/06

03-0810-113b

PAGE SCALE:
DESCRIPTION:

11/04/2008 - 12:24pm keltl F:\01 Project Files\Traco (TRA)\2003 Jobs\03-0810a-113 + 03-0810b-113 Traco 5758 Fixed Window, Small Missile (NOAs)\Traco 5758 Fixed Window, Small Missile (03-0810b-113) rev5.1.dwg

EXTERIOR

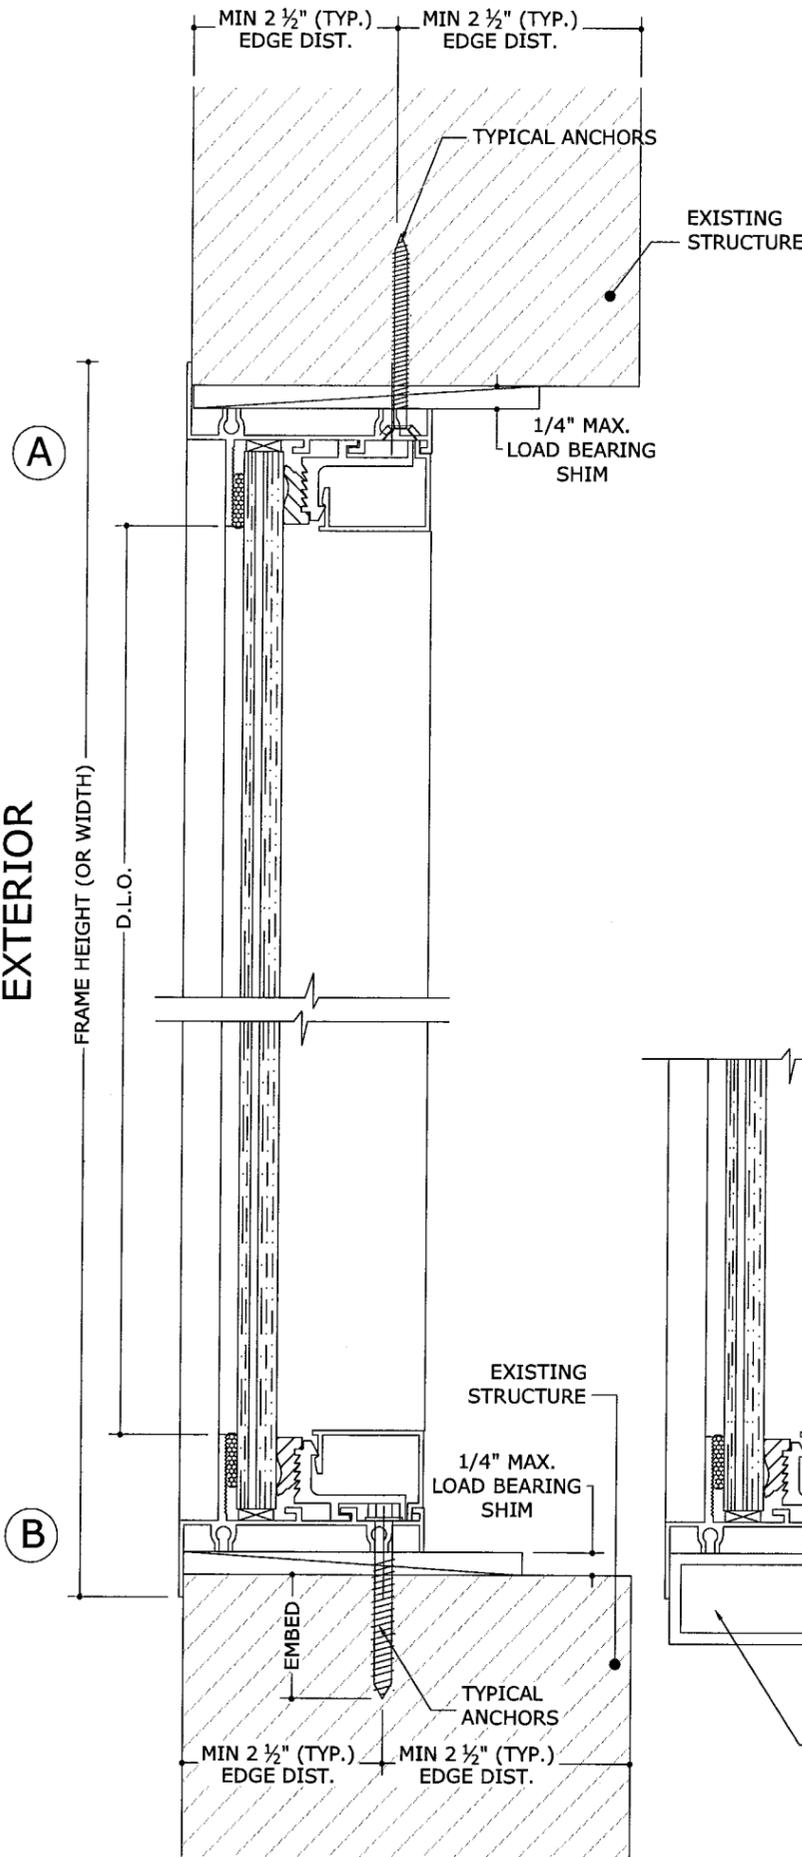

2"X4" OPTIONAL WOOD BUCKS (NOT SHOWN) NOT BY TRACO SECURITY WINDOWS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHOR NOTES:


1. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
2. ANCHOR EMBEDMENT SHALL BE INTO BASE MATERIAL, EXCLUDING STUCCO OR OTHER WALL FINISH.
3. BASE MATERIAL SHALL BE WOOD (G=0.55 OR GREATER SPECIFIC GRAVITY), MASONRY (MIN. 1500 psi MASONRY STRENGTH), CONCRETE (MIN. 3000 psi), 6063-T5 ALUMINUM (1/8" MINIMUM), OR A36 STEEL (1/8" MINIMUM).
4. SEE TYPICAL ELEVATIONS ON SHEET 1 FOR ANCHOR LOCATIONS AND SPACING.

TYPICAL ANCHORS:


- 3/16" ITW TAPCONS INTO WOOD, 1-3/8" MIN. EMBED.
- 1/4" ITW TAPCONS INTO WOOD, 1-3/4" MIN. EMBED.
- 3/16" OR 1/4" ITW TAPCONS THRU 1BY OR 2BY BUCKS, 1-1/4" MIN. EMBED. INTO MASONRY (MIN. 1500 psi) OR CONCRETE (MIN. 3000 psi)
- #12 x 5/8" 316 SS SCREWS TO 6063-T5 ALUMINUM (1/8" MINIMUM) OR A36 STEEL (1/8" MINIMUM)

SEALANTS:


FRAME CORNERS SEALED WITH SCHNEE MOREHEAD # 5504 SEALANT. FOR FRAME SILL INSTALLATION SCREW HEADS SEALED WITH GE-SC S100 SILICONE OR OTHER COMPATIBLE SILICONE.

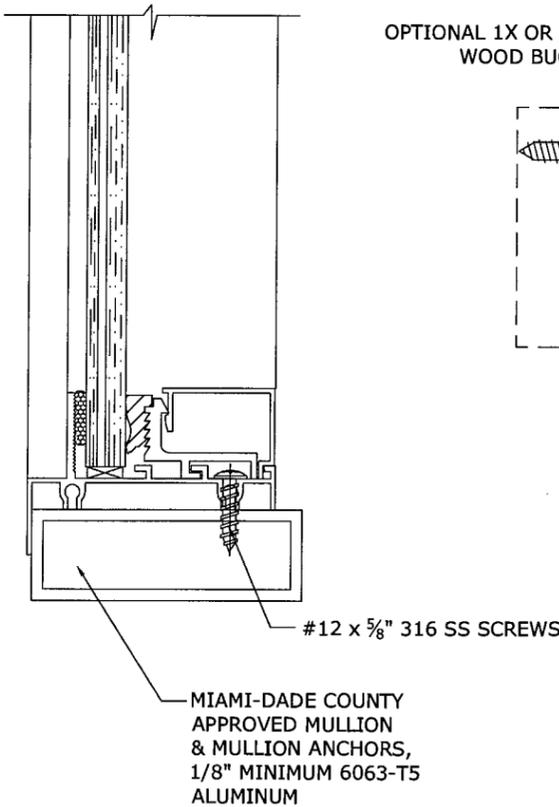

MIAMI-DADE COUNTY APPROVED MULLION & MULLION ANCHORS, 1/8" MINIMUM 6063-T5 ALUMINUM

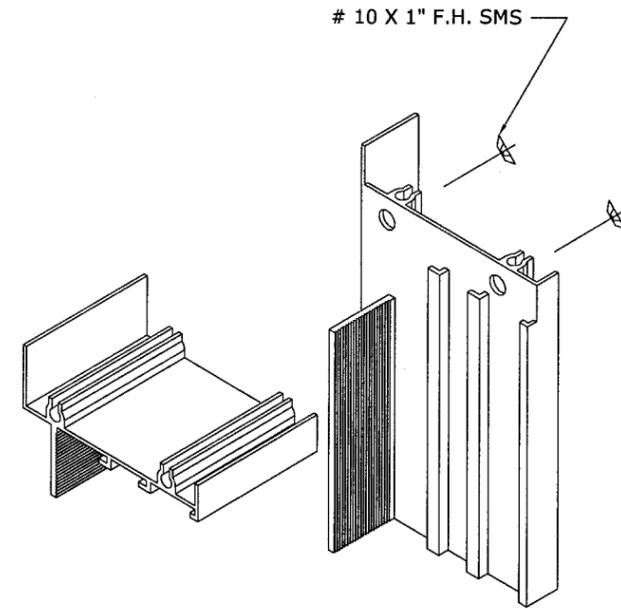

TYPICAL CORNER CONSTRUCTION

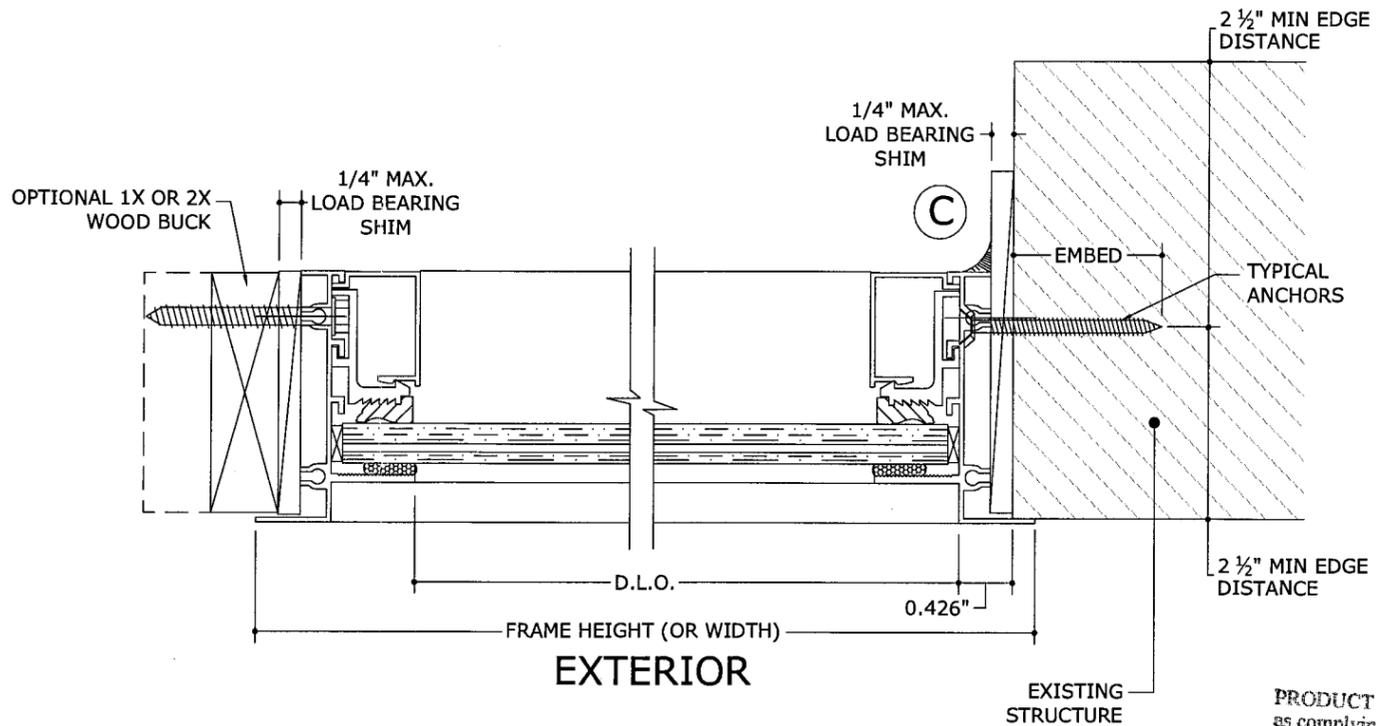

SETTING BLOCKS REQUIRED ONLY ON GLASS WIDTHS OF MORE THAN 36 IN.

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 08-1219.04 Expiration Date DEC. 15, 2011 By *Manuel Perez* Miami Dade Product Control Division

FRANK L. BENNARDO, P.E. # PE0046549

11/04/2008

ENGINEERING EXPRESS

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM

CERT OF AUTH #6885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

71 Progress Avenue,
Cranberry Township, PA 16166
Tel: (724) 776-7000

TRACO
Windows & Doors Inc.

SERIES 5758 FIXED WINDOW
SMALL MISSILE IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
REV 7 - COUNTY COMMENT	CTS	CL	06/29/07
REV 8 - BCCD COMMENTS	IMEH	CL	8/27/07
REV 9 - 2007 FBC	KL	CL	10/09/08
REV 3 - 2004 FBC	CL	FLB	06/20/05
REV 4 - COUNTY COMMENT	AML	FLB	08/25/05
REV 6 - GE SILICONE	KL	CL	10/25/06

03-0810-113b

PAGE SCALE:
DESCRIPTION:

TABLE ①


SMALL MISSILE IMPACT RESISTANT WINDOWS SHUTTERS NOT REQ'D FOR INSTALLATION ABOVE 30 FT. OF GRADE							
WINDOW DIMENSIONS 1		DESIGN LOAD CAPACITY - PSF					
		ANCHOR SPACING 2	7/16" LAM. GLASS 3/16" ANCHORS OR #12 SCREW		ANCHOR SPACING 2	7/16" LAM. GLASS 1/4" ANCHORS	
DIM 'A'	DIM 'B'		POS	NEG		POS	NEG
24"	24"	6" O.C.	120.0	120.0	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
36"			120.0	120.0		120.0	120.0
48"			120.0	120.0		120.0	120.0
60"			120.0	120.0		120.0	120.0
72"			120.0	120.0		120.0	120.0
24"	36"	6" O.C.	120.0	120.0	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
36"			86.2	86.2		120.0	120.0
48"			86.2	86.2		120.0	120.0
60"			86.2	86.2		120.0	120.0
72"			86.2	86.2		120.0	120.0
24"	48"	6" O.C.	120.0	120.0	7" O.C.	120.0	120.0
36"			86.2	86.2		120.0	120.0
48"			64.6	64.6		119.2	119.2
60"			64.6	64.6		119.2	119.2
72"			64.6	64.6		119.2	119.2
24"	60"	6" O.C.	120.0	120.0	6" O.C.	120.0	120.0
36"			86.2	86.2		120.0	120.0
48"			64.6	64.6		120.0	120.0
60"			51.7	51.7		111.2	111.2
72"			51.7	51.7		111.2	111.2
24"	72"	6" O.C.	120.0	120.0	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
36"			86.2	86.2		120.0	120.0
48"			64.6	64.6		98.1	98.1
60"			51.7	51.7		78.5	78.5
72"			43.1	43.1		65.4	65.4
24"	84"	6" O.C.	120.0	120.0	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
36"			86.2	86.2		120.0	120.0
48"			64.6	64.6		98.1	98.1
60"			51.7	51.7		78.5	78.5
72"			43.1	43.1		65.4	65.4
24"	96"	6" O.C.	120.0	120.0	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
36"			86.2	86.2		120.0	120.0
48"			64.6	64.6		98.1	98.1
24"	108"	6" O.C.	120.0	120.0	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
36"			86.2	86.2		120.0	120.0
48"			64.6	64.6		98.1	98.1
24"	120"	6" O.C.	86.2	86.2	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
36"			86.2	86.2		120.0	120.0

DESIGN LOAD CAPACITY TABLE NOTES:

- IF DIM 'A' = WINDOW WIDTH, THEN DIM 'B' = WINDOW HEIGHT.
- "ANCHOR SPACING" DESIGNATES MAXIMUM ANCHOR SPACING ("Smax") TO HOST STRUCTURE (REF TYPICAL ELEVATION SHEET 1).

TABLE ②

SMALL MISSILE IMPACT RESISTANT WINDOWS SHUTTERS NOT REQ'D FOR INSTALLATION ABOVE 30 FT. OF GRADE							
WINDOW DIMENSIONS 1		DESIGN LOAD CAPACITY - PSF					
		ANCHOR SPACING 2	7/16" LAM. GLASS 3/16" ANCHORS OR #12 SCREW		ANCHOR SPACING 2	7/16" LAM. GLASS 1/4" ANCHORS	
DIM 'A'	DIM 'B'		POS	NEG		POS	NEG
19-1/8"	26"	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	114.5	114.5	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS	120.0	120.0
26-1/2"			84.2	84.2		120.0	120.0
37"			84.2	84.2		120.0	120.0
53-1/8"			84.2	84.2		120.0	120.0
19-1/8"			38-3/8"	7-1/2" O.C. @ HEAD/SILL 8-1/2" O.C. @ JAMBS		114.5	114.5
26-1/2"	82.6	82.6			120.0	120.0	
37"	59.2	59.2			120.0	120.0	
53-1/8"	57.0	57.0			120.0	120.0	
19-1/8"	50-5/8"	6" O.C.			120.0	120.0	7" O.C.
26-1/2"			117.1	117.1	120.0	120.0	
37"			83.8	83.8	120.0	120.0	
53-1/8"			61.3	61.3	113.0	113.0	
19-1/8"			57"	6" O.C.	120.0	120.0	
26-1/2"	117.1	117.1			120.0	120.0	
37"	83.8	83.8			120.0	120.0	
53-1/8"	58.4	58.4			107.7	107.7	
19-1/8"	63"	6" O.C.			120.0	120.0	7" O.C.
26-1/2"			117.1	117.1	120.0	120.0	
37"			83.8	83.8	120.0	120.0	
53-1/8"			58.4	58.4	107.7	107.7	
19-1/8"			74-1/4"	6" O.C.	120.0	120.0	
26-1/2"	117.1	117.1			120.0	120.0	
37"	83.8	83.8			120.0	120.0	
53-1/8"	58.4	58.4			107.7	107.7	

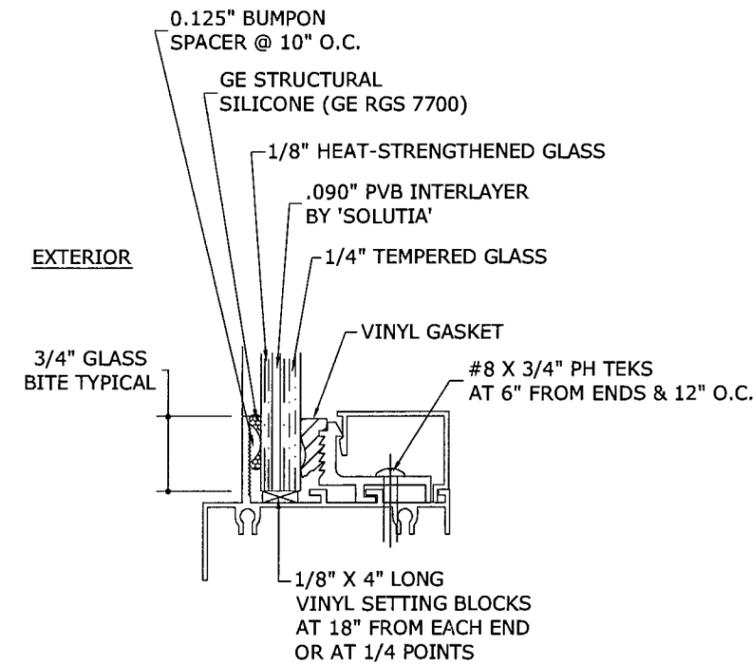

7/16" OVERALL LAMINATED GLASS

GLAZING DETAIL
SMALL MISSILE IMPACT RESISTANT

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **08-1219.04**
Expiration Date **DEC. 15, 2011**
By *Maureen Perez*
Miami Dade Product Control
Division

FRANK L. BENNARDO, P.E.
PE0046549

11/04/2008

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM

71 Progress Avenue,
Cranberry Township, PA 16166
Tel. (724) 776-7000

TRACO
Windows & Doors Inc.

SERIES 5758 FIXED WINDOW
SMALL MISSILE IMPACT RESISTANT

REMARKS	DRWN	CHKD	DATE
REV 7 - COUNTY COMMENT CTS	CL	CL	06/29/07
REV 8 - BCCO COMMENTS MEH	CL	CL	8/27/07
REV 9 - 2007 FBC KL	CL	CL	10/09/08
REV 3 - 2004 FBC CL	CL	FLB	06/20/05
REV 4 - COUNTY COMMENT AML	CL	FLB	06/25/05
REV 6 - GE SILICONE KL	CL	CL	10/25/06

03-0810-113b

PAGE SCALE:
DESCRIPTION:

11/04/2008 - 11:09am Keithl F:\01 Project Files\Traco (TRA)\2003 Jobs\03-0810a-113 + 03-0810b-113 Traco 5758 Fixed, NI + SMI (NOAs)\Traco 5758 Fixed Window, Small Missile (03-0810b-113) rev5.1.dwg