



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
**(305) 375-2901 FAX (305) 372-6339**

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

**AWP, LLC**  
**8130 NW 74<sup>th</sup> Avenue**  
**Medley, FL 33166**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Impact View" Aluminum Fixed Window - L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W03-39**, titled "Impact View Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 06/10/03, with revision "D", dated 11/24/08, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and renews** NOA # **07-0829.01** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 09-0107.09**  
**Expiration Date: March 04, 2014**  
**Approval Date: March 25, 2009**  
**Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **W03-39**, titled "Impact View Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 06/10/03, with revision "D", dated 11/24/08, signed and sealed by Humayoun Farooq, P.E,

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum fixed windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3467**, dated March 31, 2003, signed and sealed by Joseph C. Chan, P.E.

*(Submitted under NOA# 03-0710.01)*

2. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum fixed windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3553**, dated March 31, 2003, signed and sealed by Joseph C. Chan, P.E.


*(Submitted under NOA# 03-0710.01)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2004 and 2007, prepared by Al-Farooq Corporation, dated 5/23/06 and revised on 12/02/08, signed and sealed by Humayoun Farooq, P.E.  
**Complies with ASTM E1300-02/04**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

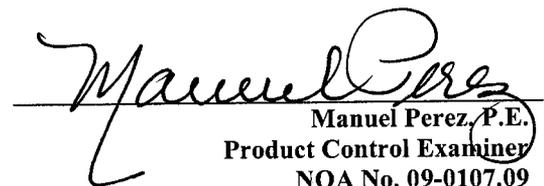  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 09-0107.09

Expiration Date: March 04, 2014  
Approval Date: March 25, 2009

AWP, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their “**Saflex III G Clear or colored interlayer**” dated 05/04/06, expiring on 05/21/11.

**F. STATEMENTS**





1. Statement letter of conformance, dated July 10, 2007, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated July 10, 2007, signed and sealed by Humayoun Farooq, P.E.
3. Statement letter of compliance, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL- 3467**, dated 04/11/03, signed and sealed by Joseph C. Chan, P.E.
4. Statement letter of conformance with FBC 2007, dated December 1, 2008, signed and sealed by Humayoun Farooq, P.E.

**G. OTHER**


1. Notice of Acceptance No. **07-0829.01**, issued to AWP, LLC for their **Series “Impact View” Aluminum Fixed Window – L.M.I.**, approved on 02/07/01 and expiring on 03/04/09.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 09-0107.09

Expiration Date: March 04, 2014  
Approval Date: March 25, 2009

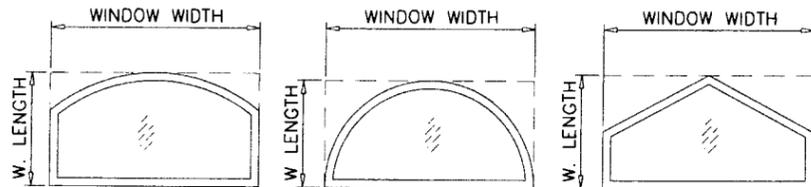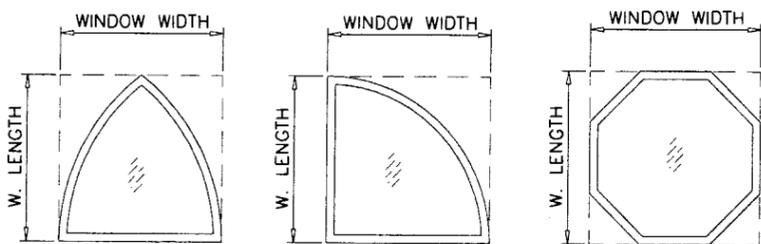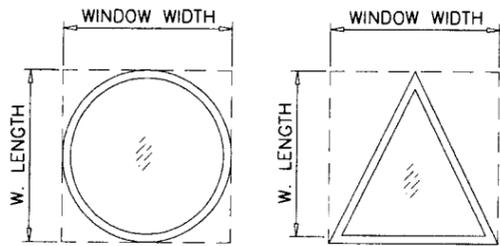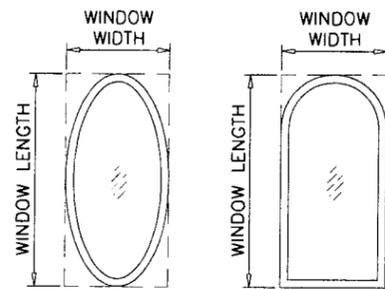

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

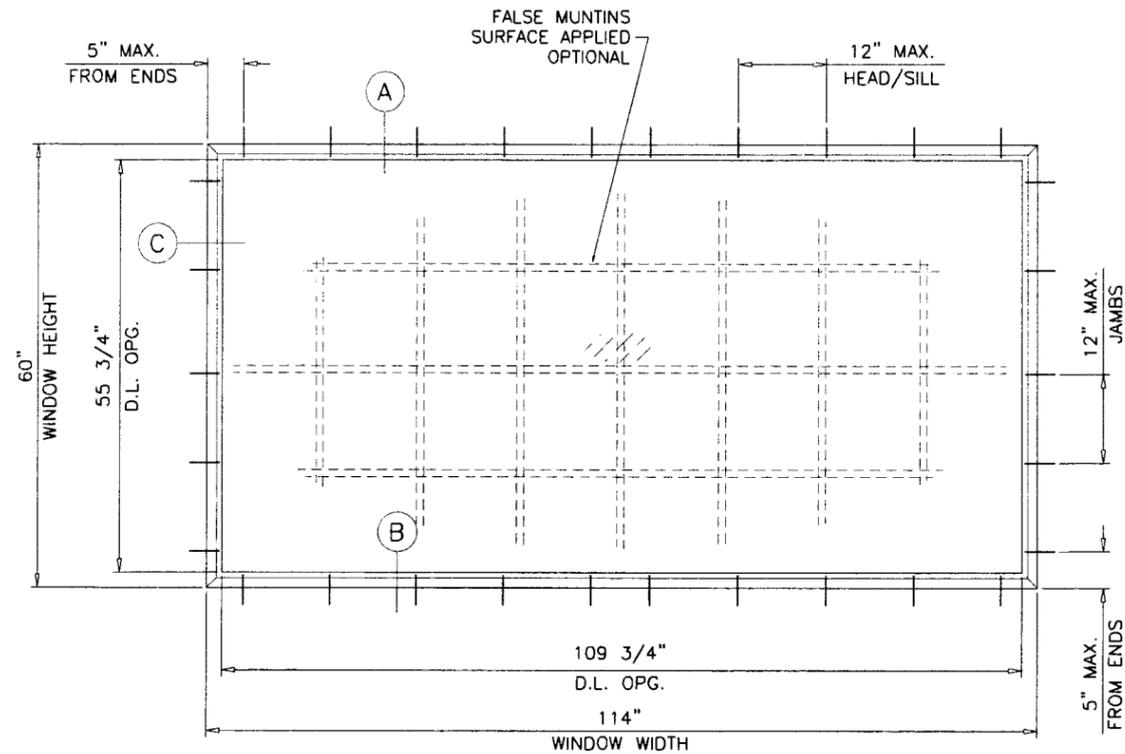

TYPICAL ELEVATION  
TESTED UNIT

**IMPACT VIEW ALUMINUM FIXED WINDOW**

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS ON SHEETS 2 & 3.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

PRODUCT REVISIONS  
as complying with the Florida Building Code  
09-0107.09  
MAY 14, 2014

DEC 02 2008

Manuel P. [Signature]

**afC**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W03-39YO


IMPACT VIEW ALUM FIXED WDW. (L.M.I.)  
**AWP, LLC.**  
8130 N.W. 74TH AVE.  
MEDLEY, FL. 33166  
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	11.06.03		NO CHANGE THIS SHEET
B	01.23.04		NOTES REV.
C	07.12.07		UPDATED FOR 2004 FBC. NAME REV
D	11.24.08		UPDATED FOR 2007 FBC

date: 06-10-03  
scale: 1/2" = 1'-0"  
dr. by: HAMID  
chk. by:


drawing no.  
**W03-39**  
sheet 1 of 6

DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		GLASS TYPE 'B'				GLASS TYPE 'C'			
		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
53-1/8"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
19-1/8"	38-3/8"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	80.0	80.0	80.0	80.0
53-1/8"		62.5	62.5	62.5	62.5	79.6	79.6	80.0	80.0
19-1/8"	50-5/8"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	80.0	80.0	80.0	80.0
53-1/8"		47.4	47.4	47.4	47.4	73.6	73.6	80.0	80.0
19-1/8"	63"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	75.6	75.6	80.0	80.0
53-1/8"		45.2	45.2	45.2	45.2	64.3	64.3	80.0	80.0
19-1/8"	74-1/4"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	70.4	70.4	80.0	80.0
53-1/8"		45.2	45.2	45.2	45.2	57.3	57.3	80.0	80.0

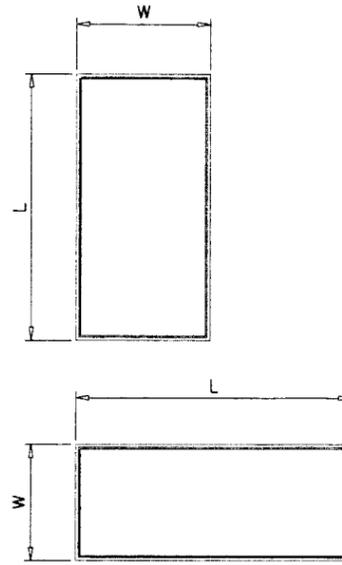

NOTE:  
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED  
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS).

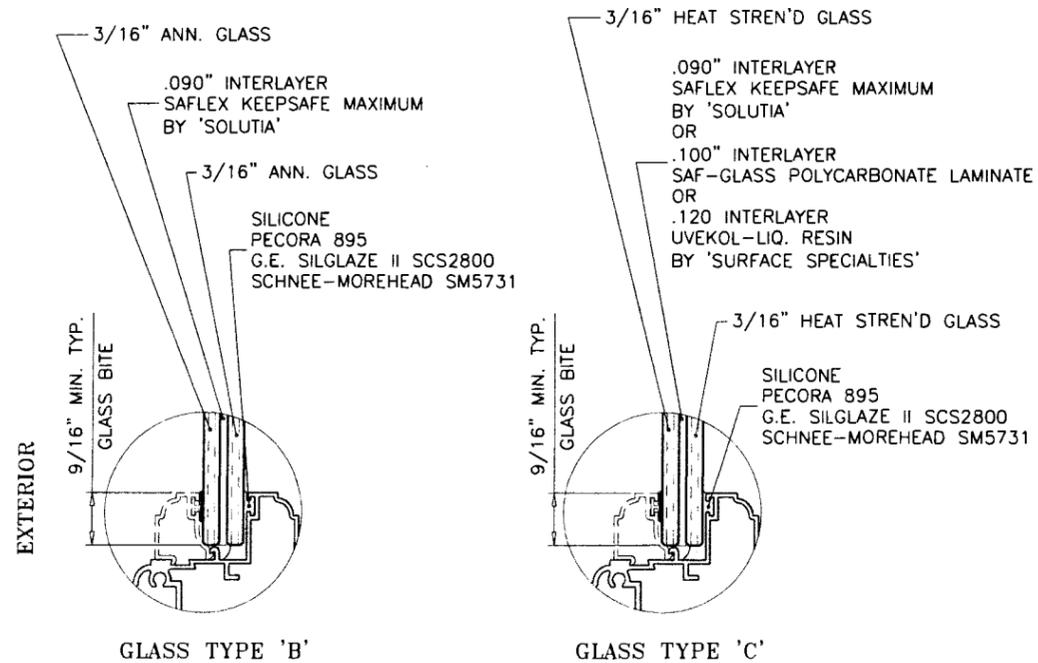

GLAZING DETAILS

Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 18557  
C.A.N. 3538

DEC 02 2008

PRODUCT REVISED  
to comply with the Florida  
Building Code  
Approved Date: 09-01-09  
MARCH 4, 2014

Signature: *Manuel Perez*



**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANI\W03-39YO

---

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)

**AWP, LLC.**  
8130 N.W. 74TH AVE.  
MEDLEY, FL. 33166  
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	LOAD CHART REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV
D	11.24.08	NOTE REV

---


date: 06-10-03  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no. **W03-39**

sheet 2 of 6

DESIGN LOAD CAPACITY - PSF										
WINDOW DIMS.		GLASS TYPE 'B'				GLASS TYPE 'C'				
		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
36"	48"	66.7	66.7	66.7	66.7	76.8	76.8	80.0	80.0	
42"		57.1	57.1	50.0	50.0	73.1	73.1	80.0	80.0	
48"		50.0	50.0	50.0	50.0	72.0	72.0	80.0	80.0	
54"		50.0	50.0	50.0	50.0	72.0	72.0	80.0	80.0	
60"		50.0	50.0	50.0	50.0	60.0	60.0	80.0	80.0	
66"		50.0	50.0	50.0	50.0	61.7	61.7	80.0	80.0	
72"		50.0	50.0	50.0	50.0	54.0	54.0	80.0	80.0	
36"	60"	66.7	66.7	66.7	66.7	68.6	68.6	80.0	80.0	
42"		57.1	57.1	50.0	50.0	63.3	63.3	80.0	80.0	
48"		50.0	50.0	50.0	50.0	60.0	60.0	80.0	80.0	
54"		44.4	44.4	44.4	44.4	58.2	58.2	80.0	80.0	
60"		40.0	40.0	40.0	40.0	57.6	57.6	80.0	80.0	
66"		40.0	40.0	40.0	40.0	57.6	57.6	80.0	80.0	
72"		40.0	40.0	40.0	40.0	49.4	49.4	80.0	80.0	
36"	72"	64.0	64.0	66.7	66.7	64.0	64.0	80.0	80.0	
42"		57.1	57.1	50.0	50.0	58.1	58.1	80.0	80.0	
48"		50.0	50.0	50.0	50.0	54.0	54.0	80.0	80.0	
54"		44.4	44.4	44.4	44.4	51.2	51.2	80.0	80.0	
60"		40.0	40.0	40.0	40.0	49.4	49.4	80.0	80.0	
66"		36.4	36.4	36.4	36.4	48.3	48.3	72.7	72.7	
72"		33.3	33.3	33.3	33.3	48.0	48.0	66.7	66.7	
36"	84"	61.1	61.1	66.7	66.7	61.1	61.1	80.0	80.0	
42"		54.9	54.9	50.0	50.0	54.9	54.9	80.0	80.0	
48"		50.0	50.0	50.0	50.0	50.4	50.4	80.0	80.0	
54"		44.4	44.4	44.4	44.4	47.2	47.2	80.0	80.0	
60"		40.0	40.0	40.0	40.0	44.8	44.8	80.0	80.0	
66"		-	-	-	-	43.1	43.1	72.7	72.7	
72"		-	-	-	-	42.0	42.0	66.7	66.7	
36"	96"	59.1	59.1	64.8	64.8	59.1	59.1	80.0	80.0	
42"		52.7	52.7	50.0	50.0	52.7	52.7	80.0	80.0	
48"		48.0	48.0	50.0	50.0	48.0	48.0	80.0	80.0	
54"		44.4	44.4	44.4	44.4	44.5	44.5	80.0	80.0	
60"		-	-	-	-	41.9	41.9	80.0	80.0	
66"		-	-	-	-	39.9	39.9	72.7	72.7	
36"		108"	57.6	57.6	63.2	63.2	57.6	57.6	80.0	80.0
42"	51.1		51.1	50.0	50.0	51.1	51.1	80.0	80.0	
48"	46.3		46.3	50.0	50.0	46.3	46.3	80.0	80.0	
54"	-		-	-	-	42.7	42.7	80.0	80.0	
60"	-		-	-	-	39.9	39.9	80.0	80.0	
36"	114"		60.0	60.0	62.5	62.5	60.0	60.0	80.0	80.0
42"			53.1	53.1	50.0	50.0	53.1	53.1	80.0	80.0
48"		48.0	48.0	50.0	50.0	48.0	48.0	80.0	80.0	
54"		-	-	-	-	44.1	44.1	80.0	80.0	
60"		-	-	-	-	41.1	41.1	80.0	80.0	
36"		120"	56.5	56.5	61.9	61.9	56.5	56.5	80.0	80.0
42"			49.9	49.9	-	-	49.9	49.9	80.0	80.0
48"	-		-	-	-	45.0	45.0	80.0	80.0	
54"	-		-	-	-	41.3	41.3	80.0	80.0	
36"	132"		55.6	55.6	60.9	60.9	55.6	55.6	80.0	80.0
42"			-	-	-	-	48.9	48.9	80.0	80.0
48"			-	-	-	-	44.0	44.0	80.0	80.0
36"		144"	54.9	54.9	60.2	60.2	54.9	54.9	80.0	80.0
42"			-	-	-	-	48.2	48.2	80.0	80.0

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS).

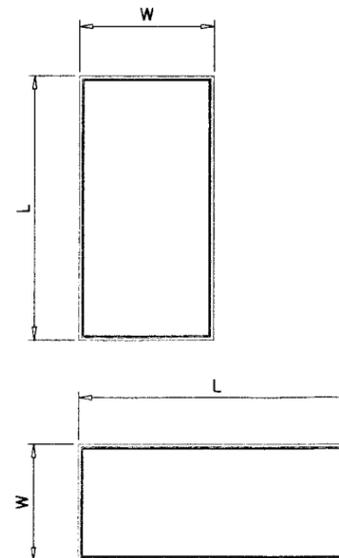


NOTE:  
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED  
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

APPROVED BY: *Manuel Diaz*  
DATE: 09-0107-09  
March 4, 2014

DEC 02 2008



**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W03-39YO

---

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)

**AWP, LLC.**  
8130 N.W. 74TH AVE.  
MEDLEY, FL. 33166  
TEL. (305) 887-2646 FAX (305) 883-1309

---

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	LOAD CHART REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV
D	11.24.08	NOTE REV.


---

date: 06-10-03	scale: -	dr. by: HAMID	chk. by:
drawing no.		W03-39	
sheet 3 of 6			

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	ANCHORS REV.
C	07.12.07	UPDATED FOR 2004 FBC. NAME REV.
D	11.24.08	ANCHORS REV.

date: 06-10-03	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
drawing no. <b>W03-39</b>			
sheet 4 of 6			

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

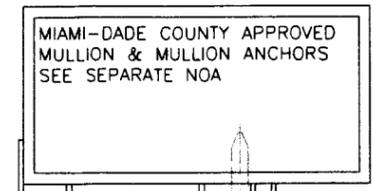

TYPICAL ANCHORS SEE ELEV. FOR SPACING

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING  
 TYPE 'A' - 3/16" TAPCONS BY 'ITW'  
3/16" ULTRACONS BY 'ELCO'  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE  
 1-3/8" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B' - 1/4" TAPCONS BY 'ITW'  
1/4" ULTRACONS BY 'ELCO'  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE  
 1-3/8" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
3/16" TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)  
 INTO METAL STRUCTURES  
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**#10 SMS OR SELF DRILLING SCREWS**  
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS  
 (NO SHIM SPACE)


**ANCHOR EDGE DISTANCES**  
 INTO CONCRETE AND MASONRY = 1-1/4" MIN.  
 INTO WOOD STRUCTURE = 3/4" MIN.  
 INTO METAL STRUCTURE = 1/2" MIN.

**SEALANTS:**  
 FRAME CORNERS AND INSTALLATION SCREWS SEALED WITH GE SILICONE SEALANT.


Engr: DR. HUMAYOON FAROOQ  
 STRUCTURES  
 FLA. PE # 18557  
 C.A.N. 353B  
 DEC 02 2008

PRODUCT REVISION  
 As complying with the Florida  
 Building Code  
 Approved By: *Manuel*  
 09-0107.09  
 MARCH 4, 2014

TYPICAL ANCHORS SEE ELEV. FOR SPACING

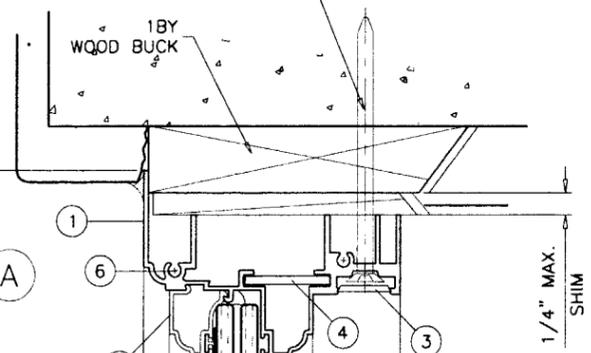

TYPICAL ANCHORS SEE ELEV. FOR SPACING

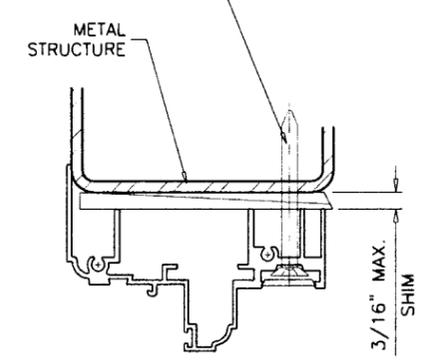

3/16" MAX. SHIM

A


B

EXTERIOR

WINDOW HEIGHT

TYPICAL ANCHORS SEE ELEV. FOR SPACING




TYPICAL ANCHORS SEE ELEV. FOR SPACING

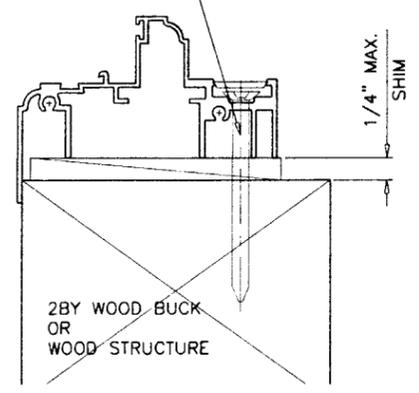

1/4" MAX. SHIM

2BY WOOD BUCK OR WOOD STRUCTURE

D.L. OPG.

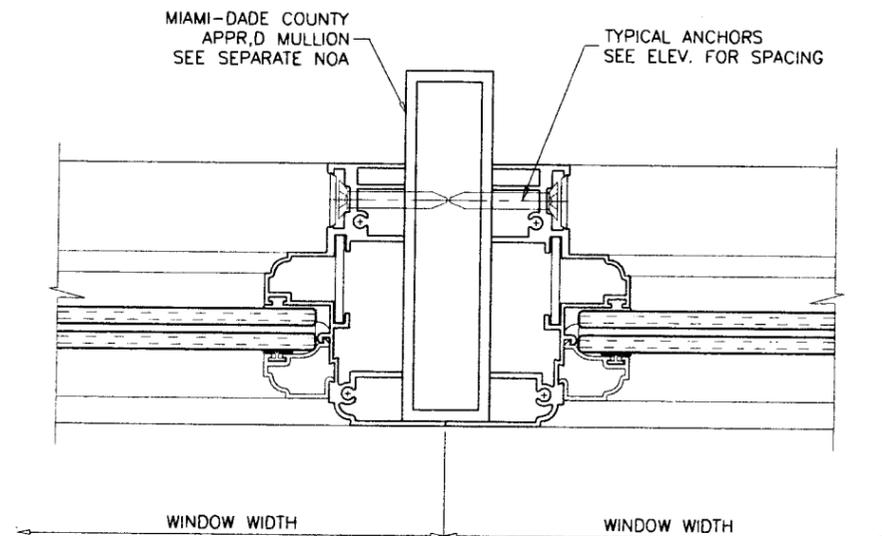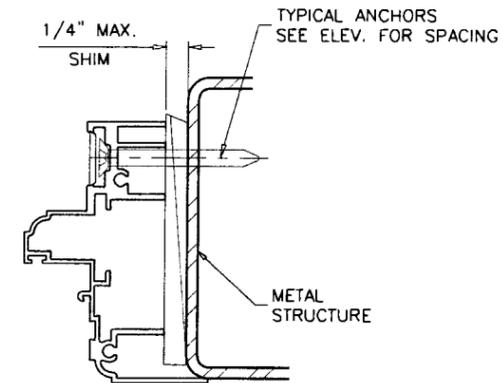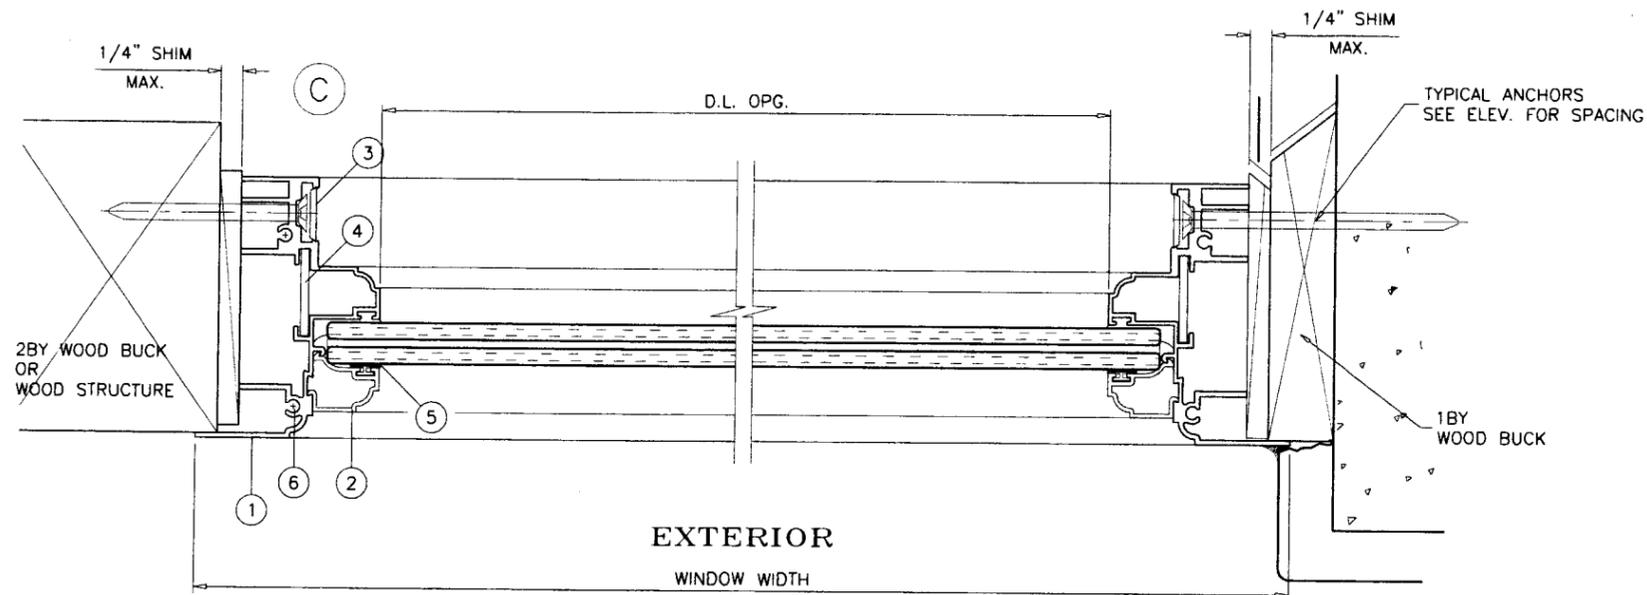

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

PRODUCT REVISED  
to comply with the Florida  
Building Code  
09-0107, 09  
MARCH 4, 2014  
Manuel  
DEC 02 2008

**afC**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W03-39YO


IMPACT VIEW ALUM FIXED WDW. (L.M.I.)  
**AWP, LLC.**  
8130 N.W. 74TH AVE.  
MEDLEY, FL. 33166  
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	11.06.03		NO CHANGE THIS SHEET
B	01.23.04		ANCHORS REV.
C	07.12.07		UPDATED FOR 2004 FBC, NAME REV
D	11.24.08		NO CHANGE THIS SHEET


date: 06-10-03  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W03-39**  
sheet 5 of 6


ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YE-68	4	WINDOW FRAME	6063-T5	-
2	YE-1405	AS REQD.	GLAZING STOP (OPTIONAL)	6063-T5	-
3	YE-816	4	COVER PLATE	6063-T5	-
4	YH-1465	4	FRAME CORNER KEY	6063-T5	-
5	YH-622	AS REQD.	GLAZING VINYL	VINYL	SULLIVAN
6	YF-10	2/ CORNER	FRAME ASSEMBLY SCREWS	-	#8 X 1" PH SMS

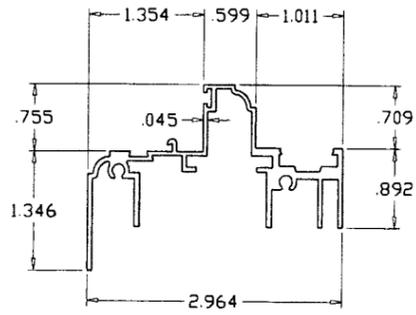


WINDOW FRAME



GLAZING BEAD

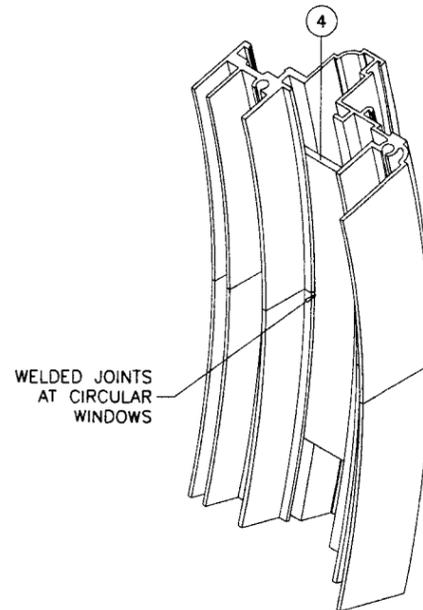


CIRCULAR WINDOWS

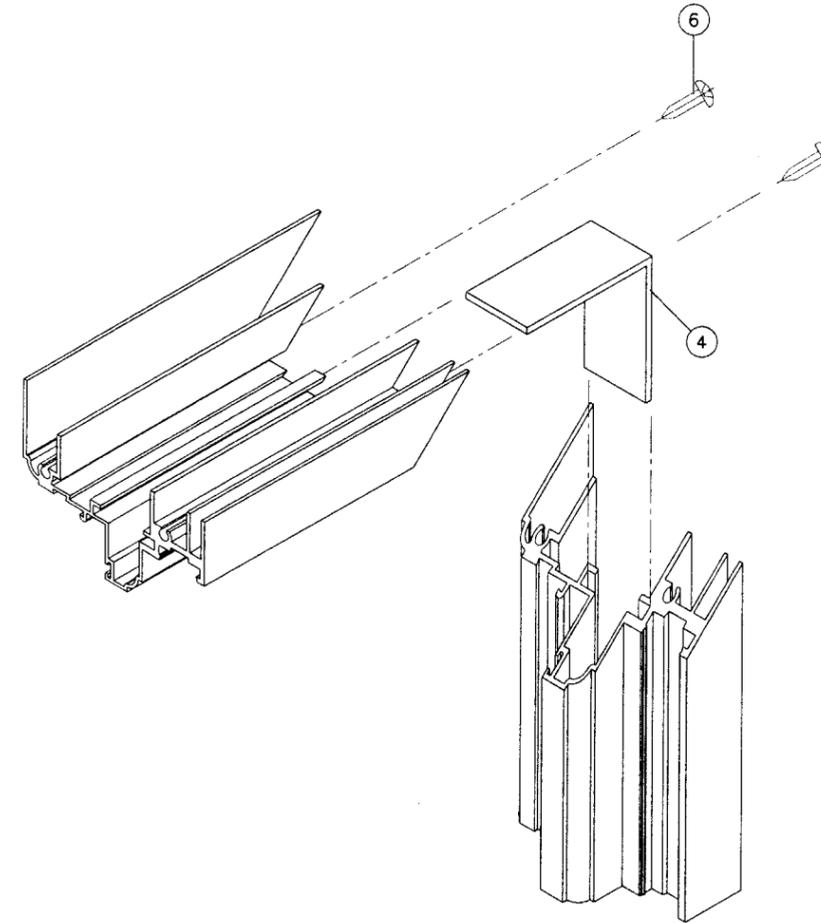

RECT. OR SQUARE WINDOWS

TYP. CORNER DETAILS



**AL-FAROQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W03-3970

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)  
**AWP, LLC.**  
8130 N.W. 74TH AVE.  
MEDLEY, FL. 33166  
TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	by	description
A	11.06.03		FRAME ALLOY REV.
B	01.23.04		NO CHANGE THIS SHEET
C	07.12.07		UPDATED FOR 2004 FBC NAME REV.
D	11.24.08		NO CHANGE THIS SHEET

Engr: DR. HUMAYCUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

PRODUCT REVISION  
09-0107.09  
MARCH 4, 2014  
*Manuel Cruz*

*[Signature]*  
DEC 02 2008

date: 06-10-03  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W03-39**

sheet 6 of 6