



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

K. D. Windows, Inc.
3705 Shares Place
Riviera Beach, FL 33404

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "400" Aluminum Horizontal Sliding Window – N.I.

APPROVAL DOCUMENT: Drawing No. **07-003**, titled "Series 400 Aluminum Horizontal Sliding Window", sheets 1 through 4 of 4, dated 01/03/07, prepared by EngCo, Inc., signed and sealed by Pedro De Figueiredo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LIMITATIONS: Miami-Dade County Product Control Approved Shutters Or Protection Devices Shall Be Required.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **06-1205.03** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 09-0122.01
Expiration Date: December 27, 2009
Approval Date: February 25, 2009
 Page 1

K. D. Windows, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS


1. Manufacturer's die drawings and sections.
2. Drawing No **07-004**, Sheets 1 through 4 of 4, titled "Series 400 Aluminum Horizontal Sliding Window", dated 01/03/07, prepared by EngCo, Inc., signed and sealed by Pedro De Figueiredo, P.E. *(Submitted under previous NOA# 06-1205.03)*

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
along with marked-up drawings and installation diagram of 3 specimens of XOX aluminum horizontal sliding window, prepared by American Test Lab South Florida, Inc., Test Report No. **ATL-0428.01-97**, dated 02/12/01, signed and sealed by William R. Mehner, P.E and by Gerard B. Sullivan, P.E. *(Submitted under NOA# 01-0110.05)*
2. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
along with marked-up drawings and installation diagram of 1 specimen of XO inside glazed aluminum horizontal sliding window, prepared by American Test Lab of South Florida, Test Report No. **ATL-0428.02-97**, dated 02/12/01, signed and sealed by William R. Mehner, P.E and by Gerard B. Sullivan, P.E. *(Submitted in NOA# 01-0110.05)*
3. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
along with marked-up drawings and installation diagram of 1 specimen of XO outside glazed aluminum horizontal sliding window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0145-0504-98**, dated 06/10/98, signed and sealed by Timothy S. Marshall, P.E. *(Submitted under previous NOA# 01-0110.05)*
4. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
along with marked-up drawings and installation diagram of 1 specimen of XO outside glazed aluminum horizontal sliding window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0145-0905-98**, dated 09/03/98, signed and sealed by Timothy S. Marshall, P.E. *(Submitted under previous NOA# 01-0110.05)*

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by EngCo, Inc., dated 02/14/07, signed and sealed by Pedro De Figueiredo, P.E. **Complies with ASTM E1300-98/02** *(Submitted under NOA# 06-1205.03)*

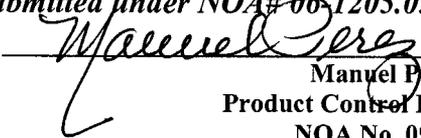
Manuel Perez, P.E.
Product Control Examiner
NOA No. 09-0122.01
Expiration Date: December 27, 2009
Approval Date: February 25, 2009

K. D. Windows, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None.

E. STATEMENTS


1. Statement letter of conformance and no financial interest, dated February 14, 2007, signed and sealed by Pedro De Figueiredo, P.E.
(Submitted under previous NOA# 06-1205.03)
2. Laboratory compliance letter for Test Report no. **ATL-0428.01-97** and **ATL-0428.02-97**, issued by Hurricane Test Laboratory, Inc., dated February 12, 2001, signed and sealed by William R. Mehner, P.E and by Gerard B. Sullivan, P.E.
(Submitted under previous NOA# 01-0110.05)
3. Laboratory compliance letter for Test Report no. **ATL-0428.01-97** and **ATL-0428.02-97**, issued by Hurricane Test Laboratory, Inc., dated February 12, 2001, signed and sealed by William R. Mehner, P.E and by Gerard B. Sullivan, P.E.
(Submitted under previous NOA# 01-0110.05)
4. Laboratory compliance letter for Test Report no. **HTL-0145-0504-98** and **HTL-0145-0905-98** issued by Hurricane Test Laboratory, Inc., dated June 10, 1998 and September 03, 1998, signed and sealed by Timothy S. Marshall, P.E.
(Submitted under previous NOA# 01-0110.05)
5. Testing agreement letter, dated 02/08/2007 between Hurricane Test Laboratory, Inc. (HTL) and K.D. Windows, Ltd. (K.D.), issued by HFTL.
(Submitted under previous NOA# 06-1205.03)
6. Second (2nd) Testing agreement letter, dated 12/19/2008 between Hurricane Test Laboratory, Inc. (HTL) and K.D. Windows, Ltd. (K.D.), issued by HTL.
7. One year conditional approval dated 04/26/07 and expired on 12/27/08, subjected to successful verification test. *(Submitted under previous NOA# 06-1205.03)*

G. OTHERS

1. Notice of Acceptance No. **06-1205.03**, issued to K.D. Windows, Ltd. for their Series 400 Aluminum Horizontal Sliding Window – Impact Resistant, approved on 04/26/07 and expiring on 12/27/08.
2. Second (2nd) additional one (1-yr.) year conditional approval, subjecting to successful verification test, the final approval will be for the remaining 3 years, the balance of a total 5 years.

H. LIMITATIONS:

Miami-Dade County Product Control Approved Shutters Or Protection Devises Shall Be Required.

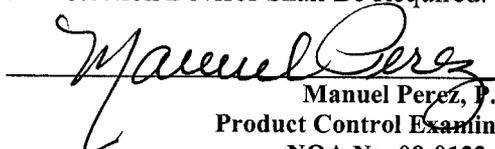
Manuel Perez, P.E.
Product Control Examiner
NOA No. 09-0122.01
Expiration Date: December 27, 2009
Approval Date: February 25, 2009


INDEX:

- SHEET 1 of 5 - GENERAL NOTES, TYPICAL ELEVATIONS OX, XOX AND ALLOWABLE PRESSURES TABLE 1
- SHEET 2 of 5 - ANCHORAGE LAY-OUT AND ANCHOR SPACING TABLE 2
- SHEET 3 of 5 - VERTICAL & HORIZONTAL DETAILS
- SHEET 4 of 5 - GLAZING DETAILS & WINDOW COMPONENTS
- SHEET 5 of 5 - ASSEMBLY DETAIL

GENERAL NOTES:

- 1- CODE: THIS PRODUCT HAS BEEN TESTED AND DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2004 INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2- DEFINITION: THIS PRODUCT IS AN ALUMINUM HORIZONTAL SLIDING WINDOW NON IMPACT RESISTANT.
- 3- POSTING: 'SERIES 400 ALUMINUM HORIZONTAL SLIDING WINDOW KD WINDOWS - RIVIERA BEACH - FLORIDA DADE COUNTY PRODUCT CONTROL APPROVED'
- 4- DESIGN LOADS: THE DESIGNED LOADS MUST BE CALCULATED BY A PROFESSIONAL ARCHITECT OR ENGINEER FOR EACH SPECIFIC PROJECT. THE CALCULATED DESIGNED PRESSURE MUST NOT EXCEED THE ALLOWABLE APPROVED PRESSURE.
- 5- MATERIAL: ALL ALUMINUM PARTS TO BE 6063-T5 ALLOY OR AS NOTED AND GLAZING TO BE AS SPECIFIED ON THIS APPROVAL.
- 6- FASTENERS: ASSEMBLY SCREWS AND ANCHORS SHALL BE AS SPECIFIED IN THE CURRENT SET OF DRAWINGS. INSTALLATION AND LOADS AS PER THIS APPROVAL. ANCHOR QUANTITY & SPACING MUST NOT EXCEED THE MAXIMUM LIMITS SPECIFIED BY THIS APPROVAL.
- 7- USE: IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, ARCHITECT OR ENGINEER OF RECORD TO VERIFY THE FOLLOWING:
 - 7.1- THE STABILITY OF THE STRUCTURE WHERE THE PRODUCT IS TO BE ATTACHED INSURING PROPER ANCHORAGE.
 - 7.2- THE SITE SPECIFIC PROJECT CRITERIA, SUCH AS BUT NOT LIMITED TO, LOCAL CODE REQUIREMENTS, DESIGNED PRESSURES ETC.
 - 7.3- THAT THIS APPROVAL IS ADEQUATE TO THE SPECIFIC PROJECT.
- 8- 33 1/3% INCREASE IN ALLOWABLE LOADS HAVE NOT BEEN USED IN THE DESIGN OF THE ANCHORS FOR THIS PRODUCT APPROVAL, HOWEVER, WOOD SCREWS WITH 1.6 INCREASE FOR WIND LOAD DURATION HAVE BEEN USED.
- 9- DISSIMILAR MATERIALS: MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL, THAT COME IN CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BUILDING CODE SECTION 2003.8.4.
- 10- LIMITATION: THIS PRODUCT CAN ONLY BE INSTALLED WITH APPROVED IMPACT RESISTANT PROTECTION IN WIND BORNE DEBRIS REGIONS AS DEFINED BY THE FLORIDA BUILDING CODE.

TYPICAL XOX ELEVATION

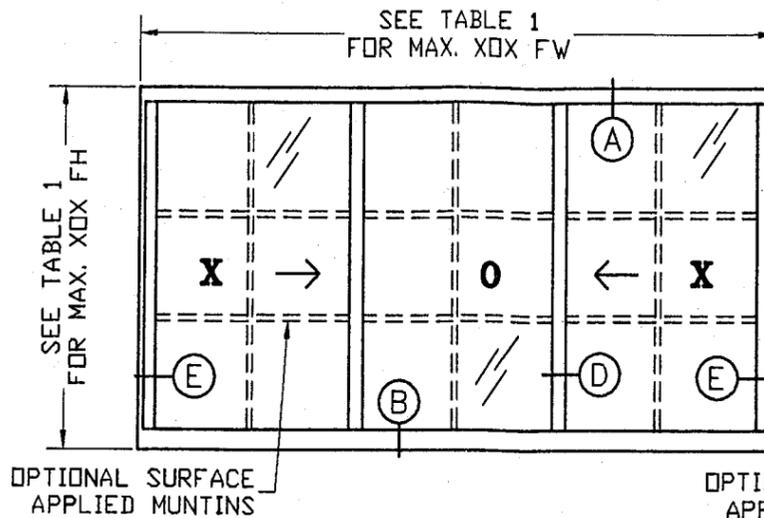

TYPICAL OX or XO ELEVATION

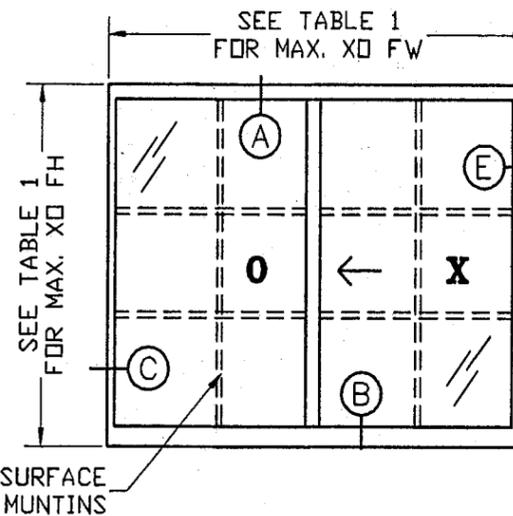


TABLE 1 - WINDOW DESIGNED PRESSURE RATING

WINDOW SIZES (inches)			WINDOW DESIGN RATING (PSF)					
			POSITIVE PRESSURE GLASS TYPE			NEGATIVE PRESSURE GLASS TYPE		
WIDTH XOX	WIDTH OX/XO	HEIGHT	1/8" AN	3/16" AN	1/4" TEMP	1/8" AN	3/16" AN	1/4" TEMP
54	36	24	53	53	100	96	122	210
72	48	24	53	53	100	81	102	210
90	60	24	53	53	100	69	92	210
118	79	24	50	53	100	50	82	210
54	36	36	53	53	100	70	100	187
72	48	36	53	53	100	57	81	187
90	60	36	51	53	100	51	70	182
118	79	36	41	53	100	41	60	157
54	36	48	53	53	100	53	91	140
72	48	48	39	53	100	39	71	140
90	60	48	37	53	100	37	59	140
108	72	48	34	51	90	34	53	140
118	79	48	31	48	82	31	51	128
54	36	60	36	53	100	36	86	112
72	48	60	-	53	88	-	63	107
90	60	60	-	45	70	-	45	86
118	79	60	-	40	54	-	40	65
54	36	64.5	-	53	100	-	84	104
72	48	64.5	-	53	76	-	60	80
90	60	64.5	-	41	61	-	41	64
118	79	64.5	-	36	46	-	36	49
156	104	64.5	-	32	35	-	32	37
54	36	72	-	53	65	-	69	69
72	48	72	-	49	49	-	52	52

EXAMPLE 3: 90X24 XOX WINDOW RATED TO +53, -69 PSF W/ 1/8" ANNEALED GLASS

EXAMPLE 2: 108X48 XOX WINDOW RATED TO +51, -53 PSF W/ 3/16" ANNEALED GLASS

EXAMPLE 1: 48X72 OX WINDOW RATED TO +49, -52 PSF W/ 1/4" TEMPERED GLASS

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No 09-0122.01
Expiration Date 12/27/2009
By *Maurice Perez*
Miami Dade Product Control Division

Manufacturer:
KD Windows
3705 SHARES PLACE
RIVIERA BCH, FL. 33404
TEL.: (561) 845-1401
FAX: (561) 845-1498

Product:
SERIES 400
ALUMINUM HORIZONTAL SLIDING WINDOW

Engineering:
EngCo Inc.
CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305

FEB 14 2007
Engineer Seal
Pedro De Figueredo
PE 52609

Date: 01/03/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:
PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 06-1205.03
Expiration Date 12/27/2008
By *Maurice Perez*
Miami Dade Product Control Division

Drawing Number
07-003

Sheet
1 of 5

TABLE 2

WINDOW SIZES (inches)			WINDOW DESIGN RATING (PSF)						MAXIMUM ANCHOR SPACING FOR PERIMETER FRAMING																	
			POSITIVE PRESSURE			NEGATIVE PRESSURE			SILL ANCHORS SPACING (S) IN ON CENTER						HEADER ANCHORS SPACING (S) IN ON CENTER						JAMB ANCHORS SPACING (S) IN ON CENTER					
			GLASS TYPE			GLASS TYPE			3/16" ANCHOR			1/4" ANCHOR			3/16" ANCHOR			1/4" ANCHOR			3/16" ANCHOR			1/4" ANCHOR		
			WIDTH XOX	WIDTH OX/XO	HEIGHT	1/8" AN	3/16" AN	1/4" TEMP	1/8" AN	3/16" AN	1/4" TEMP	1/8" AN	3/16" AN	1/4" TEMP	1/8" AN	3/16" AN	1/4" TEMP	1/8" AN	3/16" AN	1/4" TEMP	1/8" AN	3/16" AN	1/4" TEMP	1/8" AN	3/16" AN	1/4" TEMP
54	36	24	53	53	100	96	122	210	12	10	6	12	12	9	8	6	3	12	12	8	11	9	5	11	11	11
72	48	24	53	53	100	81	102	210	12	12	6	12	12	9	9	7	3	12	12	8	10	8	4	11	11	8
90	60	24	53	53	100	69	92	210	12	12	6	12	12	9	11	8	3	12	12	8	10	7	3	11	11	7
118	79	24	50	53	100	50	82	210	12	12	6	12	12	9	12	9	3	12	12	8	10	6	na	11	11	5
54	36	36	53	53	100	70	100	187	12	8	4	12	12	7	7	5	na	12	11	6	11	11	7	11	11	11
72	48	36	53	53	100	57	81	187	12	11	4	12	12	6	9	6	na	12	12	5	11	11	5	11	11	8
90	60	36	51	53	100	51	70	182	12	12	4	12	12	7	10	7	na	12	12	6	11	11	4	11	11	8
118	79	36	41	53	100	41	60	157	12	12	5	12	12	8	12	8	3	12	12	7	11	10	4	11	11	7
54	36	48	53	53	100	53	91	140	12	7	4	12	11	7	7	4	na	12	9	6	11	11	10	11	11	11
72	48	48	39	53	100	39	71	140	12	9	4	12	12	7	10	5	na	12	11	6	11	11	7	11	11	11
90	60	48	37	53	100	37	59	140	12	11	4	12	12	7	10	6	na	12	12	6	11	11	6	11	11	10
108	72	48	34	51	90	34	53	140	12	12	4	12	12	7	11	7	na	12	12	6	11	11	5	11	11	8
118	79	48	31	48	82	31	51	128	12	12	5	12	12	8	12	7	3	12	12	6	11	11	5	11	11	8
54	36	60	36	53	100	36	86	112	12	6	4	12	9	7	8	3	na	12	7	6	11	11	11	11	11	11
72	48	60	-	53	88	-	63	107	na	8	4	na	12	7	na	5	na	na	10	6	na	11	9	na	11	11
90	60	60	-	45	70	-	45	86	na	11	6	na	12	9	na	7	3	na	12	7	na	11	9	na	11	11
118	79	60	-	40	54	-	40	65	na	12	8	na	12	12	na	7	4	na	12	10	na	11	9	na	11	11
54	36	64.5	-	53	100	-	84	104	na	5	4	na	9	7	na	3	na	na	7	6	na	11	11	na	11	11
72	48	64.5	-	53	76	-	60	80	na	8	6	na	12	9	na	4	3	na	10	7	na	11	11	na	11	11
90	60	64.5	-	41	61	-	41	64	na	12	7	na	12	11	na	7	4	na	12	9	na	11	11	na	11	11
118	79	64.5	-	36	46	-	36	49	na	12	10	na	12	12	na	8	6	na	12	12	na	11	11	na	11	11
156	104	64.5	-	32	35	-	32	37	na	12	12	na	12	12	na	9	7	na	12	12	na	11	11	na	11	11
54	36	72	-	53	65	-	69	69	na	12	12	na	9	9	na	3	3	na	8	8	na	5	5	na	11	11
72	48	72	-	49	49	-	52	52	na	12	12	na	12	12	na	5	5	na	10	10	na	6	6	na	11	11

Manufacturer:
KD Windows
3705 SHARES PLACE
RIVIERA BCH, FL. 33404
TEL.: (561) 845-1401
FAX: (561) 845-1498

Product:
SERIES 400
ALUMINUM HORIZONTAL
SLIDING WINDOW

Engineering:
EngCo Inc.
CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305

[Signature]
FEB 14 2007

Engineer Seal
Pedro De Figueiredo
PE 52609

Date: 01/03/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-1205.03
Expiration Date 12/12/2008
By *[Signature]*
Miami Dade Product Control
Division

Drawing Number
07-003

Sheet
2 of 5



○ EXAMPLE 1: 48X72 OX WINDOW
RATED TO +49, -52 PSF
W/ 1/4" TEMPERED GLASS
SILL W/ 1/4" TAPCONS 12" OC
HEADER W/ 1/4" TAPCONS AT 10" OC
JAMBS W/ 1/4" TAPCONS AT 11" OC

□ EXAMPLE 2: 108X48 XOX WINDOW
RATED TO +51, -53 PSF
W/ 3/16" ANNEALED GLASS
SILL W/ 3/16" TAPCONS 12" OC
HEADER W/ 3/16" TAPCONS AT 7" OC
JAMBS W/ 3/16" TAPCONS AT 11" OC




ANCHOR TYPES:
A- 3/16" OR 1/4" TAPCON BY ITW WITH 1" MIN. EMBED. INTO 3192 psi CONCRETE
B- 3/16" OR 1/4" TAPCON BY ITW THROUGH 1X PT WOOD W/ 1" EMBED. INTO 3192 psi CONCRETE
C- 3/16" OR 1/4" TAPCON WITH 1 1/2" MIN. EMBED. INTO PT WOOD (SG) = .55
EDGE DISTANCE: 1" INTO WOOD; 2 5/8" INTO CONCRETE

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 09-0122.01
Expiration Date 12/27/2009
By *[Signature]*
Miami Dade Product Control
Division


TYPICAL ANCHOR SPACING LAY-OUT

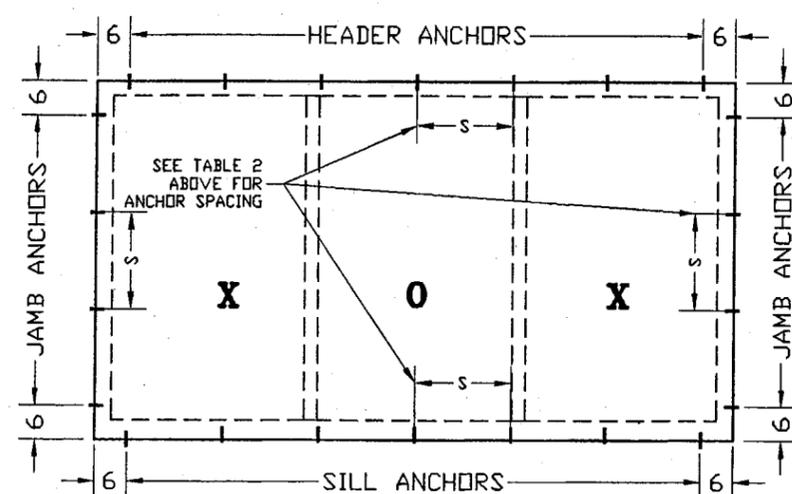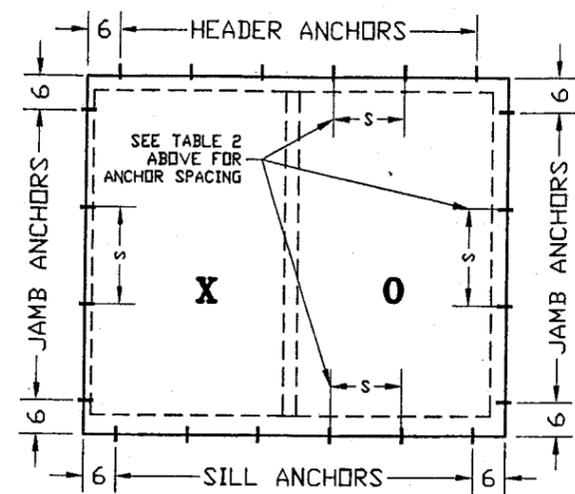


GLAZING DETAILS

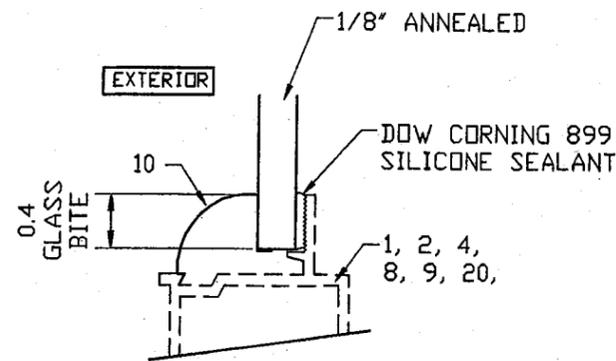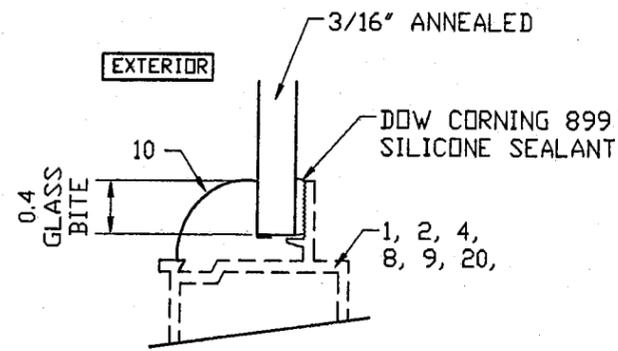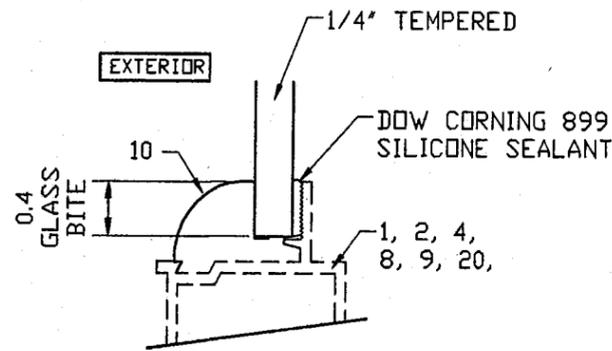


WINDOW COMPONENTS

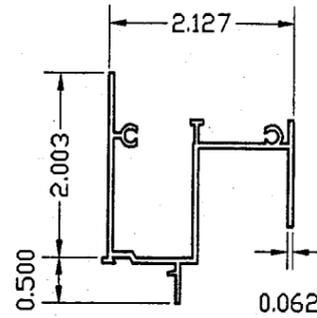


1- FRAME HEAD




7- LATCH

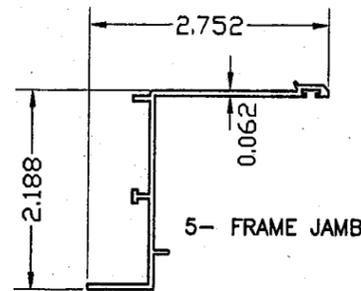


5- FRAME JAMB




8- SASH VENT JAMB




6- SASH TOP/BOTTOM




3- SILL TRACK

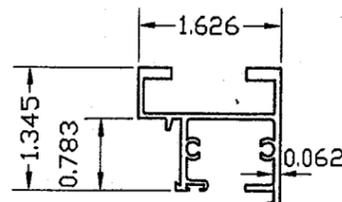


9- VENT MEETING RAIL

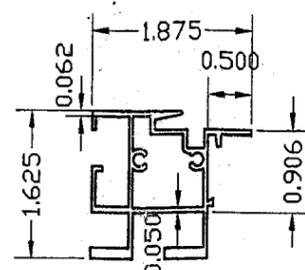

4- FIXED MEETING RAIL

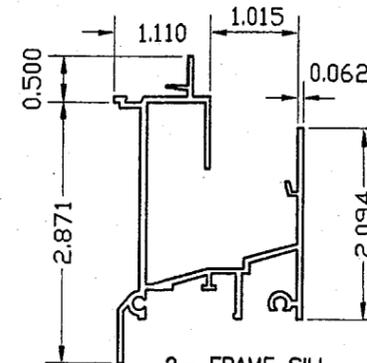

2- FRAME SILL

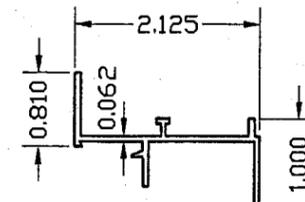

18- FRAME JAMB

MATERIAL LIST XOX/XO/OX OUTSIDE GLAZED WNDOW

No	PART	QTY		PART DESCRIPTION	MATERIAL
		XO	OXO		
1	AW-353	1	1	FRAME HEAD	6063-T5
2	AW-401	1	1	FRAME SILL	6063-T5
3	AW-402	1	1	FRAME SILL TRACK	6063-T5
4	AW-373	1	2	FIXED MEETING RAIL	6063-T5
5	AW-361	1	2	FRAME JAMB	6063-T5
6	AW-355	2	4	SASH TOP & BOTTOM	6063-T5
7	AW-354	1	2	LATCH	6063-T5
8	AW-360	1	2	SASH VENT JAMB	6063-T5
9	AW-374	1	2	VENT MEETING RAIL	6063-T5
10		AR	AR	GLAZING STOP	ROLL FORMED
11	-	AR	AR	ASSEMBLY SCREWS	#8X1 RHPS
12	-	AR	AR	ASSEMBLY SCREWS	#8X3 RHPS
13	-	4	8	PLASTIC HOUSING	-
14	-	2	4	PLASTIC WHEEL	-
15	-	AR	AR	FIN SEAL PILE	-
16	-	2	2	2" FOAM	-
17	-	AR	AR	899/995 DOW CORNING	SILICONE
18	AW-359	1	0	FRAME JAMB FIXED	6063-T5

AR - AS REQUIRED

Manufacturer:
**KD
Windows**

3705 SHARES PLACE
RIVIERA BCH, FL. 33404
TEL.: (561) 845-1401
FAX: (561) 845-1498

Product:
SERIES 400
ALUMINUM HORIZONTAL
SLIDING WINDOW

Engineering:
EngCo Inc.

CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305

FEB 14 2007

Engineer Seal
Pedro De Figueiredo
PE 52609

Date: 01/03/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **06-1205.03**
Expiration Date **12/27/2008**
By *[Signature]*
Miami/Dade Product Control
Division

Drawing Number
07-003


Sheet
4 of 5

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. **09-0122-01**
Expiration Date **12/27/2009**
By *[Signature]*
Miami/Dade Product Control
Division


FRAME ASSEMBLY

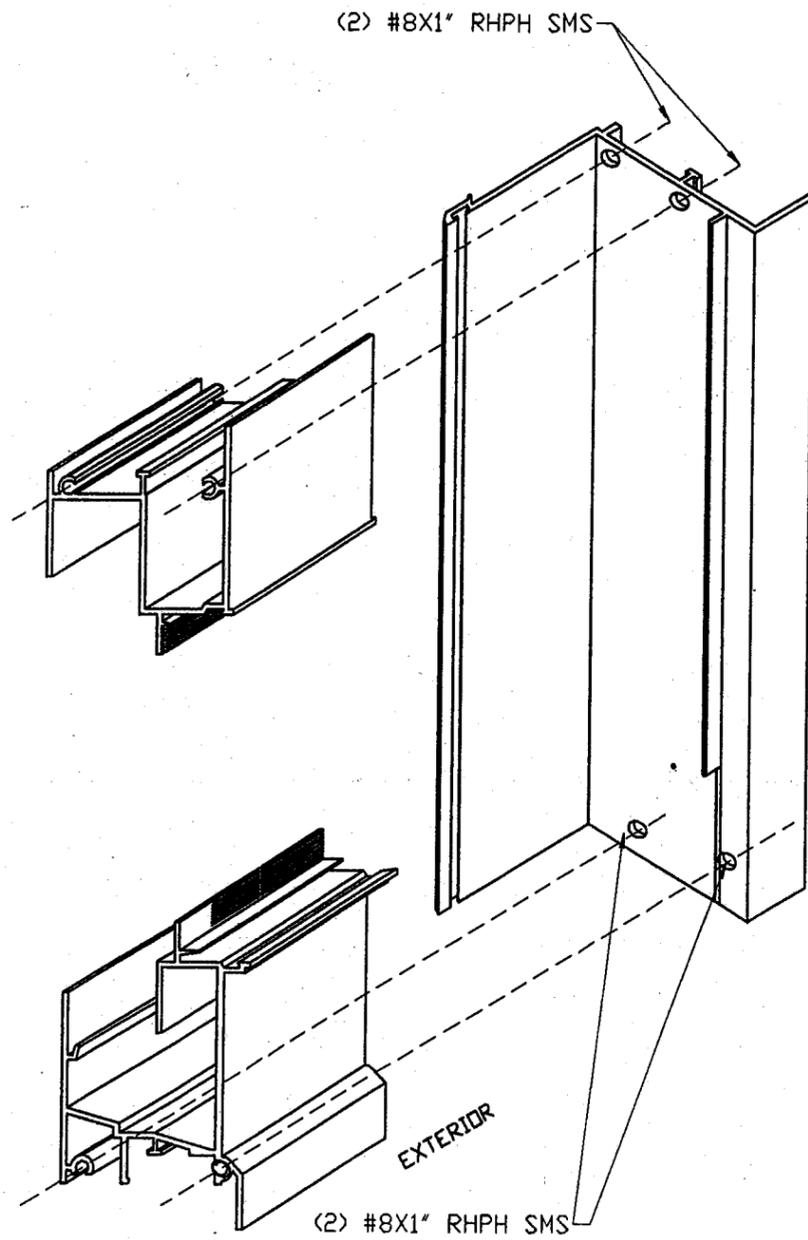

VENT ASSEMBLY

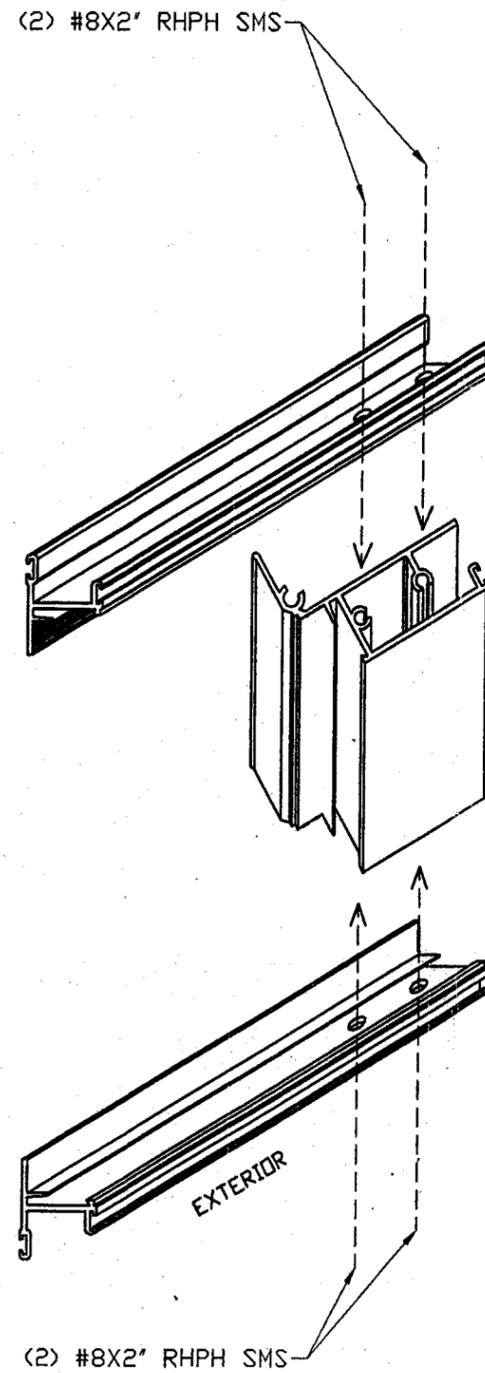

MEETING RAIL ASSEMBLY

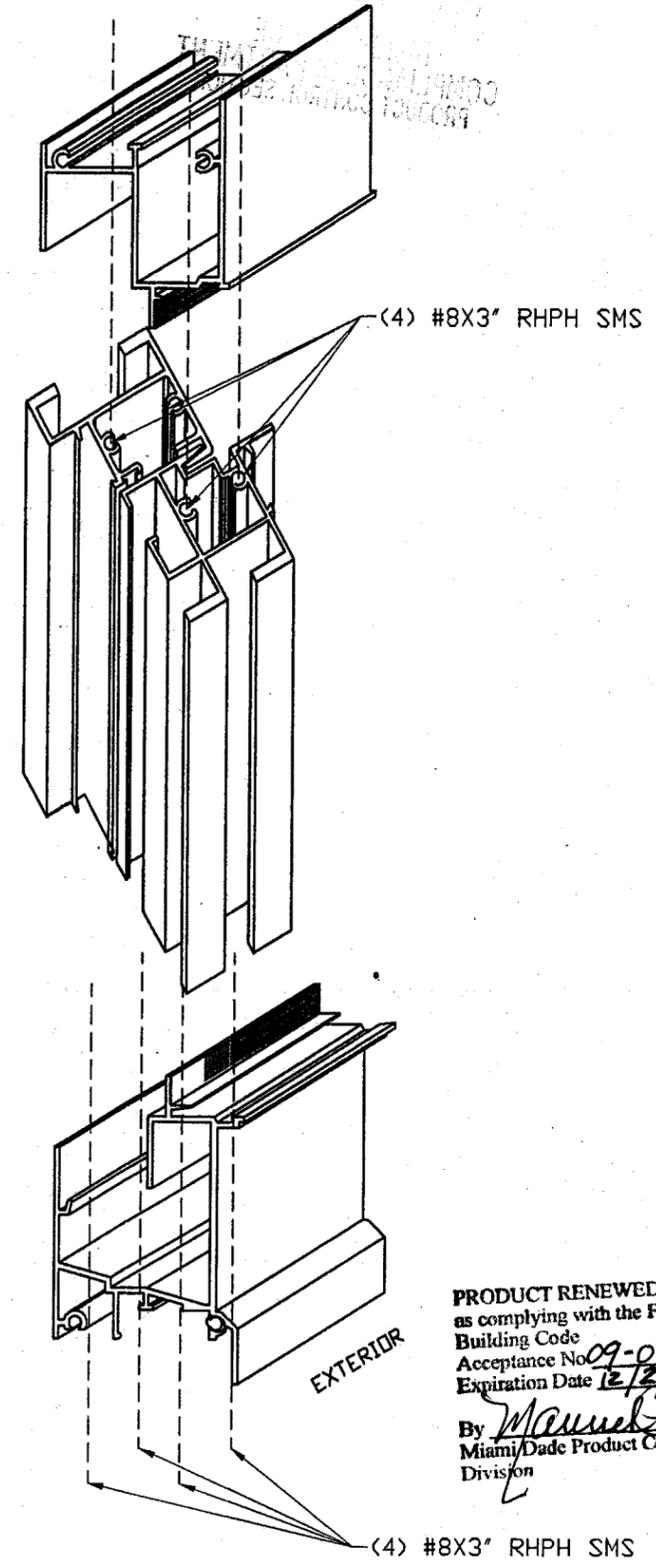

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 09-0122.01
Expiration Date 12/27/2009
By *Manuel Perez*
Miami/Dade Product Control
Division

Manufacturer:
**KD
Windows**
3705 SHARES PLACE
RIVIERA BCH, FL. 33404
TEL.: (561) 845-1401
FAX: (561) 845-1498

Product:
SERIES 400
ALUMINUM HORIZONTAL
SLIDING WINDOW

Engineering:
EngCo Inc.
CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305



FEB 14 2007
Engineer Seal
Pedro De Figueredo
PE 52609

Date: 01/03/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:
PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-1205.03
Expiration Date 12/27/2008
By *Manuel Perez*
Miami/Dade Product Control
Division

Drawing Number
07-003

Sheet
5 of 5