



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.miamidade.gov/Buildingcode

NOTICE OF ACCEPTANCE (NOA)

NAS Unlimited Doors, LLC
2450 Palm Avenue Street
Hialeah, Fl. 33010

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HI-TECH" Outswing Steel Entrance Doors-Impact

APPROVAL DOCUMENT: Drawing No. **W08-73** titled "Series "HI-TECH" OutSwing Entrance Door" Sheets 1 through 7 of 7, prepared by Al-Farooq Corporation, dated 08-11-08 and last revised on July 02, 2009, signed and sealed by Arshad Viqar, P. E. bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitation: 1. Max. height of the door with Wood veneer is limited to 100" and Decorative Steel is limited to 83".

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Yongkang, Zhejiang, China and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No 09-0128.07
Expiration Date: July 22, 2014
Approval Date: July 22, 2009
Page 1

8
7/2/14

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's parts and sections drawings.
2. Drawing No. **W08-73** titled "Series "HI-TECH" OutSwing Entrance Door" Sheets 1 through 7 of 7, prepared by Al-Farooq Corporation, dated 08-11-08 and last revised on July 02, 2009, signed and sealed by Arshad Viqar, P. E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC TAS 202-94
 - 2) Uniform Static Air Pressure Test Loading per FBCTAS 202-94
 - 3) Water Resistance Test, per FBC TAS 202-94
 - 4) Forced Entry Resistance Test, per FBC TAS 202-94
 - 5) Large Missile Impact Test, FBC TAS 201-94
 - 6) Cyclic Loading Test, per FBC TAS 203-94

Along with installation diagram of double outswing steel doors, marked-up by Fenestration Testing Laboratories, Inc. Test Reports Nos. **FTL 5478 (FTL07190)**, dated 01/26/09 and **FTL 5656 (FTL08090)** dated 01/27/09, both signed and sealed by Carlos Rionda, P.E.

C. CALCULATIONS:

1. Anchor calculations and structural analysis per FBC 2007, prepared by Al-Farooq Corporation, dated 10/09/08, signed and sealed by Dr. Humayun Farooq, P.E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Tensile Test report No. **FTL5478**, Tests #1, 2 & 3 dated 01-26-09 per ASTM A-370-05 for steel face sheet, prepared by Fenestration Testing laboratory, signed and sealed by Carlos Rionda, P.E.

F. STATEMENTS



1. Statement letter of conformance and no financial interest, dated July 01, 2009, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.
2. Statement letter of conformance and no financial interest, dated September 23, 2008, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E.
3. Laboratory Compliance statement issued as part of test report.

G. OTHER

1. Test proposal # 07-3338, 07-3338 R and 07-03338R-1, dated 06/05/08, approved by BCCO.
2. Distribution agreement between NAS Unlimited Door, LLC and the manufacturer, China.



Ishaq I Chanda, P.E.
Product Control Examiner
NOA No 09-0128.07
Expiration Date: July 22, 2014
Approval Date: July 22, 2009

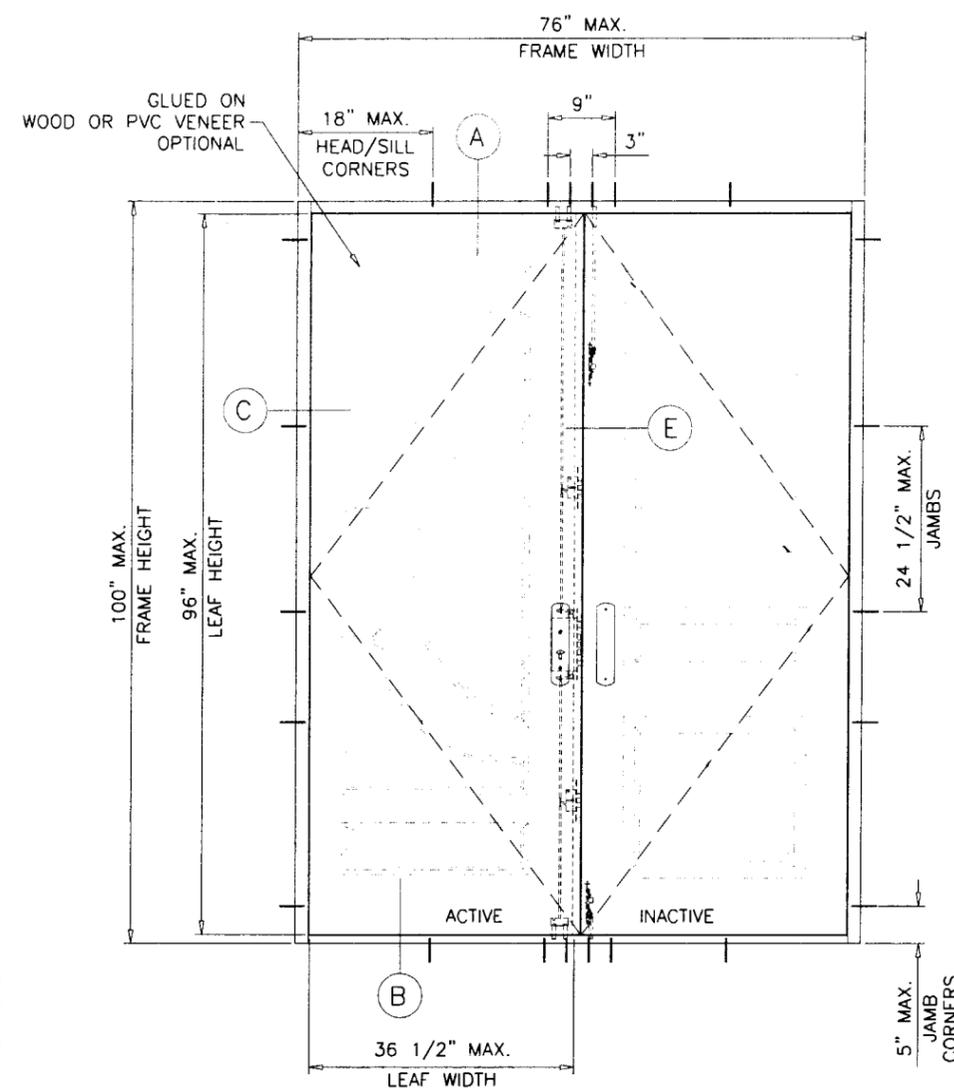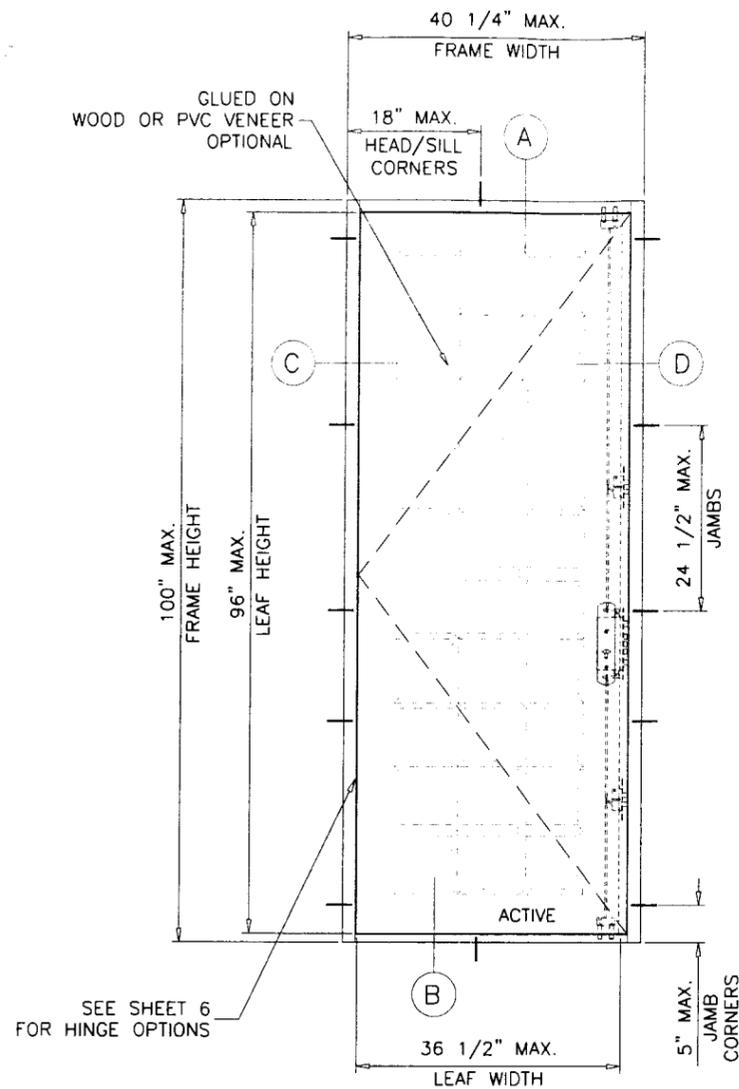

(X)

(XX)

MAXIMUM DESIGN LOAD RATING = + 70.0 PSF
 (FOR SIZES SHOWN OR SMALLER - 80.0 PSF
 AS LIMITED BY CODE)
 DOORS WITH WOOD VENEER

EGRESS REQUIREMENTS TO BE REVIEWED BY BUILDING OFFICIAL

Approved as complying with the
 Florida Building Code
 Date July 22, 2009
 NOA# 09-0128-07
 Miami Dade Product Control
 Division
 By Isaac I. Chande

**SERIES HI-TECH OUTSWING ENTRANCE DOORS
 WITH DECORATIVE WOOD VENEER
 OR WITH DECORATIVE STEEL SURFACE**

DOORS ARE APPROVED FOR INSTALLATIONS WHERE
 WATER INFILTRATION RESISTANCE IS REQUIRED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
 REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING
 HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO
 TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
 EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
 ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO
 CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS
 OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
 SHUTTERS ARE NOT REQUIRED.

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUL 02 2009


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W08-73NUD

SERIES HI-TECH OUTSWING ENTRANCE DOOR (L.M.I.)
NAS UNLIMITED DOORS, LLC.
 2450 PALM AVE.
 HIALEAH, FL. 33010
 TEL. (305) 805-0522 FAX. (305) 805-8422


no.	date	description	REV. PER BCCO COMMENTS
A	06.25.09		

date: 08-11-08
 scale: 1/2"=1'-0"
 dr. by: HAMID
 chk. by:

drawing no.
W08-73
 sheet 1 of 7

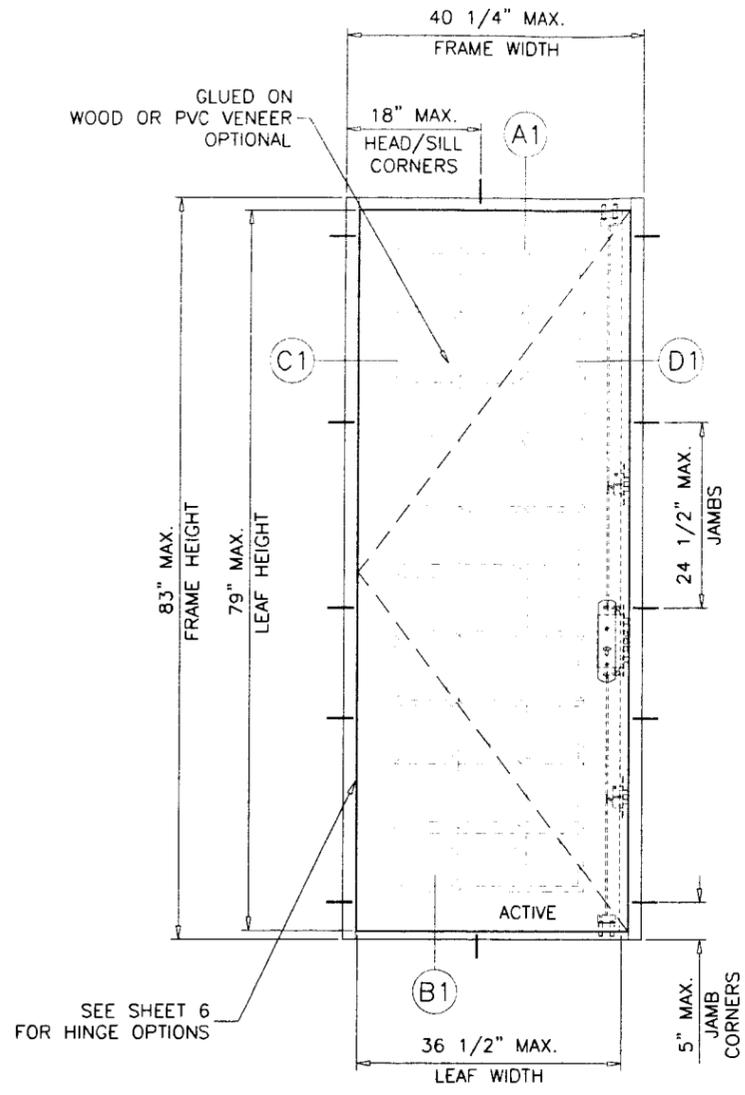

(X)

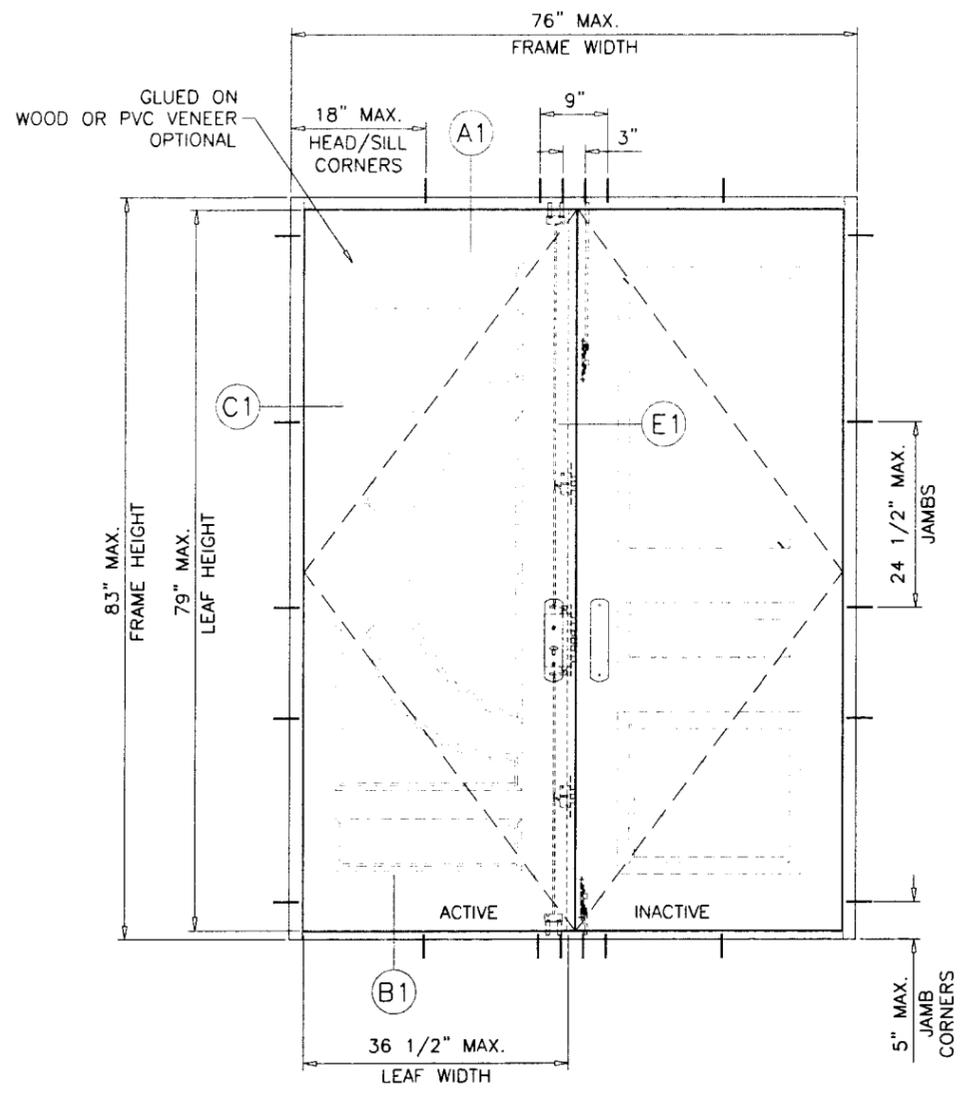

(XX)

SEE SHEET 6 FOR HINGE OPTIONS

MAXIMUM DESIGN LOAD RATING = + 70.0 PSF
 (FOR SIZES SHOWN OR SMALLER - 80.0 PSF AS LIMITED BY CODE)
 DOORS WITH DECORATIVE STEEL SURFACE

EGRESS REQUIREMENTS TO BE REVIEWED BY BUILDING OFFICIAL

Approved as complying with the Florida Building Code
 Date July 22, 2009
 NOA# 09-0128-07
 Miami Dade Product Control Division
 By Ishaq Ehsani

Engr. ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUL 02 2009


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \ W08 - 73NUD

SERIES HI-TECH OUTSWING ENTRANCE DOOR (L.M.I.)
NAS UNLIMITED DOORS, LLC.
 2450 PALM AVE.
 HIALEAH, FL. 33010
 TEL. (305) 805-0522 FAX. (305) 805-8422


no.	date	by	description
A	06.25.09		REV. PER ECCC COMMENTS

date: 08-11-08
 scale: 1/2"=1'-0"
 dr. by: HAMID
 chk. by:


drawing no.
W08-73
 sheet 2 of 7

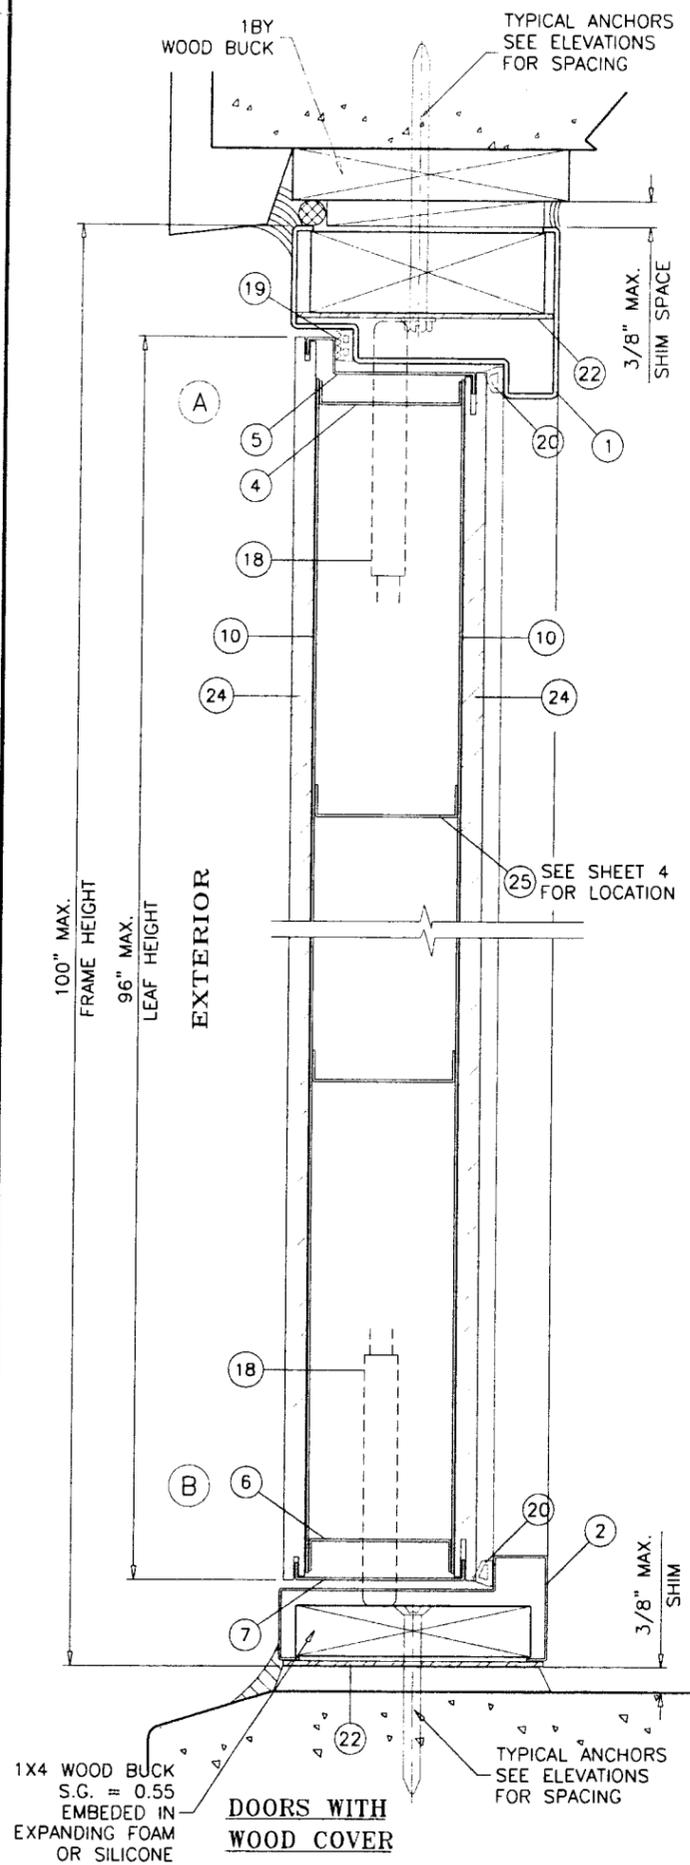


DOORS WITH WOOD COVER

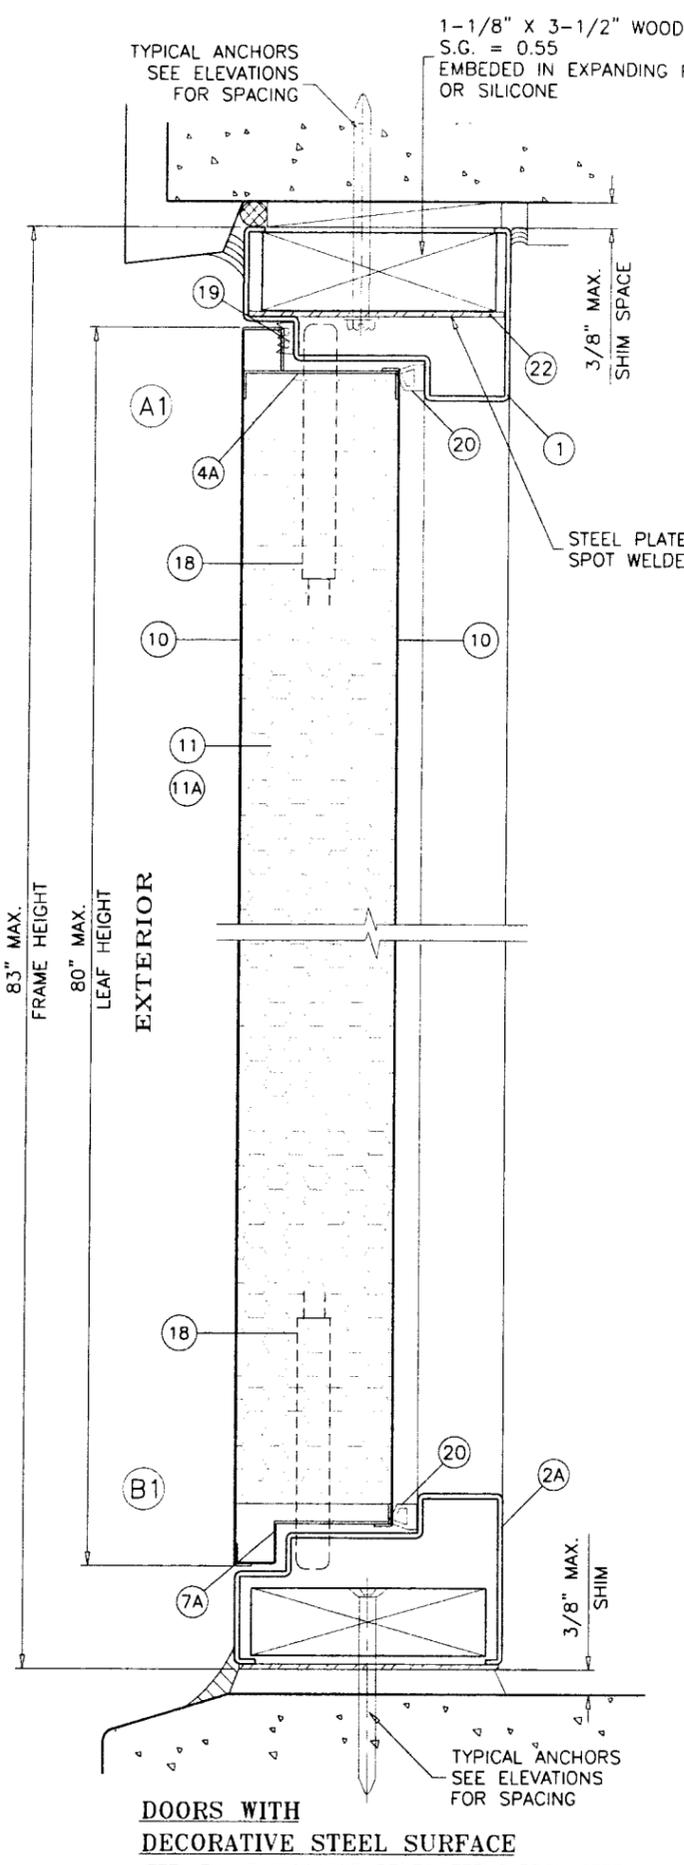

DOORS WITH DECORATIVE STEEL SURFACE
STEEL TO BE STAINLESS OR PAINTED CARBON STEEL

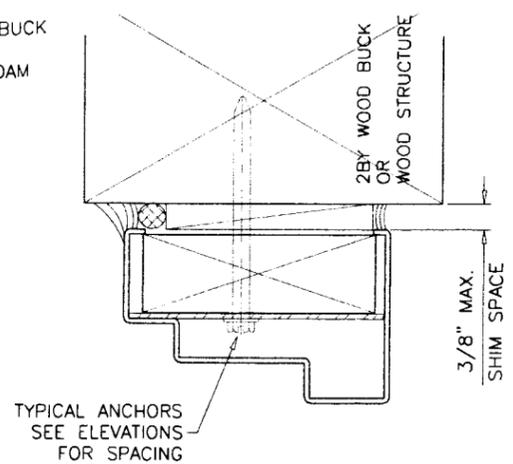

STEEL PLATE SPOT WELDED TO FRAME

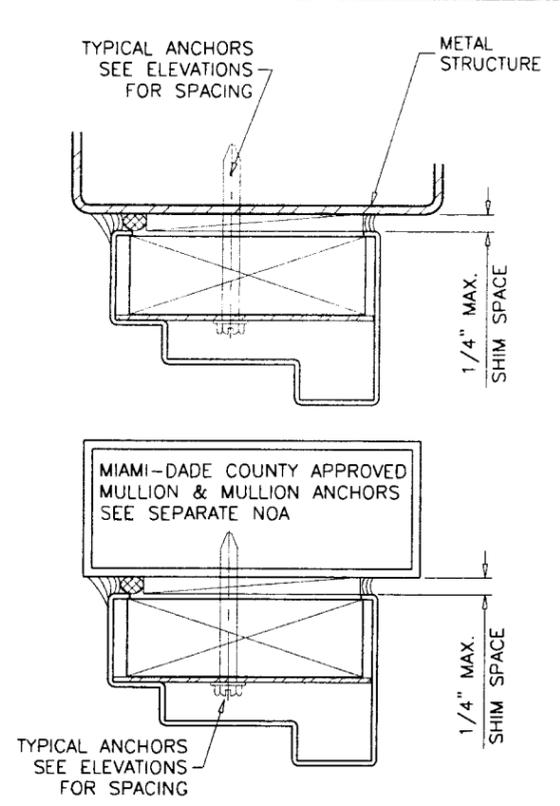

WOOD BUCKS AND METAL STRUCTURES NOT BY NAS UNLIMITED MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
- INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
- 1-1/2" MIN. PENETRATION INTO WOOD
- THRU 1BY BUCKS INTO CONC. OR MASONRY
- 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
- DIRECTLY INTO CONC. OR MASONRY
- 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

- #14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
- INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")
- INTO METAL STRUCTURES
- STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
- ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
- (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

- INTO CONCRETE AND MASONRY = 2-1/2" MIN.
- INTO WOOD STRUCTURE = 1" MIN.
- INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
MASONRY f'm = 2000 PSI MIN.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

Ar
JUL 02 2009

Approved as complying with the
Florida Building Code
Date July 22, 2009
NOA# 09-0128-07
Miami Dade Product Control
Division
By [Signature]

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-73NUID


SERIES HI-TECH OUTSWING ENTRANCE DOOR (L.M.I.)
NAS UNLIMITED DOORS, LLC.
2450 PALM AVE.
HIALEAH, FL. 33010
TEL. (305) 805-0522 FAX. (305) 805-8422

revisions:	no	date	by	description
	A	06.25.09		REV. PER BCCO COMMENTS


date: 08-11-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-73


sheet 3 of 7

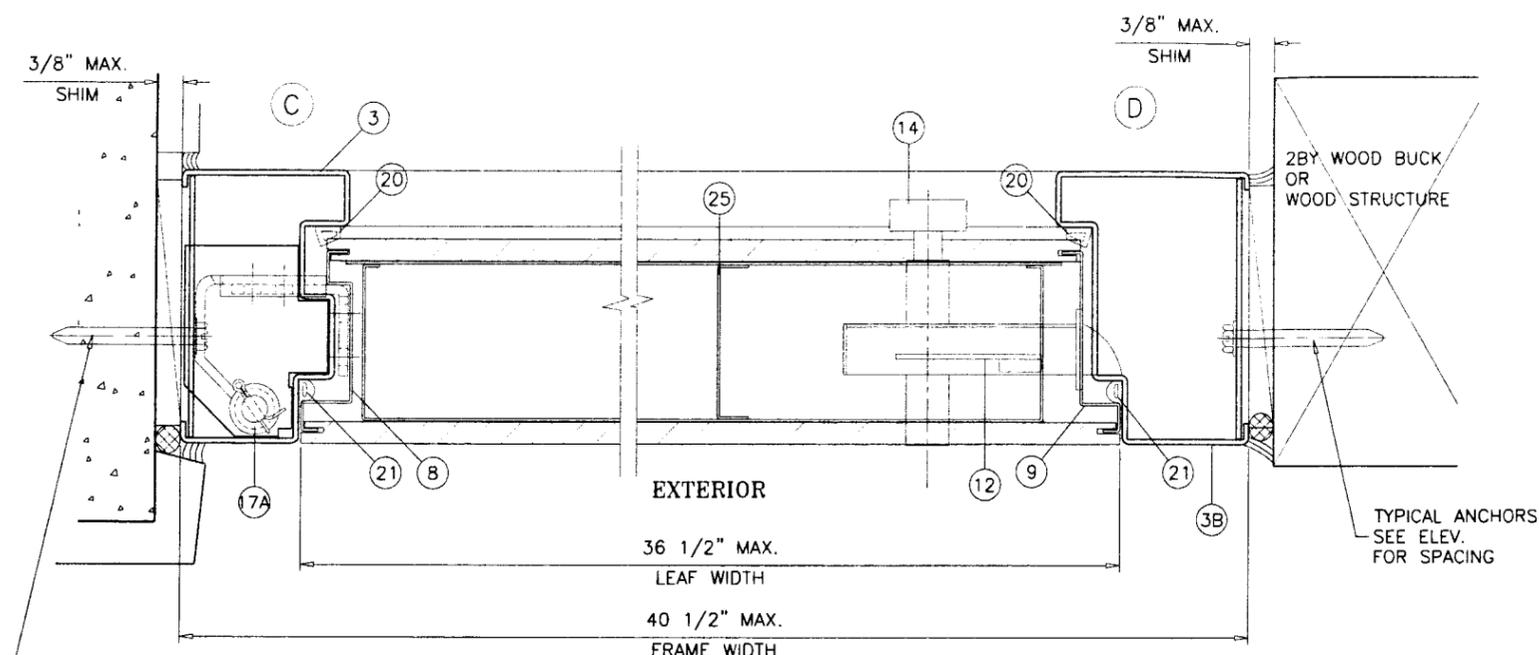

SINGLE (X) DOORS WITH WOOD COVER

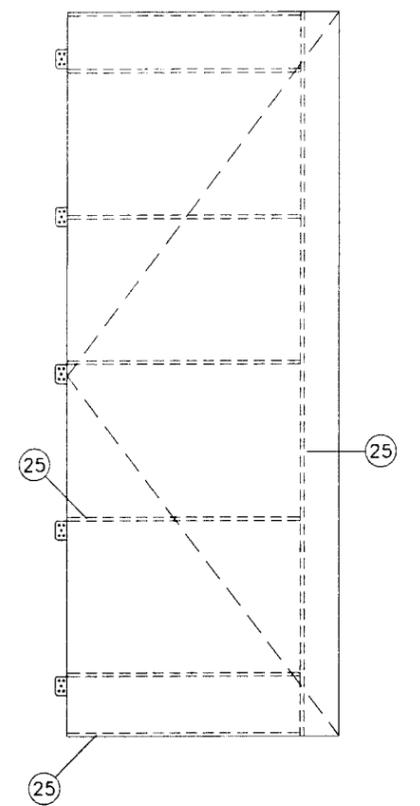

DOOR LEAF WITH WOOD COVER REINFORCING CHANNEL LOCATIONS

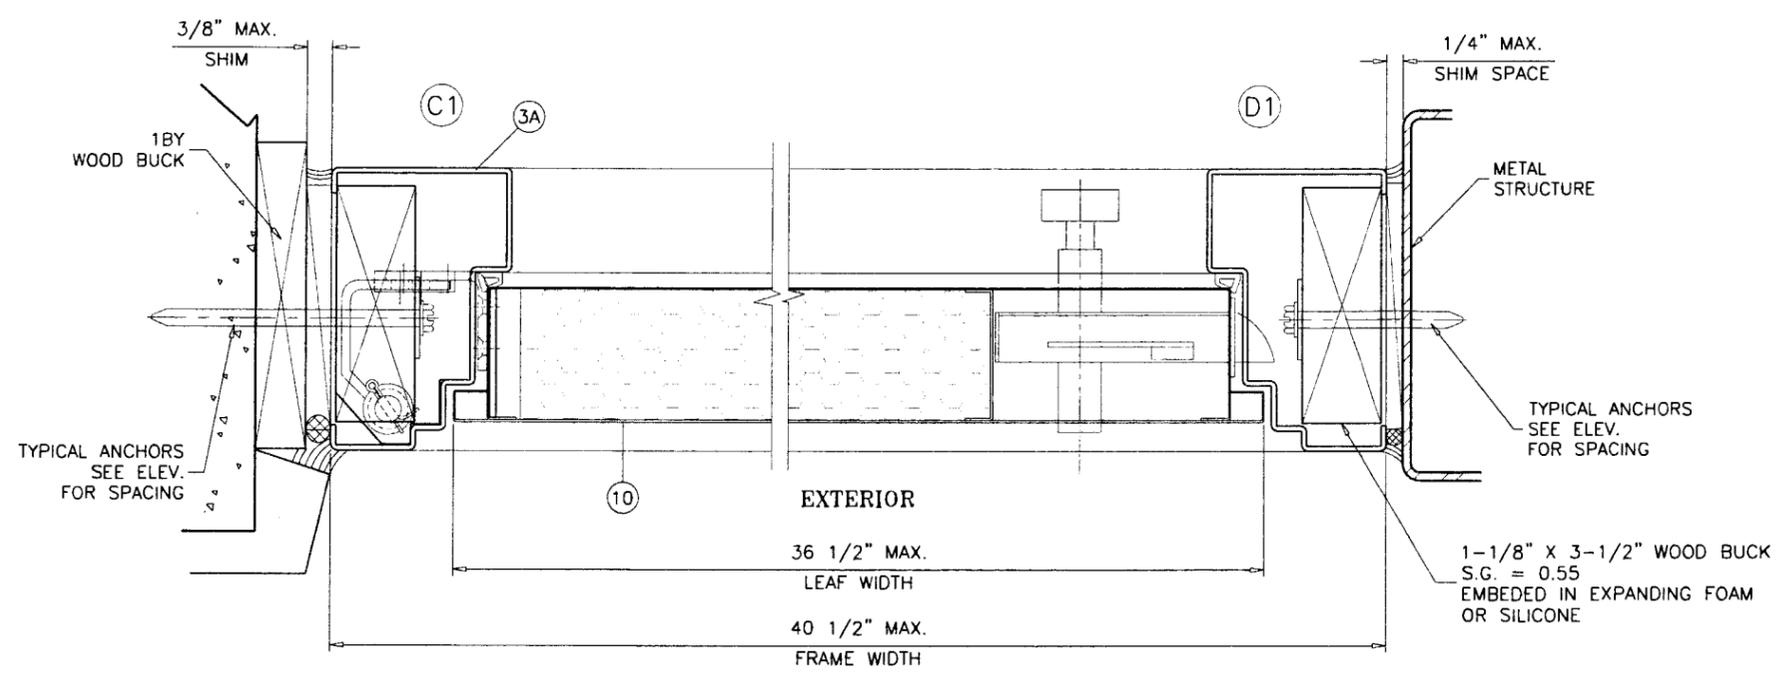

SINGLE (X) DOORS WITH DECORATIVE STEEL SURFACE

Approved as complying with the
 Florida Building Code
 Date July 22, 2009
 NOA# 09-0128.07
 Miami Dade Product Control
 Division
 By Shag I. Choudhury


Engr. ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUL 02 2009

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \ W08 - 73NUD


SERIES HI-TECH OUTSWING ENTRANCE DOOR (L.M.I.)
NAS UNLIMITED DOORS, LLC.
 2450 PALM AVE.
 HIALEAH, FL. 33010
 TEL. (305) 805-0522 FAX. (305) 805-8422

no.	date	by	description
A	06.25.09		REV. PER BECCO COMMENTS
revisions:			
date:	08-11-08	scale:	3/8" = 1"
dr. by:	HAMID	chk. by:	
drawing no.		W08-73	
sheet 4 of 7			

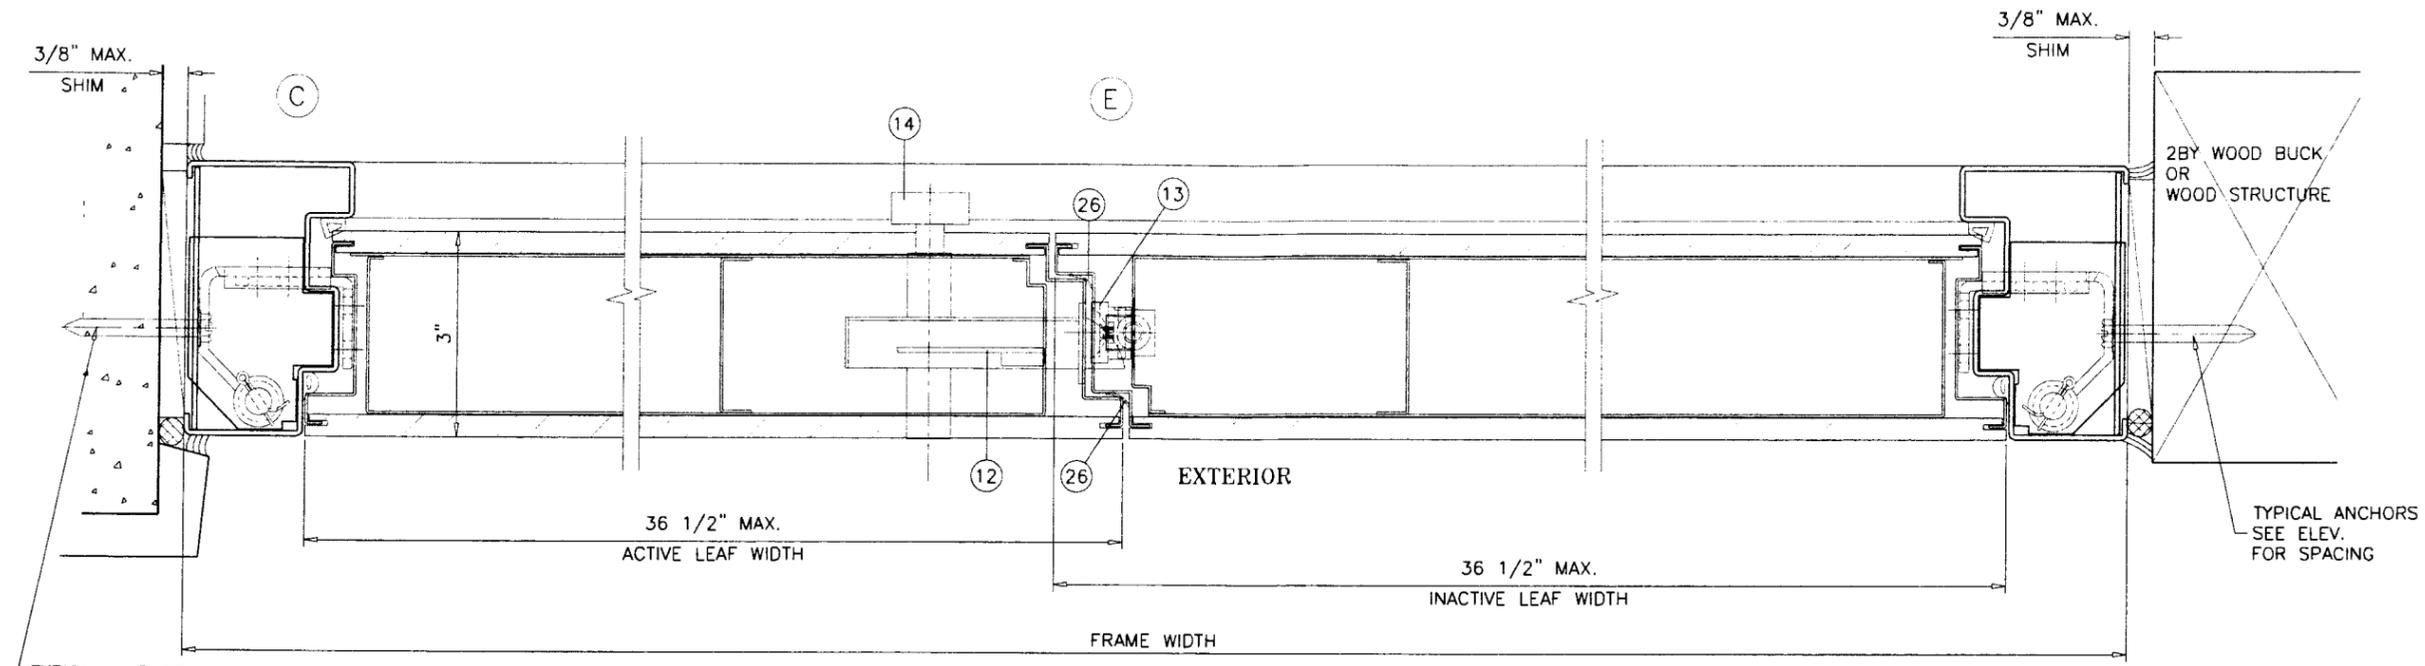

DOUBLE (XX) DOORS WITH WOOD COVER

Approved as complying with the
 Florida Building Code
 Date July 22, 2009
 NOA# 09-0129-07
 Miami Dade Product Control
 Division
 By Shay L. Grande

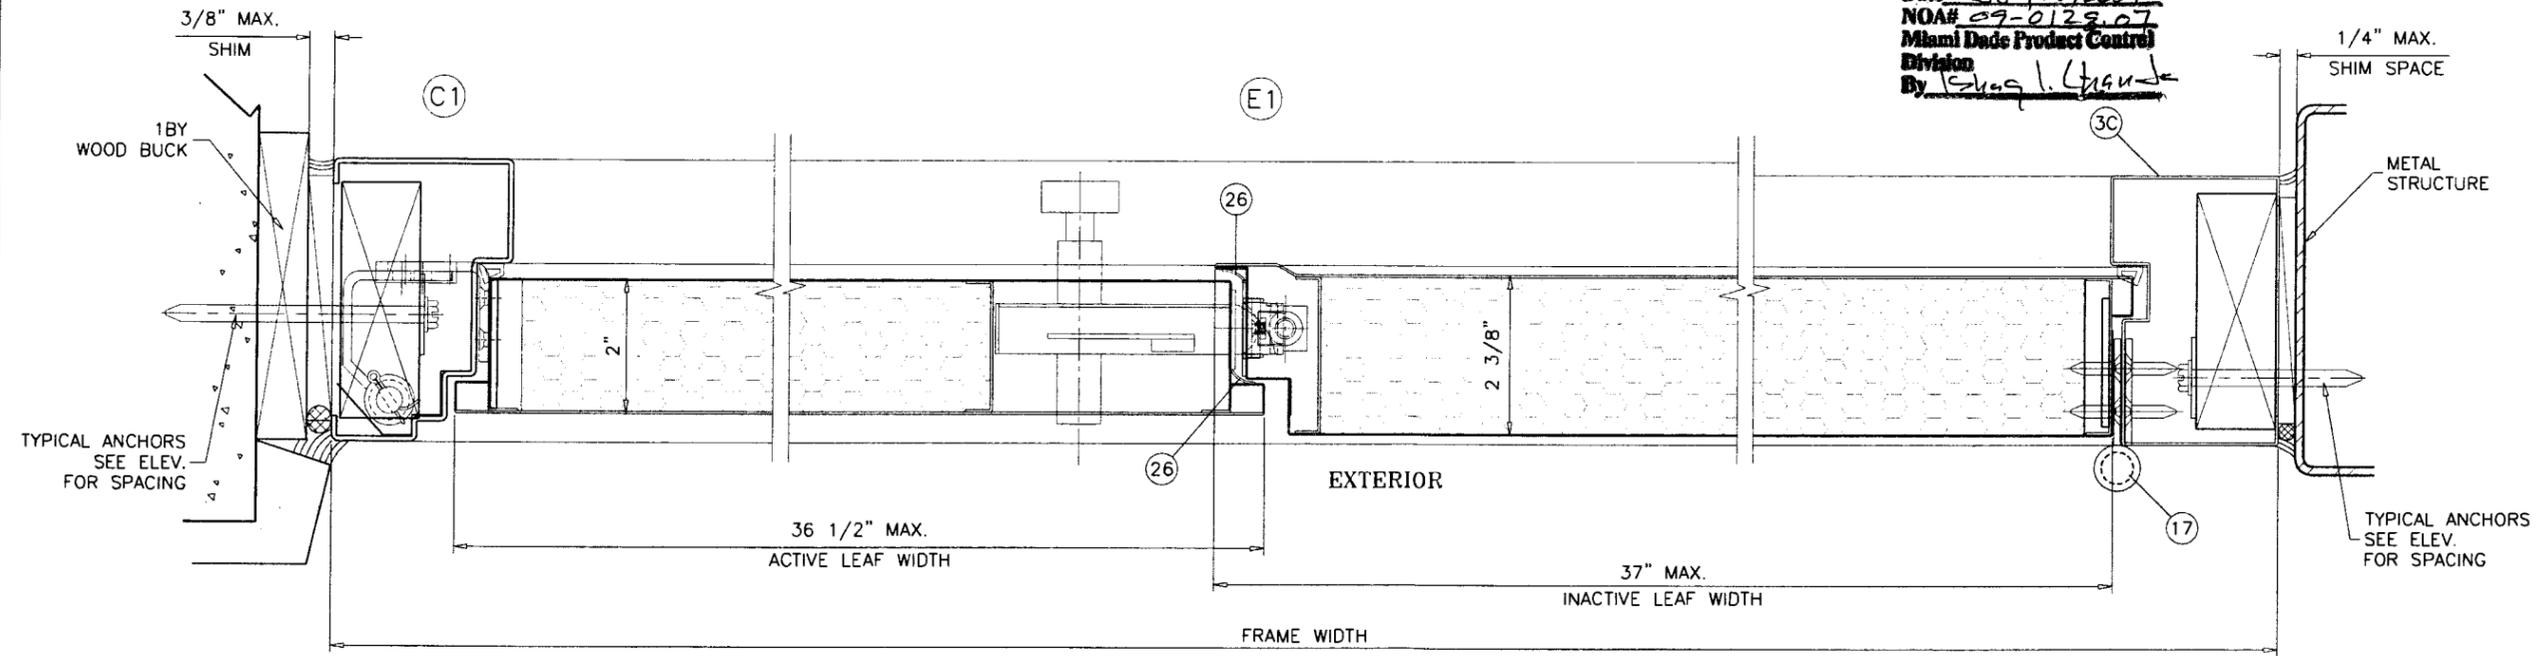

DOUBLE (XX) DOORS WITH DECORATIVE STEEL SURFACE

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUL 02 2009

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W08-73NUID

SERIES HI-TECH OUTSWING ENTRANCE DOOR (L.M.I.)
NAS UNLIMITED DOORS, LLC.
 2450 PALM AVE.
 HIALEAH, FL. 33010
 TEL. (305) 805-0522 FAX. (305) 805-8422

no	date	by	description
A	06.25.09		REV. PER BCCO COMMENTS

date: 08-11-08
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W08-73
 sheet 5 of 7

LOCKS:

OPTION #1

ACTIVE LEAF


MULTI POINT LOCK SYSTEM WITH THUMB TURN OPERATOR ON INTERIOR KEY OPERATED ON EXTERIOR LOCATED AT 37-1/4" FROM BOTTOM, FASTENED TO LEAF WITH (8) #10-24 X 1/2" FH MS

METALLIC DEAD BOLT LOCK WITH THUMB OPERATOR ON INTERIOR AT 35-1/4" FROM BOTTOM FASTENED TO LEAF WITH (8) #10-24 X 1/2" FH MS

10-3/16" LONG ST. STEEL STRIKE PLATE FACING DEAD BOLT LOCK AT 39" FROM BOTTOM FASTENED WITH (6) 3/16" RIVETS

INACTIVE LEAF

CONCEALED FLUSH BOLTS AT 4" AND 77-1/2" FROM BOTTOM FASTENED WITH (2) 3/16" RIVETS.

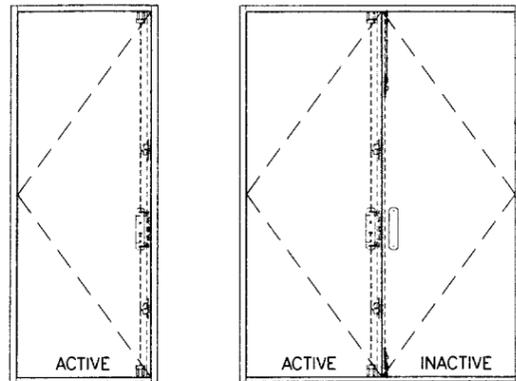

OPTION #2

ACTIVE LEAF


MULTI POINT LOCK SYSTEM WITH THUMB TURN OPERATOR ON INTERIOR KEY OPERATED ON EXTERIOR LOCATED AT 38-1/2" FROM BOTTOM, FASTENED TO LEAF WITH (4) #10-32 X 3/8" FH MS

METALLIC DEAD BOLT LOCK WITH THUMB OPERATOR ON INTERIOR AT 36" FROM BOTTOM FASTENED TO LEAF WITH (8) #10-24 X 1/2" FH MS

10-3/16" LONG ST. STEEL STRIKE PLATE FACING DEAD BOLT LOCK AT 39" FROM BOTTOM FASTENED WITH (6) 3/16" RIVETS

INACTIVE LEAF



CONCEALED FLUSH BOLTS AT 4" AND 77-1/2" FROM BOTTOM FASTENED WITH (2) 3/16" RIVETS.

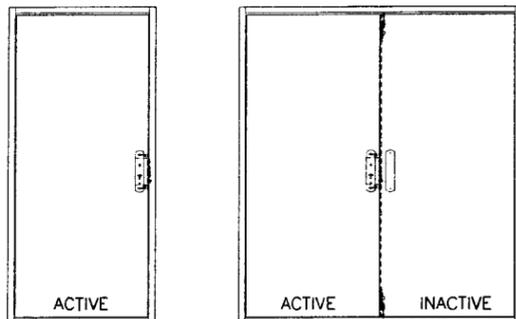

HINGES:



OPTION #1:

.136" THK. X 2-3/4" LONG METALLIC TWO PIECE CONCEALED HINGES, 5 PER LEAF FOR 100" FRAME HT. 4 PER LEAF FOR 83" FRAME HT.

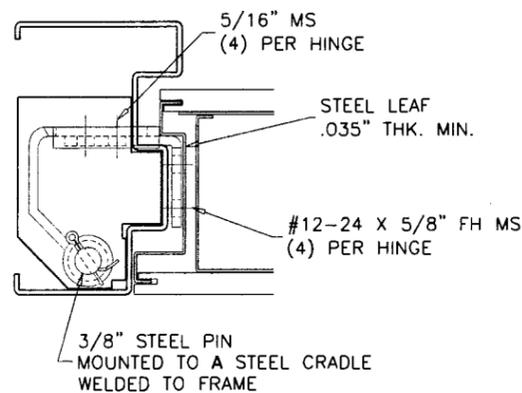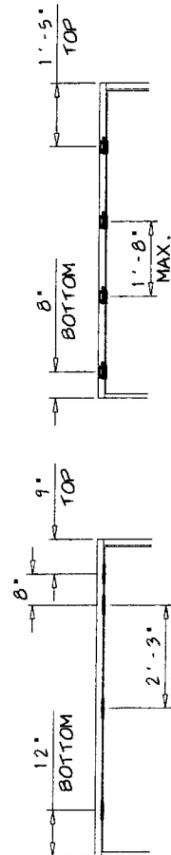

OPTION #2:

5" LONG SURFACE MOUNT TWO PIECE BUTT HINGES EACH FASTENED TO DOOR LEAF AND FRAME WITH #10-32 X 3/8" FH MS (5) PER HASP, 5 PER LEAF FOR 100" FRAME HT. 4 PER LEAF FOR 83" FRAME HT.

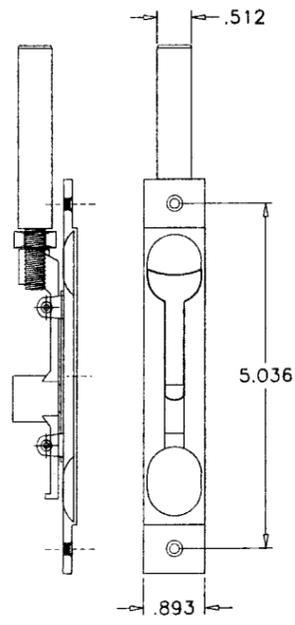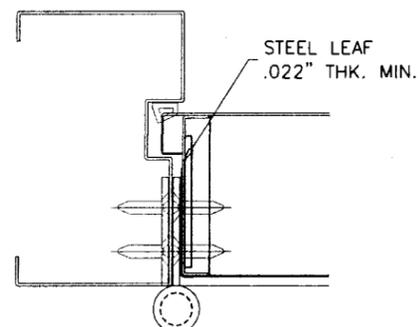

INACTIVE LEAF FLUSH BOLT

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	NAS-102	1	FRAME HEAD	STEEL	ROLL FORMED, MIN. Fy = 36.0 KSI
2	NAS-102	1	FRAME SILL	STEEL	ROLL FORMED, MIN. Fy = 36.0 KSI
2A	NAS-202	1	ALT. FRAME SILL	STEEL	ROLL FORMED, MIN. Fy = 36.0 KSI
3	NAS-103	1	FRAME JAMB	STEEL	ROLL FORMED, MIN. Fy = 36.0 KSI
3A	NAS-303	1	ALT. FRAME JAMB	STEEL	ROLL FORMED, MIN. Fy = 36.0 KSI
3B	-	1	ALT. FRAME JAMB	STEEL	ROLL FORMED, MIN. Fy = 36.0 KSI
3C	NAS-204	1	ALT. FRAME JAMB	STEEL	ROLL FORMED, MIN. Fy = 36.0 KSI
4	-	1	TOP RAIL CHANNEL (FULL LENGTH)	STEEL	-
4A	-	1	ALT. TOP RAIL CHANNEL (FULL LENGTH)	STEEL	-
5	-	1	TOP RAIL COVER (FULL LENGTH)	STEEL	-
6	-	1	BOTTOM RAIL CHANNEL (FULL LENGTH)	STEEL	-
7	-	1	BOTTOM RAIL COVER (FULL LENGTH)	STEEL	-
7A	-	1	ALT. BOTTOM RAIL COVER (FULL LENGTH)	STEEL	-
8	-	1	HINGE STILE COVER	STEEL	-
9	-	1	LOCK STILE COVER	STEEL	-
10	NAS-110	AS REQD.	LEAF EXTERIOR & INTERIOR SHEET	STEEL	MIN. THK = .028", MIN. Fy = 36.0 KSI
11	-	AS REQD.	HONEYCOMB PAPER INSULATION	-	-
12	NAS-212	1	MULTI POINT LOCK	-	-
13	NAS-113	1	LOCK STRIKE PLATE	-	-
14	NAS-114	AS REQD.	LOCK HANDLE	-	-
17	NAS-327	4/ LEAF	BUTT HINGES-.095" THK.	STEEL	-
17A	NAS-227	4/ LEAF	CONCEALED HINGES-.136" THK.	STEEL	-
18	NAS-118	2/ LEAF	FLUSH BOLTS	-	-
19	NAS-119	AS REQD.	FRAME EXTERIOR W'STRIPPING	EPDM	WEATHERSEAL #636
20	NAS-120	AS REQD.	FRAME INTERIOR W'STRIPPING	EPDM	WEATHERSEAL
21	NAS-121	AS REQD.	JAMB EXTERIOR W'STRIPPING	EPDM	WEATHERSEAL #025
22	NAS-125	1	HEAD/SILL PLATE	STEEL	.072" X 3-7/8" X FULL LENGTH
23	NAS-126	AS REQD.	JAMB SHEAR STRAP	STEEL	-
24	NAS-136	AS REQD.	DECORATIVE MOULDING	-	WOOD S.G. = 0.45 MIN.
25	-	AS REQD.	REINFORCING CHANNELS	STEEL	-
26	-	AS REQD.	LEAF W'STRIPPING	VINYL	-

Approved as complying with the Florida Building Code
 Date July 22, 2009
 NOA# 09-0128-07
 Miami Dade Product Control
 Division
 By Chag. Chay

Engr: ARSHAD VIGAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUL 02 2009


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W08-73NUID

SERIES HI-TECH OUTSWING ENTRANCE DOOR (L.M.I.)
NAS UNLIMITED DOORS, LLC.
 2450 PALM AVE.
 HIALEAH, FL. 33010
 TEL. (305) 805-0522 FAX. (305) 805-8422


revisions:	no	date	by	description
	A	06.25.09		REV. PER BCCO COMMENTS

date: 08-11-08
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W08-73
 sheet 6 of 7

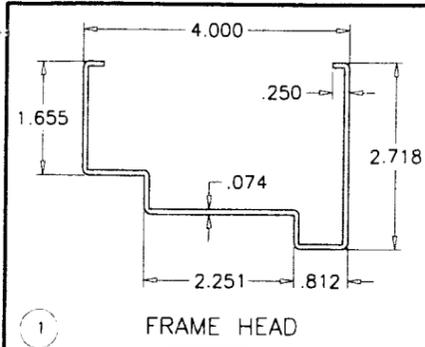


1 FRAME HEAD

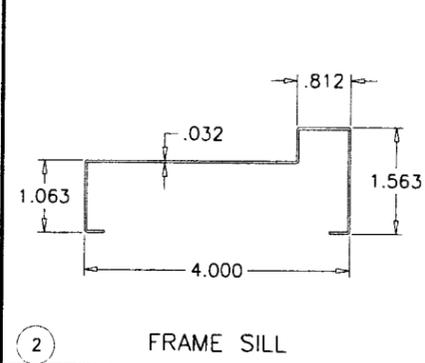


2 FRAME SILL

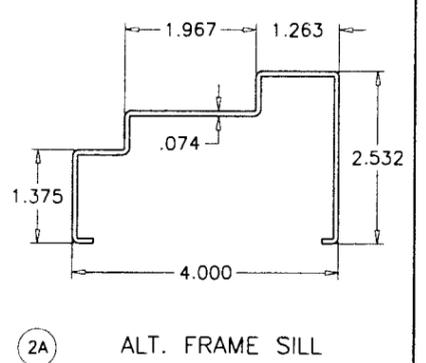


2A ALT. FRAME SILL

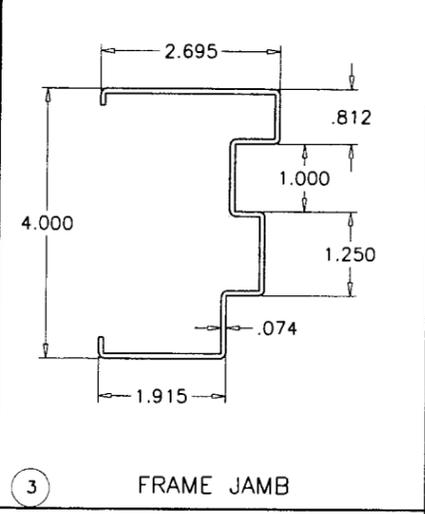


3 FRAME JAMB

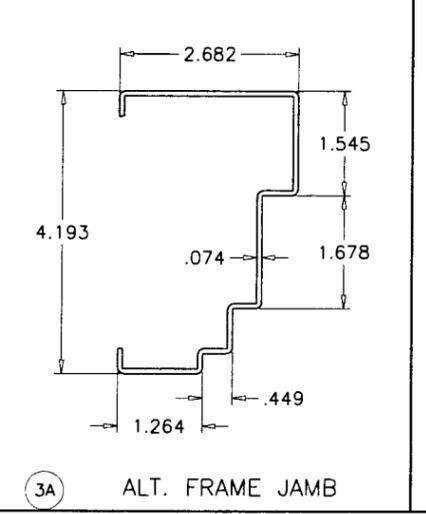


3A ALT. FRAME JAMB

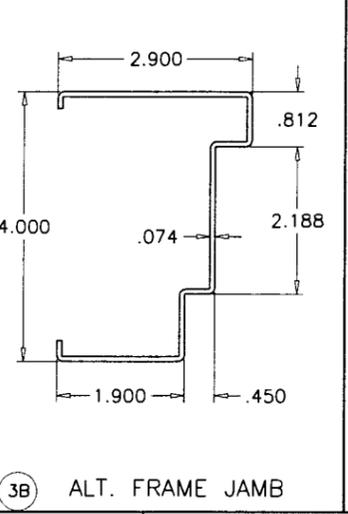


3B ALT. FRAME JAMB

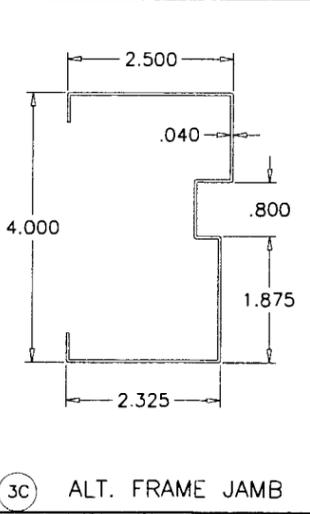


3C ALT. FRAME JAMB

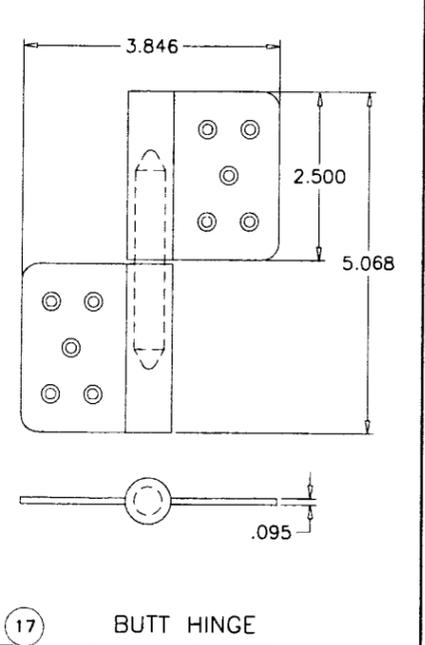


17 BUTT HINGE

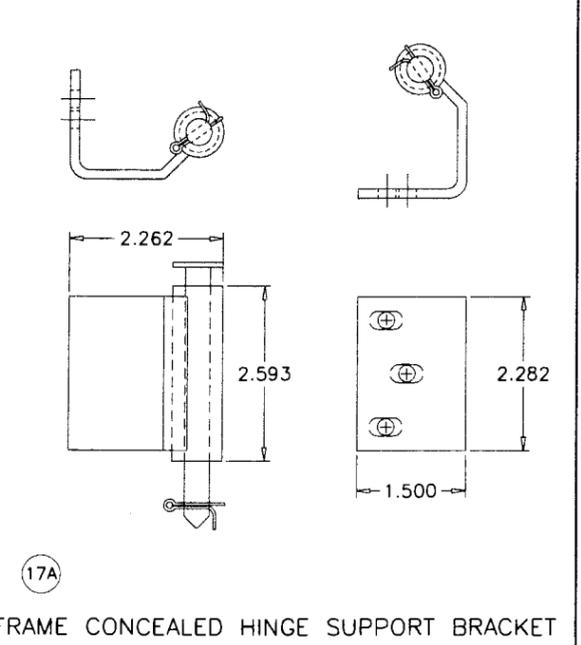


17A FRAME CONCEALED HINGE SUPPORT BRACKET

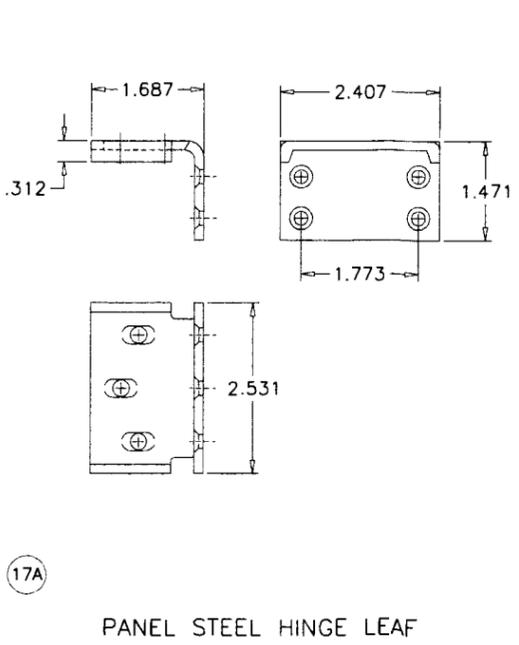

17A PANEL STEEL HINGE LEAF

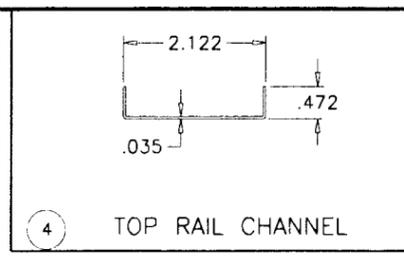


4 TOP RAIL CHANNEL

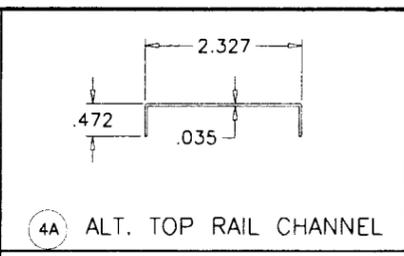


4A ALT. TOP RAIL CHANNEL


Approved as complying with the
 Florida Building Code
 Date July 22, 2009
 NOA# 09-012907
 Miami Dade Product Control
 Division
[Signature]

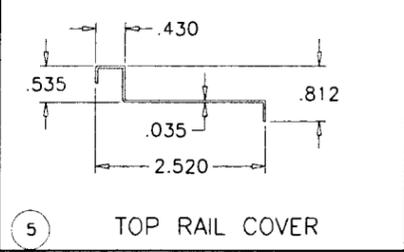


5 TOP RAIL COVER

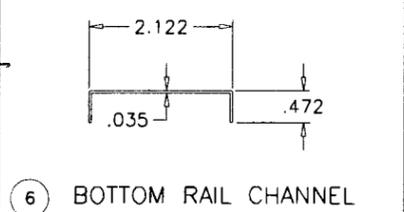


6 BOTTOM RAIL CHANNEL

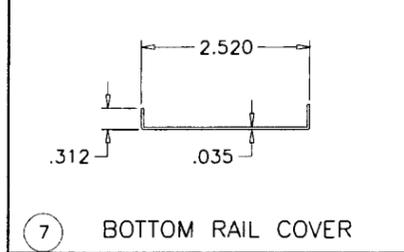


7 BOTTOM RAIL COVER

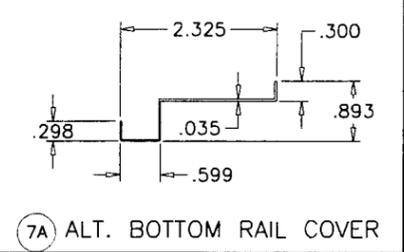

7A ALT. BOTTOM RAIL COVER

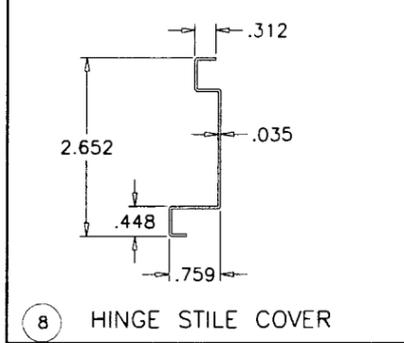

8 HINGE STILE COVER

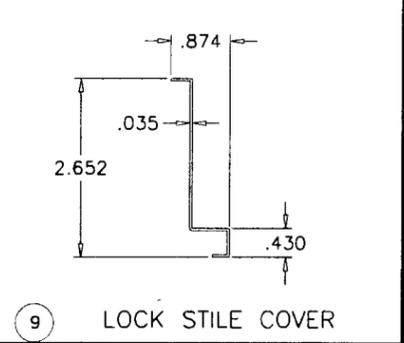

9 LOCK STILE COVER

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538
[Signature]
 JUL 02 2009

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \ W08 - 73NUD

SERIES HI-TECH OUTSWING ENTRANCE DOOR (L.M.I.)
NAS UNLIMITED DOORS, LLC.
 2450 PALM AVE.
 HIALEAH, FL. 33010
 TEL. (305) 805-0522 FAX. (305) 805-8422

revisions:	no	date	by	description
A	06.25.09			REV. PER BCCO COMMENTS

date: 08-11-08
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W08-73
 sheet 7 of 7