



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Korus USA, Inc.
1959 Tigertail Blvd.
Dania Beach, FL 33304

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Firenze – Venezia – Roma" Aluminum Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W07-69**, titled "Firenze – Venezia - Roma Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 5 of 5, dated 09/13/07, with revision B dated 05/19/09, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises NOA # 07-1029.04** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 09-0128.12
Expiration Date: January 10, 2012
Approval Date: July 1, 2009
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W07-69**, Sheets 1 through 5 of 5, titled "Firenze – Venezia - Roma Alum. Fixed Wdw. (L.M.I.)", dated 09/13/07, with revision B dated 05/19/09, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

B. TESTS

1. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum fixed windows rectangular top and eyebrow glass top, **specimen #9**, prepared by Hurricane test Laboratory LLC, Test Reports No. **HTL-0458-0605-07**, dated 6/4/08, signed and sealed by Vinu J. Abraham, P.E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum fixed windows rectangular, round top and eyebrow top, **specimens #5, #8, #10, #11 & #12**, prepared by Hurricane test Laboratory LLC, Test Reports No. **HTL-0458-0108-07** and **HTL-0458-0605-07**, dated 3/8/07 to 6/19/07, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under previous NOA#07-1029.04)

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with FBC-2004 and 2007, prepared by Al-Farooq Corporation, dated 12/18/08, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02/04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.
2. Notice of Acceptance No. **08-0520.08** issued to Solutia Inc. for their "**Vanceva Composites Glass Interlayer**" dated 7/17/08, expiring on 12/11/13.

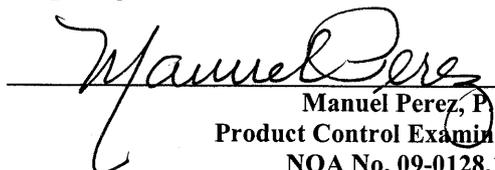
Manuel Perez, P.E.
Product Control Examiner
NOA No. 09-0128.12
Expiration Date: January 10, 2012
Approval Date: July 1, 2009

Korus USA, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


F. STATEMENTS

1. Statement letter of conformance, dated May 20, 2009, signed and sealed by Arshad Viqar, P.E.
2. Statement letter of no financial interest, dated May 20, 2009, signed and sealed by Arshad Viqar, P.E.
3. Letter of *Adoption of as his Own, the Work of Another Engineer* per Section 61G15-27 of the FBPE, dated May 21, 2009 signed and sealed by Arshad Viqar, P.E.


G. OTHERS

1. Notice of Acceptance No. **07-1029.04**, issued to Korus USA, Inc. for their Series "Firenze – Venezia – Roma" Aluminum Fixed Window – L.M.I., approved on 01/10/07 and expiring on 01/10/12.

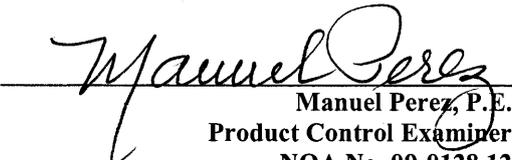
Manuel Perez, P.E.
Product Control Examiner
NOA No. 09-0128.12
Expiration Date: January 10, 2012
Approval Date: July 1, 2009

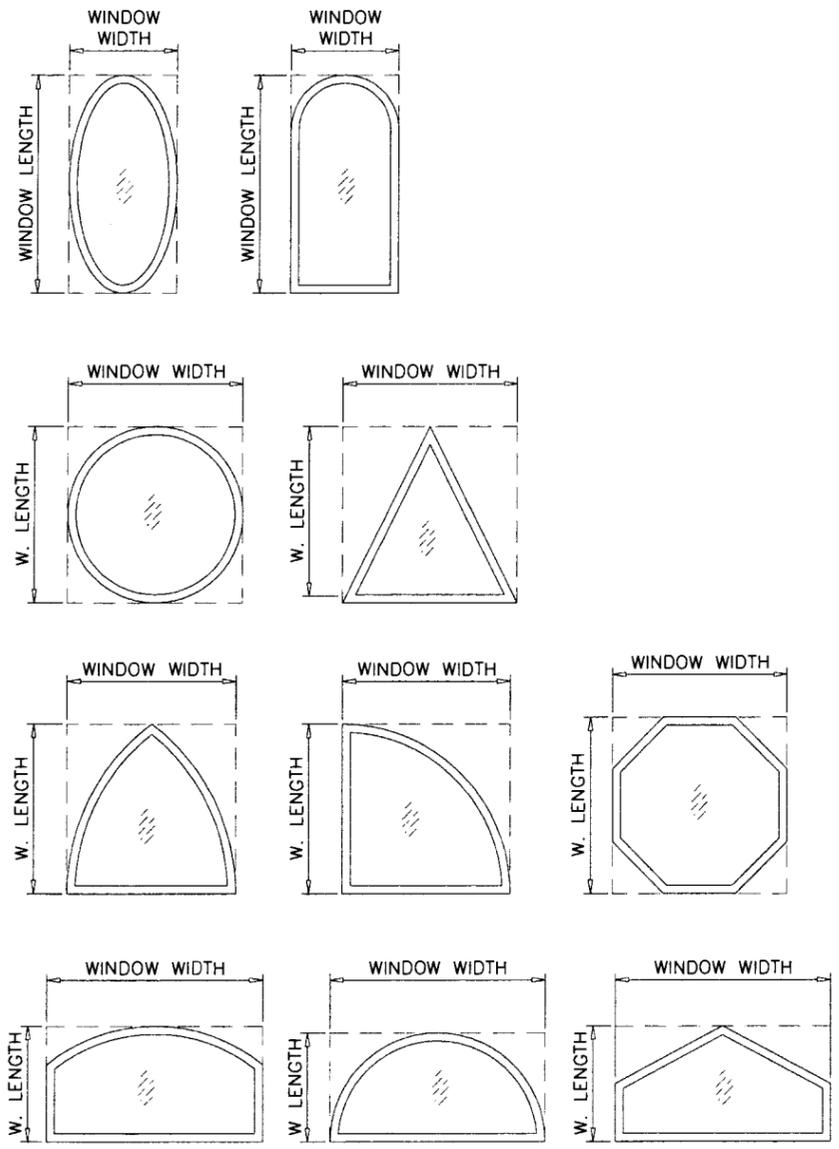

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

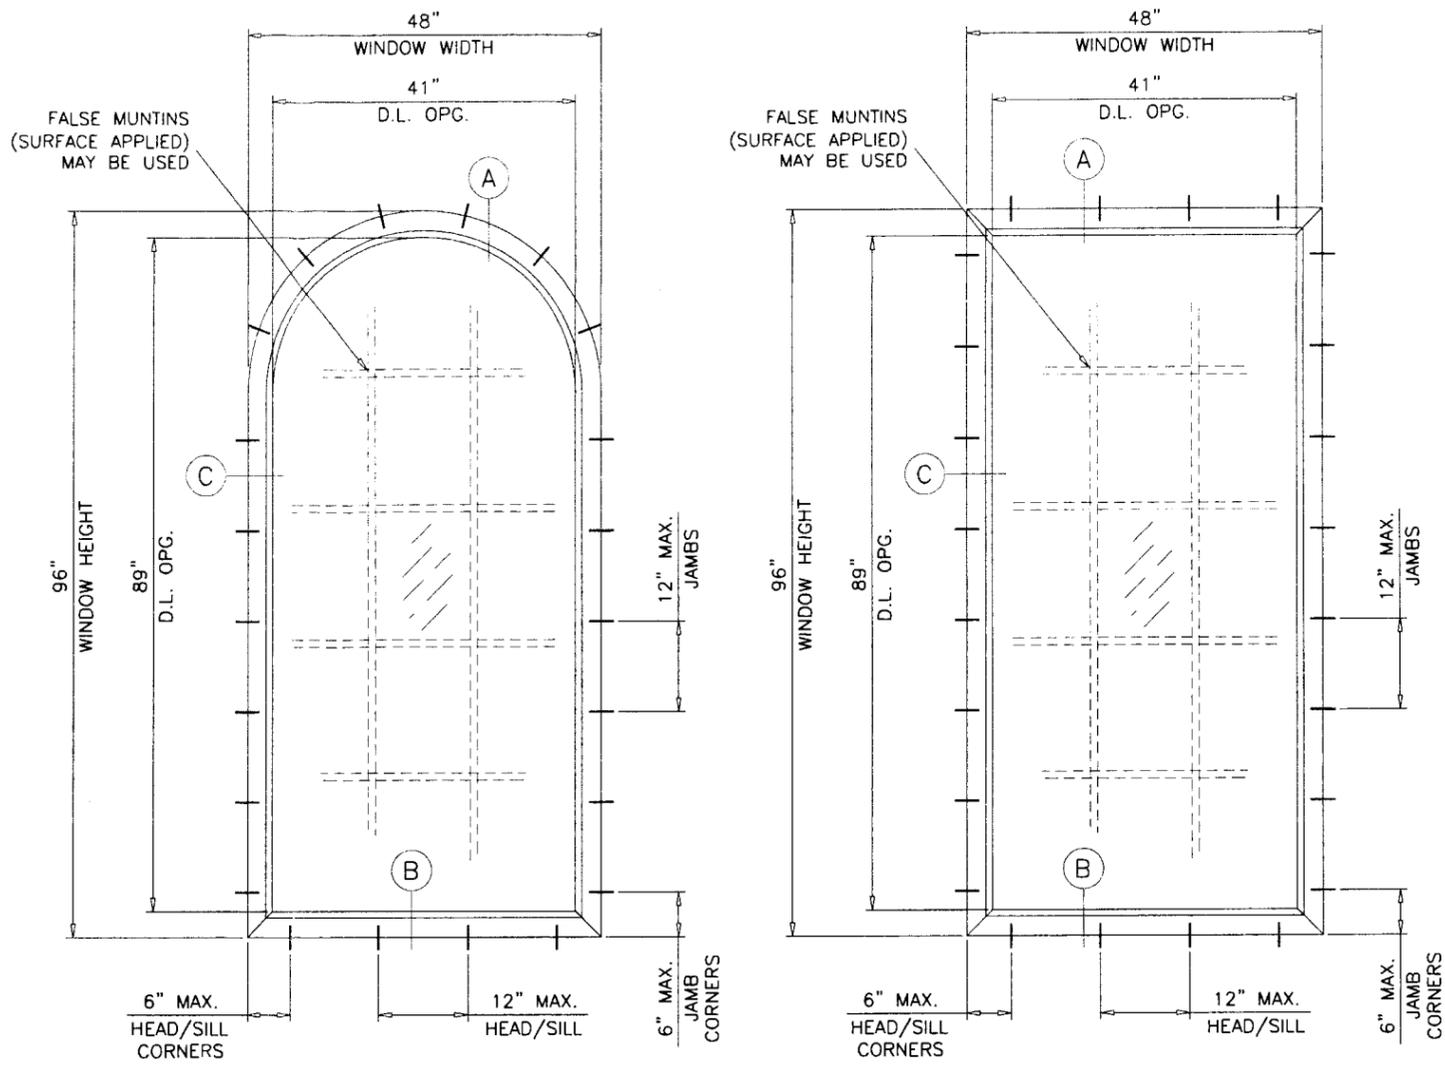

TYPICAL ELEVATIONS
TESTED UNITS

**FIRENZE-VENEZIA-ROMA
ALUMINUM FIXED WINDOW**

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
Arshad Viqar
JUN 30 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0128.12
Expiration Date JAN. 10, 2012
Muhammad Pasha
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W07 - 69KUJ

FIRENZE-VENEZIA-ROMA ALUM FIXED WDW. (L.M.I.)
KORUS USA INC.
1959 TIGERTAIL BLVD
DANIA BEACH, FL. 33304
TEL. (954) 888-9370 FAX. (954) 888-9371

no.	date	by	description
A	11.10.08		UPDATED FOR 2007 FBC
B	05.19.09		REV. PER BCCO COMMENTS


date: 09-13-07
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W07-69


sheet 1 of 5

DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26"	75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
53-1/8"	38-3/8"	75.0	75.0	75.0	75.0
26-1/2"		75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"	75.0	75.0	75.0	75.0	
53-1/8"	50-5/8"	75.0	75.0	75.0	75.0
26-1/2"		75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"	75.0	75.0	75.0	75.0	
53-1/8"	63"	71.1	71.1	71.1	71.1
26-1/2"		75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"	75.0	75.0	75.0	75.0	
53-1/8"	74-1/4"	67.8	67.8	67.8	67.8
26-1/2"		75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"	75.0	75.0	75.0	75.0	
53-1/8"	78"	67.8	67.8	67.8	67.8
26-1/2"		75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"	75.0	75.0	75.0	75.0	
53-1/8"	84"	67.8	67.8	67.8	67.8
26-1/2"		75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"	75.0	75.0	75.0	75.0	
53-1/8"	96"	67.8	67.8	67.8	67.8
26-1/2"		75.0	75.0	75.0	75.0
32"		75.0	75.0	75.0	75.0
37"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"	75.0	75.0	75.0	75.0	

DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	36"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
54"		75.0	75.0	75.0	75.0
60"		75.0	75.0	75.0	75.0
24"	48"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
54"		75.0	75.0	75.0	75.0
60"		75.0	75.0	75.0	75.0
24"	60"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
54"		66.7	66.7	66.7	66.7
60"		60.0	60.0	60.0	60.0
24"	72"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
54"		66.7	66.7	66.7	66.7
60"		60.0	60.0	60.0	60.0
24"	84"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
54"		66.7	66.7	66.7	66.7
60"		60.0	60.0	60.0	60.0
24"	96"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
54"		66.7	66.7	66.7	66.7
60"		60.0	60.0	60.0	60.0
24"	108"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0
48"		75.0	75.0	75.0	75.0
54"		66.7	66.7	66.7	66.7
60"		60.0	60.0	60.0	60.0
24"	120"	75.0	75.0	75.0	75.0
30"		75.0	75.0	75.0	75.0
36"		75.0	75.0	75.0	75.0
42"		75.0	75.0	75.0	75.0

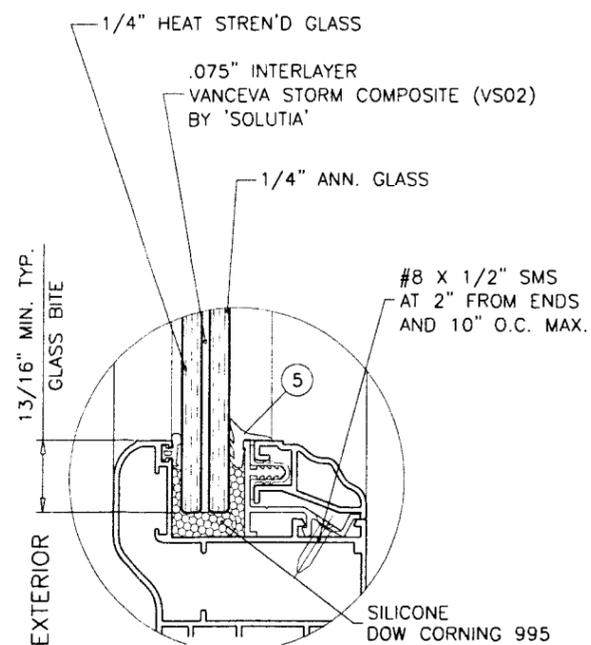


GLASS TYPE 'A'

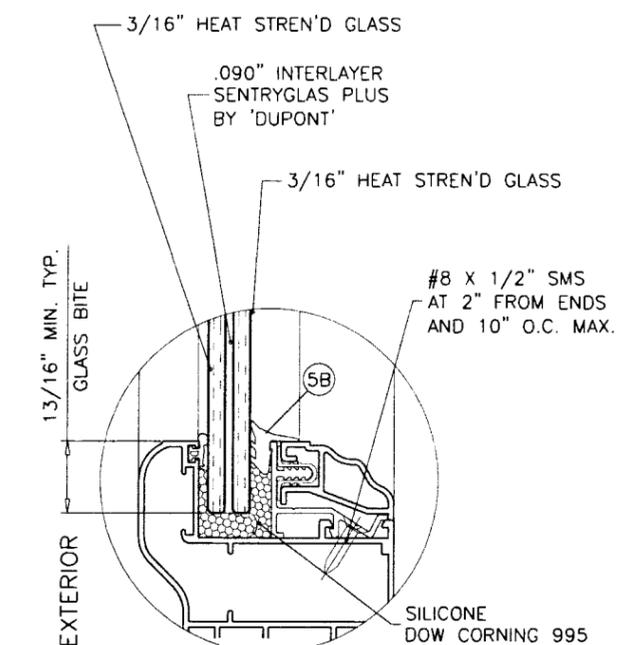

GLASS TYPE 'B'

GLAZING OPTIONS

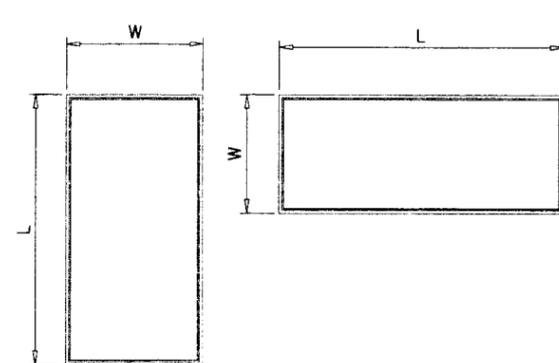

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS).

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

JUN 30 2009

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 09-0128-12
Expiration Date JAN. 10, 2012
By: *Manuel Torres*
Miami Trade Product Control
Division



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-69KUI

FIRENZE-VENEZIA-ROMA ALUM FIXED WDW. (L.M.I.)
KORUS USA INC.
1959 TIGERTAIL BLVD.
DANIA BEACH, FL. 33304
TEL. (954) 888-9370 FAX. (954) 888-9371

revisions:	no.	date	description
	A	11.10.08	NO CHANGE THIS SHEET
	B	05.19.09	REV. PER BCCO COMMENTS

date: 09-13-07
scale: -
dr. by: HAMID
chk. by:

drawing no.
W07-69
sheet 2 of 5

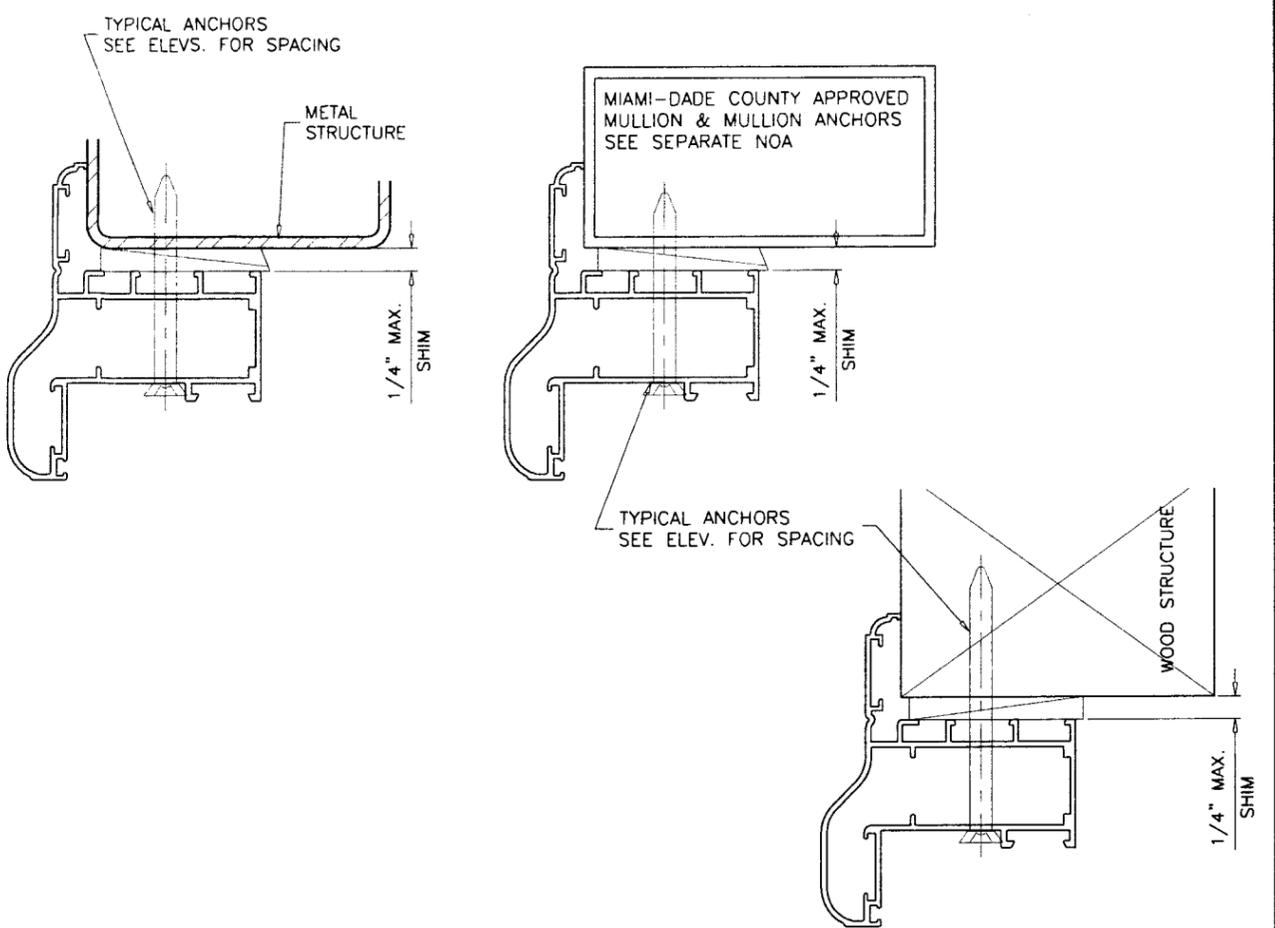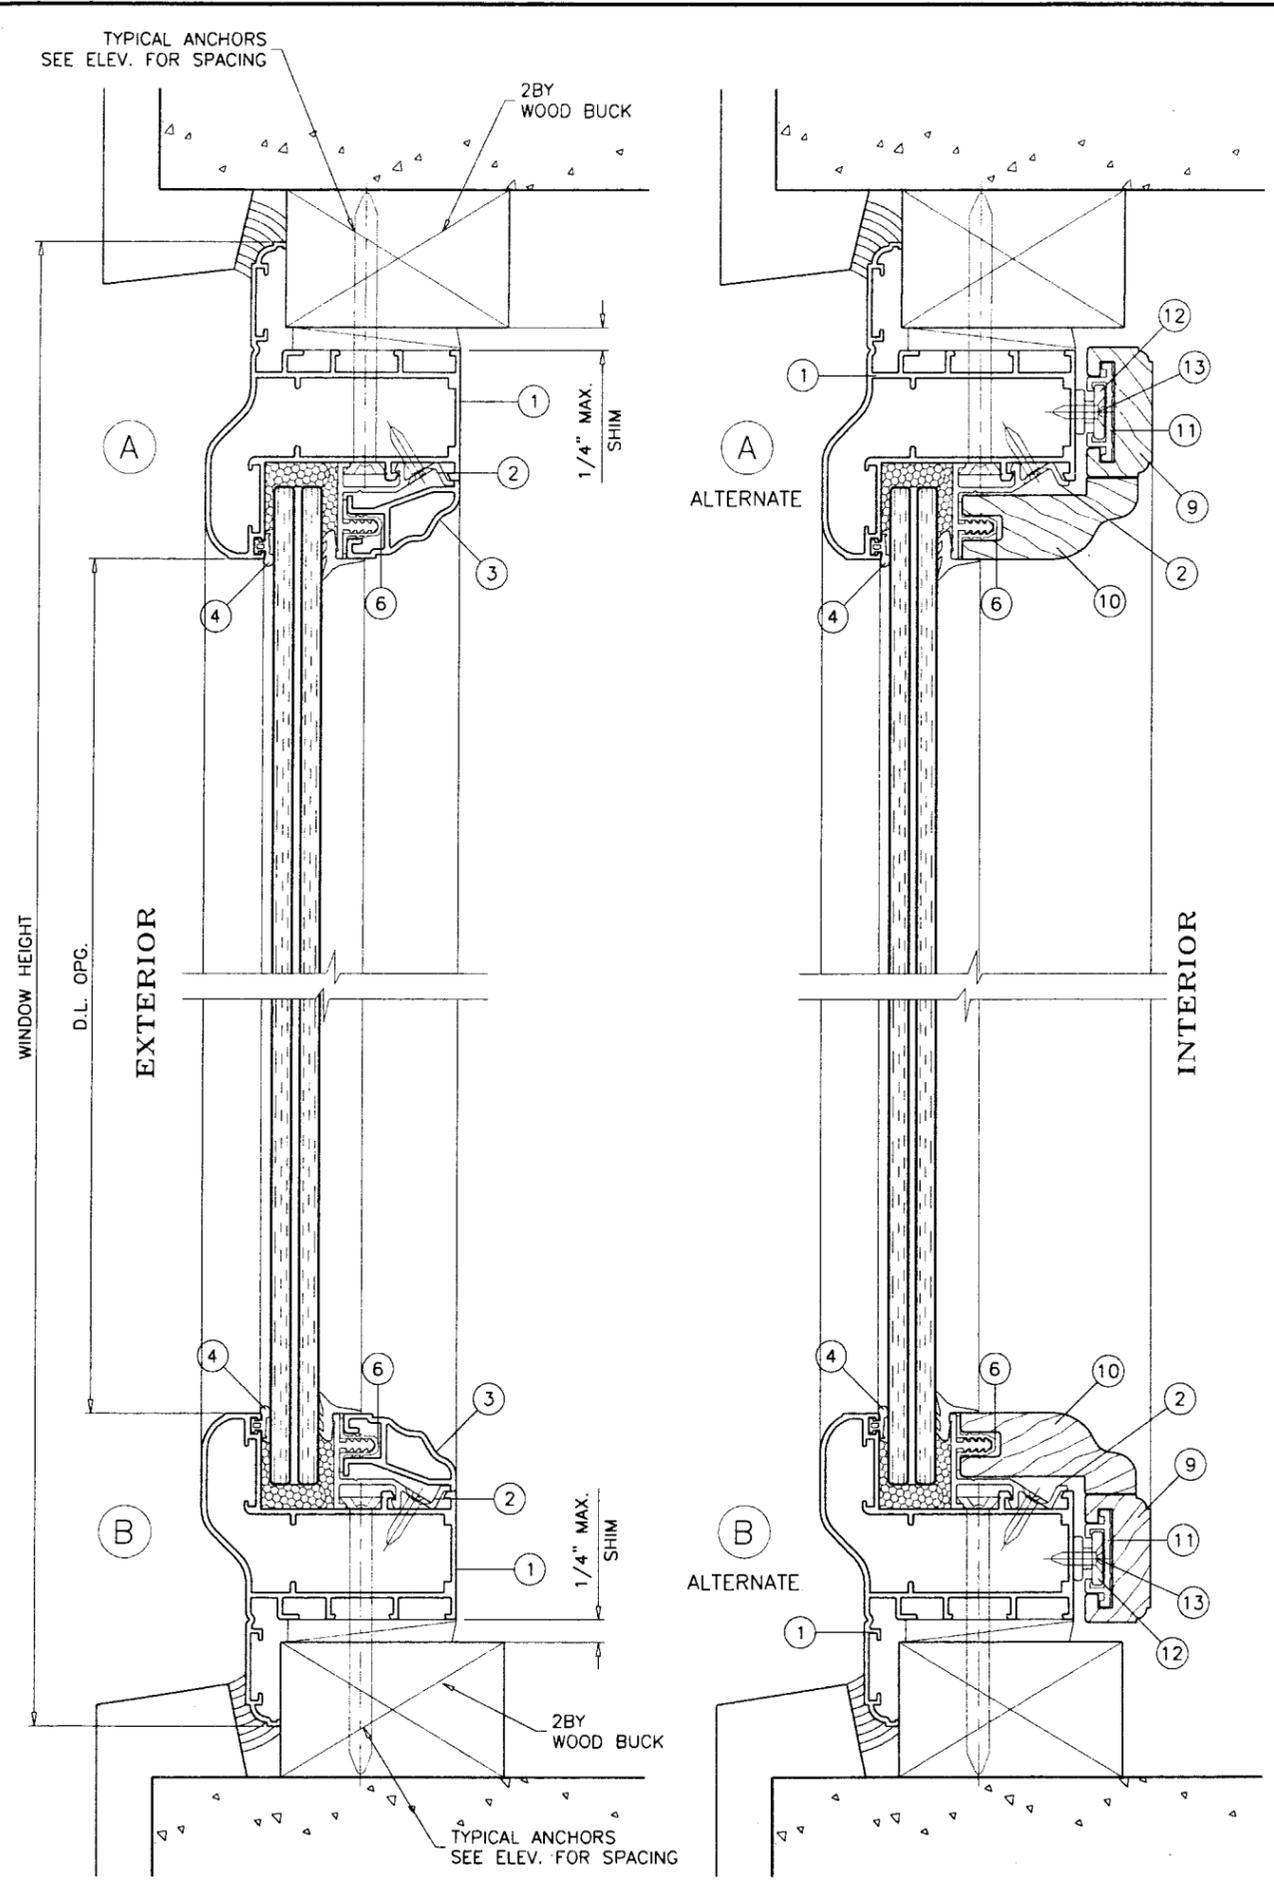

WOOD BUCKS AND METAL STRUCTURE NOT BY KORUS
 MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
 AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD
 1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1-1/2" MIN.
 INTO WOOD STRUCTURE = 3/4" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE f'c = 3000 PSI MIN.
 MASONRY f'm = 1500 PSI MIN.

Engr. ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538
 JUN 30 2009

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0128.12
 Expiration Date: JAN. 10, 2012
 Manuel Perez
 Miami-Dade Permit Control
 Division

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-69KUI

FIRENZE-VENEZIA-ROMA ALUM FIXED WDW. (L.M.I.)





KORUS USA INC.
 1959 TIGERTAIL BLVD.
 DANIA BEACH, FL. 33304
 TEL. (954) 888-9370 FAX. (954) 888-9371

no	date	by	description
A	11.10.08		UPDATED FOR 2007 FBC
B	05.19.09		REV. PER BCCO COMMENTS

revisions:

date: 09-13-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-69
 sheet 3 of 5

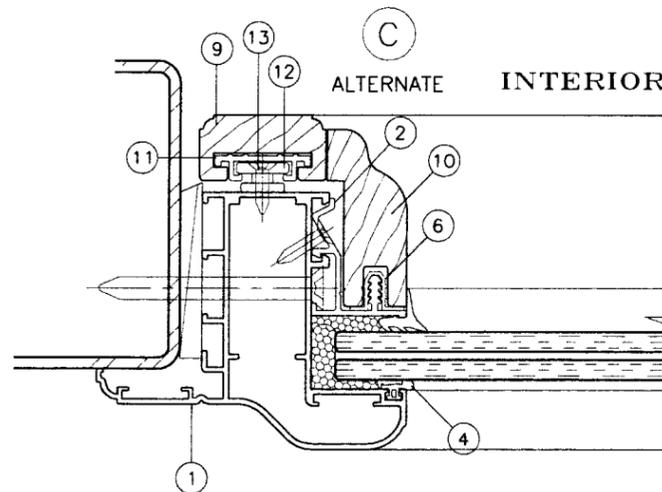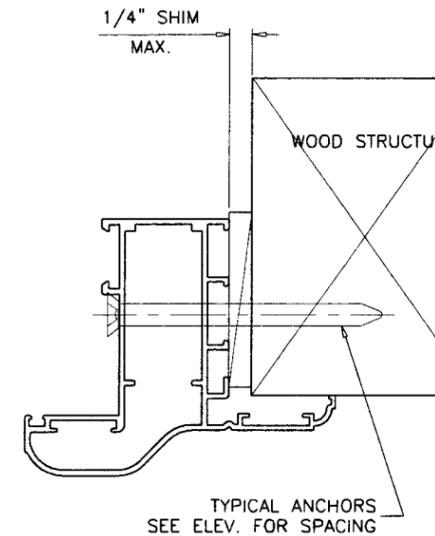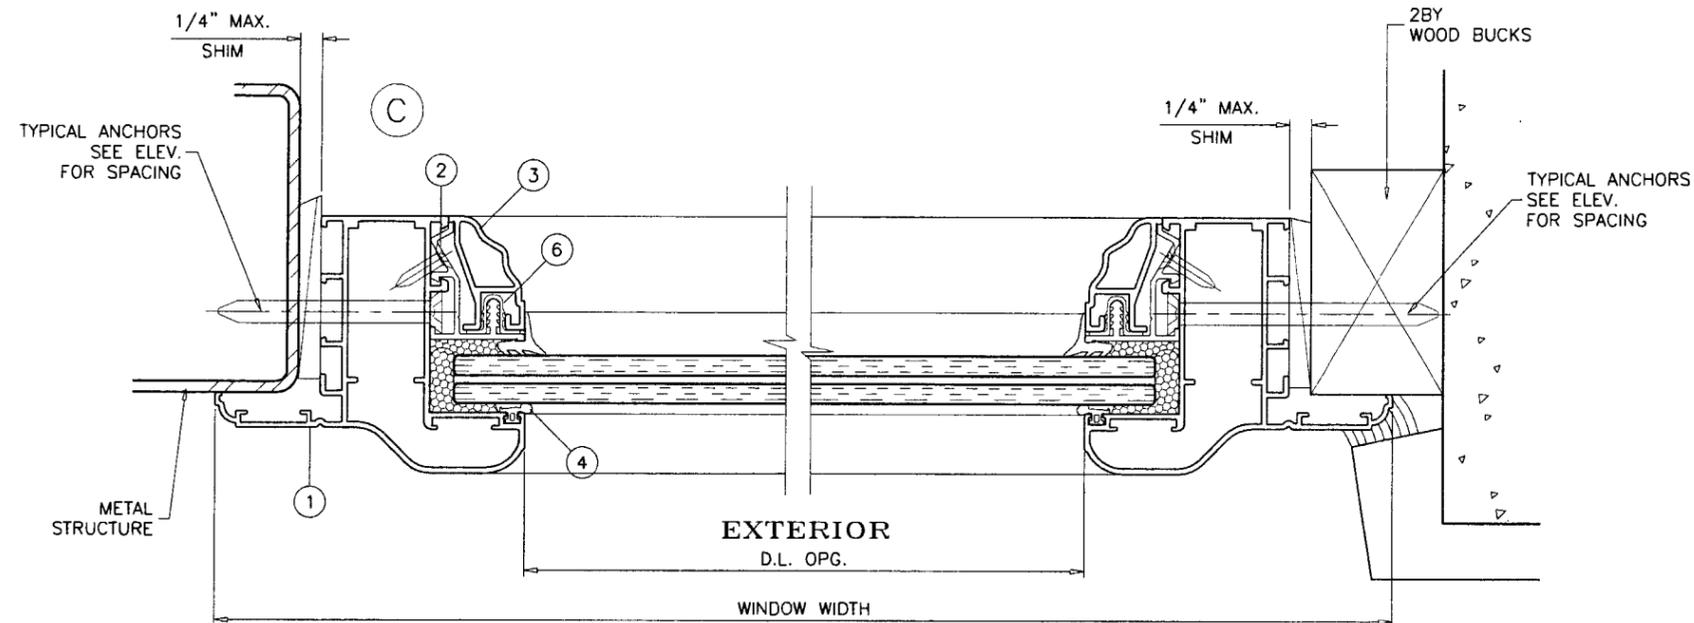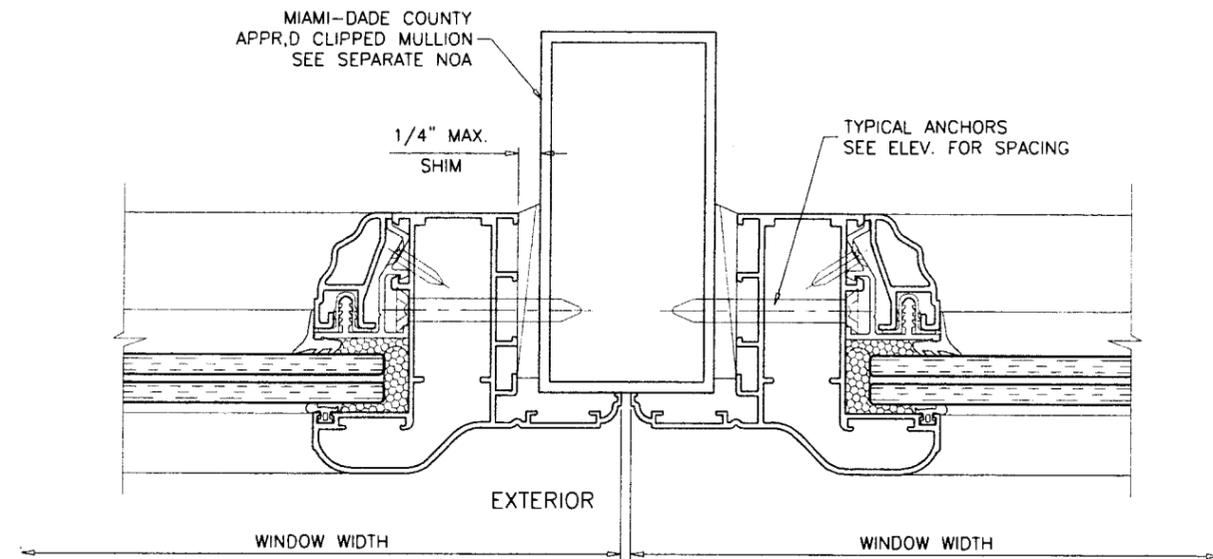

Engr: ARSHAD VIGAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

Arp
 JUN 30 2009

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0128-12
 Expiration Date JAN. 10, 2012
 Dr. *Manuel Perez*
 Registered Professional Engineer
 State of Florida

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-69KUI


FIRENZE-VENEZIA-ROMA ALUM FIXED WDW. (L.M.I.)
KORUS USA INC.
 1959 TIGERTAIL BLVD.
 DANIA BEACH, FL. 33304
 TEL. (954) 888-9370 FAX. (954) 888-9371

revisions:


no	date	by	description
A	11.10.08		UPDATED FOR 2007 FBC
B	05.19.09		REV. PER BCCO COMMENTS

date: 09-13-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W07-69
 sheet 4 of 5


ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	KA011	4	WINDOW FRAME	6060-T5	KORUS
2	KA006	4	GLASS STOP	6060-T5	KORUS
3	KA007	4	GLASS STOP COVER	6060-T5	KORUS
4	COP8069	4	EXTERIOR GASKET	EPDM	COMPLASTEX
5	COPOUP4W	4	INTERIOR GLAZING GASKET	EPDM	COMPLASTEX
5A	COPOUP5W	4	INTERIOR GLAZING GASKET	EPDM	COMPLASTEX
5B	COPOUP6W	4	INTERIOR GLAZING GASKET	EPDM	COMPLASTEX
6	COP2217	AS REQD.	GLASS STOP HOOK GASKET	EPDM	COMPLASTEX
7	PONK20	AS REQD.	ALIGNING BRACKET	PA6	PONTINA STAMPI
8	MON5002	AS REQD.	FRAME JOINING BRACKET	CAST ALUM	MONTICELLI
9	-	AS REQD.	INTERIOR FRAME COVER	WOOD	DECORATIVE
10	-	AS REQD.	INTERIOR GLASS STOP COVER	WOOD	DECORATIVE
11	C71808	AS REQD.	COVER RECIEVER CHANNEL	6060-T5	KORUS
12	PS002	AS REQD.	COVER LATCH AT 12" O.C.	CAST ALUM	MONTICELLI
13	#6 X 3/4"	1/ LATCH	LATCH INSTALLATION SCREWS	-	FH SMS

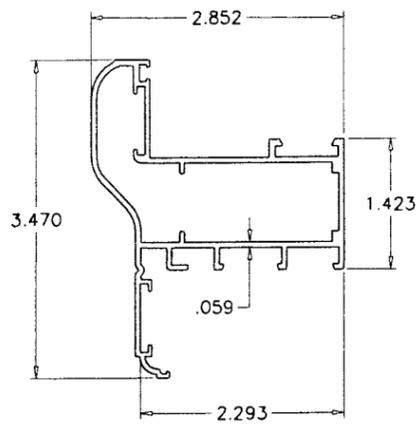


① WINDOW FRAME




⑨ INTERIOR FRAME COVER

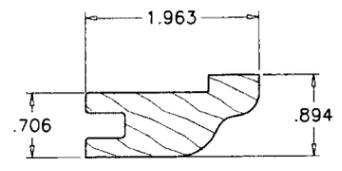


⑩ INTERIOR GLASS STOP COVER

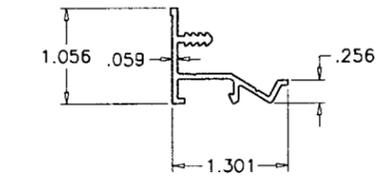


② GLASS STOP




⑪ COVER RECIEVER CHANNEL



③ GLASS STOP COVER



⑫ COVER LATCH

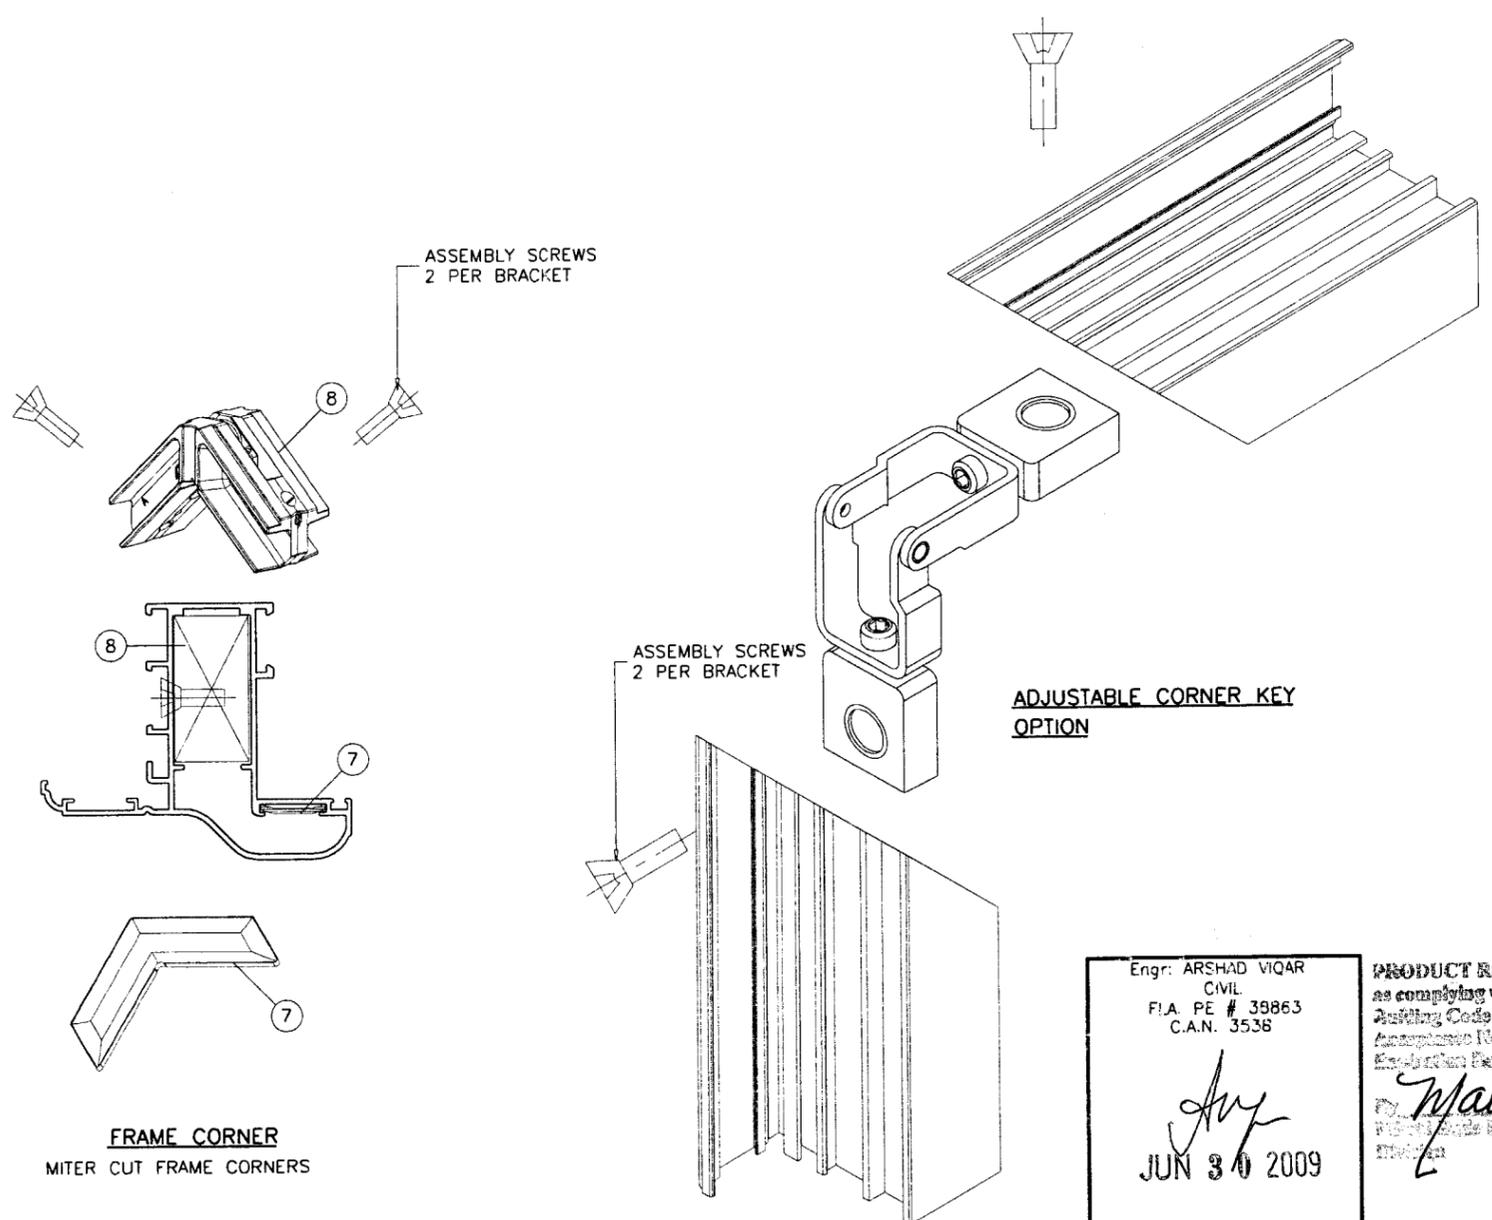

Engr: ARSHAD VIQAR
 CIVIL
 F.I.A. PE # 39863
 C.A.N. 3538

JUN 30 2009

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Approved By: 09-0128-12
 JAN. 10, 2012
 Manuel Perez

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-69KUI

FIRENZE-VENEZIA-ROMA ALUM FIXED WDW. (L.M.I.)
KORUS USA INC.
 1959 TIGERTAIL BLVD.
 DANIA BEACH, FL. 33304
 TEL. (954) 888-9370 FAX. (954) 888-9371

no	date	by	description
A	11.10.08		UPDATED FOR 2007 FBC
B	05.19.09		REV. PER. BCCO COMMENTS

date: 09-13-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-69
 sheet 5 of 5