



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.miamidade.gov/buildingcode

NOTICE OF ACCEPTANCE (NOA)

Eurotech Industries, Inc.
250 NE 32 Street
Fort Lauderdale, FL 33334

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Aluminum Outswing Entrance Door-LMI

APPROVAL DOCUMENT: Drawing No. **W04-01**, titled "Aluminum Outswing Entrance Door", sheets 1 through 5 of 5, dated 01/15/04 and last revised on June 02, 2009, prepared by AL-Farooq Corporation, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

Limitations:

1. Single or double doors may be mulled with approved clipped mullion or sidelites or transom (under separate approvals), lower design rating shall apply and such installation to be reviewed & approved by AHJ.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews & revises** NOA No. **08-0507.10** consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No 09-0310.05
Expiration Date: June 10, 2014
Approval Date: June 24, 2009
Page 1

6/3/09

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (transferred from file # 08-0507.10)

1. Manufacturer's die drawings and sections.
2. Drawing No. **W04-01**, titled "Aluminum Outswing Entrance Door", sheets 1 through 5 of 5, dated 01/15/04 and last revised on June 02, 2009, prepared by AL-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

B. TESTS (transferred from file # 08-0507.10)

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
 - 5) Large Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with installation diagram of aluminum outswing door, prepared by Hurricane Engineering Testing Inc., Test Report No(s). **HETI- 08-2021, 08-2022, 08-2023 and 08-2024**, all dated 03/15/08, signed and sealed by Candido Font, P.E.

2. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
 - 5) Large Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with installation diagram of aluminum outswing door, prepared by Hurricane Engineering Testing Inc., Test Report No(s). **HETI- 03-1882, 08-1889, 08-18890 and 08-2024**, dated 01/15/04 thru 02/09/2004, all signed and sealed by Rafael E. Droz-Seda, P.E. (transferred from file # **06-1019.06**)

3. Tensile Test prepared by Hurricane Engineering & Testing, Test No. HETI-04-T100, dtd 01/29/04, tested per ASTM E8-01, signed & sealed by Rafael E. Droz-Seda, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis, prepared by Al-Farooq Corp., dated 04/28/08 and last revised on 06-02-09, signed and sealed by Arshad Viqar, P.E.
2. Complies with ASTM E1300-02 & -04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont DeNemours for "SentryGlasPlus", expiring on 01/14/2012.
2. Notice of Acceptance No. **05-1208.02** issued to "E.I. DuPont Denemours" for "DuPont Butacite ® PVB" dated 02/15/01, expiring on 12/11/10.

F. STATEMENTS




1. Statement letter of conformance & no financial interest, dated June 02, 2009, signed and sealed by Arshad Viqar, P.E.
2. Statement letter of lab compliance, part of above test reports.

G. OTHER

1. This **renews & revises** NOA # **08-0507.10**, expiring June 10, 2009.
2. Test proposal # **07-3527** approved by BCCO.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 09-0310.05
Expiration Date: June 10, 2014
Approval Date: June 24, 2009

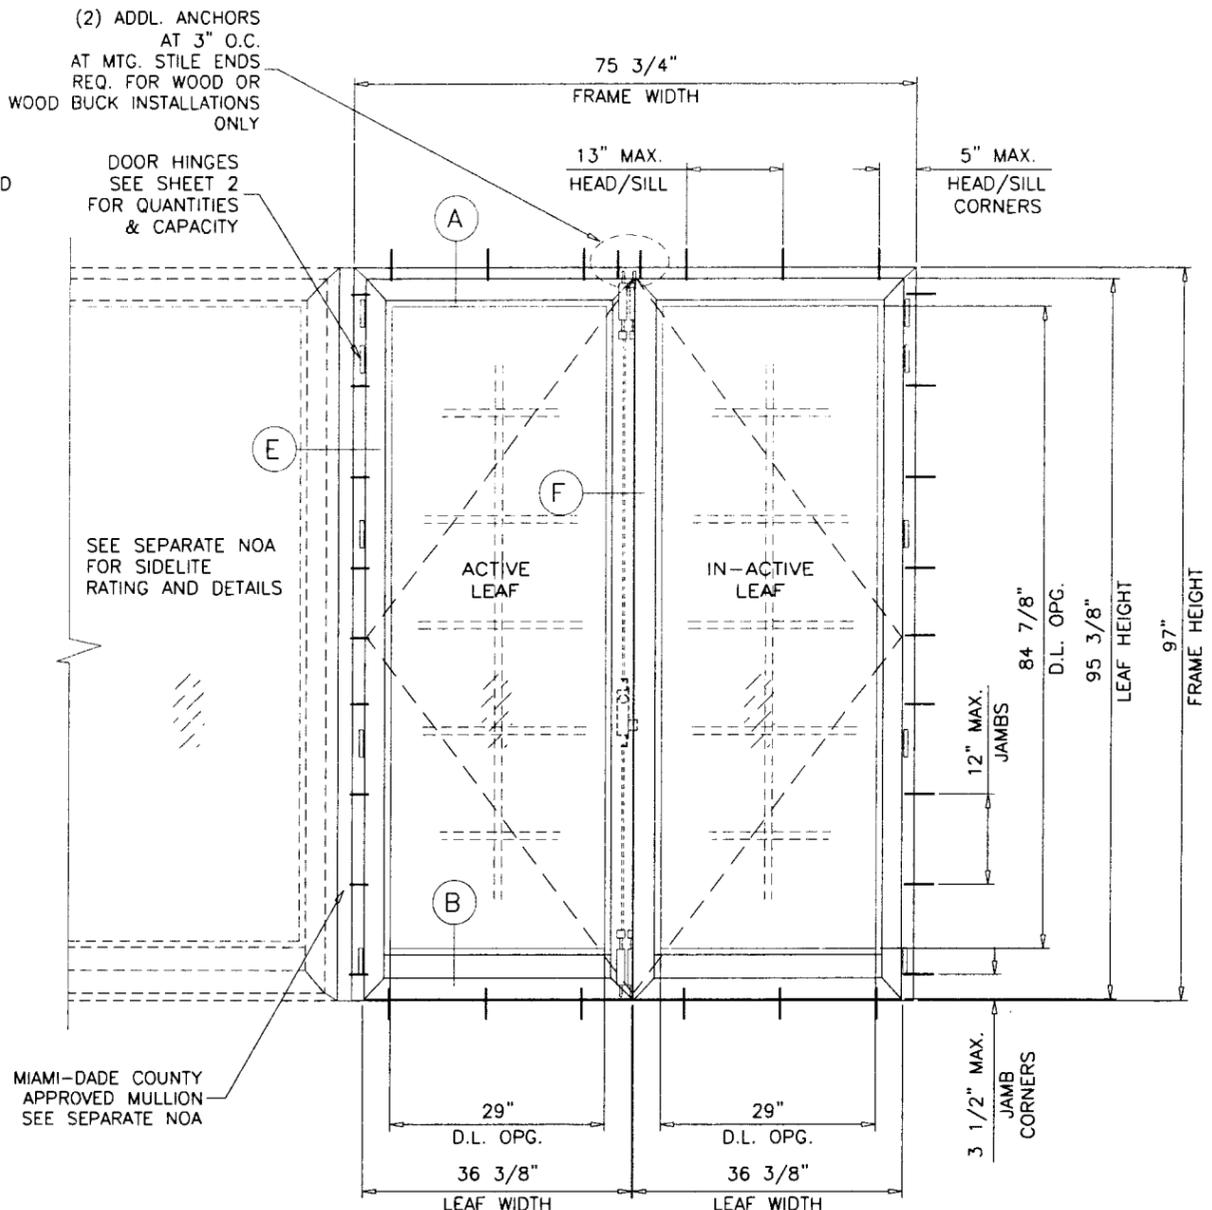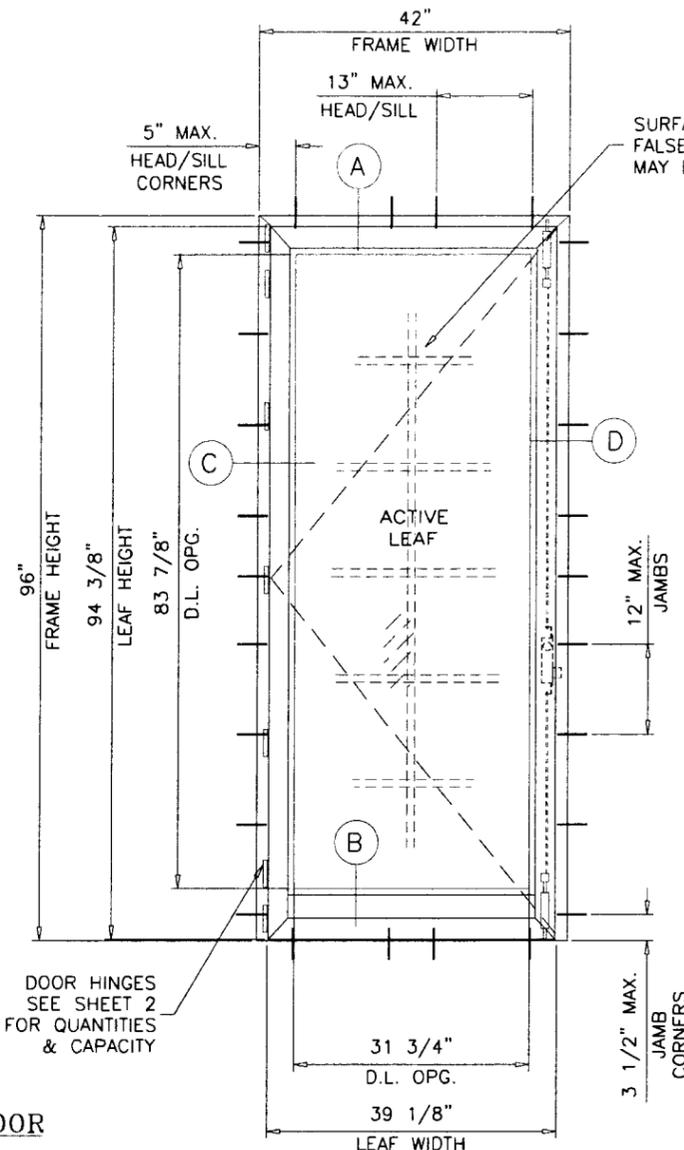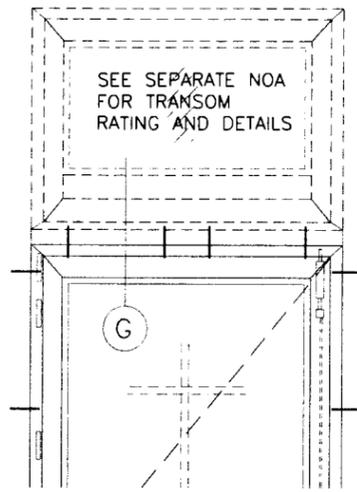

TYPICAL ELEVATIONS

ALUMINUM OUTSWING ENTRANCE DOOR

APPROVAL APPLIES TO SINGLE (X) AND DOUBLE (XX) LEAF DOORS. ALSO SINGLE AND DOUBLE DOORS IN COMBINATION WITH SIDELITES USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. ALSO SINGLE AND DOUBLE DOORS WITH OR WITHOUT SIDELITES IN COMBINATION WITH TRANSOMS USING MIAMI-DADE COUNTY APPROVED MULLION IN BETWEEN. LOWER DESIGN PRESSURES FROM DOOR, SIDELITE OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

JUN 2 2009

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 09-0310-05
Expiration Date JUNE 10, 2014

By Ishag I. Chanda
Miami Dade Product Control
Division




af c
AL-FAROQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W04 - 01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)
EUROTECH WINDOWS & DOORS
250 N.E. 32nd STREET
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 TEL. (954) 630-0217

no	date	by	description
A	04.28.06		UPDATED FOR 2004 FBC
B	04.11.08		GENERAL REVISION

date: 01-15-04
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W04-01
sheet 1 of 5

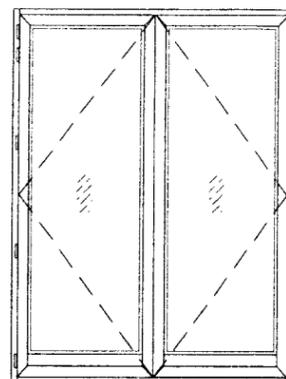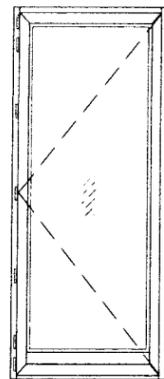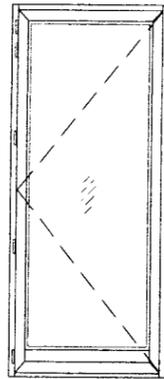

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ER006	AS REQD.	DOOR FRAME	6063-T6	-
2	ER012	AS REQD.	DOOR LEAF	6063-T6	-
3	VZ1566	1/ LEAF	DOOR BASE BOARD	6063-T6	-
4	VZ-1483	1/ DOOR	FRAME SILL	6063-T6	-
5	-	1/ DOOR	SILL BASE	6063-T6	-
6	VZ-1481	AS REQD.	ASTRAGAL STILE	6063-T6	-
7	VZ-1535	4/ LEAF	GLAZING BEAD	6063-T6	-
8	2801	AS REQD.	GLAZING GASKET	VINYL	-
9	-	-	-	-	-
10	1001/50	1/ CORNER	CORNER KEY	ALUMINUM	MONTICELLO
11	00600X	4/ LEAF	HINGES	ALUMINUM	GIESSE
12	#10 X 3/8"	4/ HINGE	HINGE INSTALLATION SCREWS	-	PH MACHINE SCREWS
13	-	AS REQD.	BULB W'STRIPPING	-	-
14	#10 X 2"	AS REQD.	ASSEMBLY SCREWS	-	HH SELF DRILLING
15	#12 X 1-1/4"	-	FRAME ASSEMBLY SCREWS	-	SMS

DESIGN LOAD CAPACITY - PSF SINGLE (X) DOORS				
DOOR SIZE		GLASS TYPE 'A'		
WIDTH	HEIGHT	EXT. (+)	INT. (-)	
2/6	6/8	75.0	85.0	
3/0		75.0	85.0	
3/6		75.0	85.0	
2/6	7/0	75.0	85.0	
3/0		75.0	85.0	
3/6		75.0	85.0	
2/6	8/0	75.0	85.0	
3/0		75.0	85.0	
3/6		75.0	85.0	


DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

DESIGN LOAD CAPACITY - PSF SINGLE (X) DOORS				
DOOR SIZE		GLASS TYPE 'B'		
WIDTH	HEIGHT	EXT. (+)	INT. (-)	
2/6	6/8	100.0	140.0	
3/0		100.0	140.0	
3/3		100.0	140.0	
2/6	7/0	100.0	140.0	
3/0		100.0	140.0	
3/3		100.0	140.0	
2/6	8/0	100.0	140.0	
3/0		100.0	140.0	
3/3		100.0	140.0	

DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

DESIGN LOAD CAPACITY - PSF DOUBLE (XX) DOORS				
DOOR SIZE		GLASS TYPE 'A' OR 'B'		
WIDTH	HEIGHT	EXT. (+)	INT. (-)	
5/0	6/8	75.0	75.0	
6/4		75.0	75.0	
5/0	7/0	75.0	75.0	
6/4		75.0	75.0	
5/0	8/1	75.0	75.0	
6/4		75.0	75.0	

LOADS SHOWN ABOVE ARE FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED.
LIMIT EXTERIOR(+) LOADS TO 48 PSF FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

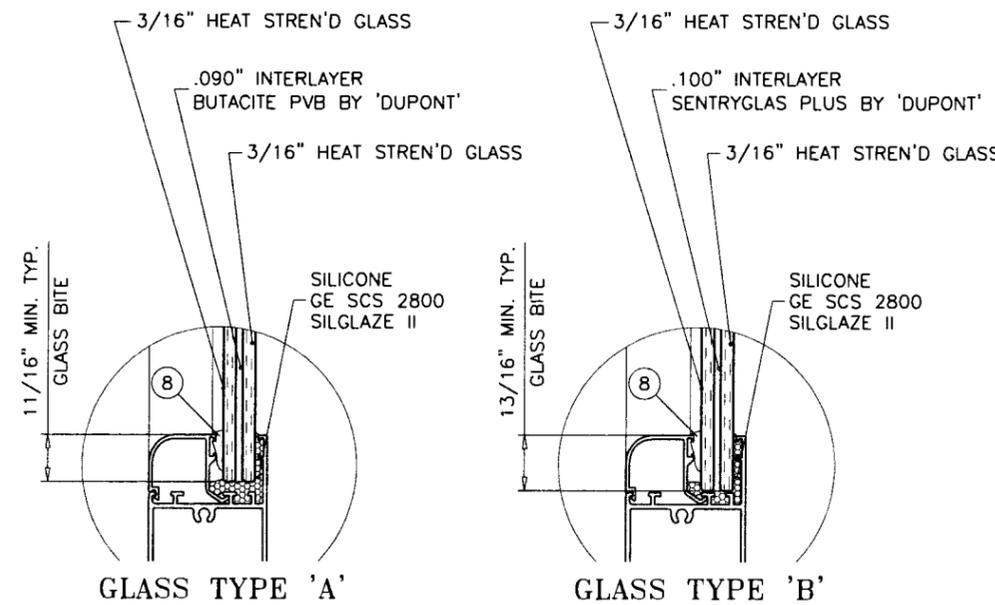

GLAZING OPTIONS

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 09-0310-05
Expiration Date: JUNE 10, 2014
By: Ishag J. Chande
Miami Dade Product Control Division

NOTE: GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-02/04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

LOCKS SINGLE DOORS:
3 POINT LOCK SYSTEM AT ACTIVE LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.
STRIKE PLATE
1-1/4" X 1/4" X 16-1/4" LONG
ATTACHED WITH (2) #8 X 3/4" SMS

HINGES SINGLE DOORS:
TWO-HANDED COMB HING
EXTRUDED ALUMINUM BRIDGE 2
BY 'GIESSE'
(5) PER LEAF
AT 6", 12", 35", 63-1/2" AND
92-1/2" FROM TOP OF DOOR

LOCKS SINGLE DOORS:
MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP AND BOTTOM OF ACTIVE LEAF PART #02181 ATTACHED WITH (4) #10 X 1-1/2" SMS.
3 POINT LOCK SYSTEM AT ACTIVE LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.
STRIKE PLATE
1-1/4" X 1/4" X 16-1/4" LONG
ATTACHED WITH (2) #8 X 3/4" SMS

HINGES SINGLE DOORS:
TWO-HANDED COMB HING
EXTRUDED ALUMINUM BRIDGE 2
BY 'GIESSE'
(7) PER LEAF AT 7/0 AND 8/0 DOORS
AT 3", 9" AND 26-3/8" FROM
TOP AND BOTTOM, ONE AT MIDSPAN
(6) PER LEAF AT 6/8 DOORS
AT 3", 9" AND 26-3/8" FROM
TOP AND BOTTOM

LOCKS DOUBLE DOORS:
ACTIVE LEAF:
MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP AND BOTTOM OF ACTIVE LEAF PART #02181 ATTACHED WITH (4) #8 X 1-1/2" SMS.
3 POINT LOCK SYSTEM AT ACTIVE LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.

INACTIVE LEAF
MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP AND BOTTOM OF INACTIVE LEAF PART #02168 ATTACHED WITH (4) #8 X 1-1/2" SMS.

HINGES DOUBLE DOORS:
TWO-HANDED COMB HING
EXTRUDED ALUMINUM BRIDGE 2
BY 'GIESSE'
(5) PER LEAF
AT 6", 12", 35", 63-1/2" AND
92-1/2" FROM TOP OF DOOR

NOTE: TOP AND BOTTOM FLUSH BOLTS MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

Arj

JUN 02 2009

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W04 - 01 EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)
EUROTECH WINDOWS & DOORS
250 N.E. 32nd STREET
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 TEL. (954) 630-0217




no.	date	by	description
A	04.26.06		UPDATED FOR 2004 FBC
B	04.11.08		GENERAL REVISION

revisions:

date: 01-15-04
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-01

sheet 2 of 5

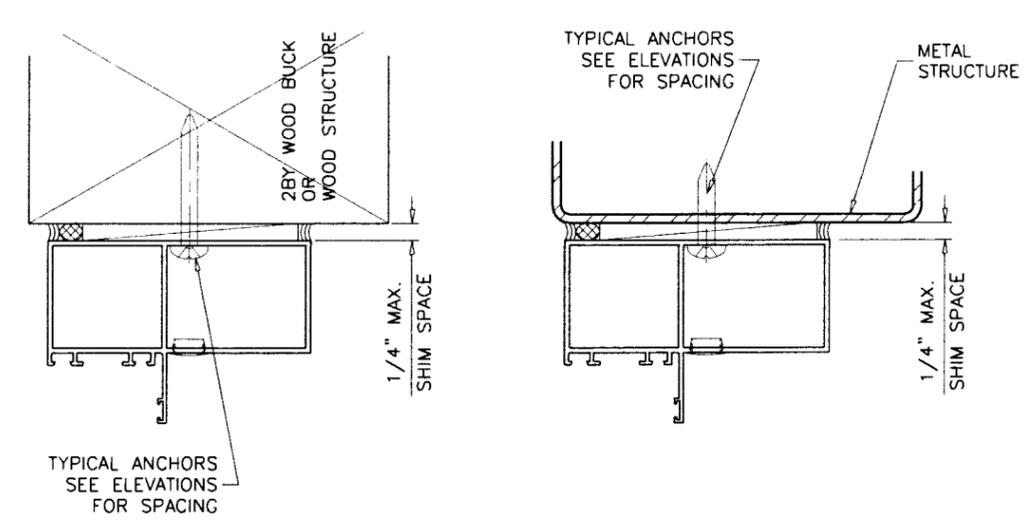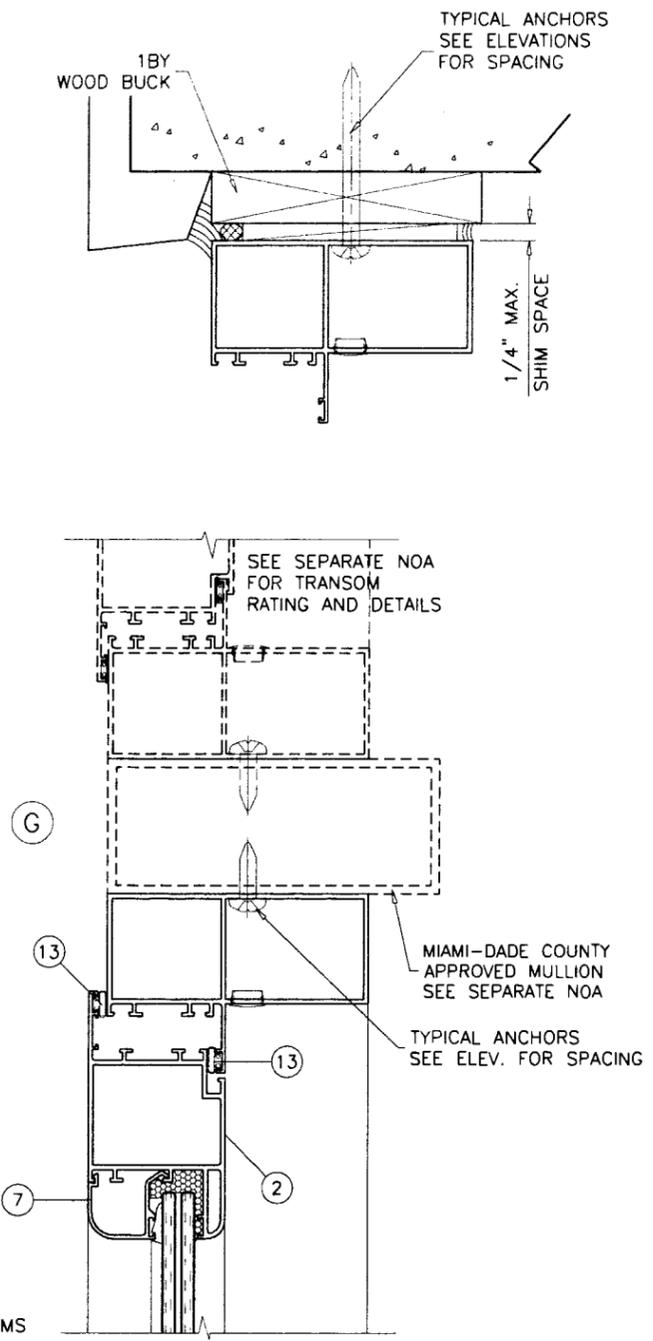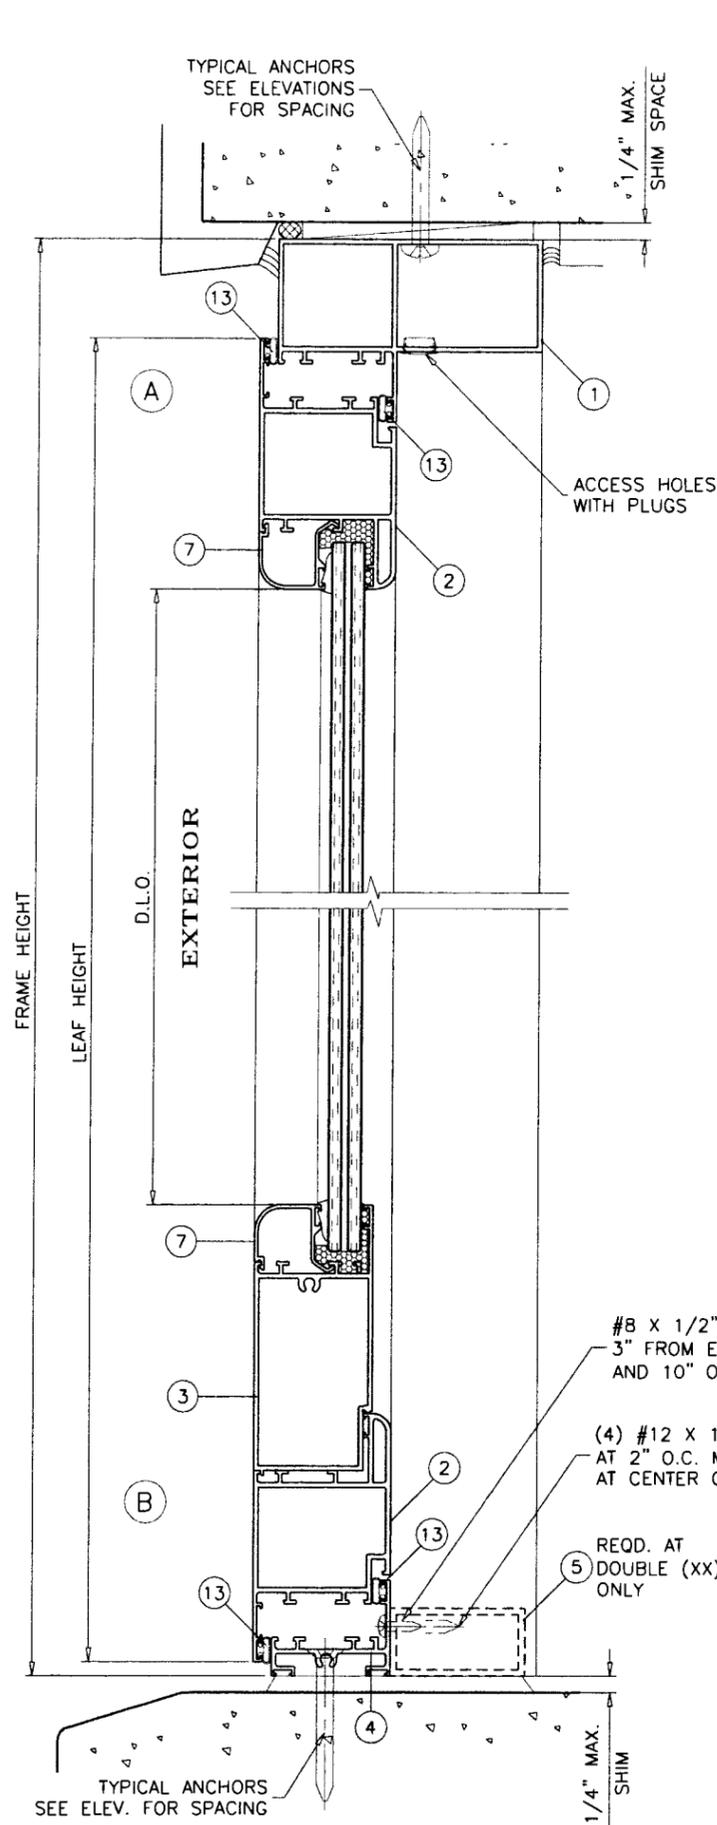

WOOD BUCKS AND METAL STRUCTURE NOT BY EUROTECH MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 1/4" DIA. TEKS/DRIL-FLEX SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS
 INTO METAL STRUCTURES
 STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK f'm = 2000 PSI MIN.

SEALANTS:
 ALL FRAME AND LEAF CORNERS AND JOINTS SEALED WITH ADSEL OR TEKNA 50729 SEALANTS.

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0310-05
 Expiration Date JUNE 10, 2014
 By *Isaac J. Chantz*
 Miami-Dade Product Control
 Division

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUN 02 2009


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 12395 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W04-01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)
EUROTECH WINDOWS & DOORS
 250 N.E. 32nd STREET
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 TEL. (954) 630-0217

no.	date	by	description
A	04.28.06		UPDATED FOR 2004 FBC
B	04.11.08		GENERAL REVISION

date: 01-15-04
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W04-01
 sheet 3 of 5

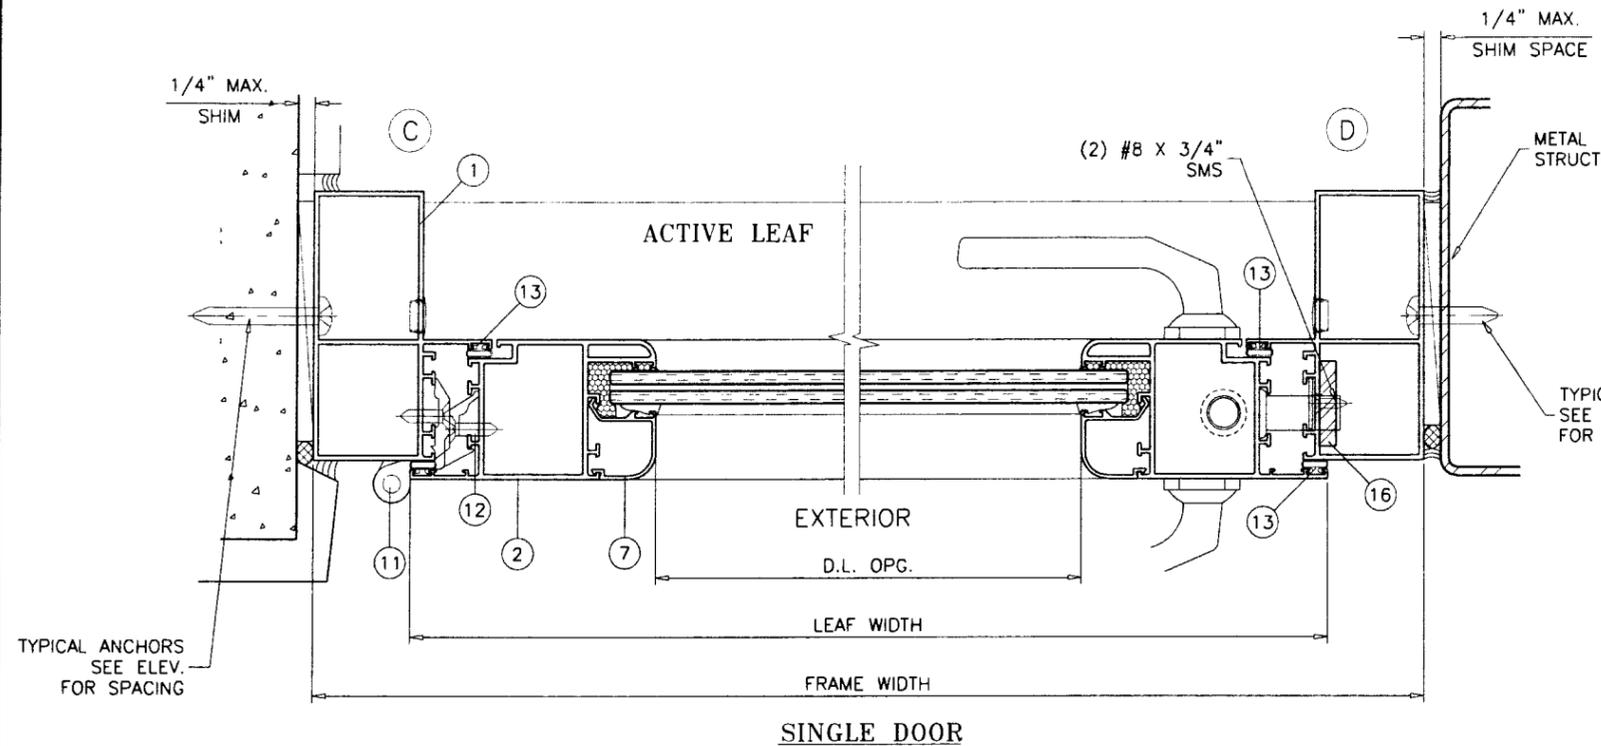


TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

1/4" MAX.
SHIM SPACE

METAL
STRUCTURE


TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

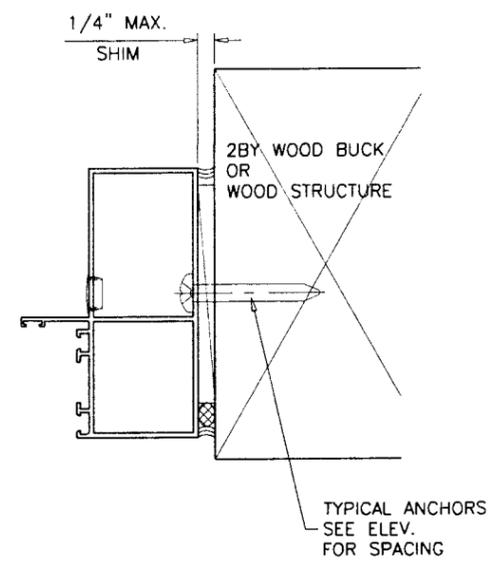

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

SINGLE DOOR

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 09-0310.05
Expiration Date JUNE 10, 2014
By Shag J. Chaudhry
Miami-Dade Product Control
Division

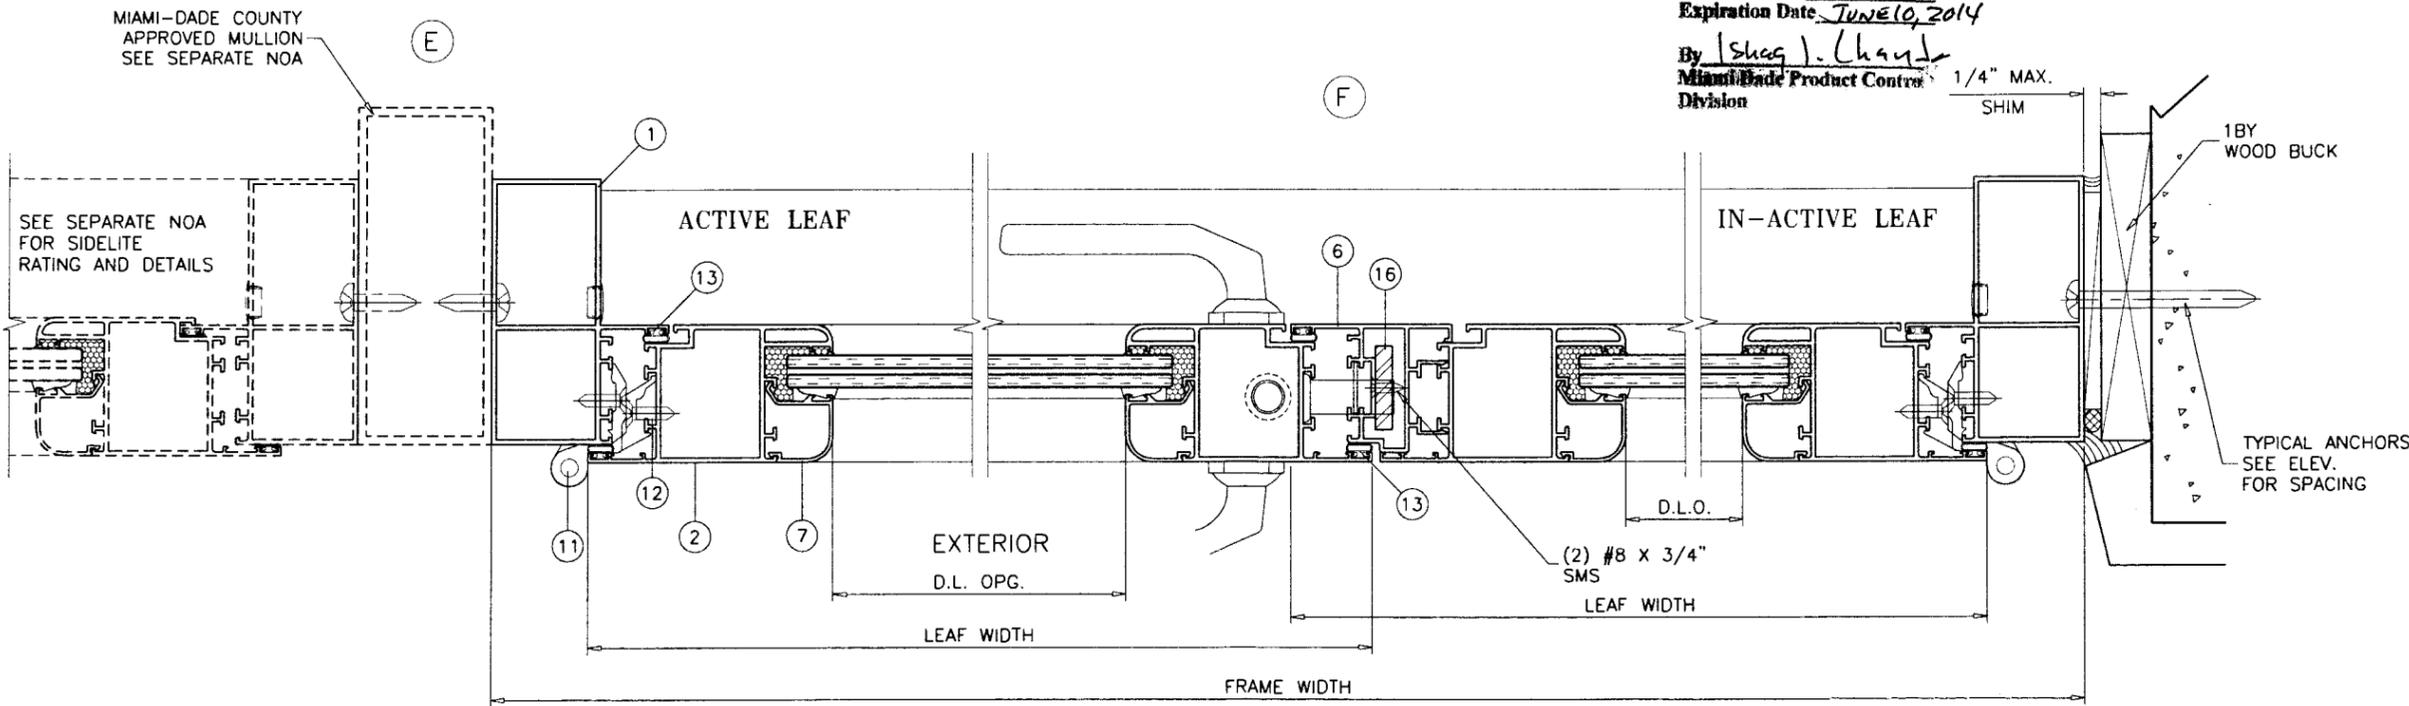

SEE SEPARATE NOA
FOR SIDELITE
RATING AND DETAILS

MIAMI-DADE COUNTY
APPROVED MULLION
SEE SEPARATE NOA

1/4" MAX.
SHIM

1BY
WOOD BUCK

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

DOUBLE DOOR

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

Arif

JUN 02 2009

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)


EUROTECH WINDOWS & DOORS
250 N.E. 32nd STREET
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 TEL. (954) 630-0217

no.	date	by	description
A	04.28.06		UPDATED FOR 2004 FBC
B	04.11.08		GENERAL REVISION


date: 01-15-04
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-01


sheet 4 of 5

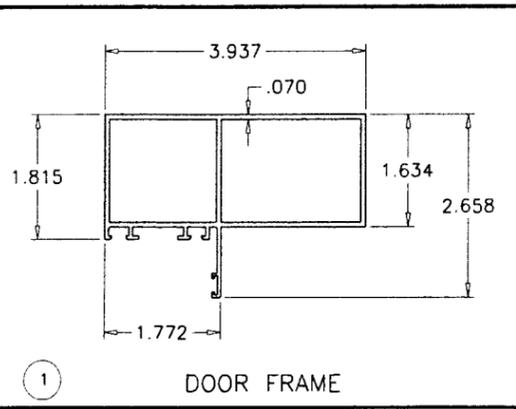


1 DOOR FRAME

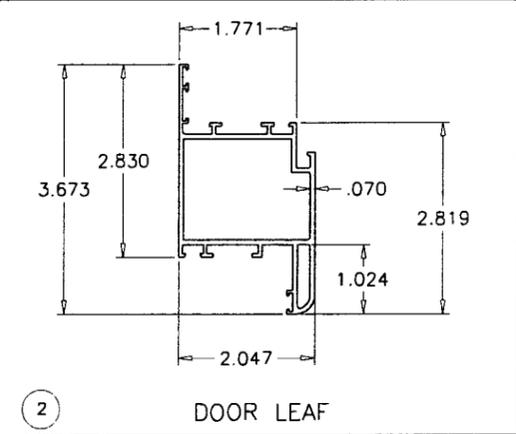


2 DOOR LEAF

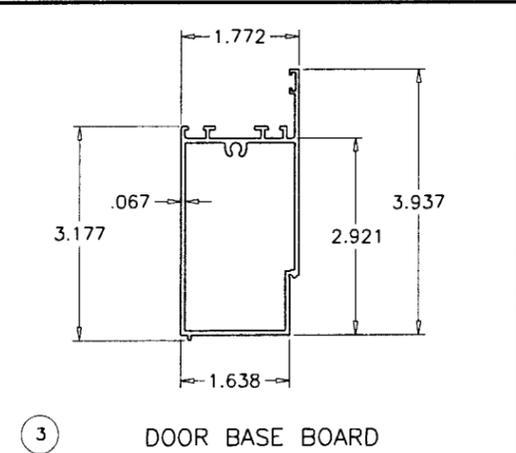



3 DOOR BASE BOARD

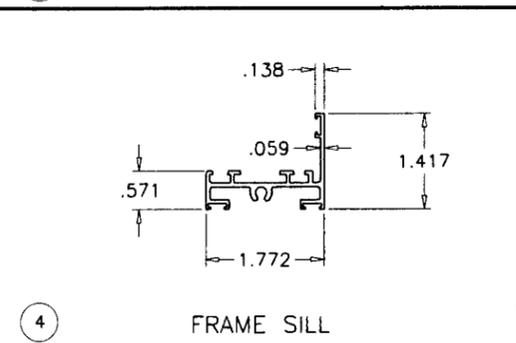


4 FRAME SILL

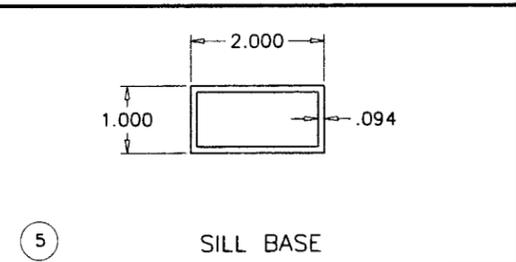


5 SILL BASE

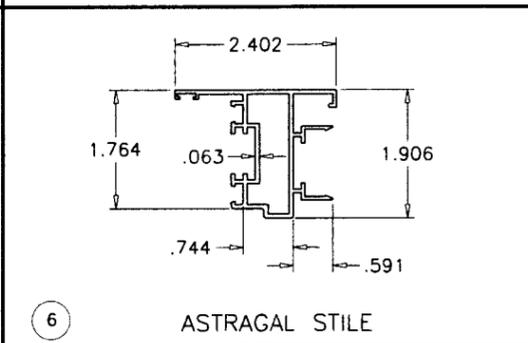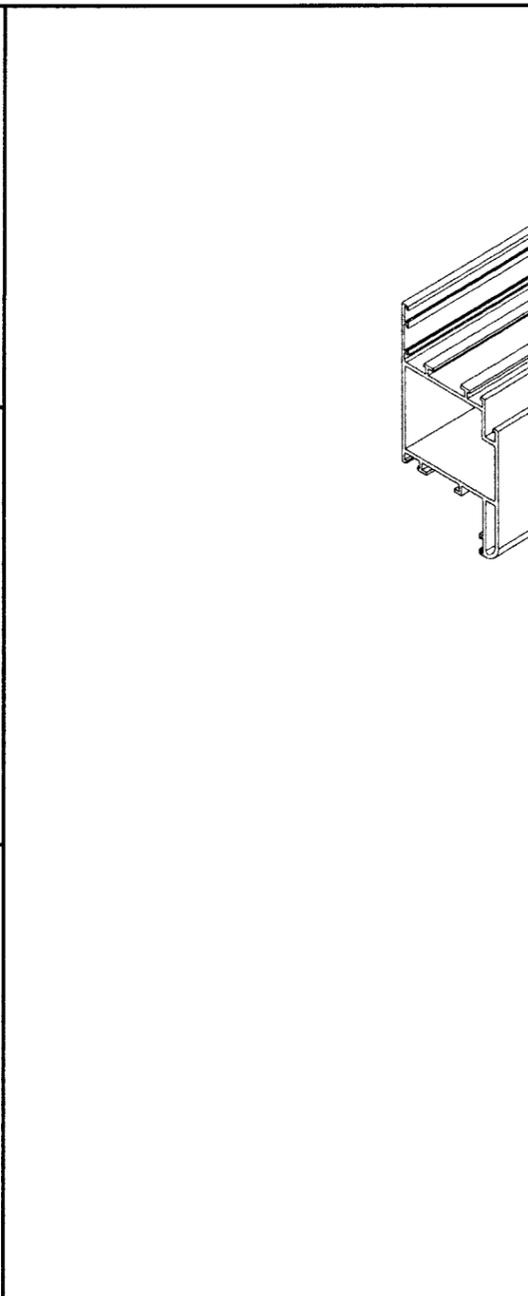

6 ASTRAGAL STILE

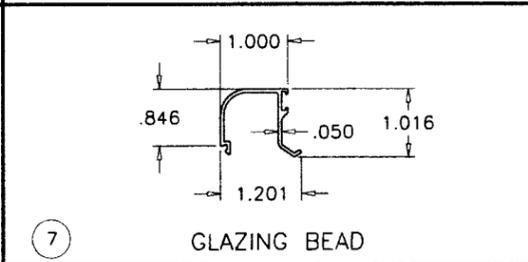

7 GLAZING BEAD

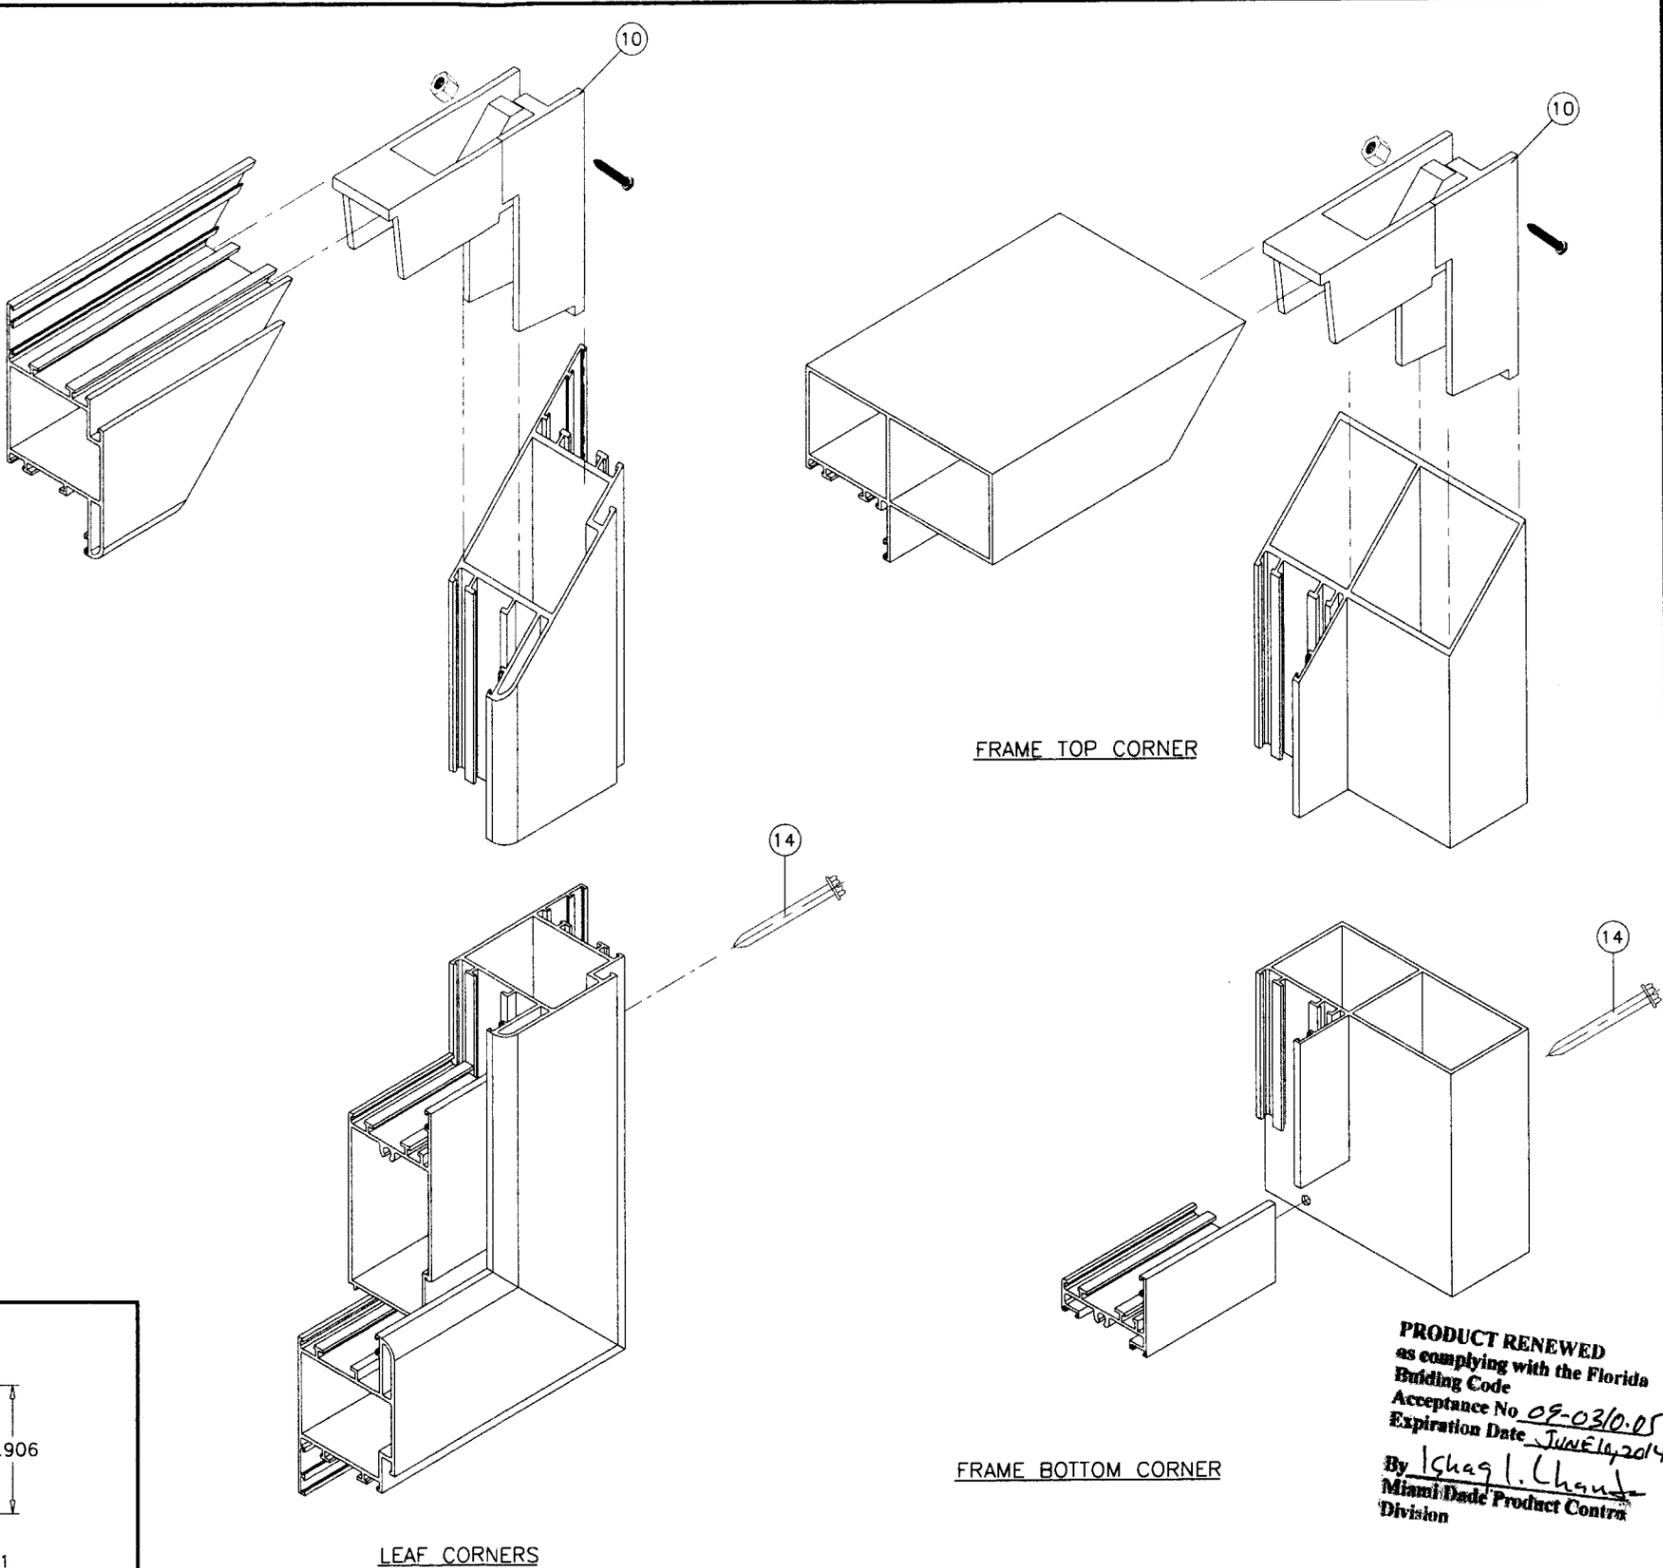

FRAME TOP CORNER

FRAME BOTTOM CORNER

LEAF CORNERS

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0310-05
 Expiration Date June 10, 2014
 By Ichag I. Chant
 Miami Dade Product Control
 Division

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUN 02 2009

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W04-01EWD

ALUM OUTSWING ENTRANCE DOOR (L.M.I.)
EUROTECH WINDOWS & DOORS
 250 N.E. 32nd STREET
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 TEL. (954) 630-0217

no.	date	description	by
A	04.28.06	NO CHANGE THIS SHEET	
B	04.11.08	GENERAL REVISION	

date: 01-15-04
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W04-01
 sheet 5 of 5