



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

**NOTICE OF ACCEPTANCE (NOA)**

**Stanley Access Technologies**  
**65 Scott Swamp Road**  
**Farmington, CT 06032**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Dura-Glide Series "3000" Aluminum Automatic Sliding Glass Door (Steel Reinforced)-NI**

**APPROVAL DOCUMENT:** Drawing No. **05-SAT-0027**, titled "Dura-Glide series 3000, Automatic Sliding Glass Door", sheets 1 through 5 of 5, prepared by Engineering Express, dated 09-18-2003 and last revised on 03/05/2009, signed and sealed by Frank L. Bernardo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None. Approved Shutters complying w/FBC, as applicable are required**

- Limitation:**
1. Electrical devices are not part of this approval and must be reviewed by corresponding authority.
  2. Adam Rites series 1853A must be used in conjunction with Adam Rites 4015 bolts.
  3. Glass option 2 w/ GLASLAM "Safety Plus II interlayer" is Non-Impacted application.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **08-0110.02** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

**NOA No 09-0312.18**  
**Expiration Date: April 21, 2013**  
**Approval Date: July 15, 2009**  
**Page 1**



6/24/19

**Stanley Access Technologies**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS** (*Transferred from NOA# 08-0110.02*)

1. Manufacturers die drawings and sections.
2. Drawing No. **05-SAT-0027**, titled "Dura-Glide series 3000, Automatic Sliding Glass Door", sheets 1 through 5 of 5, prepared by Engineering Express, dated 09-18-2003 and last revised on 03/05/2009, signed and sealed by Frank L. Bernardo, P.E.

Note: This revision consists of extrusion part numbers & addition of cluster anchors.

**B. TESTS** (*Transferred from NOA # 08-0110.02*) Original test conducted per SFBC, PA 202 now termed as TAS 202-94

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94 (Not performed)  
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

Along with installation diagram of an automatic aluminum sliding glass door w/ fixed panels, prepared by Fenestration Testing Laboratory Test Report No. FTL2523 (99115) dated January 14, 2000 signed and sealed by Aldo P. Gonzales, P.E. This test report was revised with addendum letter dated 08-29-2000 signed and sealed by Aldo P. Gonzales, P.E.)

**C. CALCULATIONS**

1. Anchor Verification Calculations, complying w/ FBC-2007, dated 03-04-2009, prepared, signed and sealed by Frank L. Bennardo, P. E.
2. Glazing complies with ASTM E-1300-02 & -04

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. **None**
2. Notice of Acceptance No. **08-0709.04** issued to issued to Nebula Glass Int'l Inc., for "Glasslam Safety plus II laminated glass", expiring on 08/17/2009

Note: (The glazing is for **Non-Impact** application only, will requires hurricane protection system)

**F. STATEMENTS** (*Transferred from NOA# 08-0110.02*)

1. Statement letter compliance to FBC-2007 and "No financial interest", both dated March 05, 2009, signed by Frank L. Bennardo, P. E.
2. Statement letter dated 12/07/07 justifying internal mechanism change, signed and sealed by Frank L. Bennardo, P.E.
3. Statement letter of compliance part of test report, dated Feb 29, 2000 issued by Fenestration testing laboratory, signed and sealed by Aldo P. Gonzales, P.E
4. Addendum letter dated 08-29-00 for test report FTL 2523 (99115) issued by Fenestration testing laboratory, signed and sealed by Aldo P. Gonzales, P.E.

**G. OTHER**

1. *This NOA revises NOA # 08-0110.02, expiring April 21, 2013*
2. Test proposal dated Sept 07, 2007 approved by BCCO.
3. Manufacture supplied Adam Rites deadbolt/hook and bolts mechanism brochures.
4. Previous NOA(s) associated with this file are #05-0829.02, 03-0812.05& 00-0508.08.

*Ishaq I. Chanda*

**Ishaq I. Chanda, P.E.**  
Product Control Examiner  
NOA No 09-0312.18  
Expiration Date: April 21, 2013  
Approval Date: July 15, 2009

# DURA-GLIDE 3000


## REINFORCED BI-PART AUTOMATIC SLIDING GLASS DOOR NON-IMPACT RESISTANT

FRANK L. BENNARDO, P.E.  
#PE0046549


03/05/2009

**ANCHOR TYPE**  
IN CONCRETE (3KSI MINIMUM): 1/4" PERMASEAL TAPPER CONCRETE SCREW EMBEDDED 1-1/2" MIN, WITH 3" MINIMUM EDGE DISTANCE.  
IN STEEL: 1/4-20 SMS SAE GRADE 5 OR BETTER (NOTE A36 3/16" STEEL SUBSTRATE MIN.), WITH 1/2" MINIMUM EDGE DISTANCE  
IN WOOD (G=0.55 MINIMUM): #14 SHEET METAL SCREW EMBEDDED 1-1/2" MIN, WITH 3/4" MINIMUM EDGE DISTANCE  
(NOTE: MINIMUM 2X4 WOODBUCK FOR WOOD SCREWS)


**ANCHOR SPACING**  
SILL: DOUBLE ROW, 5" FROM EACH CORNER, BALANCE AT 16" O.C. MAX  
HEAD: SINGLE ROW, 5" FROM EACH CORNER, BALANCE AT 10" O.C. MAX  
JAMBS: SINGLE ROW, 2" FROM BOTTOM CORNER, BALANCE AT 10" O.C. MAX

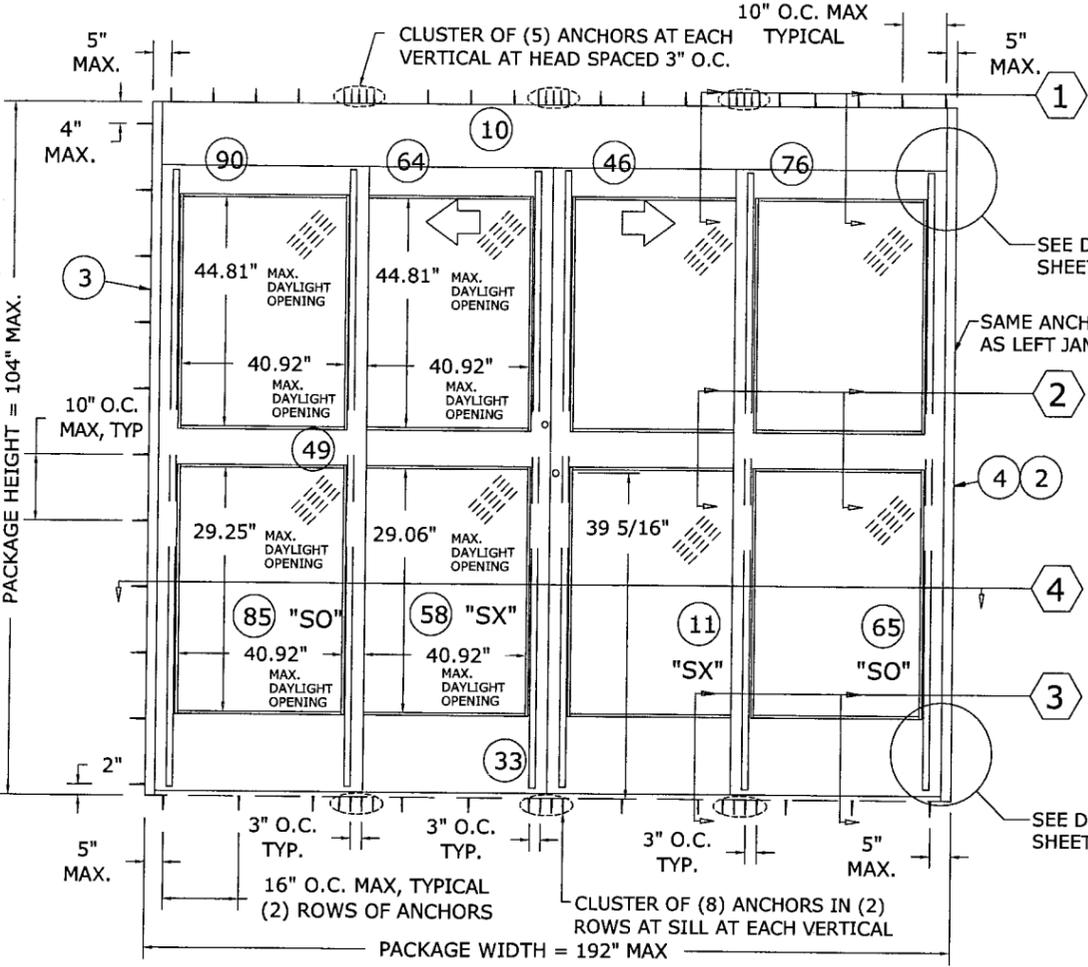


**EXTERIOR ELEVATION (OXXO)**

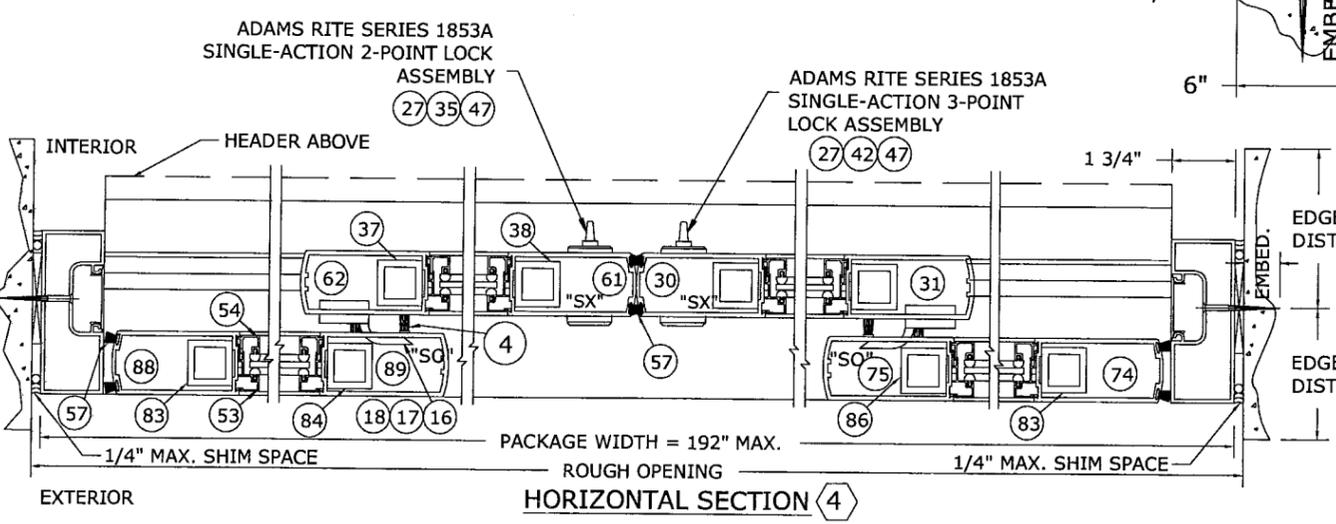

**HORIZONTAL SECTION**

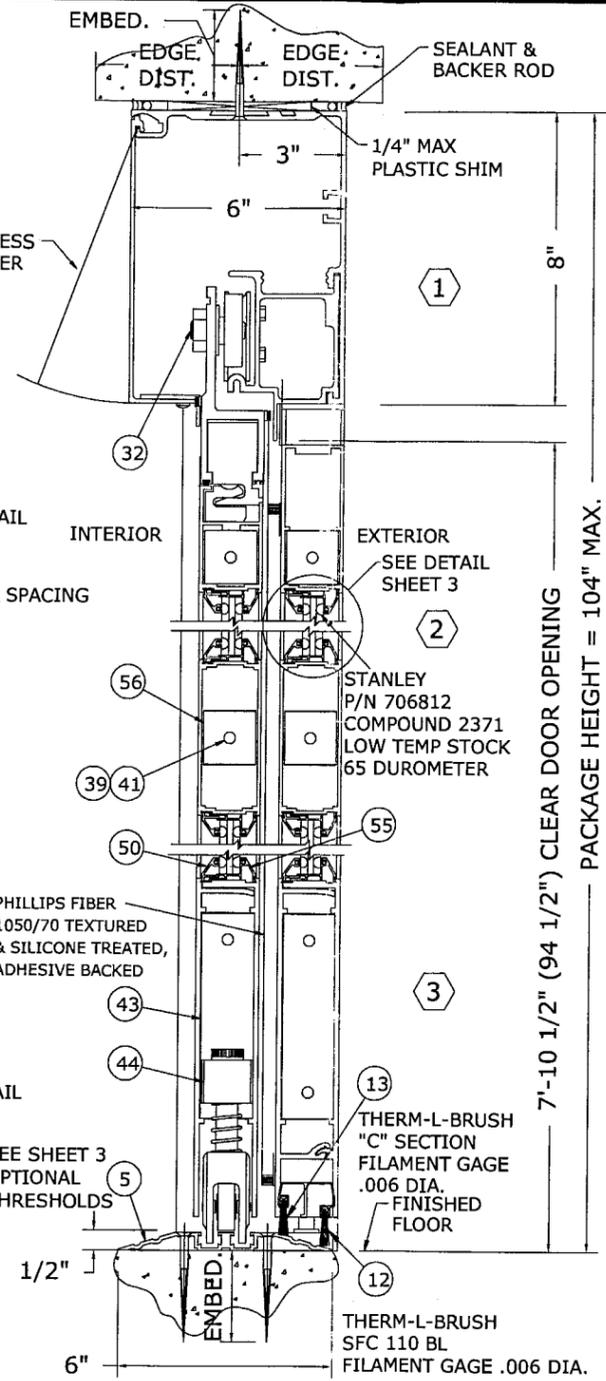

**VERTICAL SECTION**

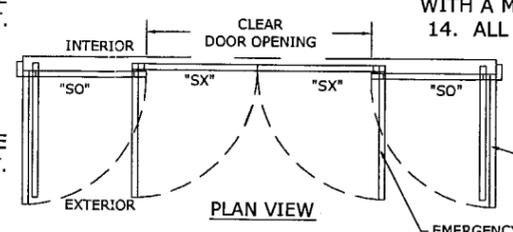

**PLAN VIEW**

PACKAGE HEIGHT INFORMATION FOR SURFACE APPLICATIONS

PACKAGE HEIGHT	MASONRY OPENING	CAULKING ALLOWANCE	ACTUAL CLEAR OPG UNDER HEADER
8'-8" (104")	8'-8 1/4" (104 1/4")	1/4"	7'-10 1/2" (94 1/2")

PACKAGE WIDTH INFORMATION

PKG WIDTH	SLIDING DOOR OPENING	(SX) DOOR WIDTH	(SO) DOOR WIDTH	DOOR TRAVEL	MASONRY OPENING	CAULKING ALLOWANCE
16'-0" (192")	80"	49 1/8"	49 1/8"	40"	16'-1/2" (192 1/2")	1/4" / SIDE

DESIGN PRESSURE RATING (NON-IMPACT)

	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED.	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED.
POSITIVE	NOT APPROVED	+ 50 PSF
NEGATIVE	NOT APPROVED	- 50 PSF

- GENERAL NOTES:**
- THIS PRODUCT HAS BEEN TESTED & DESIGNED IN ACCORDANCE WITH THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE - HIGH VELOCITY HURRICANE ZONE (HVHZ) - AND MIAMI-DADE PROTOCOL TAS 202 AS A NON-IMPACT RESISTANT SYSTEM.
  - NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
  - POSITIVE & NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
  - THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. WHERE SITE CONDITIONS DIFFER FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
  - PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND ADDITIONAL IMPOSED LOADS. WOOD BUCKS NOT BY THIS PRODUCT MANUFACTURER SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE HOST STRUCTURE.
  - THE PRODUCT DETAILED HEREIN HAS BEEN DESIGNED AND TESTED TO THE MAXIMUM SPANS & LOADS SHOWN ON THESE DRAWINGS. REFERENCE FTL TEST REPORT #2523.
  - ALL ALUMINUM PARTS ARE 6063-T5 OR 6063-T6 ALUMINUM.
  - GLAZING: 1/4" TEMPERED GLASS OR 0.575" GLASSLAM SAFETY PLUS BY NEBULA INTERNATIONAL, INC. (1/4" TEMPERED INNER & OUTER LAYERS WITH 1/8" INTERLAYER).
  - ALL UNITS SHALL BE PROTECTED WITH MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS FOR ALL INSTALLATIONS.
  - CORNER PANEL CONSTRUCTION: PANEL CORNERS ARE BUTT JOINTED, SECURED W/ (4) FULL-WIDTH 5/16" THREADED TIE RODS AT TOP RAIL, INTERMEDIATE HORIZONTAL MUNTIN BAR AND BOTTOM RAIL. ALL JOINTS ARE ALSO WELDED.
  - GLAZING MATERIAL IN BOTH FIXED & SLIDING PANELS OF ALL SLIDING DOORS SHALL COMPLY WITH THE REQUIREMENTS IN THE PERFORMANCE SPECIFICATIONS & METHODS OF TEST FOR SAFETY GLAZING MATERIALS USED IN BUILDINGS.
  - ANCHORS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS, SPACED AS NOTED HEREIN. ANCHOR EMBEDMENT TO BASE MATERIAL DOES NOT INCLUDE WALL DRESSING OR STUCCO.
  - ALL BOLTS & WASHERS SHALL BE ZINC COATED, GALVANIZED, OR STAINLESS STEEL WITH A MINIMUM TENSILE STRENGTH OF 60 KSI, EXCEPT INSTALLATION ANCHORS.
  - ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR COATED.

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No 09-0312-18  
Expiration Date APR 21, 2013  
By *Ghag1. Grande*  
Miami Dade Product Control Division

**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 FAX: (954) 354-0443  
WWW.ENGPX.COM  
CERT OF AUTH #985  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**STANLEY**  
ACCESS TECHNOLOGIES  
65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032  
DURA-GLIDE SERIES 3000  
AUTOMATIC SLIDING GLASS DOORS  
(BI-PART, REINFORCED, NON-IMPACT)

DRWN	CHKD	DATE
CL	FLB	9/18/03
CL	FLB	8/12/05
CL	FLB	12/15/05
KL	CL	12/18/07
KL	CL	03/04/09


05-SAT-0027  
PAGE SCALE: -  
DESCRIPTION:  
STANLEY DWG #413837

03/05/2009 - 10:03am Keith F:\01 Project Files\Stanley (SAT)\2005 Jobs\05-SAT-0027 Dura Glide 3000\_Reinf. Non-Impact (NOA).dwg


03/05/2009 - 10:03am keith F:\01 Project Files\Stanley (SAT)\2005 Jobs\05-SAT-0027 Dura Glide 3000, Reinf. Non-Impact (NOA).dwg

**ANCHOR TYPE**  
 IN CONCRETE (3KSI MINIMUM): 1/4" PERMASEAL TAPPER CONCRETE SCREW EMBEDDED 1-1/2" MIN, WITH 3" MINIMUM EDGE DISTANCE.  
 IN STEEL: 1/4-20 SMS SAE GRADE 5 OR BETTER (NOTE A36 3/16" STEEL SUBSTRATE MIN.), WITH 1/2" MINIMUM EDGE DISTANCE  
 IN WOOD (G=0.55 MINIMUM): #14 SHEET METAL SCREW EMBEDDED 1-1/2" MIN, WITH 3/4" MINIMUM EDGE DISTANCE  
 (NOTE: MINIMUM 2X4 WOODBUCK FOR WOOD SCREWS)


**ANCHOR SPACING**  
 SILL: DOUBLE ROW, 3" FROM EACH CORNER, BALANCE AT 16" O.C. MAX  
 HEAD: SINGLE ROW, 4" FROM EACH CORNER, BALANCE AT 10" O.C. MAX  
 JAMBS: SINGLE ROW, 2" FROM EACH CORNER, BALANCE AT 10" O.C. MAX

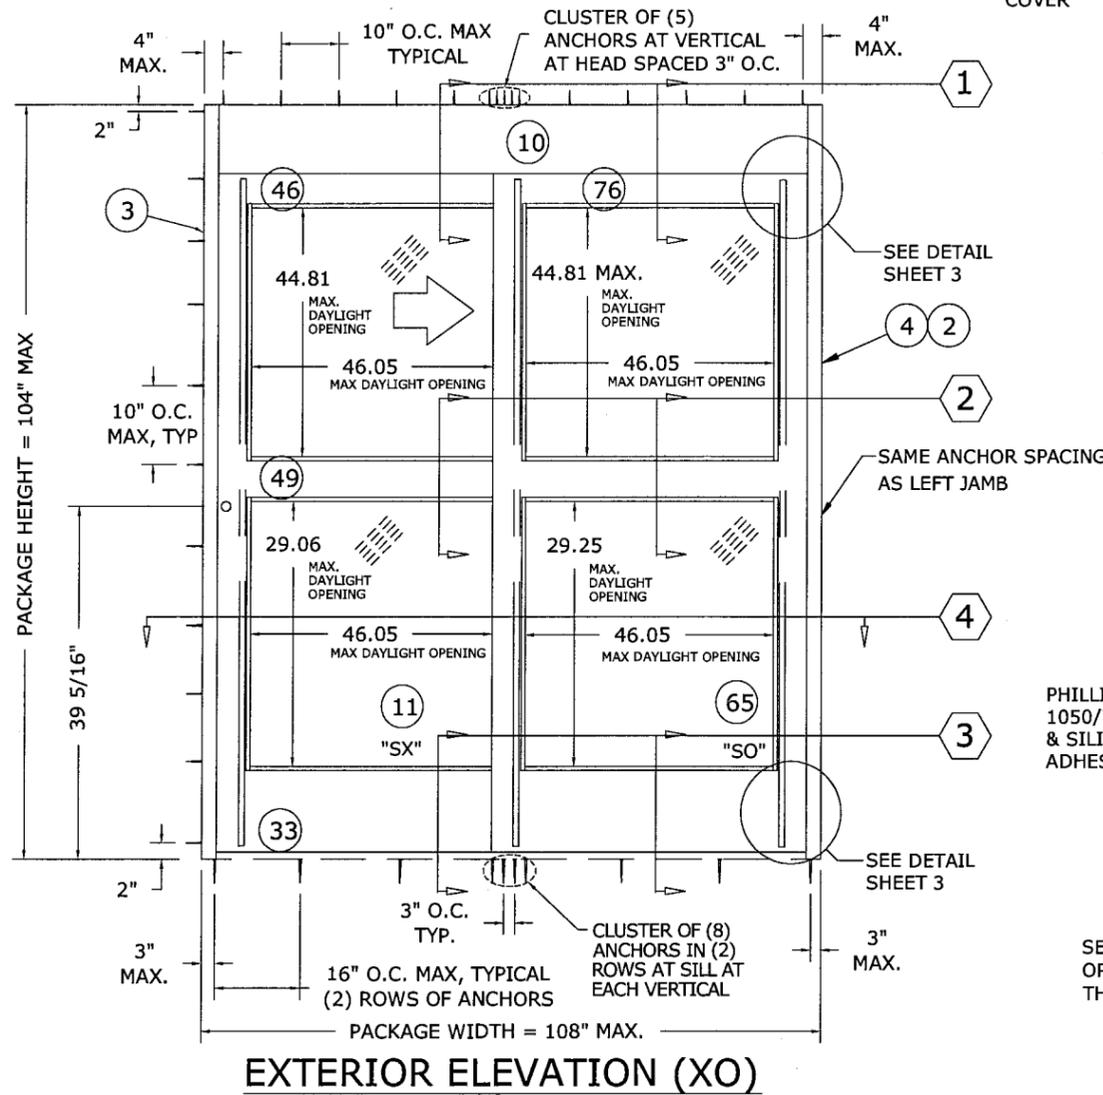


**EXTERIOR ELEVATION (XO)**

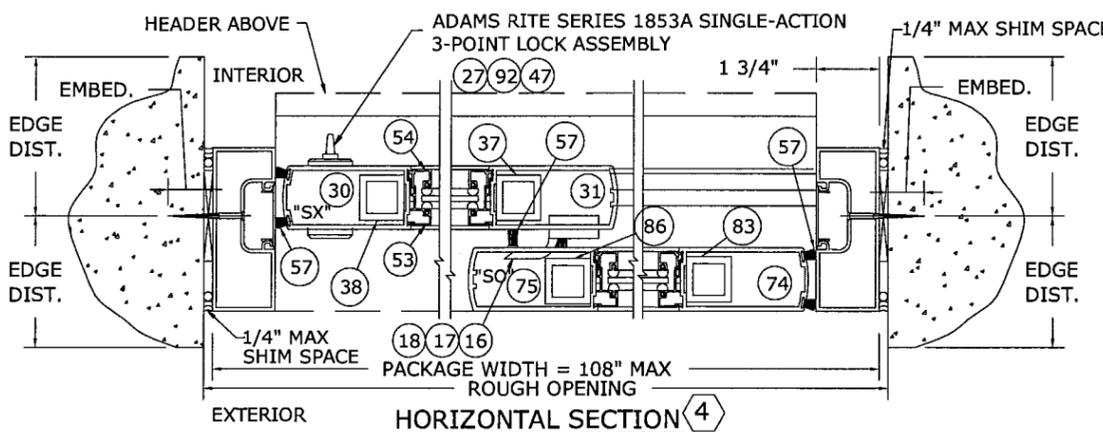

**HORIZONTAL SECTION (4)**

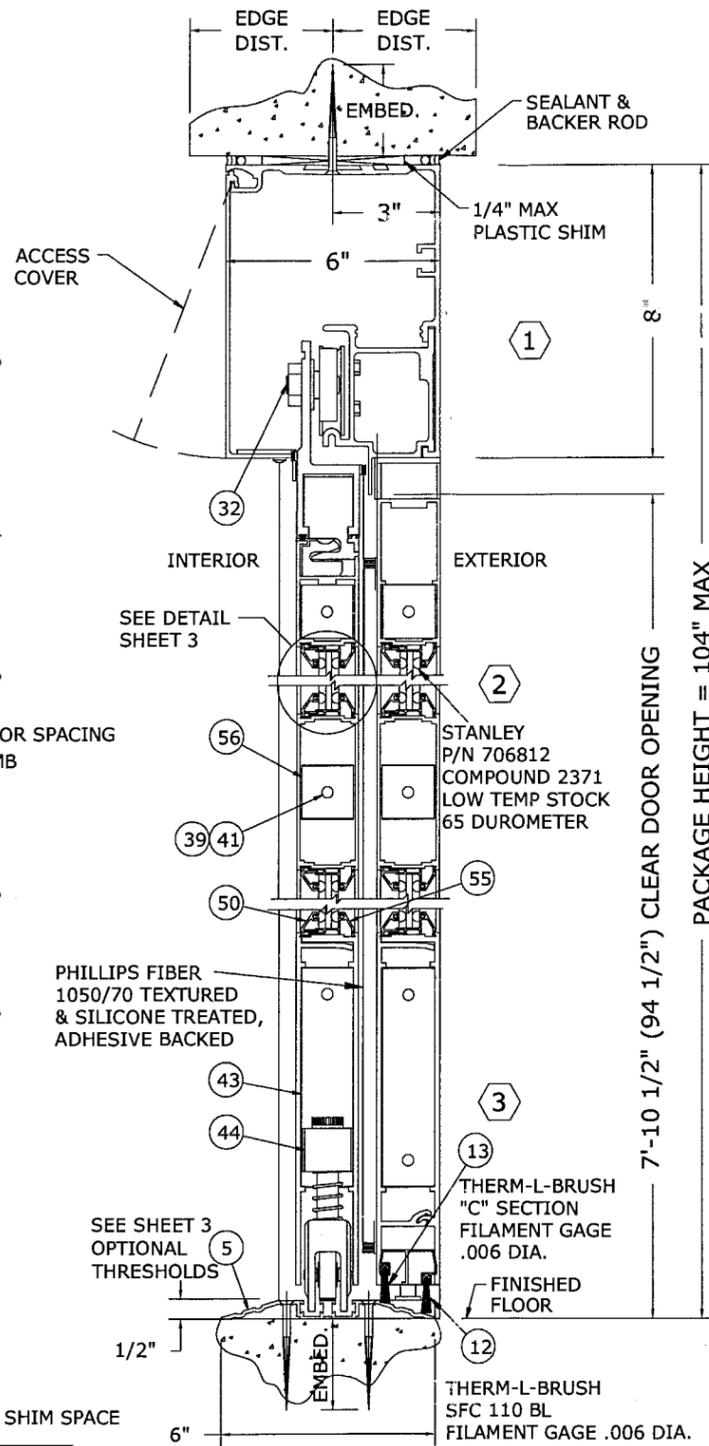

**VERTICAL SECTION (1, 2, 3)**

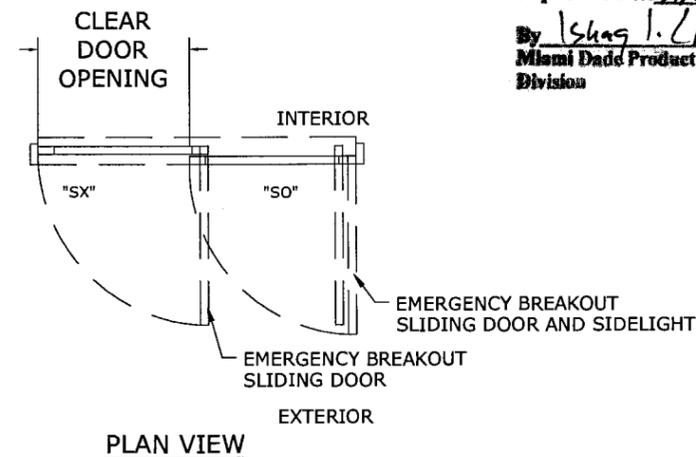

**PLAN VIEW**

PACKAGE HEIGHT INFORMATION FOR SURFACE APPLICATIONS			
PACKAGE HEIGHT	MASONRY OPENING	CAULKING ALLOWANCE	ACTUAL CLEAR OPG UNDER HEADER
8'-8" (104")	8'-8 1/4" (104 1/4")	1/4"	7'-10 1/2" (94 1/2")

PACKAGE WIDTH INFORMATION						
PKG WIDTH	SLIDING DOOR OPENING	(SX) DOOR WIDTH	(SO) DOOR WIDTH	DOOR TRAVEL	MASONRY OPENING	CAULKING ALLOWANCE
9'-0" (108")	45 1/4"	54 1/4"	54 1/4"	45 1/4"	9'-1/2" (108 1/2")	1/4" / SIDE

DESIGN PRESSURE RATING (NON-IMPACT)		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED.	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED.
POSITIVE	NOT APPROVED	+ 50 PSF
NEGATIVE	NOT APPROVED	- 50 PSF

**GENERAL NOTES:**  
 REFER TO GENERAL NOTES ON SHEET 1

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 Acceptance No. 09-0312-18  
 Expiration Date APR 21, 2013  
 By Isaac I. Chung  
 Miami Dade Product Control Division

03/05/2009

**ENGINEERING EXPRESS**  
 160 SW 12th AVENUE, #106  
 DEERFIELD BEACH, FL 33442  
 Ph: (954) 354-0660 Fax: (954) 354-0443  
 WWW.ENGGEXP.COM  
 CERT OF AUTH #9885  
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

**STANLEY**  
 ACCESS TECHNOLOGIES  
 65 SCOTT SWAMP ROAD  
 FARMINGTON, CT 06032  
 DURA-GLIDE SERIES 3000  
 AUTOMATIC SLIDING GLASS DOORS  
 (BT-PART, REINFORCED, NON-IMPACT)

DRWN	CHKD	DATE	REMARKS
		9/18/03	INIT ISSUE
		8/12/05	2004 FBC
		12/15/05	COUNTY COMMENTS
		12/18/07	REVISE HARDWARE
		03/04/09	2007 FBC

05-SAT-0027

PAGE SCALE: -  
 DESCRIPTION:  
 STANLEY DWG #413837

03/05/2009 - 10:03am keithl F:\01 Project Files\Stanley (SAT)\2005 Jobs\05-SAT-0027 Dura Glide 3000, Reinf. Non-Impact (NOA)\05-SAT-0027\_04a Dura Glide 3000, Reinf. Non-Impact (NOA).dwg

FRANK L. BENNARDO, P.E.  
# PE0046549

03/05/2009

**ENGINEERING EXPRESS**

160 SW 12th AVENUE, # 106  
DEERFIELD BEACH, FL 33442  
PH: (954) 354-0660 FAX: (954) 354-0443  
WWW.ENGEXP.COM

CERT. OF AUTH. #9886  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**STANLEY**

ACCESS TECHNOLOGIES  
65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032


DURA-GLIDE SERIES 3000  
AUTOMATIC SLIDING GLASS DOORS  
(BI-PART, REINFORCED, NON-IMPACT)

DRWN	CHKD	DATE
CL <td>FLB <td>9/18/03 </td></td>	FLB <td>9/18/03 </td>	9/18/03
CL <td>FLB <td>8/12/05 </td></td>	FLB <td>8/12/05 </td>	8/12/05
KL <td>CL <td>12/15/05 </td></td>	CL <td>12/15/05 </td>	12/15/05
KL <td>CL <td>12/18/07 </td></td>	CL <td>12/18/07 </td>	12/18/07
KL <td>CL <td>03/04/09 </td></td>	CL <td>03/04/09 </td>	03/04/09

05-SAT-0027


PAGE SCALE: -  
DESCRIPTION:  
STANLEY DWG #413837

3

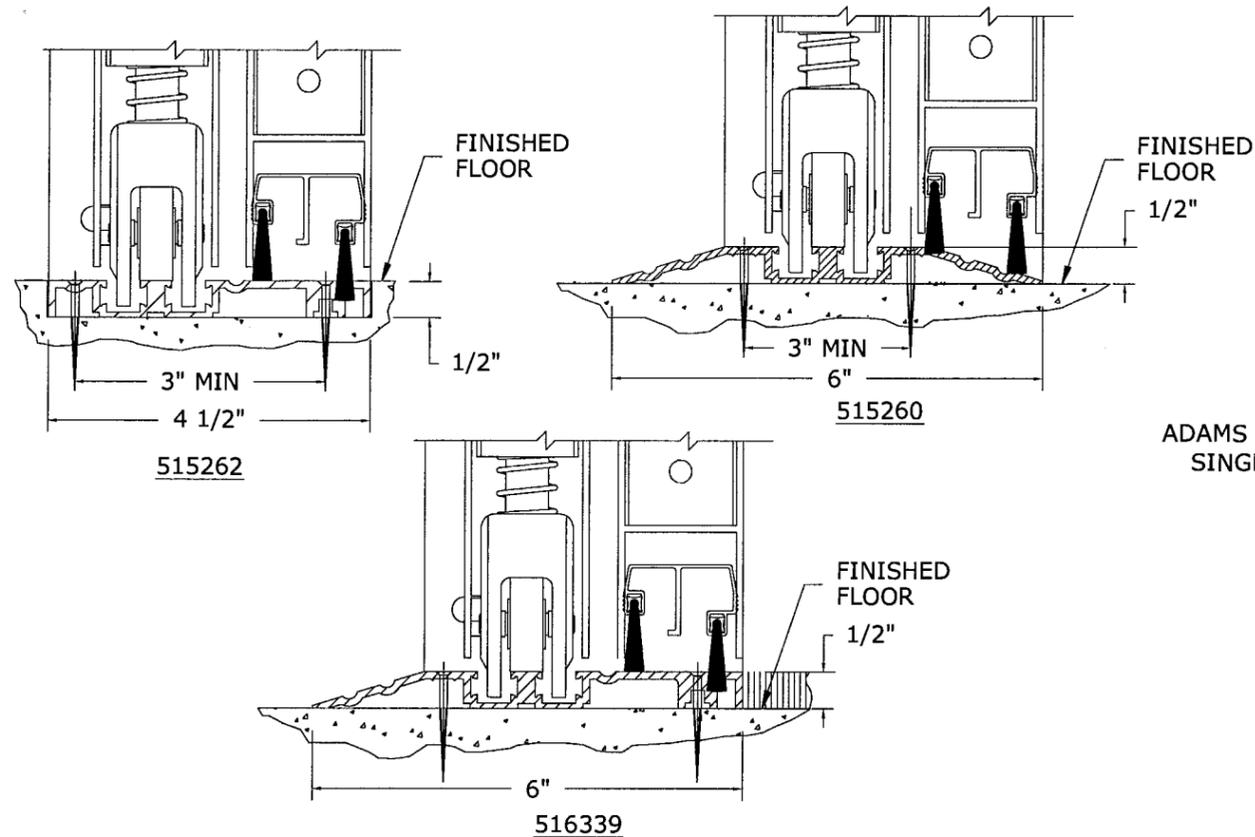


**5 THRESHOLD OPTIONS**

**GLAZING DETAILS**

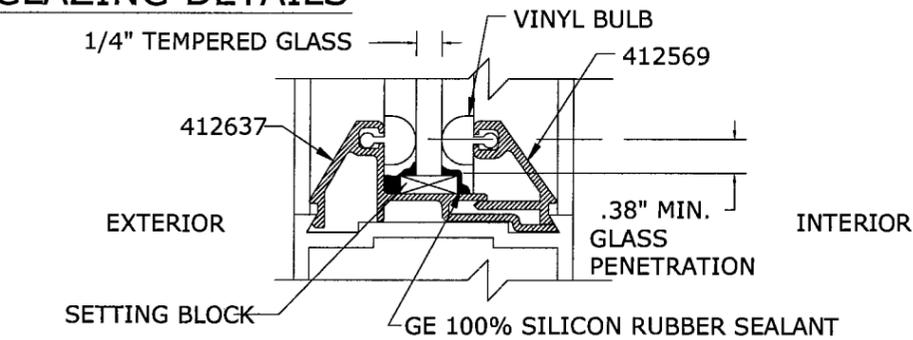


**OPTION 1: 1/4" TEMPERED GLASS**

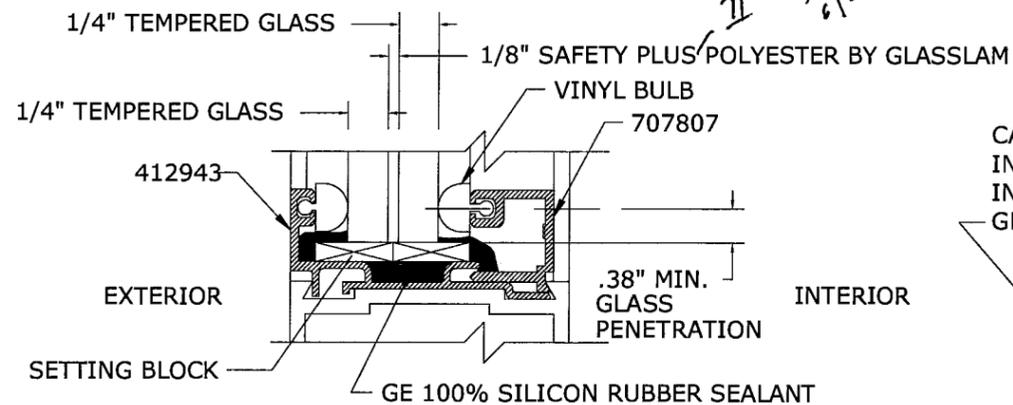

**OPTION 2: GLASSLAM SAFETY PLUS BY NEBULA INTERNATIONAL, INC. (PER CURRENT APPROVED NOA)**

ADAMS RITE SERIES 1853A  
SINGLE-ACTION 3-POINT  
LOCK ASSEMBLY

ADAMS RITE SERIES 1853A  
SINGLE-ACTION 2-POINT  
LOCK ASSEMBLY

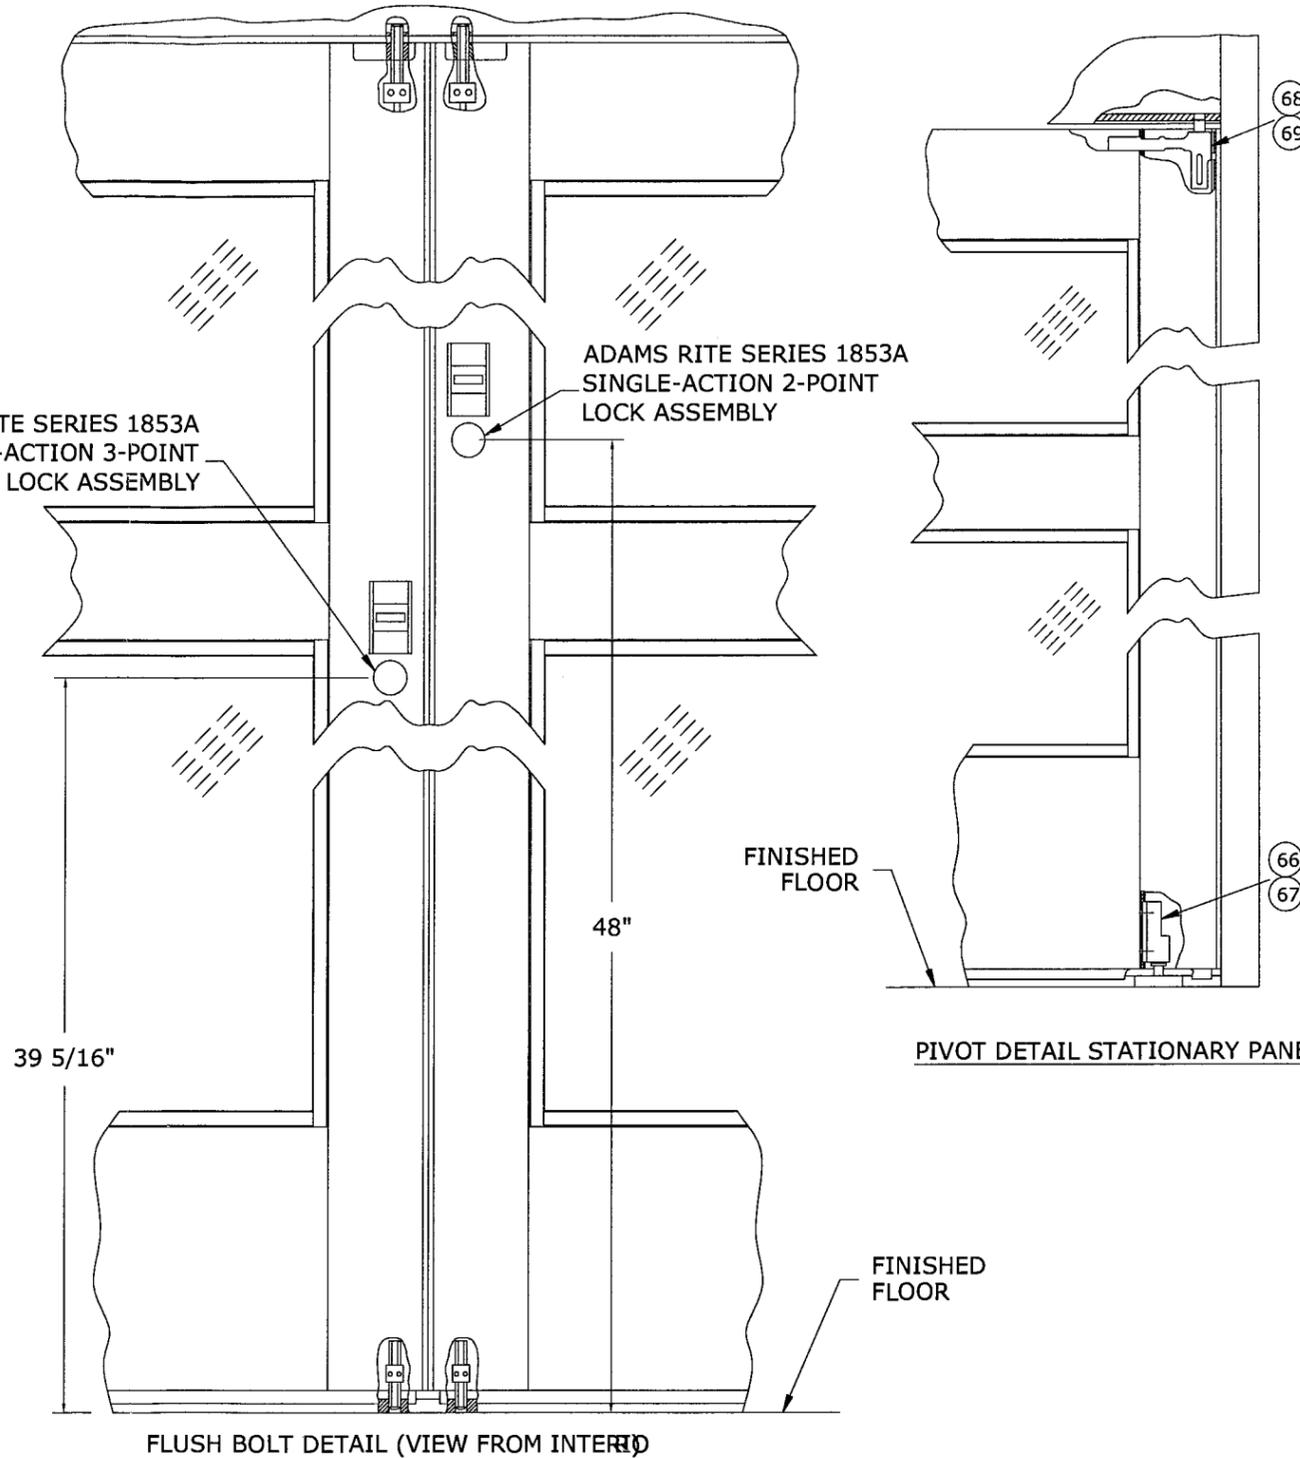

**FLUSH BOLT DETAIL (VIEW FROM INTERIOR)**

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 09-0312.18  
Expiration Date APR 21, 2013  
By Frank L. Bennardo  
Miami Dade Product Control  
Division

NO.	QTY	PART NO.	DESCRIPTION
1	1		DURA-GLIDE 3000 BI-PART
2	2	413089-1	JAMB INSERT
3	1	412858	JAMB, 4.500 X 1.750 X .100
4	1	412858	JAMB, 4.500 X 1.750 X .100
5	1	515260	THRESHOLD
	1	516339	THRESHOLD
	1	515262	THRESHOLD
10A	1	515686	HEADER COVER, 8.468 X 1.968 X .109
10B	1	110755	HEADER, 8.000 X 6.000 X .140
10C	1	515056	HEADERTRACK TUBE, 4.624 X 3.110 X .125
11	1	157508	DOOR PANEL, SX - RH
12	1	713241	THERM-L-BRUSH
13	1	710739	THERM-L-BRUSH
14	2	713416	FLUSH BOLT GUIDE
15	12	312063499	SCREW, FHM-PH 1/4-20 X 1/2 LG
16	2	713823	REINFORCEMENT, SECURITY HOOK, OUTSIDE
17	2	713822	REINFORCEMENT, SECURITY HOOK, INSIDE
18	2	713821	HOOK, SECURITY, MEDIUM STILE
19	1	380901499	NUT, HEX JAM, 5/16-18
20	1	353367000	SCREW, SHC-SK, 5/16-18 X 2.0 LG
21	1	412638	LABEL, CAUTION
22	2	413162	EXIT INDICATOR
23	1	412571	BLOCK-ANCHOR
24	1	412572	SPACER-PILLOW BLOCK
25	2	353349000	SCREW, SHM-SK, 1/4-20 X 1.0 LG
26	2	312073499	SCREW, FHM-PH, 1/4-20 X 2.0 LG
27A	2	709221	LOCK, THUMBTURN
27B	2		OPTIONAL LOCK, ADAMS RITE AR4550 LEVER
28	2	351801499	SCREW, SHC-SK, 1/4-20 X 3/8 LG
29	4	713321	SCREW, FHC-SK, #10-32 X 3/8 LG
30	1	413795	STILE, LOCK-SX, RH, 3.531 X 1.750 X .125
31	1	412944	STILE, PIVOT-SX, RH, 3.531 X 1.750 X .130
32	1	111879-2	HANGER ASSEMBLY-SX, RH
33A	1	516329	RAIL, BOTTOM-SX, 9.625 X 1.595 X .140
33B	1	516330	RAIL, BOTTOM-SX, 9.625 X 1.530 X .140
34	4	312008960	SCREW, FHM-PH, #8-32 X 5/8LG
35	1	413821	ADAMS RITE SERIES 1853A SINGLE-ACTION 2-POINT LOCK
36	2	413811	ROD ASSY, THROWBOLT ADAMS RITE 31-0278
37	6	516743	STEEL TUBE, ASTM A500, 1 1/4 X 1 1/4 X 3/16 X 90 7/8 LG
38	4	516741	STEEL TUBE, ASTM A500, 1 1/4 X 1 1/4 X 3/16 X 90 7/8 LG
39	4	711483	ROD, TIE, 5/16-18 UNC-1A, STEEL, FULL LENGTH OF RAIL
40	16	706812	SEAL, WEATHER-LENGTH AS REQUIRED
41	8	706233	NUT, FLANGED
42	1	413810	ADAMS RITE SERIES 1853A SINGLE-ACTION 3-POINT LOCK
43	2	516338	CLIP, GUIDE
44	1	515265	BOTTOM GUIDE ASSEMBLY
45	1	516224	DETENT-DOOR PORTION
46	1	412469	RAIL, TOP-SX, RH, 2.875 X 1.735 X .093
47	2	706668	LOCK, CYLINDER
48	1	413805	SWEEP HOLDER
49	1	415026	BAR, MUNTIN, 4.250 X 1.735 X .093
50	4	412569	STOP, GLASS-HORIZONTAL, .625 X .516 X .051
51	2	707807	STOP, GLASS-VERTICAL, .625 X .519 X .051
52	2	412943	STOP, GLASS-VERTICAL, 1.619 X .654 X .041
53	2	412472	STOP, GLASS-VERTICAL, 1.551 X .669 X .041
54	2	707807	STOP, GLASS-VERTICAL, .624 X .519 X .051
55	4	412637	STOP, GLASS-HORIZONTAL, 1.551 X .669 X .041
56	4	412479	CLIP, GUIDE
57	1	411624	PILE, ADHESIVE BACKED

NO.	QTY	PART NO.	DESCRIPTION
58	1	157509	DOOR PANEL, SX - LH
			SAME AS 157508 EXCEPT AS NOTED
59	2	312251960	SCREW, FHM-PH, #10-32 X 1/2 LG
60	1	516552	STRIKE PLATE ASSEMBLY
61	1	413795	STILE, STRIKE-SX, LH, 3.531 X 1.750 X .125
62	1	412944	STILE, PIVOT-SX, LH, 3.531 X 1.750 X .130
63	1	111879-1	HANGER ASSEMBLY-SX, LH
64	1	412469	RAIL, TOP-SX, LH, 2.875 X 1.735 X .093
65	1	157510	DOOR PANEL, SO - RH
			SAME AS 157508 EXCEPT AS NOTED
66	2	312066499	SCREW, FHM-PH, 1/4-20 X 3/4 LG
67	1	410100	BOTTOM PIVOT-RH
68	5	713844	PIVOT-SELF TAPPING SCREW
69	1	413829	PIVOT ASSEMBLY (UPPER)-SO
70	2	711598	WIRE CLIP
71	1	712175	LOGO, STANLEY
72	1	711463-A	BREAK OUT SWITCH (MAGNET)
73	4	312024960	SCREW, FHM-PH, #10-24 X 3/8 LG
74	1	413795	STILE, TRAILING, SO-RH, 3.531 X 1.750 X .125
75	1	412944	STILE, LEAD, SO-RH, 3.531 X 1.750 X .130
76	1	415052	RAIL, TOP, SO-RH, 5.000 X 1.735 X .093
77	2	708867	BALL DETENT ASSEMBLY
79	1	411709	DOOR HOLDER ASSEMBLY
80	2	312068499	SCREW, FHM-PH, 1/4-20 X 1.0 LG
81	2	713223	RIVNUT
82	1	413830	DAMPER ASSEMBLY
83	1	516744	STEEL TUBE, ASTM A500, 1 1/4 X 1 1/4 X 3/16 X 93 3/16 LG
84	1	516742	STEEL TUBE, ASTM A500, 1 1/4 X 1 1/4 X 3/16 X 93 3/16 LG
85	1	157511	DOOR PANEL, SO - LH
			SAME AS 157510 EXCEPT AS NOTED
86	1	516697	STEEL TUBE, ASTM A500, 1 1/4 X 1 1/4 X 3/16 X 93 3/16 LG
87	1	410101	BOTTOM PIVOT-LH
88	1	413795	STILE, TRAILING, SO-LH, 3.531 X 1.750 X .125
89	1	412944	STILE, LEAD, SO-LH, 3.530 X 1.750 X .130
90	1	415052	RAIL, TOP, SO-LH, 5.000 X 1.735 X .093
91	1		DURA-GLIDE 3000 SINGLE SLIDE
			SAME AS BI-PART EXCEPT AS NOTED
92	1	515193	ADAMS RITE SERIES 1853A SINGLE-ACTION 3-POINT LOCK
93	2	312004960	SCREW, FHM-PH, #8-32 X 3/8 LG

NOTE: ALL EXTRUSIONS  
ARE MADE FROM  
6063-T6 ALUMINUM

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 09-0312-18  
Expiration Date 02-27-2013  
By: *Isaac J. Chui*  
Miami Dade Product Central  
Division

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CL	FLB	9/18/03
2004 FBC	CL	FLB	8/12/05
COUNTY COMMENTS	CL	FLB	12/15/05
REVISE HARDWARE	KL	CL	12/18/07
2007 FBC	KL	CL	03/04/09

05-SAT-0027  
PAGE SCALE: -  
DESCRIPTION:  
STANLEY DWG #413837



ACCESS TECHNOLOGIES  
65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032  
DURA-GLIDE SERIES 3000  
AUTOMATIC SLIDING GLASS DOORS  
(BI-PART, REINFORCED, NON-IMPACT)






















160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT. OF AUTH. #9885  
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

03/05/2009

**EXTRUSIONS**

6063-T6

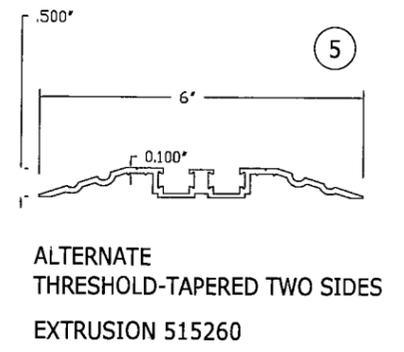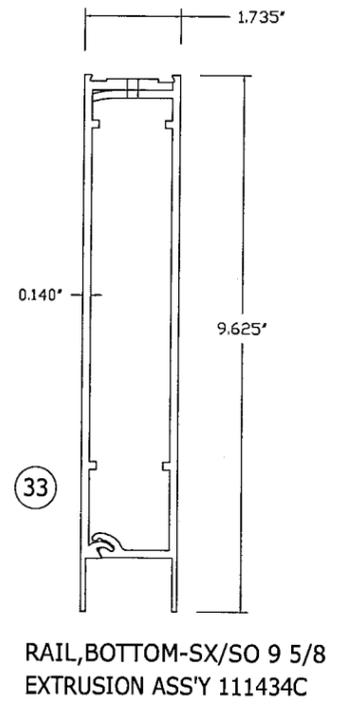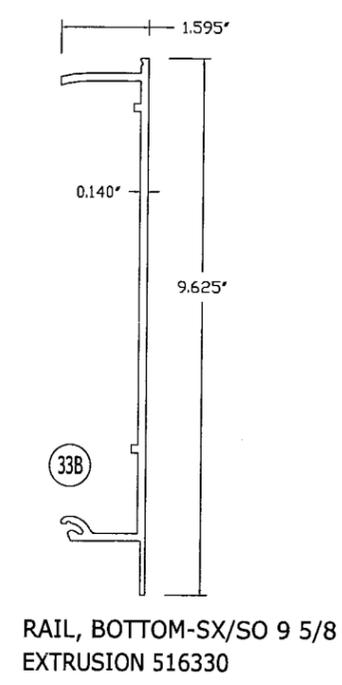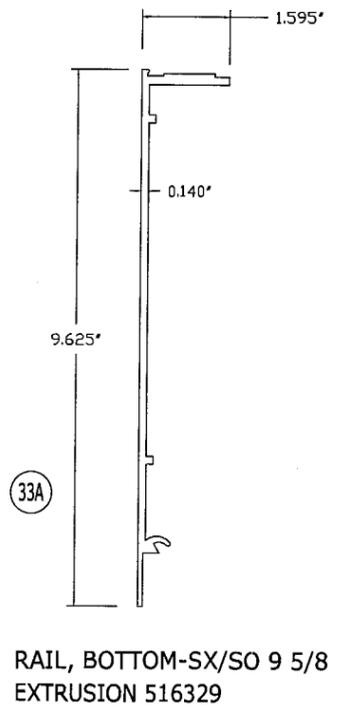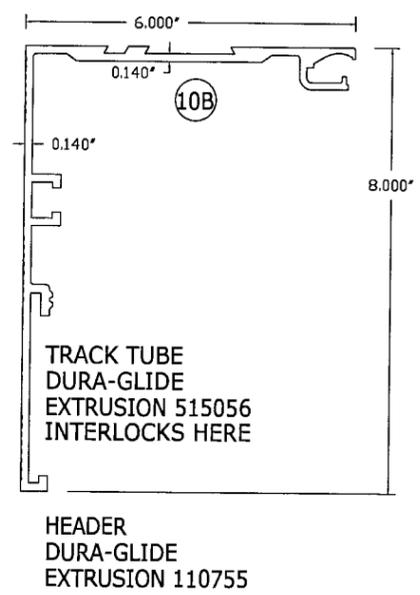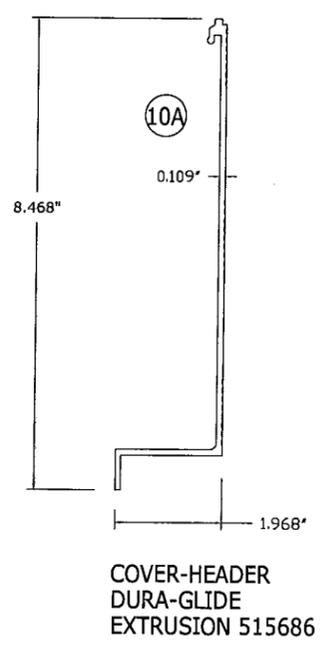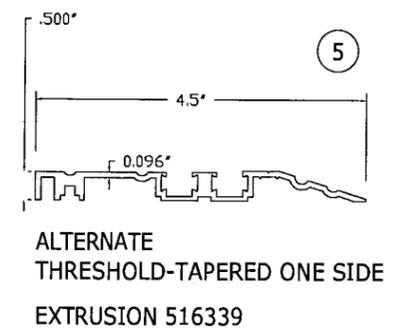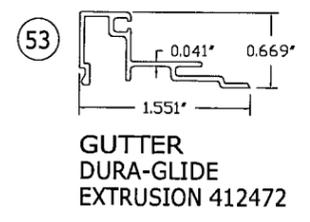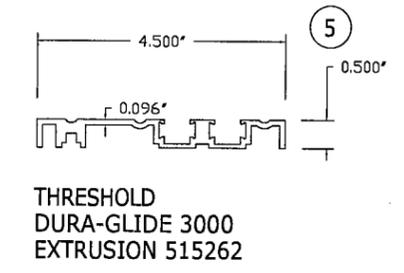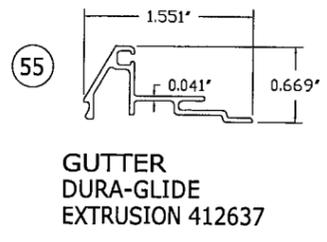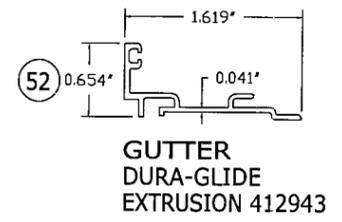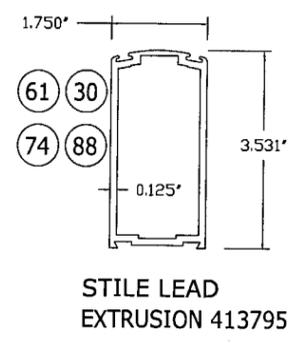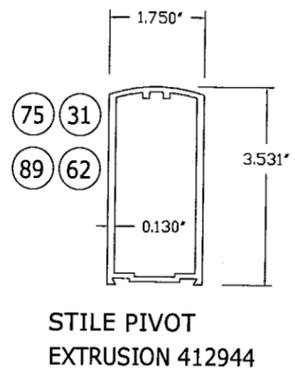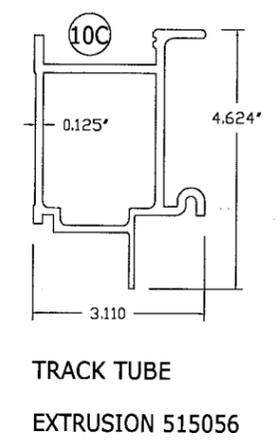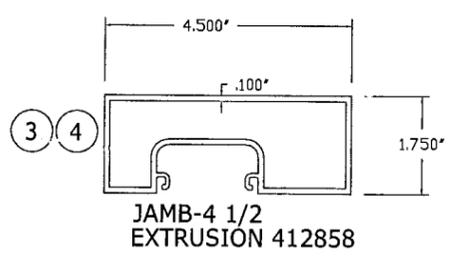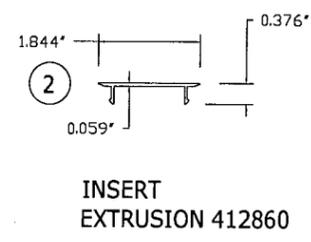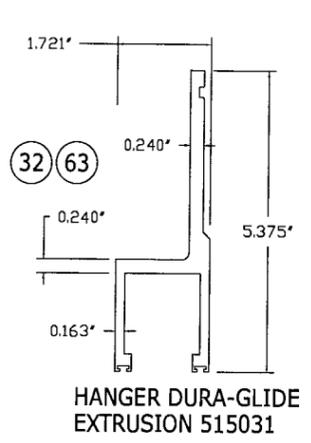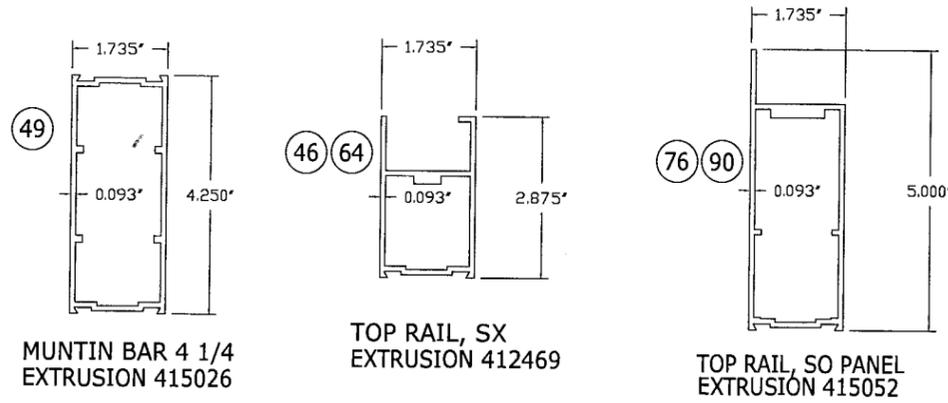

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 Acceptance No 09-0312-18  
 Expiration Date APR 21, 2013  
 By Ismael J. Guerra  
 Miami Dade Product Control Division

FRANK L. BENNARDO, P.E.  
 # PE0046549

03/05/2009

**ENGINEERING EXPRESS**  
 160 SW 12th AVENUE, #106  
 DEERFIELD BEACH, FL 33442  
 PH: (954) 354-0660 FAX: (954) 354-0443  
 WWW.ENGEXP.COM  
 CERT OF AUTH #9885  
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

**STANLEY**  
 ACCESS TECHNOLOGIES  
 65 SCOTT SWAMP ROAD  
 FARMINGTON, CT 06032  
 DURA-GLIDE SERIES 3000  
 AUTOMATIC SLIDING GLASS DOORS  
 (BI-PART, REINFORCED, NON-IMPACT)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CL	FLB	9/18/03
2004 FBC	CL	FLB	8/12/05
COUNTY COMMENTS	CL	FLB	12/15/05
REVISE HARDWARE	KL	CL	12/18/07
2007 FBC	KL	CL	03/04/09

05-SAT-0027  
 PAGE SCALE: -  
 DESCRIPTION:  
 STANLEY DWG #413837

5

F:\01 Project Files\Stanley (SAT)\2005 Jobs\05-SAT-0027 Dura Glide 3000\_Reinf. Non-Impact (NOA).dwg  
 03/05/2009 - 10:03am kelth