



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

AWP, LLC
8130 NW 74th Avenue
Miami, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 6800 Aluminum Horizontal Sliding Window

APPROVAL DOCUMENT: Drawing No. **W96-25**, titled "Series 6800 Alum Horizontal Sliding Window", sheets 1 through 5 of 5, dated 08/01/96 with revision E dated 02/20/09, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 07-0322.07 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Fitz A. Harris, P.E.**

Fitz A. Harris
 1/14/09



NOA No. 09-0316.08
Expiration Date: January 23, 2013
Approval Date: May 6, 2009
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS


1. Drawing No **W996-25**, Sheets 1 through 5 of 5, titled "Series 6800 Alum Horizontal Sliding Window", prepared by Al-Farooq Corporation, dated 08/01/96 with revision E dated 02/20/09, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports:
 - 1) Air Infiltration Test as per TAS 202-94
 - 2) Uniform Static Air Pressure Test as per TAS 202-94
 - 3) Water Infiltration Test as per TAS 202-94
 - 4) Forced Entry Test, per AAMA 1302.5, FBC TAS 202 Sec 12.1 and Sec 1707.4.2, along with installation diagram and marked-up drawings of 1 specimen of a 72" by 63" (XO) aluminum horizontal sliding window with 3/16" Clear Tempered Glass, prepared by Hurricane Engineering & Testing Inc., No. **HETI-06-4008**, dated December 08, 2006, signed and sealed by Humayoun Farooq, P.E.
2. Test reports:
 - 1) Air Infiltration Test as per TAS 202-94
 - 2) Uniform Static Air Pressure Test as per TAS 202-94
 - 3) Water Resistance Test as per TAS 202-94
 - 4) Forced Entry Test as per AAMA 1302.5, FBC TAS 202 Sec 12.1 and Sec 1707.4.2, along with installation diagram and marked-up drawings of 1 specimen of a 96" by 60" (XOX) aluminum horizontal sliding window with 3/16" Clear Tempered Glass, prepared by Hurricane Engineering & Testing Inc., No. **HETI-06-4009**, dated December 08, 2006, signed and sealed by Humayoun Farooq, P.E.

C. CALCULATIONS

1. Revised anchor calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated February 24, 2009, signed and sealed by Humayoun Farooq, P.E.
2. Anchor calculations prepared by Al-Farooq Corporation, dated February 12, 2007, signed and sealed by Humayoun Farooq, P.E.



Fitz A. Harris, P.E.

Product Control Examiner

NOA No. 09-0316-08

Expiration Date: January 23, 2013

Approval Date: May 6, 2009

AWP,LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, dated February 25, 2009, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Letter of Compliance, dated February 24, 2009, signed and sealed by Dr. Humayoun Farooq, P.E.
3. Letter from AWP, LLC, dated 03/10/09, requesting a revision to update to the FBC2007 and company name, signed by Mr. Roberto Perez, AWP, LLC.

G. OTHERS

1. None.




Fitz A. Harris, P.E.

Product Control Examiner


NOA No. 09-0316.08

Expiration Date: January 23, 2013

Approval Date: May 6, 2009

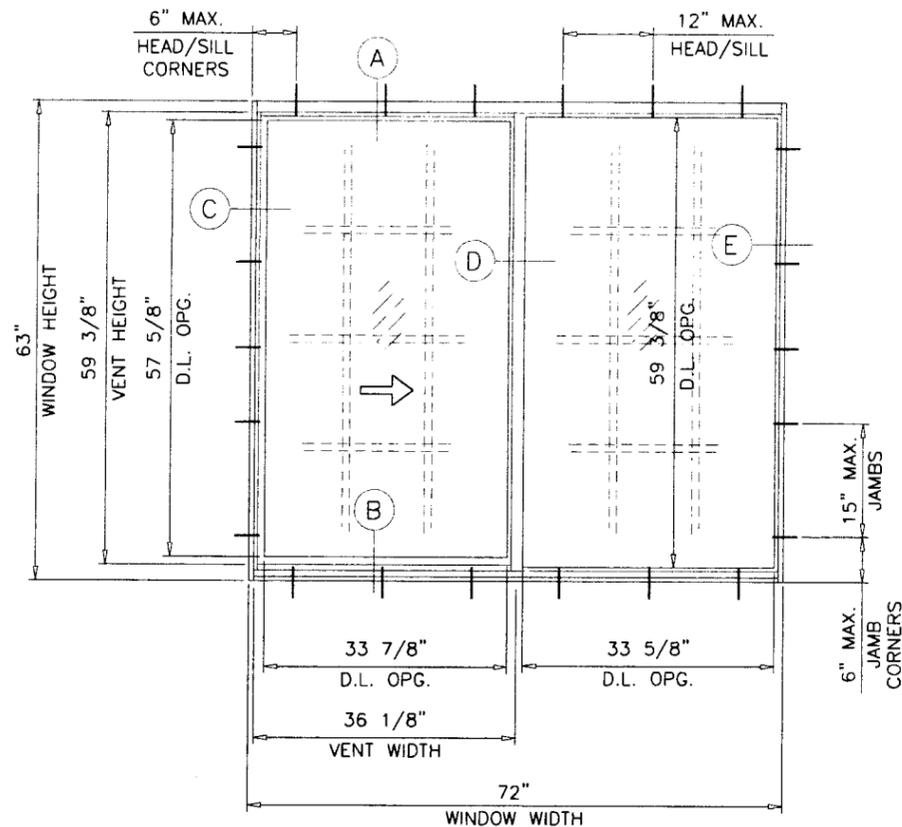

TYPICAL ELEVATION
TESTED UNITS

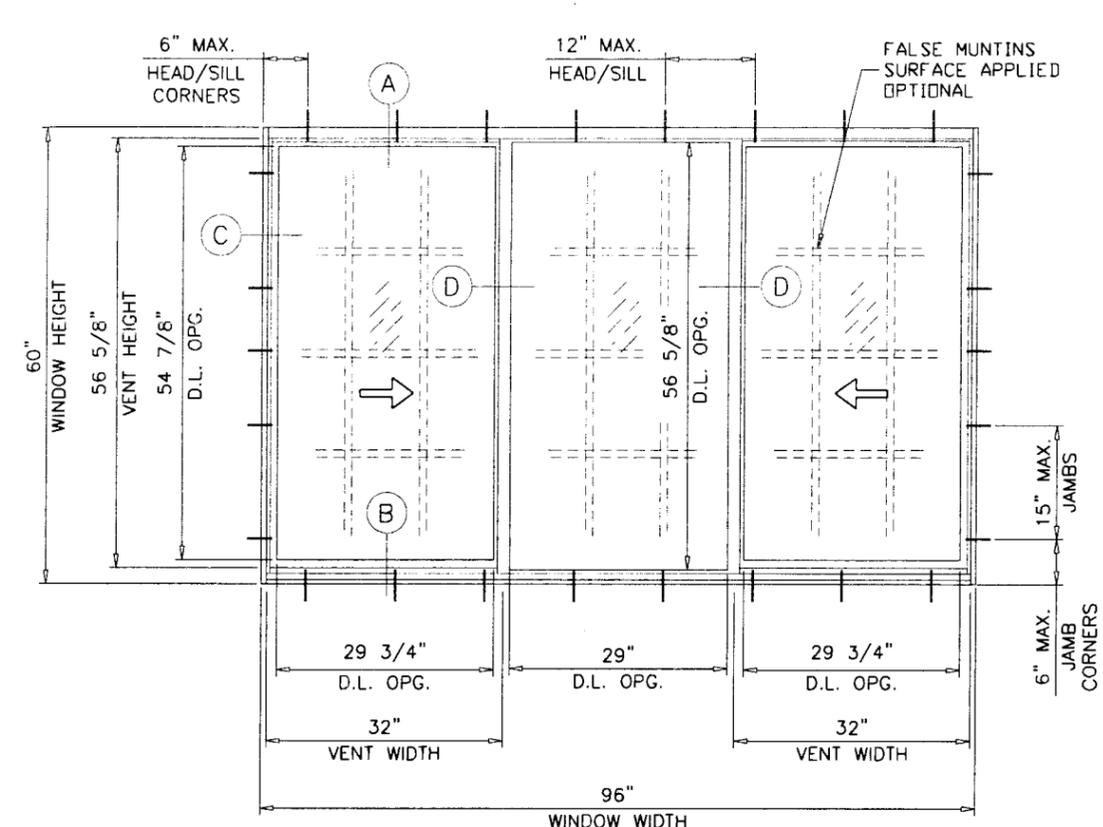

SERIES 6800
ALUMINUM HORIZONTAL SLIDING WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE HORIZONTAL SLIDING WINDOWS, ALSO COMBINATIONS OF H.S./H.S. OR HORIZONTAL SLIDING WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

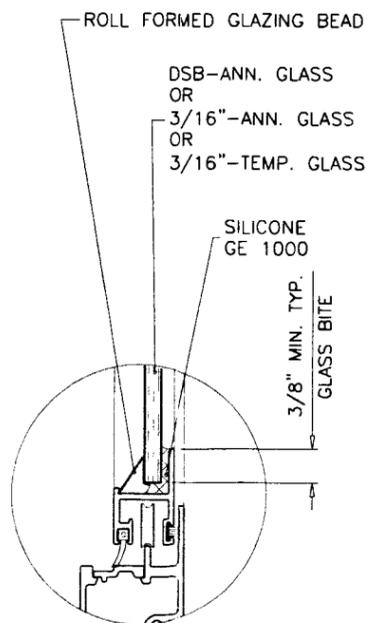

GLAZING OPTIONS

WINDOWS NOT RATED FOR IMPACT.
INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.
INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

MONOLITHIC GLASS
NON IMPACT

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Signature]
MAR 04 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0316.08
Expiration Date 1-23-2013

By *[Signature]*
Miami Dade Product Control
Division

afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W96 - 25AWP

SERIES 6800 ALUM HORIZONTAL SLIDING WDW. (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


no	date	by	description
A	11.13.96	H	JAMBS & MEETING RAILS REV.
B	11.26.96	H	GENERAL REVISION
C	09.04.02	H	GENERAL REVISION
D	01.02.07	H	UPDATED FOR 2004 FBC
E	02.20.09	H	UPDATED FOR 2007 FBC

date:	08-01-96
scale:	1/2" = 1"
dr. by:	HAMID
chk. by:	


drawing no.
W96-25
sheet 1 of 5

DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)								
WINDOW DIMS.		A	DSB ANN. GLASS		3/16" ANN. GLASS		3/16" TEMP. GLASS	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	24"	3	60.0	125.0	60.0	210.0	60.0	210.0
36"		3	60.0	125.0	60.0	210.0	60.0	210.0
48"		4	60.0	104.1	60.0	196.9	60.0	210.0
60"		5	60.0	84.7	60.0	156.9	60.0	210.0
72"		6	60.0	66.9	60.0	127.4	60.0	210.0
24"	36"	3	60.0	125.0	60.0	210.0	60.0	210.0
36"		3	60.0	79.7	60.0	163.5	60.0	179.6
48"		4	60.0	68.6	60.0	126.2	60.0	151.6
60"		5	-	-	60.0	102.8	60.0	138.6
72"		6	-	-	60.0	85.6	60.0	134.7
24"	48"	3	60.0	66.2	60.0	157.7	60.0	173.2
36"		3	45.5	45.5	60.0	113.2	60.0	124.4
48"		4	-	-	60.0	88.8	60.0	101.0
60"		5	-	-	60.0	73.5	60.0	88.2
72"		6	-	-	60.0	66.3	60.0	80.8
24"	60"	3	33.6	33.6	60.0	122.6	60.0	134.7
36"		3	-	-	60.0	86.6	60.0	95.1
48"		4	-	-	60.0	69.0	60.0	75.8
60"		5	-	-	54.5	54.5	60.0	64.7
72"		6	-	-	-	-	53.6	53.6
26-1/2"	26"	3	60.0	125.0	60.0	210.0	60.0	210.0
37"		4	60.0	122.1	60.0	210.0	60.0	210.0
53-1/8"		5	60.0	88.4	60.0	161.7	60.0	210.0
74"		7	60.0	62.7	60.0	113.7	60.0	210.0
26-1/2"	38-3/8"	3	60.0	110.4	60.0	188.9	60.0	207.5
37"		4	60.0	71.8	60.0	147.5	60.0	162.0
53-1/8"		5	-	-	60.0	106.6	60.0	131.0
74"		7	-	-	60.0	78.3	60.0	118.7
26-1/2"	50-5/8"	3	51.2	51.2	60.0	136.3	60.0	149.7
37"		4	37.7	37.7	60.0	103.8	60.0	114.0
53-1/8"		5	-	-	60.0	74.8	60.0	88.0
74"		7	-	-	60.0	61.4	60.0	73.4
26-1/2"	63"	3	26.3	26.3	60.0	106.4	60.0	116.9
37"		4	-	-	60.0	79.9	60.0	85.2
53-1/8"		5	-	-	57.9	57.9	59.6	61.6

A = NO. OF ANCHORS PER HEAD & SILL




XO



OX

DESIGN LOAD CAPACITY - PSF (XOX SIZES)						
WINDOW DIMS.		A	3/16" ANN. GLASS		3/16" TEMP. GLASS	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
72"	24"	6	60.0	197.9	60.0	210.0
84"		7	60.0	169.7	60.0	210.0
96"		8	60.0	146.7	60.0	206.9
108"		9	60.0	127.9	60.0	203.6
72"		36"	6	60.0	126.8	60.0
84"	7		60.0	110.1	60.0	141.7
96"	8		60.0	96.8	60.0	136.4
108"	9		60.0	85.9	60.0	134.7
72"	48"	6	60.0	89.3	60.0	101.0
84"		7	60.0	77.1	60.0	91.7
96"		8	60.0	71.0	60.0	85.3
108"		9	60.0	66.4	60.0	80.8
72"	60"	6	60.0	69.0	60.0	75.8
84"		7	58.2	58.2	60.0	67.8
96"		8	52.4	52.4	60.0	62.0
74"	26"	7	60.0	174.7	60.0	210.0
106-1/4"		9	60.0	120.3	60.0	193.5
111"	10	60.0	114.2	60.0	204.6	
74"	38-3/8"	7	60.0	114.2	60.0	135.9
106-1/4"		9	60.0	82.7	60.0	119.3
111"	10	60.0	78.7	60.0	118.7	
74"	50-5/8"	7	60.0	81.4	60.0	92.4
106-1/4"		9	60.0	63.0	60.0	74.9
111"	10	60.0	61.6	60.0	73.4	
74"	63"	7	60.0	61.7	60.0	65.7

A = NO. OF ANCHORS PER HEAD & SILL

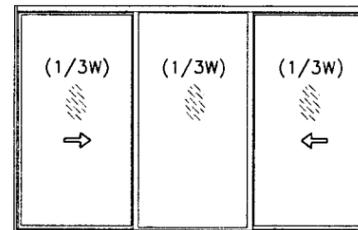


OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

XOX

DESIGN LOAD CAPACITY - PSF (XOX SIZES)						
WINDOW DIMS.		A	3/16" ANN. GLASS		3/16" TEMP. GLASS	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
72"	24"	6	60.0	134.3	60.0	210.0
84"		7	60.0	111.0	60.0	210.0
96"		8	60.0	95.2	60.0	206.9
108"		9	60.0	85.2	60.0	203.6
72"		36"	6	60.0	88.8	60.0
84"	7		60.0	78.3	60.0	146.6
96"	8		60.0	68.4	60.0	142.0
108"	9		59.0	59.0	-	-
72"	48"	6	60.0	68.1	60.0	98.0
74"	26"	7	60.0	119.7	60.0	210.0
106-1/4"		9	60.0	76.5	60.0	193.5
111"	10	60.0	73.1	60.0	204.6	
74"	38-3/8"	7	60.0	82.3	60.0	137.0
74"	50-5/8"	7	60.0	62.8	60.0	89.3

A = NO. OF ANCHORS PER HEAD & SILL

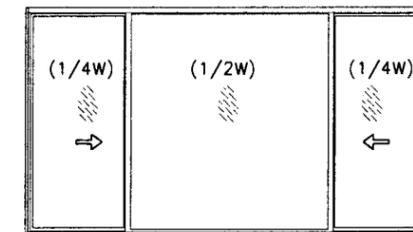

OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH

XOX

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 04 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0316.08
Expiration Date 1-23-2013

By *[Signature]*
Miami Code Product Control
Division





AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANI \ W96 - 25AWP

SERIES 6800 ALUM HORIZONTAL SLIDING WDW. (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


no	date	description
D	01.02.07	H UPDATED FOR 2004 FBC
E	02.20.09	H UPDATED FOR 2007 FBC

date: 08-01-96
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W96-25
sheet 2 of 5

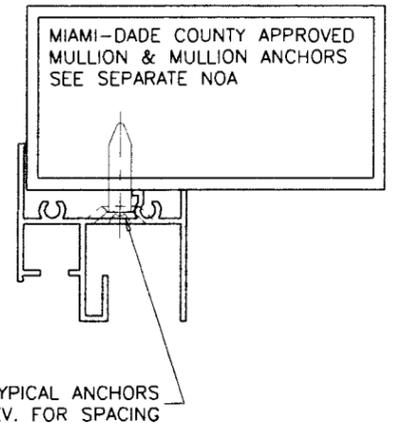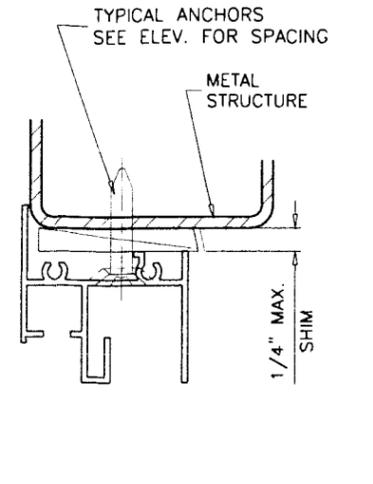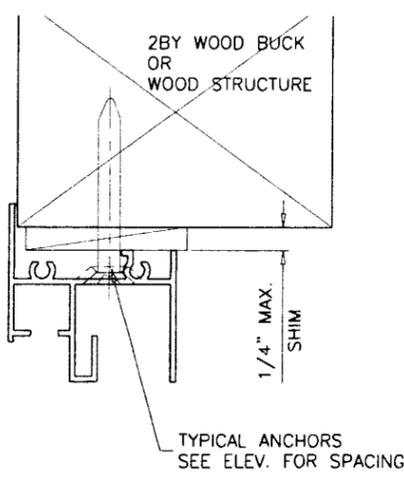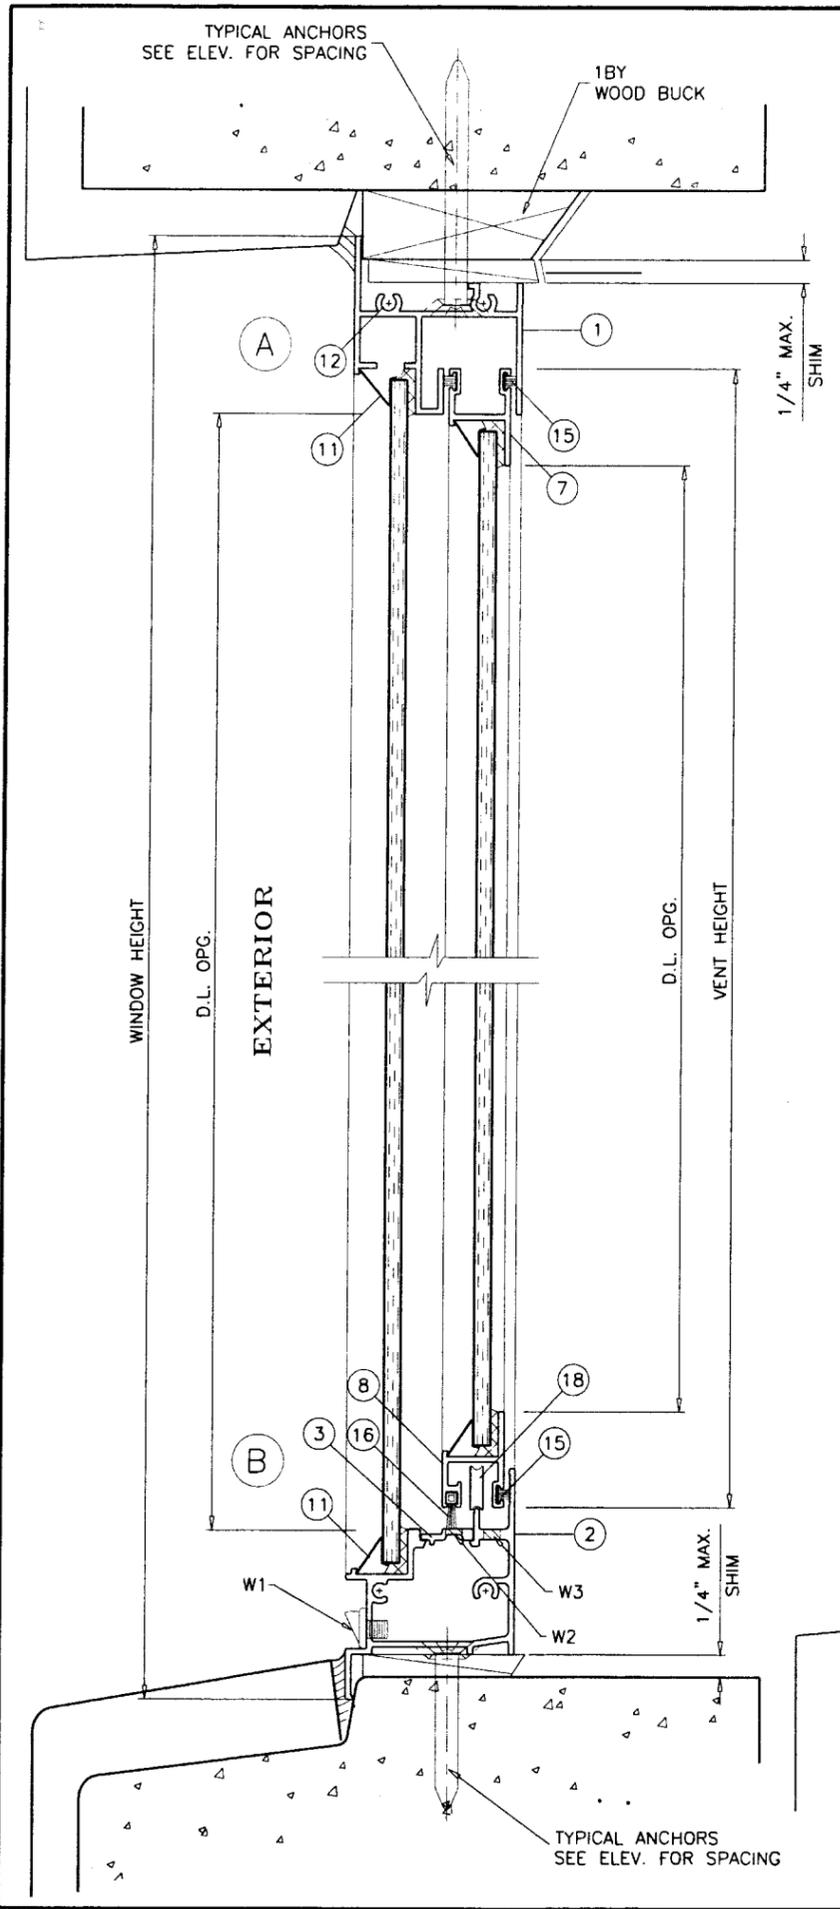

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

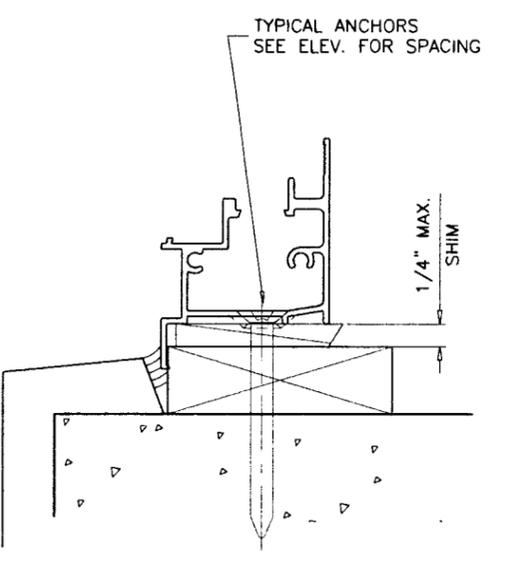

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. TAPCONS BY 'ITW'
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1-1/4" MIN.
 INTO WOOD STRUCTURE = 1/2" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
 MASONRY f'm = 2000 PSI MIN.

SEALANTS:
 FRAME CORNERS AND VENT CORNER SEAMS TO BE SEALED WITH 'SCHNEE MOREHEAD 5504' SEALANT.

WEEPHOLES:
 W1 = 1-5/8" X 1/4" WEEPHOLES AT 6" FROM EACH END WITH PLASTIC BAFFLE.
 W2 = 1/2" X 3/16" WEEP SLOTS, TWO AT 8" O.C. FROM WINDOW CENTERLINE.
 W3 = 1/2" X 3/16" WEEP SLOTS, TWO AT 8" O.C. FROM WINDOW CENTERLINE.

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 MAR 04 2009



PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 09-0516.08
 Expiration Date 1-23-2013
 By *Steve Harris*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W96-25AWP

SERIES 6800 ALUM HORIZONTAL SLIDING WDW. (N.I.)
AWP, LLC.
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
D	01.02.07	H	UPDATED FOR 2004 FBC
E	02.20.09	H	UPDATED FOR 2007 FBC

date: 08-01-96
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W96-25
 sheet 3 of 5

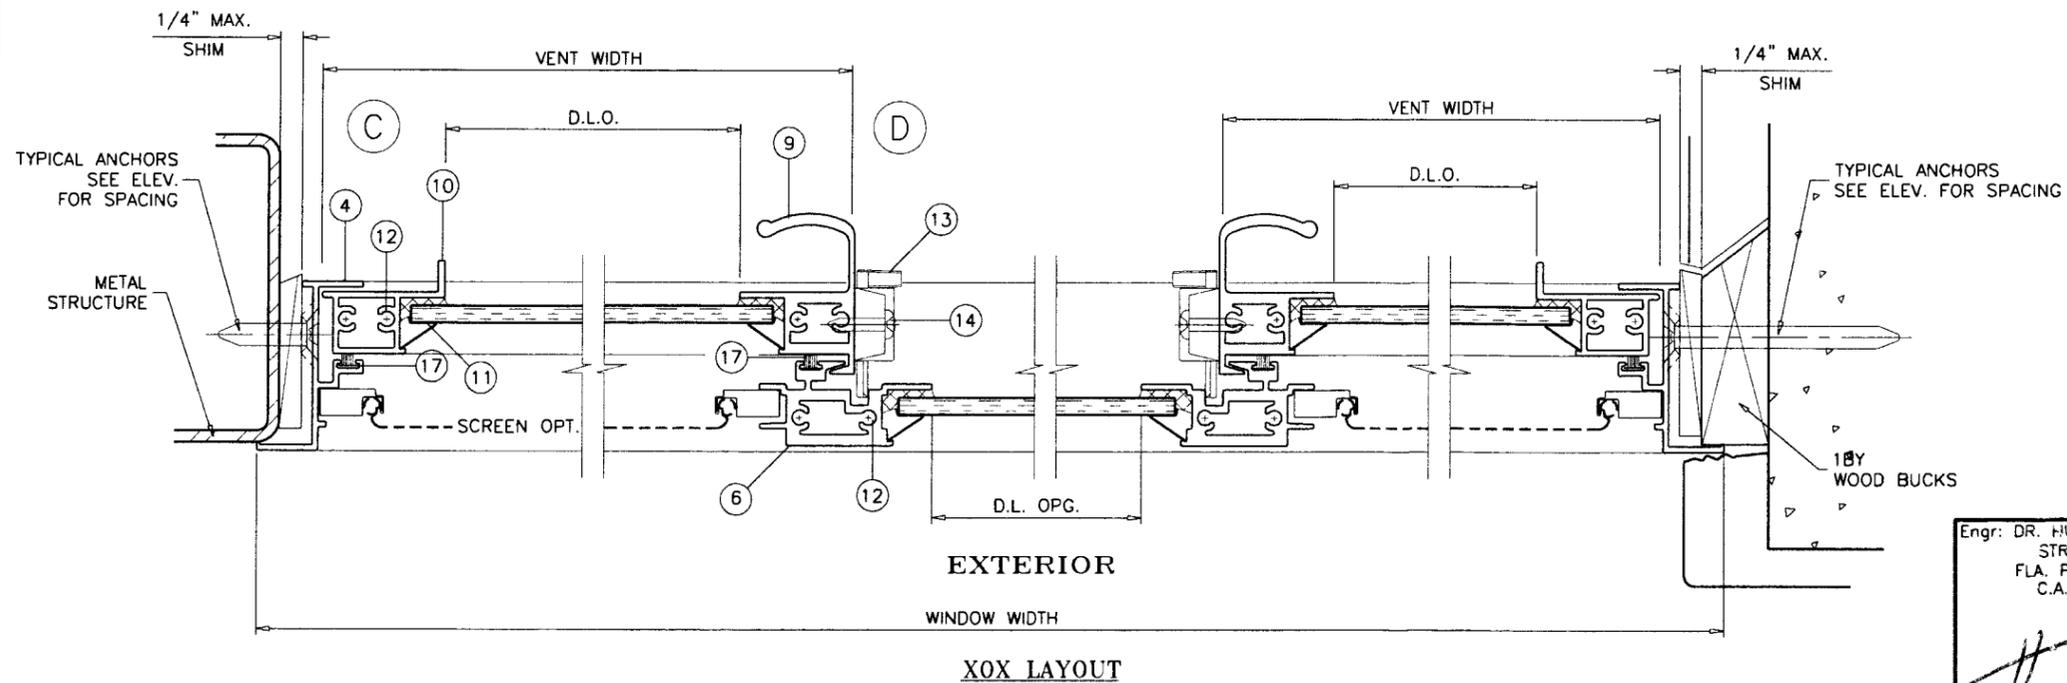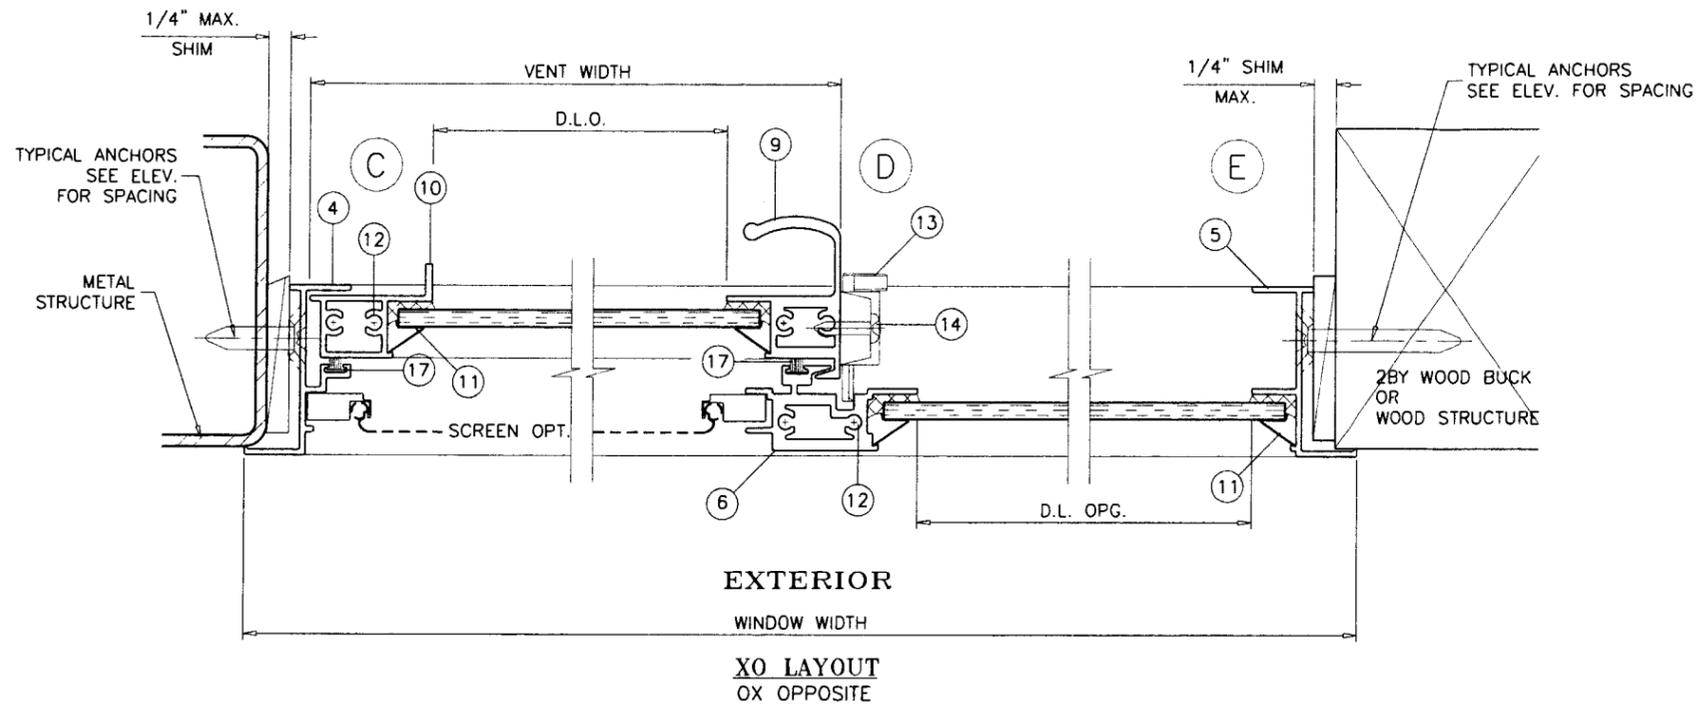

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 04 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0316-08
Expiration Date 1-23-2013

By *Jay Harris*
Miami Gate Product Control
Division


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP -ANL\W96-25AMP

SERIES 6800 ALUM HORIZONTAL SLIDING WDW. (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


no	date	by	description
D	01.02.07	H	UPDATED FOR 2004 FBC
E	02.20.09	H	UPDATED FOR 2007 FBC

08-01-96
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W96-25
sheet 4 of 5

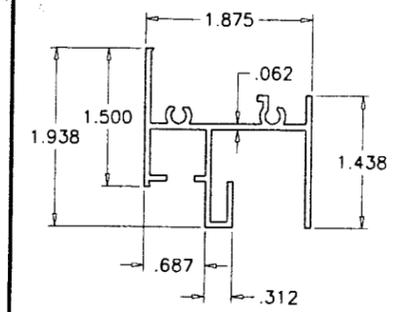


1 FRAME HEAD

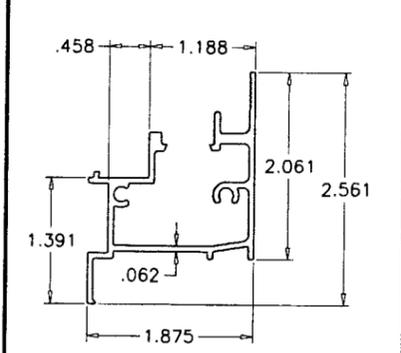


2 FRAME SILL

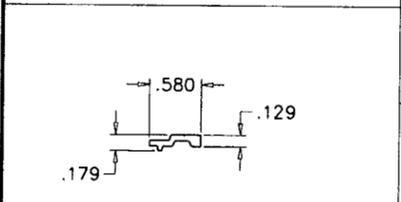


3 SILL INSERT

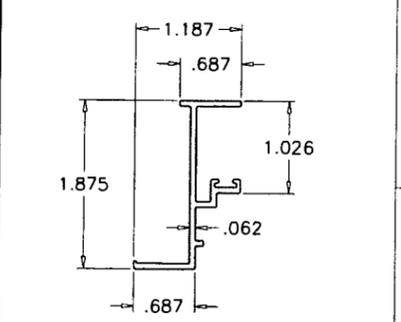


4 FRAME JAMB VENT

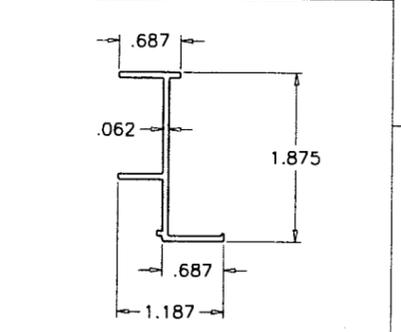


5 FRAME JAMB FIXED

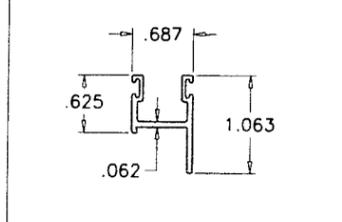


7 VENT TOP RAIL

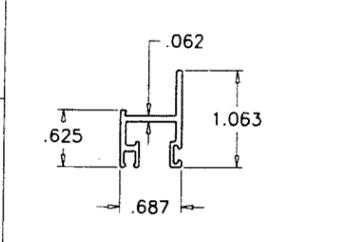


8 VENT BOTTOM RAIL

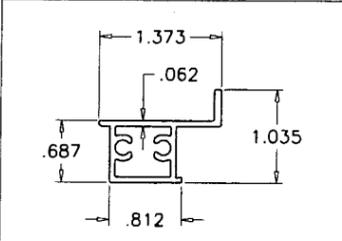


10 JAMB STILE

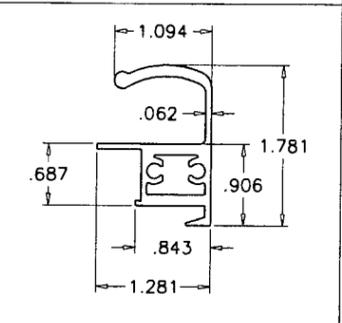


9 MEETING STILE

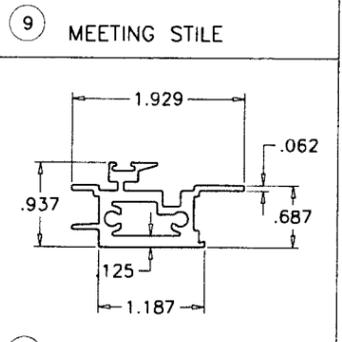

6 FIXED MTG. STILE

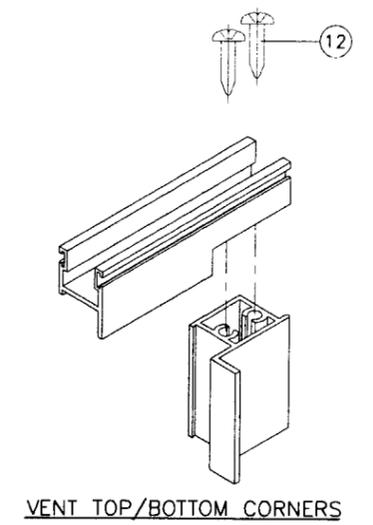


VENT TOP/BOTTOM CORNERS

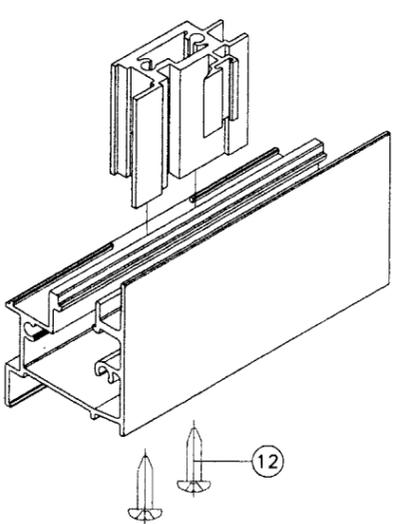


FIXED MTG. RAIL CORNER

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YE-5030	1	FRAME HEAD	6063-T5	-
2	YE-5039	1	FRAME SILL	6063-T5	-
3	YE-5038	AS REQD.	SILL INSERT	6063-T6	-
4	YE-5032	AS REQD.	FRAME JAMB-VENT	6063-T5	-
5	YE-5031	AS REQD.	FRAME JAMB-FIXED	6063-T5	-
6	YE-5037	1/ VENT	FIXED MTG. STILE	6063-T5	-
7	YE-5035	1/ VENT	VENT TOP RAIL	6063-T5	-
8	YE-5034	1/ VENT	VENT BOTTOM RAIL	6063-T5	-
9	YE-5036	1/ VENT	MEETING STILE	6063-T5	-
10	YE-5033	1/ VENT	JAMB STILE	6063-T5	-
11	YB-4	AS REQD.	ROLL FORMED GLAZING BEAD	ALUMINUM	-
12	#10X3/4" SMS	AS REQD.	FRAME & VENT ASSY. SCREW	-	CAD PLATED SMS W/ #8 HEAD
13	YH-6016	1/ VENT	CAM LATCH	ZAMAK	DECO, PLATED OR PAINTED
14	#8X5/8" SMS	2/ LATCH	LATCH INST. SCREW	-	CAD PLATED CRS
15	YH-4004	AS REQD.	FIN SEAL PILE W/ PLASTIC FIN (.187" X .250")	-	ULTRAFAB
16	YH-6006	AS REQD.	FIN SEAL PILE W/ PLASTIC FIN (.115" X .500")	-	ULTRAFAB
17	YH-6007	AS REQD.	FIN SEAL PILE W/ PLASTIC FIN (.229" X .260")	-	ULTRAFAB
18	YH-6001	2/ VENT	ROLLER ASSY.	-	YH-6002 & YH-6003

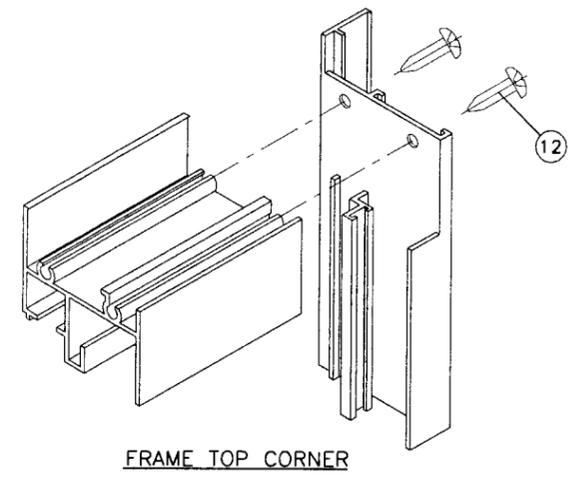

FRAME TOP CORNER

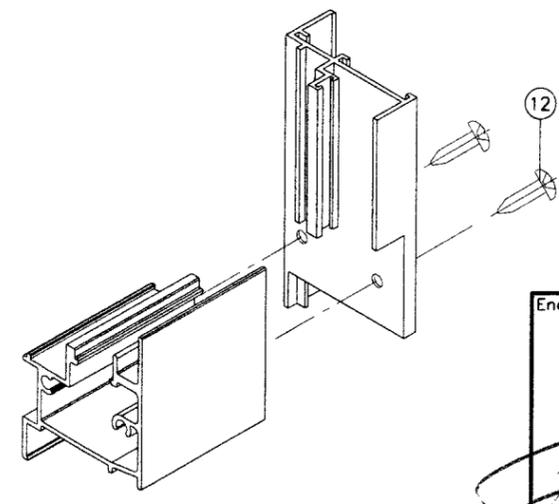

FRAME BOTTOM CORNER

Engr: DR. HUMAYGUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 04 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0316.08
Expiration Date 1-23-2013
By *Fab Hassan*
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
CORPORATE OFFICE: 1235 S.W. 87 AVE, MIAMI, FL 33174

SERIES 6800 ALUM HORIZONTAL SLIDING WDW. (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description
	D	01.02.07	H	UPDATED FOR 2004 FBC
	E	02.20.09	H	UPDATED FOR 2007 FBC

date: 08-01-96
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W96-25
sheet 5 of 5