



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

**Stanley Access Technologies
65 Scott Swamp Road
Farmington, CT 06032**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Dura-Glide 2000/3000" Aluminum Automatic Sliding Glass Door

APPROVAL DOCUMENT: Drawing No. **05-SAT-0025**, titled "series 2000/3000 Dura-Glide Automatic Sliding Glass Door", sheets 1 through 4 of 4 prepared by Engineering Express, dated 10-13-98 and last revised on 07/16/2009, signed and sealed by Frank L. Bernardo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None: Approved shutters complying w/ FBC are required.

Limitations: 1. Not approved, where water infiltration required, unless protected by overhang complying w/ FBC
2. Electrical devices are not part of this approval and must be reviewed by corresponding authority.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 07-0511.03** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



**NOA No 09-0323.24
Expiration Date: December 04, 2011
Approval Date: August 19, 2009**

7/27/09

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturers die drawings and sections.
2. Drawing No. **05-SAT-0025**, titled "series 2000/3000 Dura-Glide Automatic Sliding Glass Door", sheets 1 through 4 of 4 prepared by Engineering Express, dated 10-13-98 and last revised on 07/16/2009, signed and sealed by Frank L. Bennardo, P.E.

Note: This revision consists of extrusion part numbers & addition of cluster anchors and compliance to FBC 2007.

B. TESTS (*Transferred from NOA# 07-0511.03*) Original test conducted per SFBC, PA 201, -94 now termed as TAS 202-94

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94 (Not Performed)
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

Along with installation diagram of an automatic aluminum sliding glass door with fixed panels, prepared by Fenestration Testing Laboratory Test Report No. FTL1179, dated 11-03-1995, signed and sealed by Yamil Kuri, P.E.

2. Additional verification test report # FTL 5098 (06214) dated 02/02/2007, issued by Fenestration Testing Lab, signed and sealed by Michael Wenzel, P.E.

C. CALCULATIONS

1. Anchor Verification Calculations, complying w/ FBC-2007, dated 03-11-2009, prepared, signed and sealed by Frank L. Bennardo, P. E.
2. Glazing complies with ASTM E-1300-02 & -04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. None

F. STATEMENTS

1. Statement letter of anchor verification compliance to FBC-2007, dated March 12, 2009, signed and sealed by Frank L. Bennardo, P. E.
2. Statement letter of conformance and "no financial interest", dated 03-12-2009, signed and sealed by Frank L. Bennardo, P.E.

G. OTHER

1. This NOA revises NOA # **07-0511.03**, expiring December 04, 2011.



Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 09-0323.24
Expiration Date: December 04, 2011
Approval Date: August 19, 2009

DURA-GLIDE 2000/3000 NON-REINFORCED BI-PART AUTOMATIC SLIDING GLASS DOOR NON-IMPACT RESISTANT

FRANK L. BENNARDO, P.E.
#PE0046549

07/16/2009


ANCHOR TYPE

- IN CONCRETE (3000 PSI MIN): $\phi 1/4"$ POWERS PERMASEAL TAPPER WITH 1 1/2" MIN EMBED AND 3" MIN EDGE DISTANCE
- IN A36 STEEL ($3/16"$ MIN THICKNESS): 1/4-20 SMS SAE GRADE 5 OR BETTER
- IN WOOD (G=0.55 MIN): #14 WOOD SCREW WITH 1 1/2" MIN EMBED AND 3" MIN EDGE DISTANCE
- (NOTE: MINIMUM 2X4 WOODBUCK FOR WOOD SCREWS)

ANCHOR SPACING

- SILL: DOUBLE ROW, 4" FROM EACH CORNER WITH REMAINDER SPACED AT 9" O.C.
- HEAD: SINGLE ROW, 6" FROM EACH CORNER WITH REMAINDER SPACED AT 16" O.C.
- JAMBS: SINGLE ROW, 6" FROM EACH CORNER WITH REMAINDER SPACED AT 17" O.C.


INTERIOR "SX"



EXTERIOR

ADAMS RITE 1853A 3-PLY THROW BOLT KEY OPERATED ON EXTERIOR THUMB TURN ON INTERIOR

5

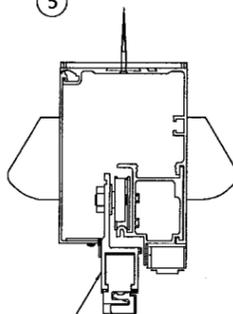

2" X 2" X 3/8" OPEN CELL FOAM PAD




6

PACKAGE HEIGHT INFORMATION FOR SURFACE APPLICATIONS

PKG HT	MASONRY OPG	CAULKING ALLOWANCE	ACTUAL CLEAR OPG UNDER HEADER
92"	92 1/4"	1/4"	82 1/2"

PACKAGE WIDTH INFORMATION

DOOR PKG	PKG WIDTH	SLIDING DOOR OPENING	(SX) DOOR WIDTH	(SO) DOOR WIDTH	DOOR TRAVEL	MASONRY OPENING	CAULKING ALLOWANCE
9-3372	168"	72"	42 5/16"	42 5/16"	36"	168 1/2"	1/4" / SIDE

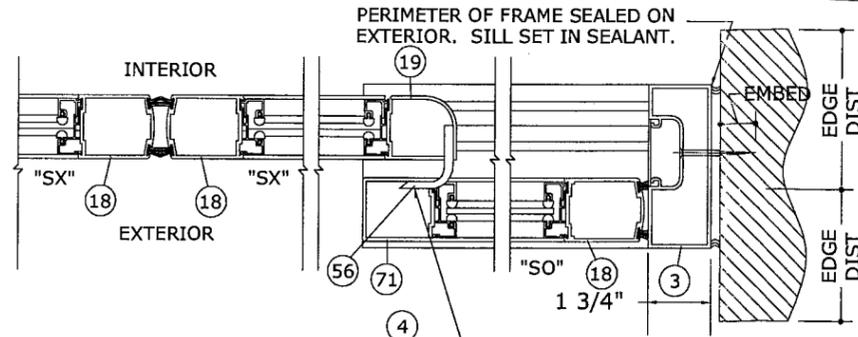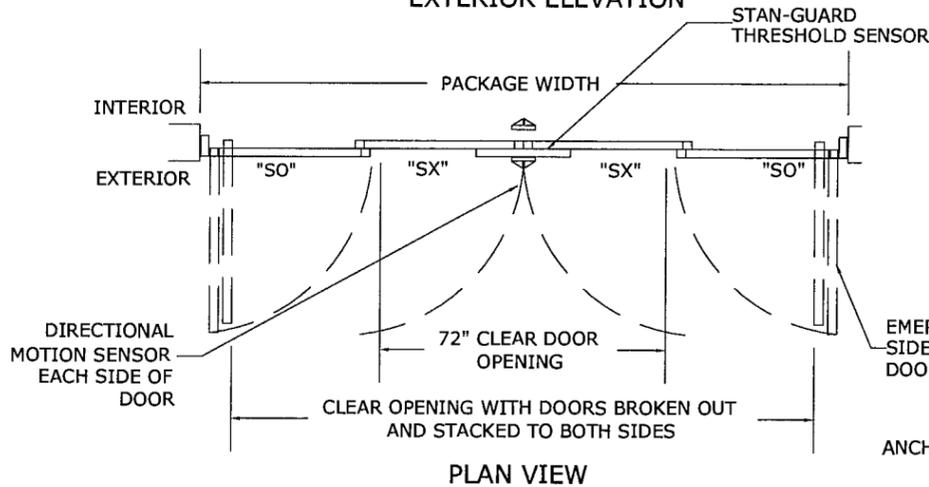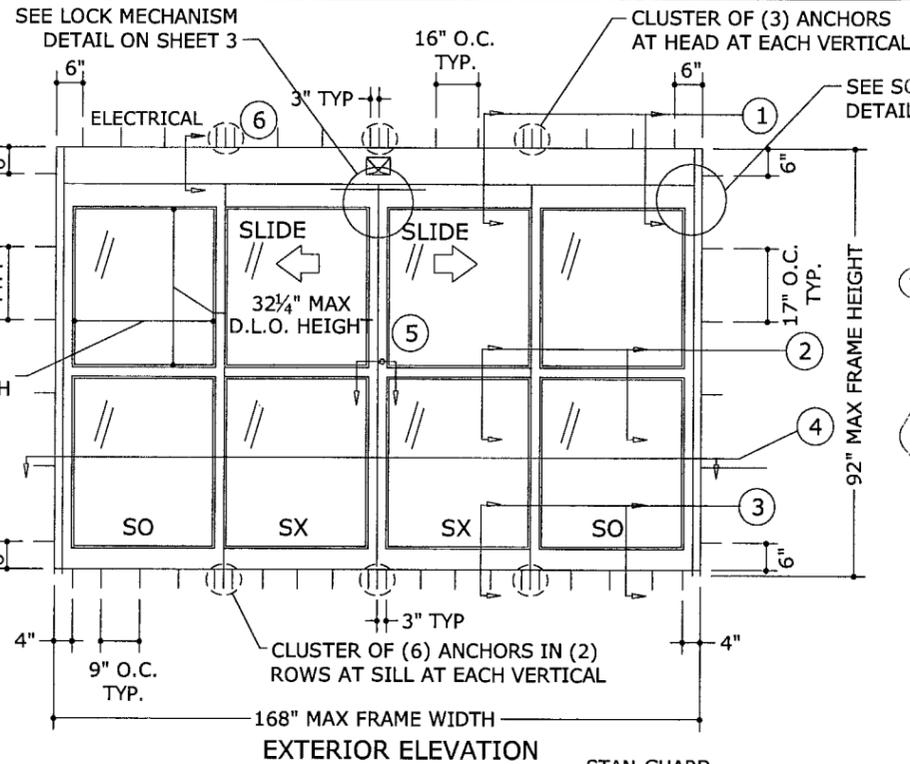

*INCLUDES 1/2" THRESHOLD WHEN RECESSING PACKAGE DEDUCT 1/2"

1 3/4" X 2 1/8" LONG X 3/16" EXTRUDED ALUMINUM APPLIED INTERLOCK SECURED WITH (2) #10-32 X 3/8 LONG FLAT HEAD SCREWS

POSITIVE DESIGN PRESSURE	+47.8 PSF
NEGATIVE DESIGN PRESSURE	-47.8 PSF

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN TESTED & DESIGNED IN ACCORDANCE WITH THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE- HIGH VELOCITY HURRICANE ZONE (HVHZ) - AND MIAMI-DADE PROTOCOLS TAS 202 AS A NON-IMPACT RESISTANT SYSTEM.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR $C_d=1.6$ HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE & NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. WHERE SITE CONDITIONS DIFFER FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
5. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND ADDITIONAL IMPOSED LOADS. WOOD BUCKS NOT BY THIS PRODUCT MANUFACTURER SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE HOST STRUCTURE.
6. THE PRODUCT DETAILED HEREIN HAS BEEN DESIGNED AND TESTED TO THE MAXIMUM SPANS & LOADS SHOWN ON THESE DRAWINGS. REFERENCE FTL TEST REPORT #5098.
7. ALL ALUMINUM PARTS ARE 6063-T6 ALUMINUM.
8. GLAZING: 1/4" TEMPERED GLASS.
9. ALL UNITS SHALL BE INSTALLED WITH MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS FOR ALL INSTALLATIONS.
10. CORNER PANEL CONSTRUCTION: PANEL CORNERS ARE BUTT JOINTED, SECURED W/ (4) FULL-WIDTH 5/16" THREADED TIE RODS AT TOP RAIL, INTERMEDIATE HORIZONTAL MUNTIN BAR AND BOTTOM RAIL.
11. GLAZING MATERIAL IN BOTH FIXED & SLIDING PANELS OF ALL SLIDING DOORS SHALL COMPLY WITH THE REQUIREMENTS IN THE PERFORMANCE SPECIFICATIONS & METHODS OF TEST FOR SAFETY GLAZING MATERIALS USED IN BUILDINGS.
12. ANCHORS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS, SPACED AS NOTED HEREIN. ANCHOR EMBEDMENT TO BASE MATERIAL DOES NOT INCLUDE WALL DRESSING OR STUCCO.
13. ALL BOLTS & WASHERS SHALL BE ZINC COATED, GALVANIZED, OR STAINLESS STEEL WITH A MINIMUM TENSILE STRENGTH OF 60 KSI, EXCEPT INSTALLATION ANCHORS.
14. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR COATED.
15. ANY ELECTRICAL COMPONENTS ARE NOT PART OF THIS APPROVAL.

LICENSED AFFILIATE OF
ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGP.COM
CERT OF AUTH #885

STANLEY
ACCESS TECHNOLOGIES
65 SCOTT SWAMP ROAD
FARMINGTON, CT 06032
DURA-GLIDE SERIES 2000 & 3000
AUTOMATIC SLIDING GLASS DOORS
(BI-PART, NON-REINFORCED, NON-IMPACT)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE			10/13/98
2004 FBC	AML	FLB	08/24/05
COUNTY COMMENTS	AML	FLB	08/29/05
BBCC COMMENTS	RKB	CL	08/15/07
2007 FBC - COMMENTS	RKB	FLB	07/15/09

05-SAT-0025

PAGE SCALE: -
DESCRIPTION:


PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 09-0323-24
Expiration Date DEC 04, 2011
By Ishaq J. Chaudhry
Miami Dade Product Control Division

BILL OF MATERIALS


ITEM	QTY	PART NUMBERS / DIE NUMBERS	DESCRIPTION
1	1	313878	DURA-GLIDE 2000/3000 BI-PART NON-IMPACT
2	2	412860	JAMB INSERT
3	1	157537	JAMB ASSEMBLY, 4.500 X 1.750 X .100
4	1	157538	JAMB ASSEMBLY, 4.500 X 1.750 X .100
5	1	515260	THRESHOLD
	1	516339	THRESHOLD
	1	515262	THRESHOLD
	1	516340	THRESHOLD
6	1	-	HEADER ASSEMBLY
6A	1	515686	HEADER COVER, 8.468 X 1.968 X .109
6B	1	110755	HEADER, 8.000 X 6.000 X .140
6C	1	515056	HEADERTRACK TUBE, 4.624 X 3.110 X .125
7	1	110937-1	DOOR PANEL ASSY, SX - RH
8	1	157655-1	HANGER -SX, RH
9	4	380257499	NUT-HEX-JAM 3/4-10
10	2	412406	ROLLER ASSY-ANTI RISER
11	2	711627	PLATE-BACK UP
12	1	411622	DETENT ASSY-SX- HANGER PORTION
13	7.031	411628	PILE, ADHESIVE BACKED
14	1	515700	PIVOT ASSY-SX DURA GLIDE
15	0.002	708135	SEALANT-LOCTITE 242
16	2	515190	CAP-END-HANGER-DK BZ
17	2	312010000	SCREW,FHM-PH 8-32 X 7/8
18	1	157550	STILE-RH LEADING SX
19	1	157552	STILE-RH PIVOT SX
20	1	157566-2	RAIL-TOP-SX
21	1	157526	RAIL-BOTTOM SX/SO PANEL
22	50.188	706812	WEATHERSTRIP-GLASS STOP
23	1	412700-1C	BRUSH, BOTTOM SWEEP
24	1	413805	HOLDER-SWEEP
25	1	516699-3	DETENT,NARROW STD(RH) & MED W/A CTRL (RH)
26	1	515265	GUIDE ASSY-BOTTOM-3000
27	6.74	411624	PILE, ADHESIVE BACKED
28	13.479	411624-1	PILE, NON-ADHESIVE BACKED
29	4	706233	NUT-HEX-FLANGED-5/16-18
30	2	711474	NUT-TIE ROD 5/16-18
31	2	711475	WASHER, TIE ROD
32	4	412479	CLIP, GUIDE
33	1	709221	THUMBTURN-LOCK
34	2	710241	PLUG-HOLE
35	3.516	713050	PILE-HANGER
36	4	347133000	SCREW,HS-FL-SK 3/8-16 X 1/2
37	2	312004960	SCREW,FHM-PH 8-32 X 3/8
38	4	713321-1	SCREW,PF 10-32 X 1/2 SS
39	2	351801499	SCREW,SHC-SK 1/4-20 X 3/8
40	1	412407	STANDOFF-.327ID .562OD .640L
41	1	353365000	SCREW,SHM-SK 5/16-18 X 1 1/2
42	1	351248499	SCREW,HHM- 5/16-18 X 1
43	1	382023499	WASHER, PLAIN 3/8 ID X 7/8 OD
44	1	380901499	NUT-HEX JAM 5/16-18 ZINC
45	2	710888	SCREW,FHM-PH 1/4-20 X .592
46	2	412638	DECAL CAUTION AUTO SLIDING DOOR
47	2	411499	WHEEL ASSY-LOAD
48	1	111916-1	RAIL-INTERMEDIATE-2" NOM PROFILE
50	2	412472	GLASS STOP, SQUARE EXTRUSION SHORT
51	2	707807	GLASS STOP, SQUARE EXTRUSION LONG
53	4	412637	GLASS STOP, BEVELED EXTRUSION LONG
54	4	412569	GLASS STOP, BEVELED EXTRUSION SHORT
55	1	711483	GROUP-TIE ROD 5/16" DIA
56	2	711568	HOOK-SECURITY CLEAR

57	1	110935-1	DOOR PANEL ASSY, SX - LH, (SAME AS 110937-1)
58	1	157551	STILE-LH PIVOT SX
59	1	157566-1	RAIL, TOP - SX
60	1	516699-4	DETENT, NARROW STD (LH) & MED W/A CTRL (LH)
61	1	157549	STILE-LH LEADING SX
62	2	312251960	SCREW,FHM-PH 10-32 X 1/2
63	1	516692	ASSY STRIKE PLATE
64	1	ZIN PG01-170063-1	PANEL ASSY-LHSX-RECESSED EXIT DEVICE-A/C
65	2	320821960	SCREW-T/F-FLH-REC-#10-32 X 3/4
66	2	415020-1	BRACKET-CLIP-MACHINING
67	4	713190	SCREW-SELF DRILLING #10 X5/8
68	2	713974	SPACER-NYLON
69	1	110926-1C	DOOR PANEL ASSY, SO -RH, (SAME AS 110937-1)
70	1	157555	STILE-PIVOT SO
71	1	157554	STILE-RH LEADING SO
72	5	157601-2	RAIL-TOP-SO
73	1	410100	PIVOT ASSY-SO-RH-LOWER
74	1	413829	PIVOT ASSY-RH
75	2	708867	DETENT BALL ASSY
76	1	711463-A	MAGNET BREAKOUT SWITCH
77	1	411709	HOLDER ASSY-DOOR
83	1	110925-1C	DOOR PANEL ASSY, SO -LH, (SAME AS 110926-1C)
84	1	157601-1	RAIL-TOP-SO
85	1	157553	STILE-LH LEADING SO
86	1	410101	PIVOT ASSY-LH-SO-LOWER
86	1	413828	PIVOT ASSY-LH
87	1	-	ADAMS RITE SERIES 1853A SNGL. ACT. 3-POINT LOCK

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0323-24
 Expiration Date DEC 04, 2011
 By Ishag I. Chavala
 Miami Dade Product Control
 Division

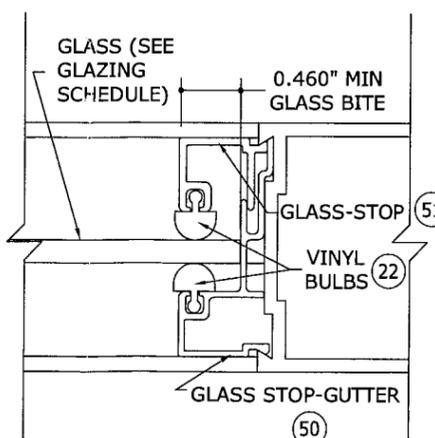

VERTICAL GLAZING DETAIL

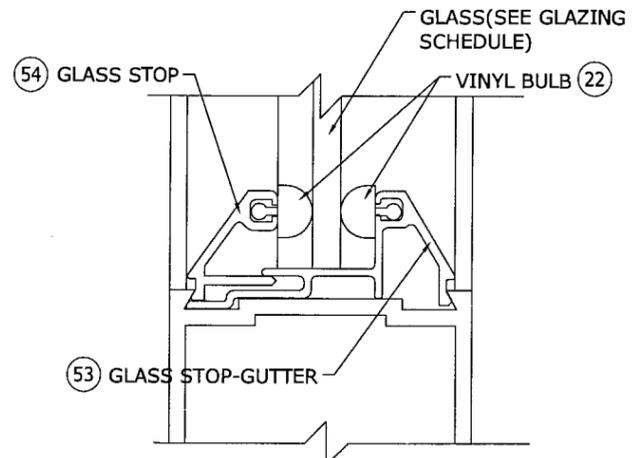

HORIZONTAL GLAZING DETAIL

GLAZING SCHEDULE
 1/4" TEMPERED GLASS
 PANELS ARE INTERIOR GLAZED WITH 0.460" GLAZING PENETRATION.

FRANK L. BENNARDO, P.E.
 # PE0046549

07/16/2009

LICENSED AFFILIATE OF
ENGINEERING EXPRESS
 160 SW 12th AVENUE, # 106
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0443
 WWW.ENGEXP.COM
 CERT. OF AUTH #888

STANLEY
 ACCESS TECHNOLOGIES
 65 SCOTT SWAMP ROAD
 FARMINGTON, CT 06032
 DURA-GLIDE SERIES 2000 & 3000
 AUTOMATIC SLIDING GLASS DOORS
 (BI-PART, NON-REINFORCED, NON-IMPACT)


REMARKS	DRWN	CHKD	DATE
INIT ISSUE	-	-	10/13/98
2004 FBC	AML	FLB	08/24/05
COUNTY COMMENTS	AML	FLB	08/29/05
BBCO COMMENTS	RKB	CL	06/15/07
2007 FBC-COMMENTS	RKB	FLB	07/15/09

05-SAT-0025


PAGE SCALE: -
 DESCRIPTION:

F:\01 Project Files\Stanley (SAT)\2005 Jobs\05-SAT-0025 Dura Glide 2-3000, Non-Reinf, Non-Impact (NOA)\05-SAT-0025_02d Dura Glide.dwg 07/16/2009 - 3:49pm rbarlett

07/16/2009 - 3:50pm rbarlett F:\01 Project Files\Stanley (SAT)\2005 Jobs\05-SAT-0025 Dura Glide 2-3000, Non-Reinf. Non-Impact (NOA)\05-SAT-0025_02.d Dura Glide.dwg

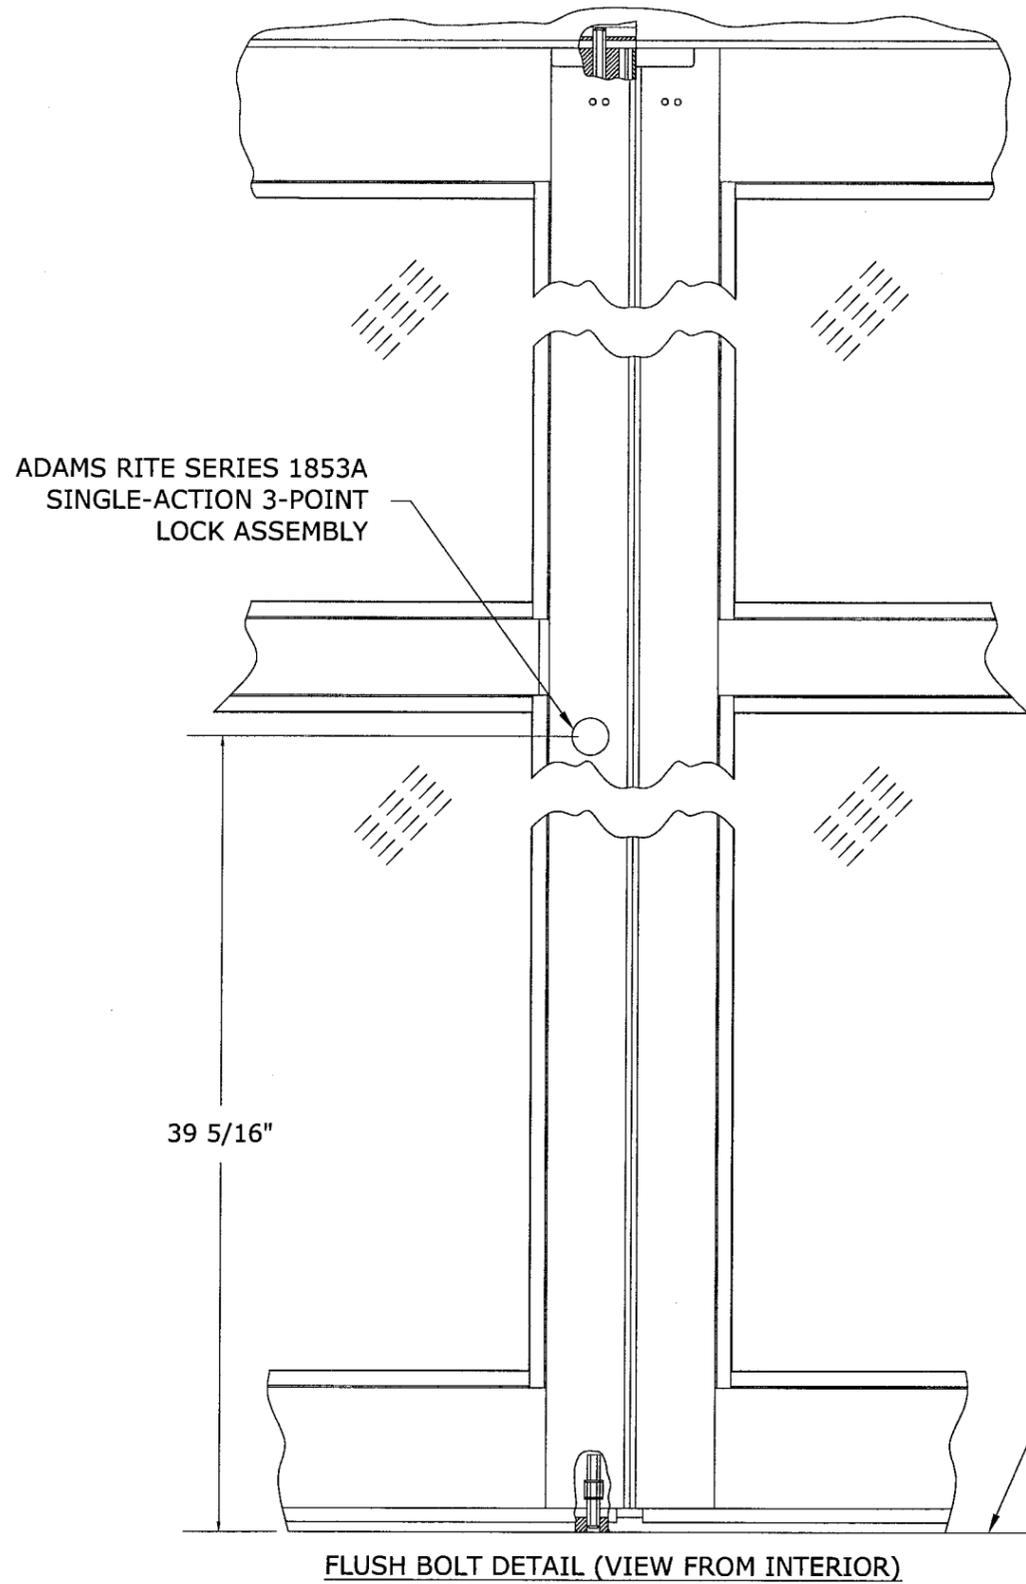

FLUSH BOLT DETAIL (VIEW FROM INTERIOR)

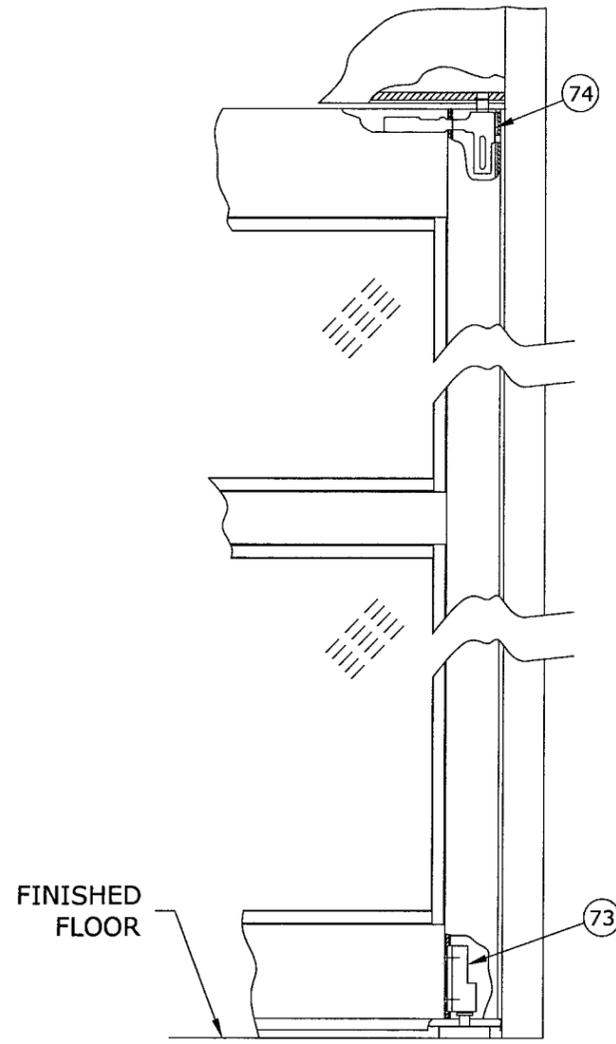

PIVOT DETAIL SO PANEL

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0323-24
 Expiration Date DEC 04, 2011
 By Iskay I. Chant
 Miami Dade Product Control
 Division

FRANK L. BENNARDO, P.E.
 # PE0046549

07/16/2009

LICENSED AFFILIATE OF
ENGINEERING EXPRESS
 160 SW 12th AVENUE, # 106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0443
 WWW.ENGEXP.COM
 CERT OF AUTH #8885

STANLEY
 ACCESS TECHNOLOGIES
 65 SCOTT SWAMP ROAD
 FARMINGTON, CT 06032
 DURA-GLIDE SERIES 2000 & 3000
 AUTOMATIC SLIDING GLASS DOORS
 (BI-PART, NON-REINFORCED, NON-IMPACT)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	-	-	10/13/98
2004 FBC	AML	FLB	08/24/05
COUNTY COMMENTS	AML	FLB	08/29/05
BBCO COMMENTS	RKB	CL	08/15/07
2007 FBC - COMMENTS	RKB	FLB	07/15/09

05-SAT-0025

PAGE SCALE: -
 DESCRIPTION:


EXTRUSIONS

NOT TO SCALE (6063-T6)

FRANK L. BENNARDO, P.E.
PE0046549


07/16/2009

48

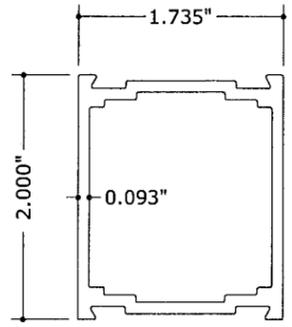


MUNTIN BAR 2.0"
EXTRUSION 412741

20 59

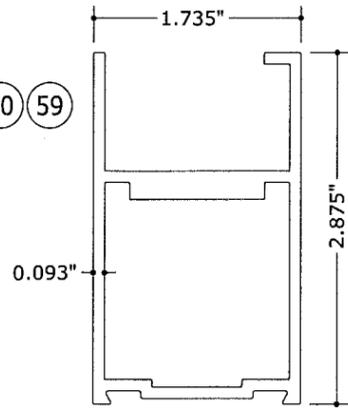


TOP RAIL, SX
EXTRUSION 516643

72 84

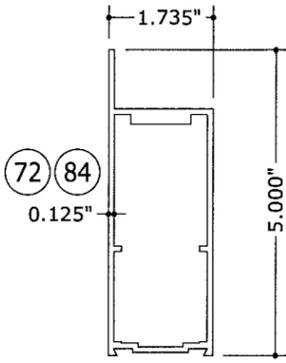


TOP RAIL PANEL
EXTRUSION 415052

8

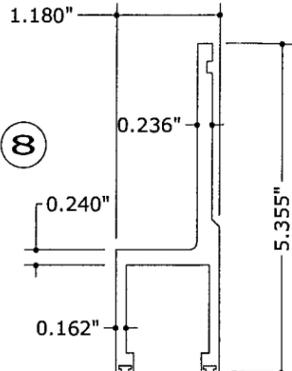

HANGER DURA-GLIDE
EXTRUSION 515031


53

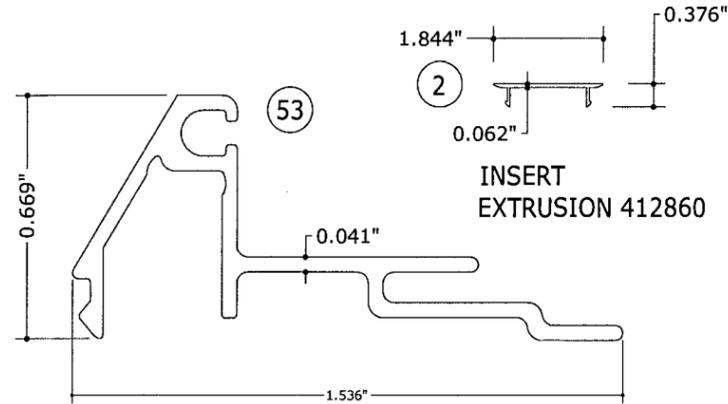

GLASS STOP
EXTRUSION 412637


INSERT
EXTRUSION 412860

6C

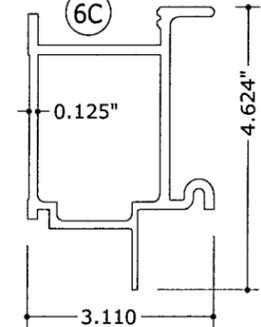


TRACK TUBE
EXTRUSION 515056

19 58

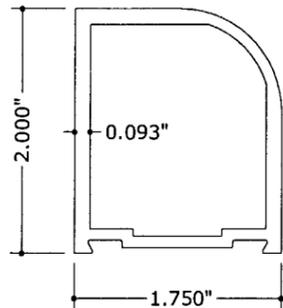


STILE
EXTRUSION 412468

18 61

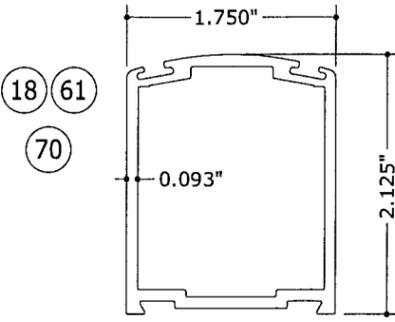


STILE
EXTRUSION 412467

71 85

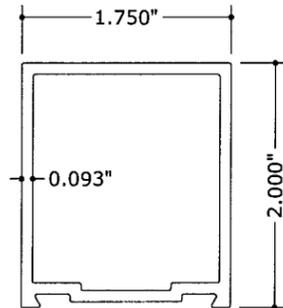


STILE
EXTRUSION 412476

3 4

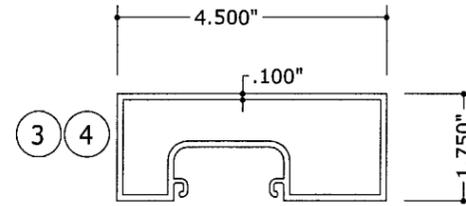


JAMB-4 1/2
EXTRUSION 412858

5

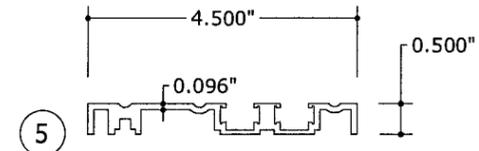


THRESHOLD
DURA-GLIDE 3000
EXTRUSION 515262

5

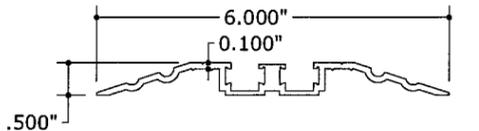


ALTERNATE
THRESHOLD-TAPERED TWO SIDES
EXTRUSION 515260

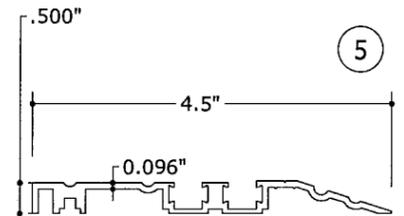

ALTERNATE
THRESHOLD-TAPERED ONE SIDE
EXTRUSION 516340


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0323-24
Expiration Date DEC 04 2011
By *Shag L. Chan*
Miami Dade Product Control
Division

51




GLASS STOP
EXTRUSION 707807

6A

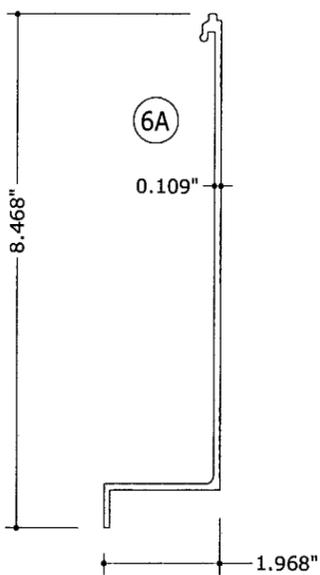


COVER-HEADER
DURA-GLIDE
EXTRUSION 515686

6B

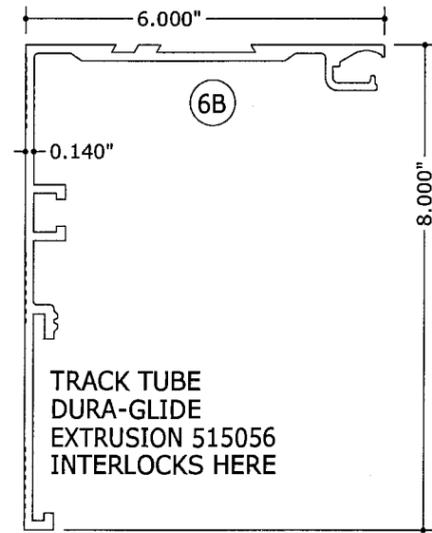


HEADER
DURA-GLIDE
EXTRUSION 110755

21

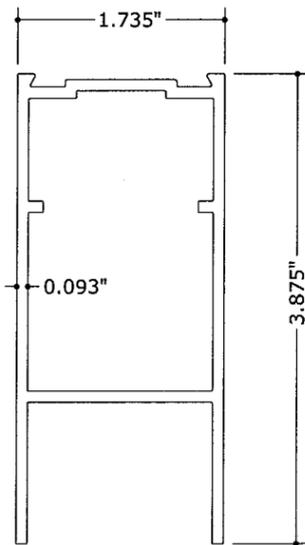


RAIL, BOTTOM-SX/SO
EXTRUSION 412470

54

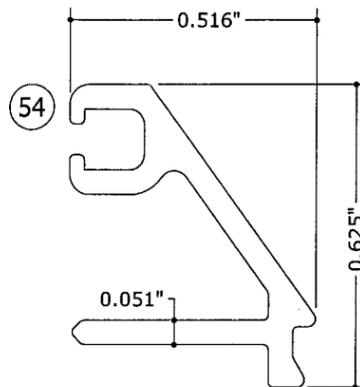

GLASS STOP
EXTRUSION 412569

50

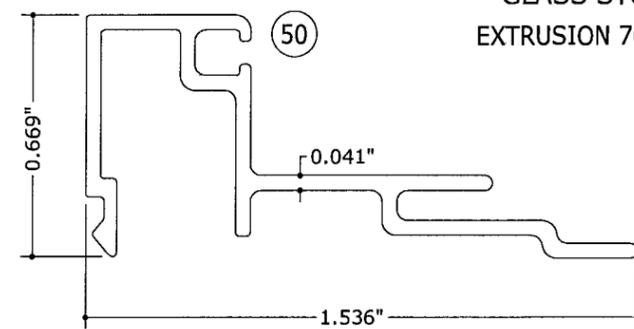

GLASS STOP
EXTRUSION 412472

STANLEY
ACCESS TECHNOLOGIES

65 SCOTT SWAMP ROAD
FARMINGTON, CT 06032

DURA-GLIDE SERIES 2000 & 3000
AUTOMATIC SLIDING GLASS DOORS
(BI-PART, NON-REINFORCED, NON-IMPACT)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE			10/13/98
2004 FBC	AML	FLB	08/24/05
COUNTY COMMENTS	AML	FLB	08/29/05
BBCO COMMENTS	RKB	CL	06/15/07
2007 FBC - COMMENTS	RKB	FLB	07/15/09

05-SAT-0025

PAGE SCALE:
DESCRIPTION: