



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.buildingcodeonline.com**

NOTICE OF ACCEPTANCE (NOA)

**AWP, LLC,
8130 N.W. 74TH Avenue,
Miami, FL 33166**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series Exterior Glazed Aluminum Fixed Windows

APPROVAL DOCUMENT: Drawing No. **W00-53**, titled "Series Exterior Glazed Alum Fixed Windows (ND)", sheets 1 through 5 of 5, prepared by Al Farooq Corp., dated 12-12-00 and last revised on March 25, 2009, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None. Hurricane Protection devices complying w/ FBC are required

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **06 -1229.02** and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Fitz A. Harris, P.E.**



Fitz A. Harris
4/30/09

**NOA No 09-0331.13
Expiration Date: December 13, 2011
Approval Date: May 27, 2009
Page 1**

AWP, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections. (transferred from file # **06-1229.02**)
2. Drawing No. **W00-53**, titled "Series Exterior Glazed Alum fixed windows(NI)", sheets 1 through 5 of 5, prepared by Al Farooq Corp., dated 12-12-00 Last revised on March 25, 2009, signed and sealed by Dr. Humayoun Farooq, P.E.

B. TESTS (transferred from file # **06-1229.02**). Original test conducted per SFBC, PA 202-94, now termed as FBC, TAS 202-94.

1. Test report on : 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94

Along with installation diagram of an aluminum fixed arch window (3/16" temp), prepared by Hurricane Engineering & Testing Inc., Report No. **HETI-00-1174A**, **HETI-00-1174B**, **HETI-00-1174C** and **HETI-00-1174D**, all dated 10/19/00, signed and sealed by Arshad Viqar, P.E.

C. CALCULATIONS

1. Anchor verification calculations dated March 2 2009 prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.
2. Anchor verification and comparative analysis dated December 13, 2006, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E. (transferred from file # **06-1229.02**)
3. Glazing Complies with ASTM E-1300-02/04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None

F. STATEMENTS

1. Statement letter of compliance with 2007-FBC dated 3/2/09, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of "No financial interest", dated 12/13/07, signed and sealed by Dr. Humayoun Farooq, P.E. (transferred from file # **06-1229.02**)
3. Laboratory compliance as a part of above test reports

G. OTHER

1. NOA # **06-1229.02** issued to Yale Ogron Manufacturing Co. on 2/21/07 expiring on 12/13/2011.







Fitz A. Harris, P.E.

Product Control Examiner


NOA No 09-0331.13

Expiration Date: December 13, 2011

Approval Date: May 27, 2009

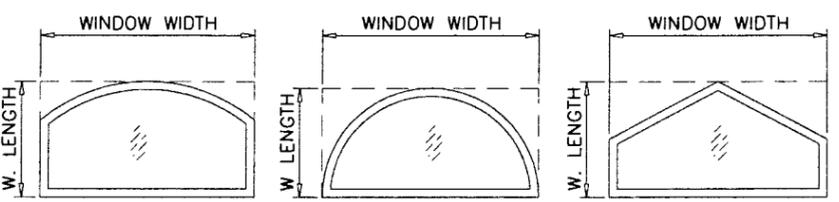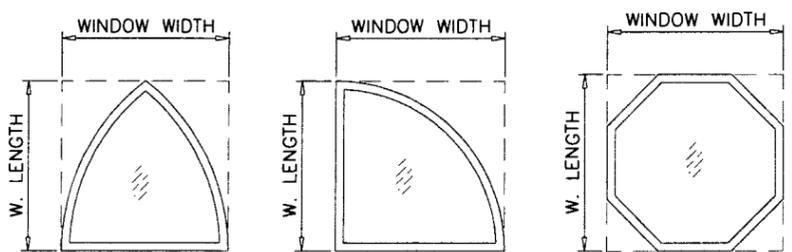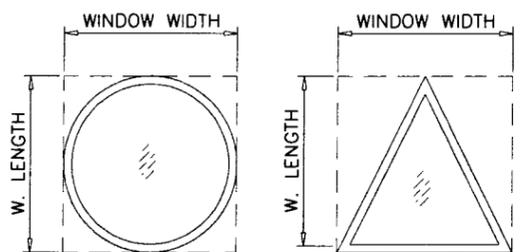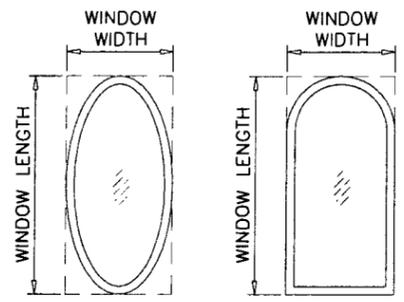

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

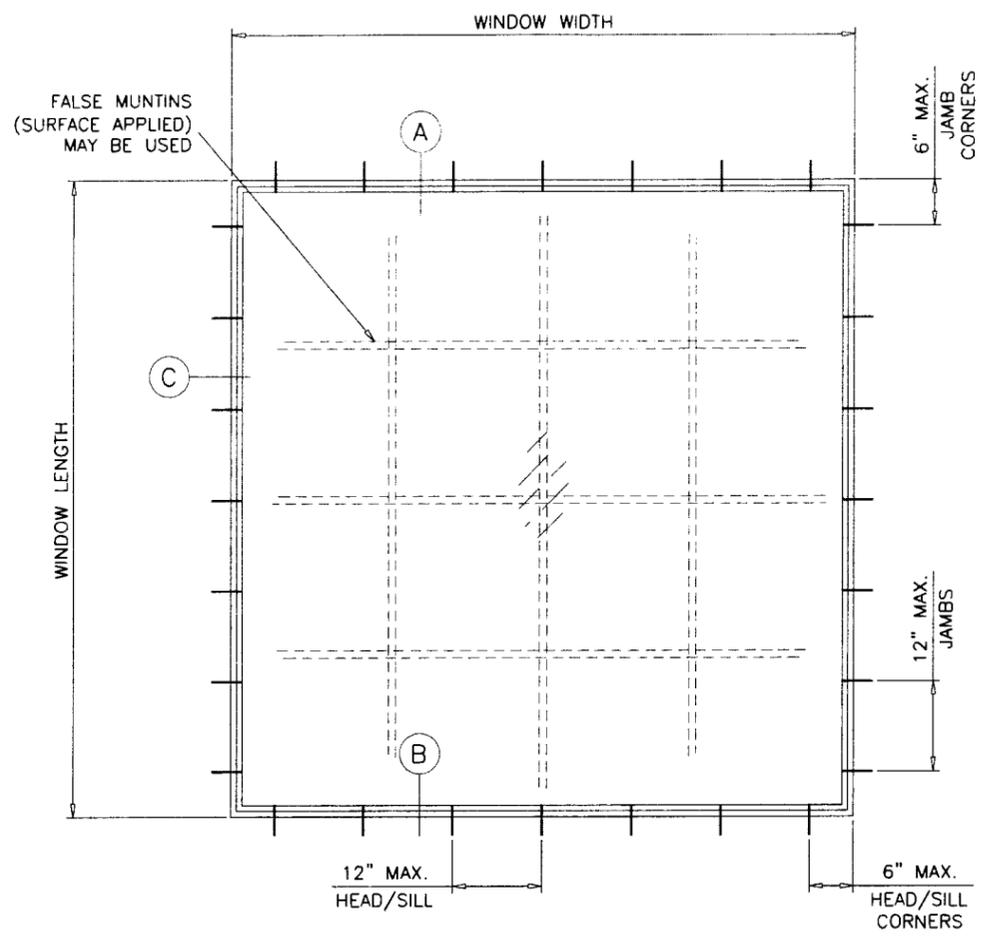

TYPICAL ELEVATION

EXTERIOR GLAZED ALUMINUM FIXED WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS ON SHEET 2.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

WINDOWS NOT RATED FOR IMPACT. INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS. INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 26 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0331-13
Expiration Date 12-13-2011
By *J. Harris*
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W00 - 53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
A	10.02.01	CHARIS REV. PER ASTM E-1300
B	12.11.06	UPDATED FOR 2004 FBC
C	03.25.09	NOTES REV., MANF. NAME CHANGE

revisions:
date: 12-12-00
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:



drawing no.
W00-53
sheet 1 of 5

DESIGN LOAD CAPACITY - PSF								
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMPERED GLASS				
		ANCHORS TYPE 'A'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	
18"	24"	80.0	82.2	80.0	153.6	80.0	186.7	
24"		61.7	61.7	80.0	140.0	80.0	140.0	
30"		61.7	61.7	80.0	140.0	80.0	140.0	
36"		61.7	61.7	80.0	108.0	80.0	140.0	
42"		61.7	61.7	80.0	115.2	80.0	140.0	
48"		61.7	61.7	80.0	96.0	80.0	140.0	
54"		59.5	59.5	80.0	102.9	80.0	135.0	
60"		57.8	57.8	80.0	90.0	80.0	131.3	
66"		56.5	56.5	80.0	96.0	80.0	128.3	
72"		55.6	55.6	80.0	86.4	80.0	126.0	
18"	36"	80.0	82.2	80.0	128.0	80.0	186.7	
24"		61.7	61.7	80.0	108.0	80.0	140.0	
30"		49.3	49.3	80.0	98.7	80.0	112.0	
36"		41.1	41.1	80.0	93.3	80.0	93.3	
42"		41.1	41.1	80.0	93.3	80.0	93.3	
48"		41.1	41.1	76.8	76.8	80.0	93.3	
54"		41.1	41.1	80.0	80.0	80.0	93.3	
60"		41.1	41.1	68.6	68.6	80.0	93.3	
66"		41.1	41.1	72.0	72.0	80.0	93.3	
72"		38.1	38.1	64.0	64.0	80.0	93.3	
18"	48"	75.9	75.9	80.0	118.2	80.0	172.3	
24"		61.7	61.7	80.0	96.0	80.0	140.0	
30"		49.3	49.3	80.0	83.8	80.0	112.0	
36"		41.1	41.1	76.8	76.8	80.0	93.3	
42"		35.2	35.2	73.1	73.1	80.0	80.0	
48"		30.8	30.8	70.0	70.0	70.0	70.0	
54"		30.8	30.8	70.0	70.0	70.0	70.0	
60"		-	-	60.0	60.0	70.0	70.0	
66"		-	-	61.7	61.7	70.0	70.0	
72"		-	-	54.0	54.0	70.0	70.0	
18"	60"	72.5	72.5	80.0	112.9	80.0	164.7	
24"		57.8	57.8	80.0	90.0	80.0	131.3	
30"		49.3	49.3	76.8	76.8	80.0	112.0	
36"		41.1	41.1	68.6	68.6	80.0	93.3	
42"		35.2	35.2	63.3	63.3	80.0	80.0	
48"		-	-	60.0	60.0	70.0	70.0	
54"		-	-	58.2	58.2	62.2	62.2	
60"		-	-	56.0	56.0	56.0	56.0	
66"		-	-	56.0	56.0	56.0	56.0	
72"		-	-	49.4	49.4	56.0	56.0	
18"	72"	70.5	70.5	80.0	109.7	80.0	160.0	
24"		55.5	55.5	80.0	86.4	80.0	126.0	
30"		44.7	44.7	72.8	72.8	80.0	106.1	
36"		38.1	38.1	64.0	64.0	80.0	93.3	
42"		-	-	58.1	58.1	80.0	80.0	
48"		-	-	54.0	54.0	70.0	70.0	
54"		-	-	51.2	51.2	62.2	62.2	
60"		-	-	49.4	49.4	56.0	56.0	
18"		84"	69.1	69.1	80.0	107.5	80.0	156.8
24"			54.0	54.0	80.0	84.0	80.0	122.5
30"	40.7		40.7	70.1	70.1	80.0	102.3	
36"	-		-	61.1	61.1	80.0	89.1	
42"	-		-	54.9	54.9	80.0	80.0	
48"	-		-	50.4	50.4	70.0	70.0	
54"	-		-	47.2	47.2	62.2	62.2	

DESIGN LOAD CAPACITY - PSF								
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMPERED GLASS				
		ANCHORS TYPE 'A'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	
18"	96"	68.0	68.0	80.0	105.9	80.0	154.5	
24"		52.9	52.9	80.0	82.3	80.0	120.0	
30"		-	-	68.3	68.3	80.0	99.6	
36"		-	-	59.1	59.1	80.0	86.2	
42"		-	-	52.7	52.7	76.8	76.8	
48"		-	-	48.0	48.0	70.0	70.0	
18"	108"	57.5	57.5	80.0	104.7	80.0	152.7	
24"		52.0	52.0	80.0	81.0	80.0	118.1	
30"		-	-	66.9	66.9	80.0	97.5	
36"		-	-	57.6	57.6	80.0	84.0	
42"		-	-	51.1	51.1	74.5	74.5	
18"		114"	50.8	50.8	80.0	109.7	80.0	152.0
24"	50.8		50.8	80.0	84.7	80.0	117.4	
30"	-		-	69.8	69.8	80.0	96.7	
36"	-		-	60.0	60.0	80.0	83.1	
18"	120"		45.3	45.3	80.0	103.8	80.0	151.4
24"			-	-	80.0	80.0	80.0	116.7
30"		-	-	65.8	65.8	80.0	96.0	
36"		-	-	56.5	56.5	80.0	82.4	
18"		132"	36.6	36.6	80.0	103.0	80.0	146.4
24"			-	-	79.2	79.2	80.0	115.5
30"	-		-	65.0	65.0	80.0	94.8	
18"	144"		30.1	30.1	80.0	102.4	80.0	120.3
24"			-	-	78.5	78.5	80.0	114.5
30"			-	-	64.3	64.3	80.0	93.8

DESIGN LOAD CAPACITY - PSF							
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMPERED GLASS			
		ANCHORS TYPE 'A'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
19-1/8"	26"	77.4	77.4	80.0	175.7	80.0	175.7
26-1/2"		56.9	56.9	80.0	129.2	80.0	129.2
37"		56.9	56.9	80.0	129.2	80.0	129.2
53-1/8"		56.5	56.5	80.0	99.4	80.0	128.3
19-1/8"	38-3/8"	77.3	77.3	80.0	150.5	80.0	175.5
26-1/2"		55.8	55.8	80.0	124.6	80.0	126.8
37"		40.0	40.0	80.0	90.8	80.0	90.8
53-1/8"	59"	38.6	38.6	79.6	79.6	80.0	87.6
19-1/8"		69.3	69.3	80.0	109.7	80.0	157.3
26-1/2"		54.0	54.0	80.0	85.5	80.0	122.6
37"		40.0	40.0	69.2	69.2	80.0	90.8
53-1/8"	63"	-	-	60.2	60.2	63.2	63.2
19-1/8"		68.4	68.4	80.0	121.7	80.0	155.3
26-1/2"		53.0	53.0	80.0	94.4	80.0	120.4
37"		40.0	40.0	75.6	75.6	80.0	90.8
53-1/8"	74-1/4"	-	-	63.2	63.2	63.2	63.2
19-1/8"		66.6	66.6	80.0	117.3	80.0	151.2
26-1/2"		51.0	51.0	80.0	89.8	80.0	115.8
37"		-	-	70.4	70.4	80.0	90.7
53-1/8"	-	-	57.3	57.3	63.2	63.2	

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS).

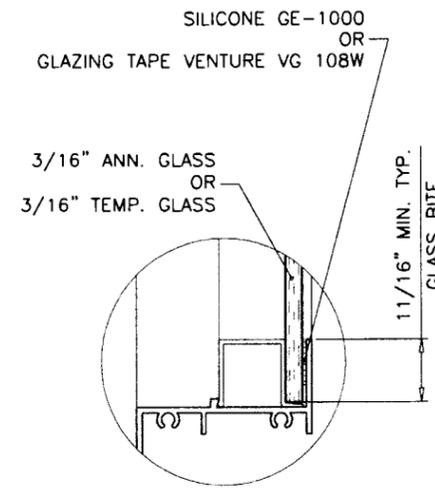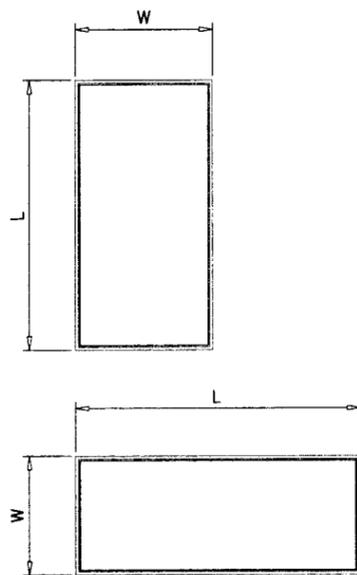

GLAZING DETAIL

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 26 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0331-13
Expiration Date 12-13-2011
By *Dale Harris*
Miami Dade Product Control
Division

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W00 - 53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	description
	B	12.11.06	UPDATED FOR 2004 FBC
	C	03.25.09	NOTES REV. MANF. NAME CHANGE

date: 12-12-00
scale: -
dr. by: HAMID
chk. by:

drawing no.
W00-53
sheet 2 of 5





WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW.
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
B	12.11.06		UPDATED FOR 2004 FBC
C	03.25.09		MANUF. NAME CHANGE

date: 12-12-00
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no. **W00-53**
sheet 3 of 5

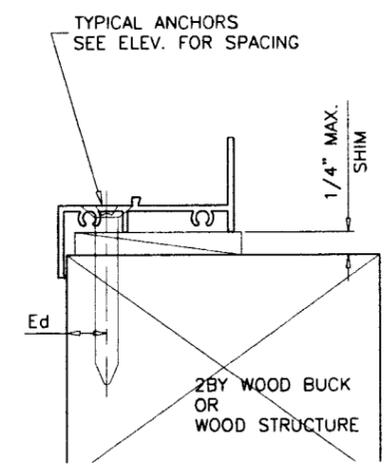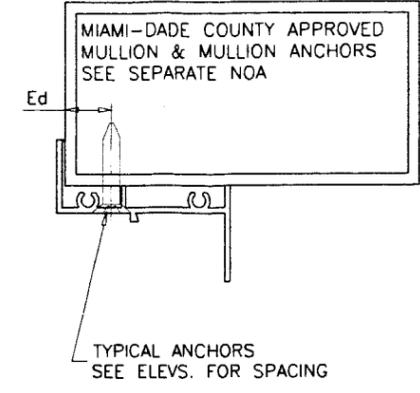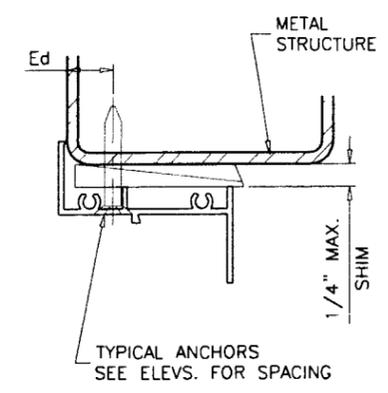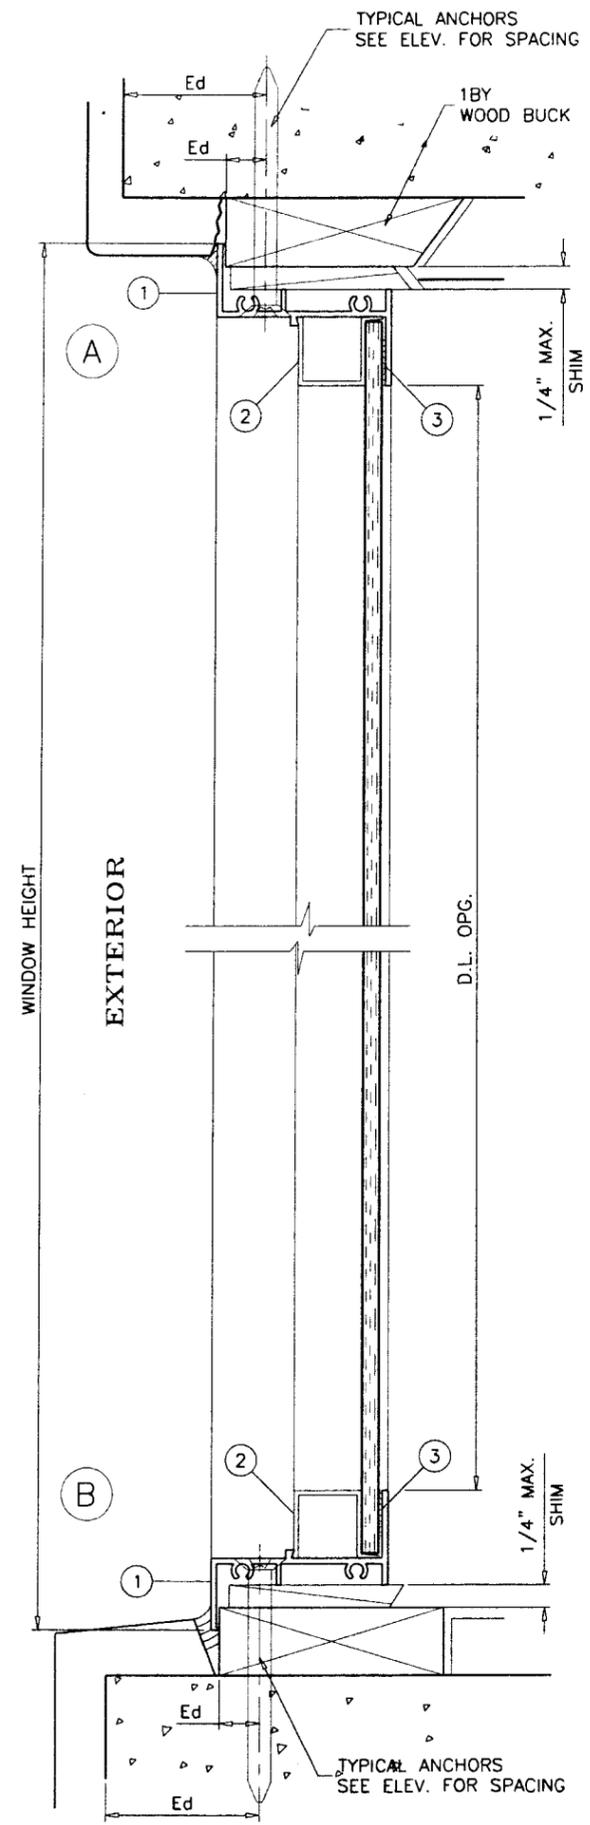

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - 3/16" TAPCONS
INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
1-3/8" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B' - 1/4" TAPCONS
INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
1-3/8" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

3/16" TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO METAL STRUCTURES
STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#10 SMS OR SELF DRILLING SCREWS
INTO DADE COUNTY APPROVED MULLIONS
(NO SHIM SPACE)




Ed = ANCHOR EDGE DISTANCE
INTO CONCRETE AND MASONRY = 1-1/4" MIN.
INTO WOOD STRUCTURE = 9/16" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

SEALANTS:
FRAME CORNERS AND INSTALLATION SCREWS SEALED WITH
GE SILICONE SEALANT.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0331-13
Expiration Date 12-13-2011
MAR 26 2009

By *Dita Harris*
Miami Dade Product Control
Division

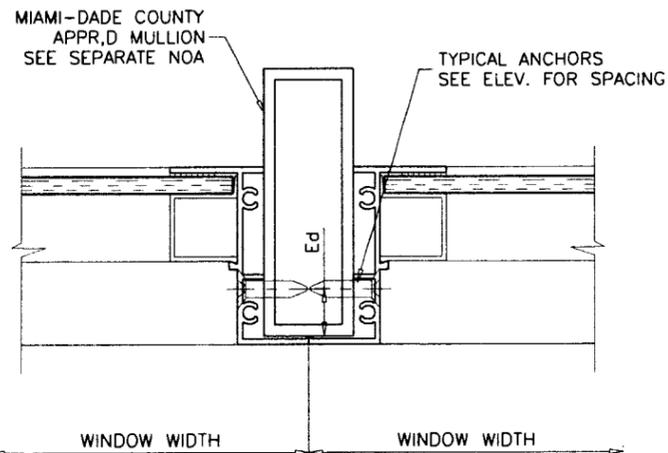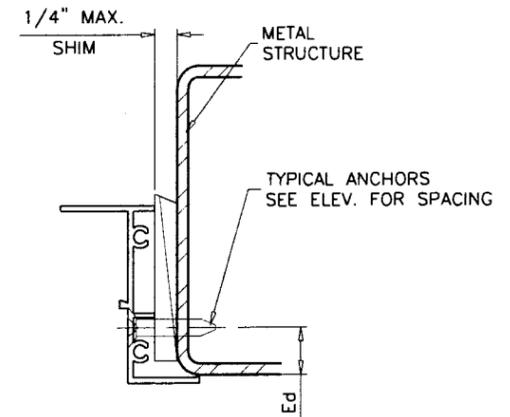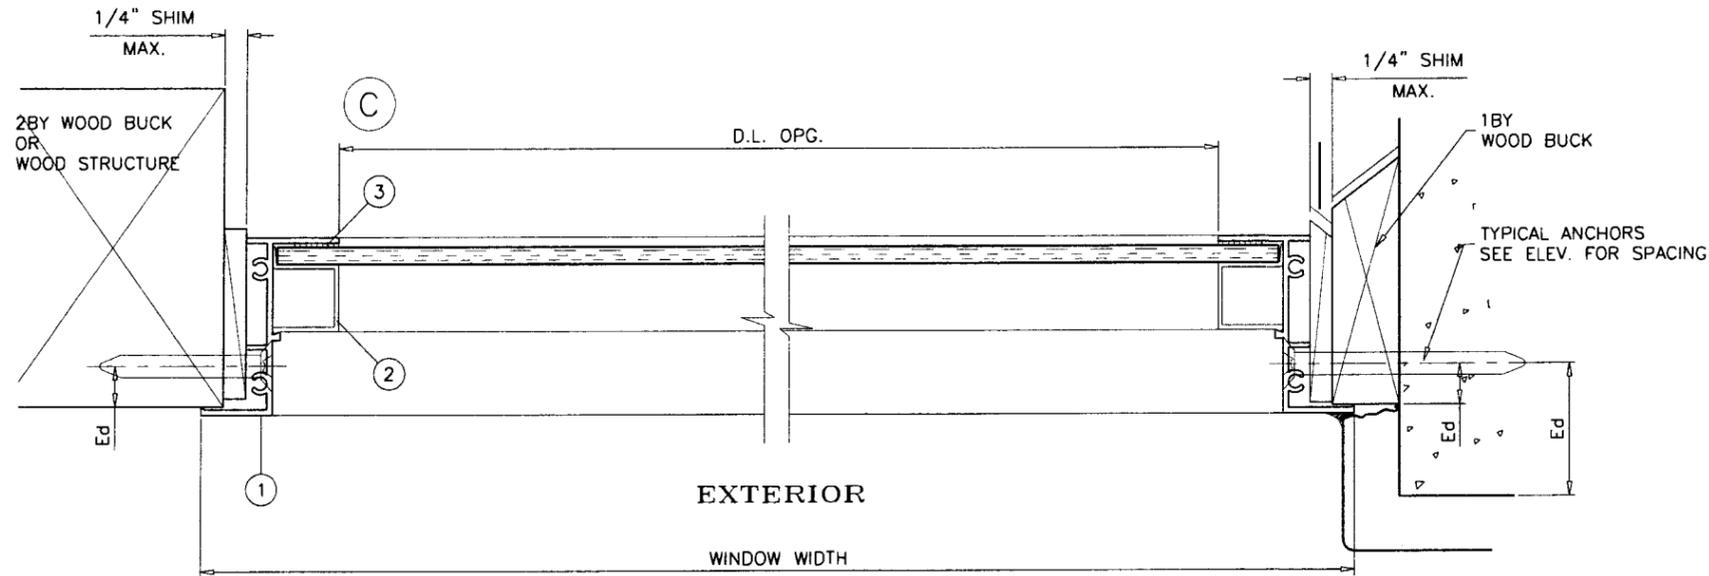

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 18557
C.A.N. 3538

MAR 26 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0331-13
Expiration Date 12-13-2011

By *Steve Harris*
Miami Dade Product Control
Division


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


no.	date	description
B	12.11.06	UPDATED FOR 2004 FBC
C	03.25.09	MANUF. NAME CHANGE

date: 12-12-00
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W00-53
sheet 4 of 5



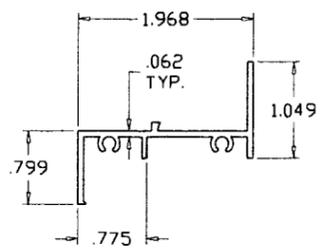


WINDOW FRAME

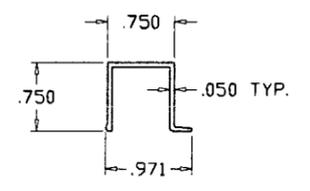

GLAZING STOP

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPLIER/REMARKS
1	YE-60	4	WINDOW FRAME	ALUMINUM	6063-T5
2	YE-42	4	GLAZING STOP	ALUMINUM	6063-T5
3	GE-1000	AS REQD.	GLAZING COMPOUND	SILICONE	-
3A	VG 108W	AS REQD.	GLAZING TAPE (1/2" X 1/8")	-	VENTURE
4	#8 X 1"	2/ CORNER	FRAME ASSEMBLY SCREWS	-	-

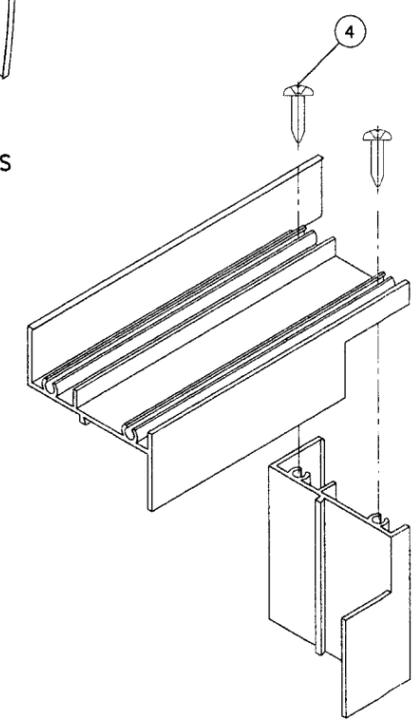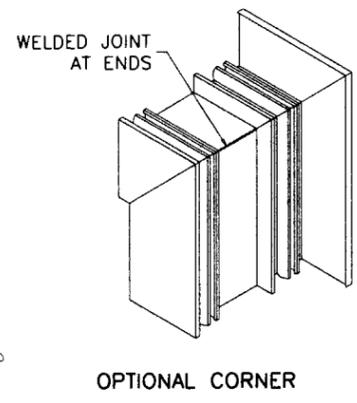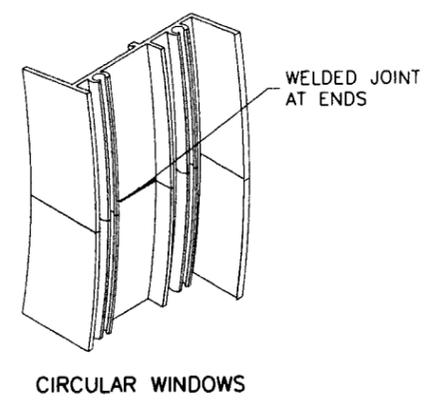

RECT. OR SQUARE WINDOWS

TYP. CORNER DETAILS

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W00-53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
 AWP, LLC.
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description
	B	12.11.06		UPDATED FOR 2004 FBC
	C	03.25.09		MANUF. NAME CHANGE

date:	12-12-00
scale:	1/2" = 1"
dr. by:	HAMID
chk. by:	

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 MAR 26 2009

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0331-11
 Expiration Date 12-13-2011
 By *Siti Harris*
 Miami Dade Product Contr[ol]
 Division

drawing no.
W00-53
 sheet 5 of 5