



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

www.miamidade.gov

NOTICE OF ACCEPTANCE (NOA)

Varco Pruden Buildings, Inc.
1140 West Mountain Street
Kernersville, NC 27284

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: 0.022" (min.) 1- 3/16" x 36" Steel Structural Roof Panel

APPROVAL DOCUMENT: Drawing No. FLPRROOF1, titled "0.022" (min.) 1- 3/16" x 36" Steel Structural Roof Panel ", sheets 1 through 5 of 5, prepared by Varco Pruden Buildings, Inc., signed and sealed by Larry L. Boozer, P.E., on June 16, 2009, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, Rainsville, Alabama and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 09-0127.09 and consists of this page 1, evidence submitted E-1, E-2, E-3 & E-4 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
 07/15/2009

NOA No. 09-0402.21
Expiration Date: 03/07/2014
Approval Date: 07/15/2009
Page 1

Varco Pruden Buildings, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL No. 95-0517.01

A. DRAWINGS

Title: "Panel -Rib" roof mock-up
Number: 95-0517.01, sheets 1 through 5
Signature: Larry L. Boozer, P.E. and R.G. Miller, P.E.
Date: 04/28/95 and 12/28/95
Revision Date: 05/10/95 and 02/13/96

B. TESTS

Laboratory: Architectural Testing, Inc.
Number: ATI-15642
Type: 1- Large missile impacts, per PA 201-94
2- Uniform static air pressure loading, per ASTM E330
Signature: Allen N. Reeves, P.E.
Date: 05/10/95

Laboratory: Center for Applied Engineering, Inc.
Material Testing Services.
Number: MTS No. 257485B and 257485A
Type: 1- Resistance to wind driven rain, per PA 100-95
2- Susceptibility to leakage for class 1 metal roof, per PA 114-95
appendix G.
Signature: R.G. Miller, P.E.
Date: 01/11/96

C. CALCULATIONS

Title: Varco-Pruden Buildings "24 gauge panel rib roof"
Signature: Larry L. Boozer, P.E.
Date: 05/12/95
Revision: 09/25/95, 10/09/95 and 02/08/96

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL No. 99-0324.12

A. DRAWINGS

1. *None. (See original drawings in file #95-0517.01)*

B. TESTS

1. *None. (See original test reports in file #95-0517.01)*


Henry A. Makar, P.E., M.S.

Senior Product Control Examiner

NOA No. 09-0402.21

Expiration Date: 03/07/2014

Approval Date: 07/15/2009

Varco Pruden Buildings, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. *None. (See original calculations in file #95-0517.01)*

D. MATERIAL CERTIFICATIONS

1. *None. (See original certifications in file #95-0517.01)*

3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL No. 02-0123.08

A. DRAWINGS

1. *None. (See original drawings in file #95-0517.01).*

B. TESTS

1. *None. (See original drawings in file #95-0517.01).*

C. CALCULATIONS

1. *None. (See original drawings in file #95-0517.01).*

D. MATERIAL CERTIFICATIONS

1. *None. (See original drawings in file #95-0517.01).*

4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #07-0312.04

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*

5. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 08-0305.08

A. DRAWINGS

1. *None.*



Helmy A. Makar, P.E., M.S.
Senior Product Control Examiner
NOA No. 09-0402.21
Expiration Date: 03/07/2014
Approval Date: 07/15/2009

Varco Pruden Buildings, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*

6. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 09-0127.09

A. DRAWINGS

1. *None.*

B. TESTS

1. *Susceptibility to Leakage Test in accordance with FM 4471, Appendix G, prepared by Farabaugh Engineering and Testing, Inc., Report No. T122-09, dated February 11, 2009, signed and sealed by Daniel G. Farabaugh, P.E.*
2. *Uniform Static Air Pressure Test in accordance with ASTM E 1592, prepared by Farabaugh Engineering and Testing, Inc., Report No. T135-08, dated December 31, 2008, signed and sealed by Daniel G. Farabaugh, P.E.*
3. *Large Missile Test per TAS 201 and Cyclic Air Pressure Test in accordance with TAS 203, prepared by Farabaugh Engineering and Testing, Inc., Report No. T141-08, dated December 31, 2008, signed and sealed by Daniel G. Farabaugh, P.E.*
4. *Large Missile Test per TAS 201, prepared by Farabaugh Engineering and Testing, Inc., Report No. T140-08, dated December 31, 2008, signed and sealed by Daniel G. Farabaugh, P.E.*

C. CALCULATIONS


1. *Calculation titled Varco-Pruden Buildings "24 gauge panel rib roof", 19 sheets, dated 01/20/09, prepared and signed and sealed by Larry L. Boozer, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*



Helmy A. Makar, P.E., M.S.

Senior Product Control Examiner

NOA No. 09-0402.21

Expiration Date: 03/07/2014

Approval Date: 07/15/2009

Varco Pruden Buildings, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

7. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *Drawing No. FLPRROOF1, titled " 0.022" (min.) 1- 3/16" x 36" Steel Structural Roof Panel ", sheets 1 through 5 of 5, prepared by Varco Pruden Buildings, Inc., signed and sealed by Larry L. Boozer, P.E., on June 16, 2009.*

B. TESTS

1. *Wind and Wind Driven Rain Resistance of Discontinuous Roof Systems Test in accordance with TAS 100-95, prepared by Farabaugh Engineering and Testing, Inc., Report No. T145-08, revised dated February 12, 2009, signed and sealed by Daniel G. Farabaugh, P.E.*

C. CALCULATIONS

1. *Calculation titled " Structural Design Data ", 22 sheets, dated 03/31/09, prepared and signed and sealed by Larry L. Boozer, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*




Helmy A. Makar, P.E., M.S.

Senior Product Control Examiner


NOA No. 09-0402.21

Expiration Date: 03/07/2014

Approval Date: 07/15/2009

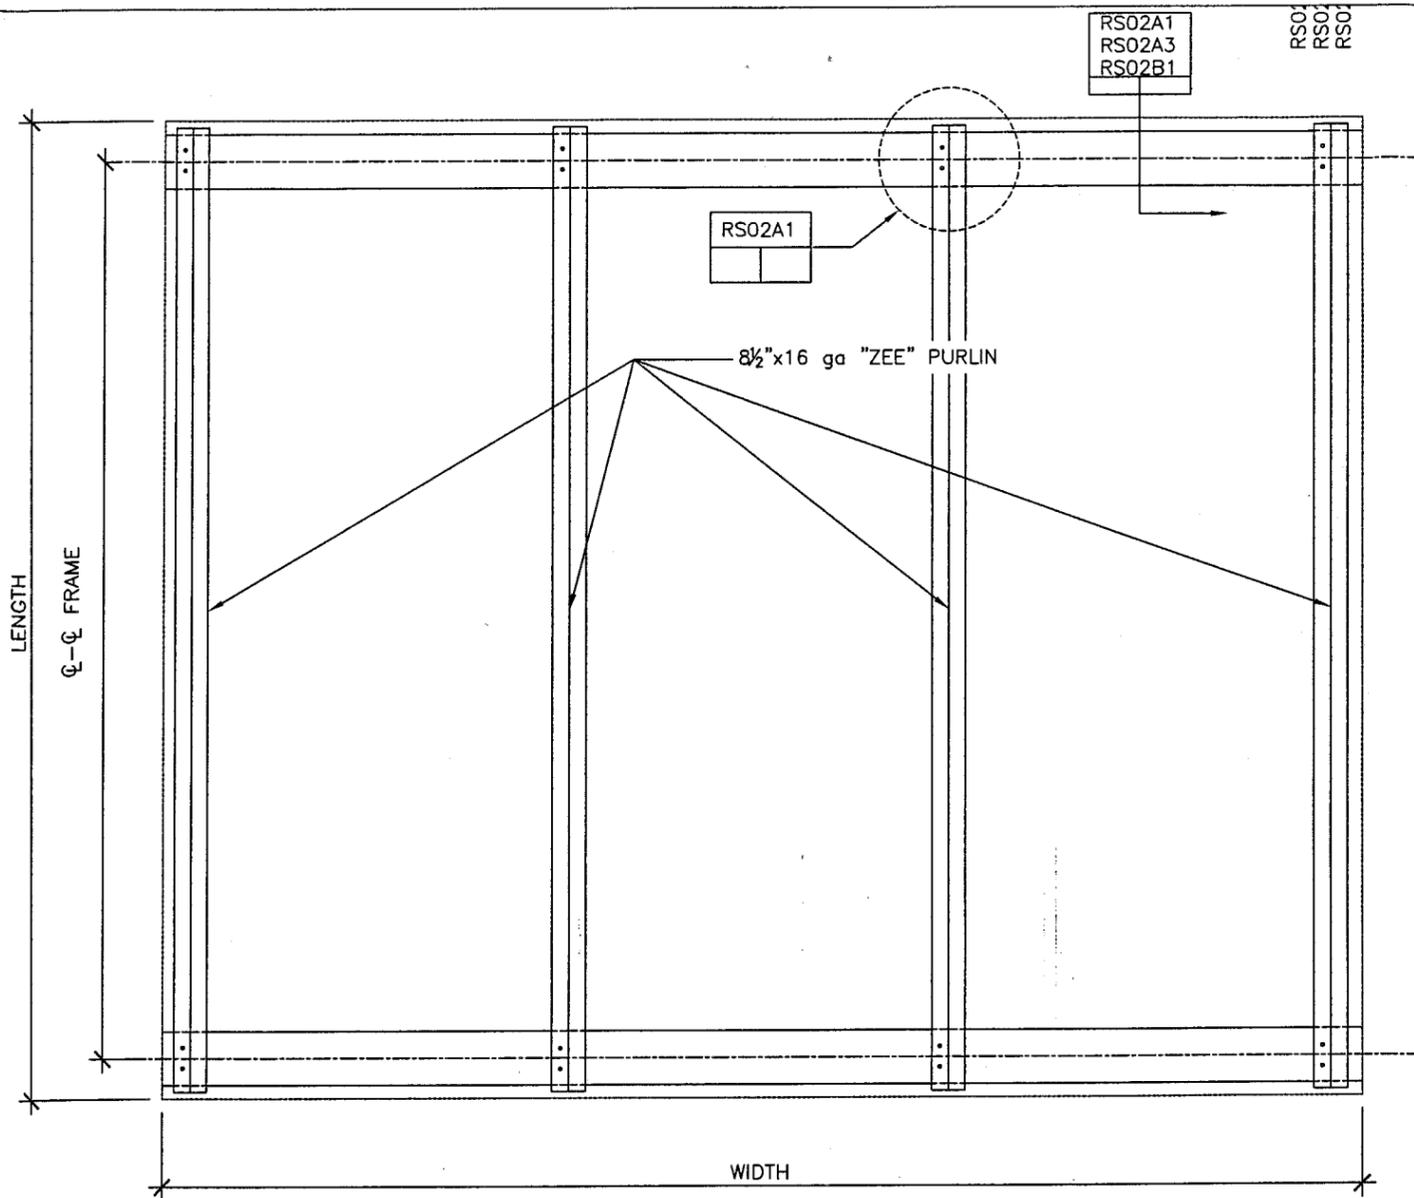


FRAMING PLAN

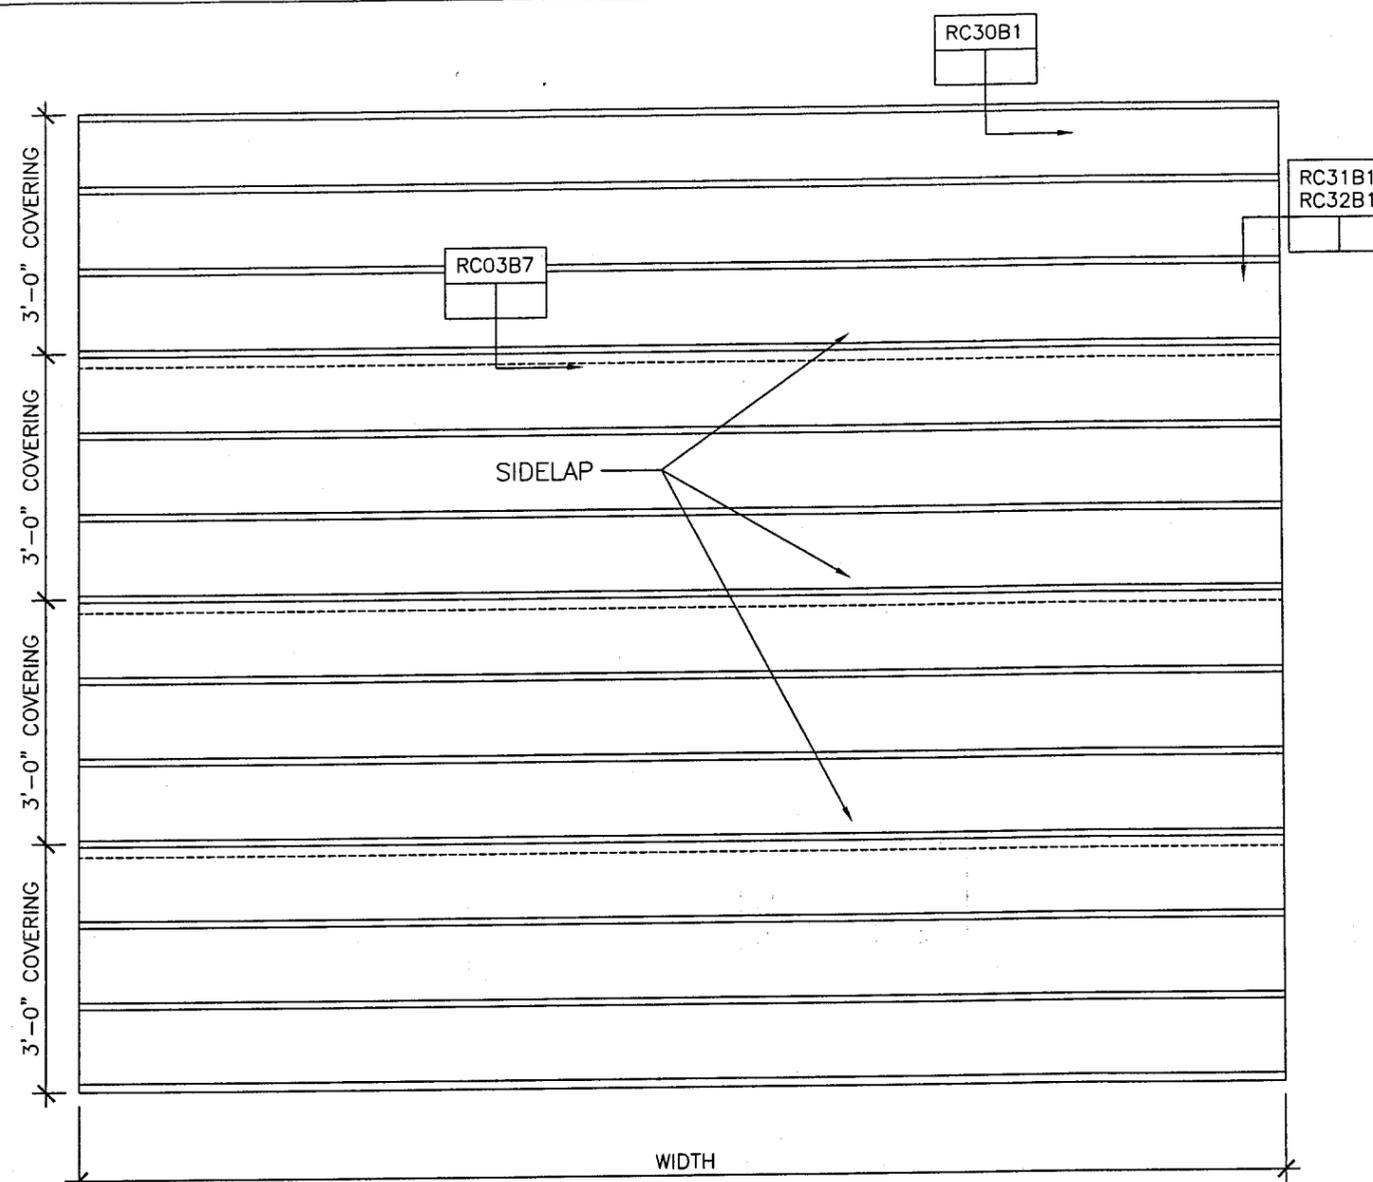

0.022" (MIN.) 1 3/16" x 36" STEEL STRUCTURAL ROOF PANEL (PANEL-RIB) SHEETING PLAN

① (2) 3/16" Ø HOLES (3" GAGE) FOR 1/2" x 1 1/2" A-325 BOLTS (TYP.)

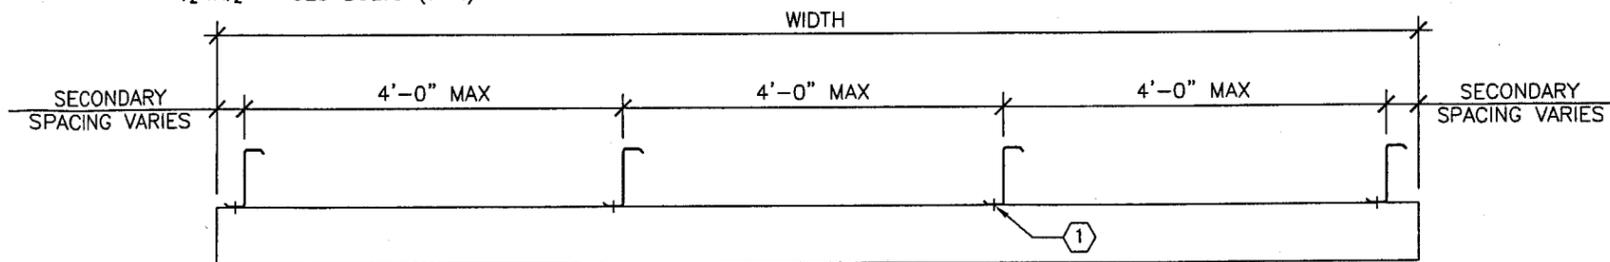

FRAMING CROSS SECTION

PANEL STRENGTHS AS FOLLOWS:
 PANEL BENDING AT SUPPORTS: 1409.28 in-lb PER FOOT WIDTH OF PANEL
 PANEL BENDING BETWEEN SUPPORTS: 1127.42 in-lb PER FOOT WIDTH OF PANEL
 INTERIOR PANEL REACTION: Pa int = 323 lb
 EXTERIOR PANEL REACTION: Pa ext = 117 lb
 DEFLECTION BASED ON E_lx min = 571,899.67 lb-in² PER FOOT WIDTH OF PANEL

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0402-21
 Expiration Date 03/07/2014
 By *Heather A. Miller*
 Minor Design Product Control
 Division

Larry L. Boozer
 4/16/09
 LARRY L. BOOZER PE
 No. 44236
 VP BUILDINGS
 1140 W. MOUNTAIN STREET
 KERNERSVILLE, NC 27284

NOTE: THIS PANEL SHALL BE USED FOR ROOF CONSTRUCTION ONLY. FRAMING AND DETAILS SHOWN REPRESENT ACTUAL CONSTRUCTION DETAILS IN FIELD AND FOR TEST SPECIMENS USED IN TAS125-03 STANDARD REQUIREMENTS FOR METAL ROOF SYSTEMS. SIZES OF TEST APPARATUS VARY, REFER TO SPECIFIC TEST FOR SAMPLE SIZE. EACH ACTUAL ROOF PROJECT SHALL BE CONSTRUCTED USING THE SAME DETAILS SHOWN ON THESE DRAWINGS, INCLUDING: A) DETAILS OF ALL PANEL RIB SECTIONS WITH DIMENSIONS AND THICKNESS; B) ASSEMBLY DETAILS INCLUDING ALL CONNECTIONS; C) FASTENER DIAGRAM WITH THE SIZE AND LOCATION; D) PANEL MATERIAL CHARACTERISTICS.

THE VP ENGINEER'S SEAL APPLIES ONLY TO THE WORK PRODUCT OF VP AND DESIGN AND PERFORMANCE REQUIREMENTS SPECIFIED BY VP. THE VP ENGINEER'S SEAL DOES NOT APPLY TO THE PERFORMANCE OR DESIGN OF ANY OTHER PRODUCT OR COMPONENT FURNISHED BY VP EXCEPT TO ANY DESIGN OR PERFORMANCE REQUIREMENTS SPECIFIED BY VP.

MINIMUM ROOF SLOPE:
 1/2:12






THIS DRAWING, INCLUDING THE INFORMATION HEREON, REMAINS THE PROPERTY OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC. IT IS PROVIDED SOLELY FOR ERECTING THE BUILDING DESCRIBED IN THE APPLICABLE PURCHASE ORDER AND SHALL NOT BE MODIFIED, REPRODUCED OR USED FOR ANY OTHER PURPOSE WITHOUT PRIOR WRITTEN APPROVAL OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC.

THE GENERAL CONTRACTOR AND/OR ERECTOR IS SOLELY RESPONSIBLE FOR ACCURATE, GOOD QUALITY WORKMANSHIP IN ERECTING THIS BUILDING IN CONFORMANCE WITH THIS DRAWING, DETAILS REFERENCED IN THIS DRAWING, ALL APPLICABLE VP ERECTION GUIDES, AND INDUSTRY STANDARDS PERTAINING TO PROPER ERECTION, INCLUDING THE CORRECT USE OF TEMPORARY BRACING.

Varco Pruden Buildings, a division of BlueScope Buildings North America, Inc. 3200 Players Club Circle Memphis TN 38125			
REV	DATE	BY	DESCRIPTION
Δ	06/16/09	LLB	REVISED PANEL VALUES
NTS			

0.022" (MIN.) 1 3/16" x 36" STEEL STRUCTURAL ROOF PANEL

BUILDER	VP BUILDINGS	DRAWING NO	FLPRROOF1
CUSTOMER	VARCO-PRUDEN	DATE	
LOCATION		DRAWN/CHECK	JXS /
PROJECT		PAGE	1 OF 5
BUILDERS PO#		A BlueScope Steel Company VPC VERSION: 7.1c	

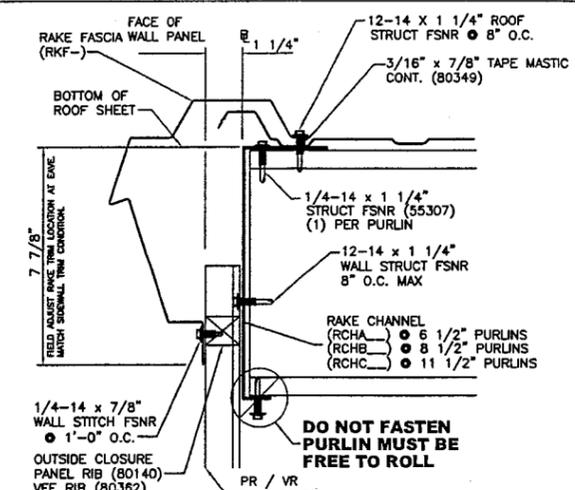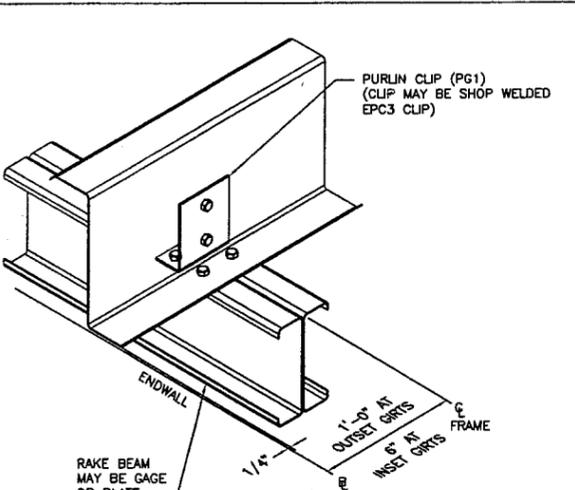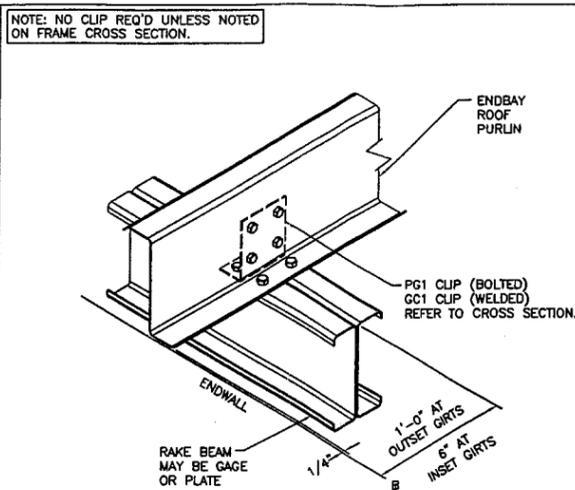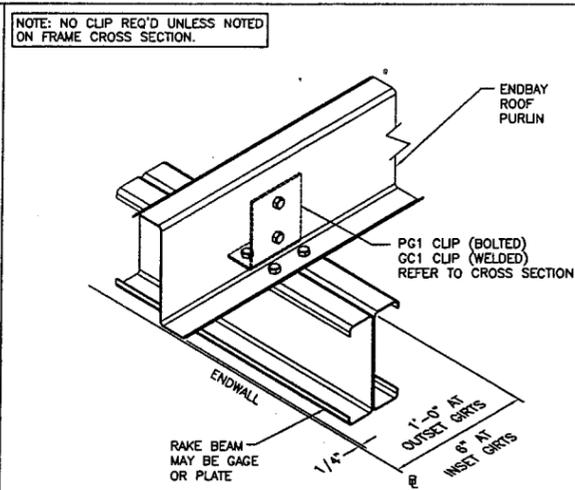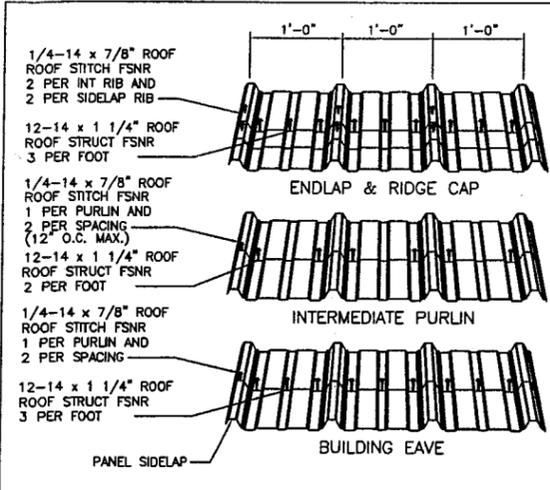

PANEL RIB ROOF FASTENER PATTERN **RC04B3**

U.L. 90 RATED
RC04B3M R 02/26/2004

PURLIN CONN. TO END FRAME **RS02A1**

6 1/2" OR 8 1/2" CONT.
RS02A1M R 11/27/2006

PURLIN CONN. TO END FRAME **RS02A3**

6 1/2" OR 8 1/2" SIMPLE PURLINS
RS02A3M R 11/27/2006

PURLIN AT END FRAME **RS02B1**


11 1/2" CONTINUOUS / SIMPLE PURLINS
RS02B1M R 06/23/2007

PANEL RIB ROOF RAKE TRIM **RC30B1**





ALL PURLINS AT PR, VR OR RPR WALL THRU 2:12
RC30B1M R 05/31/2005

MAXIMUM LENGTH: 41'-0"
TOLERANCES: DIM. ± .0313" (1/32")
ANGLES: ± 2"
ALL INSIDE RADIUS = .125" (1/8")

REFERENCE GAGE	THICKNESS	BLANK WIDTH	MATERIAL AND FINISH
24	0.022(MIN.)	42 3/4"	REFER TO THE QUALITY CONTROL REFERENCE MANUAL

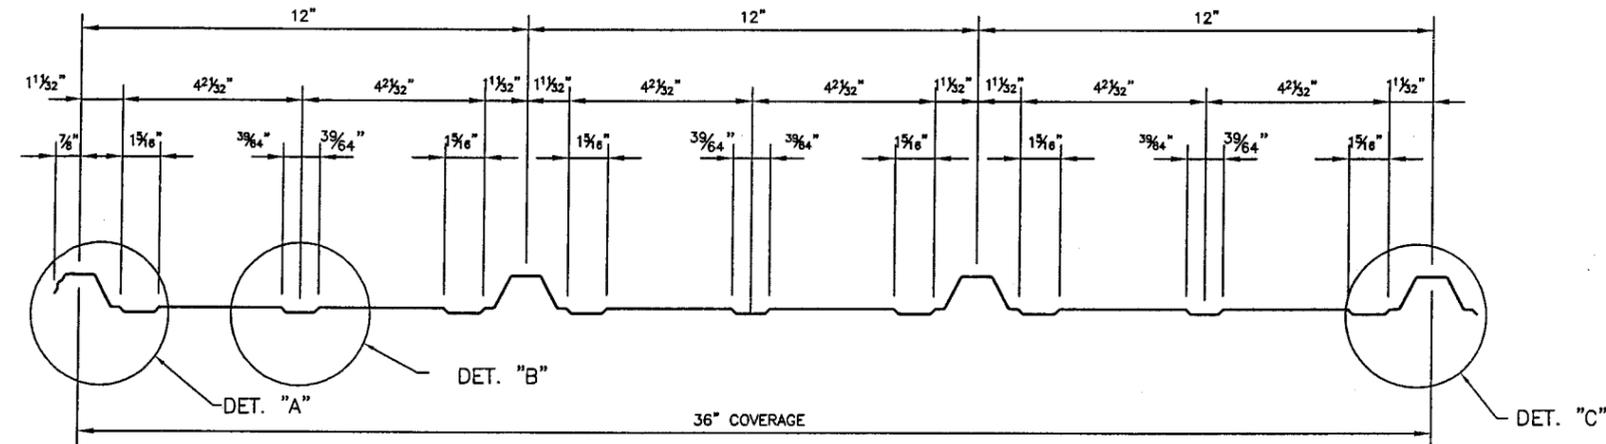


PANEL PROFILE

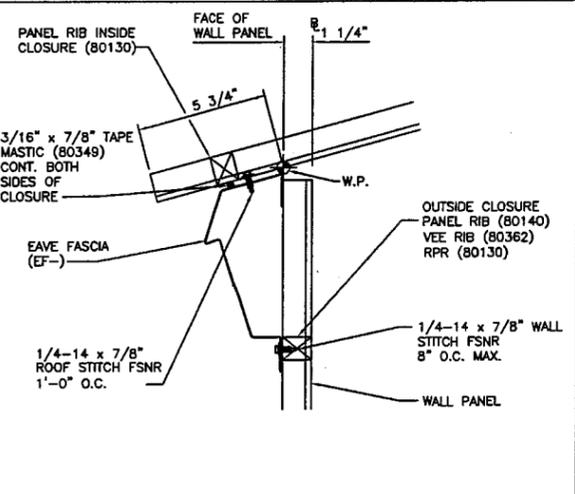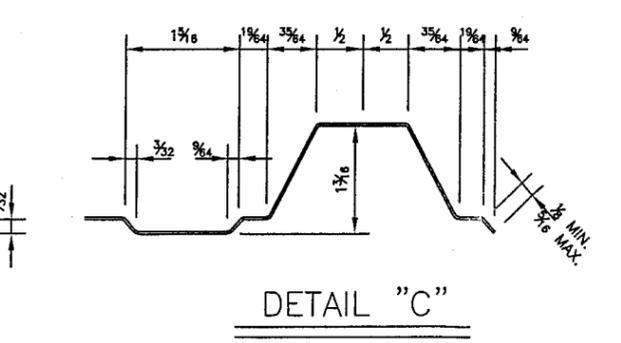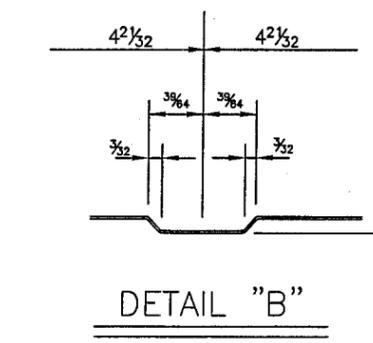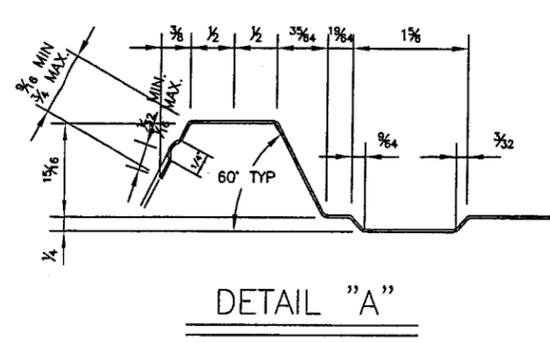


PANEL RIB W/ EAVE FASCIA **RC31B1**

PR, VR OR RPR WALL
RC31B1M R 05/31/2005

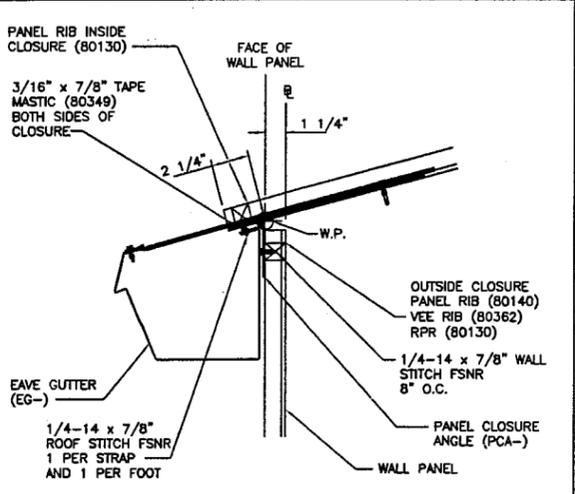

PANEL RIB W/ EAVE GUTTER **RC32B1**

PR, VR OR RPR WALL
RC32B1M R 05/31/2005

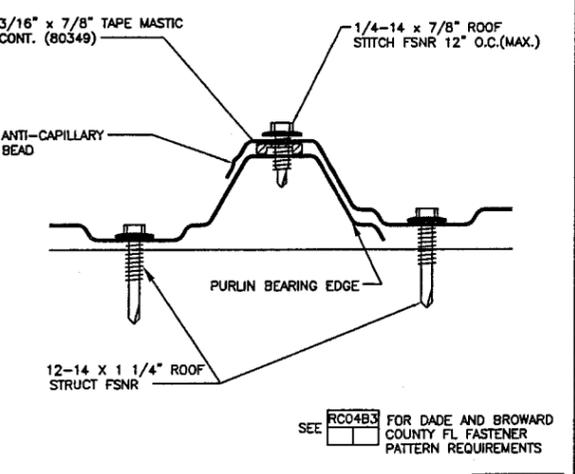

PANEL RIB ROOF **RC03B7**

PANEL SIDELAP MEETS DADE AND BROWARD COUNTY REQUIREMENTS
RC03B7M 01/17/2005

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No. 09-0402.21
Expiration Date 03/07/2014
By *Helmut A. Mahr*
Miami Data Product Control Division

Larry L. Boozer
LARRY L. BOOZER PE
No. 44236
VP BUILDINGS
1140 W. MOUNTAIN STREET
KERNERSVILLE, NC 27284

NOTE: THIS PANEL SHALL BE USED FOR ROOF CONSTRUCTION ONLY. FRAMING AND DETAILS SHOWN REPRESENT ACTUAL CONSTRUCTION DETAILS IN FIELD AND FOR TEST SPECIMENS USED IN TASI25-03 STANDARD REQUIREMENTS FOR METAL ROOF SYSTEMS. SIZES OF TEST APPARATUS VARY, REFER TO SPECIFIC TEST FOR SAMPLE SIZE. EACH ACTUAL ROOF PROJECT SHALL BE CONSTRUCTED USING THE SAME DETAILS SHOWN ON THESE DRAWINGS, INCLUDING: A) DETAILS OF ALL PANEL RIB SECTIONS WITH DIMENSIONS AND THICKNESS; B) ASSEMBLY DETAILS INCLUDING ALL CONNECTIONS; C) FASTENER DIAGRAM WITH THE SIZE AND LOCATION; D) PANEL MATERIAL CHARACTERISTICS.

THE VP ENGINEER'S SEAL APPLIES ONLY TO THE WORK PRODUCT OF VP AND DESIGN AND PERFORMANCE REQUIREMENTS SPECIFIED BY VP. THE VP ENGINEER'S SEAL DOES NOT APPLY TO THE PERFORMANCE OR DESIGN OF ANY OTHER PRODUCT OR COMPONENT FURNISHED BY VP EXCEPT TO ANY DESIGN OR PERFORMANCE REQUIREMENTS SPECIFIED BY VP.

MINIMUM ROOF SLOPE:
1/2:12

THIS DRAWING, INCLUDING THE INFORMATION HEREON, REMAINS THE PROPERTY OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC. IT IS PROVIDED SOLELY FOR THE BUILDING DESCRIBED IN THE APPLICABLE PURCHASE ORDER AND SHALL NOT BE MODIFIED, REPRODUCED OR USED FOR ANY OTHER PURPOSE WITHOUT PRIOR WRITTEN APPROVAL OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC.

THE GENERAL CONTRACTOR AND/OR ERECTOR IS SOLELY RESPONSIBLE FOR ACCURATE, GOOD QUALITY WORKMANSHIP IN ERECTING THIS BUILDING IN CONFORMANCE WITH THIS DRAWING, DETAILS REFERENCED IN THIS DRAWING, ALL APPLICABLE VP ERECTION GUIDES, AND INDUSTRY STANDARDS PERTAINING TO PROPER ERECTION, INCLUDING THE CORRECT USE OF TEMPORARY BRACING.

Varco Pruden Buildings, a division of BlueScope Buildings North America, Inc.
3200 Players Club Circle Memphis TN 38125

REV	DATE	BY	DESCRIPTION



NTS

0.022"(MIN.) 1 1/8" x 36" STEEL STRUCTURAL ROOF PANEL

BUILDER	CUSTOMER	LOCATION	PROJECT	BUILDERS PO#

DRAWING NO. FLPROOF1
DATE
DRAWN/CHECK JXS /
PAGE 2 OF 5

VP BUILDINGS
VARCO-PRUDEN
A BlueScope Steel Company
VPC VERSION: 7.1c

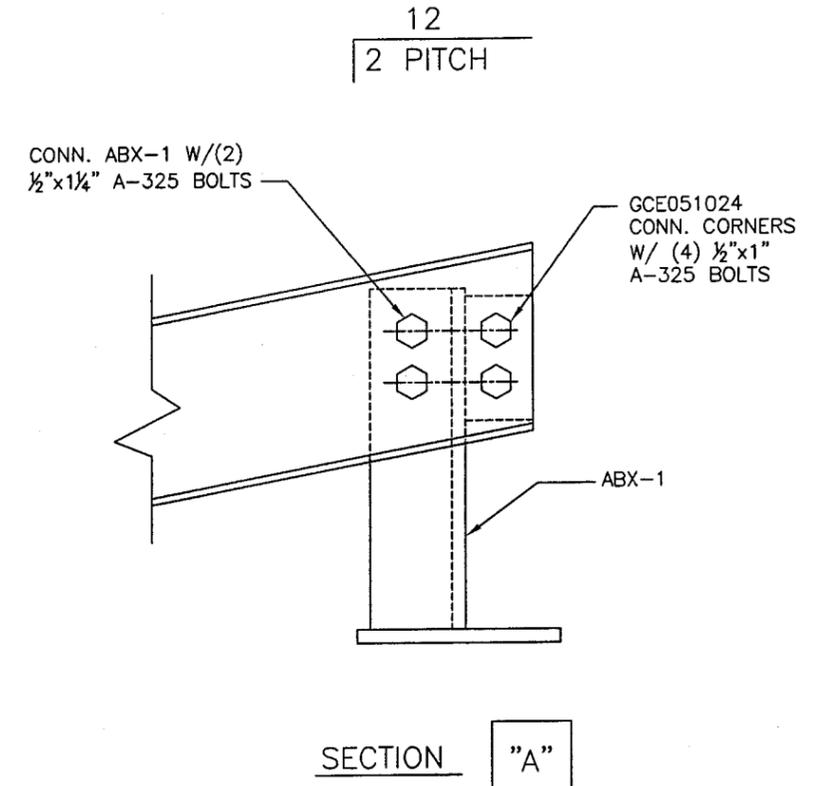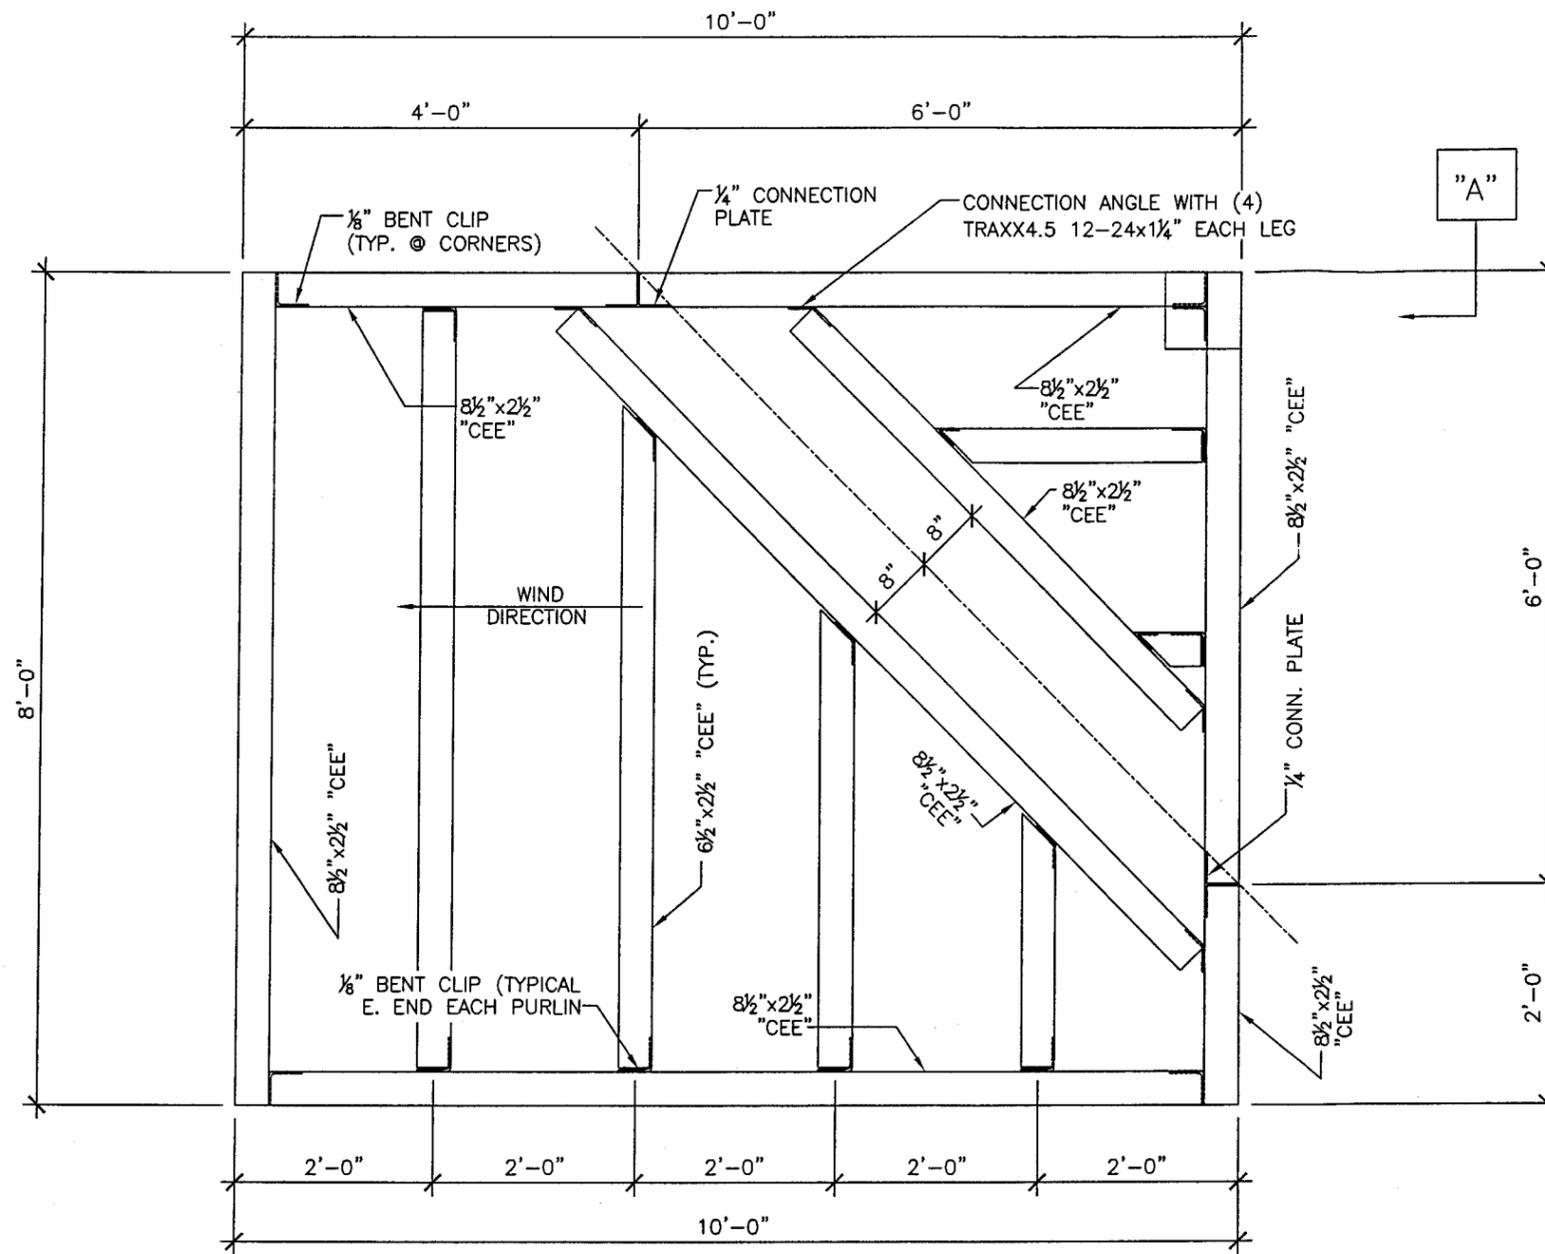

SECTION "A"

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0402.21
 Expiration Date 03/07/2014
 By *Heather A. Walker*
 Miami Dade Product Control
 Division

Larry L. Boozer
 6/11/09
 LARRY L. BOOZER PE
 No. 44236
 VP BUILDINGS
 1140 W. MOUNTAIN STREET
 KERNERSVILLE, NC 27284

NOTE: THIS PANEL SHALL BE USED FOR ROOF CONSTRUCTION ONLY. FRAMING AND DETAILS SHOWN REPRESENT ACTUAL CONSTRUCTION DETAILS IN FIELD AND FOR TEST SPECIMENS USED IN TAS125-03 STANDARD REQUIREMENTS FOR METAL ROOF SYSTEMS. SIZES OF TEST APPARATUS VARY, REFER TO SPECIFIC TEST FOR SAMPLE SIZE. EACH ACTUAL ROOF PROJECT SHALL BE CONSTRUCTED USING THE SAME DETAILS SHOWN ON THESE DRAWINGS. INCLUDING: A) DETAILS OF ALL PANEL RIB SECTIONS WITH DIMENSIONS AND THICKNESS; B) ASSEMBLY DETAILS INCLUDING ALL CONNECTIONS; C) FASTENER DIAGRAM WITH THE SIZE AND LOCATION; D) PANEL MATERIAL CHARACTERISTICS.

THE VP ENGINEER'S SEAL APPLIES ONLY TO THE WORK PRODUCT OF VP AND DESIGN AND PERFORMANCE REQUIREMENTS SPECIFIED BY VP. THE VP ENGINEER'S SEAL DOES NOT APPLY TO THE PERFORMANCE OR DESIGN OF ANY OTHER PRODUCT OR COMPONENT FURNISHED BY VP EXCEPT TO ANY DESIGN OR PERFORMANCE REQUIREMENTS SPECIFIED BY VP.

TESTED ROOFSLOPE:
 2:12

THIS DRAWING, INCLUDING THE INFORMATION HEREON, REMAINS THE PROPERTY OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC. IT IS PROVIDED SOLELY FOR ERECTING THE BUILDING DESCRIBED IN THE APPLICABLE PURCHASE ORDER AND SHALL NOT BE MODIFIED, REPRODUCED OR USED FOR ANY OTHER PURPOSE WITHOUT PRIOR WRITTEN APPROVAL OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC.

THE GENERAL CONTRACTOR AND/OR ERECTOR IS SOLELY RESPONSIBLE FOR ACCURATE, GOOD QUALITY WORKMANSHIP IN ERECTING THIS BUILDING IN CONFORMANCE WITH THIS DRAWING, DETAILS REFERENCED IN THIS DRAWING, ALL APPLICABLE VP ERECTION GUIDES, AND INDUSTRY STANDARDS PERTAINING TO PROPER ERECTION, INCLUDING THE CORRECT USE OF TEMPORARY BRACING.

Varco Pruden Buildings, a division of
 BlueScope Buildings North America, Inc.
 3200 Players Club Circle Memphis TN 38125

0.022"(MIN.) 1 3/16" x 36" STEEL STRUCTURAL
 VALLEY PANEL



REV	DATE	BY	DESCRIPTION

BUILDER	
CUSTOMER	
LOCATION	
PROJECT	
BUILDERS PO#	


VP BUILDINGS
 VARCO-PRUDEN
 A BlueScope Steel Company
 VPC VERSION: 7.1c

DRAWING NO	FLPRROOF1
DATE	
DRAWN/CHECK	JMS /
PAGE	3 OF 5


NTS

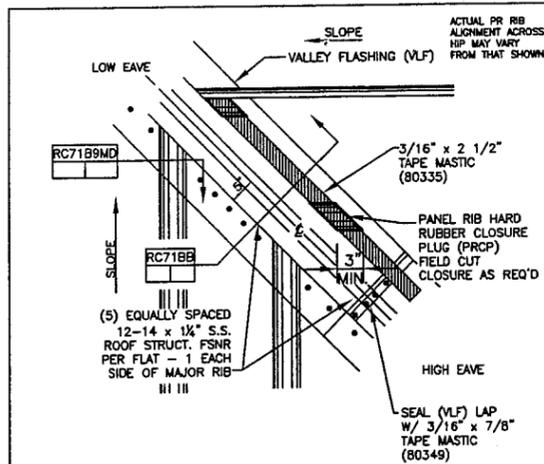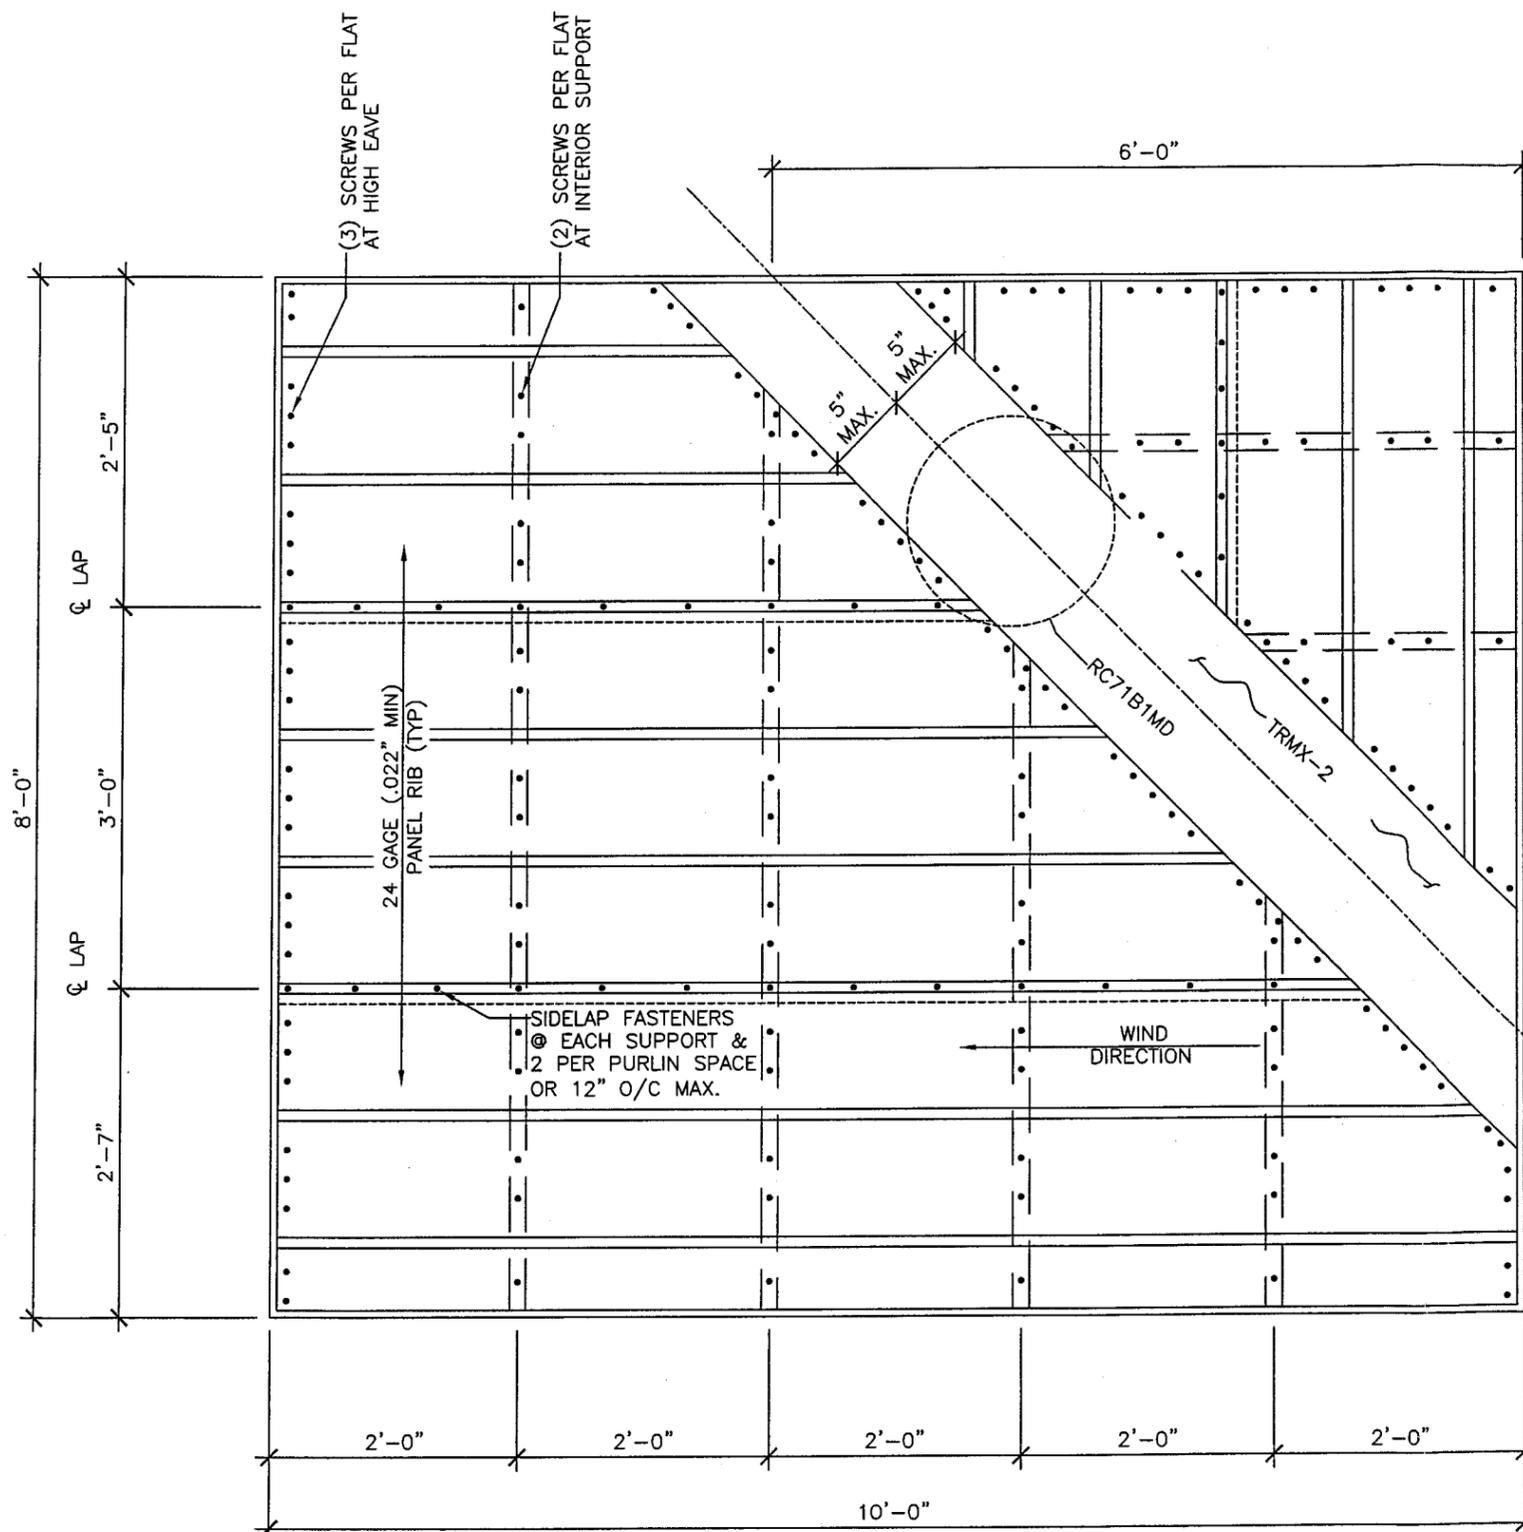


PANEL RIB VALLEY FLASHING RC71B1MD
PLAN VIEW
RC71B1M4 R 11/09/2004

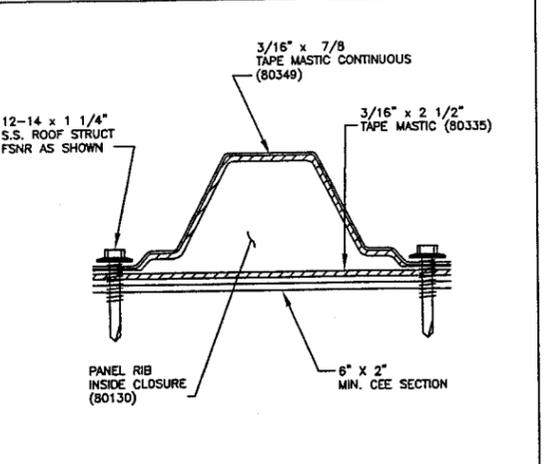

PANEL RIB AT VALLEY RC71B9MD
RC71B9MD R 2/24/2009

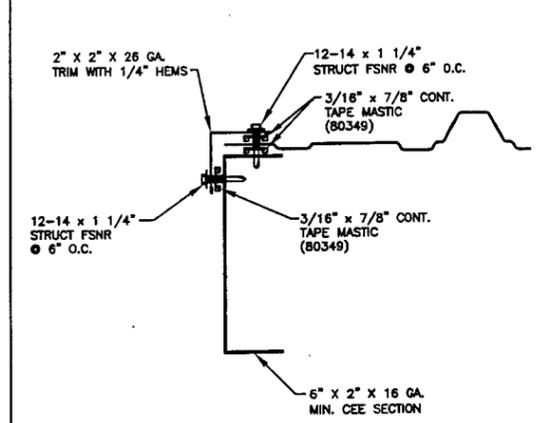

ADDITIONAL RAKE FLASHING REQUIRED AT ROOF PITCHES OF 2:12 OR GREATER
NOTE: THIS DETAIL IS IN ADDITION TO THE STANDARD DETAILS SHOWN ON STANDARD RAKE DETAILS (SD)
RC71B9M3 R 11/03/2009

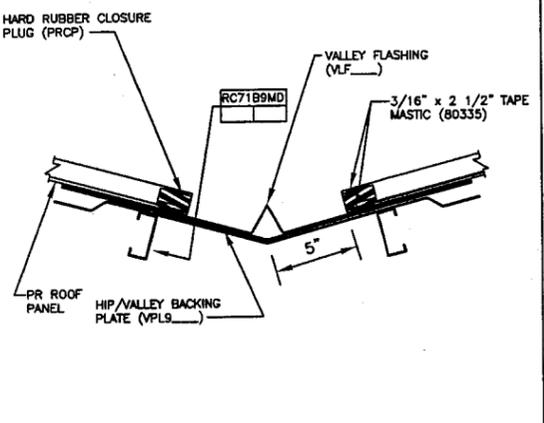

PANEL RIB VALLEY FLASHING RC71BB
RC71BB R 11/03/2009

PANEL RIB ROOF SYSTEMS CONSISTS OF 0.022"(MIN.) 1 3/16" X 36" STEEL STRUCTURAL ROOF PANEL (PANEL RIB) AND ATTACHMENTS TO SECONDARY STRUCTURAL MEMBERS, SEALANTS, MASTICS, CLOSURES AND TRIM AND/OR FLASHINGS NECESSARY TO PROVIDE WEATHERTIGHTNESS AND/OR FINISHED APPEARANCE. PANEL RIB ROOF SYSTEM MAY BE USED WITH ALL VARCO-PRUDEN STANDARD PRIMARY FRAMING SYSTEMS AND SECONDARY STRUCTURAL MEMBERS (EXCEPT TRANSBAY JOISTS) WITH A MINIMUM ROOF PITCH 1/2:12. PANEL RIB ROOF PANELS PROVIDE 36" WIDE NET COVERAGE AND HAVE 1 3/16" HIGH MAJOR RIBS AT 12" ON CENTER WITH MINOR RIBS SPACED BETWEEN THE MAJOR RIBS. SIDE LAPS ARE AT LEAST ONE FULL MAJOR RIB. THE ROOF UNDERLYING RIB UTILIZES A SUPPORTING MEMBER BEARING EDGE. THE ROOF OVERLAPING RIB UTILIZES AN ANTI-CAPILLARY GROOVE. ALL PANELS ARE CONTINUOUS FROM EAVE TO RIDGE EXCEPT WHERE THE LENGTH EXCEEDS 41' OR OTHERWISE BECOMES PROHIBITIVE FOR HANDLING PURPOSES, IN WHICH CASE, ENDLAPS ARE PROVIDED.

GALVALUME AND GALVANIZED STEEL COIL USED IN ROLL FORMED OR PRESS BROKEN ROOF COVERING GENERALLY WILL BE MATERIAL BASED ON THE REQUIREMENTS OF ASTM A792 FOR GALVALUME AND A653 FOR GALVANIZED. THE MINIMUM YIELD STRENGTH IS 50,000 PSI.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0402.21
Expiration Date 03/07/2014
By *Halley A. Melton*
Miami Dade Product Control
Division

Larry Boozer
6/16/09
LARRY L. BOOZER PE
No. 44236
VP BUILDINGS
1140 W. MOUNTAIN STREET
KERNERSVILLE, NC 27284

NOTE: THIS PANEL SHALL BE USED FOR ROOF CONSTRUCTION ONLY. FRAMING AND DETAILS SHOWN REPRESENT ACTUAL CONSTRUCTION DETAILS IN FIELD AND FOR TEST SPECIMENS USED IN T&S125-03 STANDARD REQUIREMENTS FOR METAL ROOF SYSTEMS. SIZES OF TEST APPARATUS VARY, REFER TO SPECIFIC TEST FOR SAMPLE SIZE. EACH ACTUAL ROOF PROJECT SHALL BE CONSTRUCTED USING THE SAME DETAILS SHOWN ON THESE DRAWINGS, INCLUDING: A) DETAILS OF ALL PANEL RIB SECTIONS WITH DIMENSIONS AND THICKNESS; B) ASSEMBLY DETAILS INCLUDING ALL CONNECTIONS; C) FASTENER DIAGRAM WITH THE SIZE AND LOCATION; D) PANEL MATERIAL CHARACTERISTICS.

THE VP ENGINEER'S SEAL APPLIES ONLY TO THE WORK PRODUCT OF VP AND DESIGN AND PERFORMANCE REQUIREMENTS SPECIFIED BY VP. THE VP ENGINEER'S SEAL DOES NOT APPLY TO THE PERFORMANCE OR DESIGN OF ANY OTHER PRODUCT OR COMPONENT FURNISHED BY VP EXCEPT TO ANY DESIGN OR PERFORMANCE REQUIREMENTS SPECIFIED BY VP.


TESTED ROOFSLOPE:
2:12






THIS DRAWING, INCLUDING THE INFORMATION HEREON, REMAINS THE PROPERTY OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC. IT IS PROVIDED SOLELY FOR THE BUILDING DESCRIBED IN THE APPLICABLE PURCHASE ORDER AND SHALL NOT BE MODIFIED, REPRODUCED OR USED FOR ANY OTHER PURPOSE WITHOUT PRIOR WRITTEN APPROVAL OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC.

THE GENERAL CONTRACTOR AND/OR ERECTOR IS SOLELY RESPONSIBLE FOR ACCURATE, GOOD QUALITY WORKMANSHIP IN ERECTING THIS BUILDING IN CONFORMANCE WITH THIS DRAWING, DETAILS REFERENCED IN THIS DRAWING, ALL APPLICABLE VP ERECTION GUIDES, AND INDUSTRY STANDARDS PERTAINING TO PROPER ERECTION, INCLUDING THE CORRECT USE OF TEMPORARY BRACING.

Varco Pruden Buildings, a division of BlueScope Buildings North America, Inc. 3200 Players Club Circle Memphis TN 38125			
REV	DATE	BY	DESCRIPTION
NTS			

0.022"(MIN.) 1 3/16" x 36" STEEL STRUCTURAL VALLEY PANEL		DRAWING NO. FLPRROOF1
BUILDER	CUSTOMER	DATE
LOCATION	PROJECT	DRAWN/CHECK JXS /
BUILDERS PO#		PAGE 4 OF 5

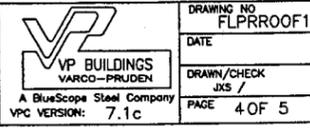

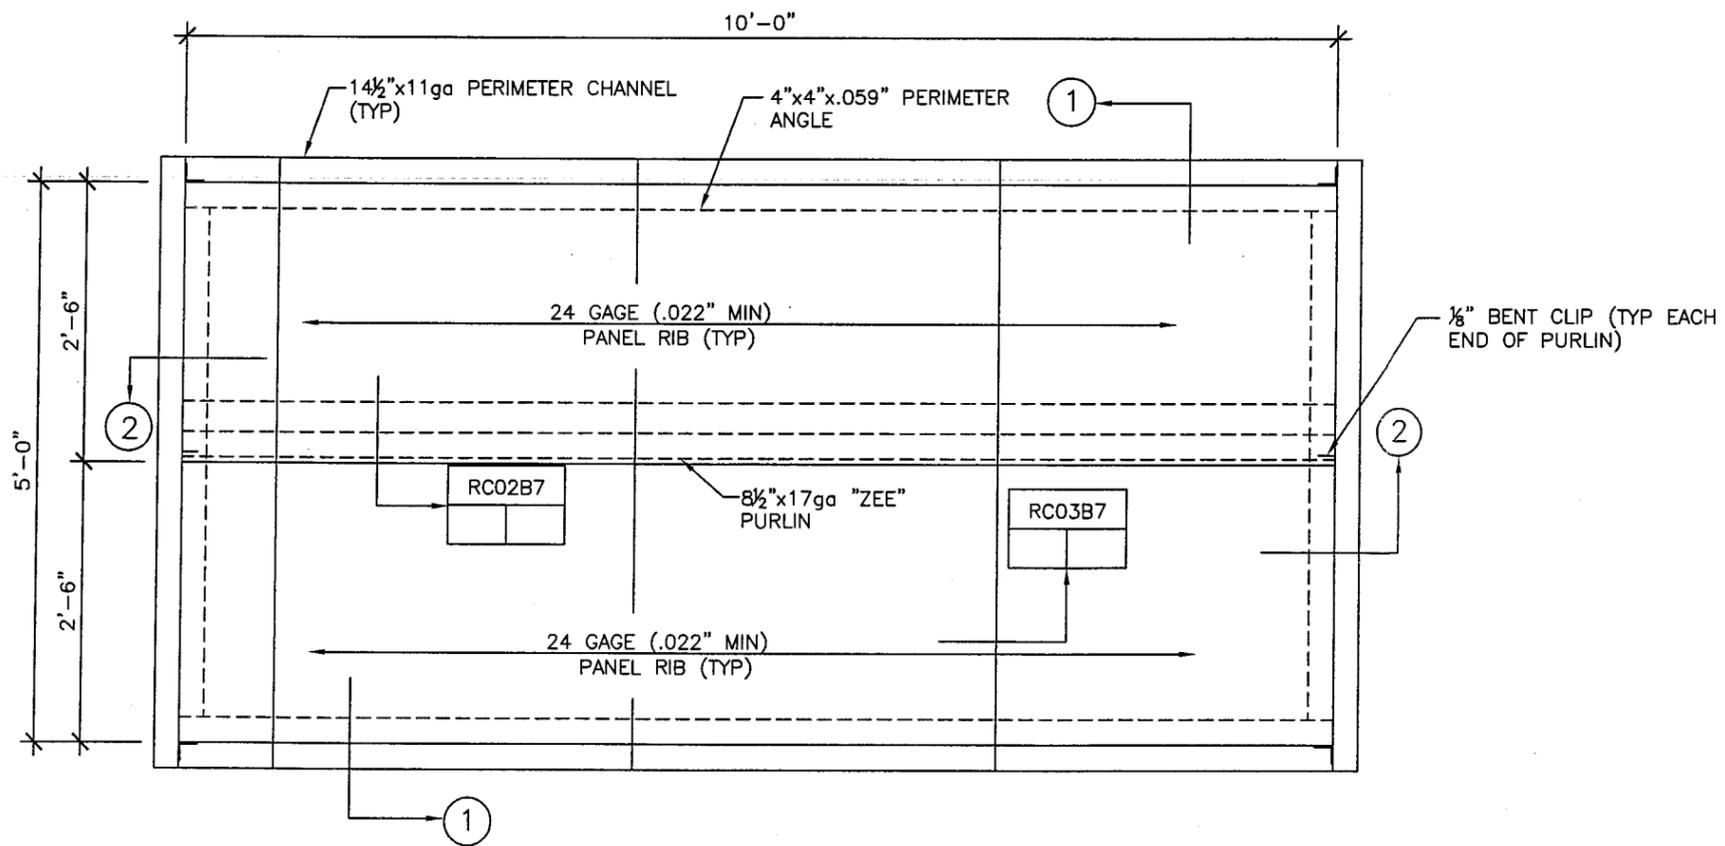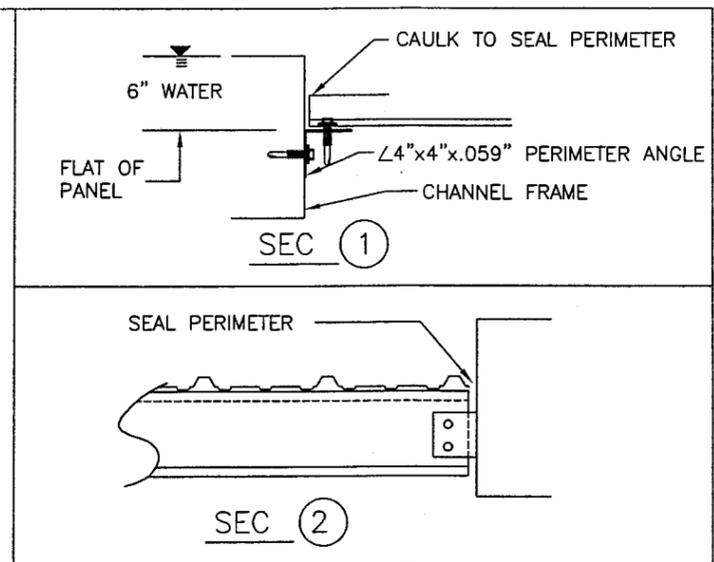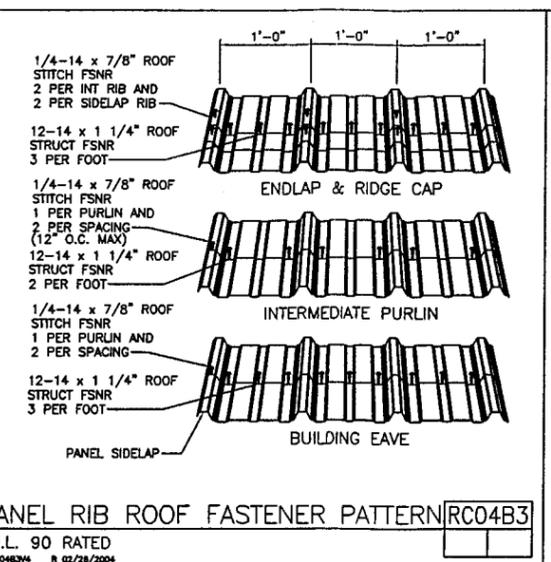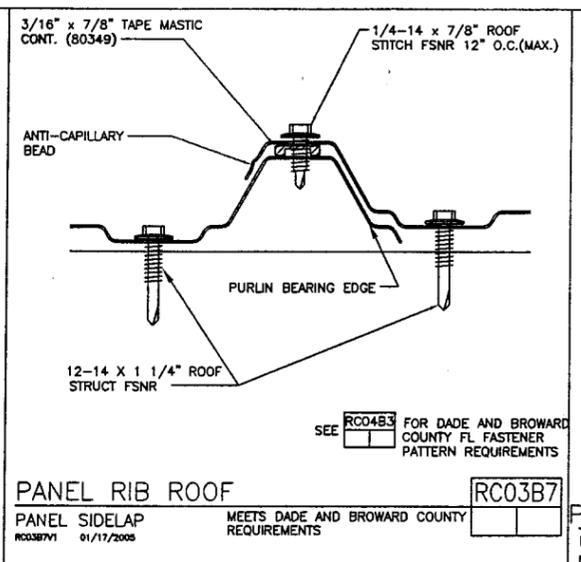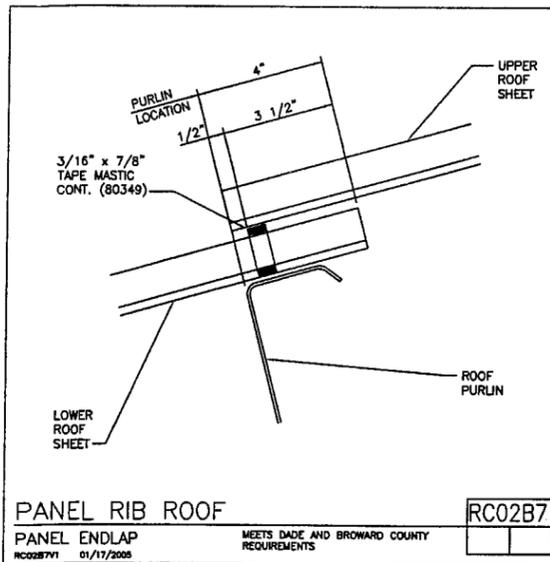

- ROOF PANEL COATINGS AND / OR FINISHES CONSIST OF THE FOLLOWING:
1. GALVALUME AZ55 AN ALUMINUM-ZINC ALLOY COATING THICKNESS OF APPROXIMATELY .0018" APPLIED TO BOTH SIDES OF BASE METAL.
 2. GALVALUME AZ50 AN ALUMINUM-ZINC ALLOY COATING THICKNESS OF APPROXIMATELY .0016" APPLIED TO BOTH SIDES OF BASE METAL.
 3. GALVANIZED G90 A ZINC COATING THICKNESS OF APPROXIMATELY .0015" APPLIED TO BOTH SIDES OF BASE METAL.
 4. GALVALUME AZ55 MAY OR MAY NOT HAVE AN SP OR KXL COATING.
 5. GALVALUME AZ50 AND GALVANIZED G90 MUST HAVE AN SP OR KXL COATING.

FASTENERS
 EXPOSED FASTENERS ARE SELF DRILLING, STAINLESS STEEL-CAPPED WITH INTEGRAL SEALING WASHER. COLOR OF FASTENER HEADS MATCH THE ROOF PANEL FINISH WHEN SPECIFIED. CONCEALED FASTENERS ARE SELF-DRILLING WITH THE TYPE AND SIZE AS REQUIRED BY ROOF SECONDARY STRUCTURAL MEMBERS. LOCATION AND QUANTITIES OF FASTENERS ARE INDICATED ON THE DETAILS ABOVE. FASTENERS ARE MANUFACTURED BY ITW BUILDEX 1349 WEST MANOR AVE. ITASCA, IL 60143.

CLOSURES, MASTICS, AND SEALANTS
 CLOSURES, FORMED TO MATCH ROOF PANEL PROFILES ARE SUPPLIED AS REQUIRED OR SPECIFIED TO PROVIDE WEATHERTIGHTNESS. CLOSURES ARE OF A COATED COIL MATERIAL, NORMALLY EPDM (ETHYLENE-PROPYLENE-DUENE-MONOMRE) IN A GRAY OR NEUTRAL COLOR. CLOSURES ARE MANUFACTURED BY HANNA RUBBER COMPANY INC. 1511 BALTIMORE AVE. KANSAS CITY, MO 64108. PREFORMED TAPE MASTICS, AND/OR NON-SKINNING TUBE SEALANTS ARE SUPPLIED FOR THE SIDELAPS AND ENDLAPS OF ALL VARCO-PRUDEN ROOF COVERINGS. TAPE MASTIC IS PREFORMED BUTYL RUBBER-BASED COMPOUND. THE COMPOUND IS NON-HARDENING, NON-CORROSIVE TO METAL AND HAS EXCELLENT ADHESION PROPERTIES. TAPE MASTIC IS WHITE OR LIGHT GRAY IN COLOR. TAPE MASTIC IS MAUNUFACTURED BY SIKA CORP. 30800 STEPHENSON HWY. MADISON HEIGHTS, MI 48071. TUBE SEALANT IS A SYNTHETIC ELASTOMER BASED MATERIAL. SEALANT COLOR IS GRAY OR BRONZE. TUBE SEALANT IS MANUFACTURED BY SIKA CORP. 30800 STEPHENSON HWY. MADISON HEIGHTS, MI 48071.

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 09-0402.21
 Expiration Date 03/07/2014
 By *Helmut A. Miller*
 Miami Dade Product Control
 Division

Larry L. Boozer
 6/16/09
 LARRY L. BOOZER PE
 No. 44236
 VP BUILDINGS
 1140 W. MOUNTAIN STREET
 KERNERSVILLE, NC 27284

NOTE: THIS PANEL SHALL BE USED FOR ROOF CONSTRUCTION ONLY. FRAMING AND DETAILS SHOWN REPRESENT ACTUAL CONSTRUCTION DETAILS IN FIELD AND FOR TEST SPECIMENS USED IN TAS125-03 STANDARD REQUIREMENTS FOR METAL ROOF SYSTEMS. SIZES OF TEST APPARATUS VARY, REFER TO SPECIFIC TEST FOR SAMPLE SIZE. EACH ACTUAL ROOF PROJECT SHALL BE CONSTRUCTED USING THE SAME DETAILS SHOWN ON THESE DRAWINGS. INCLUDING: A) DETAILS OF ALL PANEL RIB SECTIONS WITH DIMENSIONS AND THICKNESS; B) ASSEMBLY DETAILS INCLUDING ALL CONNECTIONS; C) FASTENER DIAGRAM WITH THE SIZE AND LOCATION; D) PANEL MATERIAL CHARACTERISTICS.

THE VP ENGINEER'S SEAL APPLIES ONLY TO THE WORK PRODUCT OF VP AND DESIGN AND PERFORMANCE REQUIREMENTS SPECIFIED BY VP. THE VP ENGINEER'S SEAL DOES NOT APPLY TO THE PERFORMANCE OR DESIGN OF ANY OTHER PRODUCT OR COMPONENT FURNISHED BY VP EXCEPT TO ANY DESIGN OR PERFORMANCE REQUIREMENTS SPECIFIED BY VP.

TESTED ROOFSLOPE:
 FLAT

THIS DRAWING, INCLUDING THE INFORMATION HEREON, REMAINS THE PROPERTY OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC. IT IS PROVIDED SOLELY FOR ERECTING THE BUILDING DESCRIBED IN THE APPLICABLE PURCHASE ORDER AND SHALL NOT BE MODIFIED, REPRODUCED OR USED FOR ANY OTHER PURPOSE WITHOUT PRIOR WRITTEN APPROVAL OF VARCO PRUDEN BUILDINGS, A DIVISION OF BLUESCOPE BUILDINGS NORTH AMERICA, INC.

THE GENERAL CONTRACTOR AND/OR ERECTOR IS SOLELY RESPONSIBLE FOR ACCURATE, GOOD QUALITY WORKMANSHIP IN ERECTING THIS BUILDING IN CONFORMANCE WITH THIS DRAWING, DETAILS REFERENCED IN THIS DRAWING, ALL APPLICABLE VP ERECTION GUIDES, AND INDUSTRY STANDARDS PERTAINING TO PROPER ERECTION, INCLUDING THE CORRECT USE OF TEMPORARY BRACING.

Varco Pruden Buildings, a division of BlueScope Buildings North America, Inc. 3200 Players Club Circle Memphis TN 38125

REV	DATE	BY	DESCRIPTION

NTS

0.022"(MIN.) 1 3/8" x 36" STEEL STRUCTURAL ROOF PANEL	DRAWING NO. FLRPR001
	DATE
	DRAWN/CHECK
	JXS /
	PAGE 5 OF 5

VP BUILDINGS
 VARCO-PRUDEN
 A BlueScope Steel Company
 VPC VERSION: 7.1c