



MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339
www.miamidade.gov/buildingcode

BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION
NOTICE OF ACCEPTANCE (NOA)

ECO Window Systems, LLC.
 745 W 18 Street
 Hialeah, FL 33010

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: ECO-Guard Series-300 Aluminum Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. W09-20, titled "ECO-Guard Series-300 Aluminum Fixed Window (L.M.I.)", sheets 1 through 5 of 5, dated 03/23/09, with revision date of 05/18/09, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



J. Gascon
 5/27/09

NOA No. 09-0413.08
 Expiration Date: June 17, 2014
 Approval Date: June 17, 2009
 Page 1


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W09-20**, titled "ECO-Guard Series-300 Aluminum Fixed Window (L.M.I.)", sheets 1 through 5 of 5, dated 03/23/09, with revision date of 05/18/09, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
Along with installation diagram of a 97 1/4" wide x 96 1/8" high Eco-Guard Series 300 aluminum Double Fixed Window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2192A**, dated January 15, 2009, signed and sealed by Candido F. Font, P.E.
2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
Along with installation diagram of a 97 1/4" wide x 96 1/8" high Eco-Guard Series 300 Aluminum Double Fixed Window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2192B**, dated January 15, 2009, signed and sealed by Candido F. Font, P.E.
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
Along with installation diagram of a 48 1/4" wide x 96 3/8" high Eco-Guard Series 300 Aluminum Circular Arch Top Fixed Window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2193A**, dated January 15, 2009, signed and sealed by Candido F. Font, P.E.
4. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
Along with installation diagram of a 48 1/4" wide x 96 3/8" high Eco-Guard Series 300 Aluminum Circular Arch Top Fixed Window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2193B**, dated January 15, 2009, signed and sealed by Candido F. Font, P.E.
5. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
Along with installation diagram of a 47 5/8" wide x 96" high Eco-Guard Series 300 Aluminum Triangular Top Fixed Window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2194**, dated January 15, 2009, signed and sealed by Candido F. Font, P.E.

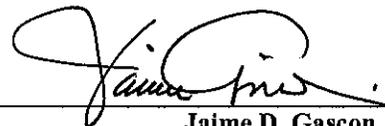

Jaime D. Gascon, P.E.

Product Control Examiner

NOA No. 09-0413.08

Expiration Date: June 17, 2014

Approval Date: June 17, 2009

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (Cont.)

6. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94

Along with installation diagram of a 50 5/8" wide x 63 1/4" high Eco-Guard Series 300 Aluminum Fixed Window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2195A**, dated January 15, 2009, signed and sealed by Candido F. Font, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004/2007, prepared by Al-Farooq Corporation, dated 03/14/09, signed and sealed by Humayoun Farooq, P.E., and letter prepared by Al-Farooq Corporation, dated 05/20/09, signed and sealed by Arshad Viqar, P.E.
Complies with ASTM E1300-02/04

D. QUALITY ASSURANCE


1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None

F. STATEMENTS

1. Statement letter of compliance, prepared by Al-Farooq Corporation, dated March 14, 2009, signed and sealed by Humayoun Farooq, P.E., and letter prepared by Al-Farooq Corporation, dated May 20, 2009, signed and sealed by Arshad Viqar, P.E.
2. No financial interest letter, prepared by Al-Farooq Corporation, dated March 14, 2009, signed and sealed by Humayoun Farooq, P.E., and letter prepared by Al-Farooq Corporation, dated May 20, 2009, signed and sealed by Arshad Viqar, P.E.

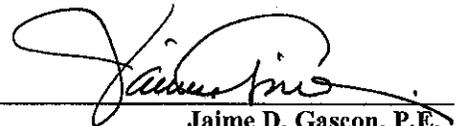


Jaime D. Gascon, P.E.

Product Control Examiner


NOA No. 09-0413.08

Expiration Date: June 17, 2014


Approval Date: June 17, 2009

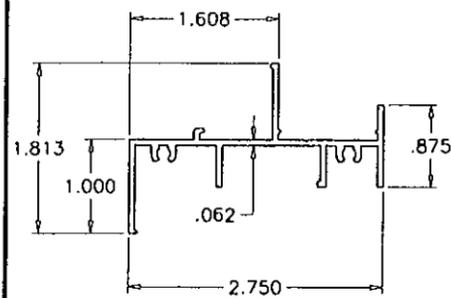


① FRAME HEAD/SILL/JAMB

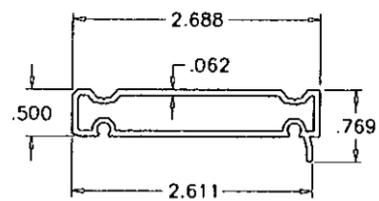

⑦ FLUSH FRAME ADAPTER



② GLAZING BEAD



③ ANCHOR COVER

**ECO-GUARD SERIES-300
ALUMINUM FIXED WINDOW**

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEETS 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIX./FIX. OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004/2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

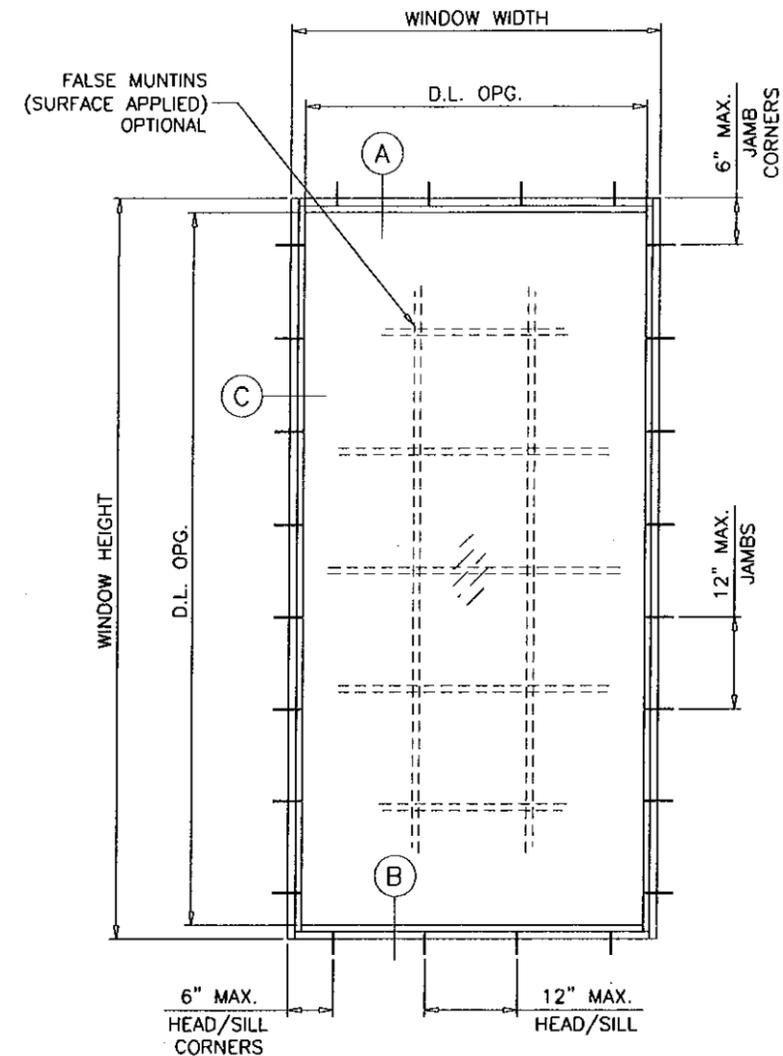

TYPICAL ELEVATION

GLASS D.L.O. DIMS.

D.L.O. HEIGHT = WINDOW HEIGHT - 3.625"
D.L.O. WIDTH = WINDOW WIDTH - 3.625"

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

[Signature]
MAY 21 2009

Approved as complying with the
Florida Building Code
Date June 17, 2009
NOA# 09-041308
Miami Dade Product Control
Division
By *[Signature]*




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANI\W09-20ECO

ECO-GUARD SERIES-300 ALUM FIXED WDW. (L.M.I.)
ECO WINDOW SYSTEMS, LLC.
745 WEST 18TH STREET
HIALEAH, FL. 33010
TEL. (305) 261-2223 FAX (305) 261-2539


no.	date	by	description
A	05.18.09	REV. PER	BCCO COMMENTS

date: 03-23-09
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W09-20
sheet 1 of 5

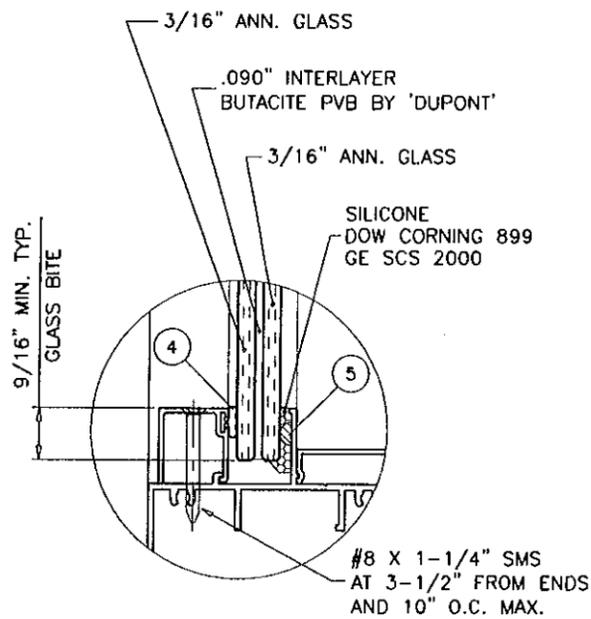


GLASS TYPE 'C'

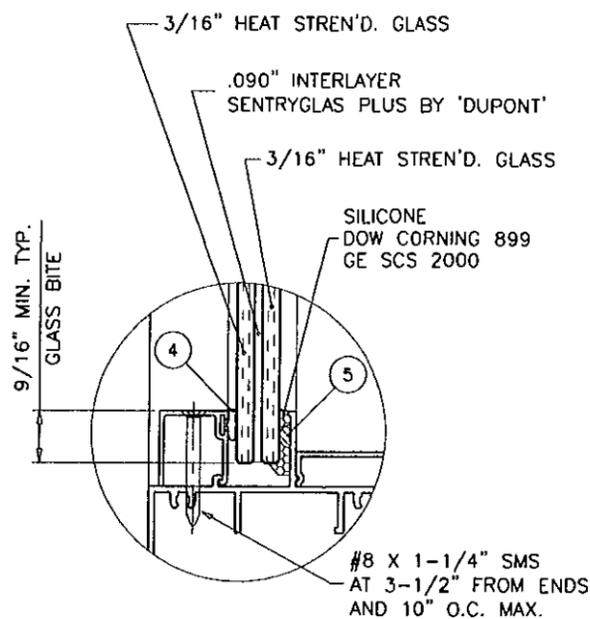

GLASS TYPE 'D'


GLAZING OPTIONS

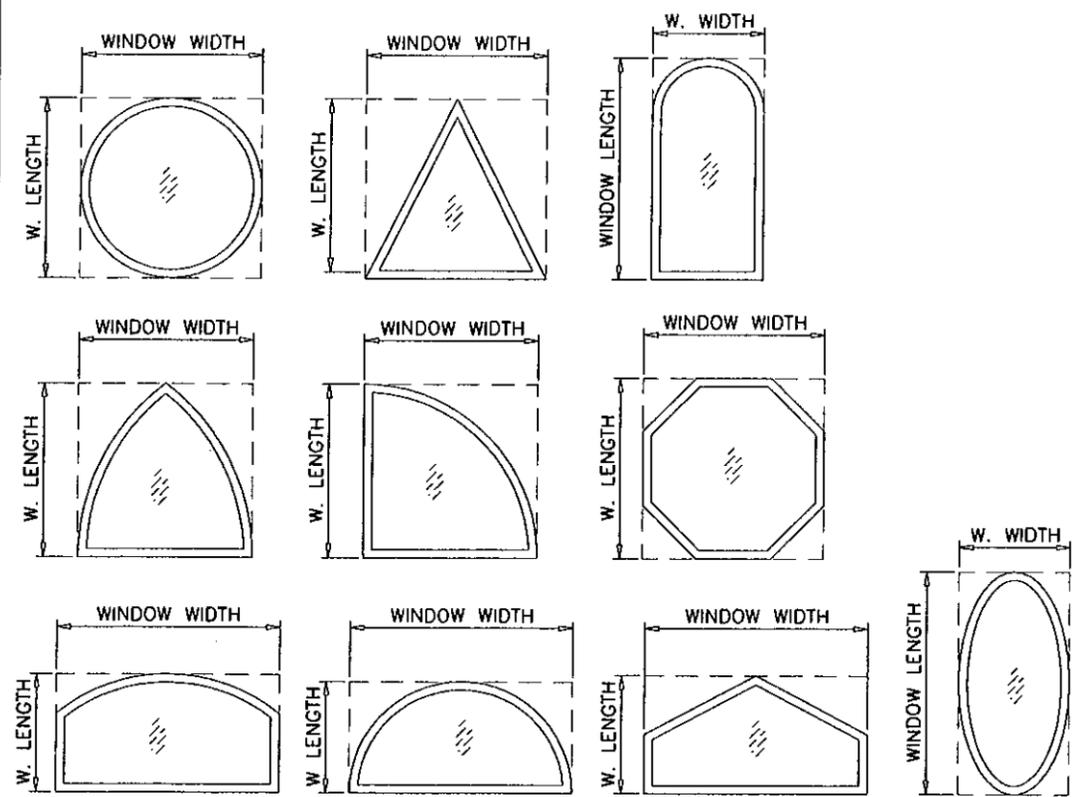

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH (W)	LENGTH (L)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	36"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		75.0	80.0	80.0	90.0
42"		75.0	80.0	80.0	90.0
48"		75.0	80.0	80.0	90.0
54"		75.0	80.0	80.0	90.0
60"		75.0	80.0	80.0	90.0
72"		75.0	80.0	80.0	90.0
24"	48"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		75.0	80.0	80.0	90.0
42"		75.0	80.0	80.0	90.0
48"		75.0	80.0	80.0	90.0
54"		75.0	80.0	80.0	90.0
60"		75.0	80.0	80.0	90.0
72"		75.0	80.0	80.0	90.0
24"	60"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		75.0	80.0	80.0	90.0
42"		75.0	80.0	80.0	90.0
48"		75.0	80.0	80.0	90.0
54"		66.8	71.3	80.0	90.0
60"		60.2	64.2	80.0	90.0
72"		60.2	64.2	80.0	90.0
24"	72"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		75.0	80.0	80.0	90.0
42"		75.0	80.0	80.0	90.0
48"		75.0	76.6	80.0	90.0
54"		66.8	71.3	80.0	90.0
60"		60.2	64.2	80.0	90.0
72"		60.2	64.2	80.0	90.0
24"	84"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		75.0	80.0	80.0	90.0
42"		70.0	70.0	80.0	90.0
48"		65.6	65.6	80.0	90.0
54"		64.3	64.3	80.0	90.0
72"		75.0	80.0	80.0	90.0
84"		75.0	80.0	80.0	90.0
24"	96"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		75.0	76.2	80.0	90.0
42"		64.6	64.6	80.0	90.0
48"		59.9	59.9	80.0	90.0
72"		75.0	80.0	80.0	90.0
84"		75.0	80.0	80.0	90.0
96"		74.5	74.5	80.0	90.0
24"	108"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		74.5	74.5	80.0	90.0
42"		61.5	61.5	80.0	90.0
72"		75.0	80.0	80.0	90.0
84"		75.0	80.0	80.0	90.0
96"		74.5	74.5	80.0	90.0
108"		74.5	74.5	80.0	90.0
24"	120"	75.0	80.0	80.0	90.0
30"		75.0	80.0	80.0	90.0
36"		74.5	74.5	80.0	90.0
36"		74.5	74.5	80.0	90.0

DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH (W)	LENGTH (L)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26"	75.0	80.0	80.0	90.0
37"		75.0	80.0	80.0	90.0
53-1/8"		75.0	80.0	80.0	90.0
74"		75.0	80.0	80.0	90.0
26-1/2"	38-3/8"	75.0	80.0	80.0	90.0
37"		75.0	80.0	80.0	90.0
53-1/8"		75.0	80.0	80.0	90.0
74"		75.0	80.0	80.0	90.0
26-1/2"	50-5/8"	75.0	80.0	80.0	90.0
37"		75.0	80.0	80.0	90.0
53-1/8"		71.3	76.0	80.0	90.0
74"		71.3	73.1	80.0	90.0
26-1/2"	63"	75.0	80.0	80.0	90.0
37"		75.0	80.0	80.0	90.0
53-1/8"		67.9	72.5	80.0	90.0
74"		67.9	72.5	80.0	90.0
26-1/2"	76"	75.0	80.0	80.0	90.0
37"		75.0	80.0	80.0	90.0
53-1/8"		67.9	69.9	80.0	90.0
74"		67.9	69.9	80.0	90.0

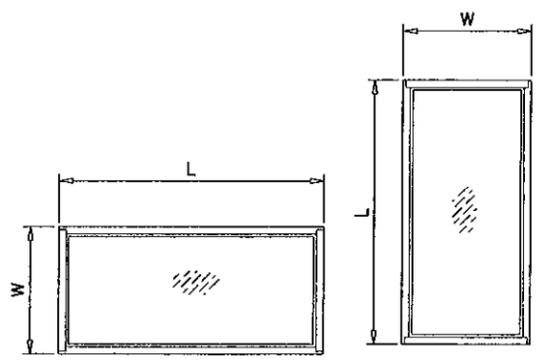

NOTE: WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE: GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-02/04 (3 SEC. GUSTS).

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538
 MAY 21 2009

Approved as complying with the Florida Building Code
 Date June 17, 2009
 NOA# 09-0413-08
 Miami Dade Product Control
 By *[Signature]*





AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W09-20ECO

ECO-WINDOW SERIES-300 ALUM FIXED WDW. (L.M.I.)
ECO WINDOW SYSTEMS, LLC.
 745 WEST 18TH STREET
 HIALEAH, FL. 33010
 TEL. (305) 261-2223 FAX (305) 261-2539

revisions:	no	date	by	description
	A	05.18.09		REV. PER BECCO COMMENTS

date: 03-23-09
 scale: 1/2"=1'-0"
 dr. by: HAMD
 chk. by:

drawing no. **W09-20**
 sheet 2 of 5

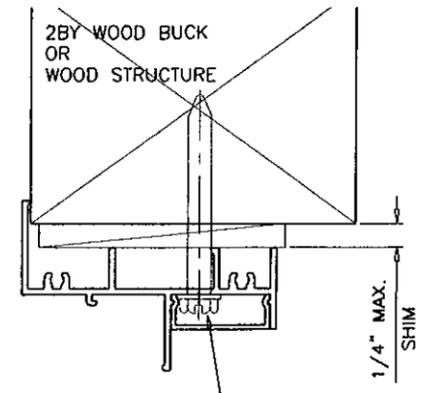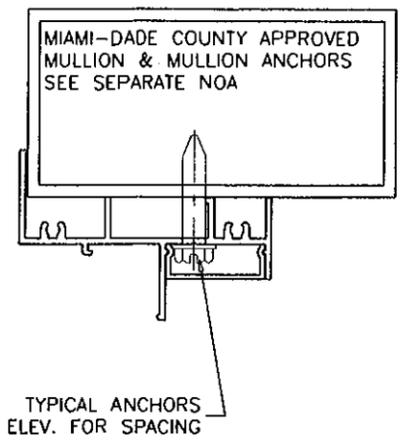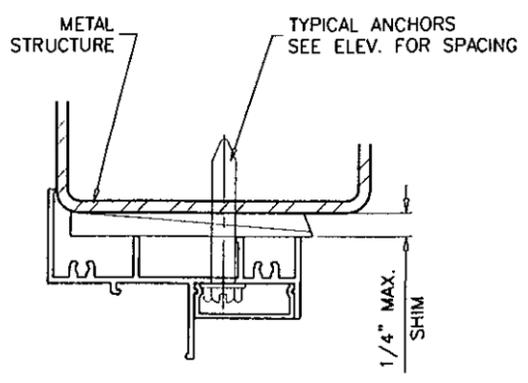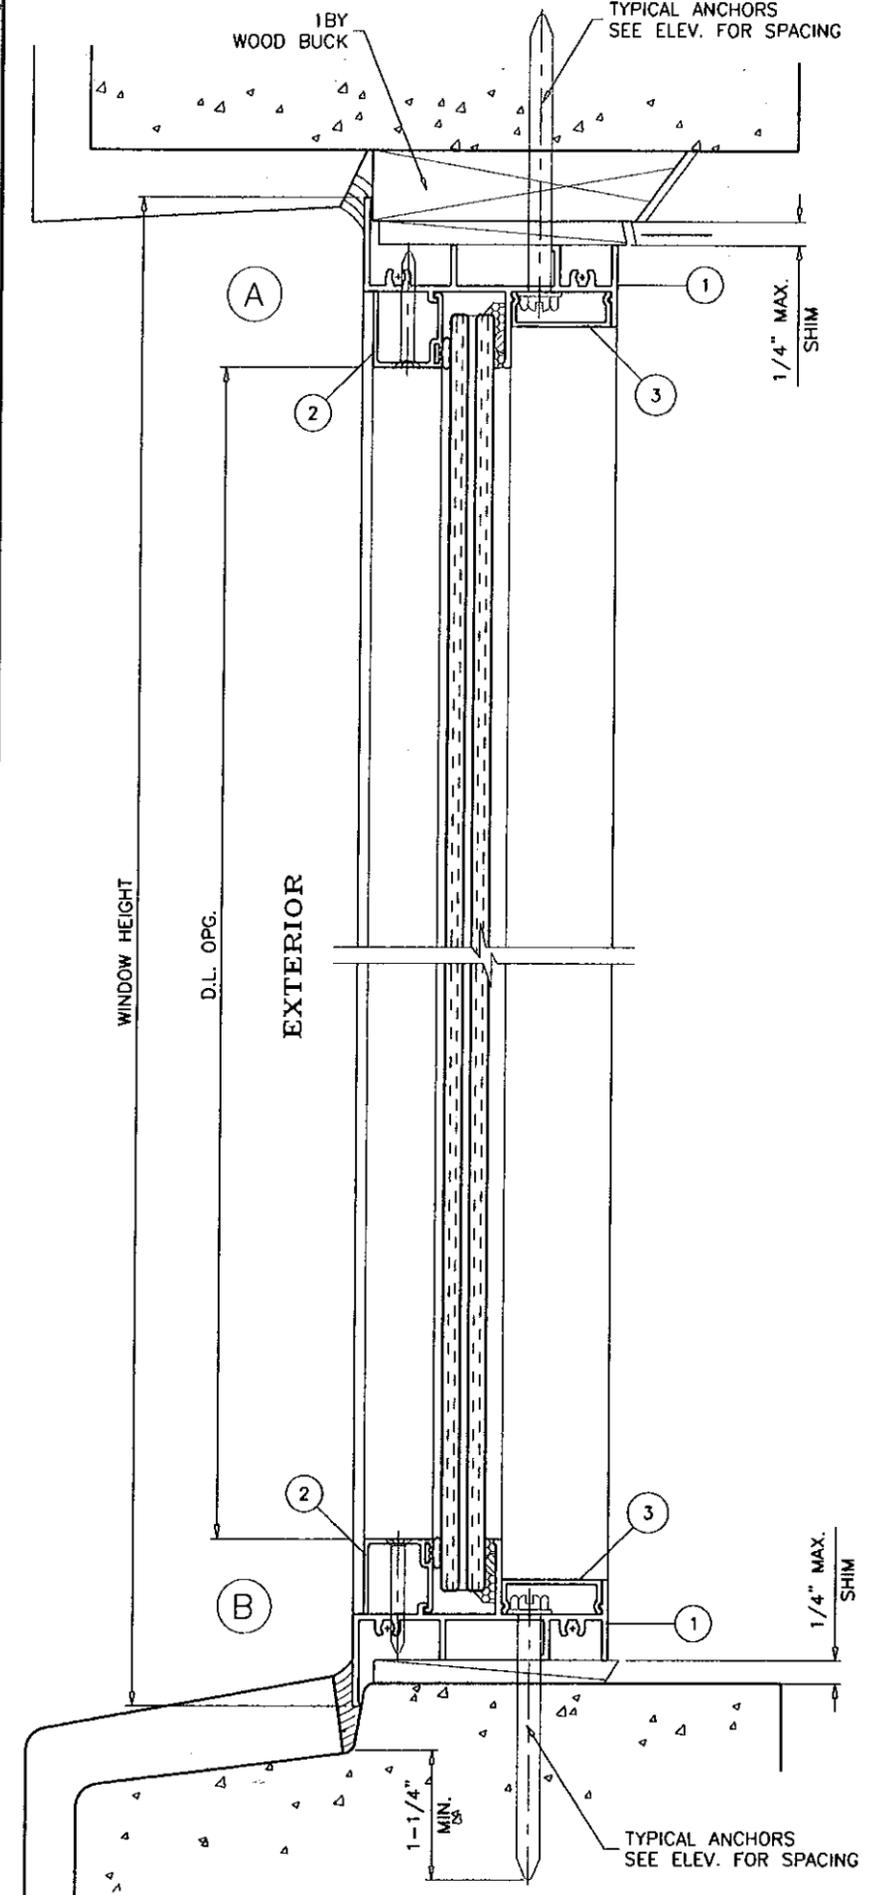

WOOD BUCKS AND METAL STRUCTURE NOT BY ECO WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
 1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY


1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO METAL STRUCTURES
 STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK f'm = 1500 PSI MIN.

SEALANT:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH JOINT SEALER.

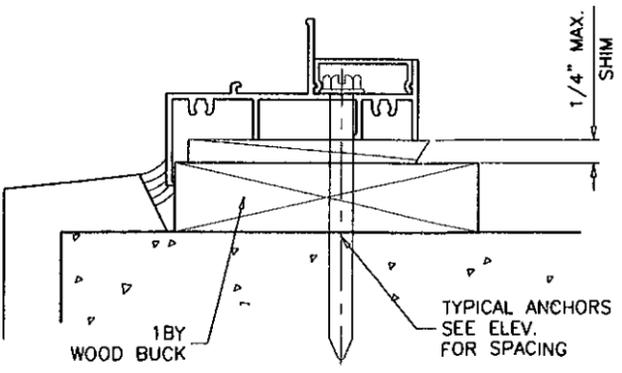

Engr: ARSHAD VIQAR
 CIVIL
 FLA. RE # 38863
 C.A.N. 3538
 MAY 21 2009

Approved as complying with the
 Florida Building Code
 Date June 17, 2009
 NOA# 09-0413-08
 Miami Dade Product Control
 Division
 By [Signature]

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANI\W09-20ECO


ECO-GUARD SERIES-300 ALUM FIXED WDW. (L.M.I.)
ECO WINDOW SYSTEMS, LLC.
 745 WEST 18TH STREET
 HIALEAH, FL. 33010
 TEL (305) 261-2223 FAX (305) 261-2539

no.	date	by	description
A	05.18.09		NO CHANGE THIS SHEET

date: 03-23-09
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W09-20
 sheet 3 of 5

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	FY301	2	FRAME HEAD/SILL/JAMB	6063-T6	-
2	FY302	AS REOD.	GLAZING BEAD- 7/16" GLASS	6063-T6	-
3	FY303	AS REOD.	ANCHOR COVER	6063-T5	-
4	E203	AS REOD.	GLAZING BEAD BULB	NEOPRENE	ULTRAFAB
5	FLB-50	1	GLASS SPACER - 1/8" HIGH	SILICONE	FRANK LOWE
6	#10 x 1"	8	FRAME ASSEMBLY SCREWS	CRS	PH SMS
7	FY120	-	FLUSH FRAME ADAPTER	6063-T6	OPTIONAL

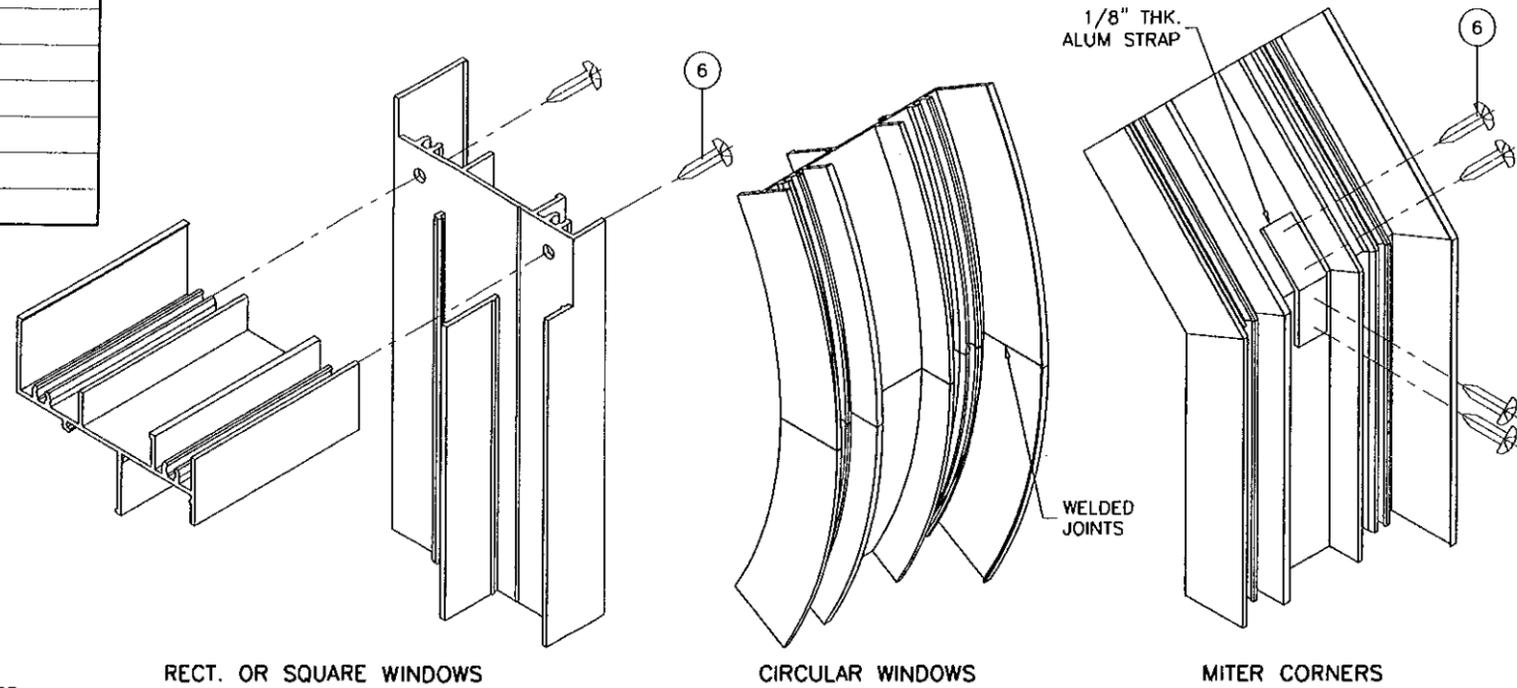


RECT. OR SQUARE WINDOWS

CIRCULAR WINDOWS

MITER CORNERS

CORNER DETAILS

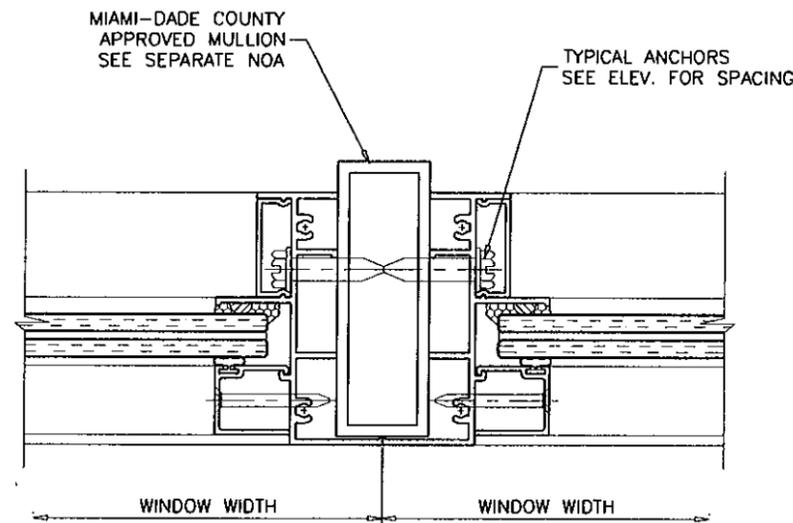

TYPICAL ANCHORS
SEE ELEV. FOR SPACING

1/4" MAX.
SHIM

2BY WOOD BUCK
OR
WOOD STRUCTURE

1

C

3

2

EXTERIOR

D.L. OPG.

WINDOW WIDTH

1/4" MAX.
SHIMS

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

1BY
WOOD BUCKS

1/4" MAX.
SHIM

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

METAL
STRUCTURE

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

MAY 27 2009

Approved as complying with the
Florida Building Code
Date June 17, 2009
NOA# 09-0413.08
Miami Dade Product Control
Division
By [Signature]

ECO-GUARD SERIES-300 ALUM FIXED WDW. (L.M.I.)

ECO WINDOW SYSTEMS, LLC.

745 WEST 18TH STREET
HIALEAH, FL. 33010

TEL. (305) 261-2223 FAX (305) 261-2539

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

1235 S.W. 87 AVE
MIAMI, FLORIDA 33174

TEL. (305) 264-8100 FAX. (305) 262-6978

revisions:
no. date by description
A 05.18.09 NO. CHANGE THIS SHEET

date: 03-23-09

scale: 1/2" = 1"

dr. by: HAMID






chk. by:

drawing no.
W09-20

sheet 4 of 5

afC

COMP-ANL\W09-20ECO

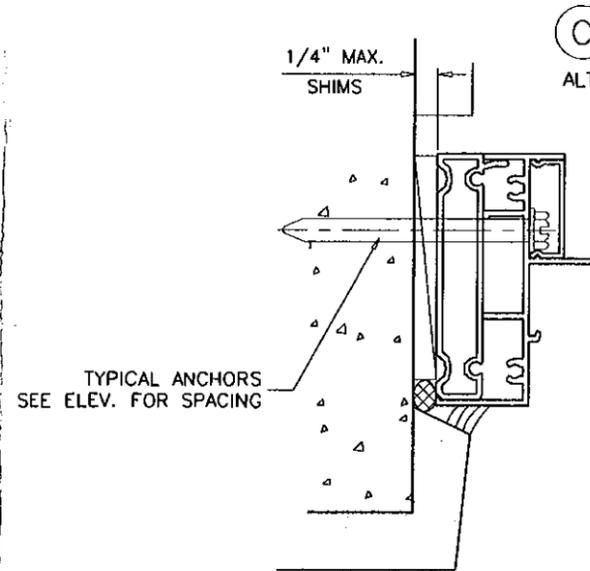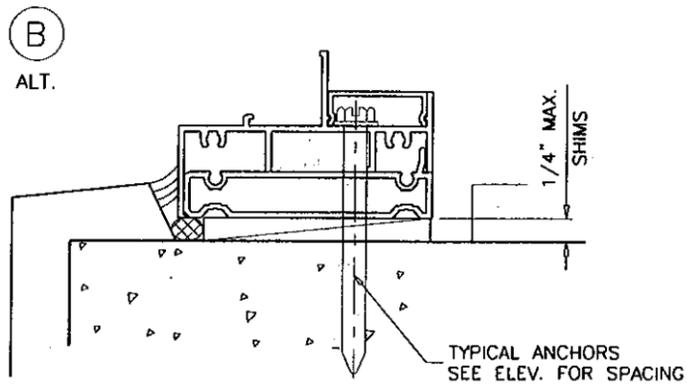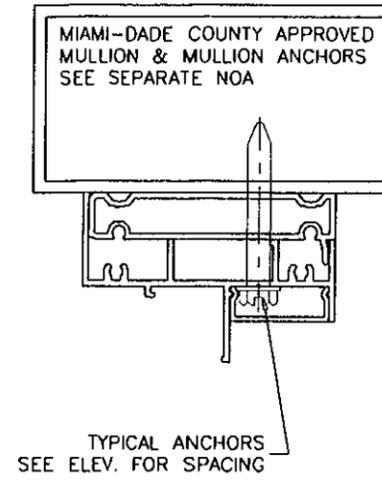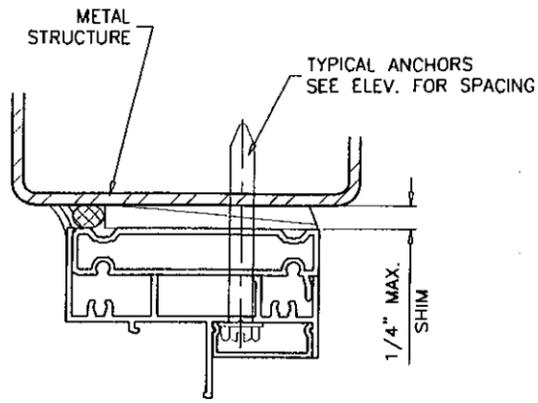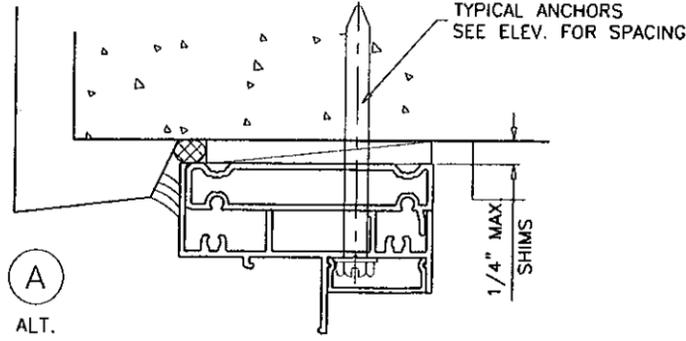

INSTALLATION DETAILS WITH FLUSH FRAME ADAPTER

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 36863
C.A.N. 3538

By *[Signature]*
MAY 21 2009

Approved as complying with the
Florida Building Code
Date June 17, 2009
NOA# 09-0413-08
Miami Dade Product Control
Division
By *[Signature]*

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W09-20ECO

ECO-GUARD SERIES-300 ALUM FIXED WDW. (L.M.I.)
ECO WINDOW SYSTEMS, LLC.
745 WEST 18TH STREET
HIALEAH, FL. 33010
TEL. (305) 261-2223 FAX (305) 261-2539

revisions:	
no	description
A	NO CHANGE THIS SHEET

date: 03-23-09
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W09-20
sheet 5 of 5