

NOTICE OF ACCEPTANCE (NOA)**www.miamidade.gov/buildingcode****Jeld-Wen, Inc (OR)****3737 Lakeport Boulevard****Klamath Falls, OR 97601****SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION:**Series "Gladiator/ Finishield" 6'8" W/E Outswing Glazed Steel Door System w/ sidelites – N.I.**

APPROVAL DOCUMENT: Drawing No. **JW122008**, titled "Series Gladiator/ Finishield Glazed Wood Edge 12-0 x 6-8 Outswing Steel Door" sheets 1 through 14 of 14, dated 08/12/08 with revision "B" dated 02/09/10, prepared by CertWorks, LLC, signed, sealed and dated 10/14/10 by Kristina S. Daugherty, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None.**LIMITATIONS:**

- 1.) Miami-Dade County Product Control Approved Shutters Or Protection Devices Shall Be Required.
- 2.) Maximum design pressure rating shall be + 30 PSF where water infiltration requirement is needed.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1, evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**

**MIAMI-DADE COUNTY
APPROVED***J. Gascon*
10/21/10**NOA No. 09-0415.08****Expiration Date: November 11, 2015****Approval Date: November 11, 2010****Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **JW122008**, titled "Series Gladiator/ Finishield Glazed Wood Edge 12-0 x 6-8 Outswing Steel Door" sheets 1 through 14 of 14, dated 08/12/08 with revision "B" dated 02/09/10, prepared by CertWorks, LLC, signed, sealed and dated 10/14/10 by Kristina S. Daugherty, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of French door with sidelites, prepared by National Certified Testing Laboratories, Inc., Test Report No. **NCTL 210-3558-1**, dated 10/07/08, signed and sealed by Gerald J. Ferrara, P. E.
2. Test reports on: 1) "Standard Test Method for Tensile Properties of Plastics" per ASTM D 638-08, tensile yield of 31.3 Ksi and tensile modulus of elasticity of 38.4 Ksi,
along with marked-up drawings and installation diagram of French door with sidelites, prepared by ETC Laboratories, Inc., Test Report No. **ETC-08-056-21686.0**, dated 10/20/08, signed and sealed by Joseph Labora Doldan, P.E.
3. Test reports on: 1) ASTM E84-08 Standard Test Method for Surface Burning Characteristics of Building Materials
along with marked-up drawings and installation diagram of dylite expandable polystyrene, prepared by Intertek Testing Services, N. A., Inc., Test Report No. **ITS 3113726SAT-001 Rev. 1**, dated 03/13/09, signed and sealed by Frederick D. Curkeet, P. E.
4. Test reports on: 1) "Standard Test Method for Tensile Properties of Plastics" per ASTM D 638-03, tensile yield of 132.0 Ksi and tensile modulus of elasticity of 15.3 Ksi;
2) "Standard Test Methods for Density and Specific Gravity (Relative Density) of Plastics by Displacement" per ASTM D792-00, G=0.4286,
along with marked-up drawings and installation diagram of Endura Products extruded PVC, prepared by IMR Test Lab., Inc., accredited by Nadcap and A2LA, Test Report No. **IMR-200707982**, dated 09/10/07, signed by Sophia Ezell and Stan Deforest, validated by O. M. Engineering Services, Inc., signed sealed and dated 09/19/08 by Nimesh Bhavsar, P. E.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0415.08

Expiration Date: November 11, 2015
Approval Date: November 11, 2010

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

- C. Test reports on: 1) "Standard Test Methods for Density and Specific Gravity (Relative Density) of Plastics by Displacement" per ASTM D792-08, G=1.11, along with marked-up drawings and installation diagram of Endura Products extruded PVC, prepared by IMR Test Lab., Inc., accredited by Nadcap and A2LA, Test Report No. **IMR-200908522**, dated 10/27/09, signed by Jamie Wech and Michael Bimbo.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, dated 04/06/09, prepared by CertWorks, LLC, signed, sealed and dated 10/14/10 by Kristina S. Daugherty, P. E.
Complies with ASTM E1300-98/ 04

D. QUALITY ASSURANCE


1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **07-0214.08** issued to ODL, Inc. for their "**ODL/ Western reflection's Non-Impact HP Polypropylene Lite-Kit Assembly**" dated 03/22/07, expiring on 12/30/10.
2. Notice of Acceptance No. **07-0801.05** issued to ODL, Inc. for their "**HP Polypropylene series High Performance Door lite material – Component Approval**" dated 09/27/07, expiring on 01/17/11.

F. STATEMENTS

1. Statement letter of conformance, no financial interest and compliance with the FBC 2007, prepared by CertWorks, LLC, signed, sealed and dated 04/06/09 by Kristina S. Daugherty.
2. Statement letter of IMR Test Lab., Inc. validation, prepared by O. M. Engineering Services, Inc., signed, sealed and dated 09/19/08 by Nimesh Bhavsar, P. E.
3. Laboratory compliance letter for Test Report No. **NCTL 210-3558-1**, issued by National Certified Testing Laboratories, Inc., dated October 07, 2008, signed and sealed by Gerald J. Ferrara, P. E.
4. Laboratory addendum letter number 01 for Test Report No. **NCTL 210-3558-1**, issued by National Certified Testing Laboratories, Inc., dated August 25, 2009, signed and sealed by Gerald J. Ferrara, P. E.
5. Laboratory addendum letter number 02 for Test Report No. **NCTL 210-3558-1**, issued by National Certified Testing Laboratories, Inc., dated June 15, 2010, signed and sealed by Gerald J. Ferrara, P. E.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0415.08

Expiration Date: November 11, 2015
Approval Date: November 11, 2010

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

6. Laboratory compliance letter for Test Report No. **ETC-08-056-21686.0**, issued by ETC Laboratories, Inc., dated October 20, 2008, signed and sealed by Joseph Labora Doldan, P. E.
7. Laboratory compliance letter for Test Report No. **ITS 3113726SAT-001 Rev. 1**, issued by Intertek Testing Services, N. A., Inc., dated March 13, 2009, signed and sealed by Frederick D. Curkeet, P. E.
8. Laboratory compliance letter for Test Report No. **IMR-200707982**, issued by IMR Test Lab., Inc., dated September 10, 2007, signed by Sophia Ezell and Stan Deforest.
9. Laboratory compliance letter for Test Report No. **IMR-200908522**, issued by IMR Test Lab., Inc., dated October 27, 2009, signed by Jamie Wech and Michael Bimbo.
10. Distributor Agreement between Millwork Masters, Florida and Jeld-Wen (OR), Oregon, dated 02/02/9, signed by Steve Saffell, respectively.

G. OTHERS

1. None.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0415.08

Expiration Date: November 11, 2015
Approval Date: November 11, 2010

**GLADIATOR/FINISHIELD GLAZED WOOD EDGE
12-0x6-8 OUTSWING STEEL DOOR SYSTEM**

GENERAL NOTES

1. THE PRODUCT SHOWN HEREIN IS DESIGNED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC) BASED ON THE SIGNED AND SEALED DATE: INCLUDING HVHZ AND HAS BEEN EVALUATED IN ACCORDANCE WITH TAS 202-94 AND ASTM E331-00 AND ASTM E330-02.
2. 2X AND 1X WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE I, PAGE 1.
5. FLORIDA APPROVED IMPACT RESISTANCE SHUTTERS ARE REQUIRED FOR DOORS AND SIDELITES.
6. SCALE BASED ON 11x17 SHEET SIZE.
7. ALL 1X & 2X TO BE 0.55 SPECIFIC GRAVITY OR GREATER.

DOOR LEAF CONSTRUCTION:

FACE SHEETS: THE FACE SHEETS ARE GLUED TO THE CORE AND SUBSTRATE WITH LMC ADHESIVE.


CORE DESIGN: THE CORE CONSISTS OF 1-1.25 POUND DENSITY EXPANED POLYSTYRENE (EPS).

PANEL CONSTRUCTION: EACH DOOR PANEL IS CONSTRUCTED FROM TWO SHEETS OF 25-GAUGE (.018" MINIMUM) GALVANIZED STEEL. THE FACE SHEETS ARE BENT 90° OVER THE 1.688" X 1.0" LVL (LAMINATED VENEER LUMBER) STILES AND TOP RAIL. THE AVERAGE MIN YIELD STRENGTH OF 25 GA SHEET STEEL SKIN IS 38,400 psi. THE 1.688"X1.203" BOTTOM RAIL CONSISTS OF ROLLED-FORMED GALVANIZED 25-GAUGE (.018" MINIMUM) STEEL. THE WOOD LOCK BLOCK IS 1.688" X 3 1/8" X 12".

FRAME CONSTRUCTION: THE FRAME JAMBS & HEAD ARE CONSTRUCTED OF WOOD. THE SILL IS COMPRISED OF A NON-ADJUSTABLE COMPOSITE MATERIAL WITH ALUMINUM CLADDING. CORNERS ARE COPED, BUTTED, & SEALED USING SILICONE. THE HEAD AND SIDE JAMBS ARE FASTENED USING FOUR 16 GA. 7/16" X 2" STAPLES PER CORNER. THE SILL AND SIDE JAMBS ARE FASTENED USING THREE 16 GA. 7/16" X 2" STAPLES PER CORNER. THE VERTICAL SOLID MULLION IS FASTENED THROUGH THE HEAD & SILL USING THREE #8X2-1/2" SCREWS PER END. A 3/8" HOLE IS DRILLED AT THE CENTER OF THE FRAME HEAD AND THRESHOLD WHERE A METAL STRIKE PLATE IS FASTENED USING TWO #6 X 1 1/2" SCREWS TO RECEIVE THE TOP AND BOTTOM ASTRAGAL BOLT. EACH FIXED PANEL IS SECURED INTO THE FRAME USING FOUR 16 GA. 7/16" X 2" LONG STAPLES PER STILE FASTENED THROUGH THE JAMBS. ALL MULLION JOINERY & THE FIXED PANELS / FRAME JOINERY ARE SEALED AT THE EXTERIOR USING 1199 SILICONE.

MATERIAL PROTECTION

1. ALL LATCH/LOCK AND HINGE HARDWARE TO BE OF CORROSION RESISTANT MATERIAL OR CORROSION RESISTANT COATED.
2. ANCHORING COMPONENTS MUST MEET THE CORROSION RESISTANT STANDARDS AS IDENTIFIED IN THE FBC.
3. ALL WOOD FRAMING IS TREATED IN ACCORDANCE WITH WOOD PROTECTION STANDARDS AS IDENTIFIED IN THE FBC.

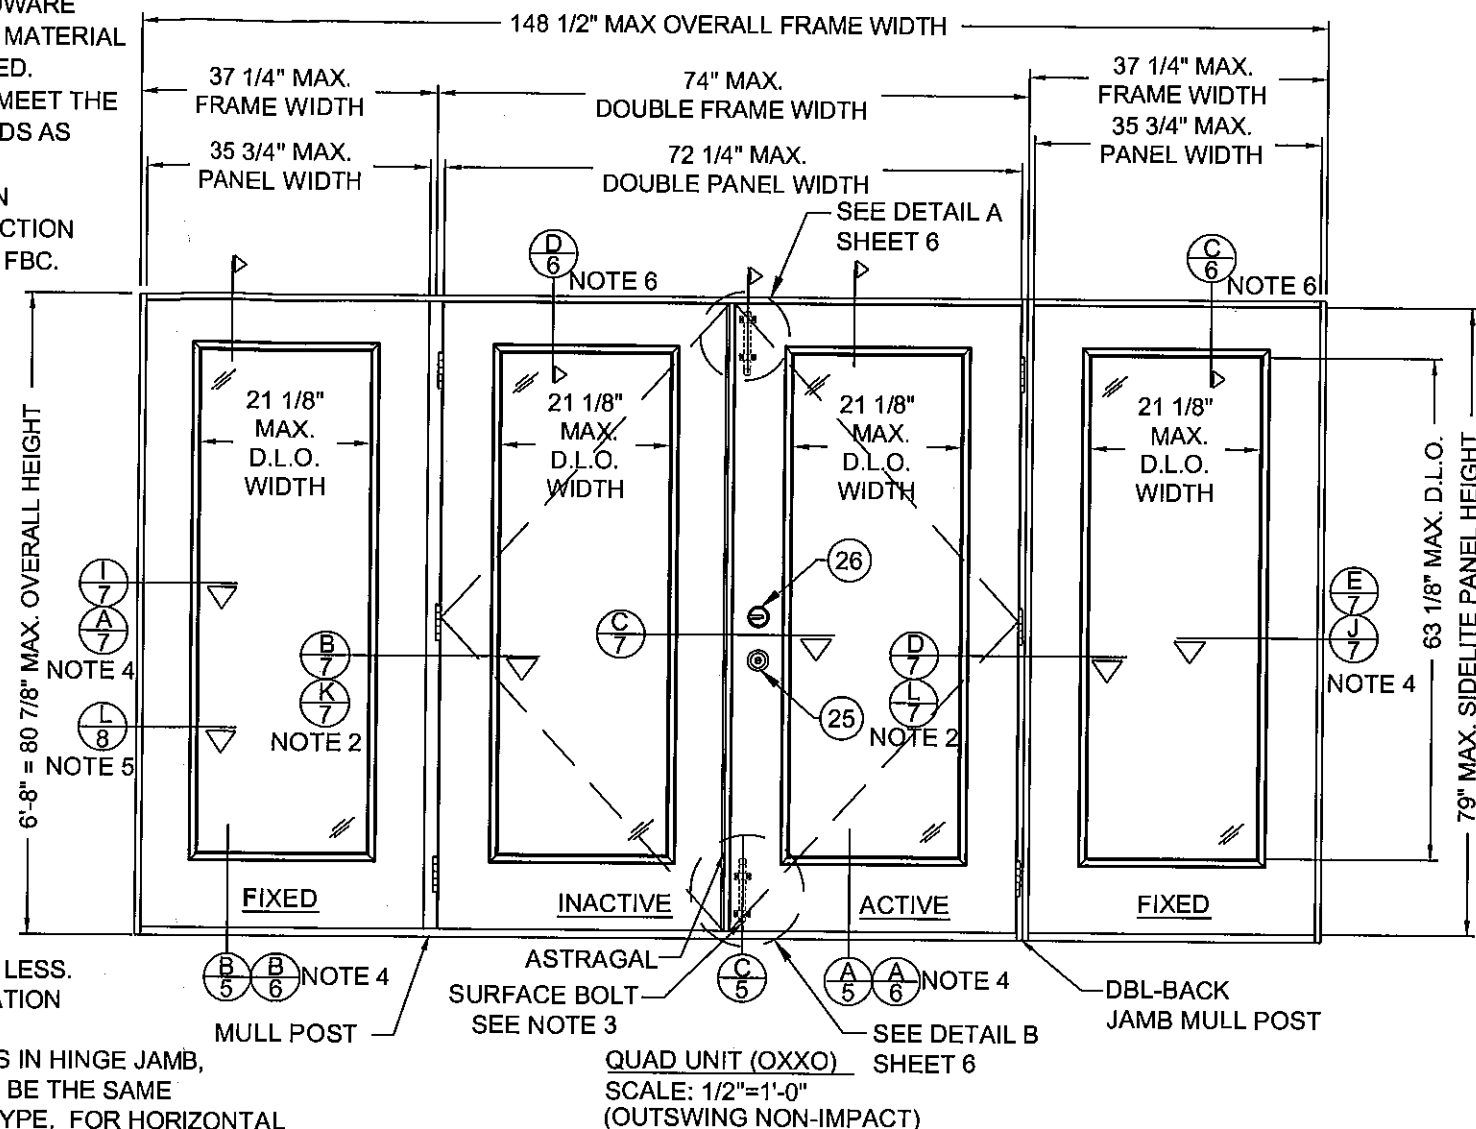

NOTES:


- 1 - ALL VIEWS FROM EXTERIOR.
- 2 - MULL POSTS & DOUBLE BACK JAMBS ARE INTERCHANGEABLE. (SEE OPTIONAL CROSS SECTIONS)
- 3 - SURFACE BOLT NOT REQUIRED FOR APPLICATIONS REQUIRING DP-45 OR LESS.
- 4 - MASONRY AND CONCRETE INSTALLATION DETAILS.
- 5 - POSITION AND NUMBER OF ANCHORS IN HINGE JAMB, LATCH JAMB OR SIDELITE JAMB WILL BE THE SAME REGARDLESS OF ROUGH OPENING TYPE. FOR HORIZONTAL CROSS SECTION IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 8 FOR DETAILS.
- 6 - FOR VERTICAL ANCHOR IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 6 FOR DETAILS.

TABLE OF CONTENTS	
SHT #	DESCRIPTION
1	TYP. ELEVATIONS & GENERAL NOTES
2	TYPICAL ELEVATIONS
3	TYPICAL ELEVATIONS
4	TYPICAL ELEVATIONS
5	VERTICAL CROSS SECTIONS & B.O.M.
6	VERTICAL CROSS SECTIONS
7	HORIZONTAL CROSS SECTIONS
8	HORIZONTAL CROSS SECTIONS
9	ANCHORING LOCATIONS & DETAILS
10	ANCHORING LOCATIONS & DETAILS
11	ANCHORING LOCATIONS
12	UNIT COMPONENTS & DETAILS
13	VENT LITE DETAIL
14	VENT LITE MATERIAL LIST

TABLE 1

DESIGN PRESSURE RATING (PSF)					
	*WHERE WATER INFILTRATION REQUIREMENT IS NEEDED			WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	
	WITHOUT SURFACE BOLTS	WITH SURFACE BOLTS		WITHOUT SURFACE BOLTS	WITH SURFACE BOLTS
POSITIVE	*+45	*+55	POSITIVE	+45	+55
NEGATIVE	-45	-55	NEGATIVE	-45	-55

*NOTE: UNIT SHALL BE INSTALLED AT LOCATION PROTECTED BY OVERHANG SUCH THAT OVERHANG(OH) RATIO = OH LENGTH/OH HEIGHT IS EQUAL TO, OR GREATER THAN, 1.0. WHERE REQUIRED OVERHANG CANNOT BE ACHIEVED, DESIGN PRESSURE LIMITED TO +30 PSF

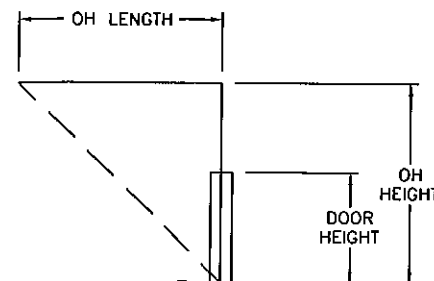

Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 09-0415.03
Miami-Dade Product Control
Division
By [Signature]

Kristina S. Daugherty
CertWorks LLC
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

PRODUCT:

GLADIATOR/FINISHIELD GLAZED
WOOD EDGE 12-0x6-8
OUTSWING STEEL DOOR


PART OR ASSEMBLY:

TYPICAL ELEVATIONS

B	2/9/2010	P.E. CHANGES	GL		
A	6/19/09	CHG DP TABLE	WBD		
NQ.	DATE	REVISIONS	BY		

DATE:	8/12/08
SCALE:	AS NOTED
DWG. BY:	WBD
CHK. BY:	S. FREY
DRAWING NO.:	JW122008
SHEET 1 OF 14	


JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

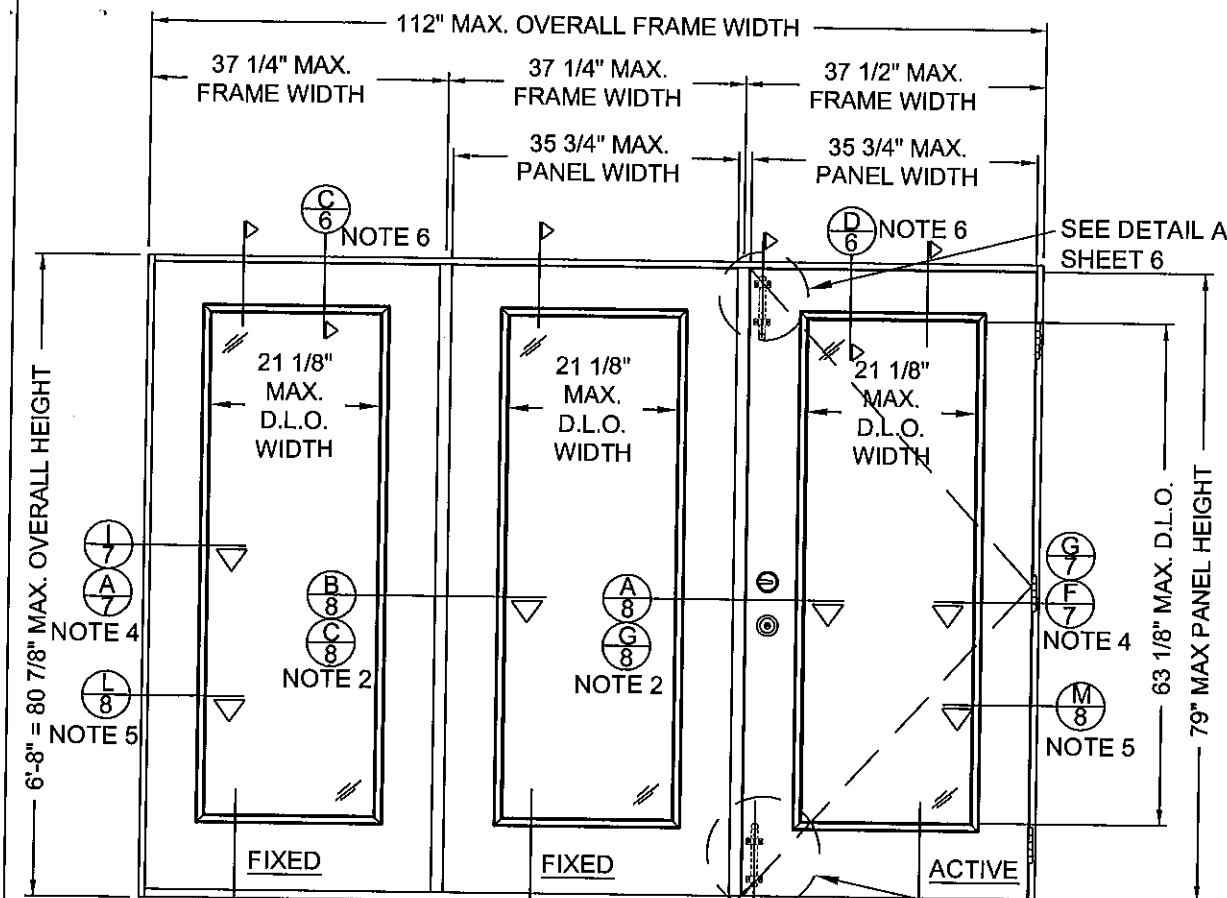

MULL POST SHOWN
DBL-BACK JAMB MULL
POST OPTIONAL

SURFACE BOLT
SEE NOTE 3

TRI UNIT (OOX) OR (XOO)
SCALE: 1/2" = 1'-0"

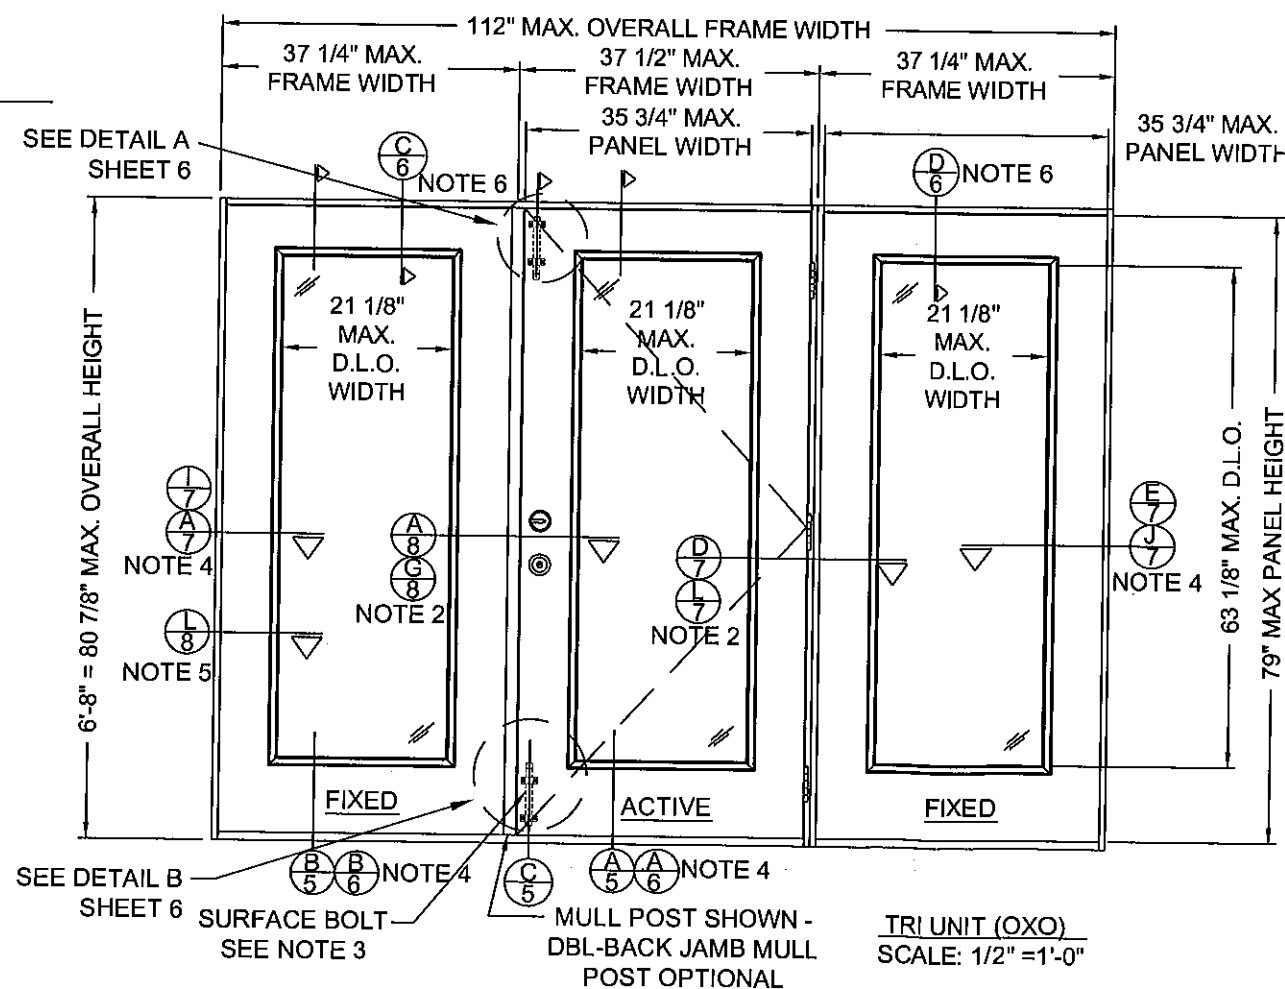


SEE DETAIL B
SHEET 6

SURFACE BOLT
SEE NOTE 3

MULL POST SHOWN -
DBL-BACK JAMB MULL
POST OPTIONAL

TRI UNIT (OXO)
SCALE: 1/2" = 1'-0"

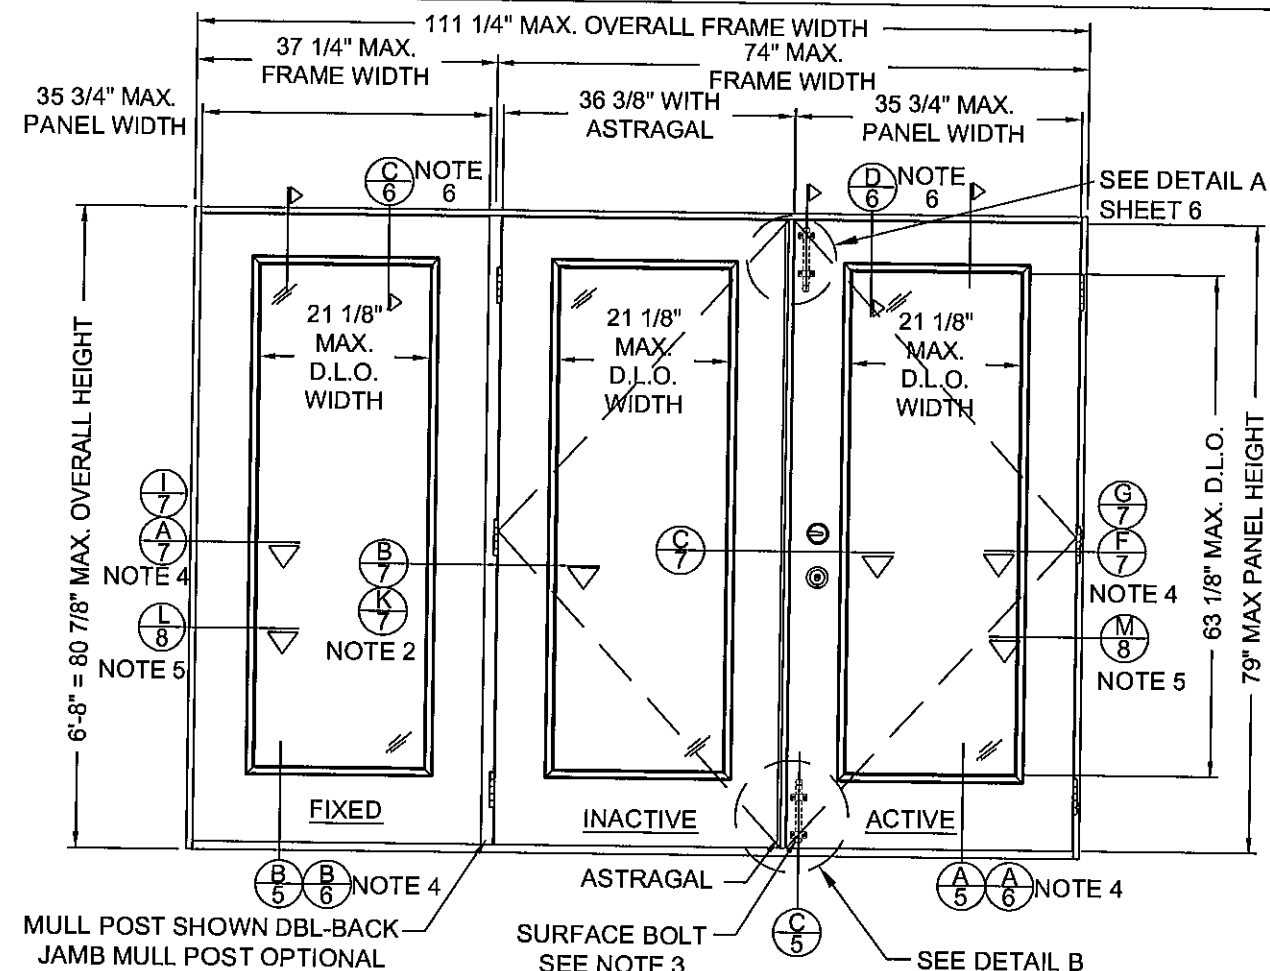

MULL POST SHOWN DBL-BACK
JAMB MULL POST OPTIONAL

SURFACE BOLT
SEE NOTE 3

SEE DETAIL B
SHEET 6

TRI UNIT (OXX) OR (XXO)
SCALE: 1/2" = 1'-0"

NOTES:

- 1 - ALL VIEWS FROM EXTERIOR.
- 2 - MULL POSTS & DOUBLE BACK JAMBS ARE INTERCHANGEABLE. (SEE OPTIONAL CROSS SECTIONS)
- 3 - SURFACE BOLT NOT REQUIRED FOR APPLICATIONS REQUIRING DP-45 OR LESS.
- 4 - MASONRY AND CONCRETE INSTALLATION DETAILS.
- 5 - POSITION AND NUMBER OF ANCHORS IN HINGE JAMB, LATCH JAMB OR SIDELITE JAMB WILL BE THE SAME REGARDLESS OF ROUGH OPENING TYPE. FOR HORIZONTAL CROSS SECTION IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 8 FOR DETAILS.
- 6 - FOR VERTICAL ANCHOR IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 6 FOR DETAILS.

Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 09-0415.0B
Miami Dade Product Control
Division
By [Signature]


[Signature]
10-14-10
Kristina S. Daugherty
CertWorks LLC
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

DATE: 8/12/08
SCALE: AS NOTED
DWG. BY: WBD
CHK. BY: S. FREY
DRAWING NO.: JW122008
SHEET 2 OF 14


PRODUCT: GLADIATOR/FINISH GLAZED
WOOD EDGE 12-0x6-8
OUTSWING STEEL DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATIONS


JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

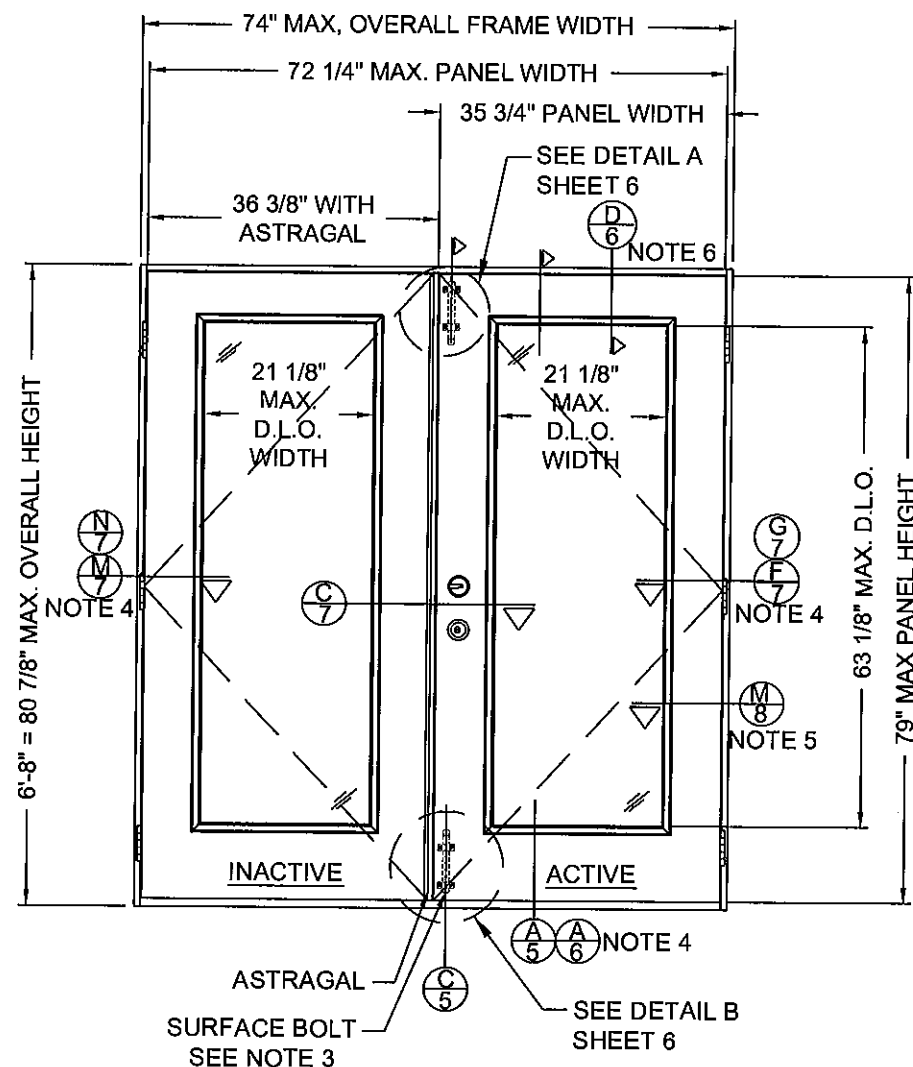

DUAL UNIT (XX)
SCALE: 1/2" = 1'-0"

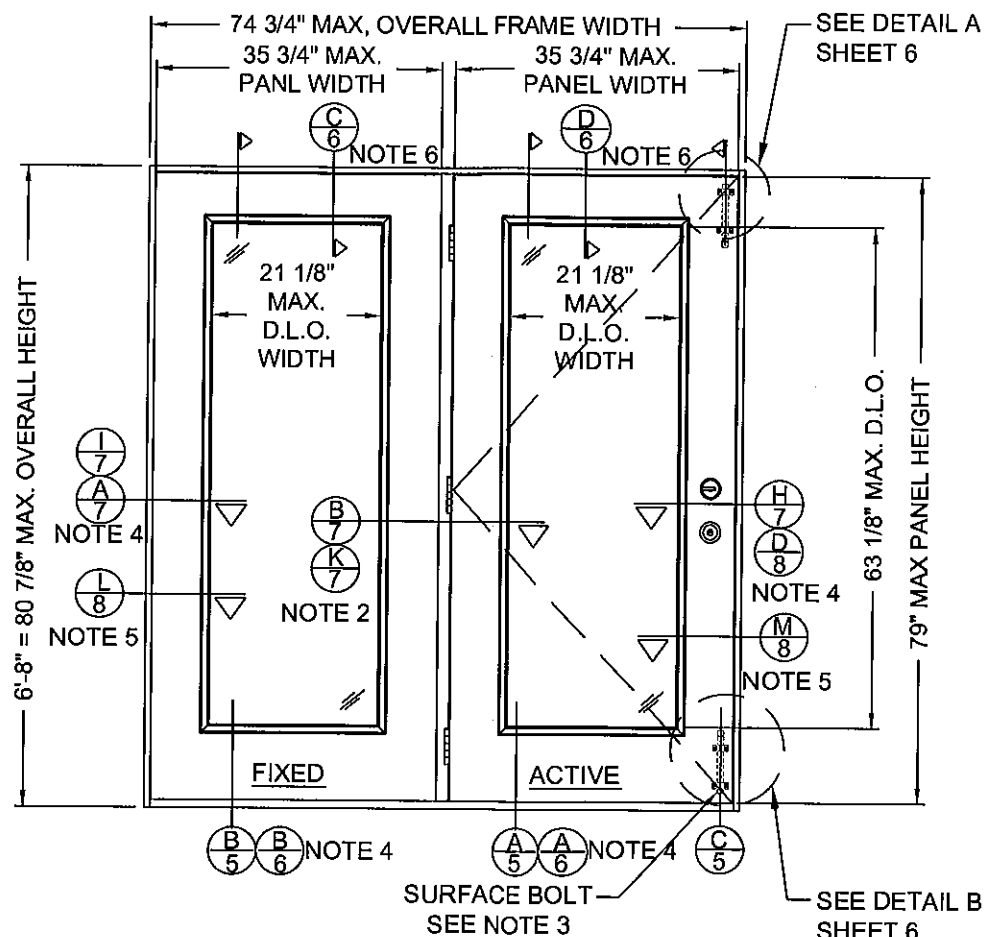

DUAL UNIT (OX) OR (XO)
SCALE: 1/2" = 1'-0"

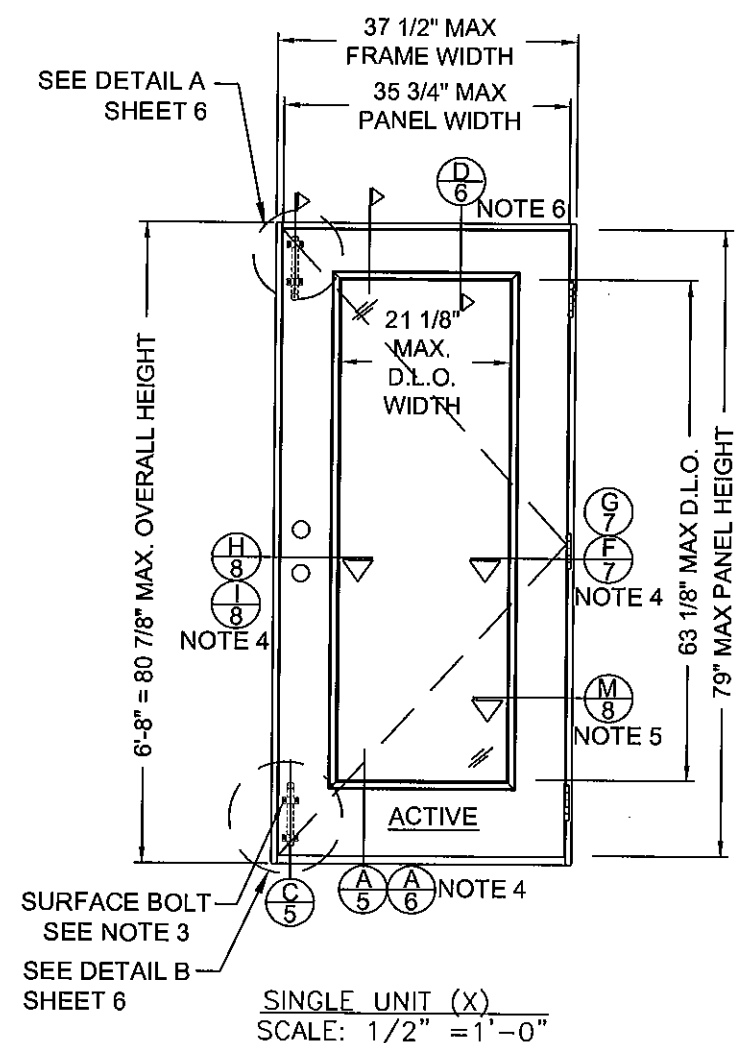

SINGLE UNIT (X)
SCALE: 1/2" = 1'-0"

- NOTES:
- 1 - ALL VIEWS FROM EXTERIOR.
 - 2 - MULL POSTS & DOUBLE BACK JAMBS ARE INTERCHANGEABLE. (SEE OPTIONAL CROSS SECTIONS)
 - 3 - SURFACE BOLT NOT REQUIRED FOR APPLICATIONS REQUIRING DP-45 OR LESS.
 - 4 - MASONRY AND CONCRETE INSTALLATION DETAILS.
 - 5 - POSITION AND NUMBER OF ANCHORS IN HINGE JAMB, LATCH JAMB OR SIDELITE JAMB WILL BE THE SAME REGARDLESS OF ROUGH OPENING TYPE. FOR HORIZONTAL CROSS SECTION IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 8 FOR DETAILS.
 - 6 - FOR VERTICAL ANCHOR IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 6 FOR DETAILS.

Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 09-0415.08
Miami Dade Product Control
Division
By *[Signature]*

[Signature]
10-14-10
Kristina S. Dougherty
CertWorks LLC
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

PRODUCT: GLADIATOR/FINISHIELD GLAZED
WOOD EDGE 12-0x6-8
OUTSWING STEEL DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATIONS

NO.	DATE	REVISIONS	BY
B	2/9/2010	P.E. CHANGES	GL
A	6/19/09	CHG DP TABLE	WBD

DATE: 8/12/08

SCALE: AS NOTED

DWG. BY: WBD


CHK. BY: S. FREY

DRAWING NO.:


JW122008

SHEET 3 OF 14


WELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

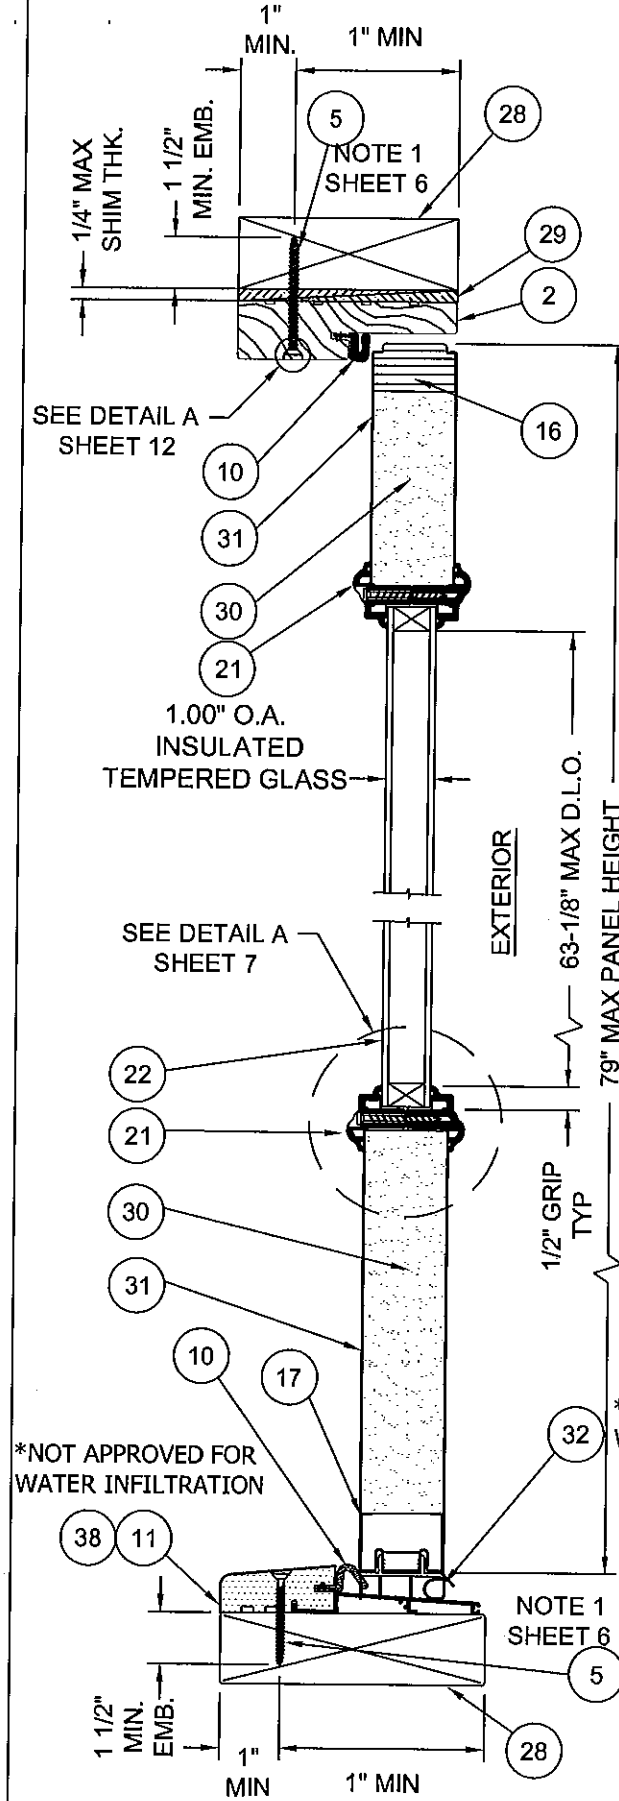

A
5 VERTICAL CROSS SECTION,
ACTIVE DOOR TYP.
WOOD FRAME INSTALLATION
SCALE: 3" = 1'-0"

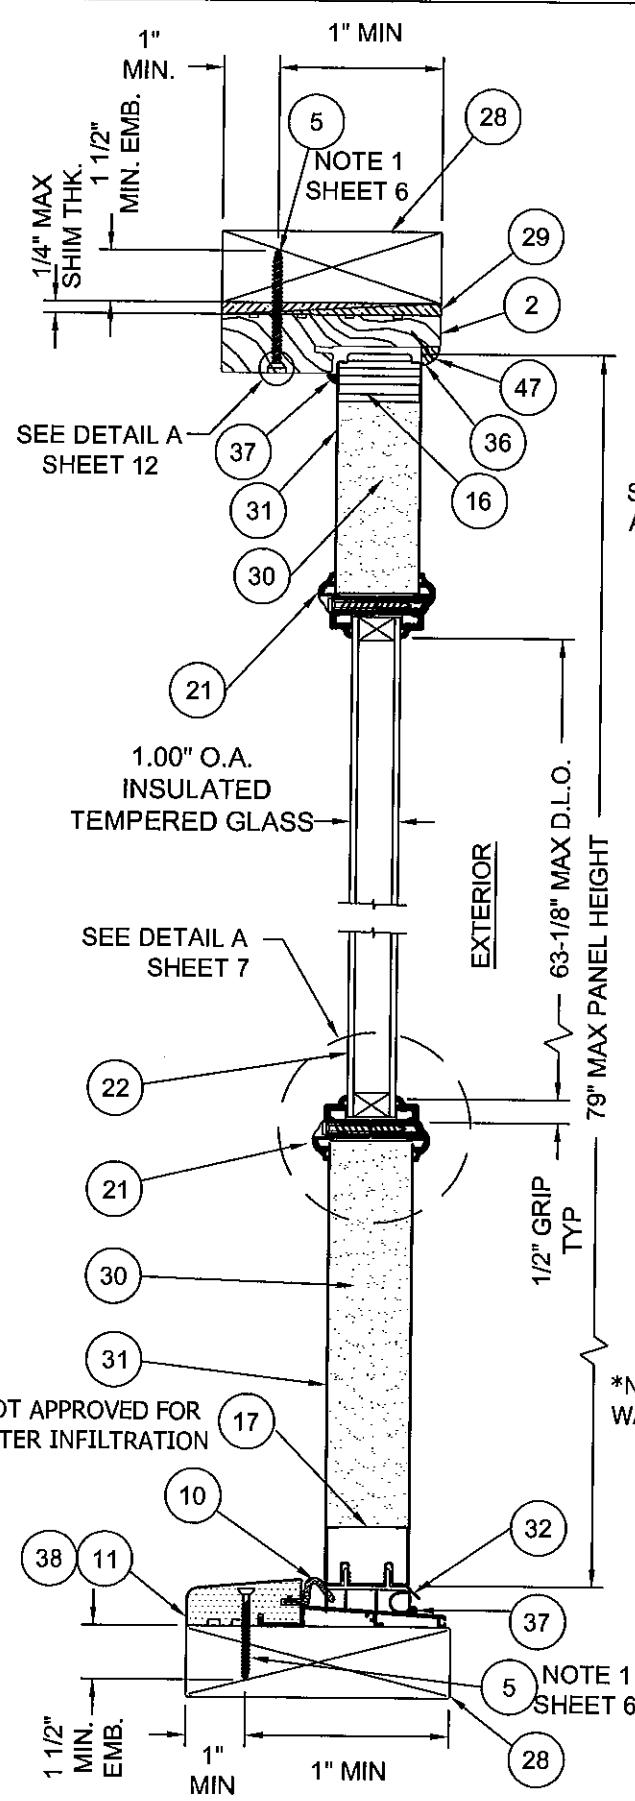

B
5 VERTICAL CROSS SECTION,
SIDE LITE TYP.
WOOD FRAME INSTALLATION
SCALE: 3" = 1'-0"

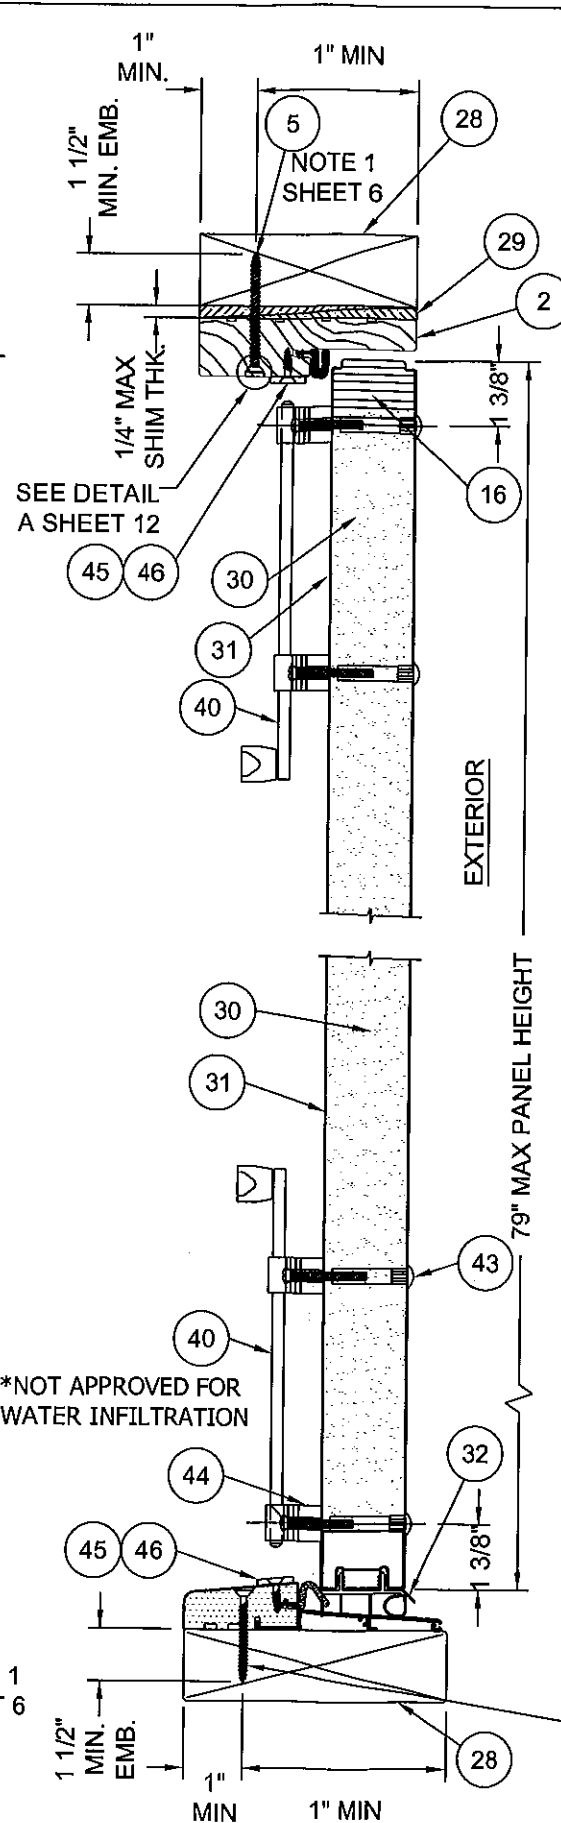


C
5 VERTICAL CROSS SECTION,
SURFACE BOLTS TYP.
WOOD FRAME INSTALLATION
SCALE: 3" = 1'-0"

Item	DESCRIPTION	Material
1	HINGE JAMB (1 1/4"x4-5/8" FINGERJOINTED PINE)	PINE
2	HEAD JAMB (1 1/4"x4-5/8" FINGERJOINTED PINE)	PINE
3	LATCH JAMB (1-1/4"x4-5/8" FINGERJOINTED PINE)	PINE
4	SIDELITE JAMB (1-1/4"x4-5/8" FINGERJOINTED PINE)	PINE
5	#10 PHILLIPS FLATHEAD WOOD SCREW WITH 1 1/2" MIN. EMBEDMENT	STEEL
6	4" x 4" BUTT HINGE 12GA. (.089" MIN)	STEEL
7	#8 x 3/4" PHILLIPS FLATHEAD WOOD SCREW	STEEL
8	#8 x 1 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
9	3/16" ITW BUILDDEX TAPCON WITH 1 1/4" MIN. EMBEDMENT	STEEL
10	COMPRESSION WEATHERSTRIP (LoxSeal 650)	VINYL
11	AFCO A-297 OUTSWING BUMPER SILL 6063-T5	AL/COMP./PVC
12	DOUBLE BACK JAMB, LAMINATED VENEER LUMBER (LVL)	LVL
13	EXTRUDED ASTRAGAL GLOBAL #79-WATA-OLH-R17 6063-T6 AL	ALUMINUM
14	#8 X 1" PHILLIPS PAN HEAD SHEET METAL SCREW	STEEL
15	ATA STRIKE PLATE - R4 (GLOBAL PRODUCTS)	STEEL
16	TOP RAIL (LAMINATED VENEER LUMBER)-MIN. G = 0.55	LVL
17	BOTTOM RAIL 25GA (0.018") GALVANIZED STEEL	STEEL
18	HINGE SIDE STILE (LAMINATED VENEER LUMBER)-MIN. G = 0.55	LVL
19	LATCH SIDE STILE (LAMINATED VENEER LUMBER)-MIN. G = 0.55	LVL
20	LOCK BLOCK 1.688 X 3 1/8" x 12" LG PINE-MIN. G = 0.55	PINE
21	ODL LIP-LITE FRAME #686-BKWD (NOA 07-0214.08)	PLASTIC
22	1.00" O.A. INSULATED TEMPERED GLASS	GLASS
23	16 Ga. 7/16" CROWN x 2" LONG STAPLES	STEEL
24	CORRUGATED NAIL 1/2" x 1 1/16" 25 GA	STEEL
25	KWIKSET LOCK SERIES 400	STEEL
26	KWIKSET DEADBOLT SERIES 980	STEEL
27	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
28		WOOD
29	NON-COMPRESSION SHIM 1/4" MAX. THICKNESS	WOOD
30	EXPANDED POLYSTYRENE (1.0 TO 1.25lbs DENSITY) MFG BY JELD-WEN	FOAM
31	STEEL DOOR PANEL SKIN MATERIAL (25 GA GALVANIZED) A-525 COMMERCIAL QUALITY 0.018" MIN. THICK.)	STEEL GALVANIZED
32	VINYL DOOR BOTTOM SWEEP	VINYL
33	CORNER PADS 2", LOCATED AT THE BOTTOM OF EACH JAMB LEG SETTING ON TOP OF THE SILL, BEHIND THE WEATHERSTRIP	PLASTIC
34	#6 x 1 1/2" PHILLIPS WOOD SCREW	STEEL
35	SOLID MULL POST (LAMINATED VENEER LUMBER)-MIN. G = 0.55	LVL
36	3/8" QUARTER ROUND MOULDING-MIN. G = 0.55	WOOD
37	SILICONE BEAD DOW 1199	SILICONE
38	AFCO A-496 THRESHOLD (OPTIONAL) 6063-T5	AL/COMP.
39	ASTRAGAL THROW BOLT, STEEL ROD, 5/16 DIA. x 18"	STEEL
40	IVES SURFACE BOLT #454 8.0" L X 3/4" W X 1/4" THK.	STEEL
41	ODL MODEL 799 VENTED HALF LITE (NOA 07-0801.05)	PLASTIC
42	1x WOOD BUCK GRD 2 SOUTHERN YELLOW PINE-MIN. G = 0.55	WOOD
43	SEX BOLT 10-32 X 1-9/16 LG X 5/16 BARREL	STEEL
44	IVES SURFACE BOLT SPACERS	STEEL
45	IVES SURFACE BOLT STRIKE PLATE	STEEL
46	#8 X 3/4" LG FLATHEAD WOODSCREWS FOR STRIKE PLATE	STEEL
47	1 1/4" BRAD NAIL 18 GA. @ 8" O.C. (HEAD) 5" O.C. (JAMBS)	STEEL


Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 09-0415.08
Miami Dade Product Control
Division
By *[Signature]*

[Signature]
10-14-10
Kristina S. Dougherty
CertWorks LLC.
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

JELD-WEN, INC. 3737 LAKEPORT BLVD. KLAMATH FALLS, OR, 97601 PH. 541-882-3451	
PRODUCT: GLADIATOR/FINISH GLAZED WOOD EDGE 12-0x6-8 OUTSWING STEEL DOOR	PART OR ASSEMBLY: VERTICAL CROSS SECTIONS & BILL OF MATERIALS
DATE: 8/12/08	SCALE: AS NOTED
DWG. BY: WBD	CHK. BY: S. FREY
DRAWING NO.: JW122008	SHEET 5 OF 14


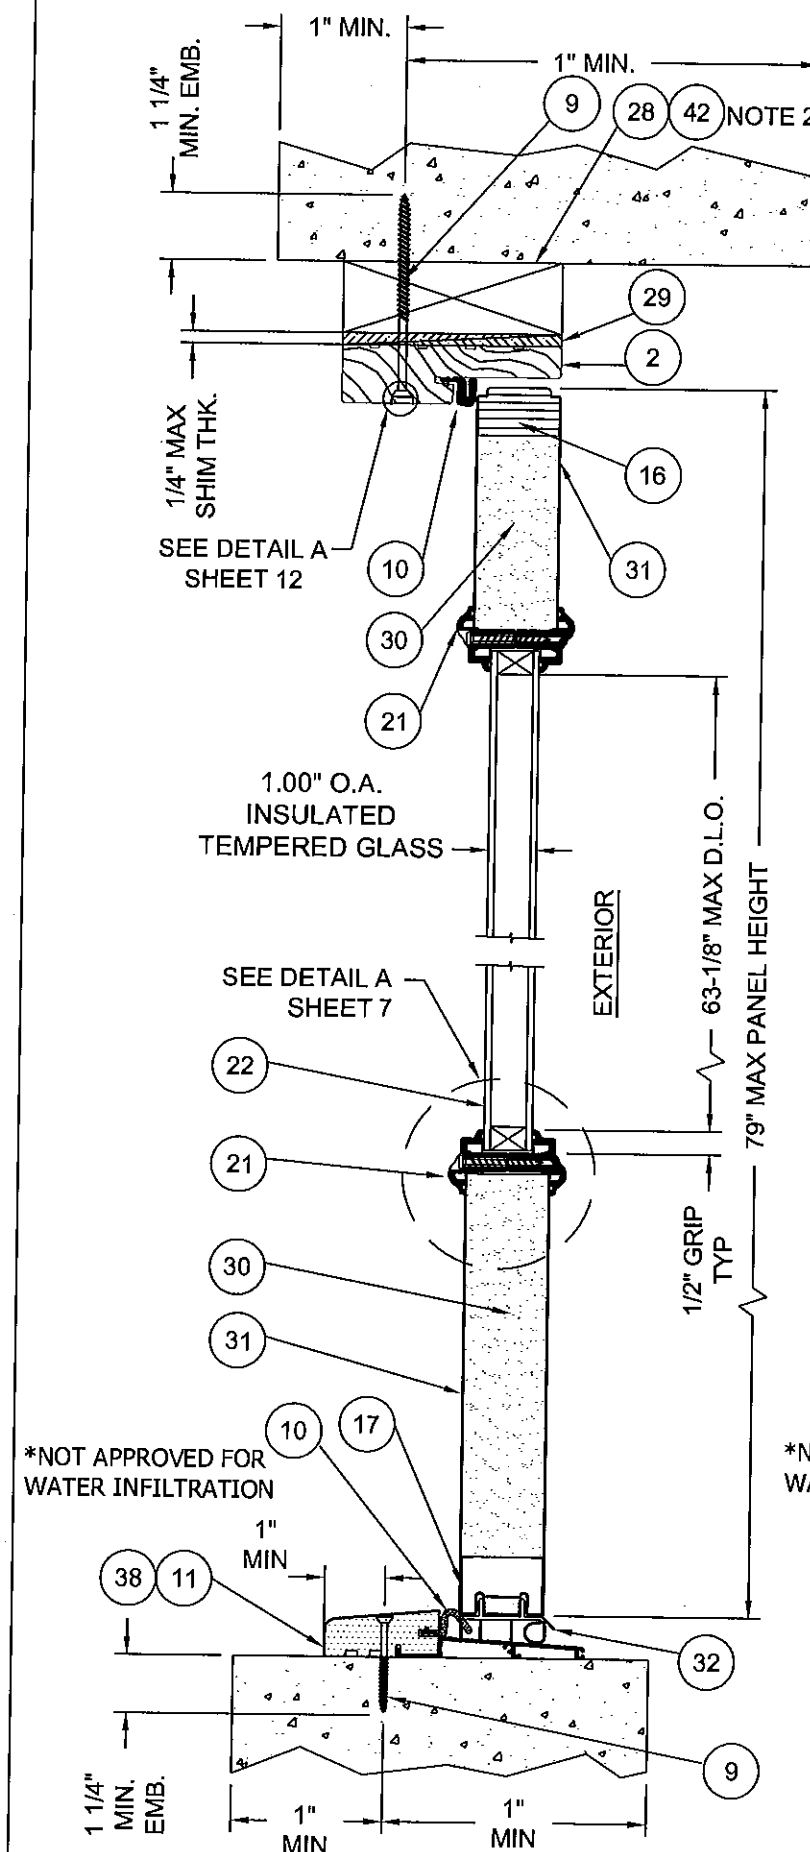


A VERTICAL CROSS SECTION, ACTIVE DOOR TYP.
6 MASONRY AND CONCRETE INSTALLATION
 SCALE: 3" = 1'-0"

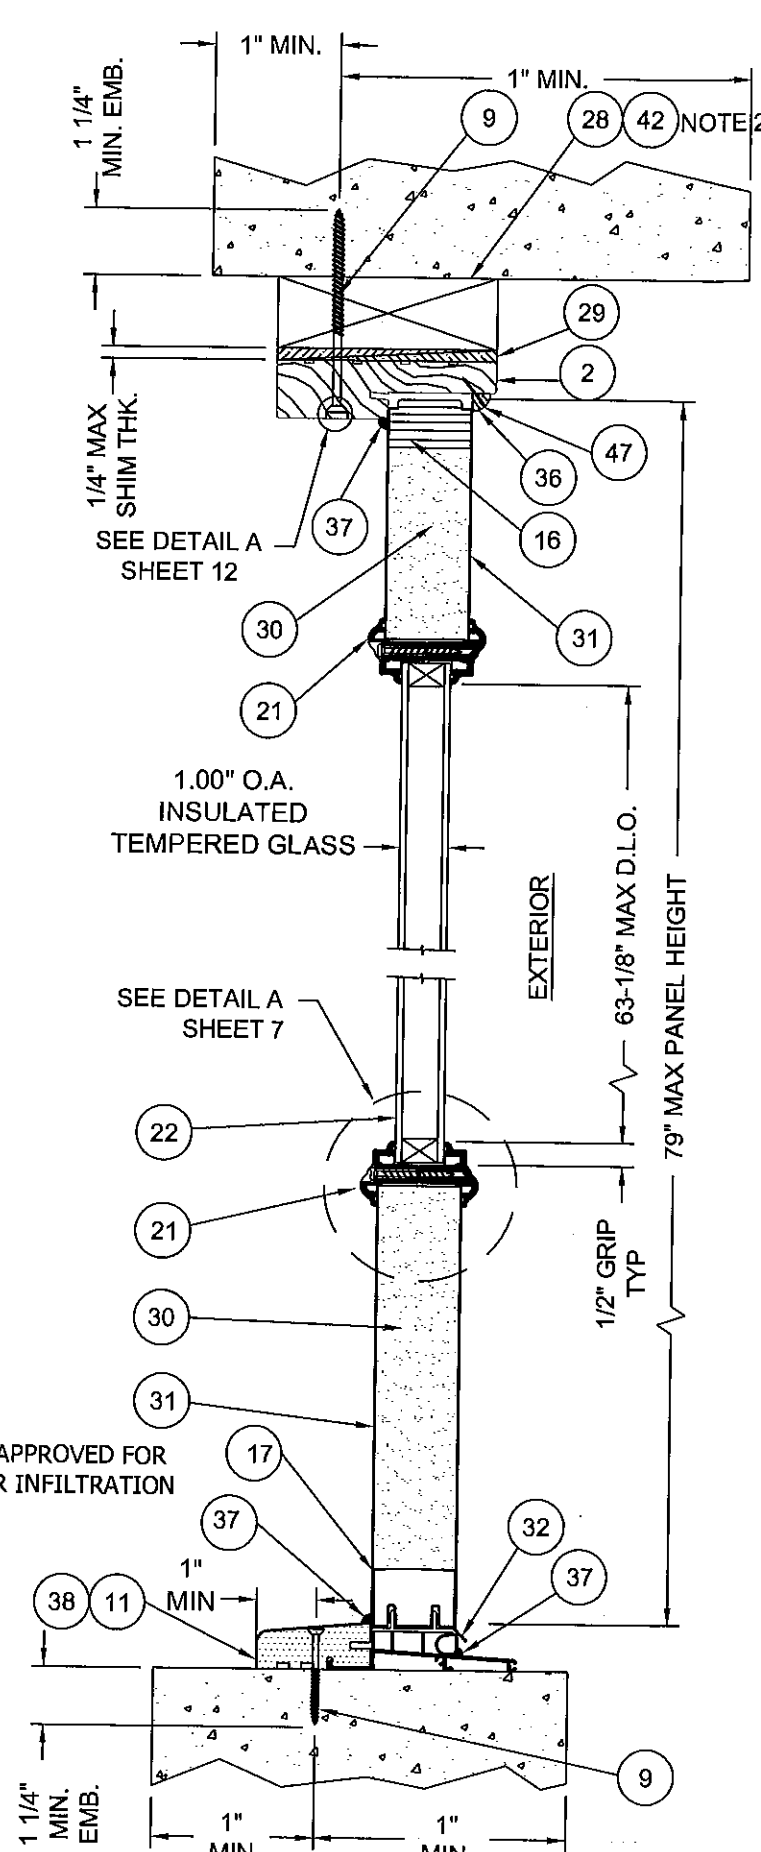



B VERTICAL CROSS SECTION, SIDE LITE TYP.
6 MASONRY AND CONCRETE INSTALLATION
 SCALE: 3" = 1'-0"

C VERTICAL CROSS SECTION
6 FIXED UNIT 1X BUCK OPTION IN MASONRY & CONCRETE INSTALL
 SCALE: 3" = 1'-0"

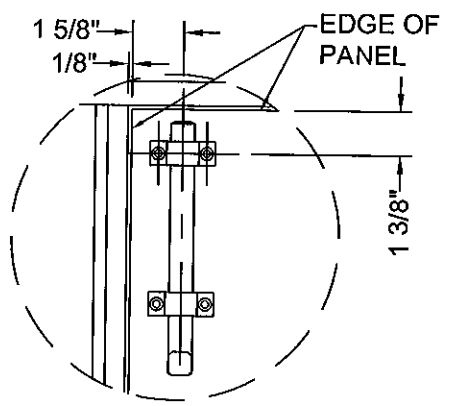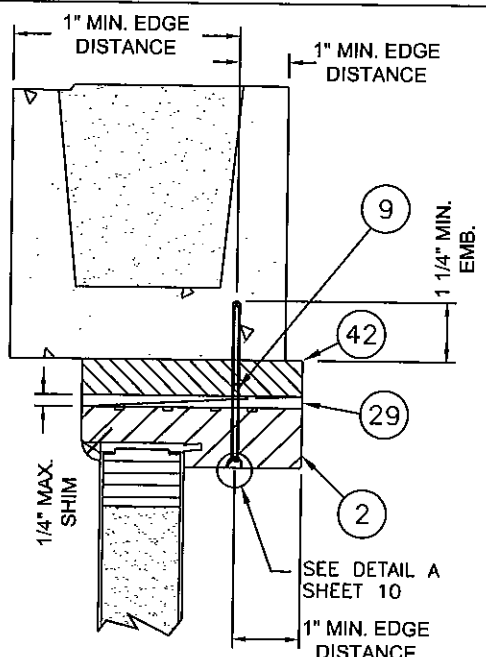

DETAIL A SURFACE
 BOLT TOP LOCATION
 SCALE: 2" = 1'-0"

D VERTICAL CROSS SECTION
6 OPERATING UNIT 1X BUCK OPTION IN MASONRY & CONCRETE INSTALL
 SCALE: 3" = 1'-0"

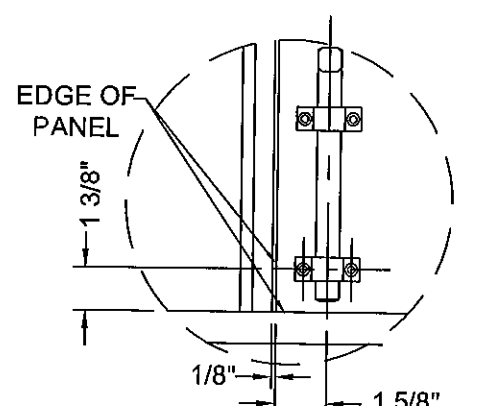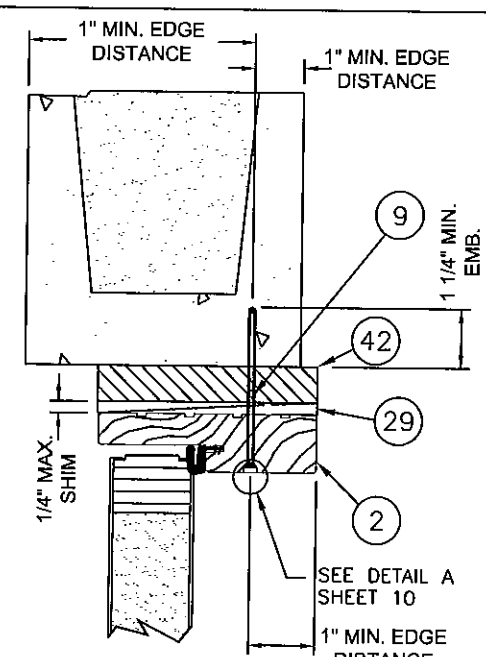


DETAIL B SURFACE
 BOLT BOTTOM LOCATION
 SCALE: 2" = 1'-0"

- NOTES:**
1. FOR ANCHOR SPACING (ITEMS #5 OR #9), SEE SHEETS 9, 10, & 11.
 2. 1X MAY BE UTILIZED AS AN OPTION. FOR VERTICAL SECTIONS, SEE DETAILS **C** **D** SHEET 6. HORIZONTAL SECTIONS: DETAILS **L** **M** SHEET 8.
 3. TAPCON MASONRY ANCHOR SPACING SAME AS WOOD ANCHOR SCREW CONFIGURATION.
 4. OPTIONALLY, ANCHORS CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT IS ACHIEVED.


Approved as complying with the
 Florida Building Code
 Date 11/11/08
 NOA# 09-0415-08
 Miami Dade Product Control
 Division
 By [Signature]

[Signature]
 10-14-10
 Kristina S. Dougherty
 CertWorks LLC.
 Florida P.E. No. 68455
 127 W. Fairbanks Ave, Ste 438
 Winter Park, FL 32789
 FBPE Cert. of Authorization #28520


JELD-WEN, INC. 3737 LAKEPORT BLVD. KLAMATH FALLS, OR, 97601 PH. 541-882-3451			
PRODUCT: GLADIATOR/FINISHIELD GLAZED WOOD EDGE 12-0x6-8 OUTSWING STEEL DOOR		PART OR ASSEMBLY: VERTICAL & HORIZONTAL CROSS SECTIONS	
		GL	BY
B	2/9/2010	P.E. CHANGES	WBD
A	6/19/09	CHG DP TABLE	WBD
	NO.	DATE	REVISIONS
DATE: 8/12/08 SCALE: AS NOTED DWG. BY: WBD CHK. BY: S. FREY DRAWING NO.: JW122008 SHEET <u>6</u> OF <u>14</u>			

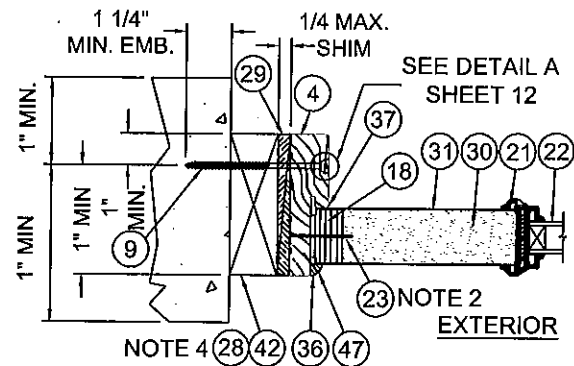


A
7 HORIZONTAL CROSS SECTION
MASONRY & CONCRETE INSTALL
SCALE: 2"=1'-0"

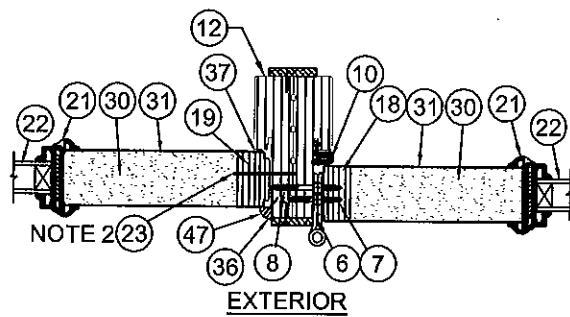


B
7 HORIZONTAL CROSS SECTION
SCALE: 2"=1'-0"

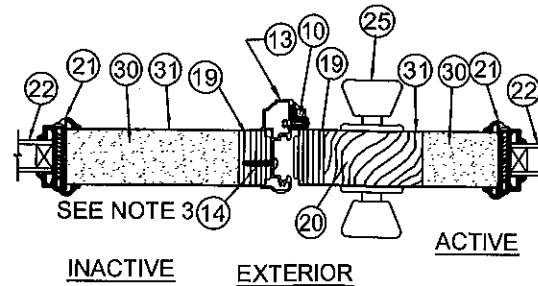


C
7 HORIZONTAL CROSS SECTION
SCALE: 2"=1'-0"

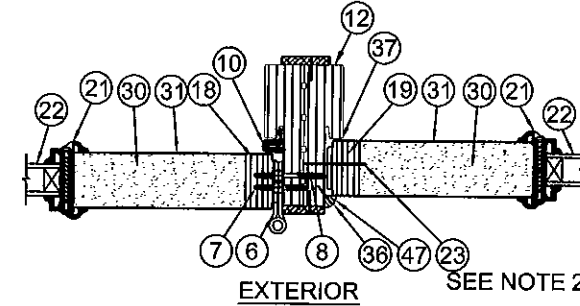


D
7 HORIZONTAL CROSS SECTION
SCALE: 2"=1'-0"

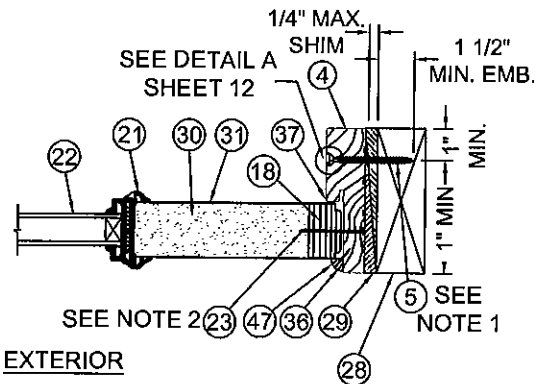


E
7 HORIZONTAL CROSS SECTION
WOOD INSTALLATION
SCALE: 2"=1'-0"

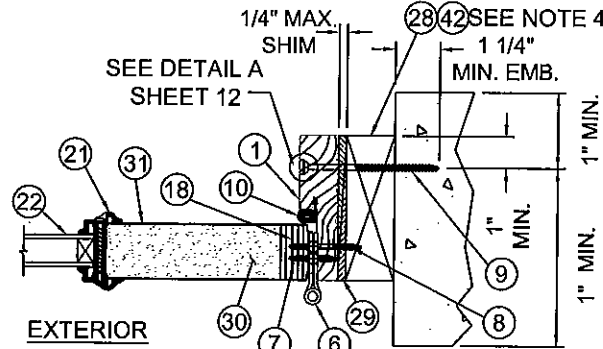


F
7 HORIZONTAL CROSS SECTION
MASONRY & CONCRETE INSTALL
SCALE: 2"=1'-0"

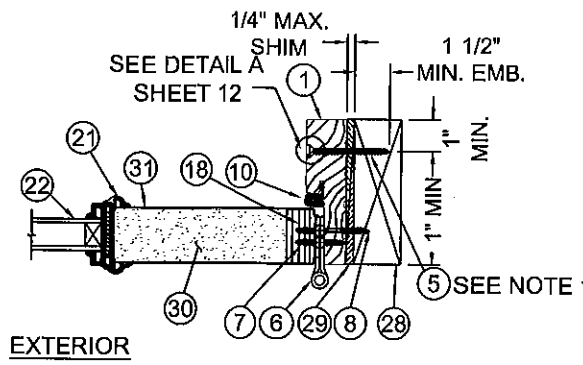


G
7 HORIZONTAL CROSS SECTION
WOOD INSTALLATION
SCALE: 2"=1'-0"

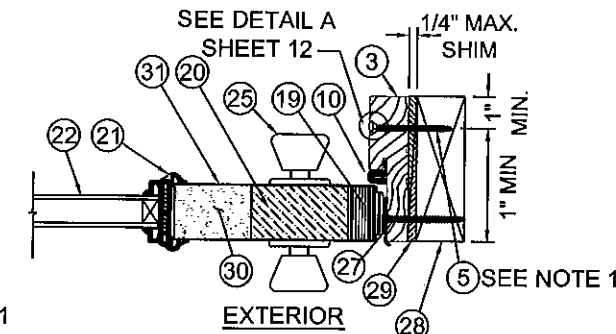


H
7 HORIZONTAL CROSS SECTION
WOOD INSTALLATION
SCALE: 2"=1'-0"

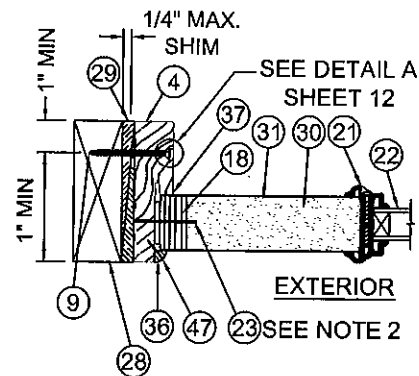


I
7 HORIZONTAL CROSS SECTION
WOOD INSTALLATION
SCALE: 2"=1'-0"

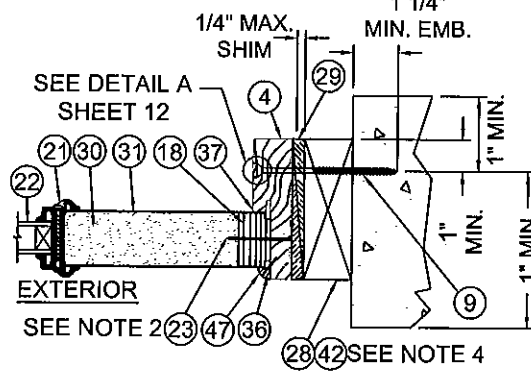


J
7 HORIZONTAL CROSS SECTION
MASONRY & CONCRETE INSTALL
SCALE: 2"=1'-0"

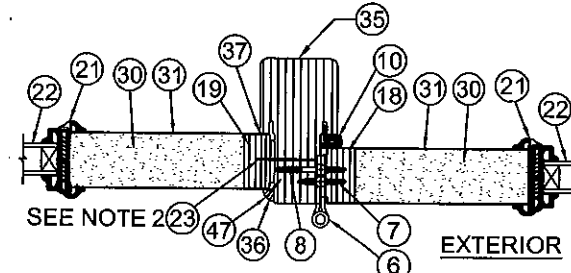


K
7 HORIZONTAL CROSS SECTION
SCALE: 2"=1'-0"

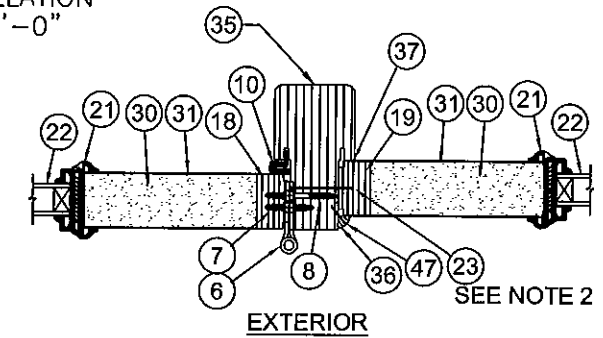


L
7 HORIZONTAL CROSS SECTION
SCALE: 2"=1'-0"

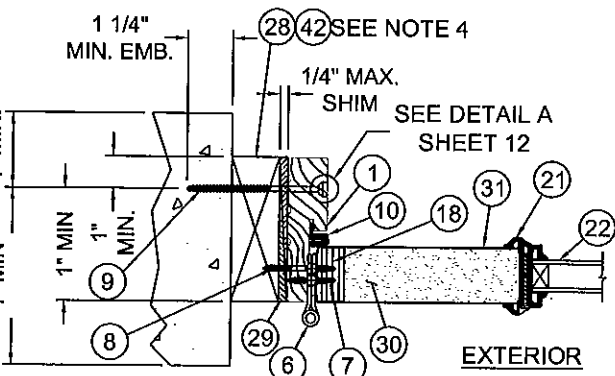

M
7 HORIZONTAL CROSS SECTION
MASONRY & CONCRETE INSTALL
SCALE: 2"=1'-0"

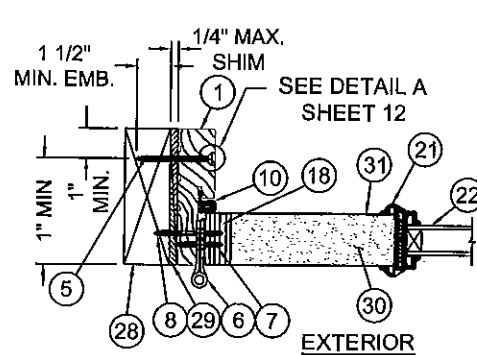

N
7 HORIZONTAL CROSS SECTION
WOOD INSTALLATION
SCALE: 2"=1'-0"

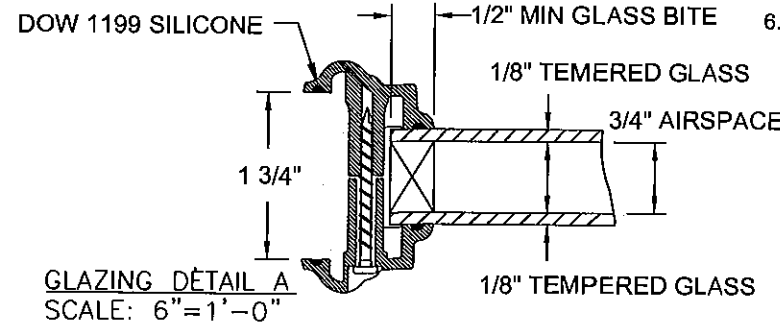

- NOTES:
- FOR ANCHOR SPACING (ITEMS #5 OR #9), SEE SHEETS 9, 10, & 11.
 - SPACING FOR #23 FROM TOP OF SIDELITE DOWN (SEE SHEET 10).
 - ASTRAGAL SCREW PATTERN SPACING FOR #13:
FROM BOTTOM: 1/2", 2", 3 1/2", 20", 24 3/4".
FROM TOP: 1/2", 2", 3 1/2", 20", 24 3/4", 39".
 - 1X MAY BE UTILIZED AS AN OPTION. FOR VERTICAL SECTIONS, SEE DETAILS
C **D** SHEET 6. HORIZONTAL SECTIONS: DETAILS **L** **M** SHEET 8.
 - TAPCON MASONRY ANCHOR SPACING SAME AS WOOD ANCHOR SCREW CONFIGURATION.
 - OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT IS ACHIEVED.

Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 2010-0015-00
Miami Dade Product Control
Division
By [Signature]


[Signature]
10-14-10
Kristina S. Daugherty
CertWorks LLC
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

DATE: 8/12/08
SCALE: AS NOTED
DWG. BY: WBD
CHK. BY: S. FREY
DRAWING NO.: JW122008
SHEET 7 OF 14


JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

PRODUCT: GLADIATOR/FINISHIELD GLAZED
WOOD EDGE 12-0x6-8
OUTSWING STEEL DOOR
PART OR ASSEMBLY:
HORIZONTAL CROSS SECTION


NO.	DATE	REVISIONS	BY
B	2/9/2010	P.E. CHANGES	GL
A	6/19/09	CHG DP TABLE	WBD

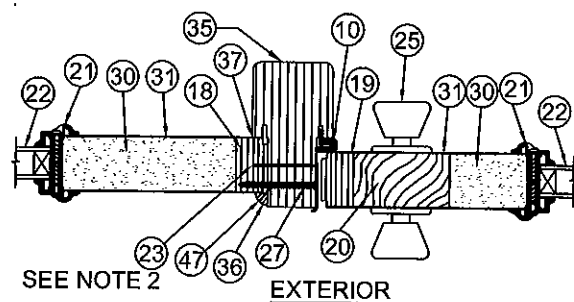


SEE NOTE 2
A HORIZONTAL CROSS SECTION
 8 SCALE: 2"=1'-0"

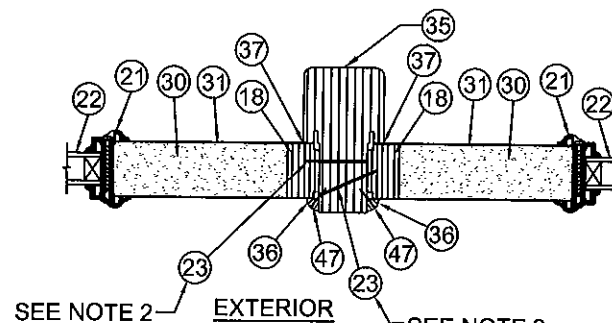


SEE NOTE 2
B HORIZONTAL CROSS SECTION
 8 SCALE: 2"=1'-0"

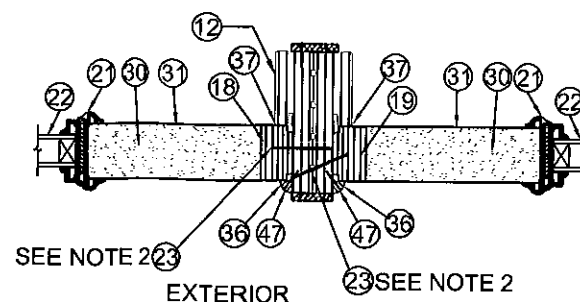


SEE NOTE 2
C HORIZONTAL CROSS SECTION
 8 SCALE: 2"=1'-0"

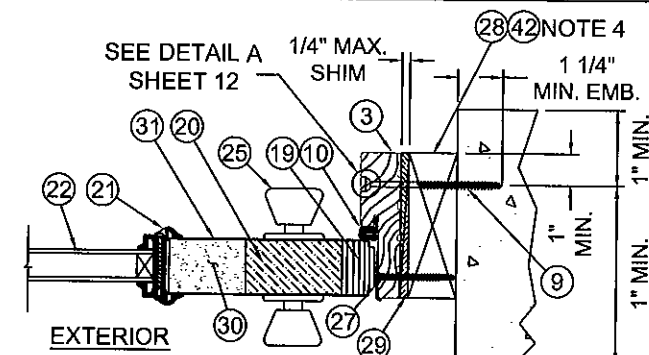


SEE DETAIL A SHEET 12
D HORIZONTAL CROSS SECTION
 8 MASONRY & CONCRETE INSTALL
 SCALE: 2"=1'-0"

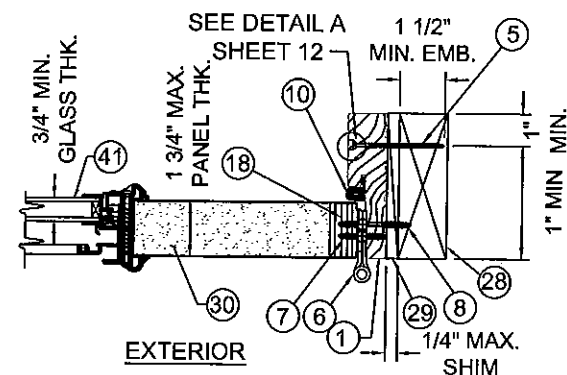


SEE DETAIL A SHEET 12
E HORIZONTAL CROSS SECTION
 8 WOOD INSTALLATION
 SCALE: 2"=1'-0"

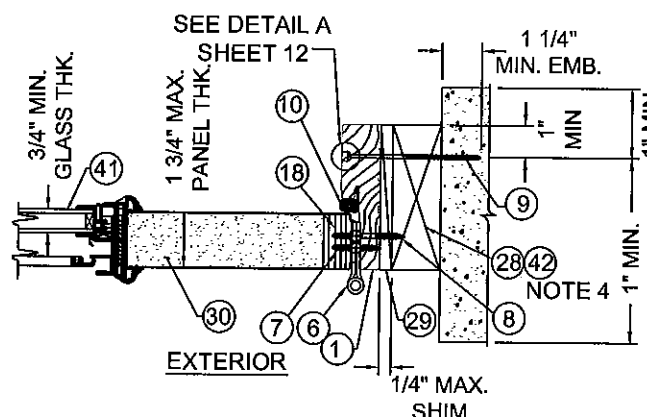


SEE DETAIL A SHEET 12
F HORIZONTAL CROSS SECTION
 8 MASONRY & CONCRETE INSTALL
 SCALE: 2"=1'-0"

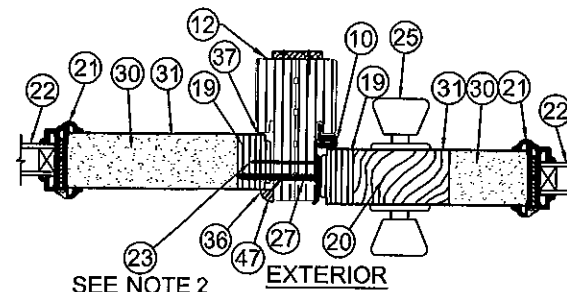


SEE NOTE 2
G HORIZONTAL CROSS SECTION
 8 SCALE: 2"=1'-0"

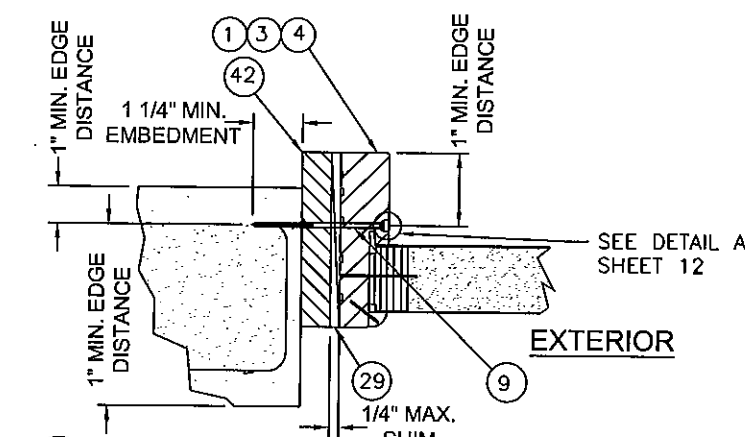


L HORIZONTAL CROSS SECTION
 8 FIXED UNIT 1X BUCK OPTION IN
 MASONRY & CONCRETE INSTALL
 (LEFT-HAND ANCHOR SHOWN, RIGHT-HAND ANCHOR SIMILAR)

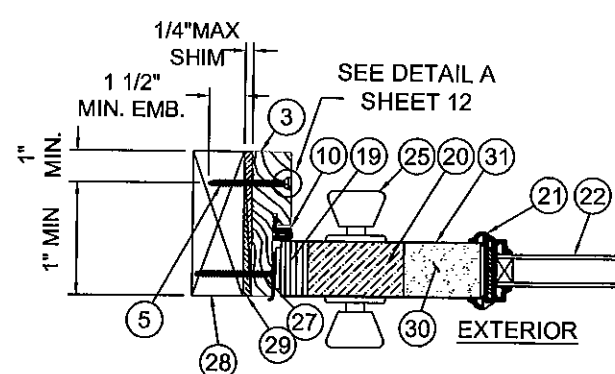


H HORIZONTAL CROSS SECTION
 8 WOOD INSTALLATION
 SCALE: 2"=1'-0"

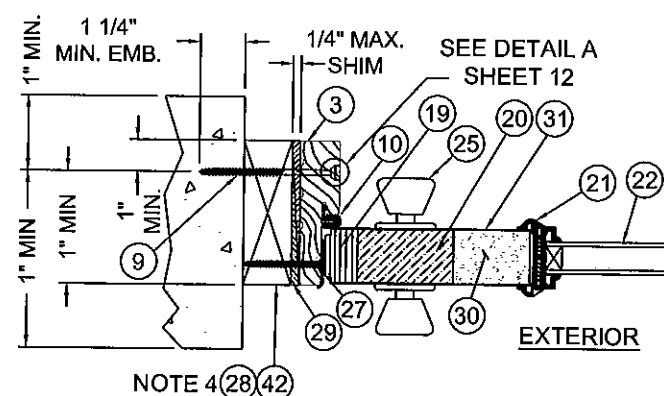


I HORIZONTAL CROSS SECTION
 8 MASONRY & CONCRETE INSTALL
 SCALE: 2"=1'-0"

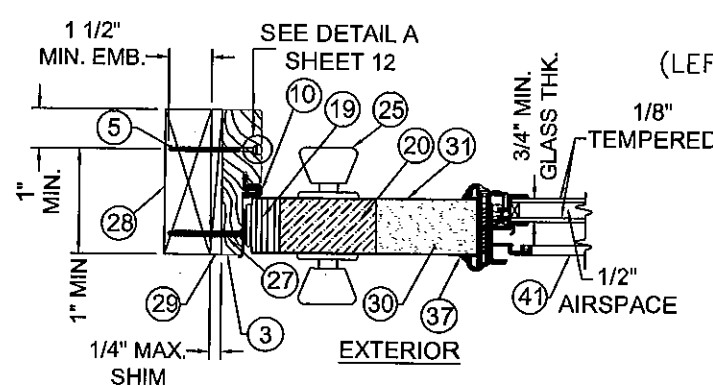

J MODEL 799 VENTED HALF LITE
 8 HORIZONTAL CROSS SECTION
 WOOD INSTALLATION
 SCALE: 2"=1'-0"

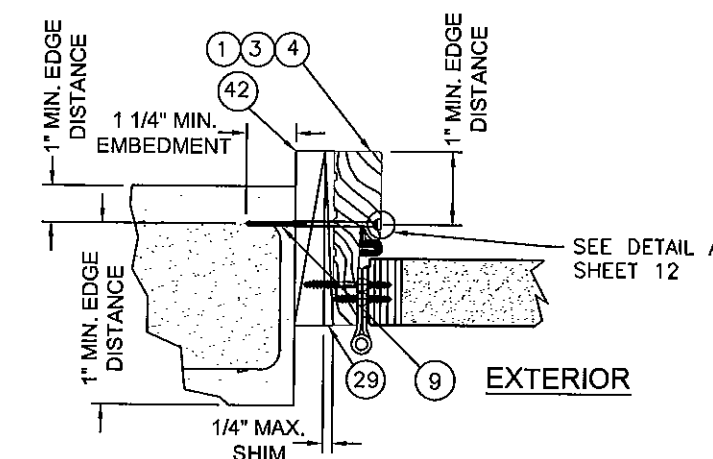

M HORIZONTAL CROSS SECTION
 8 OPERATING UNIT 1X BUCK OPTION IN
 MASONRY & CONCRETE INSTALL
 (LEFT-HAND ANCHOR SHOWN, RIGHT-HAND ANCHOR SIMILAR)

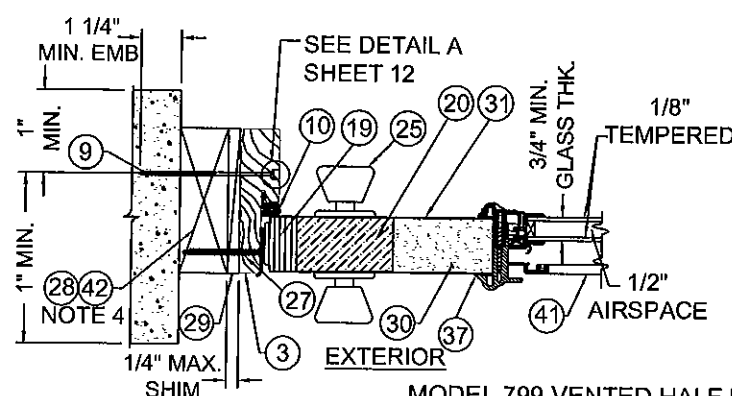

K MODEL 799 VENTED HALF LITE
 8 HORIZONTAL CROSS SECTION
 MASONRY AND CONCRETE INSTALLATION
 SCALE: 2"=1'-0"

NOTES:

- FOR ANCHOR SPACING (ITEMS #5 OR #9), SEE SHEETS 9, 10, & 11.
- SPACING FOR #23 FROM TOP OF SIDELITE DOWN (SEE SHEET 10).
- ASTRAGAL SCREW PATTERN SPACING FOR #13:
 FROM BOTTOM: 1/2", 2", 3 1/2", 20", 24 3/4".
 FROM TOP: 1/2", 2", 3 1/2", 20", 24 3/4", 39".
- 1X MAY BE UTILIZED AS AN OPTION. FOR VERTICAL SECTIONS, SEE DETAILS
 (C) (D) SHEET 6. HORIZONTAL SECTIONS: DETAILS (L) (M) SHEET 8.
- TAPCON MASONRY ANCHOR SPACING SAME AS WOOD ANCHOR SCREW CONFIGURATION.
- OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT IS ACHIEVED.

Approved as complying with the
 Florida Building Code
 Date 11/11/2010
 NOA# 09-0415-08
 Miami Dade Product Control
 Division
 By [Signature]

Kristina S. Daugherty
 CertWorks LLC.
 Florida P.E. No. 68455
 127 W. Fairbanks Ave, Ste 438
 Winter Park, FL 32789
 BPE Cert. of Authorization #28520

DATE: 8/12/08
 SCALE: AS NOTED
 DWG. BY: WBD
 CHK. BY: S. FREY
 DRAWING NO.: JW122008
 SHEET 8 OF 14


JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR, 97601
 PH. 541-882-3451

PRODUCT: GLADIATOR/FINISH GLAZED
 WOOD EDGE 12-0x6-8
 PART OR ASSEMBLY: OUTSWING STEEL DOOR
 HORIZONTAL CROSS SECTION


NO.	DATE	REVISIONS	BY
B	2/9/2010	P.E. CHANGES	GL
A	6/19/09	CHG DP TABLE	WBD

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451


PRODUCT: GLADIATOR/FINISH GLAZED WOOD EDGE 12-0x6-8 OUTSWING STEEL DOOR		PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS	
		GL	BY
		WBD	
		CHG DP TABLE	
		P.E. CHANGES	
		2/9/2010	
		6/19/09	
		DATE	
		NO.	
		REVISIONS	

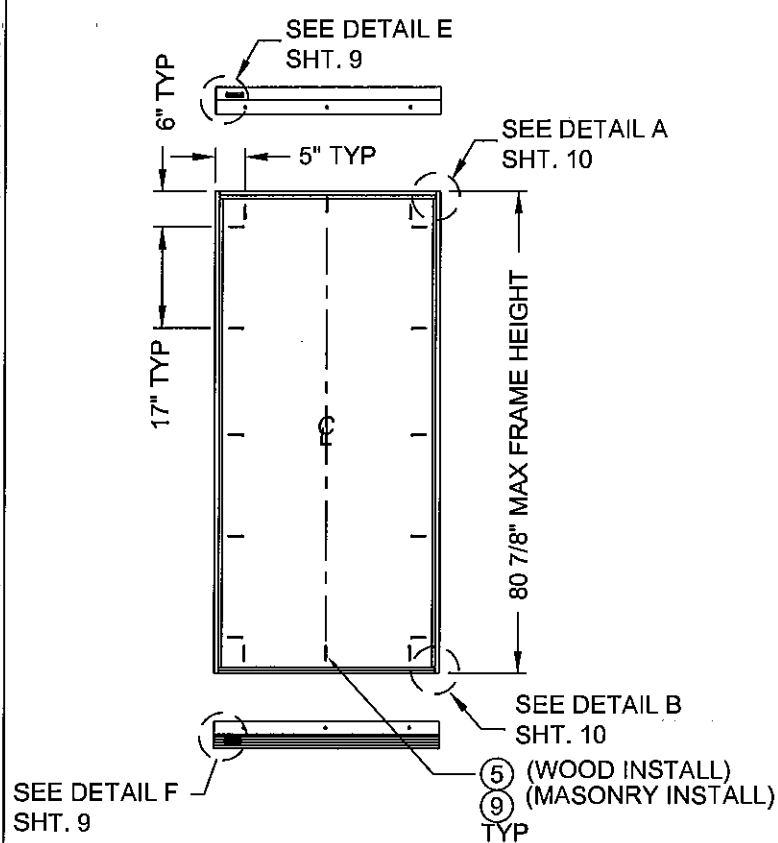


ANCHORING LOCATIONS OUTSWING SINGLE UNIT (X)
SCALE: 3/8" = 1'-0"

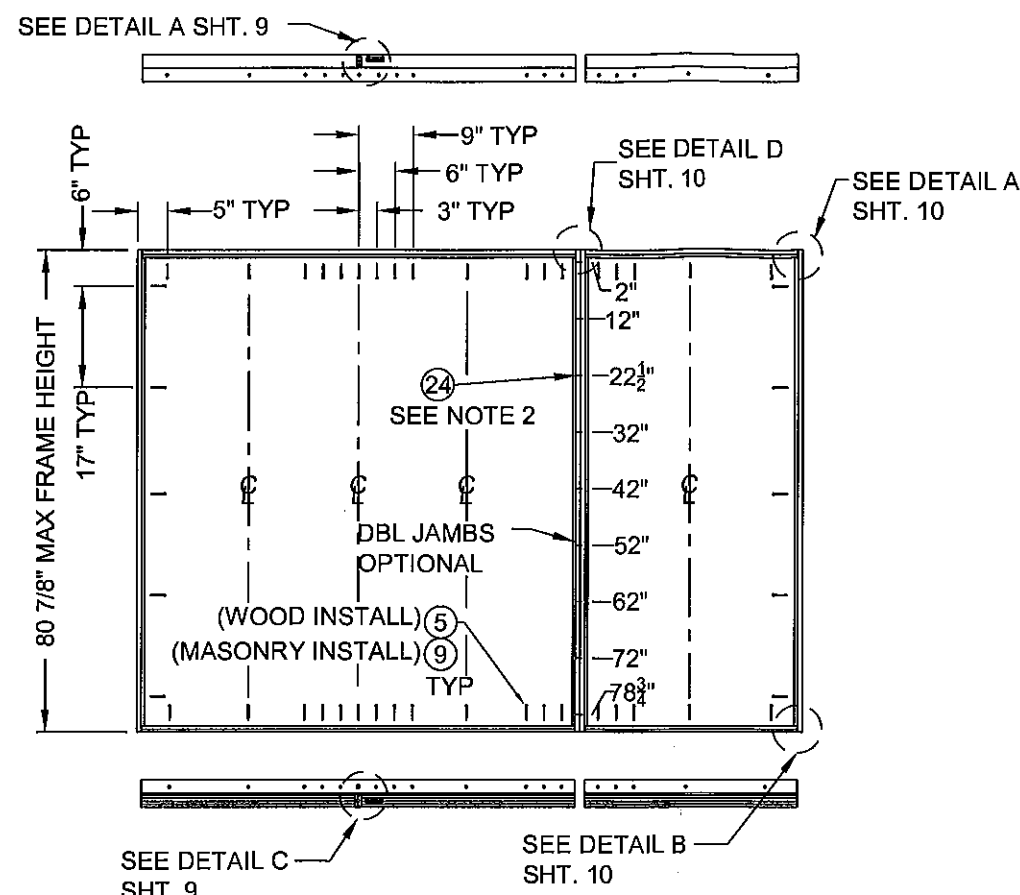


ANCHORING LOCATIONS DOUBLE OUTSWING UNIT W/ 1 SIDELITE (XXO)
SCALE: 3/8" = 1'-0"

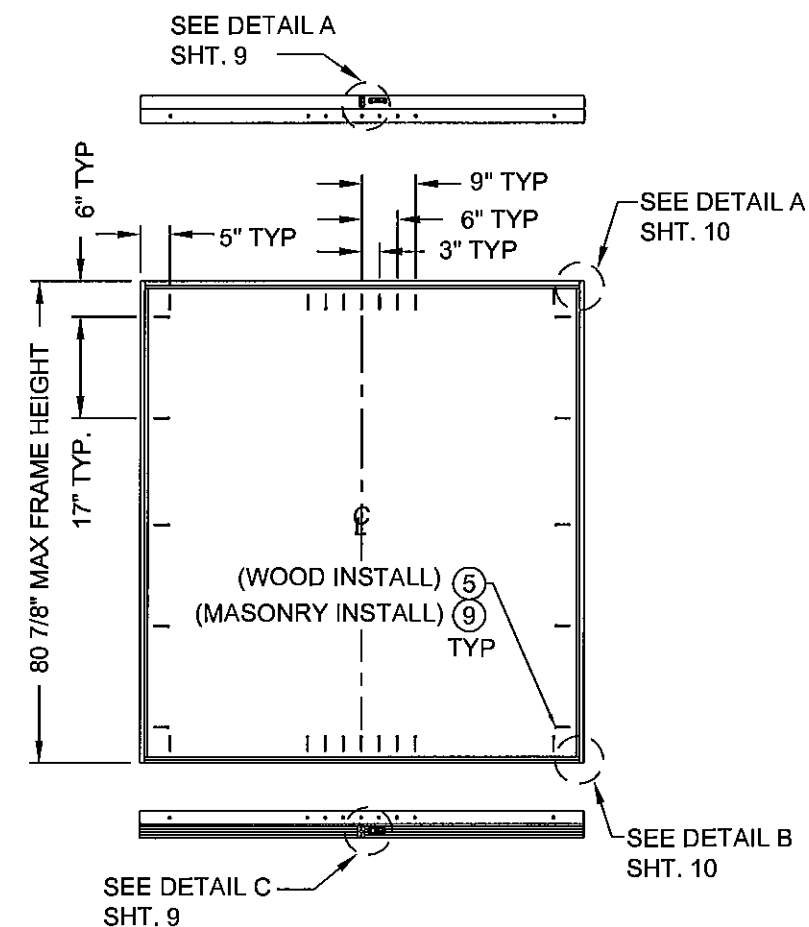


ANCHORING LOCATIONS DOUBLE OUTSWING UNIT (XX)
SCALE: 3/8" = 1'-0"

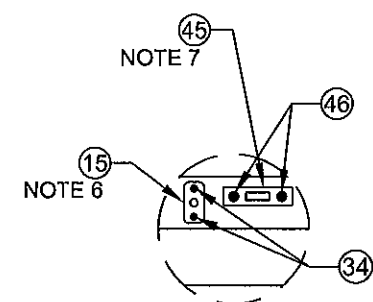


DETAIL A
UPPER SURFACE BOLT STRIKE PLATE & UPPER ASTRAGAL BOLT STRIKE
SCALE: 1/2" = 1'-0"

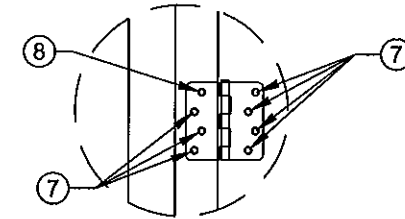


DETAIL B
HINGE DETAIL
SCALE: 1/2" = 1'-0"

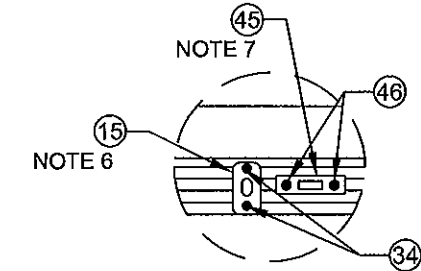


DETAIL C
LOWER SURFACE BOLT STRIKE PLATE & LOWER ASTRAGAL BOLT STRIKE
SCALE: 1/2" = 1'-0"

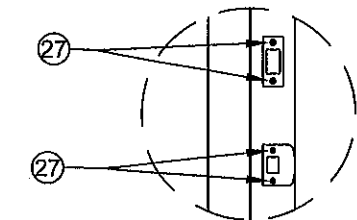

DETAIL D
LATCH & DEADBOLT STRIKE PLATES
SCALE: 1/2" = 1'-0"

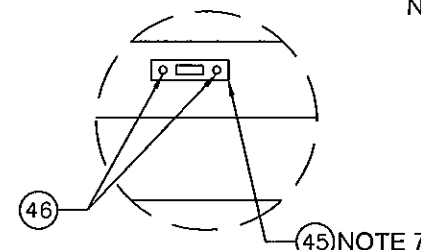

DETAIL E AT HEAD
SURFACE BOLT PLATE
SCALE: 1/2" = 1'-0"

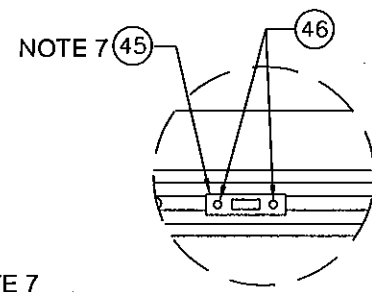



DETAIL F AT SILL
SURFACE BOLT PLATE
SCALE: 1/2" = 1'-0"

- NOTES:
1. CORRUGATED FASTENERS TO BE APPLIED ON BOTH INTERIOR AND EXTERIOR SURFACES AT SPACING SHOWN, +/-1", FOR TOTAL OF NINE FASTENERS PER SIDE.
 2. CORRUGATED FASTENERS ARE UTILIZED ON DOUBLE BACK JAMBS ONLY. OMIT ON SOLID MULL POST CONFIGURATIONS.
 3. SEE SHEET 10 FOR LATCH AND HINGE LOCATIONS.
 4. SEE SHEET 10 FOR SIDELITE FASTENER LOCATIONS.
 5. SEE SHEET 10 FOR SIDELITE BRAD NAIL LOCATIONS FOR QUARTER ROUND MOULDING ATTACHMENT.
 6. ASTRAGAL THROW BOLT HOLES AT HEAD AND SILL ARE DRILLED AT FABRICATION WHEN ASTRAGAL IS APPLIED AND THROW BOLT LOCATIONS ARE DETERMINED. STRIKE PLATES ARE ATTACHED IN THE FIELD.
 7. TOP AND BOTTOM SURFACE BOLTS ARE APPLIED AT FABRICATION. SURFACE BOLT HOLES ARE ALSO DRILLED AT FABRICATION WHEN BOLT LOCATIONS ARE DETERMINED. STRIKE PLATES ARE ATTACHED IN THE FIELD.

Approved as complying with the Florida Building Code
Date 11/11/2010
NOA# 09-0415-08
Miami Dade Product Control Division
By *[Signature]*

[Signature]
10-14-10
Kristina S. Dougherty
CertWorks LLC
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

DATE: 8/12/08
SCALE: AS NOTED
DWG. BY: WBD
CHK. BY: S. FREY
DRAWING NO.: JW122008
SHEET 9 OF 14

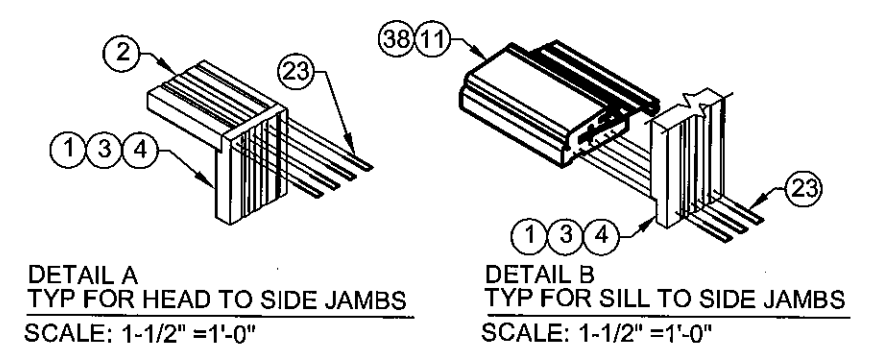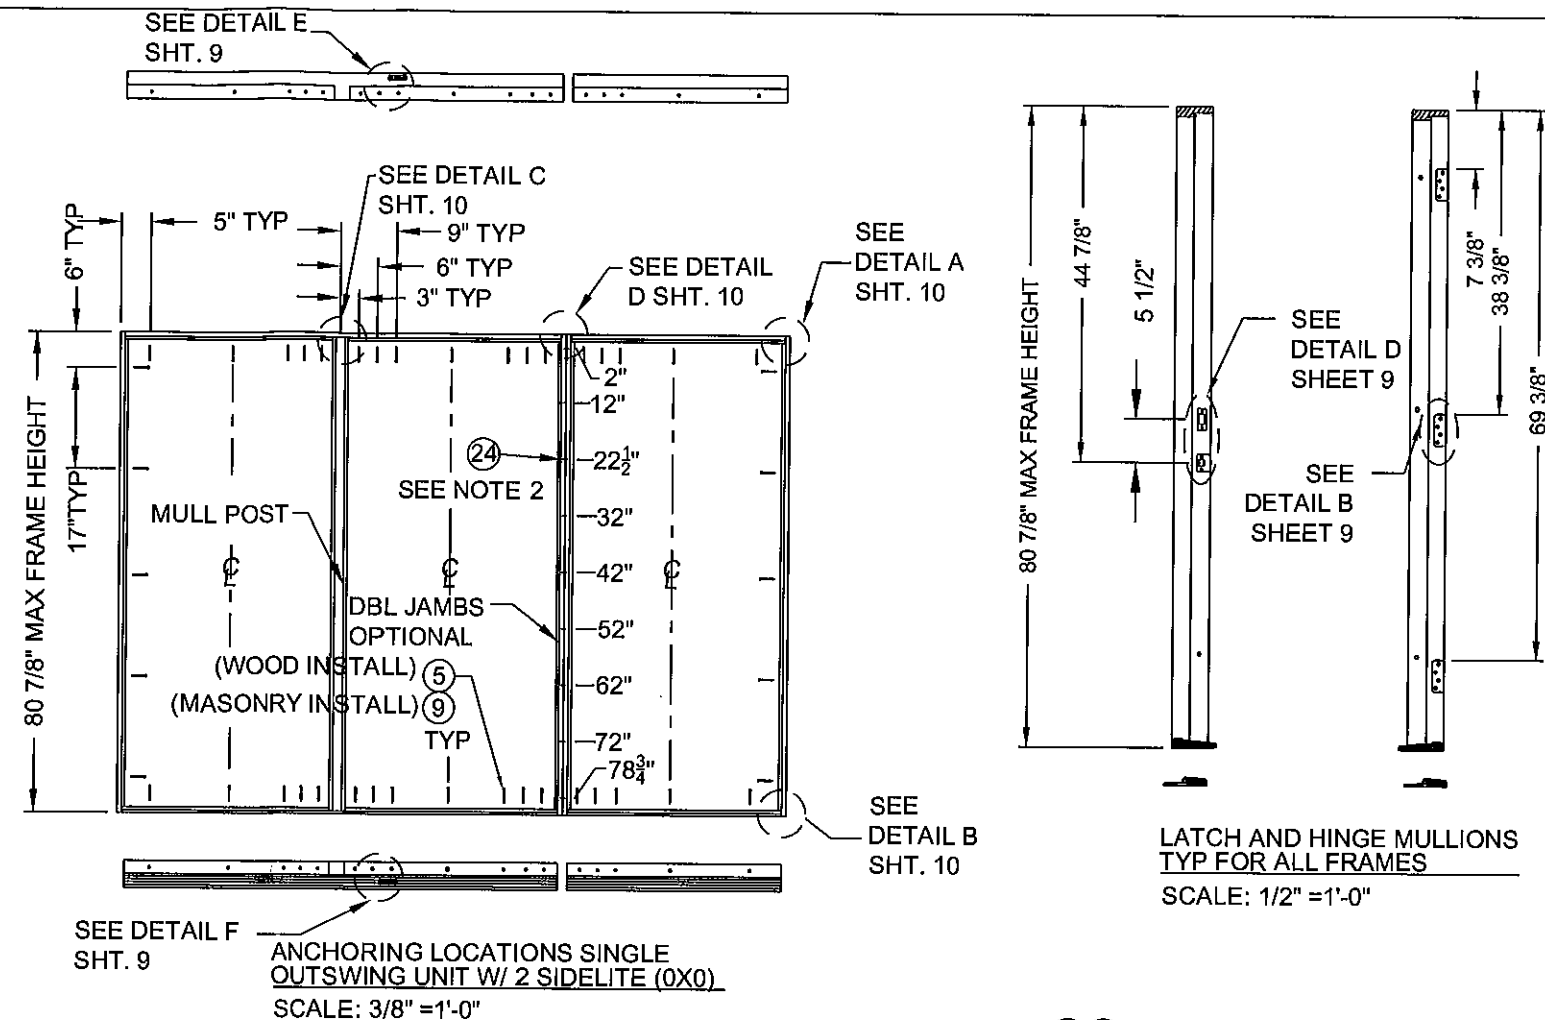

- NOTES:
1. CORRUGATED FASTENERS TO BE APPLIED ON BOTH INTERIOR AND EXTERIOR SURFACES AT SPACING SHOWN, +/-1", FOR TOTAL OF NINE FASTENERS PER SIDE.
 2. CORRUGATED FASTENERS ARE UTILIZED ON DOUBLE BACK JAMBS ONLY. OMIT ON SOLID MULL POST CONFIGURATIONS.
 3. SEE SHT 10 FOR LATCH AND HINGE LOCATIONS.
 4. SEE SHT 10 FOR SIDELITE FASTENER LOCATIONS.
 5. SEE SHT 10 FOR SIDELITE BRAD NAIL LOCATIONS FOR QUARTER ROUND MOUNDING ATTACHMENT.
 6. ALL VIEWS FROM EXTERIOR.





Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 090415-08
Miami Dade Product Control
Division
By [Signature]

Kristina S. Daugherty
CertWorks LLC.
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

PRODUCT:	GLADIATOR/FINISHIELD GLAZED WOOD EDGE 12-0x6-8 OUTSWING STEEL DOOR
PART OR ASSEMBLY:	ANCHORING LOCATIONS & DETAILS

B	2/9/2010	P.E. CHANGES	GL						
A	6/19/09	CHG DP TABLE	WBD						
NO.	DATE	REVISIONS	BY						
DATE: 8/12/08									
SCALE: AS NOTED									
DWG. BY: WBD									
CHK. BY: S. FREY									
DRAWING NO.: JW122008									
SHEET 10 OF 14									

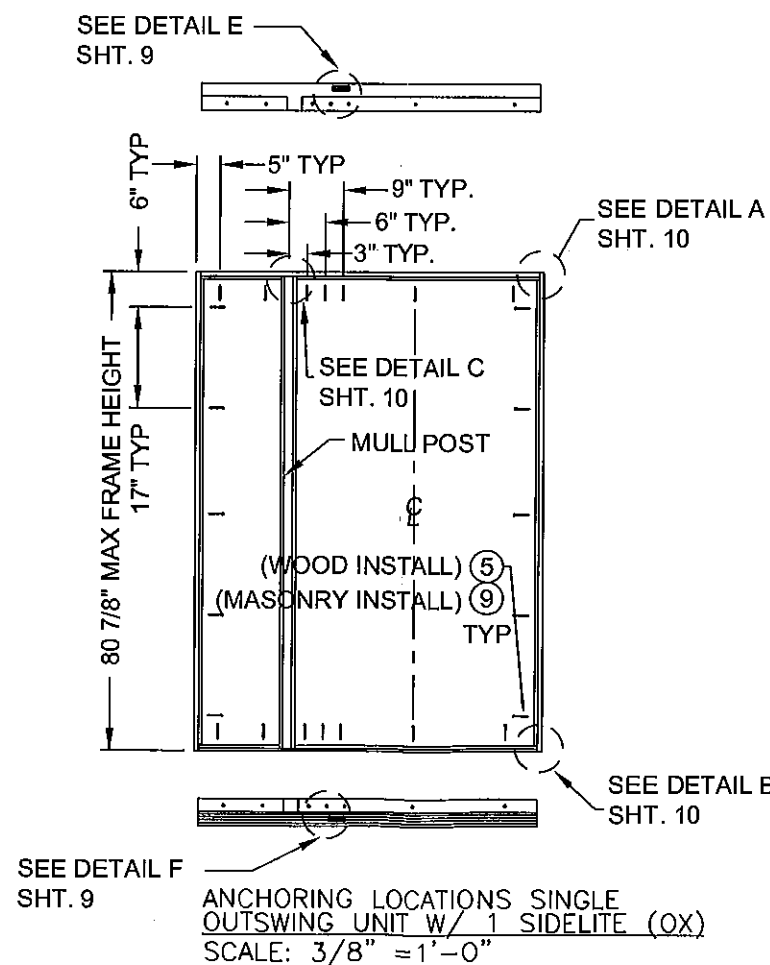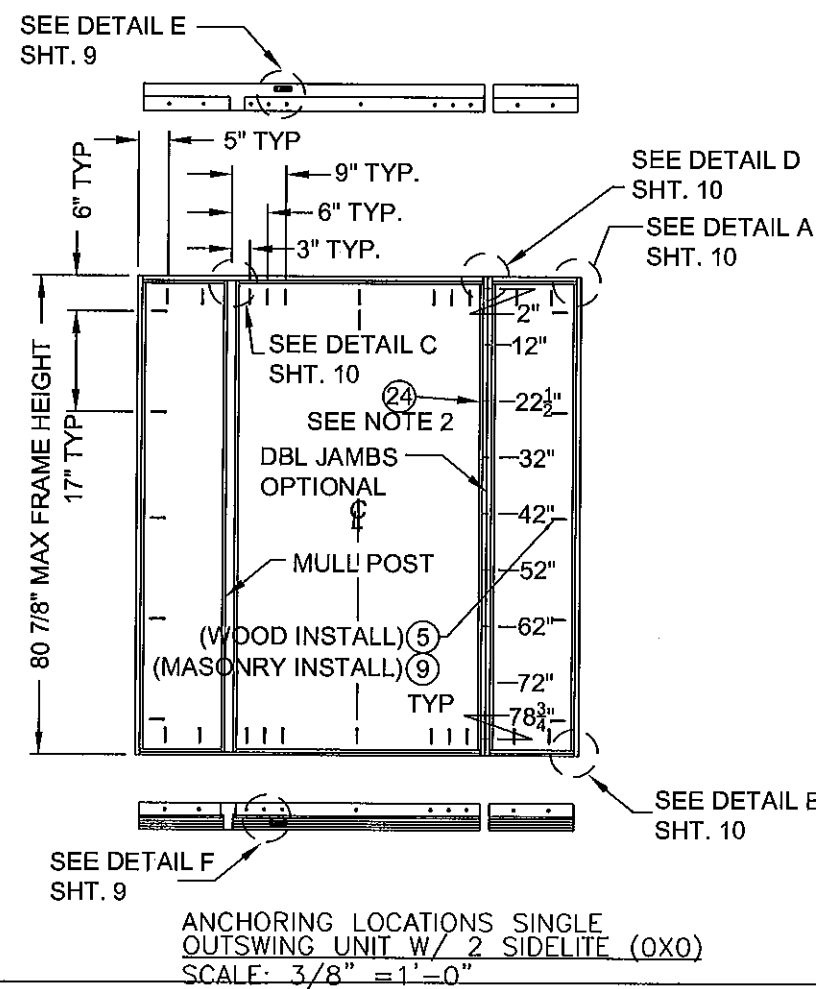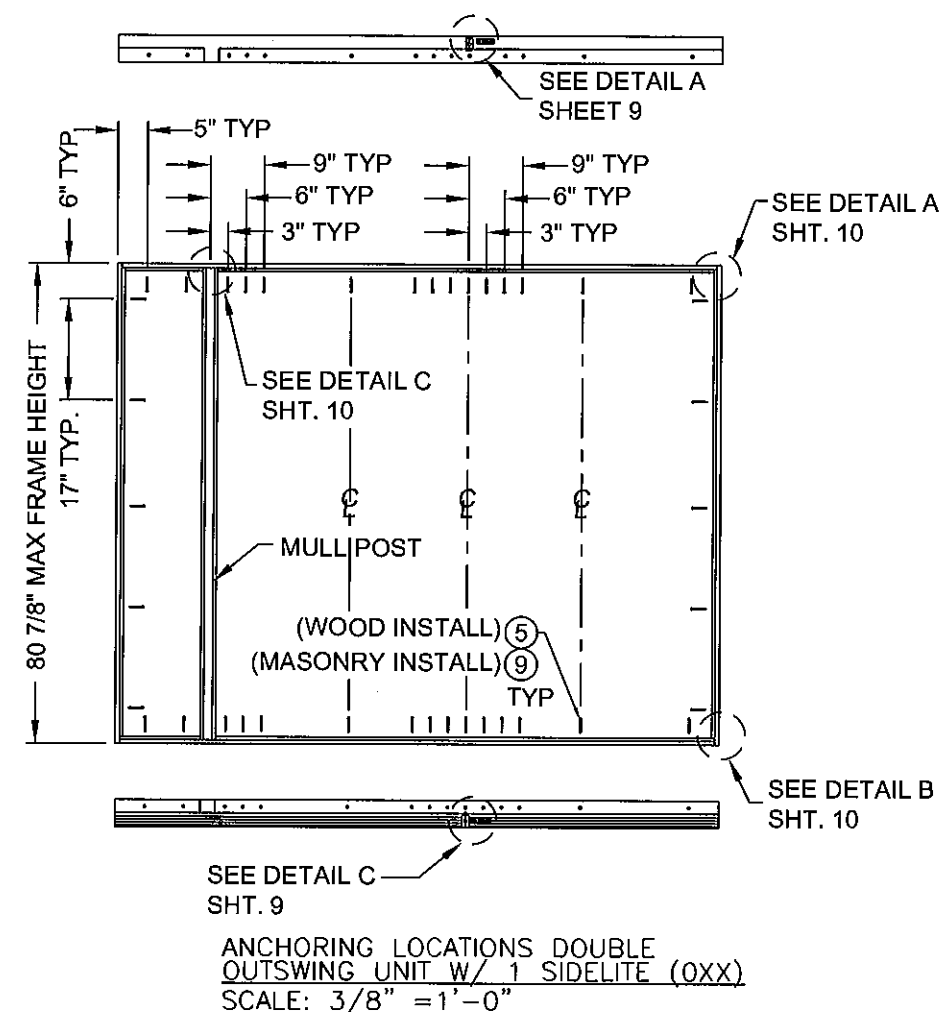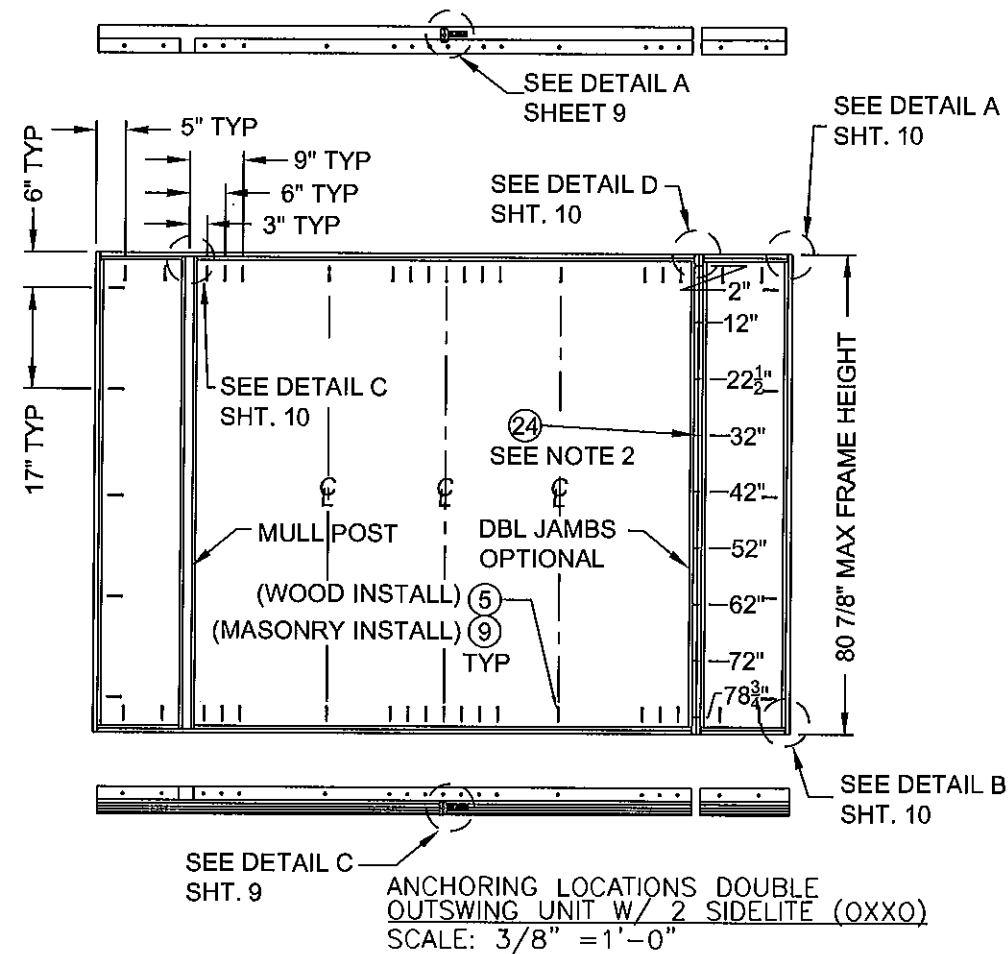

NOTES:

1. CORRUGATED FASTENERS TO BE APPLIED ON BOTH INTERIOR AND EXTERIOR SURFACES AT SPACING SHOWN, +/-1", FOR TOTAL OF NINE FASTENERS PER SIDE.
2. CORRUGATED FASTENERS ARE UTILIZED ON DOUBLE BACK JAMBS ONLY. OMIT ON SOLID MULL POST CONFIGURATIONS.
3. SEE SHT 10 FOR LATCH AND HINGE LOCATIONS.
4. SEE SHT 10 FOR SIDELITE FASTENER LOCATIONS.
5. SEE SHT 10 FOR SIDELITE BRAD NAIL LOCATIONS FOR QUARTER ROUND MOUNDING ATTACHMENT.
6. ALL VIEWS FROM EXTERIOR.

Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 09-2415-DB
Miami Dade Product Control
Division
By *[Signature]*






[Signature]
10-14-10
Kristina S. Dougherty
CertWorks LLC.
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

DATE: 8/12/08
SCALE: AS NOTED
DWG. BY: WBD
CHK. BY: S. FREY
DRAWING NO.: JW122008
SHEET 11 OF 14

PRODUCT: GLADIATOR/FINISHIELD GLAZED
WOOD EDGE 12-0x6-8
OUTSWING STEEL DOOR

PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

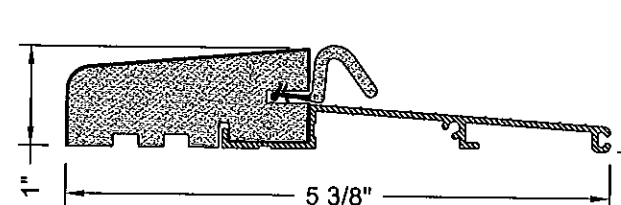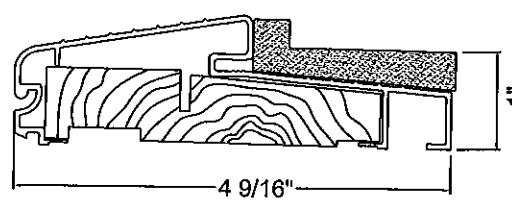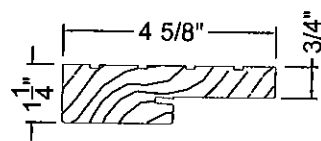







- 1 WOOD JAMB
FINGERJOINTED PINE
2 SCALE: 3" = 1'-0"
3
4

- 6 BUTT HINGE
4x4x12 GA. STEEL
SCALE: 3" = 1'-0"

- 38 OPTIONAL OUTSWING THRESHOLD
AFCO A-496 O/S BUMPER SILL WITH PINE SUBSTRATE
& DD-233-0 OUTSWING ADAPTOR BASE
SCALE: 6" = 1'-0"

- 11 OUTSWING THRESHOLD
AFCO A297
6063-T5 ALUMINUM/COMPOSITE PLASTIC
SCALE: 6" = 1'-0"

- 35 MULL POST
LAMINATED VENEER LUMBER (LVL)
SCALE: 6" = 1'-0"
SPECIE - SOUTHERN PINE
GRADE - SELECT STRUCTURAL
MIN. G = 0.55

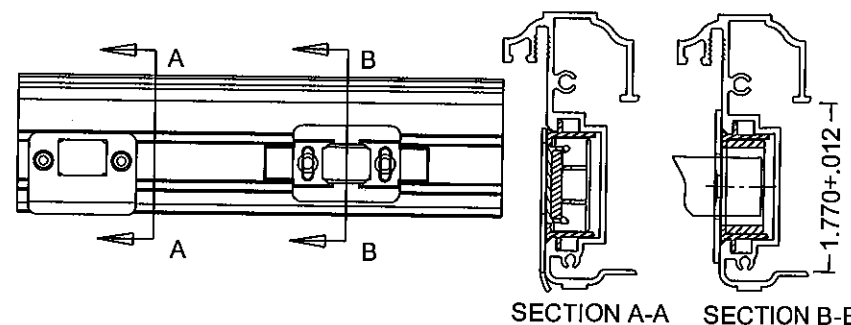

- 10 COMPRESSION
WEATHERSTRIP
LOXSEAL 650
VINYL
SCALE: 6" = 1'-0"





- 13 ASTRAGAL (GLOBAL)
6063-T6 ALUMINUM
SCALE: 3" = 1'-0"

- 15 WATA STRIKE & DEADBOLT
6063 T6 ALUMINUM SCALE: 3" = 1'-0"

- 16 STILES AND RAILS
TOP RAIL
HINGE STILE
LAMINATED VENEER
LUMBER (LVL)
SCALE: 3" = 1'-0"

- 17 BOTTOM RAIL
25 GA. STEEL
SCALE: 3" = 1'-0"

- 19 LATCH SIDE STILE
LAMINATED VENEER LUMBER (LVL)
SCALE: 3" = 1'-0"




- 20 LOCK BLOCK
FINGERJOINTED PINE
SCALE: 3" = 1'-0"





- 21 ODL LIP-LITE FRAME
PLASTIC
SCALE: 3" = 1'-0"
NOA 07-0214.08

- 32 DOOR BOTTOM SWEEP
VINYL
SCALE: 3" = 1'-0"

- 33 CORNER PADS
PLASTIC
SCALE: 3" = 1'-0"

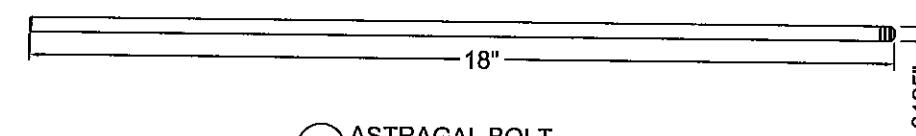

- 39 ASTRAGAL BOLT
MATERIAL: COLD ROLLED STEEL
ZINC & YELLOW CHROMATE
SCALE: 3" = 1'-0"

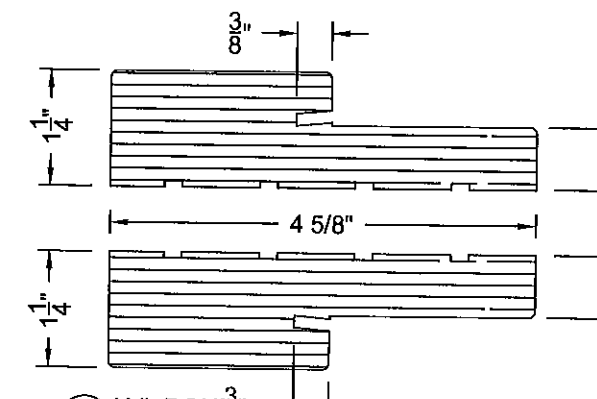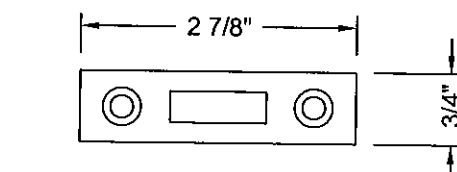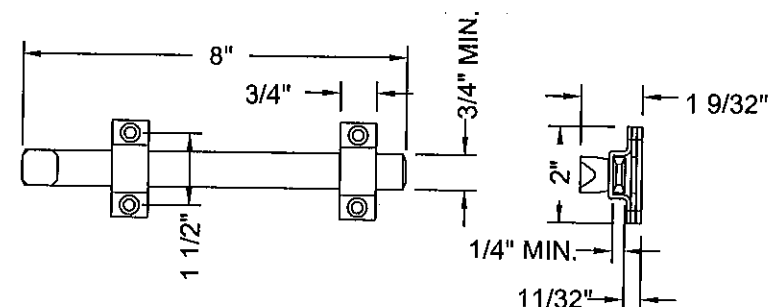


- 40 IVES SURFACE BOLT
STEEL
SCALE: 3" = 1'-0"

- 45 IVES SURFACE BOLT STRIKE PLATE
STEEL
SCALE: 6" = 1'-0"

- 44 IVES SURFACE BOLT SPACER
PLASTIC
SCALE: 3" = 1'-0"

- 12 LVL DOUBLE BACK JAMB
LAMINATED VENEER LUMBER (LVL)
SCALE: 6" = 1'-0"
SPECIE - SOUTHERN PINE
GRADE - SELECT STRUCTURAL
MIN. G = 0.55

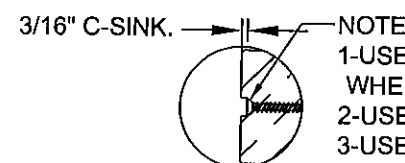

NOTE
1-USE #10 WOOD INSTALLATION SCREW W/ 1.50" MIN. EMBEDMENT
WHEN INSTALLING INTO WOOD SUBSTRATE AT HEAD & JAMBS.
2-USE #8 x 2 1/2" PFH WOOD SCREW WHEN INSTALLING INTO MULLIONS.
3-USE 3/16" ITW TAPCON ANCHOR W/ 1 1/4" MIN. EMBED.
WHEN INSTALLING INTO CONCRETE/MASONRY SUBSTRATE AT SIDELITE SILLS.

DETAIL - A
SCALE: 1/4" = 1'-0"

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

PRODUCT: GLADIATOR/FINISHIELD GLAZED
WOOD EDGE 12-0x6-8
OUTSWING STEEL DOOR
PART OR ASSEMBLY:





UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
B	2/9/2010	P.E. CHANGES	GL
A	6/19/09	CHG DP TABLE	WBD

Approved as complying with the
Florida Building Code
Date 11/11/2010
NOA# 09-0415-08
Miami Dade Product Control
Division
By

Kristina S. Daugherty
CertWorks LLC.
Florida P.E. No. 68455
127 W. Fairbanks Ave, Ste 438
Winter Park, FL 32789
FBPE Cert. of Authorization #28520

DATE: 8/12/08
SCALE: AS NOTED
DWG. BY: WBD
CHK. BY: S. FREY
DRAWING NO.: JW122008
SHEET 12 OF 14

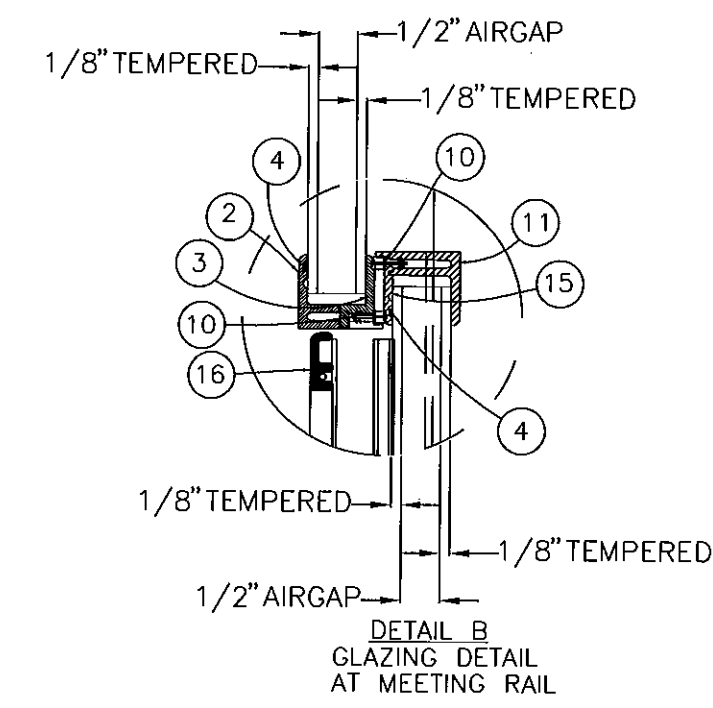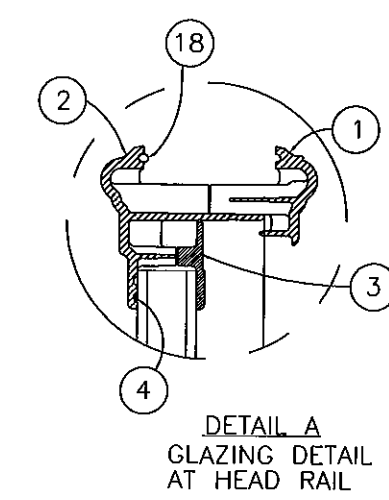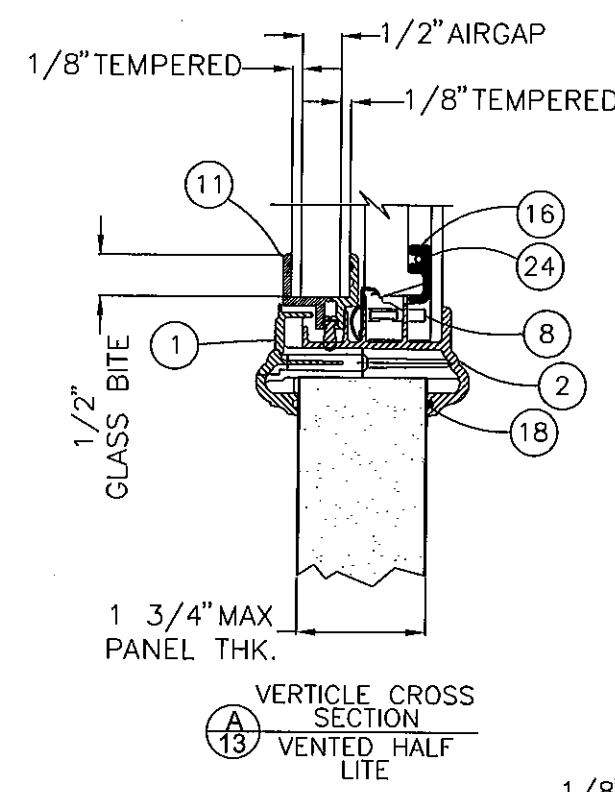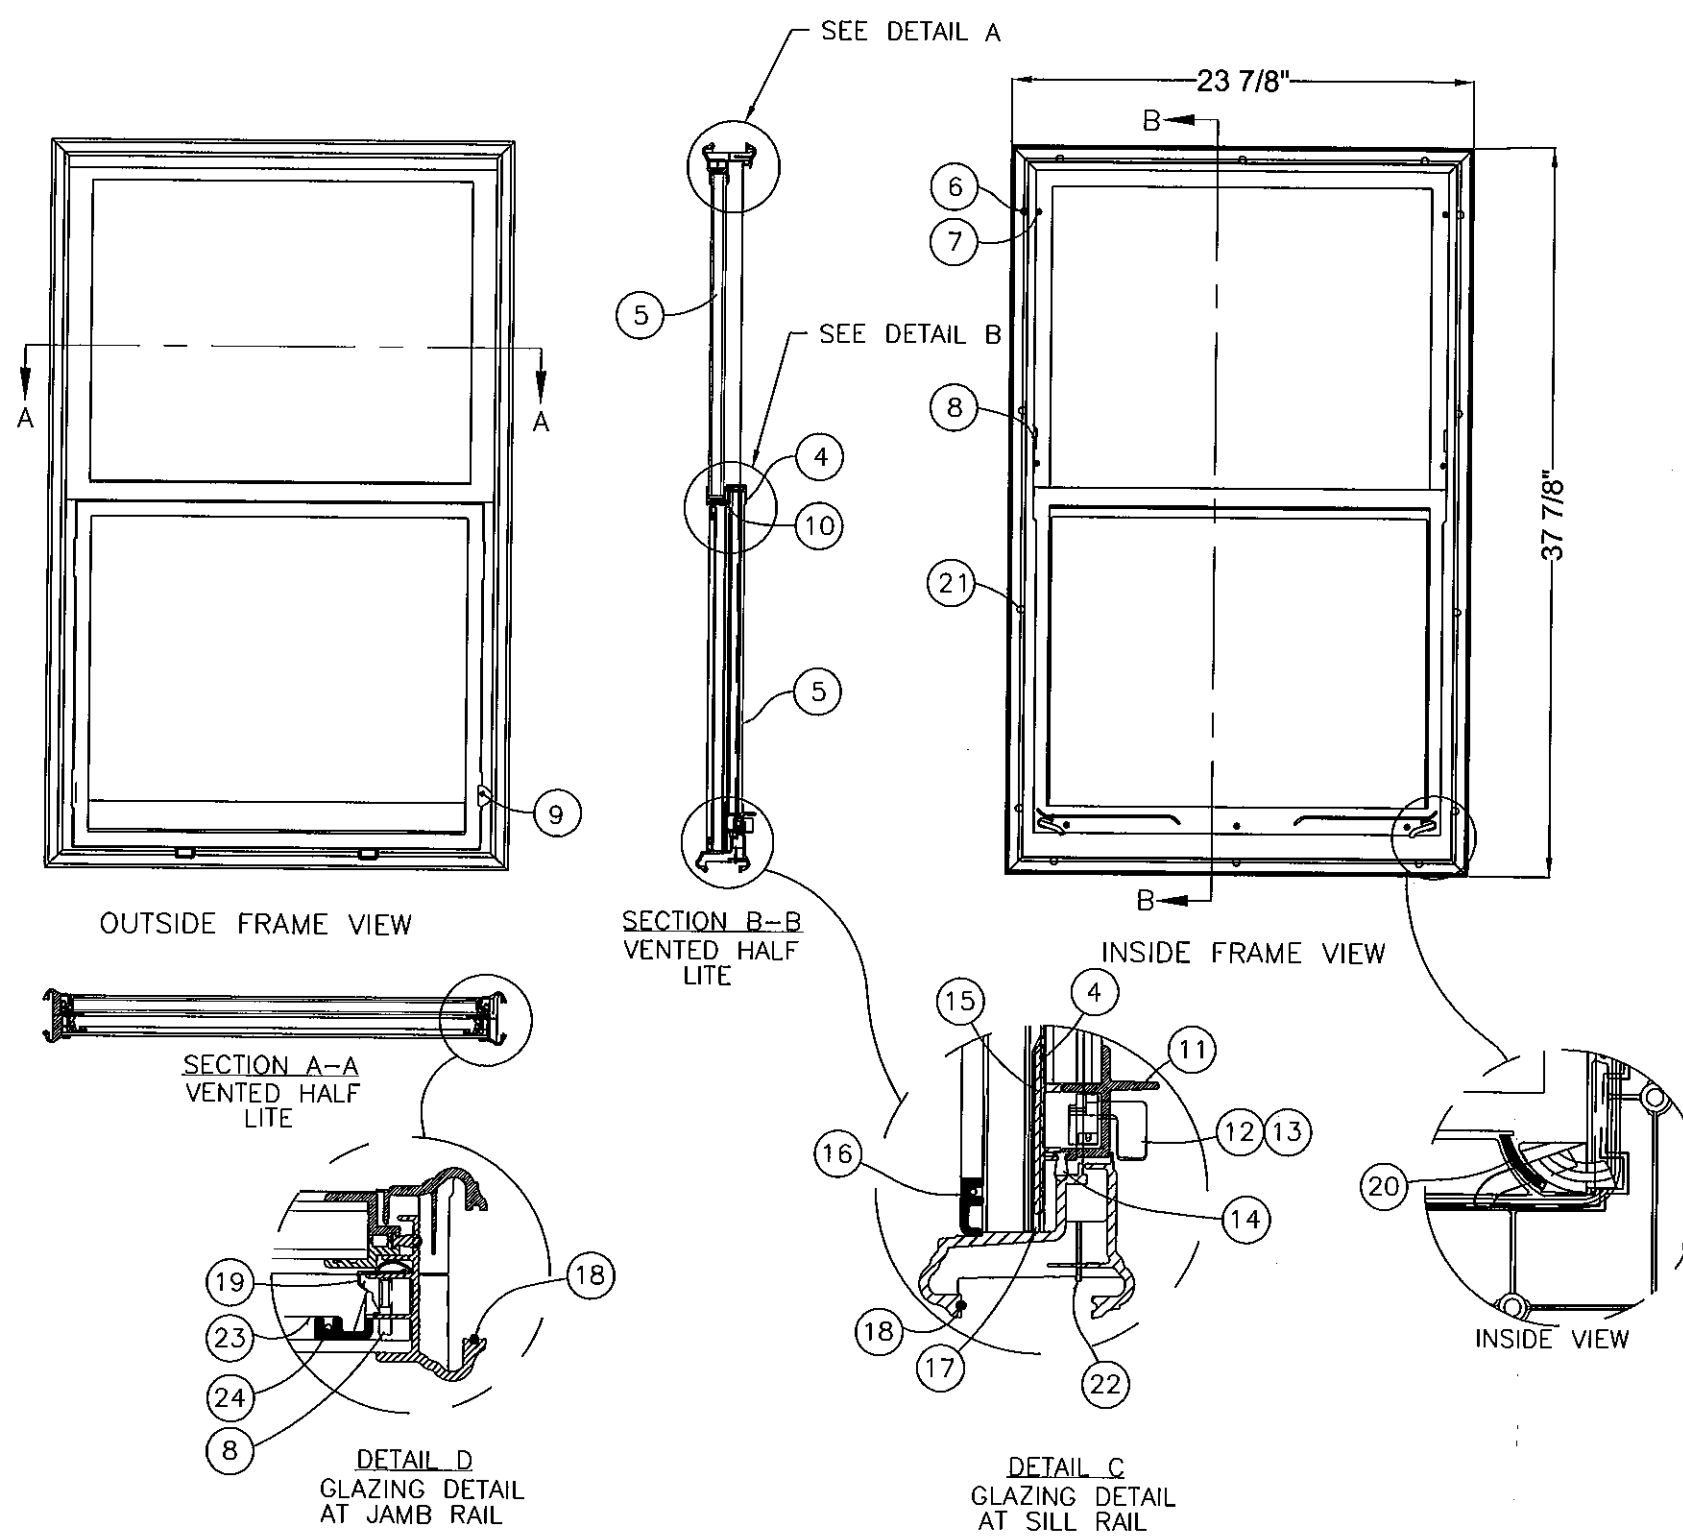

- NOTES:**
- SEE SHEET 14 FOR ITEM DESCRIPTIONS.
 - PLEASE REFER TO NOA NO. 07-0807.05 FOR PLASTIC APPROVAL

Approved as complying with the Florida Building Code
 Date 11/11/2010
 NOA# 09-0415.08
 Miami Dade Product Control Division
 By [Signature]

[Signature]
 10-14-10
 Kristino S. Daugherty
 CertWorks LLC
 Florida P.E. No. 68455
 127 W. Fairbanks Ave, Ste 438
 Winter Park, FL 32789
 BPE Cert. of Authorization #28520

DATE: 8/12/08
 SCALE: AS NOTED
 DWG. BY: WBD
 CHK. BY: S. FREY
 DRAWING NO.: JW122008
 SHEET 13 OF 14

JELD-WEN, INC. 3737 LAKEPORT BLVD. KLAMATH FALLS, OR, 97601 PH. 541-882-3451									
PRODUCT:		GLADIATOR/FINISHIELD GLAZED WOOD EDGE 12-0x6-8 OUTSWING STEEL DOOR							
PART OR ASSEMBLY:		ODL MODEL 799 VENT LITE							

