



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1107
 MIAMI, FLORIDA 33130-1563
 (305) 375-2902 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Continental Glass Systems, Inc.
325 West 74 Place
Hialeah, FL 33014

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "5500-SH" Aluminum Single Hung Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. **CGS005**, titled "Series 5500-SH Single Hung Window", sheets 1 through 5 of 5, dated 06/26/09 with revision B dated 08/25/09, prepared by CertWorks, LLC, signed and sealed by Kristina S. Daugherty, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 9/16/09

NOA No. 09-0630.15
 Expiration Date: October 07, 2014
 Approval Date: October 07, 2009
 Page 1

Continental Glass Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **CGS005**, titled "Series 5500-SH Single Hung Window", sheets 1 through 5 of 5, dated 06/26/09 with revision B dated 08/25/09, prepared by CertWorks, LLC, signed and sealed by Kristina S. Daugherty, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL - 5965**, dated 06/18/09, signed and sealed by Julio E. Gonzalez, P. E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by CertWorks, LLC, dated 06/26/09, signed, sealed and dated 09/16/09 by Kristina S. Daugherty, P.E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **08-0520.08** issued to Solutia Inc. for their "**Vanceva Composites Glass Interlayer**" dated 7/17/08, expiring on 12/11/13.

E. STATEMENTS

1. Statement letter of conformance and no financial interest, dated June 26, 2009, signed and sealed by Kristina S. Daugherty, P. E.
2. Laboratory compliance letter for Test Report No. **FTL-5965**, issued by Fenestration Testing Laboratory, Inc., dated June 18, 2009, signed and sealed by Julio E. Gonzalez, P. E.
3. Proposal No. **09-1644** issued by BCCO, dated May 27, 2009, signed by Jaime D. Gascon, P. E.

G. OTHERS

1. None.



Jaime D. Gascon, P. E.

Chief, Product Control Division

NOA No. 09-0630.15

Expiration Date: October 07, 2014

Approval Date: October 07, 2009

CONTINENTAL GLASS SYSTEMS

SERIES 5500 SINGLE HUNG WINDOW



325 W. 74TH PLACE
HIALEAH, FL 33014
PH: (305) 231-1101 FX: (305) 231-1103

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE #14 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION THROUGH STEEL STUD USE #14 SELF-TAPPING SCREWS PER INSTALLATION CLIP OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM ENGAGEMENT INTO STEEL FRAME SUBSTRATE.
- FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- ALL 1X AND 2X BUCKS IN CONTACT WITH MASONRY OR CONCRETE SUBSTRATES TO BE PROTECTED PER 2007 FBC, CHAPTER 2326.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2007 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: ALUMINUM 6063-T6
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 5 FOR GLAZING DETAIL.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	B	INSTALLATION & GENERAL NOTES
2	A	ELEVATION & ANCHOR LAYOUT
3	B	VERTICAL SECTIONS
4	B	HORIZONTAL SECTIONS
5	B	COMPONENTS, GLAZING DETAIL & BILL OF MATERIALS

LARGE MISSILE IMPACT RATED

TITLE: SERIES 5500 SH INSTALLATION & GENERAL NOTES
 PREPARED BY: CERTWORKS, LLC
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	BY	DATE
A	T.O.C. PER MIAMI-DADE COMMENTS	JLR	08/06/09
B	ADDED 2004 TO ASTM E 1300	HFN	08/25/09

Kristina S. Dalrymple
 8-25-09
 KRISTINA S. DALRYMPLE
 FLORIDA P. E. NO. 06455
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 FBRE CERT. OF AUTHORIZATION NO. 28650

Approved as complying with the Florida Building Code
 Date October 07, 2009
 NOA# 09-0636.15
 Miami Dade Product Control
 Division
 By *[Signature]*

DATE: 06.26.09
 DWN BY: GRN
 CHK BY: KSD
 SCALE: NTS
 DWG #: CGS005
 SHEET: 1 OF 5

TITLE: **SERIES 5500 SH ELEVATIONS & ANCHOR LAYOUTS**

PREPARED BY: **CERTWORKS, LLC**
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366


REVISIONS

NO.	DESCRIPTION	BY	DATE
A	ANCHORS & PRESSURES PER M-D	JLR	08/06/09


[Signature]
8-25-09
KRISTINA S. DALGHERY
FLORIDA P.E. NO. 88455
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FBRP CERT. OF AUTHORIZATION NO. 28500

Approved as complying with the Florida Building Code
Date: **October 07, 2009**
NOA# **09-0630.15**
Miami Dade Product Control
By: *[Signature]*

DATE: 06.26.09
DWN BY: GRN
CHK BY: KSD
SCALE: NTS
DWG #: **CGS005**
SHEET: **2 OF 5**

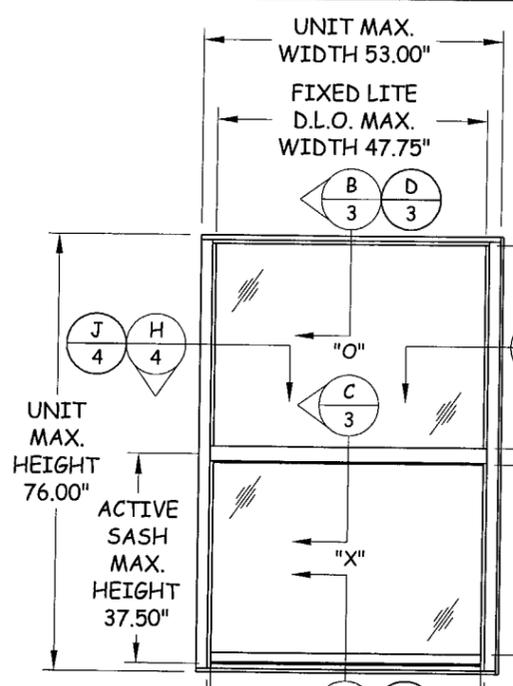


ELEVATION
SINGLE UNIT

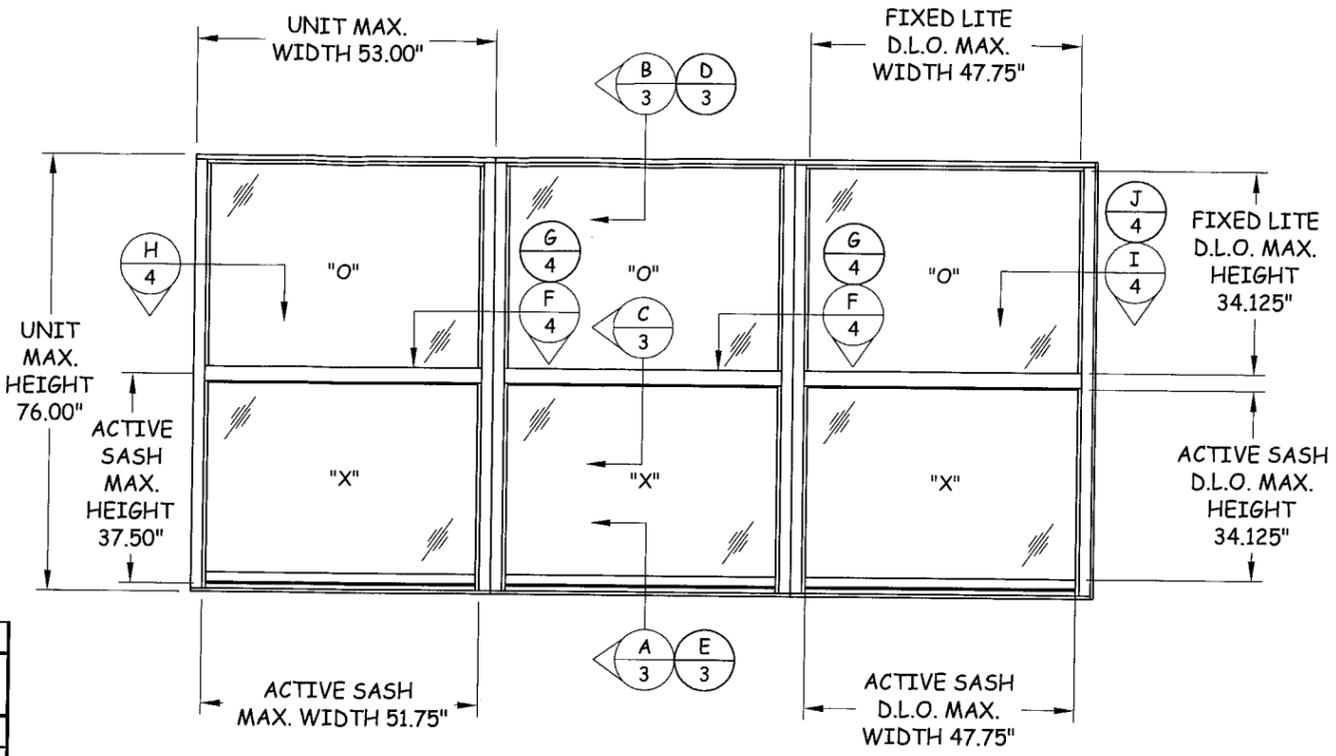


ELEVATION
MULTIPLE UNIT

Height (in)	Width (in)	w/ Reinforcement	w/o Reinforcement
42.0	24.0	90.0	90.0
	30.0	90.0	90.0
	38.0	90.0	90.0
	42.0	90.0	-
	48.0	82.0	-
48.0	24.0	90.0	90.0
	30.0	90.0	90.0
	38.0	90.0	90.0
	42.0	89.7	-
	48.0	74.8	-
54.0	24.0	90.0	90.0
	30.0	90.0	90.0
	38.0	90.0	90.0
	42.0	84.0	-
	48.0	69.4	-
60.0	24.0	90.0	90.0
	30.0	90.0	90.0
	38.0	84.2	-
	42.0	79.8	-
	48.0	65.3	-
76.0	24.0	85.4	-
	30.0	71.7	-
	38.0	60.5	-
	42.0	56.8	-
	48.0	52.5	-
	53.0	50.0	-

REINFORCEMENT APPLIES TO BOTH MULLION AND FREE FLOATING JAMB MULLION ASSEMBLIES

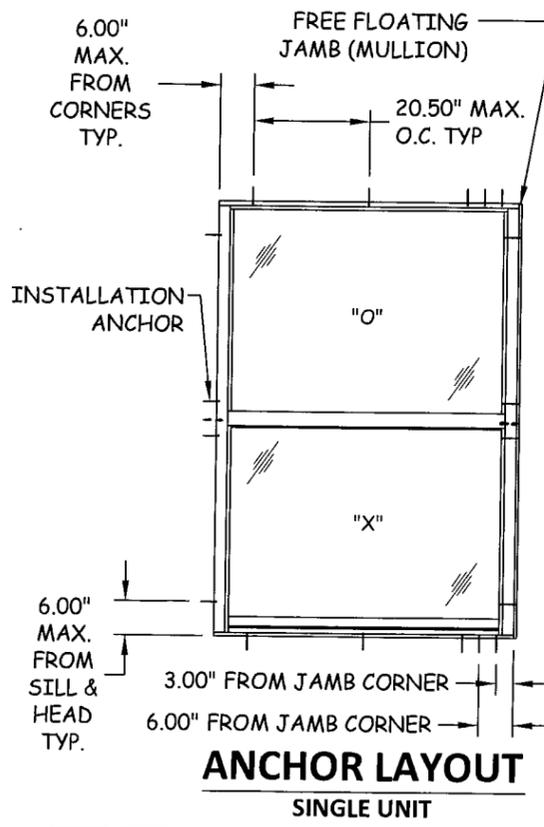

ANCHOR LAYOUT
SINGLE UNIT

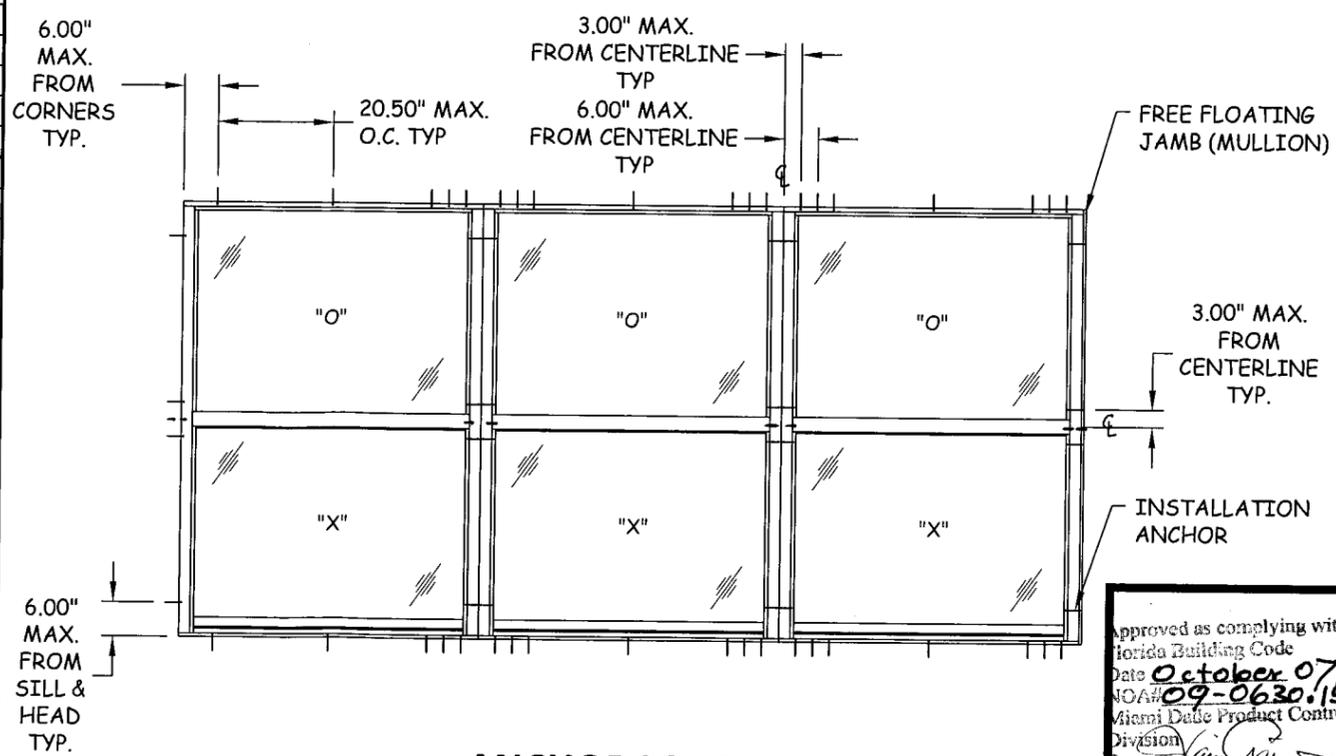


ANCHOR LAYOUT
MULTIPLE UNIT

8/25/2009 2:34 PM

p:\projects\continental glass systems\m-d-tr-09-0526.1 - 5500 series sh\dwgs\cg005 - 5500 series sh - submit\tdwg


8/25/2009 2:34 PM

p:\projects\continental_glass_systems\nd-p-09-0826.1 - 5500 series sh.dwg\cgs005 - 5500 series sh - submit.dwg

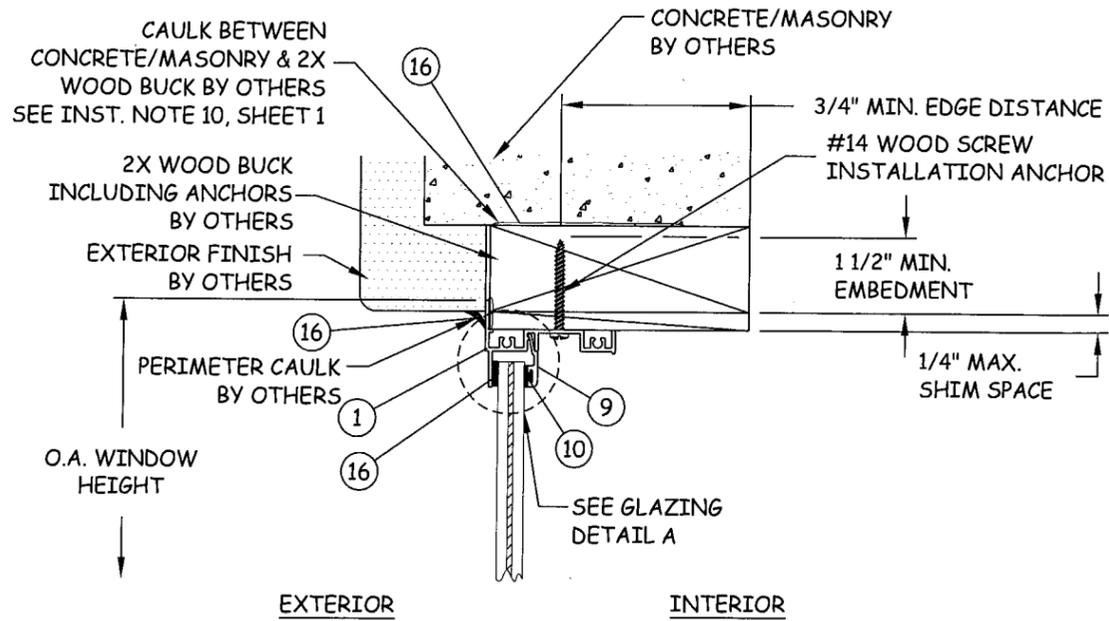


EXTERIOR INTERIOR

B
3 VERTICAL SECTION
2X WOOD BUCK

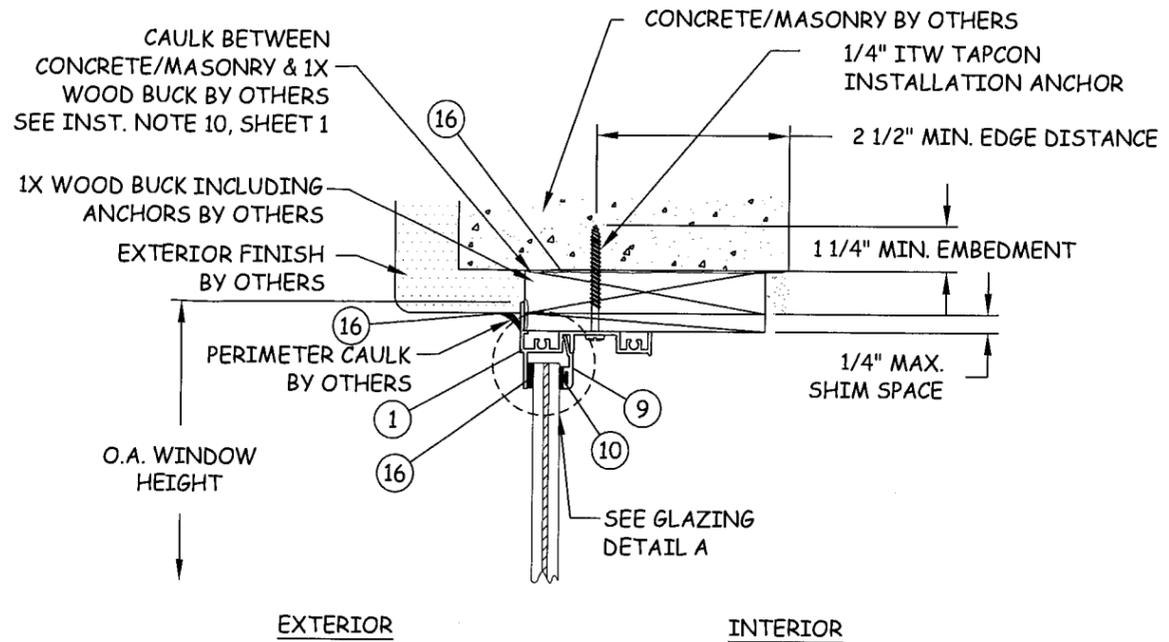


EXTERIOR INTERIOR

D
3 VERTICAL SECTION
1X BUCK/CONCRETE/MASONRY

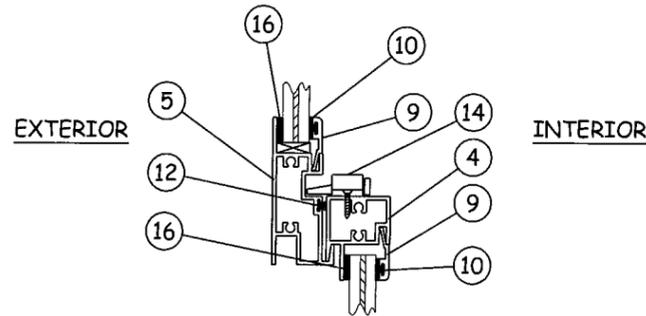


EXTERIOR INTERIOR

C
3 VERTICAL SECTION
MEETING RAIL

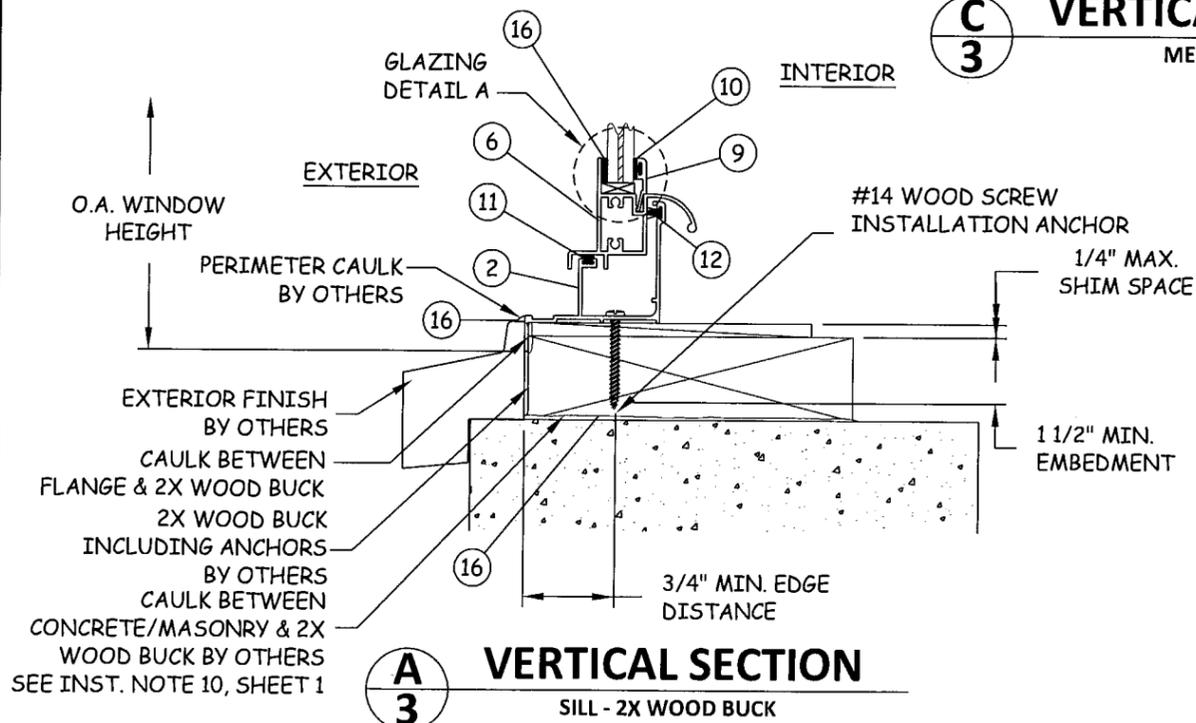

A
3 VERTICAL SECTION
SILL - 2X WOOD BUCK

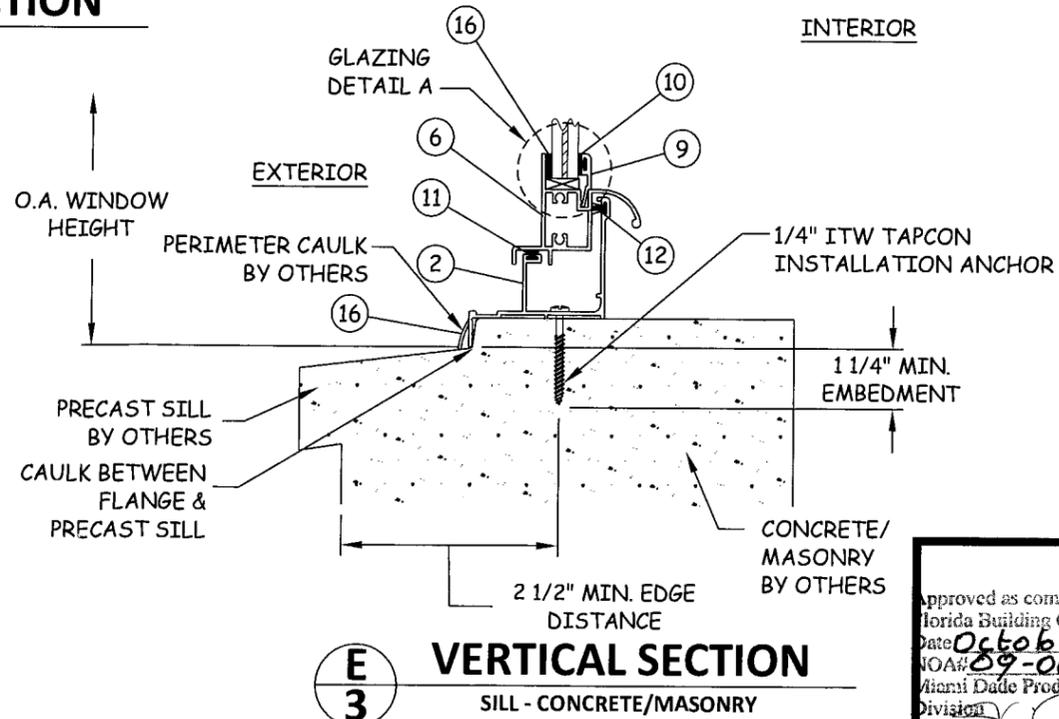

E
3 VERTICAL SECTION
SILL - CONCRETE/MASONRY



325 W. 74TH PLACE
HIALEAH, FL 33014
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 5500 SH
VERTICAL SECTIONS
PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS		NO.	DESCRIPTION	BY	DATE
8	ITEM 16 AND WOOD PROTECTION	HFN	08/25/09		


Handwritten signature
8-25-09
KRISTINA S. DAUGHERTY
FLORIDA P. E. NO. 68465
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FEBE CERT. OF AUTHORIZATION NO. 28620

Approved as complying with the Florida Building Code
Date: October 07 2009
NOA#: 09-0630.15
Miami Dade Product Control Division
By: *Handwritten signature*


DATE: 06.26.09
DWN BY: GRN
CHK BY: KSD
SCALE: NTS
DWG #: CGS005
SHEET: 3 OF 5

8/25/2009 2:34 PM


p:\projects\continental_glass_systems\mfg-p-09-0256.1 - 5500_series.sh\mfgs\cgs005 - 5500_series.sh - submit.dwg

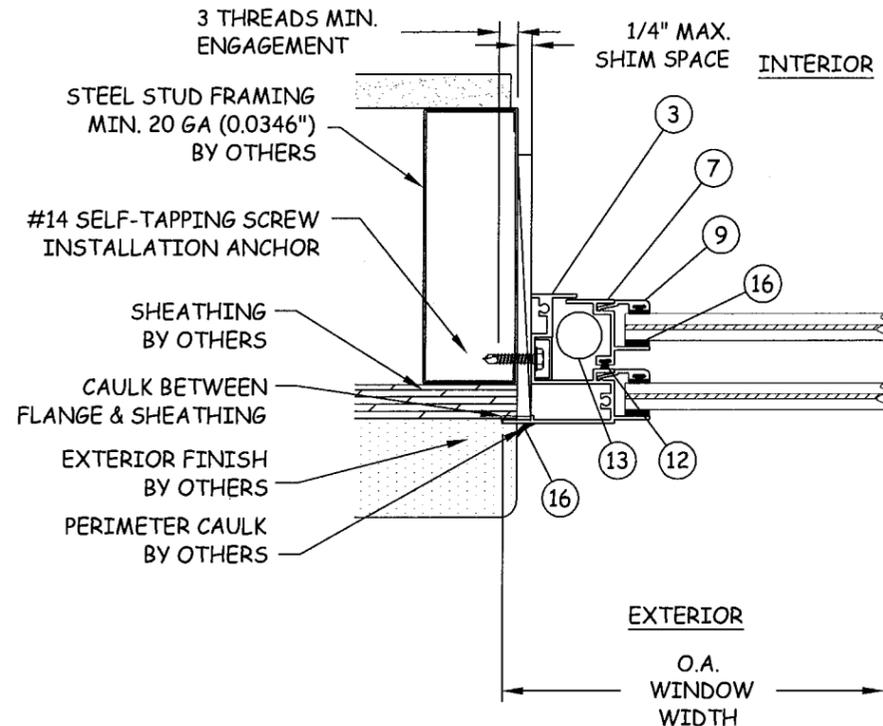

H
4 HORIZONTAL SECTION
JAMB - STEEL STUD FRAME

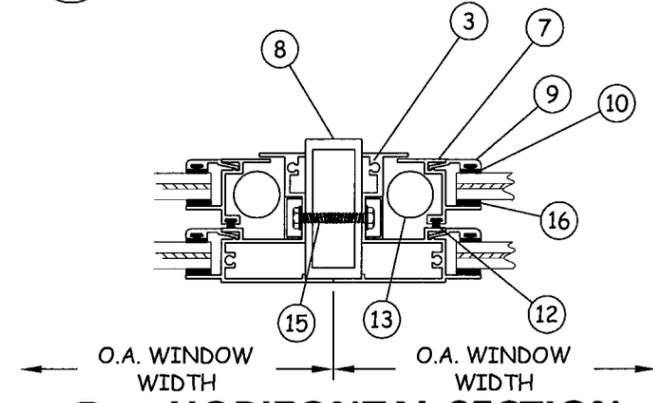


G
4 HORIZONTAL SECTION
VERTICAL NON-REINFORCED MULLION

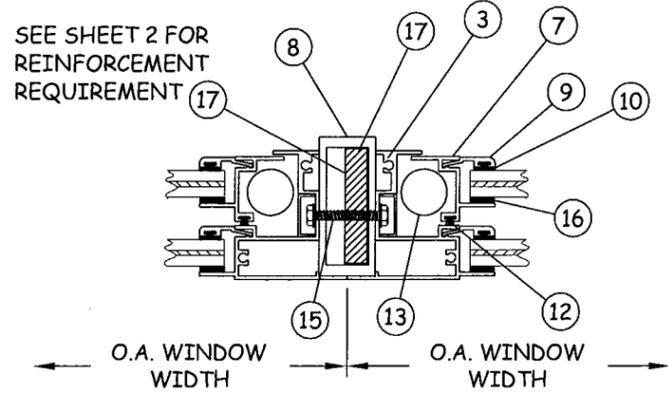


F
4 HORIZONTAL SECTION
VERTICAL REINFORCED MULLION

NOTES:
1. BACKER ROD DIAMETER EQUALS SEAL WIDTH X 120%
2. SEALANT DEPTH IS 7/16" (-0", +1/16") FOR SEALANT WIDTH UP TO 7/8"

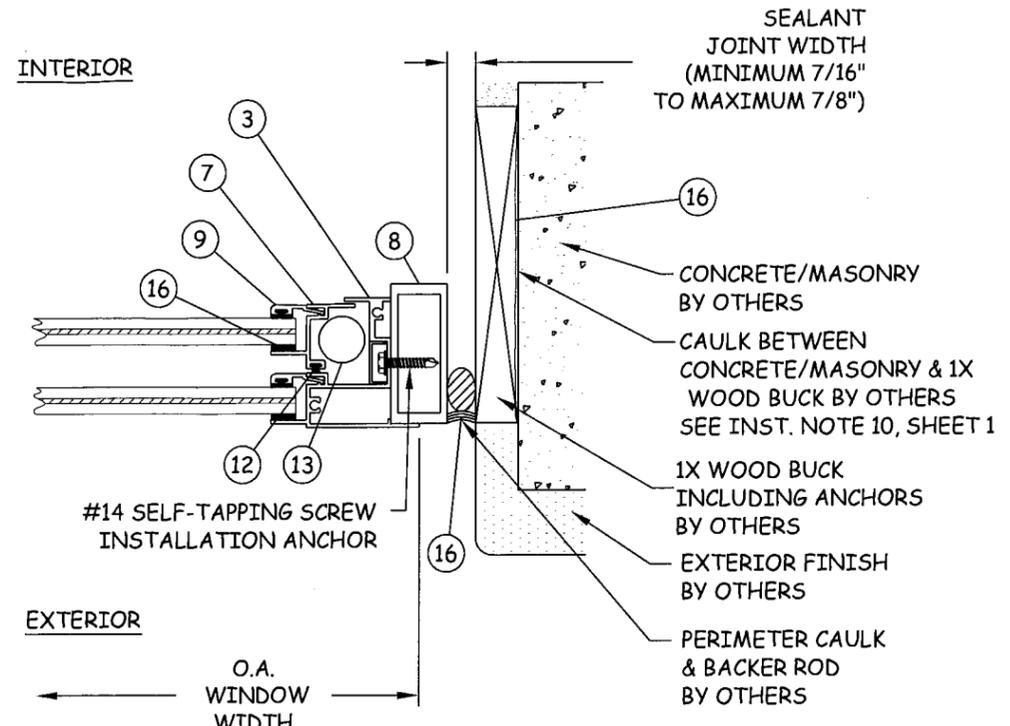

I
4 HORIZONTAL SECTION
FREE FLOATING JAMB

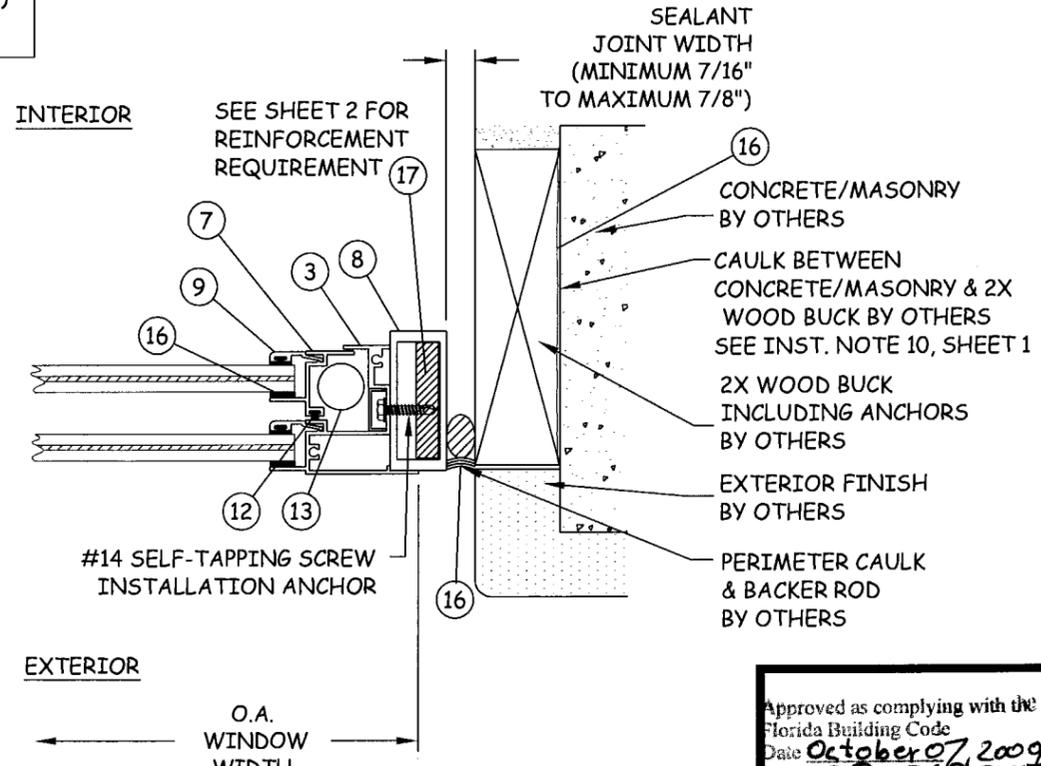

J
4 HORIZONTAL SECTION
FREE FLOATING REINFORCED JAMB



325 W. 74TH PLACE
HIALEAH, FL 33014
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 5500 SH
HORIZONTAL SECTIONS
PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS		NO.	DESCRIPTION	BY	DATE
A	SEALANT WIDTH PER MIAMI-DADE	JLR	08/06/09		
B	ITEM 16 AND REINFORCEMENT NOTE	HFN	08/25/09		

Jim Damm
8-25-09
KIRSTINA S. DALCHERTY
FLORIDA P.E. NO. 60415
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FBPE CERT. OF AUTHORIZATION NO. 28560


Approved as complying with the Florida Building Code
Date: October 07, 2009
NOA# 09-0630.15
Miami Dade Product Control
Division
By: *[Signature]*

DATE: 06.26.09
DWN BY: GRN
CHK BY: KSD
SCALE: NTS
DWG #: **CGS005**
SHEET: 4 OF 5


8/25/2009 2:34 PM

p:\projects\continental glass systems\ind-p-09-0526.1-5500 series sh\dwgs\cgs005-5500 series sh-submittal.dwg


1 HEAD 5500-01
6063-T6
0.062" TYP. WALL THICKNESS

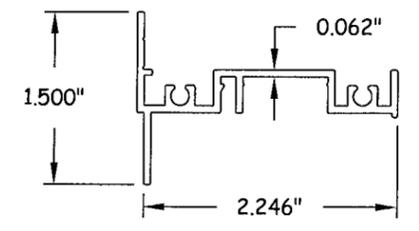


2 SILL 5500-02
6063-T6
0.062" TYP. WALL THICKNESS

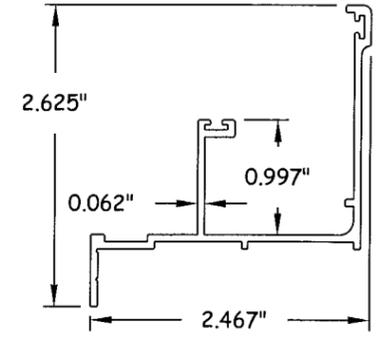


3 JAMB 5500-03
6063-T6
0.063" TYP. WALL THICKNESS

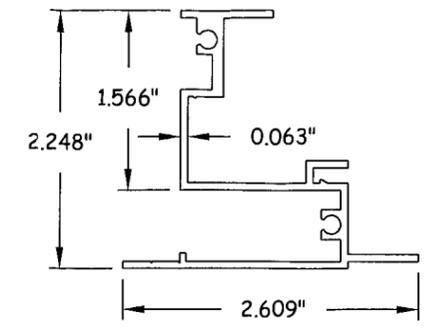


4 TOP VENT 5500-05
6063-T6
0.062" TYP. WALL THICKNESS

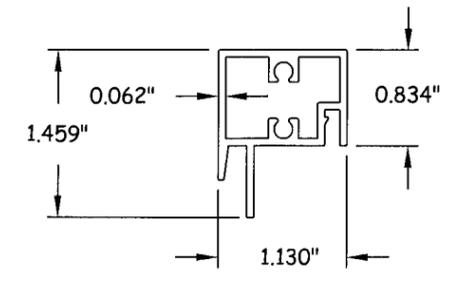


5 MEETING RAIL 5500-04
6063-T6
0.062" TYP. WALL THICKNESS

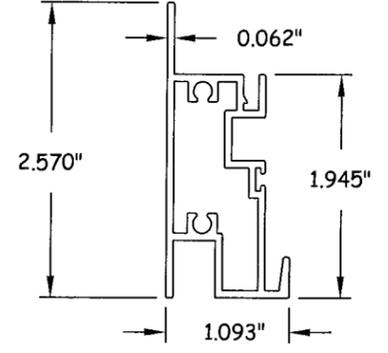


6 BOTTOM VENT 5500-06
6063-T6
0.062" TYP. WALL THICKNESS

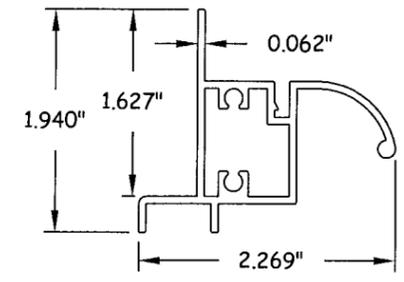


7 SIDE RAIL 5500-07
6063-T6
0.062" TYP. WALL THICKNESS

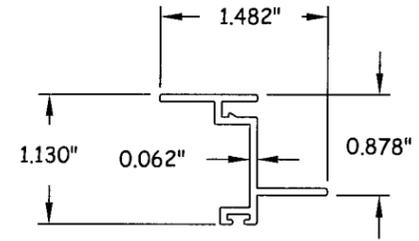


8 MULLION 5500-10
6063-T6

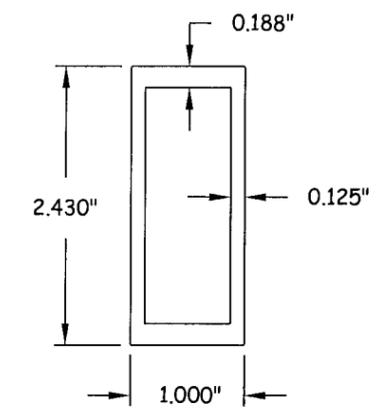


9 GLAZING BEAD 5500-08
6063-T6
0.177" TYP. WALL THICKNESS

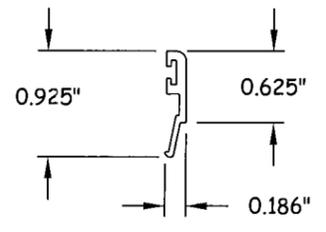

17 REINFORCEMENT
6063-T6

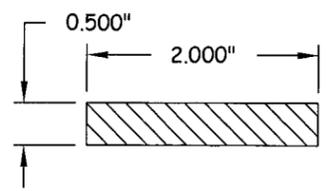

BILL OF MATERIALS				
ITEM #	PART #	DESCRIPTION	MATERIAL	MANUFACTURER
1	5500-01	HEAD	6063-T6	CGS
2	5500-02	SILL	6063-T6	CGS
3	5500-03	JAMB	6063-T6	CGS
4	5500-05	TOP VENT	6063-T6	CGS
5	5500-04	MEETING RAIL	6063-T6	CGS
6	5500-06	BOTTOM VENT	6063-T6	CGS
7	5500-07	SIDE RAIL	6063-T6	CGS
8	5500-10	MULLION	6063-T6	CGS
9	5500-08	GLAZING BEAD	6063-T6	CGS
10		GLASS SPACER	VINYL	FRANK LOWE
11		VINYL BULB		CGS
12		FIN-SEAL		ULTRAFAB
13		BALANCER		CALDWELL
14		CAM LOCKS		DNS
15		#14 X 1/2" PH SMS	STAINLESS STEEL	
16		STRUCTURAL SILICONE DOW 795	SILICONE	DOW CORNING
17		MULLION REINFORCEMENT	6063-T6	
18		#10 X 1" PH SMS	STAINLESS STEEL	

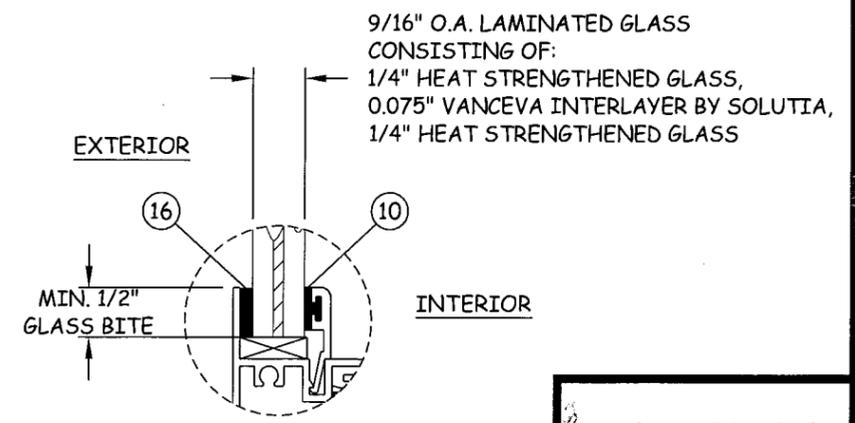

GLAZING DETAIL A

Approved as complying with the Florida Building Code
Date October 07, 2009
NOA# 09-0636.15
Miami Dade Product Control
Division
By [Signature]



325 W. 74TH PLACE
HIALEAH, FL 33014
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 5500 SH COMPONENTS, GLZ DTS & BILL OF MATERIALS
PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	BY	DATE
		A	JLR
B	HFN	08/25/09	

[Signature]
8-25-09
KRISTINA S. DAUBERTY
FLORIDA P. E. NO. 08465
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FPE CERT. OF AUTHORIZATION NO. 26560

DATE: 06.26.09
DWN BY: GRN
CHK BY: KSD
SCALE: NTS
DWG #: CGS005
SHEET: 5 OF 5