



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

Hurd Windows & Doors, Inc.
575 South Whelen Avenue
Medford, WI 54451

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series Feel Safe Aluminum Clad Wood Casement Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. 1403, titled "Feel Safe Aluminum Clad Wood Impact Operable Casement Window, sheets 1 through 6 of 6, with latest revision A1 dated 06/29/09, prepared by W. W. Schaefer Engineering & Consulting, P.A., dated 07/21/05, signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #06-0130.03 consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Fitz A. Harris, P.E.**



NOA No 09-0714.05
Expiration Date: June 29, 2011
Approval Date: October 21, 2009
Page 1

Hurd Windows & Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **1403**, Sheets 1 through 6 of 6, titled "Feel Safe Aluminum Clad Wood Operable Casement Window, with latest revision A1 dated 06/29/09, prepared by W. W. Schaefer Engineering & Consulting, P.A., dated 07/21/05, signed and sealed by Warren W. Schaefer, P.E.

B. TESTS

1. Test reports on : 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
prepared by Stork Twin City Testing Corporation ,Test Report #180-7776.1 dated 03-04-09, signed and sealed by Tom Kolden, P.E.
2. Test Report on : 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
prepared by Stork Twin City Testing Corporation ,Test Report #180-7705.1 dated 11-07-09, signed and sealed by Tom Kolden, P.E.
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of 6 specimens each consisting of three-panel configuration of aluminum clad casement windows, prepared by Architectural Testing, Inc., Test Report No. **ATI-60529.01-602-18**, dated 10/11-14/05, signed and sealed by Joseph A. Reed, P.E.
4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94



Fitz A. Harris, P.E.

Product Control Examiner

NOA No 09-07140.05

Expiration Date: June 29, 2011

Approval Date: October 21, 2009

Hurd Windows & Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

long with marked-up drawings and installation diagram of 6 specimens each consisting of three-panel configuration of aluminum clad casement windows, prepared by Architectural Testing, Inc., Test Report No. **ATI-522274.04-602.18**, dated 07/28/04, signed and sealed by Joseph A. Reed, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis, complying with FBC-2007, prepared by W. W. Schaefer Engineering & Consulting, P.A., dated 06/29/09, signed and sealed by Warren W. Schaefer, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **08-1118.07**, issued to OldCastle Glass for "Stormglass Laminated Glass" dated 03/25/09, expiring on 12/11/2013.
2. Notice of Acceptance No. **06-0216.06** issued to Solutia, Inc. for "Saflex/Keepsafe Maximum" dated 05/05/06, expiring on 05/21/11.

F. STATEMENTS

1. Statement letter of compliance with FBC 2007 issued by W. W. Schaefer Engineering & Consulting, P.A., dated June 29, 2009, signed and sealed by Warren W. Schaefer, P.E.
2. Statement letter of no financial interest issued by W. W. Schaefer Engineering & Consulting, P.A., dated June 29, 2009, signed and sealed by Warren W. Schaefer, P.E.

G. OTHER

1. None



Fitz A. Harris, P.E.
Product Control Examiner
NOA No 09-07140.05
Expiration Date: June 29, 2011
Approval Date: October 21, 2009

GENERAL NOTES:

- THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S)".
- OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
- ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT WINDOWS.
- THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
- IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE WINDOWS.
- ALL ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
- DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF $K_d = 0.85$ MAY BE APPLIED PER THE ASCE-7 STANDARD.
- NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR $C_d = 1.6$ WAS USED FOR WOOD SCREW ANALYSIS ONLY.
- MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.
- ALL WOOD MEMBERS OF WINDOWS THAT MAY POSSIBLY COME INTO CONTACT WITH MASONRY OR CONCRETE SUBSTRATES, ARE SUBJECT TO MOISTURE &/OR ARE SUBJECT TO THE OUTSIDE ENVIRONMENT SHALL BE OF AN APPROVED DURABLE SPECIES OR BE TREATED IN AN APPROVED METHOD WITH AN APPROVED PRESERVATIVE PER FBC SECTION 2326.

CORNER CONSTRUCTION:


- WOOD FRAME:** SQUARE CUT, RABBETED, SILICONE SEALED & SECURED WITH THREE (3) 16 GA. X 1/2" X 2" CROWN STAPLES.
- FRAME CLAD:** MITER CUT, JOINED WITH A CORNER KEY & TWO (2) NO. 7 X 1/2" SCREWS & SEALED WITH A FOAM GASKET.
- WOOD SASH:** MORTISE & TENON CONSTRUCTION AND SECURED WITH TWO (2) 14 GA. X 2 1/2" T-NAILS.
- SASH CLAD:** SQUARE CUT, BUTTED TOGETHER AND SNAP FIT TO SASH AND SEALED WITH SILICONE.

LOCK REQUIREMENTS		SNUBBER REQUIREMENTS	
MAX. FRAME HEIGHT	NO. OF LOCK STRIKES	MAX. FRAME HEIGHT	NO. OF SNUBBERS REQUIRED
72 3/16"	5	72 3/16"	4
60 3/16"	4	53 3/16"	3
48 3/16"	3	34 3/16" & LESS	2
32 3/16" & LESS	2		


FRAME ANCHOR REQUIREMENTS TABLE

OPENING TYPE (SUBSTRATE)	FRAME/FIN TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
FRAME SCREWS			
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 10 SMS OR WOOD SCREW	1 1/4"	3/4"
MIN. 18 GA. 33 KSI METAL STUD	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK A36 STEEL	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
C-90 CMU/2500 PSI CONCRETE	(1) 1/4" CONCRETE SCREW	1 1/4"	2"
(2) NAILING FIN FASTENERS			
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 8 SMS SCREW	1 1/8"	1/2"
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	11 GA. ROOFING NAIL	1 3/4"	1/2"
MIN. 1/8" THK A36 STEEL	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"

- (1) CONCRETE SCREWS SHALL BE ELCO ULTRACONS, ITW RAMSET/RED HEAD TAPCONS, HILTI KWIK-CON II OR POWERS RAWL TAPPER (HARDENED STEEL OR S.S.).
- (2) NAIL FIN SCREWS SHALL BE A PAN HEAD OR HEX HEAD SCREW OR HAVE A FLAT WASHER AT THE SCREW HEAD.

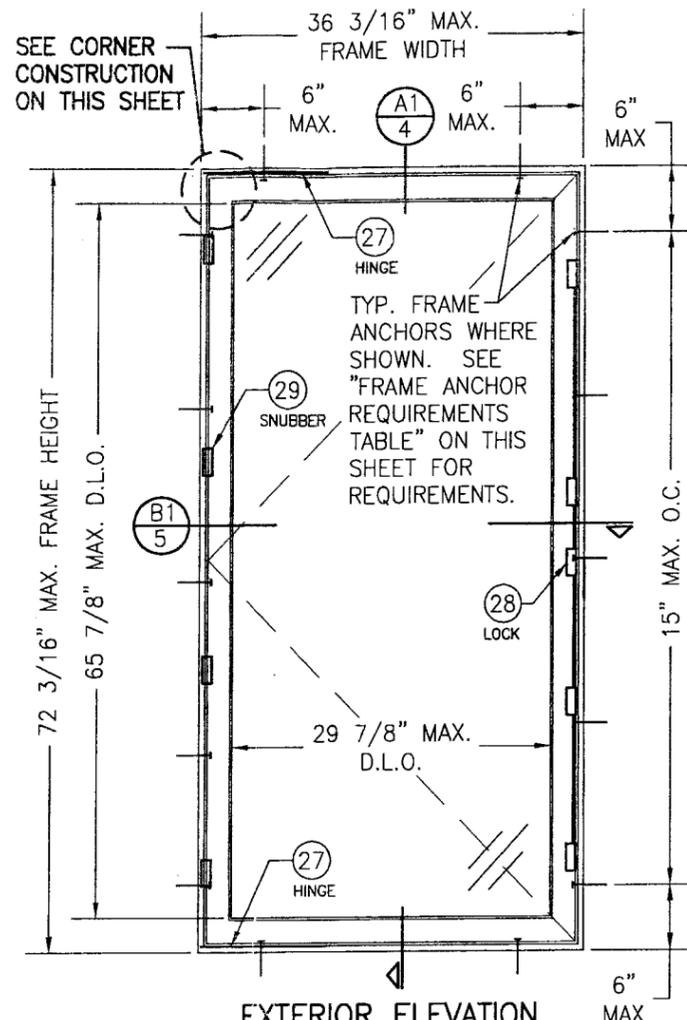

EXTERIOR ELEVATION SINGLE WINDOW (FRAME SCREW MOUNT)
SCALE: 3/4"=1'-0"

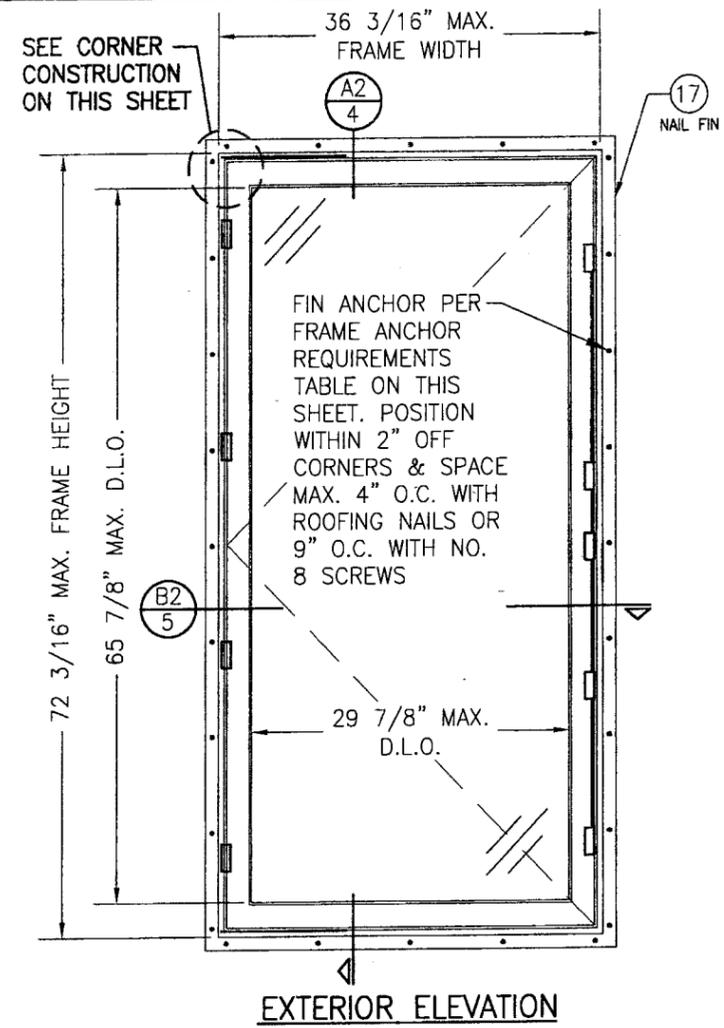

EXTERIOR ELEVATION SINGLE WINDOW (FIN MOUNT)
SCALE: 3/4"=1'-0"


FOR INFORMATION NOT SHOWN, SEE FRAME SCREW MOUNTED SINGLE WINDOW ELEVATION

ALLOWABLE DESIGN PRESSURE (SINGLE WINDOWS)				
GLASS OPTION	MAXIMUM FRAME WIDTH (IN.)	MAXIMUM FRAME HEIGHT (IN.)	ALLOWABLE PRESSURE	
			POSITIVE (PSF)	NEGATIVE (PSF)
1	36 3/16	72 3/16	65	70
2 & 3	36 3/16	60 3/16	65	85
4	36 3/16	72 3/16	65	65
4	32 3/16	72 3/16	65	70
4	36 3/16	68 3/16	65	70

SEE GLAZING DETAILS FOR GLASS OPTIONS

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 09-07/4-05
Expiration Date 6-29-2011
Warren W. Schaefer
Miami Dade Product Control Division

DRAWN BY: S.T.R.		CHECKED BY: W.W.S.	
PLOT: 1=16		DATE: 7/21/05	
NO.	REVISION	DESCRIPTION	DATE
AT	ADD	TWIN WINDOW WITH TRANSOM	06/29/05
		CONDITION	
FEEL SAFE ALUMINUM CLAD WOOD IMPACT OPERABLE CASEMENT WINDOW MANUFACTURER: HURD WINDOWS & DOORS 575 S. HELEN AVE. MEDFORD, WI 54451 800-433-4873			
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903			
DRAWING TITLE: FEEL SAFE ALUMINUM CLAD WOOD IMPACT OPERABLE CASEMENT WINDOW CERTIFICATION: JUL 09 2009 WARREN W. SCHAEFER, P.E. P.E. NO. 44135			
DRAWING NO. 1403		REV. A	
SHEET NO. 1 OF 6			

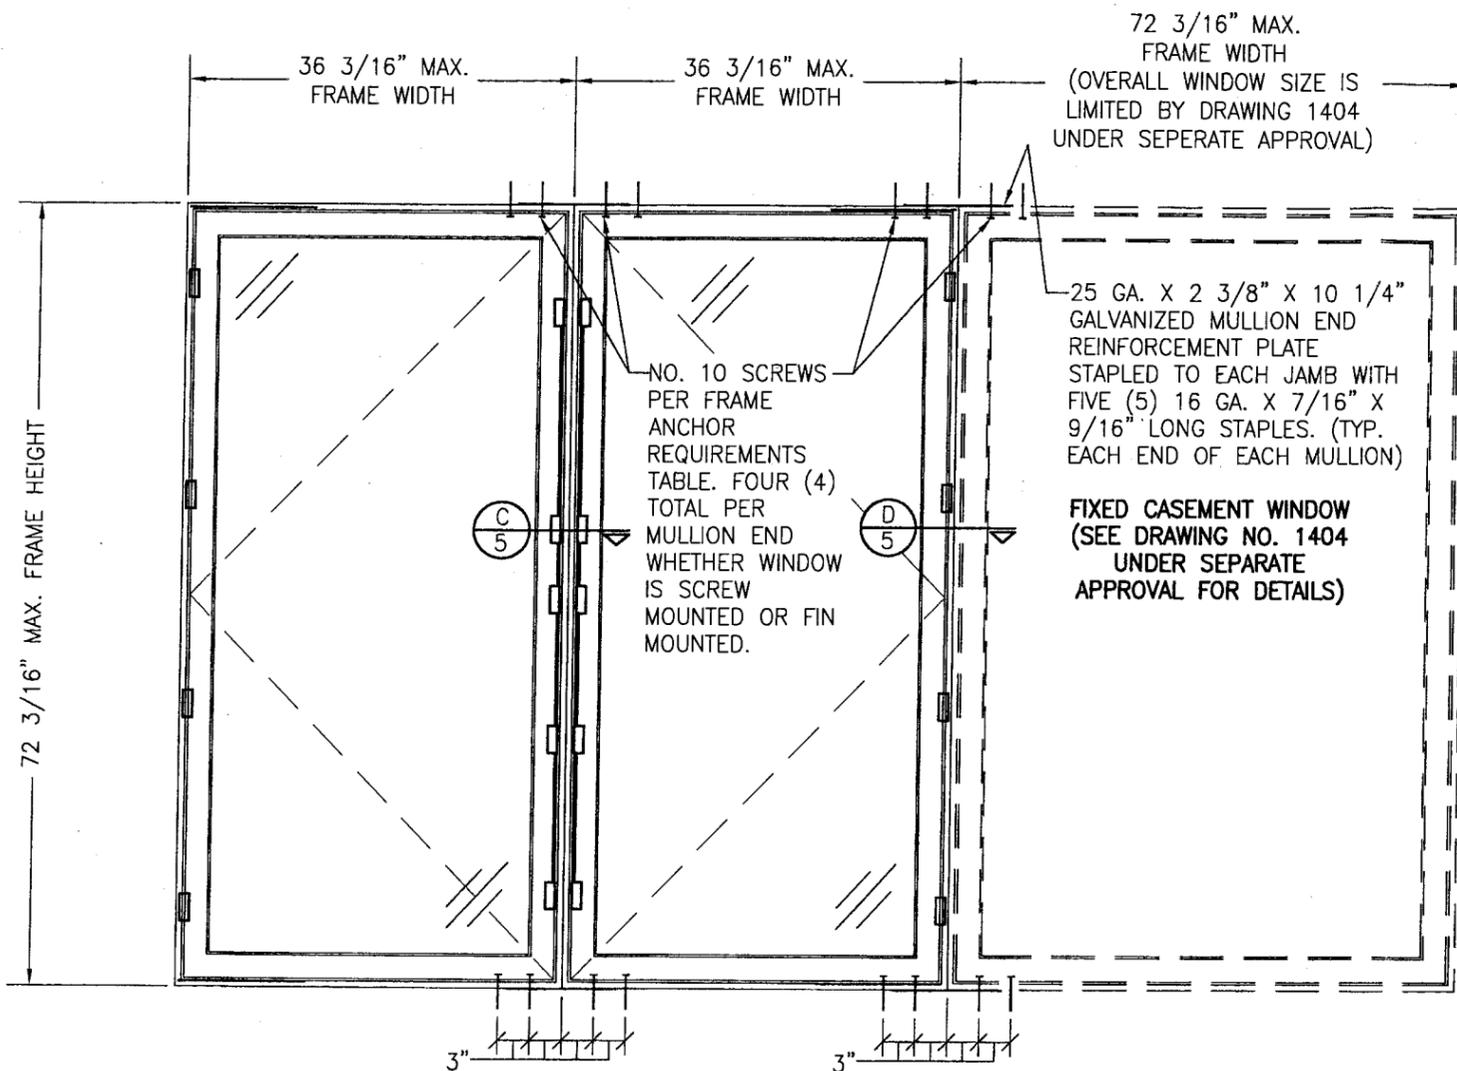


**EXTERIOR ELEVATION
MULTIPLE SIDE-BY-SIDE OPERABLE/FIXED WINDOWS**

SCALE: 3/4"=1'-0"
(FOR INDIVIDUAL WINDOW INSTALLATION & DETAILS, SEE SINGLE WINDOW ELEVATIONS)
(TRIPLE WINDOW SHOWN. MORE THAN 3 WINDOWS MAY BE COMBINED
HORIZONTALLY IN ONE OPENING IN ANY COMBINATION OF FIXED & OPERABLE)
NOTE: FOR FIXED TO FIXED, SEE DRAWING 1404 UNDER SEPARATE APPROVAL

FOR INFORMATION NOT SHOWN, SEE SINGLE
WINDOW ELEVATIONS ON SHEET 1

**ALLOWABLE DESIGN PRESSURE
(SIDE-BY-SIDE & SINGLE WINDOW WITH TRANSOM)**

MULLED UNIT ALLOWABLE DESIGN PRESSURE & INDIVIDUAL WINDOW SIZES WITHIN A MULLED UNIT SHALL BE LIMITED BY THE INDIVIDUAL WINDOW REQUIREMENTS AS SPECIFIED IN THE ALLOWABLE DESIGN PRESSURE TABLE ON SHEET 1.

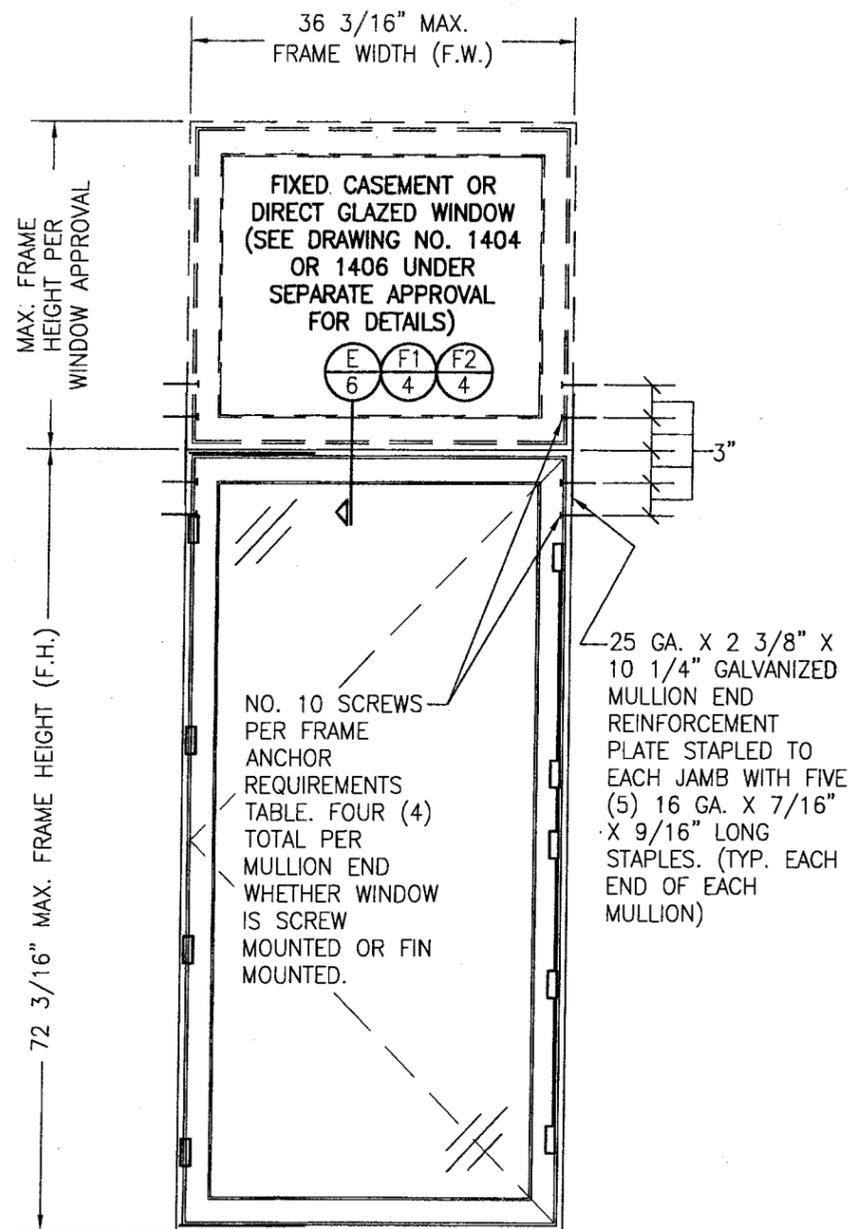

**EXTERIOR ELEVATION
SINGLE WINDOW WITH TRANSOM**


SCALE: 3/4"=1'-0"
(FOR INDIVIDUAL WINDOW INSTALLATION & DETAILS, SEE SINGLE WINDOW ELEVATIONS)

FOR INFORMATION NOT SHOWN, SEE SINGLE
WINDOW ELEVATIONS ON SHEET 1

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-07425
Expiration Date 6-29-2011

By: *[Signature]*
Miami Dade Product Control
Division

DRAWN BY: S.T.R.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 7/21/05
NO.	DATE
NO.	REVISION DESCRIPTION
DRAWING TITLE FEEL SAFE ALUMINUM CLAD WOOD IMPACT OPERABLE CASEMENT WINDOW	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8885 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	MANUFACTURER HURD WINDOWS & DOORS 575 S. WHELEN AVE. MEDFORD, WI 54451 800-433-4873
CERTIFICATION JUL 09 2009	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1403	REV. A
SHEET NO. 2 OF 6	

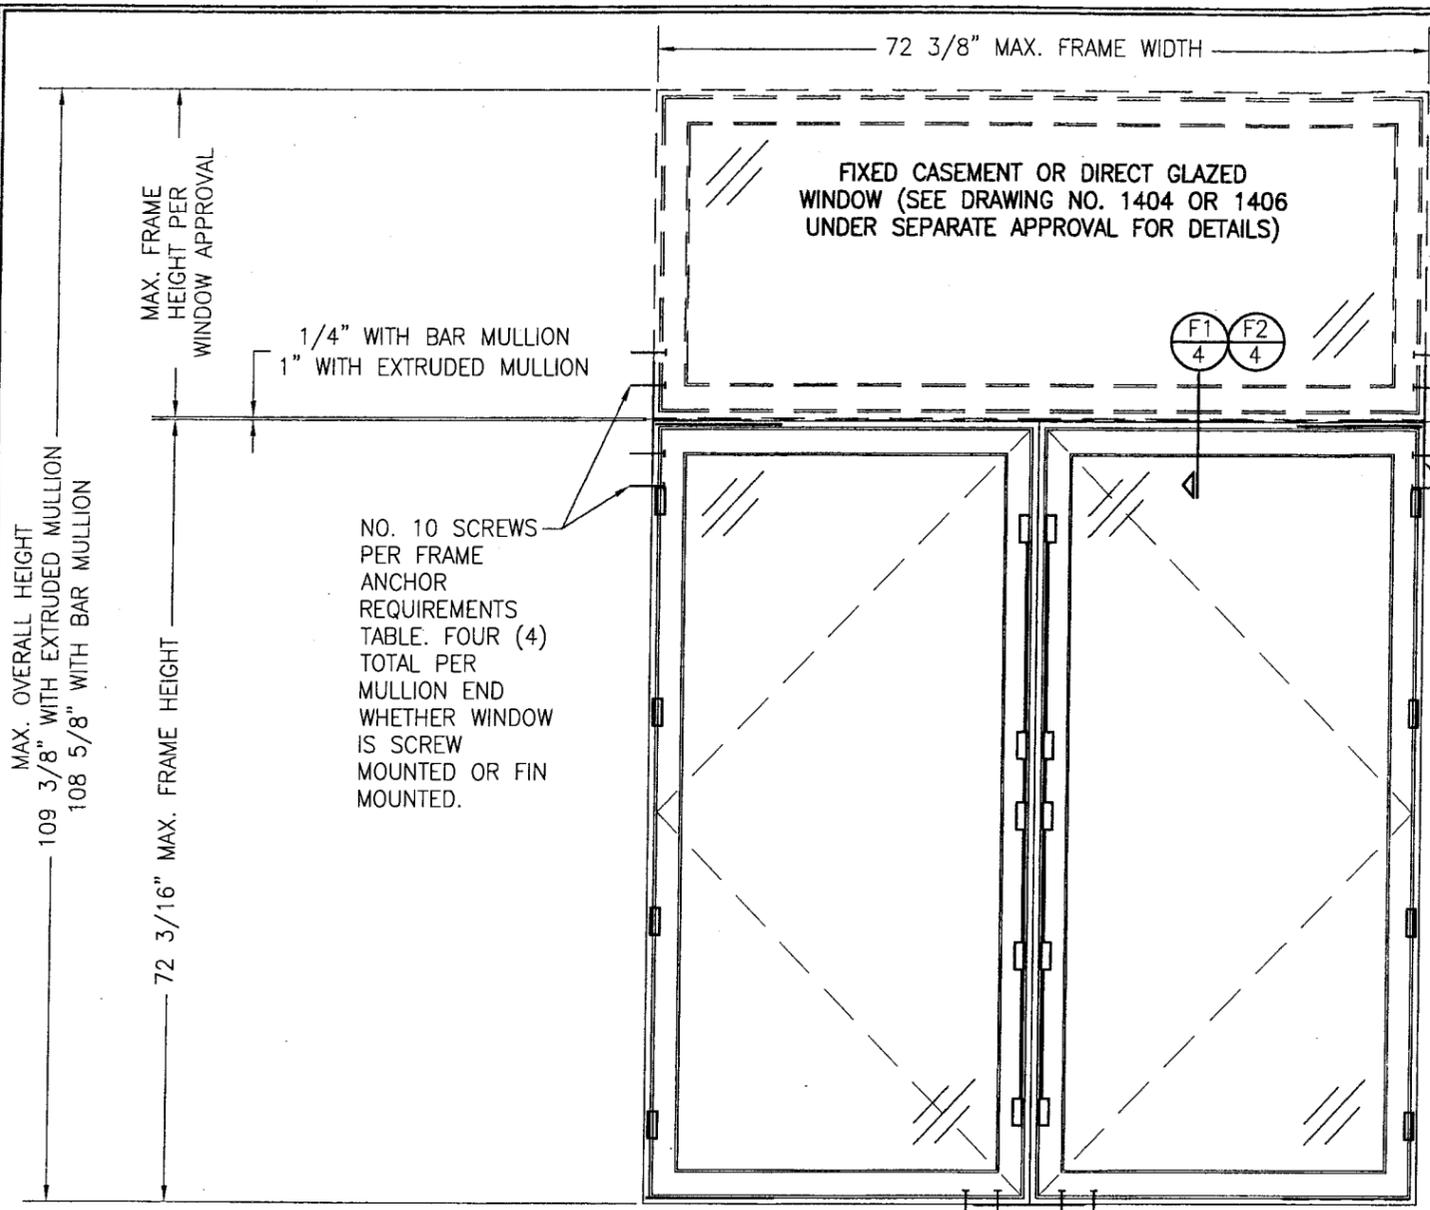

**EXTERIOR ELEVATION
TWIN WINDOW WITH TRANSOM**
SCALE: 3/4"=1'-0"


- ELEVATION NOTES:**
1. FOR INDIVIDUAL WINDOW INSTALLATION & DETAILS, SEE SINGLE WINDOW ELEVATIONS.
 2. TWIN WINDOWS ARE SHOWN AS "XX". "XO" WINDOW ALSO APPLIES WITH "O" WINDOW BEING A FIXED CASEMENT WINDOW UNDER SEPARATE APPROVAL DRAWING NO. 1404

**ALLOWABLE DESIGN PRESSURE
(TWIN WINDOW WITH TRANSOM)**


AS CONTROLLED BY THE INDIVIDUAL WINDOW ALLOWABLE PRESSURES (NOT TO EXCEED +65/-70 PSF)

PRODUCT REVISION
as complying with the Florida Building Code
Acceptance No. 09-074-05
Expiration Date 6-29-2011

By John Harris
Miami Dade Product Control Division

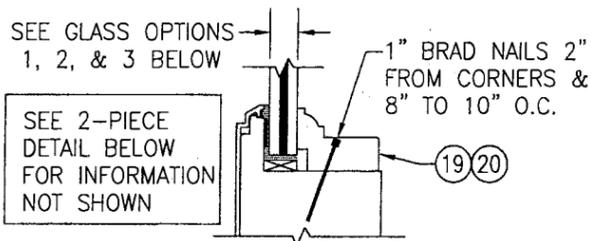


**NON-I.G. GLAZING DETAIL WITH
1-PIECE GLAZING BEAD**

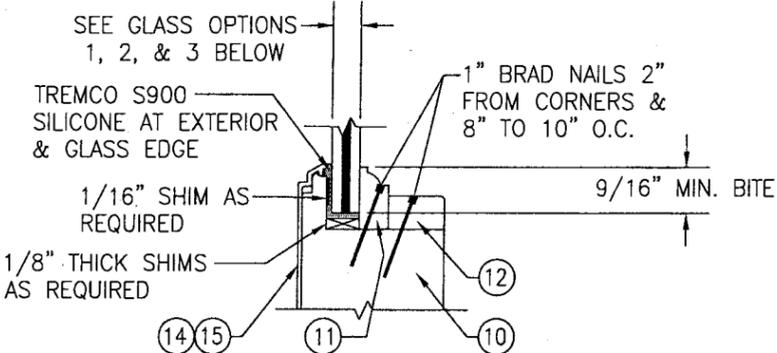

**NON-I.G. GLAZING DETAIL WITH
2-PIECE GLAZING BEAD**


- OPTION 1:** 3/8" LAMINATED GLASS BY OLDCASTLE (5/32" AN/0.09 SOLUTIA SAFLEX IIIIG PVB/5/32" AN)
- OPTION 2:** 9/16" LAMINATED GLASS BY OLDCASTLE (1/4" AN/0.075 OLDCASTLE STORM GLASS/1/4" AN)
- OPTION 3:** 9/16" LAMINATED GLASS BY OLDCASTLE (1/4" AN/0.09 SOLUTIA SAFLEX IIIIG PVB PVB/1/4" AN)

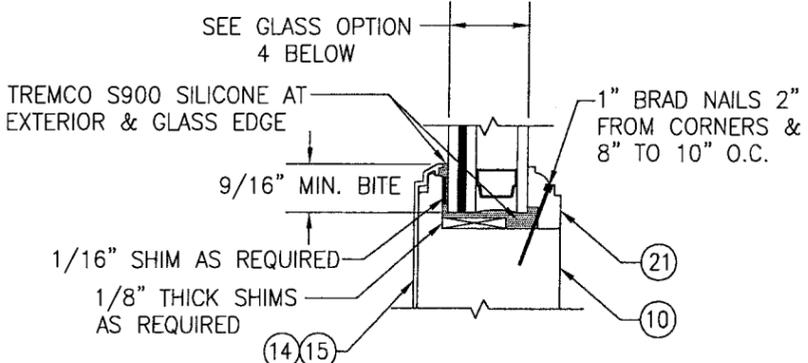


TYPICAL I.G. GLAZING DETAIL

- OPTION 4:** 7/8" LAMINATED I.G. BY OLDCASTLE (1/8" AN./0.09" SOLUTIA SAFLEX IIIIG PVB/1/8" AN. EXTERIOR; 7/16" SPACER; 1/8" TEMP. INTERIOR)

DRAWN BY: S.T.R.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 7/21/05
DATE	
BY	
REVISION DESCRIPTION	
NO.	
DRAWING TITLE FEEL SAFE ALUMINUM CLAD WOOD IMPACT OPERABLE CASEMENT WINDOW	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	MANUFACTURER HURD WINDOWS & DOORS 575 S. HELEN AVE. MEDFORD, WI 54451 800-433-4873
CERTIFICATION JUL 09 2009	WARREN W. SCHAEFER P.E. P.E. NO. 44135
DRAWING NO. 1403	REV. A
SHEET NO. 3	OF 6



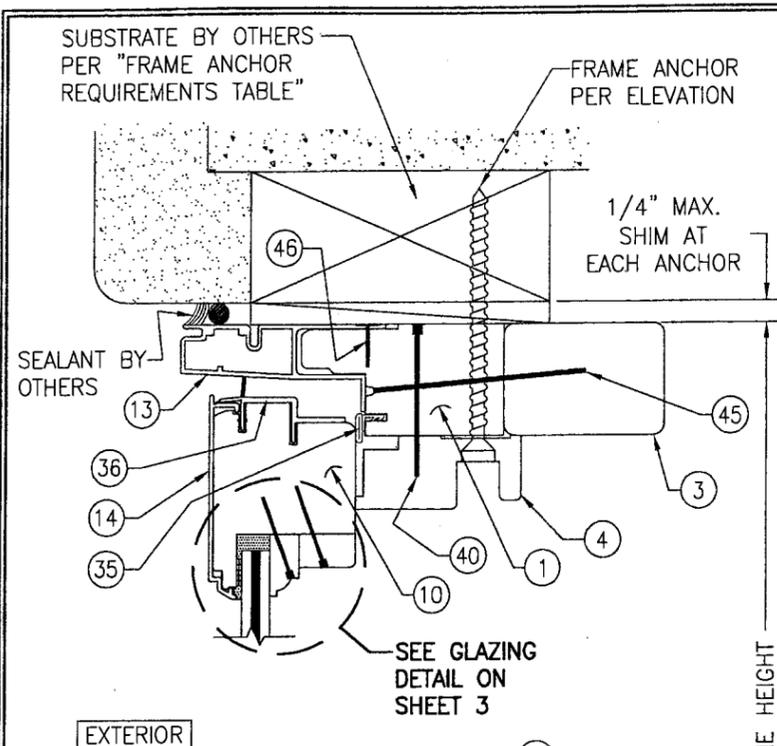


SECTION A1
SCALE: 1/2 FULL

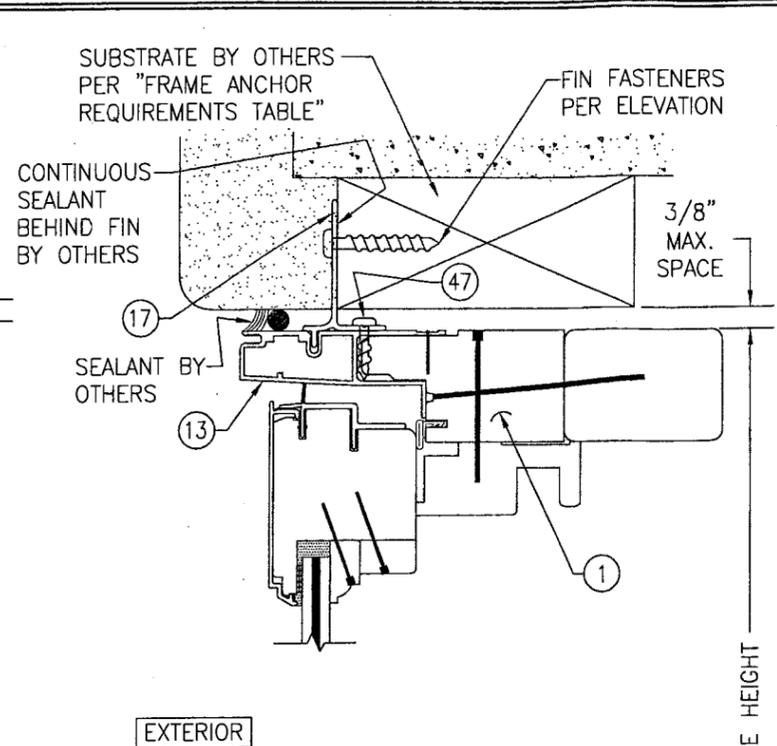


SECTION A2
SCALE: 1/2 FULL

(SEE SECTION A1/4 FOR DETAILS NOT SHOWN)

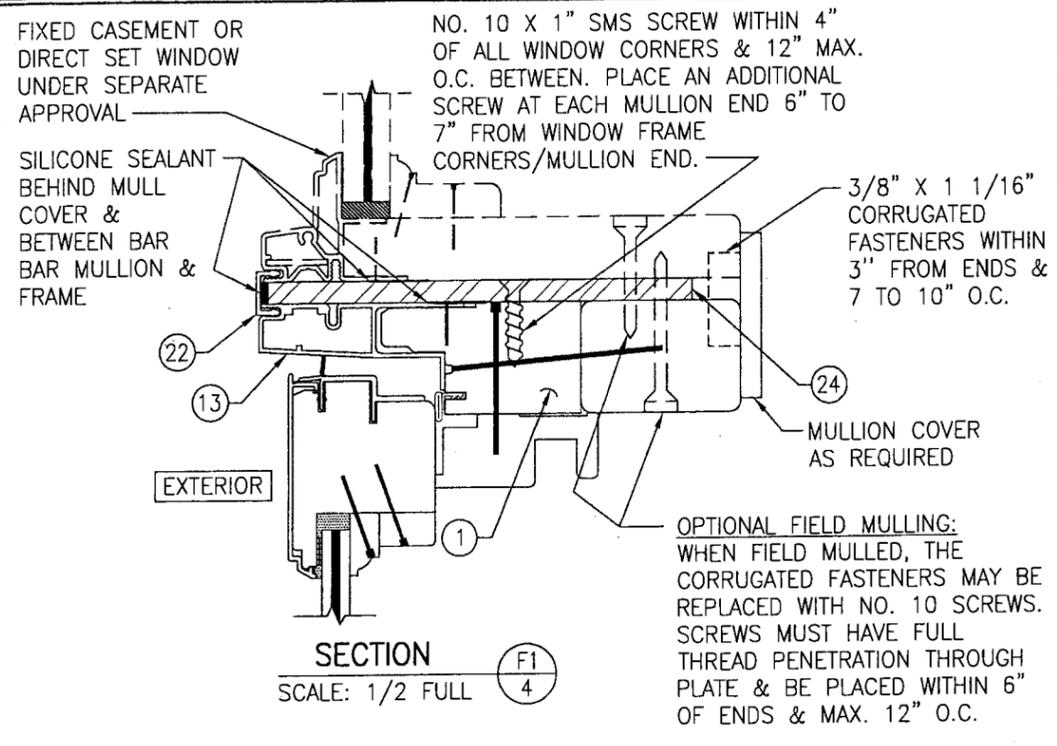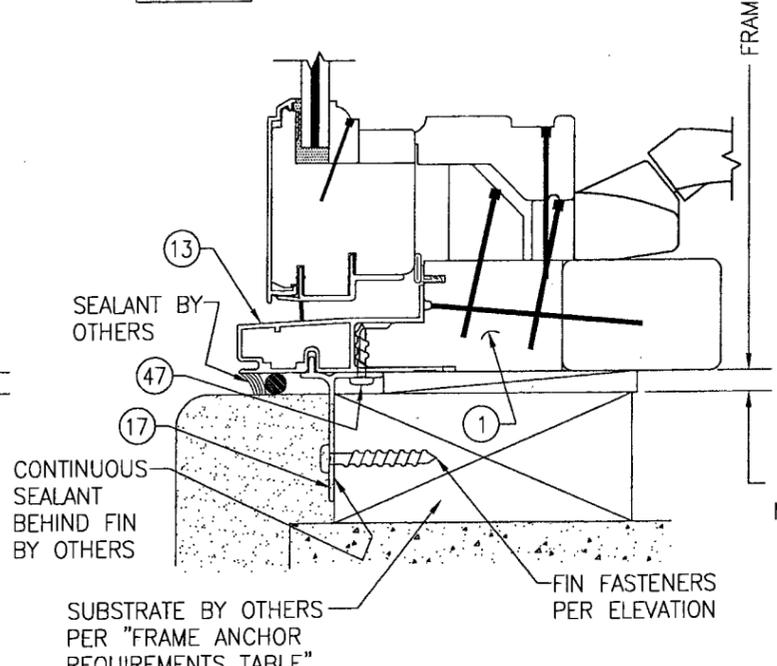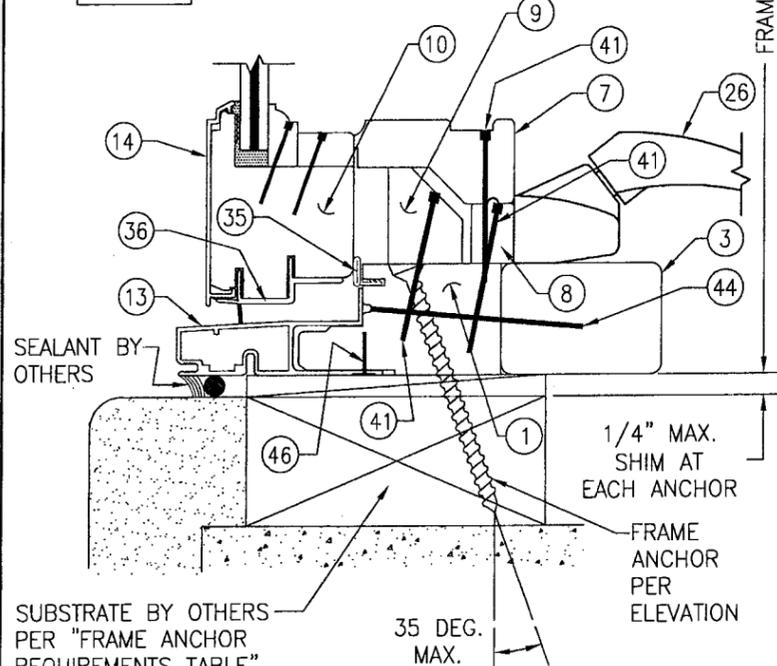


SECTION F1
SCALE: 1/2 FULL

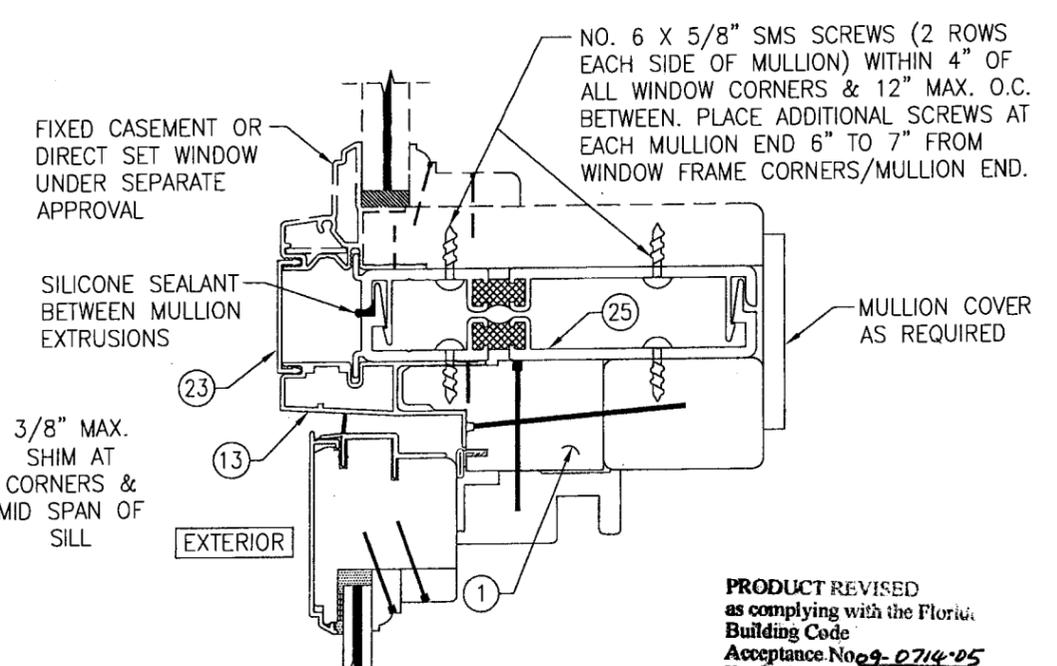


SECTION F2
SCALE: 1/2 FULL

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0714-05
Expiration Date 6-29-2011
By *St. Harris*
Miami Dade Product Control
Division


DRAWN BY: S.T.R.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 7/21/05
NO.	REVISION DESCRIPTION
DATE	BY
DRAWING TITLE FEEL SAFE ALUMINUM CLAD WOOD IMPACT OPERABLE CASEMENT WINDOW	
MANUFACTURER HURD WINDOWS & DOORS 575 S. WHELEN AVE. MEDFORD, WI 54451 800-433-4873	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4802 FAX: 561-775-4803	
CERTIFICATION JUL 09 2009	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1403	REV. A
SHEET NO. 4 OF 6	

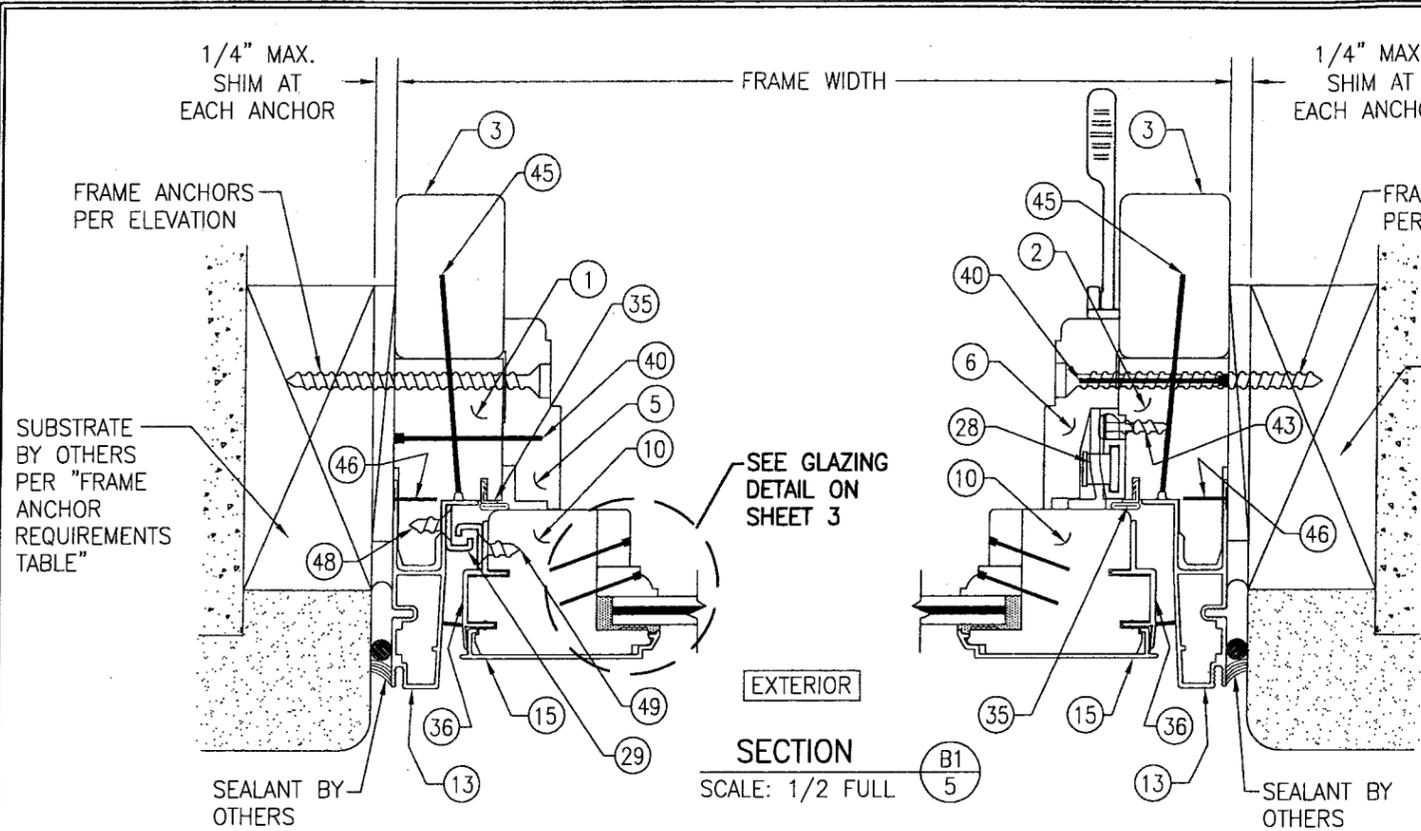

SECTION B1/5
SCALE: 1/2 FULL

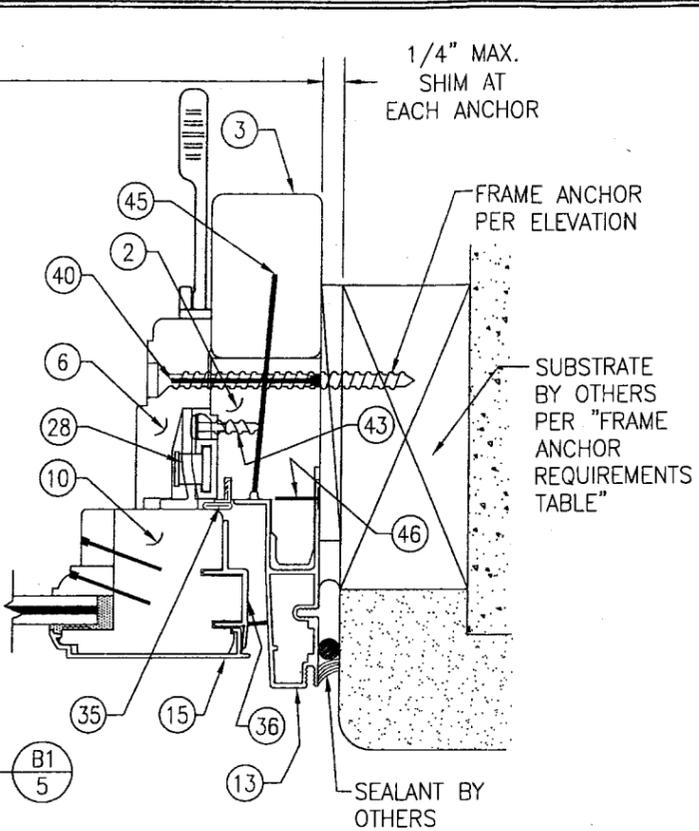


SECTION B1/5
SCALE: 1/2 FULL

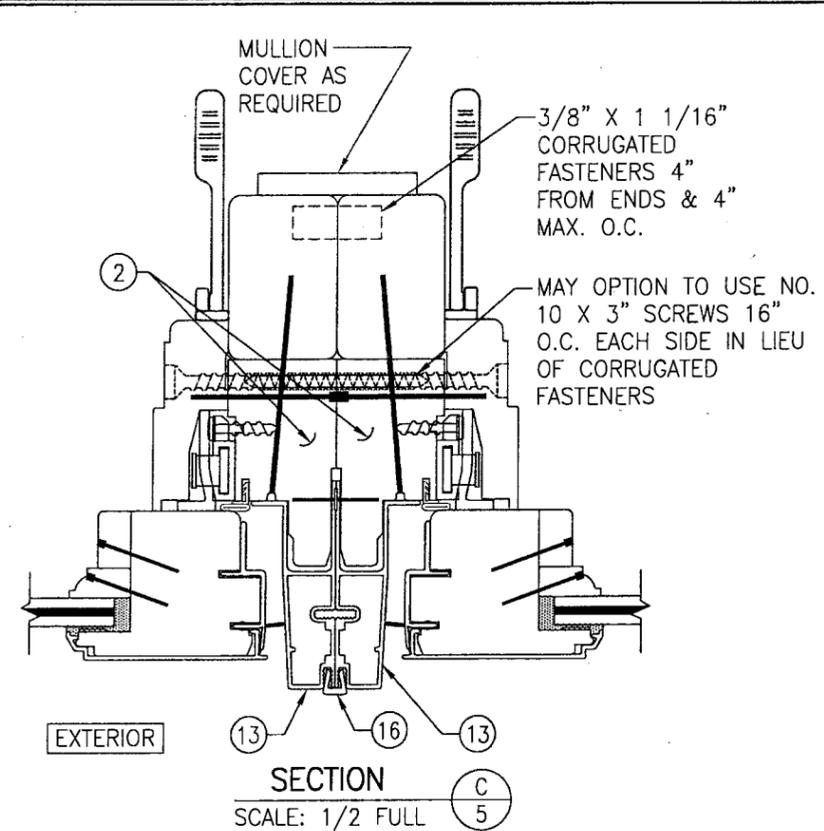


SECTION C
SCALE: 1/2 FULL


(SEE SECTION B1/5 FOR DETAILS NOT SHOWN)

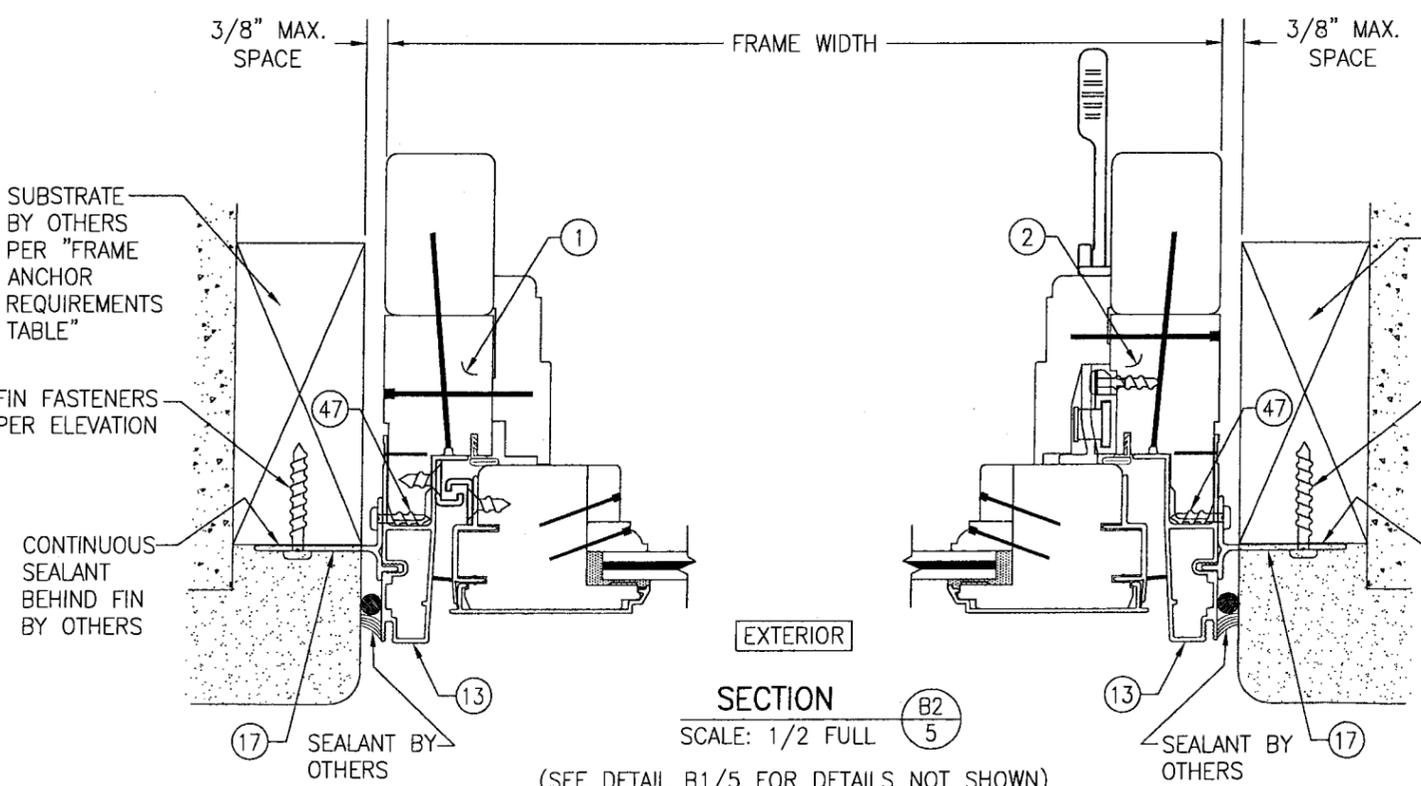

SECTION B2/5
SCALE: 1/2 FULL

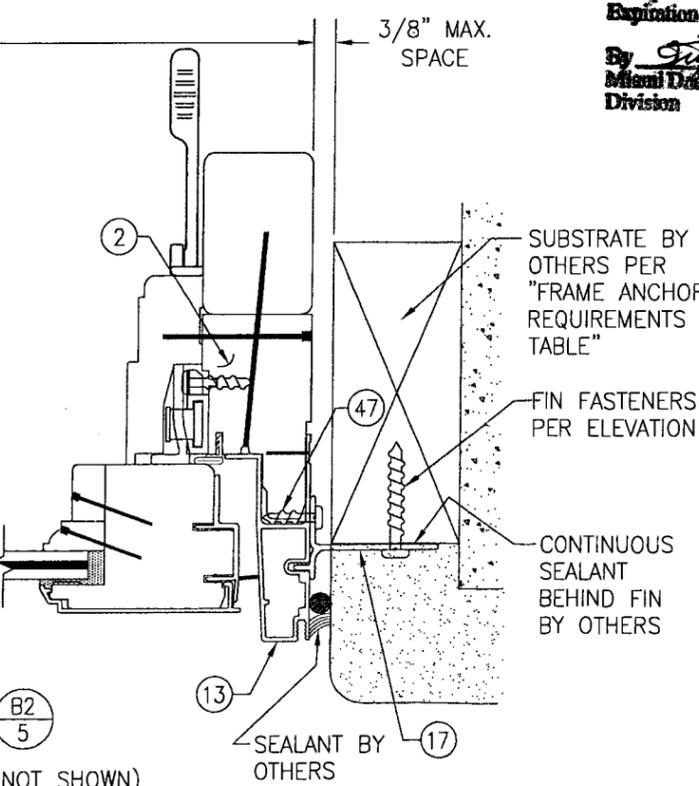

SECTION B2/5
SCALE: 1/2 FULL

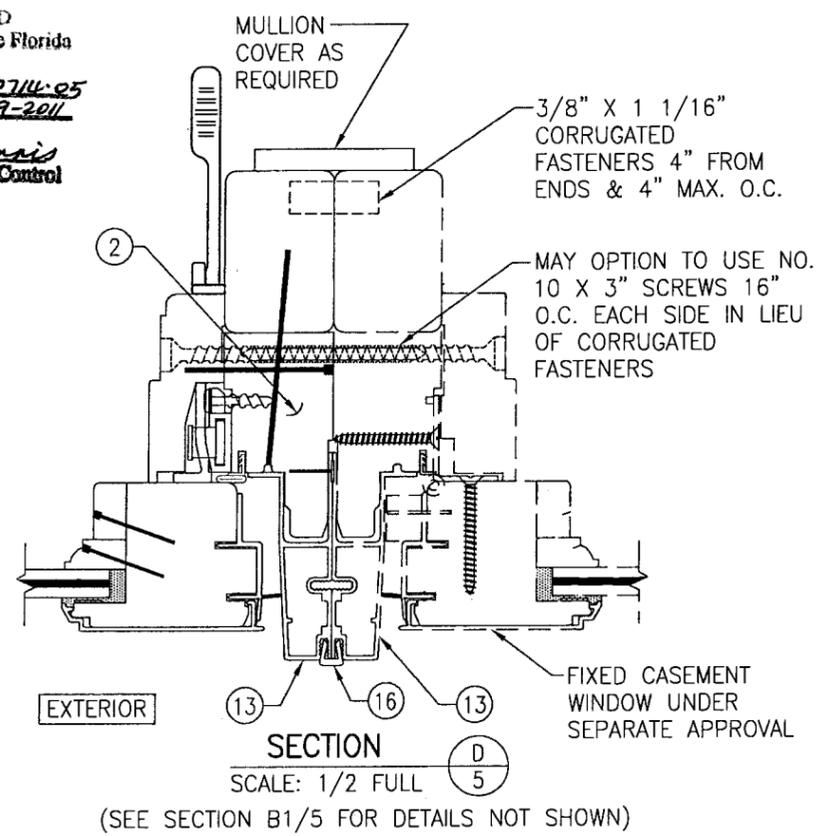

SECTION D
SCALE: 1/2 FULL

(SEE SECTION B1/5 FOR DETAILS NOT SHOWN)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0714-05
Expiration Date 4-29-2011
By Stib Harris
Miami Dade Product Control
Division

DRAWN BY:	S.T.R.	CHECKED BY:	W.W.S.
PLOT:	1=2	DATE:	7/21/05
NO.		REVISION DESCRIPTION	
DATE		BY	

DRAWING TITLE
FEEL SAFE ALUMINUM CLAD WOOD IMPACT OPERABLE CASEMENT WINDOW


MANUFACTURER
HURD WINDOWS & DOORS
575 S. HELEN AVE.
MEDFORD, WI 54451
800-433-4873

CONSULTANTS
W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
8895 N. MILITARY TRAIL, SUITE C-204
PALM BEACH GARDENS, FL 33410
PHONE: 561-775-4902 FAX: 561-775-4903


CERTIFICATION
JUL 09 2009

WARREN W. SCHAEFER, P.E.
P.E. NO. 44135

DRAWING NO.	REV.
1403	A
SHEET NO.	
5	OF 6

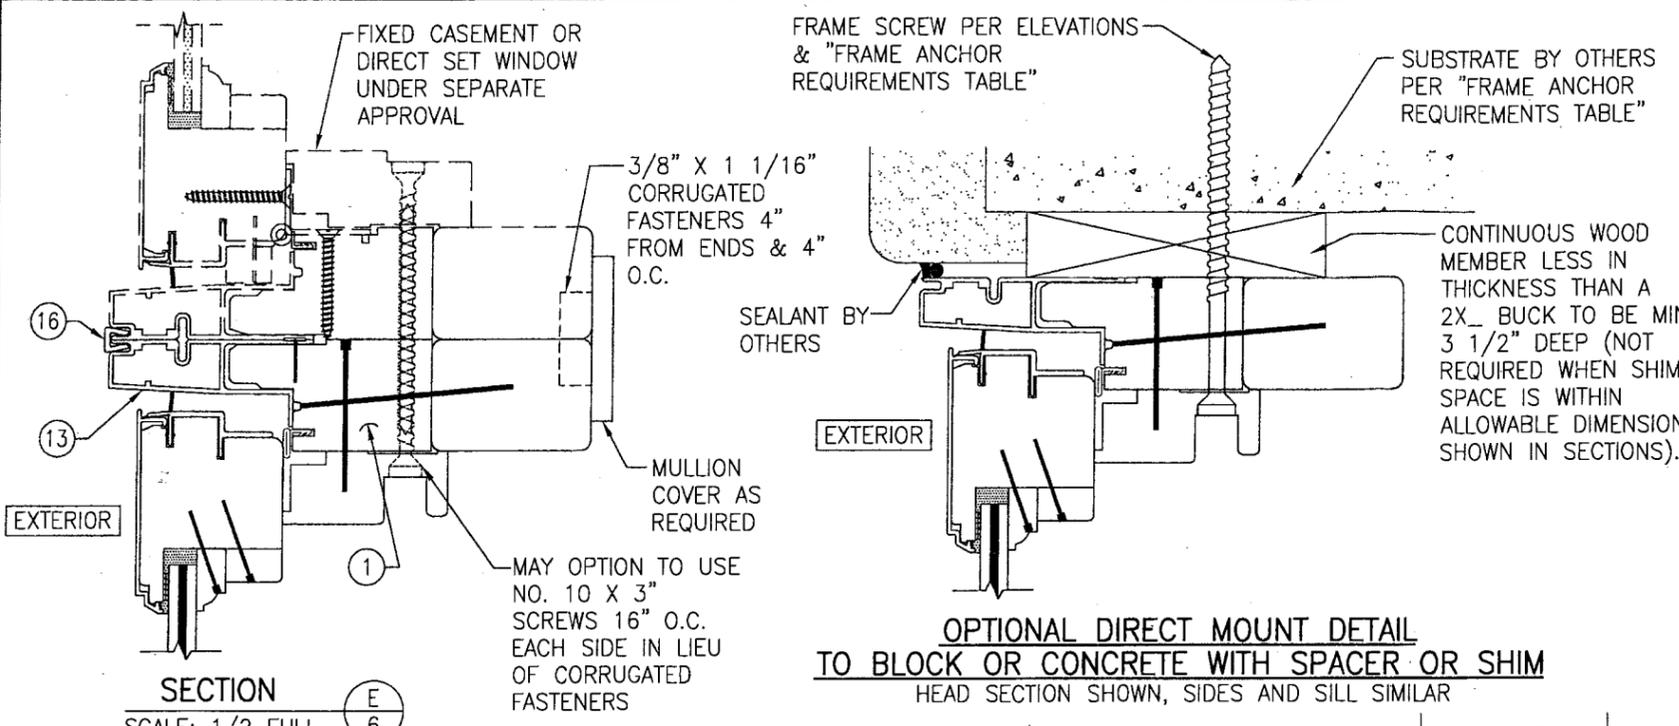

OPTIONAL DIRECT MOUNT DETAIL TO BLOCK OR CONCRETE WITH SPACER OR SHIM
HEAD SECTION SHOWN, SIDES AND SILL SIMILAR

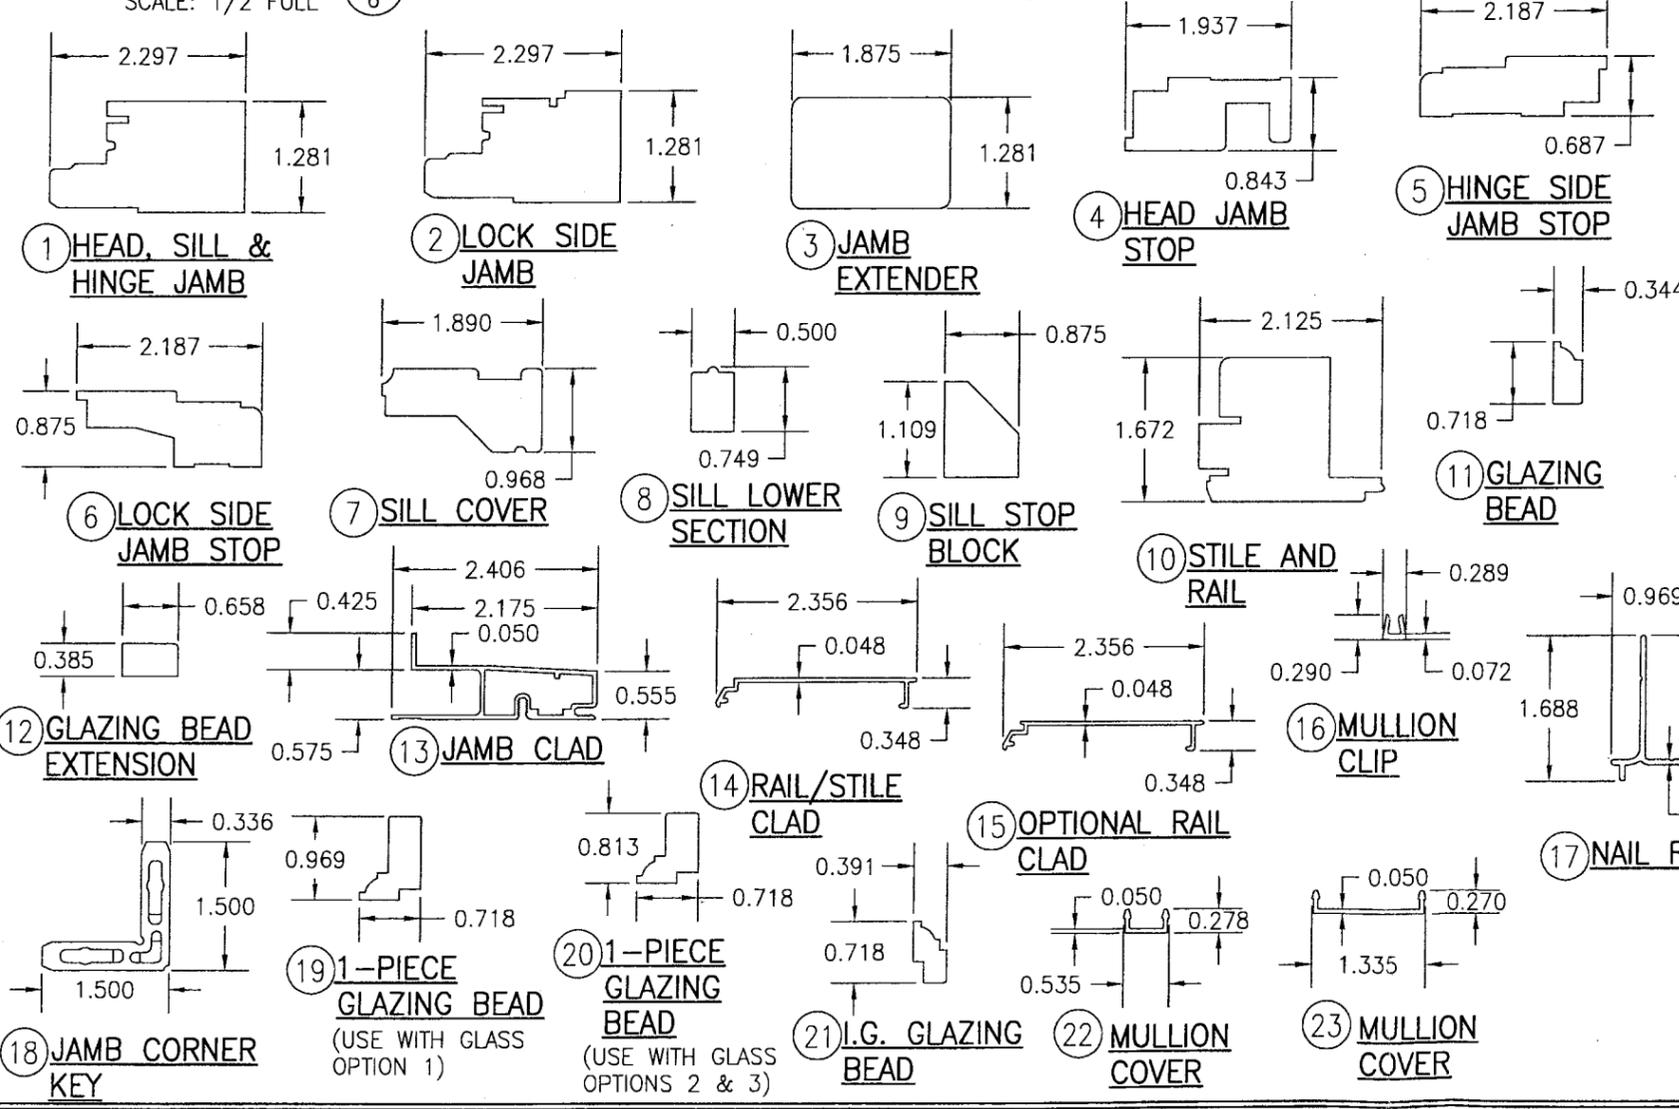

ITEM #	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS		
1	CCSE 215 HEAD, SILL, & HINGE JAMB	* PONDEROSA/SUGAR PINE
2	CCSE 223 LOCK SIDE JAMB	* PONDEROSA/SUGAR PINE
3	CCSE 225 JAMB EXTENDER	* PONDEROSA/SUGAR PINE
4	CCSE 260 HEAD JAMB STOP	* PONDEROSA/SUGAR PINE
5	CCSE 245 HINGE SIDE JAMB STOP	* PONDEROSA/SUGAR PINE
6	CCSE 235 LOCK SIDE JAMB STOP	* PONDEROSA/SUGAR PINE
7	CCSE 285 SILL COVER	* PONDEROSA/SUGAR PINE
8	CCSE 290 SILL LOWER SECTION	* PONDEROSA/SUGAR PINE
9	CCSE 295 SILL STOP BLOCK	* PONDEROSA/SUGAR PINE
10	ECSE 200 STILE AND RAIL	* PONDEROSA/SUGAR PINE
11	ALWD 375 GLAZING BEAD	* PONDEROSA/SUGAR PINE
12	300-0025 GLAZING BEAD EXTENSION	* PONDEROSA/SUGAR PINE
13	CCSE 440 JAMB CLAD	6063-T6 ALUMINUM
14	ECSE 400 RAIL/STILE CLAD	6063-T5 ALUMINUM
15	ECSE 405 OPTIONAL RAIL CLAD	6063-T5 ALUMINUM
16	PA 115 MULLION CLIP	6060-T5 ALUMINUM
17	- NAIL FIN	6063-T6 ALUMINUM
18	CCSE 620 JAMB CORNER KEY	NYLON 66 MATERIAL
19	216273 1-PIECE GLAZING BEAD	* PONDEROSA/SUGAR PINE
20	216275 1-PIECE GLAZING BEAD	* PONDEROSA/SUGAR PINE
21	- I.G. GLAZING BEAD	* PONDEROSA/SUGAR PINE
22	- MULLION COVER	6063-T6 ALUMINUM
23	- MULLION COVER	6063-T6 ALUMINUM
24	- MULLION BAR	6061-T6 ALUMINUM
25	- MULLION EXTRUSION	6063-T6 ALUMINUM
HARDWARE		
26	OPERATOR	AS REQUIRED
27	CCSE 711 SCISSOR HINGE	@ HEAD AND SILL
28	ECSE 155 MULTI-POINT LOCK SYSTEM	TRUTH
29	21642.92 2 PIECE SNUBBER	0.320" X 0.531" X 1.844" LONG STAMPED STEEL
SEALS AND SEALANTS		
35	020546 FRAME WEATHERSTRIP	GREY SANTOPRENE FOAM
36	ECSE 625 SASH WEATHERSTRIP	VINYL
FASTENERS		
40	092748 13 GA. 1 1/2" RING SHANK NAIL	4" FROM CORNERS & 6" TO 12" O.C.
41	011824 16 GA. 1 3/4" T-NAIL	1" FROM CORNERS & 6" TO 10" O.C. @ SILL COVER & SILL LOWER SECTION AND 1 PER SILL BLOCK
43	013801 #8 X 1 1/4" PH S.S. SMS	2 PER LOCK STRIKE
44	010226 AUTO WIRE NAIL	2" FROM CORNERS & 6" TO 8" O.C.
45	024617 2 1/2" X 1" CROWN STAPLE	2" FROM CORNERS & 10 O.C.
46	019892 #18 X 1/2" GSN STAPLE	2" FROM CORNERS & 7" TO 10" O.C.
47	- #6 X 5/8" PH SCREW	2" FROM CORNERS & 9" O.C.
48	- NO. 8 X 1 1/4" S.S. SMS	2 PER SNUBBER INTO SASH
49	- NO. 7 X 1/2" S.S. SMS	2 PER SNUBBER INTO FRAME

NOTE: WOOD USED IN TESTING WAS PONDEROSA PINE. OTHER WOOD SPECIES APPLICABLE FOR USE WITH THIS PRODUCT ARE THOSE WITH A SPECIFIC GRAVITY OF 0.43 AND MODULUS OF ELASTICITY OF 1,200,000 PSI OR GREATER. ALL WOOD IS MINIMUM GRADE 2 MILLED BY HURD WINDOWS & DOORS TO SELECT.

DRAWN BY: S.T.R.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 7/21/05
DATE	
BY	
REVISION DESCRIPTION	
NO.	

FEEL SAFE ALUMINUM CLAD WOOD IMPACT OPERABLE CASEMENT WINDOW

HURD WINDOWS & DOORS
575 S. WHELEN AVE.
MEDFORD, WI 54451
800-433-4873

MANUFACTURER

CONSULTANTS
W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
8895 N. MILITARY TRAIL, SUITE C-204
PALM BEACH GARDENS, FL 33410
PHONE: 561-775-4902 FAX: 561-775-4903

CERTIFICATION
JUL 09 2009

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 09-0714-05
Expiration Date 6-29-2011
By *John Harris*
Miami Dade Product Control Division

DRAWING NO.	REV.
1403	A
SHEET NO.	
6	6