MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1107
MIAMI, FLORIDA 33130-1563
(305) 375-2902 FAX (305) 375-2908
www.miamidade.gov/buildingcode

NOTICE OF ACCEPTANCE (NOA)

Metallum Enterprises, Inc.
7500 NW 68 Street
Miami, Florida 33166

SCOPE:
This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).
This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.
This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Aluminum Roof Stand Frame Support for A/C Condensing Units.

APPROVAL DOCUMENT: Drawing No. 06-MEE-0002, titled "Aluminum A/C Stand ", sheets 1 through 4 of 4, prepared by Engineering Express, dated March 09, 2007, last revision dated February 03, 2009, signed and sealed by Frank L. Bennardo, P.E., on May 13, 2010, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by Miami-Dade County Product Control Division

MISSILE IMPACT RATING: None

LABELING: Each stand frame shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 07-0322.13** and consists of this page 1, evidence submitted pages E-1 & E-2 as well as approval document mentioned above.
The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**

MIAMI-DADE COUNTY APPROVED

Helmy A. Makar
06/02/2010

NOA No. 09-0720.01
Expiration Date: June 28, 2012
Approval Date: June 02, 2010

Metallum Enterprises, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 07-0322.13

A. DRAWINGS:

1. Drawing No 06-MEE-0002, titled "Aluminum A/C Stand", sheets 1 through 3 of 3, prepared by Engineering Express, dated 03/09/07, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS:

1. None.

C. CALCULATIONS:

1. Calculation titled "Aluminum A/C Stands Calculations", dated 03/14/2007, sheets 1 through 11 of 11, signed and sealed by Frank L. Bennardo, P.E.

D. QUALITY ASSURANCE:

1. By Miami-Dade County Building Code Compliance Office.

E. MATERIAL CERTIFICATIONS:

1. None.

F. STATEMENTS:

1. Review Request Letter issued by Metallum Enterprises, Inc., dated June 09, 2007, signed by Victor Toyos.

2. Code Compliance Letter issued by Engineering Express, dated March 16, 2007, signed and sealed by Frank L. Bennardo, P.E.

3. No financial Interest Letter issued by Engineering Express, dated March 16, 2007, signed and sealed by Frank L. Bennardo, P.E.

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS:

1. Drawing No. 06-MEE-0002, titled "Aluminum A/C Stand ", sheets 1 through 4 of 4, prepared by Engineering Express, dated March 09, 2007, last revision dated February 03, 2009, signed and sealed by Frank L. Bennardo, P.E., on May 13, 2010.

B. TESTS:

1. None.

Helmy A. Makar, P.E., M.S.
Senior Product Control Examiner
NOA No. 09-0720.01
Expiration Date: June 28, 2012
Approval Date: June 02, 2010

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS:

1. *Calculation titled "Aluminum A/C Stands Calculations", dated 03/29/2010, sheets 1 through 122 of 122, signed and sealed by Frank L. Bennardo, P.E.*

D. QUALITY ASSURANCE:

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS:

1. *None.*

F. STATEMENTS:

1. *Code Compliance Letter with the FBC 2007 issued by Engineering Express, dated March 29, 2010, signed and sealed by Frank L. Bennardo, P.E.*

Henny A. Makar, P.E., M.S.
Senior Product Control Examiner
NOA No. 09-0720.01
Expiration Date: June 28, 2012
Approval Date: June 02, 2010

ALUMINUM A/C STAND W/ TELESCOPIC CROSS-MEMBER

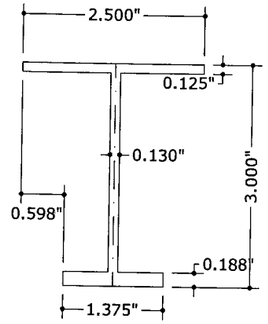

1 RAIL (I-BEAM)
6061-T6 ALUM
6"=1'-0"



2 SQUARE TUBING
6061-T6 ALUM
6"=1'-0"



2.1 SQUARE TUBING
6061-T6 ALUM
6"=1'-0"

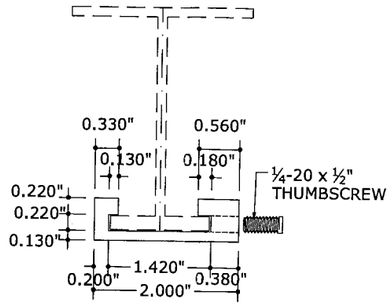

3 C-CHANNEL
6061-T6 ALUM
6"=1'-0"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0720.01
Expiration Date 06/28/2012
By
Miami Dade Product Control
Division



4 POST
6061-T6 ALUM
6"=1'-0"

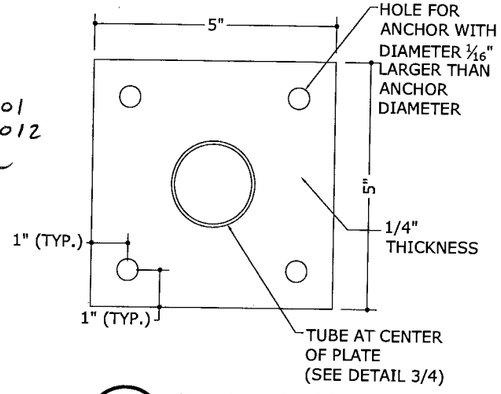

5 BASE PLATE
6061-T6 ALUM
4"=1'-0"

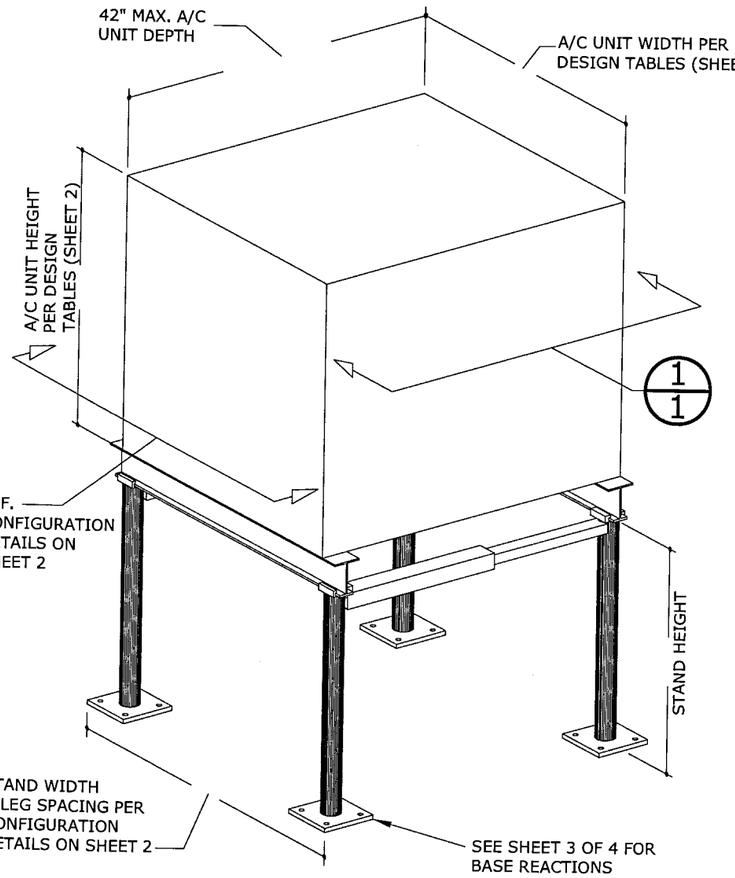

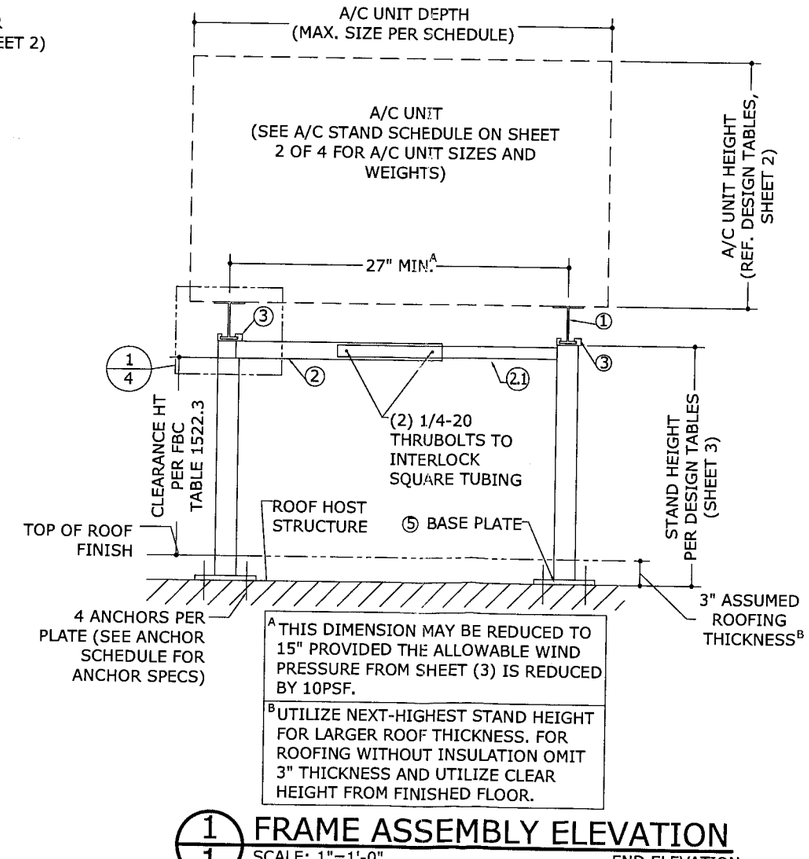

A THIS DIMENSION MAY BE REDUCED TO 15" PROVIDED THE ALLOWABLE WIND PRESSURE FROM SHEET (3) IS REDUCED BY 10PSF.

B UTILIZE NEXT-HIGHEST STAND HEIGHT FOR LARGER ROOF THICKNESS. FOR ROOFING WITHOUT INSULATION OMIT 3" THICKNESS AND UTILIZE CLEAR HEIGHT FROM FINISHED FLOOR.

1/1 FRAME ASSEMBLY ELEVATION
SCALE: 1"=1'-0" END ELEVATION

GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. MAXIMUM DIMENSIONS AND WEIGHT OF EACH A/C UNIT HAVE BEEN SPECIFIED AS SHOWN IN DESIGN SCHEDULES AND ILLUSTRATIONS ON SHEET 2. SMALLER UNIT DIMENSIONS ARE PERMISSIBLE PROVIDED MINIMUM UNIT WEIGHT OF 100LB. NO PART OF ANY UNIT SHALL BE INSTALLED BEYOND 6" FROM ANY STAND'S LAST POST SUPPORT (SEE DETAIL PAGE 3).
5. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE-SPECIFIC DOCUMENTS AND SUBMIT FOR ONE-TIME NOTICE OF ACCEPTANCE IN CONJUNCTION WITH THIS DOCUMENT.
6. AC STANDS SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE LABEL PER FRAME ASSEMBLY CONTAINING THE FOLLOWING:

METALLUM ENTERPRISES, MIAMI, FLORIDA
MIAMI-DADE PRODUCT CONTROL APPROVED

7. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS.
8. ALL EXTRUSIONS SHALL BE OF ALUMINUM ALLOY / TEMPER NOTED HEREIN. CONCRETE SPECIFIED HEREIN SHALL BE MINIMUM LIGHTWEIGHT STRUCTURAL CONCRETE AND SHALL REACH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI IN 7 DAYS.
9. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN FLORIDA BUILDING CODE 2003.8.4.
10. FOR "TOTAL STAND HEIGHT" ADD 3-¼" TO "STAND HEIGHT."
11. STANDS SHALL BE INSTALLED WITH A MINIMUM CLEAR HEIGHT IN ACCORDANCE WITH FBC 15.1522 AND TABLE 1522.3.

FRANK L. BENNARDO, P.E.
PE0046549
05/13/2010

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

METALLUM ENTERPRISES
7500 NW 68 STREET
MIAMI, FL 33166
Phn. (305) 884-7076 - Fax. (305) 884-7073

ALUMINUM A/C STAND
HVHZ COMPLIANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	CL	03/09/07
REVISE FOR 07 FBC	TSB	CL	02-03-09

06-MEE-0002
SCALE: - 02
PAGE DESCRIPTION:
-
-

4
1

STAND AND UNIT CONFIGURATIONS (SEE SHEET 3 FOR ASSOCIATED DESIGN SCHEDULE)

(CONFIGURATIONS ARE SHOWN FOR ILLUSTRATION ONLY; SPECIFIC ELEVATIONS MAY VARY)

NOTE: USE ANY COMBINATION OF UNITS TO FIT STAND PER MANUFACTURER'S REQUIREMENTS. THE NUMBER OF UNITS MAY BE LESS THAN SHOWN, BUT MAY NOT EXCEED CONFIGURATION LIMITS AS SHOWN. WHEN USING MULTIPLE SIZES ON ONE STAND, UTILIZE MAXIMUM UNIT SIZE TO DETERMINE ALLOWABLE DESIGN FROM TABLES ON SHEET 3.

STAND TYPE (A)

NOTE: A/C UNITS WITHIN STAND TYPES MAY BE COMBINED BY USING MAX ADDITIVE WEIGHTS AND WIDTHS;ALL HEIGHT VALUES SHALL REMAIN AS SHOWN HEREIN

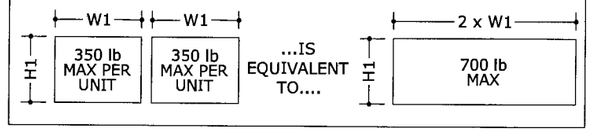

STAND TYPE (B)

(350 LB. MAX PER UNIT U.N.O.)

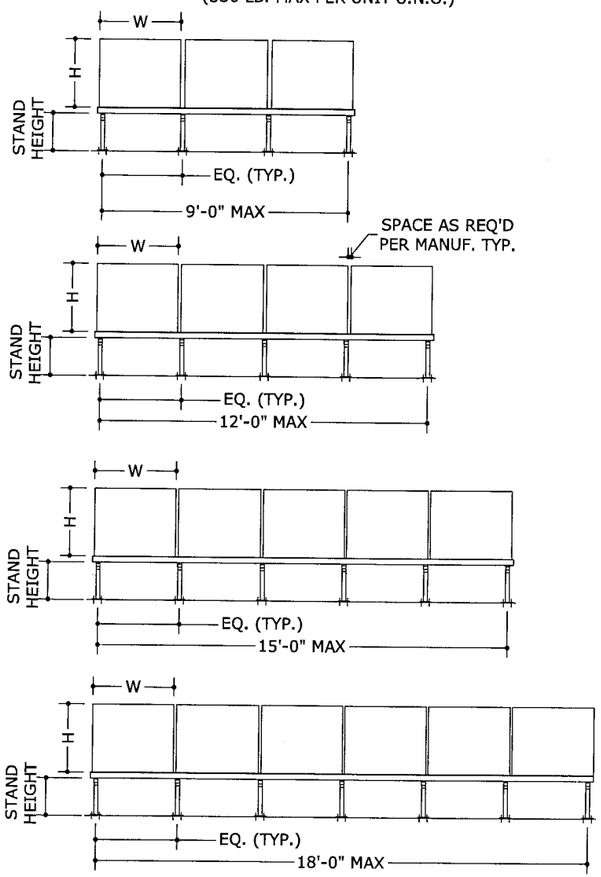

STAND TYPE (C)

(350 LB. MAX PER UNIT U.N.O.)

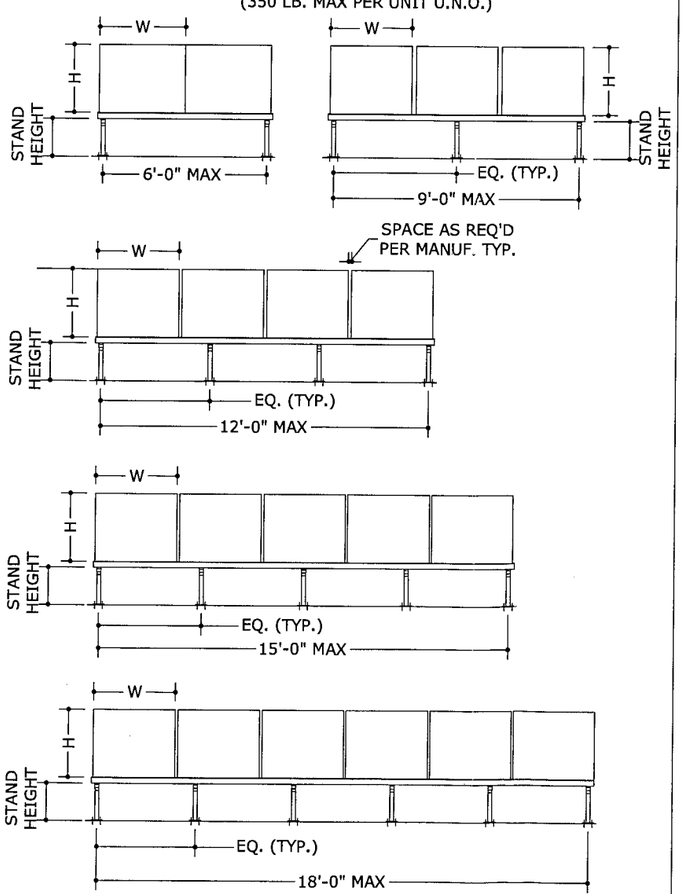

STAND TYPE (D*)

(350 LB. MAX PER UNIT U.N.O.)

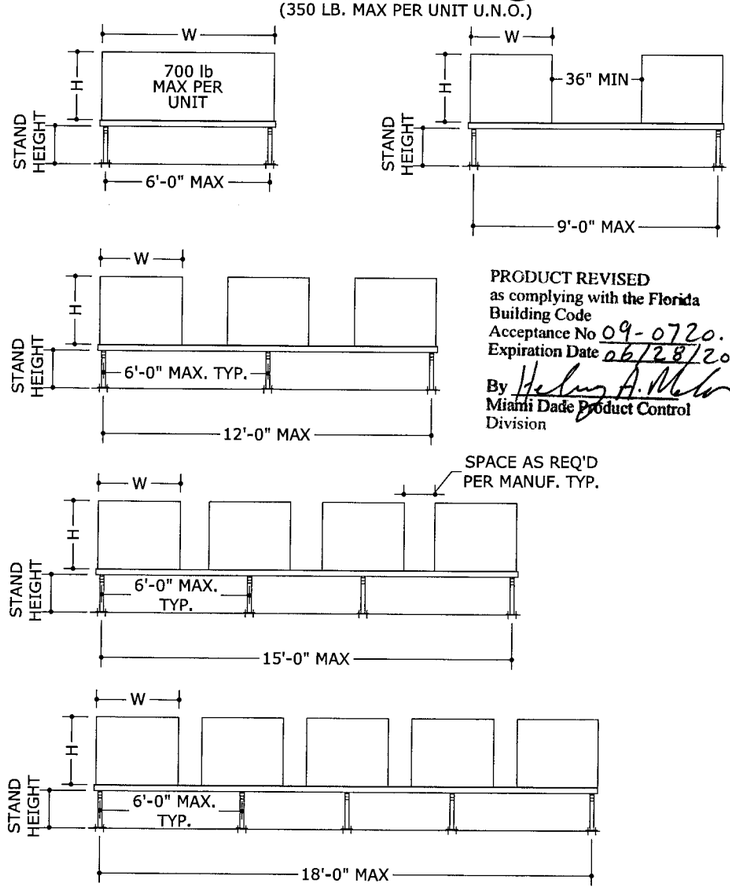

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 09-0720.01
Expiration Date 06/28/2012
By Helen A. Mohn
Miami Dade Product Control Division

*FOR THIS STAND TYPE, ASSEMBLIES WITH UNITS GREATER THAN 30" WIDE SHALL UTILIZE ONE LESS UNIT THAN SHOWN IN MULTI-UNIT CONFIGURATIONS

FRANK L. BENNARDO, P.E.
PE0046549
STATE OF FLORIDA
05/13/2010

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9865
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

METALLUM ENTERPRISES
7500 NW 68 STREET
MIAMI, FL 33166
Phn. (305) 884-7076 - Fax. (305) 884-7073

ALUMINUM A/C STAND
HVHZ COMPLIANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	CL	03/09/07
REVISE FOR 07 FBC	TSB	CL	02-03-09
-	-	-	-
-	-	-	-
-	-	-	-

06-MEE-0002
SCALE: - 02
PAGE DESCRIPTION:
-
-

4

2

DESIGN SCHEDULES

DESIGN SCHEDULE 1

(TYPICAL INSTALLATION OVER VARIOUS SUBSTRATES - SEE ANCHOR TYPES):

UNIT DIMENSIONS W	UNIT DIMENSIONS H	MAX STAND HEIGHT	MIN CLEARANCE HEIGHT (SEE GEN NOTE #11)	ALLOWABLE WIND PRESSURES STAND TYPE Ⓐ [3][4]	STAND TYPE Ⓐ [1][2]	STAND TYPE Ⓑ [3][4]	STAND TYPE Ⓑ [1][2]	STAND TYPE Ⓒ [3][4]	STAND TYPE Ⓒ [1][2]	STAND TYPE Ⓓ [3][4]	STAND TYPE Ⓓ [1][2]	MAX. BASE MOMENT (M)	MAX. BASE SHEAR (V)	MAX. BASE UPLIFT (T)	MAX. BASE GRAVITY (C)
24 in	24 in	18 in	18 in	150.0 PSF	134.1 PSF	150.0 PSF	84.6 PSF	123.5 PSF	68.1 PSF	123.5 PSF	68.1 PSF	267 LB-FT	247 LB	317 LB	542 LB
30 in	30 in			150.0 PSF	84.2 PSF	98.5 PSF	53.1 PSF	78.7 PSF	42.8 PSF	78.7 PSF	42.8 PSF	266 LB-FT	246 LB	380 LB	595 LB
35.9 in	24 in			150.0 PSF	89.6 PSF	103.3 PSF	56.5 PSF	82.6 PSF	45.5 PSF	103.3 PSF	56.5 PSF	267 LB-FT	247 LB	327 LB	542 LB
35.9 in	36 in			109.5 PSF	57.6 PSF	68.3 PSF	36.3 PSF	54.6 PSF	29.2 PSF	68.3 PSF	36.3 PSF	265 LB-FT	246 LB	449 LB	648 LB
24 in	24 in	24 in	24 in	150.0 PSF	112.1 PSF	124.7 PSF	70.7 PSF	99.7 PSF	56.9 PSF	99.7 PSF	56.9 PSF	268 LB-FT	200 LB	299 LB	513 LB
36 in	24 in			133.3 PSF	74.7 PSF	83.2 PSF	47.2 PSF	66.5 PSF	38.0 PSF	83.2 PSF	47.2 PSF	268 LB-FT	200 LB	314 LB	513 LB
30 in	30 in			127.5 PSF	70.6 PSF	79.6 PSF	44.6 PSF	63.6 PSF	35.9 PSF	63.6 PSF	35.9 PSF	267 LB-FT	199 LB	358 LB	556 LB
36 in	36 in			88.3 PSF	48.3 PSF	55.1 PSF	30.5 PSF	44.0 PSF		55.1 PSF	30.5 PSF	266 LB-FT	199 LB	400 LB	599 LB
42 in	42 in			64.6 PSF	35.0 PSF	40.3 PSF		32.2 PSF		40.3 PSF		265 LB-FT	198 LB	443 LB	641 LB
37 in	54 in			56.7 PSF	30.0 PSF	35.3 PSF		28.2 PSF		35.3 PSF		263 LB-FT	197 LB	527 LB	725 LB
24 in	24 in	32 in	30 in	150.0 PSF	96.5 PSF	104.8 PSF	60.9 PSF	83.7 PSF	49.0 PSF	83.7 PSF	49.0 PSF	268 LB-FT	168 LB	281 LB	495 LB
36 in	24 in			112.0 PSF	64.3 PSF	69.9 PSF	38.8 PSF	55.8 PSF	32.7 PSF	69.9 PSF	40.6 PSF	268 LB-FT	168 LB	296 LB	495 LB
30 in	30 in			107.2 PSF	60.9 PSF	66.9 PSF	38.4 PSF	53.4 PSF	30.9 PSF	53.4 PSF	30.9 PSF	268 LB-FT	167 LB	333 LB	531 LB
36 in	36 in			74.2 PSF	41.8 PSF	46.3 PSF	26.3 PSF	37.0 PSF		46.3 PSF	26.3 PSF	267 LB-FT	167 LB	369 LB	567 LB
42 in	42 in			54.5 PSF	30.3 PSF	34.1 PSF		27.3 PSF		33.9 PSF		267 LB-FT	167 LB	406 LB	606 LB
37 in	54 in			47.9 PSF	26.0 PSF	29.9 PSF				29.8 PSF		265 LB-FT	166 LB	477 LB	642 LB

(LINEAR INTERPOLATION MAY BE UTILIZED TO DETERMINE INTERMEDIATE VALUES BETWEEN UNIT DIMENSIONS AND/OR STAND HEIGHTS.)

DESIGN SCHEDULE 2

(TYPICAL INSTALLATION OVER CONCRETE SUBSTRATE WITH 4" ADDITIONAL CONCRETE TOPPING/OVERPOUR OVER AC MOUNT BASEPLATE - DETAIL 2/3):

(STAND ASSEMBLIES FOR THIS SCHEDULE SHALL BE TYPICALLY INSTALLED OVER EXISTING CONCRETE HOST USING ANCHOR TYPE (3), WITH THE ADDITION OF MINIMUM 4" CONCRETE COVER OVER FULL AREA OF EACH BASEPLATE. CONCRETE SPECIFIED HEREIN SHALL BE MINIMUM LIGHTWEIGHT STRUCTURAL CONCRETE AND SHALL REACH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI IN 7 DAYS.)

UNIT DIMENSIONS W	UNIT DIMENSIONS H	MAX STAND HEIGHT	MIN CLEARANCE HEIGHT (SEE GEN NOTE #11)	ALLOWABLE WIND PRESSURES STAND TYPE Ⓐ [3]	STAND TYPE Ⓑ [3]	STAND TYPE Ⓒ [3]	STAND TYPE Ⓓ [3]	MAX. BASE MOMENT (M)	MAX. BASE SHEAR (V)	MAX. BASE UPLIFT (T)	MAX. BASE GRAVITY (C)
24 in	24 in	18 in	18 in	150.0 PSF	150.0 PSF	150.0 PSF	150.0 PSF	324 LB-FT	300 LB	396 LB	621 LB
30 in	30 in			150.0 PSF	127.4 PSF	101.9 PSF	101.9 PSF	344 LB-FT	319 LB	504 LB	719 LB
35.9 in	24 in			150.0 PSF	133.1 PSF	106.5 PSF	133.1 PSF	344 LB-FT	319 LB	433 LB	613 LB
35.9 in	36 in			142.0 PSF	88.7 PSF	71.0 PSF	88.7 PSF	344 LB-FT	319 LB	575 LB	755 LB
24 in	24 in	24 in	24 in	150.0 PSF	146.8 PSF	117.5 PSF	117.5 PSF	315 LB-FT	235 LB	359 LB	574 LB
36 in	24 in			150.0 PSF	97.9 PSF	78.3 PSF	97.9 PSF	315 LB-FT	235 LB	359 LB	574 LB
30 in	30 in			150.0 PSF	94.0 PSF	75.2 PSF	75.2 PSF	315 LB-FT	235 LB	425 LB	626 LB
36 in	36 in			104.4 PSF	65.3 PSF	52.2 PSF	65.3 PSF	315 LB-FT	235 LB	478 LB	678 LB
42 in	42 in			76.7 PSF	47.9 PSF	38.4 PSF	47.9 PSF	315 LB-FT	235 LB	530 LB	730 LB
37 in	54 in			67.7 PSF	42.3 PSF	33.9 PSF	42.3 PSF	315 LB-FT	235 LB	635 LB	835 LB
24 in	24 in	32 in	30 in	150.0 PSF	115.9 PSF	92.8 PSF	92.8 PSF	296 LB-FT	186 LB	315 LB	530 LB
36 in	24 in			123.7 PSF	77.3 PSF	61.8 PSF	77.3 PSF	296 LB-FT	186 LB	330 LB	530 LB
30 in	30 in			118.7 PSF	74.2 PSF	59.4 PSF	59.4 PSF	296 LB-FT	186 LB	371 LB	571 LB
36 in	36 in			82.4 PSF	51.5 PSF	41.2 PSF	51.5 PSF	296 LB-FT	186 LB	412 LB	612 LB
42 in	42 in			60.6 PSF	37.9 PSF	30.3 PSF	37.9 PSF	296 LB-FT	186 LB	453 LB	653 LB
37 in	54 in			53.5 PSF	33.4 PSF	26.7 PSF	33.4 PSF	296 LB-FT	186 LB	536 LB	736 LB

(LINEAR INTERPOLATION MAY BE UTILIZED TO DETERMINE INTERMEDIATE VALUES BETWEEN UNIT DIMENSIONS AND/OR STAND HEIGHTS.)

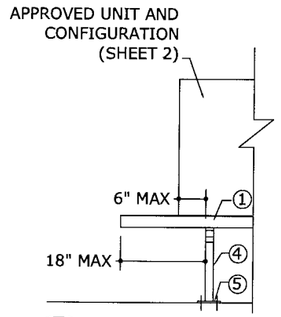

1/3 ENDPOST DETAIL
N.T.S. ELEVATION VIEW

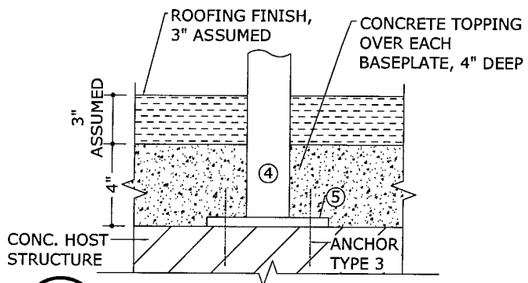

2/3 CONC. TOPPING OPTION
2" = 1'-0" SECTION VIEW

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 09-0720.01
Expiration Date 06/28/2012
By Helen A. Mele
Miami Dade Product Control Division

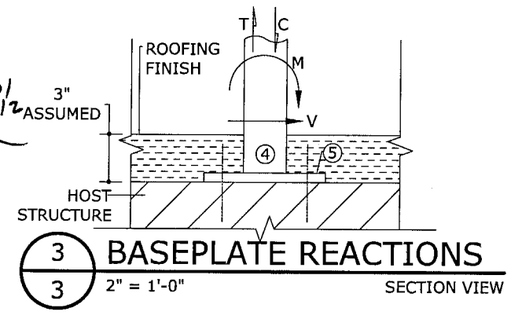

3/3 BASEPLATE REACTIONS
2" = 1'-0" SECTION VIEW

FRANK L. BENNARDO, P.E. # PE0046549
05/13/2010

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #8985
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

METALLUM ENTERPRISES
7500 NW 68 STREET
MIAMI, FL 33166
Phn. (305) 884-7076 - Fax. (305) 884-7073

ALUMINUM A/C STAND
HVHZ COMPLIANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INT ISSUE	KL	CL	03/09/07
REVISE FOR 07 FBC	TSB	CL	02-03-09

06-MEE-0002
SCALE: - 02
PAGE DESCRIPTION:
-
-

4
3

F:\01 Project Files\Metallum Enterprises (MEE)\2006 Jobs\06-MEE-0002 Rooftop AC Stand (NOA)\06-MEE-0002_05d_Rooftop AC Stand (NOA).dwg
troyb
05/13/2010 - 3:14pm

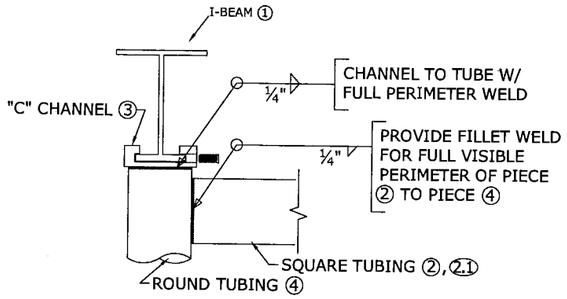

1/4 FRAME ASSEMBLY DETAIL

SCALE: 3"=1'-0"

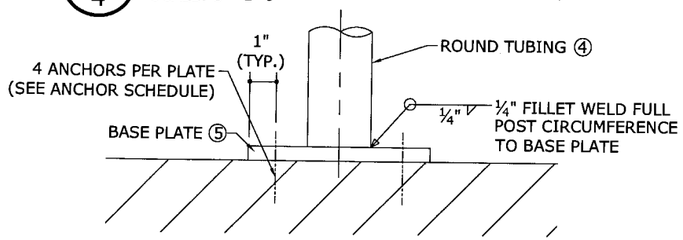

2/4 BASE PLATE DETAIL (REF DESIGN SCHEDULE)

SCALE: 3"=1'-0"

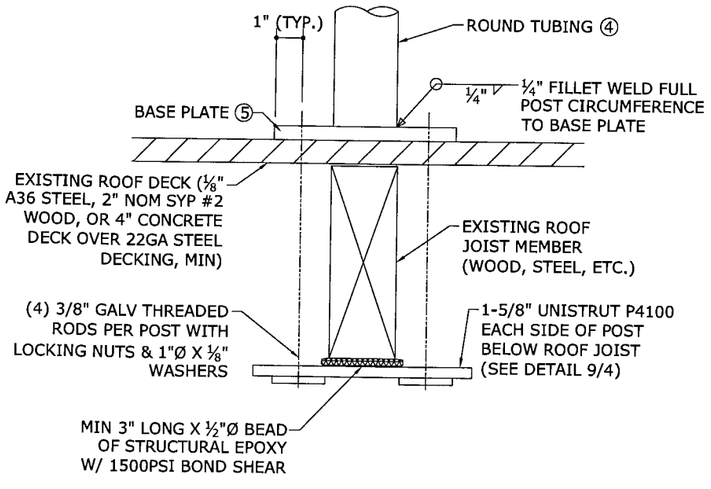

3/4 ALT. BASE PLATE ATTACHMENT DETAIL

SCALE: 3"=1'-0"

ANCHOR SCHEDULE

ANCHOR TYPE	HOST STRUCTURE	ANCHOR DESCRIPTION
1	WOOD	3/8" LAG SCREW WITH 3-1/2" MIN THREAD PENETRATION TO WOOD FRAMING & MIN 1" EDGE DISTANCE
2	STEEL	#12 ITW BUILDEX TEKS SELF-DRILLING SCREWS W/ BONDED WASHER TO STRUCTURAL STEEL MEMBERS (1/8" MIN THICKNESS)
3	CONCRETE	1/4" POWERS WEDGE-BOLT CONCRETE ANCHOR WITH 2-1/2" MIN EMBEDMENT & 3" MIN EDGE DISTANCE
4	STEEL	3/8" SAE GRADE 2 GALVANIZED BOLT W/ NUT & WASHER TO STRUCTURAL STEEL MEMBERS (1/8" MIN THICKNESS)

ANCHOR NOTES:

1. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
2. ENSURE MINIMUM EDGE DISTANCE AS NOTED IN ANCHOR SCHEDULE FOR EACH ANCHOR.
3. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
4. MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES ROOFING FINISHES.
5. WHERE EXISTING STRUCTURE IS WOOD TRUSSES, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD TRUSS MEMBERS, NOT INTO PLYWOOD.

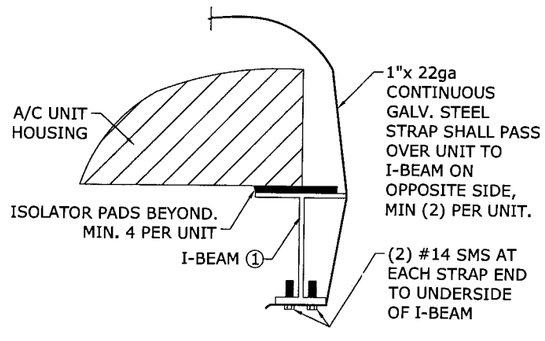

4/4 ALT. A/C UNIT TIE-DOWN DETAIL

SCALE: 3"=1'-0"

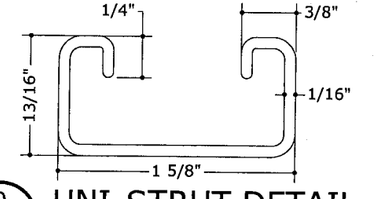

9/4 UNI-STRUT DETAIL

SCALE: N.T.S. MODEL: P4100

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 09-0720.01
Expiration Date 06/28/2012
By Helen A. Mah
Miami Dade Product Control Division

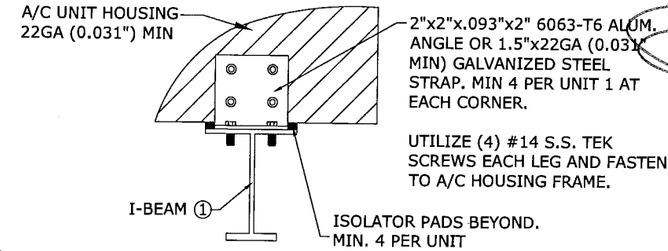

5/4 A/C UNIT TIE-DOWN DETAIL

SCALE: 3"=1'-0"

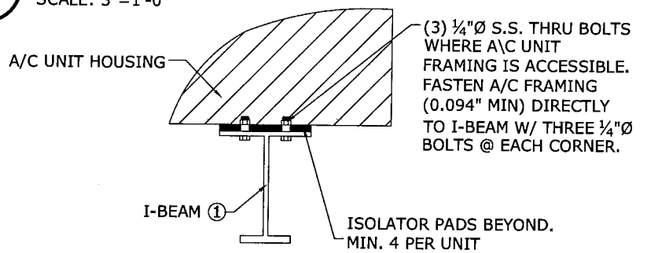

6/4 ALT. A/C UNIT TIE-DOWN DETAIL

SCALE: 3"=1'-0"

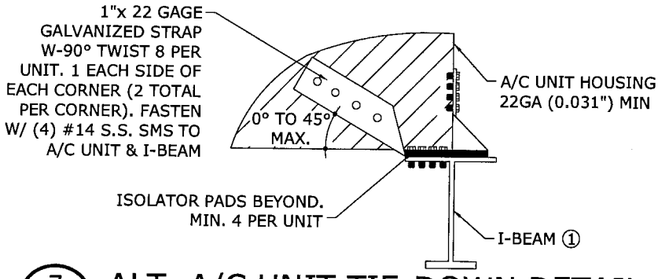

7/4 ALT. A/C UNIT TIE-DOWN DETAIL

SCALE: 3"=1'-0"

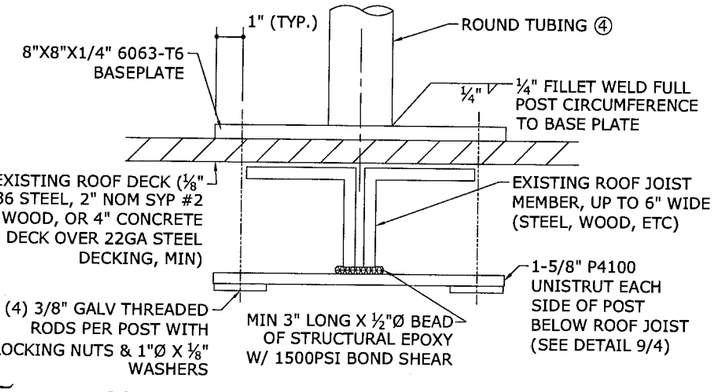

8/4 ALT. BASE PLATE ATTACHMENT DETAIL

SCALE: 3"=1'-0"

FRANK L. BENNARDO, P.E.
PE0046549
05/13/2010

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #8985
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

METALLUM ENTERPRISES
7500 NW 68 STREET
MIAMI, FL 33166
Phn. (305) 884-7076 - Fax. (305) 884-7073

ALUMINUM A/C STAND
HVHZ COMPLIANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	CL	03/09/07
REVISE FOR 07 FBC	TSB	CL	02-03-09

06-MEE-0002

SCALE: - 02

PAGE DESCRIPTION:
-
-

4

4