



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908  
www.miamidade.gov/buildingcode**

**NOTICE OF ACCEPTANCE (NOA)**

**Zeluck Incorporated  
5300 Kings Highway  
Brooklyn, NY 11234**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Outswing Series Wood French Door-LMI**

**APPROVAL DOCUMENT:** Drawing No **W97-34**, titled "H266" Outswing Mahogany Wood French Door (LMI) Sheets 1 through 6 of 6, dated Oct 28, 2009 w/ rev G, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises** NOA # **07-1026.02**, consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



**NOA No 09-0720.08**

**Expiration Date: November 22, 2011**

**Approval Date: November 18, 2009**

**Page 1**

8  
11/2/09

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS** (transferred from file # **07-1026.02**)
1. Manufacturer's die drawings and sections.
  2. Drawing No **W97-34**, titled "H266" Outswing Mahogany Wood French Door (LMD)" Sheets 1 through 6 of 6, dated Oct 28, 2009 w/ rev G, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

- B. TESTS** (transferred from file # **07-1026.02**)
1. Test reports on
    - 1) Air Infiltration Test, per FBC, TAS 202-94
    - 2) Uniform Load Static Air Pressure Test, per FBC, TAS 202-94
    - 3) Water Resistance Test, per FBC, TAS 202-94
    - 4) Forced Entry Resistance Test, per FBC, TAS 202-94
    - 5) Large Missile Impact Test per FBC, TAS 201-94
    - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of a wood outswing French door, prepared by Architectural Testing, Inc., Test Report No. **ATI-72408.01-109-18**, dated 04/04/07, signed and sealed by Michael D. Stremmel, P.E.

2. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Load Static Air Pressure Test, per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Forced Entry Resistance Test, per FBC, TAS 202-94
  - 5) Large Missile Impact Test per FBC, TAS 201-94
  - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of a wood outswing French door, prepared by Architectural Testing, Inc., Test Report No. **ATI-19719**, dated 07/02/07 and **ATI-38323.01** (Round Top) dated 01/15/01, both signed and sealed by Allen Reeves, P.E.

- C. CALCULATIONS**
1. Anchor verification calculations per FBC 2007, dated 06-09-09 and last revised on 10/28/09, prepared by Al-Farooq Corp., signed and sealed by Arshad Viqar, P.E.
  2. Glazing complies with ASTM E-1300-02 & 2004

- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).

- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "Saflex III G Clear or colored interlayer" dated 05/04/06, expiring on 05/21/11.

- F. STATEMENTS**
1. Statement letter of conformance to FBC 2007 & "No financial interest, dated 06-01-09, signed & sealed by Arshad Viqar, P.E.
  2. Lab compliance statements as a part of the above test reports.

- G. OTHER**
1. This NOA revises NOA # **07-1026.02**, which expired on Nov. 22, 2011.


Ishaq I. Chanda  
Ishaq I. Chanda, P.E.

Product Control Examiner  
NOA No 09-0720.08


Expiration Date: November 22, 2011  
Approval Date: November 18, 2009



CLUSTER OF ANCHOR AT MTG. STILE ENDS  
AT 3" O.C.  
AT TOP & BOTTOM  
(3) REQ. FOR DOORS UPTO 9 FT. HIGH  
(4) REQ. FOR DOORS OVER 9 FT. HIGH.

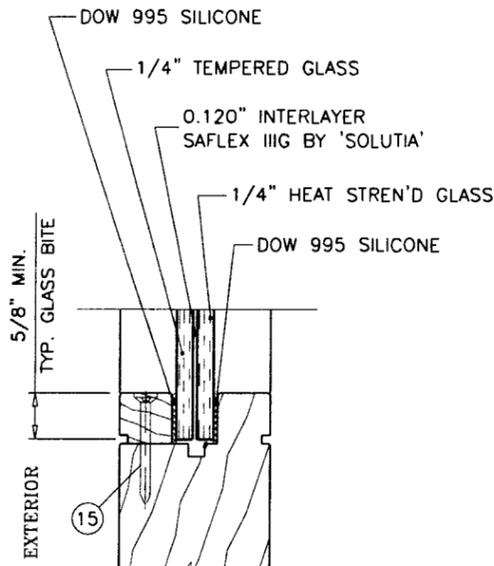


GLAZING DETAIL

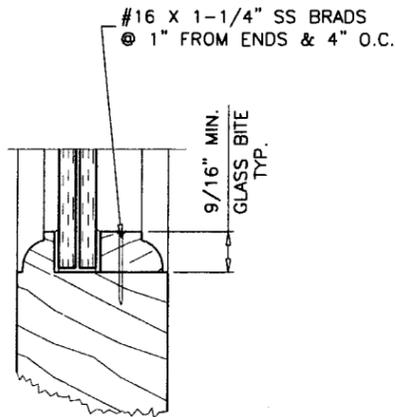

ALT. GLAZING STOP

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

THE APPROVED PRODUCTS NOTED HEREIN ARE EXEMPT FROM PRESERVATIVE TREATMENT PER 2326.2.1  
OF THE FLORIDA BUILDING CODE WHICH EXEMPTS WOOD SPECIES LISTED AS 'DURABLE'.  
THE SPECIFIC PRODUCTS HEREIN ARE EXEMPTED HONDURAN MAHOGANY-SWietenia Macrophylla OR  
EQUIVALENT SPECIES BASED ON USDA LISTING AND MUST HAVE A SPECIFIC GRAVITY EQUAL TO OR  
HIGHER THAT THE REFERENCED SPECIES.

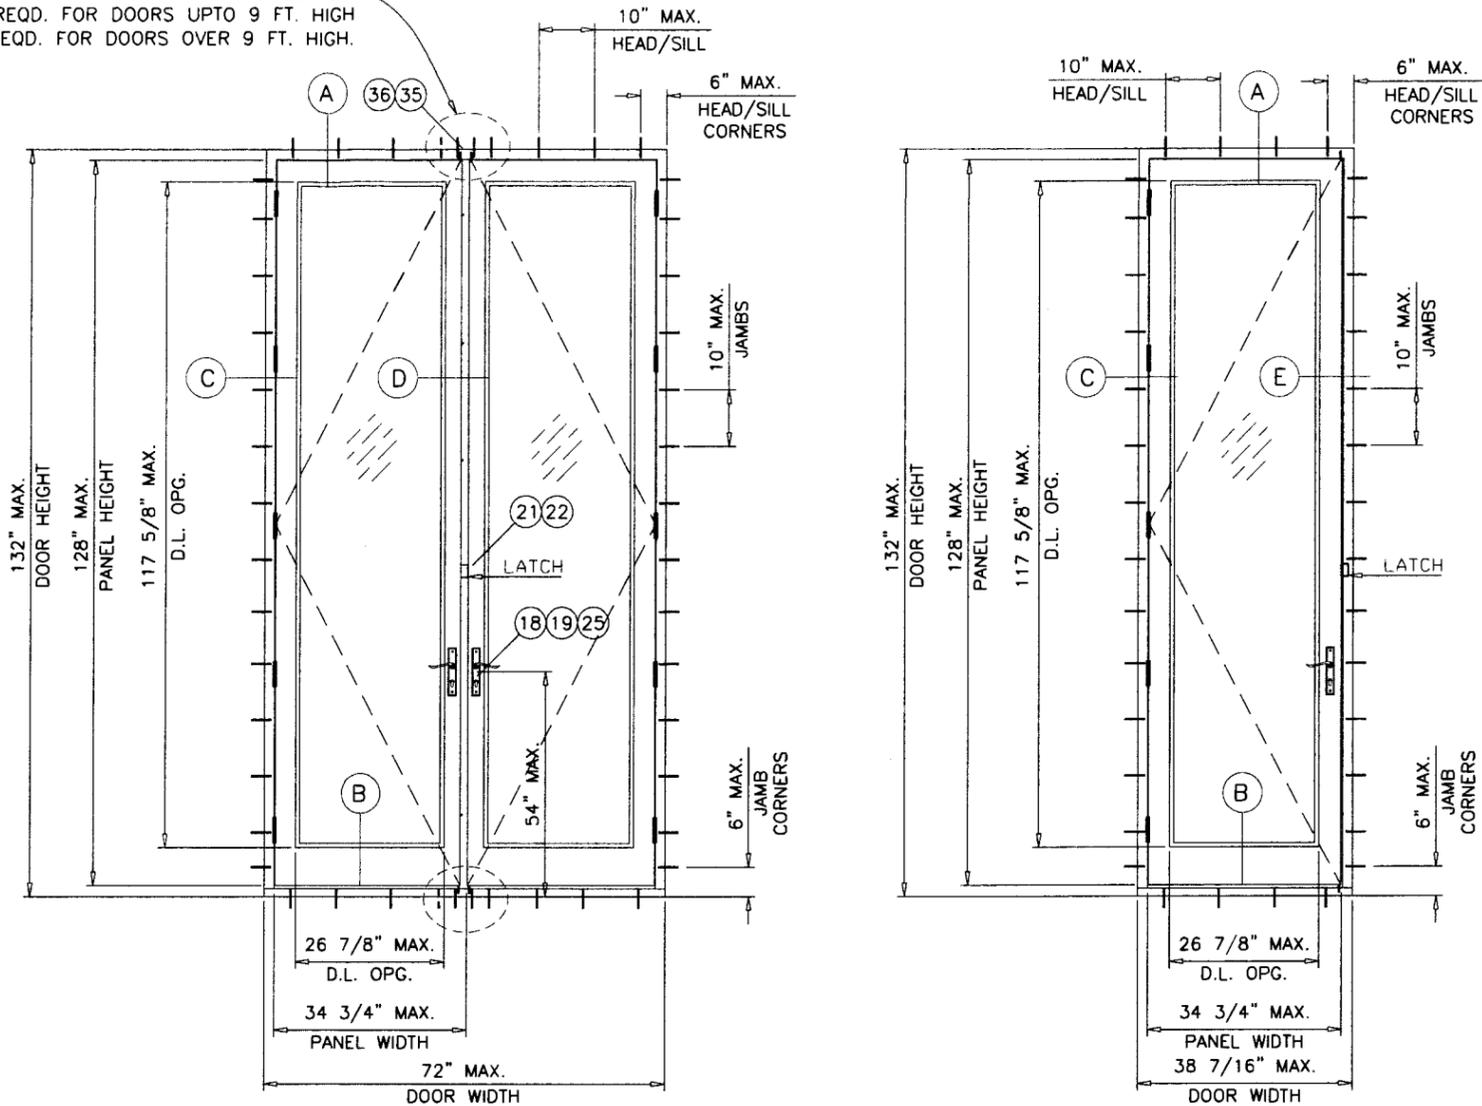

XX

TYPICAL ELEVATION

X

MAXIMUM DESIGN LOAD RATING = + 60.0 PSF  
(FOR SIZES SHOWN OR SMALLER) - 60.0 PSF

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 09-0720-08  
Expiration Date MAY 22, 2011  
*by Islem J. Chaudhry*  
Miami Dade Product Control  
Division

H266 OUTSWING MAHOGANY WOOD FRENCH DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE  
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING  
HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER  
LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS  
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.  
ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS  
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO  
CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS  
OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.  
SHUTTERS ARE NOT REQUIRED.

Engr: ARSHAD VIQAR  
CIVIL  
FLA. PE # 38863  
C.A.N. 3538  
*Arshad*  
OCT 28 2009


**afC**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP - ANL \ W97 - 34ZI

H266 OUTSWING MAHOGANY WOOD FRENCH DOOR (L.M.I.)  
**ZELUCK INCORPORATED**  
5300 KINGS HIGHWAY  
BROOKLYN, N.Y. 11234-9011  
TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	no	date	description
	C	10.06.01	REV. PER BCCO COMMENTS
	D	08.07.06	UPDATED FOR 2004 FBC
	E	11.17.06	REV. PER BCCO COMMENTS
	F	07.11.07	GENERAL REV.
	G	12.03.08	UPDATED FOR 2007 FBC

date: 10-30-09  
scale: 3/8"=1'-0"  
dr. by: HAMID  
chk. by:  
drawing no.  
**W97-34**  
sheet 1 of 6


CLUSTER OF ANCHOR AT MTG. STILE ENDS  
 AT 3" O.C.  
 AT TOP & BOTTOM  
 (3) REQD. FOR DOORS UPTO 9 FT. HIGH  
 (4) REQD. FOR DOORS OVER 9 FT. HIGH.

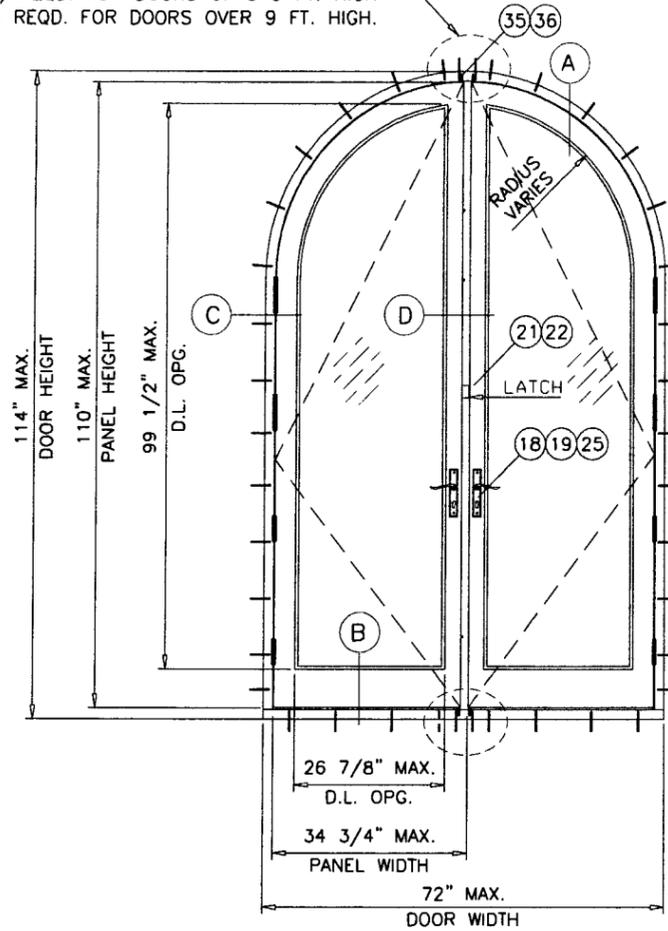

XX

TYPICAL ELEVATION

CLUSTER OF ANCHOR AT MTG. STILE ENDS  
 AT 3" O.C.  
 AT TOP & BOTTOM  
 (3) REQD. FOR DOORS UPTO 9 FT. HIGH  
 (4) REQD. FOR DOORS OVER 9 FT. HIGH.

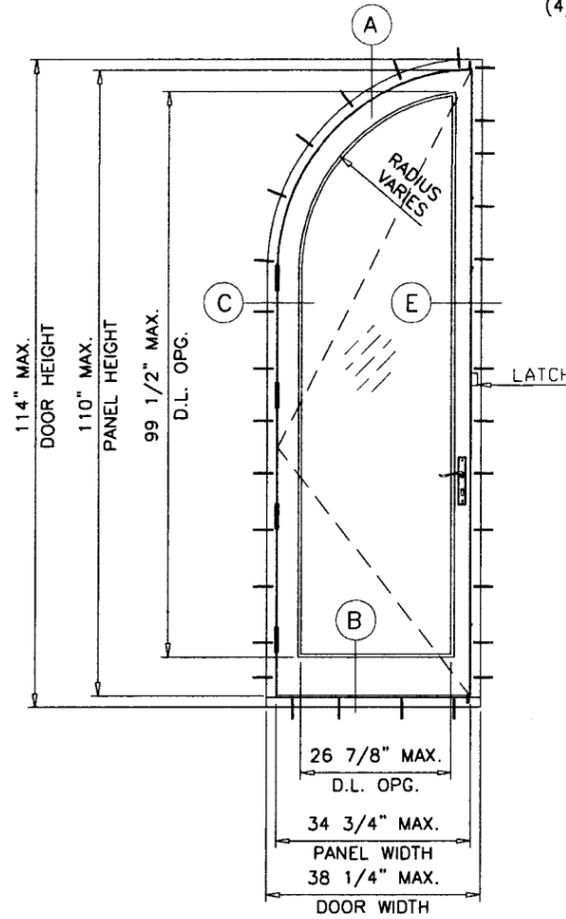

X

MAXIMUM DESIGN LOAD RATING = + 60.0 PSF  
 (FOR SIZES SHOWN OR SMALLER) - 60.0 PSF


SEE SHEET 1 FOR TYPICAL ANCHOR SPACING

NOTE:  
 GLASS CAPACITIES ON THIS SHEET ARE  
 BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)  
 AND FLORIDA BUILDING COMMISSION  
 DECLARATORY STATEMENT DCA05-DEC-219

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538

*Any*

OCT 28 2009

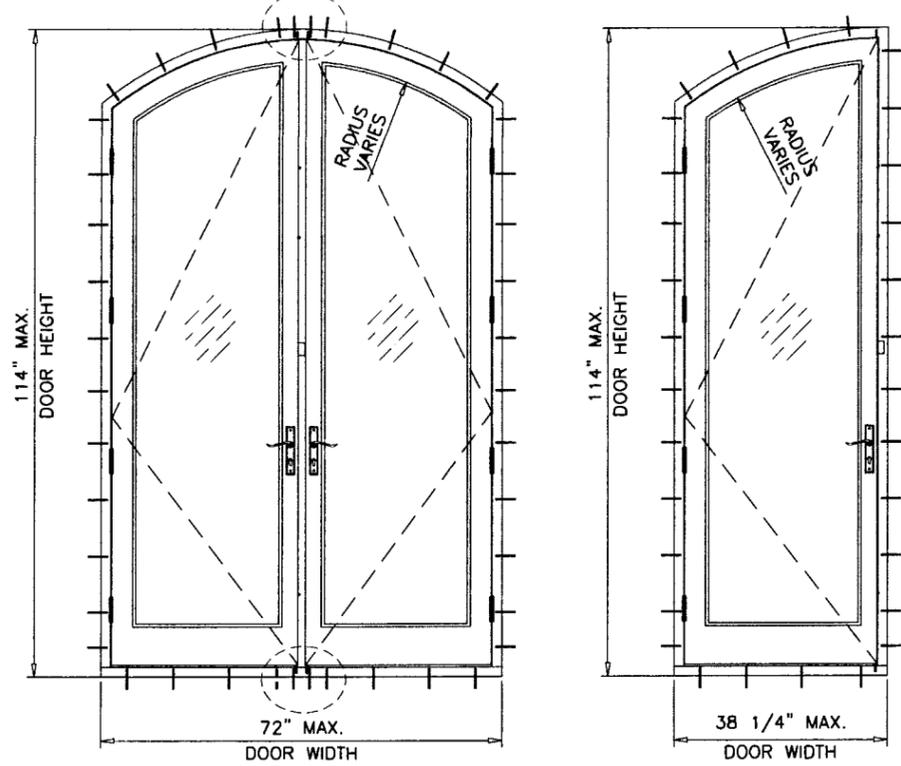

ALT. SHAPES

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 09-0720-06  
 Expiration Date NOV 22, 2011  
 By *Shag J. Chaudhry*  
 Miami Dade Product Control  
 Division

**afC**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W97-34Z1




H266 OUTSWING MAHOGANY WOOD FRENCH DOOR (L.M.I.)  
**ZELUCK INCORPORATED**  
 5300 KINGS HIGHWAY  
 BROOKLYN, N.Y. 11234-9011  
 TEL. (718) 251-8060 FAX. (718) 531-2564

no	date	description
D	08.07.06	UPDATED FOR 2004 FBC
E	11.17.06	REV. PER BCCO COMMENTS
F	07.11.07	GENERAL REV.
G	12.03.08	UPDATED FOR 2007 FBC


date:	10-30-97
scale:	3/8" = 1'-0"
dr. by:	HAMID
chk. by:	

drawing no.  
**W97-34**

sheet 2 of 6

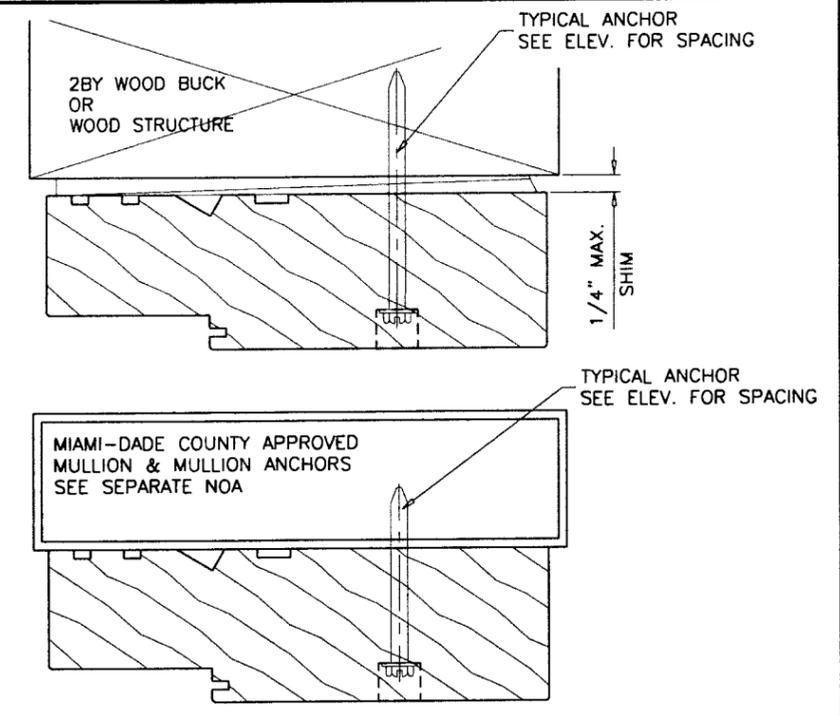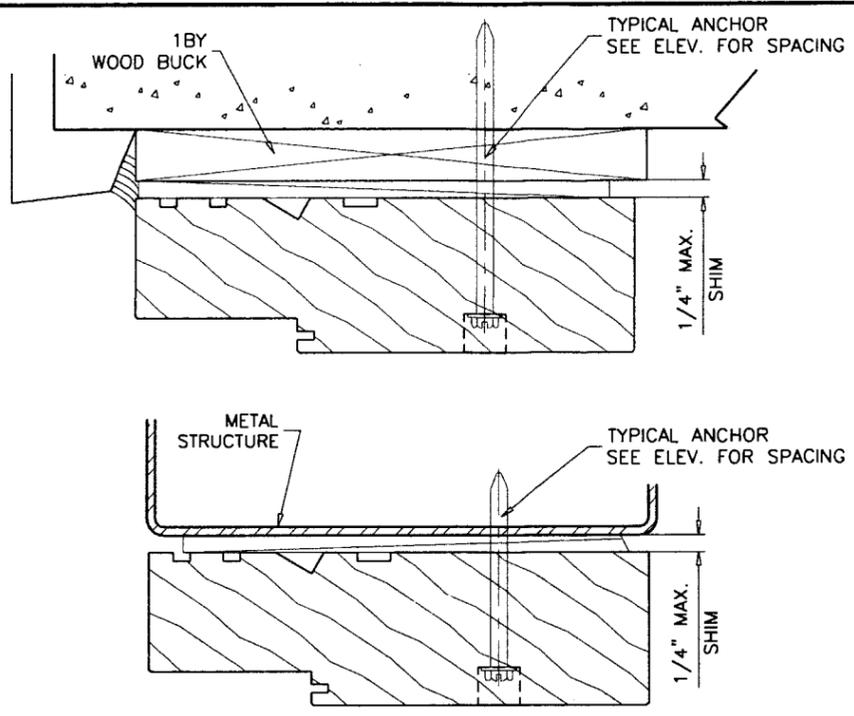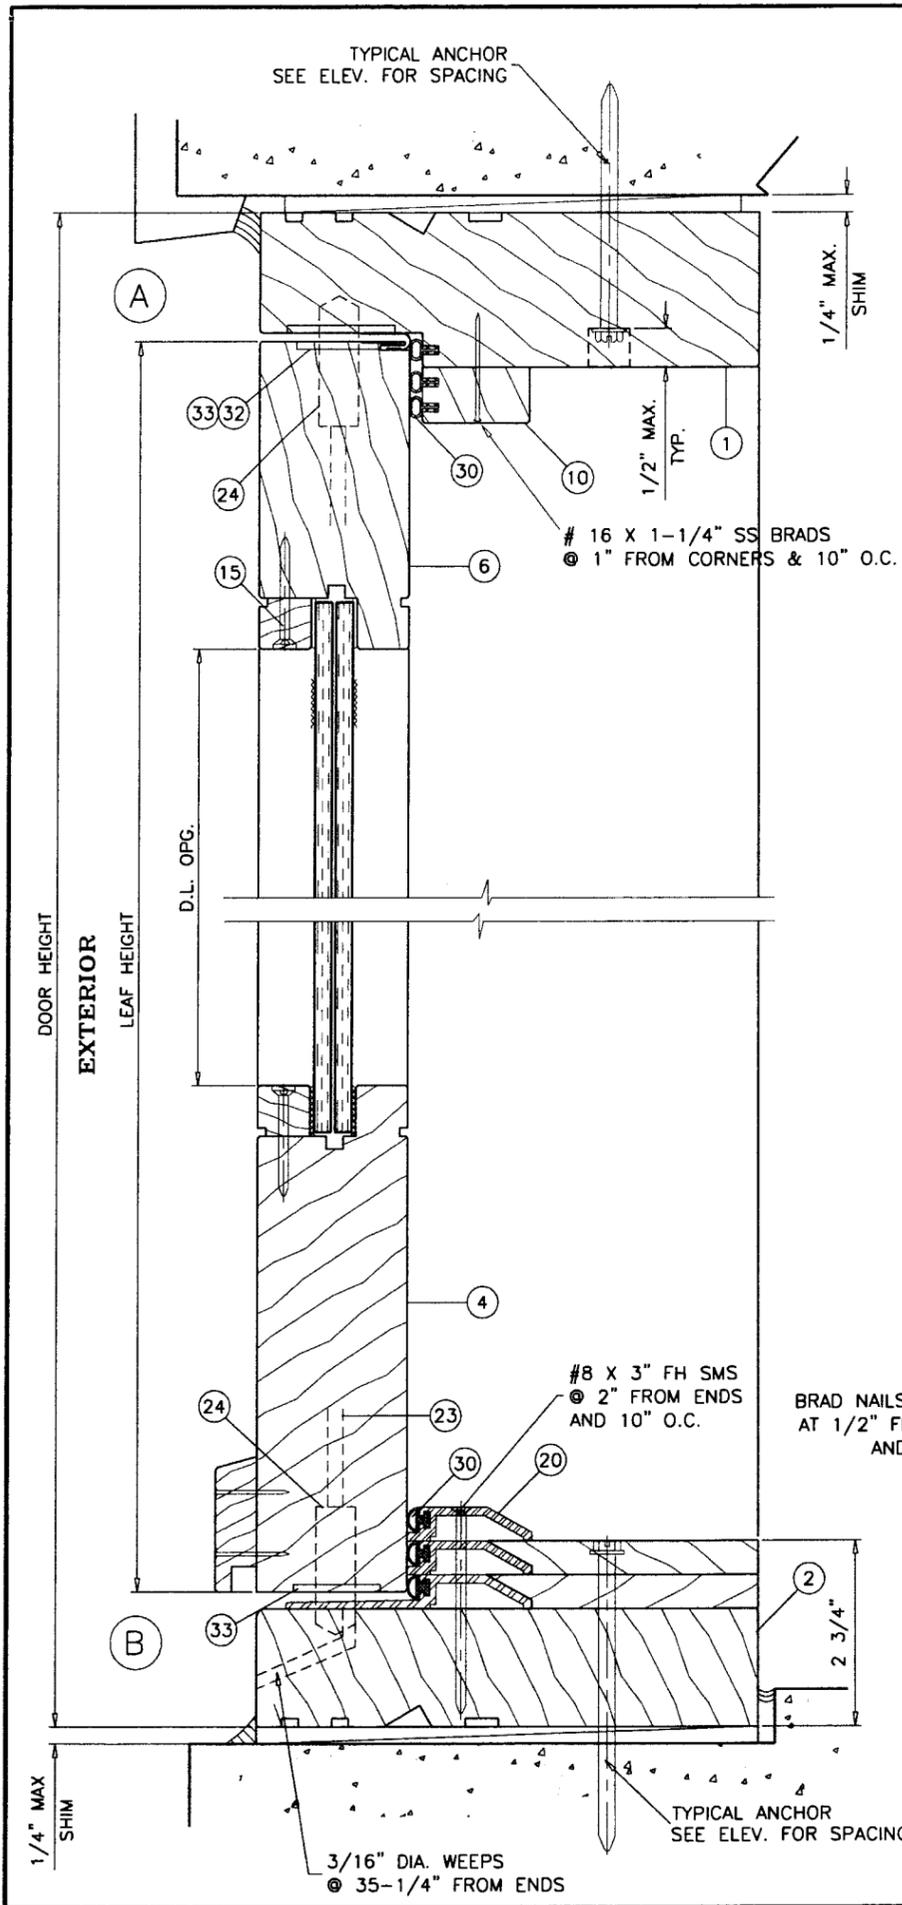

WOOD BUCKS AND METAL STRUCTURE NOT BY ZELUCK INC. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

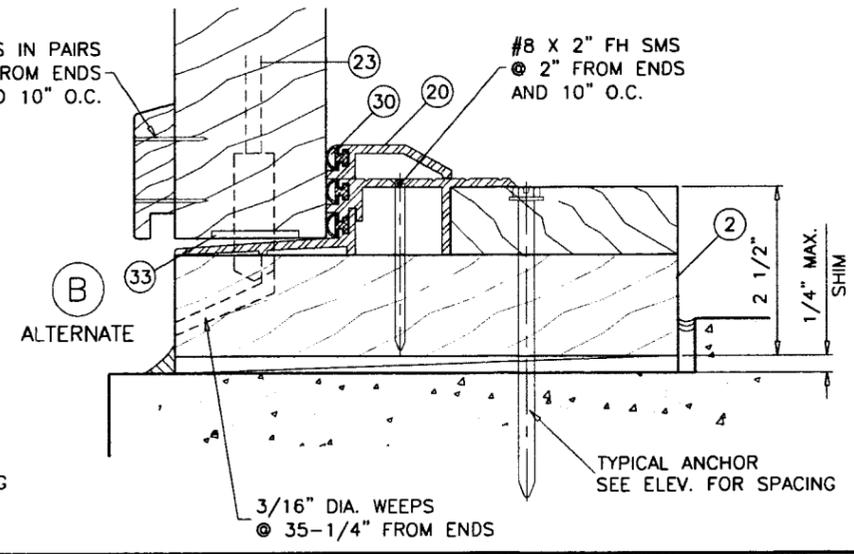

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- #14 SMS**  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-1/2" MIN. PENETRATION INTO WOOD  
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-1/2" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
- #14 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)  
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")  
 INTO METAL STRUCTURES  
 STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)  
 ALUMINUM : 1/8" THK. MIN. (6063-T6 MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**TYPICAL EDGE DISTANCE**  
 INTO CONCRETE AND MASONRY = 1-5/8" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 2730 PSI MIN.  
 MASONRY f'm = 1924 PSI MIN.

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538

*Arshad Viqar*

OCT 28 2009

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 Acceptance No. 09-0726-02  
 Expiration Date: Nov 22, 2011

*Iskander Hamid*  
 Miami Dade Product Control Division



**afC**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL W97-34Z1

H266 OUTSWING MAHOGANY WOOD FRENCH DOOR (L.M.I.)  
**ZELUCK INCORPORATED**  
 5300 KINGS HIGHWAY  
 BROOKLYN, N.Y. 11234-9011  
 TEL. (718) 251-8060 FAX. (718) 531-2564

no	date	by	description
D	08.07.06		UPDATED FOR 2004 FBC
E	11.17.06		REV. PER BCCO COMMENTS
F	07.11.07		GENERAL REV.
G	12.03.08		UPDATED FOR 2007 FBC

date: 10-30-09  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W97-34**  
 sheet 3 of 6

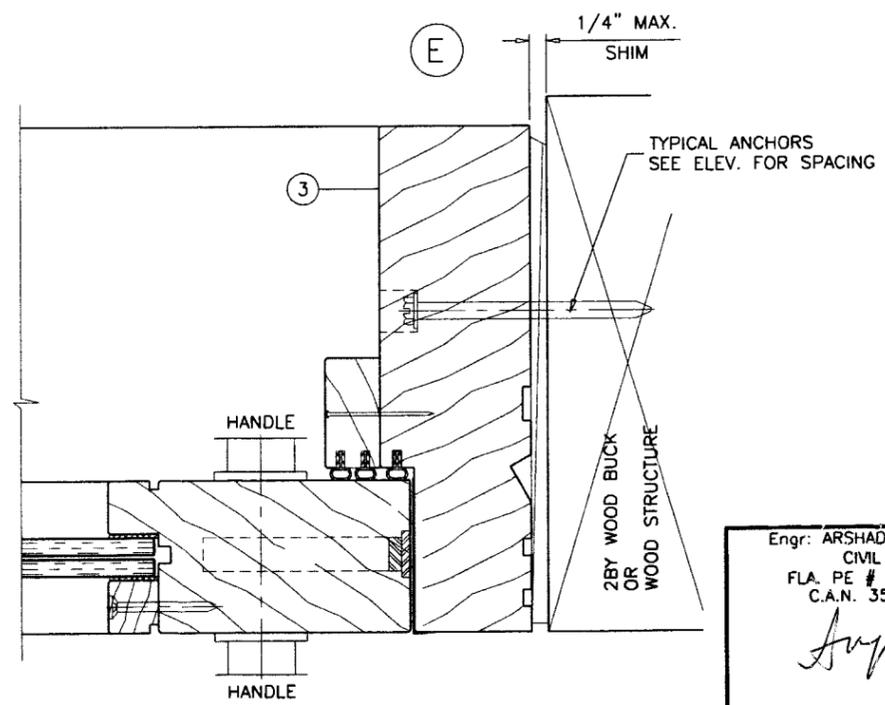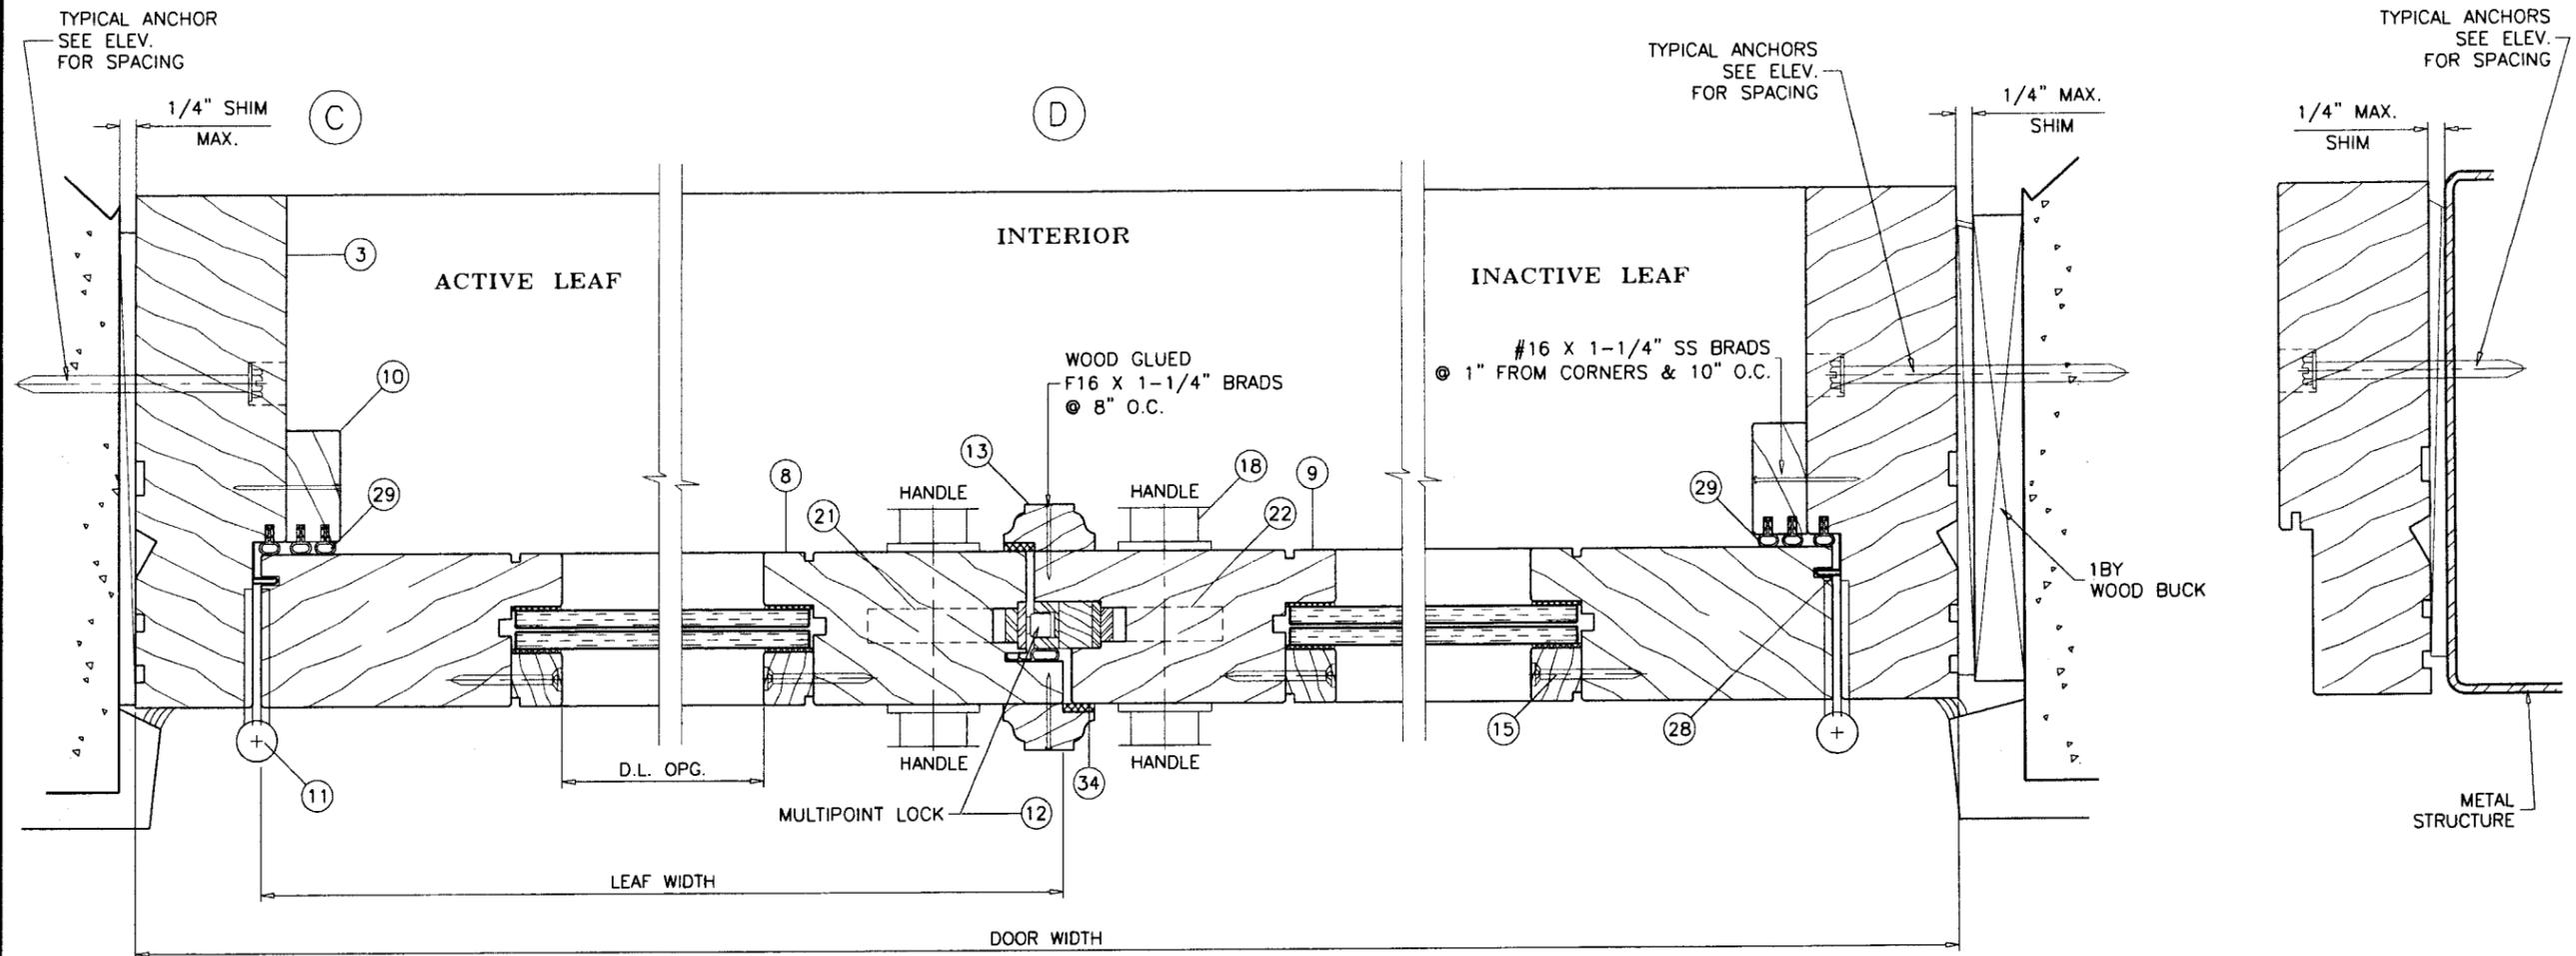

**PRODUCT REVISED:**  
 as complying with the 2004  
 Building Code  
 Acceptance No. 09-0720-05  
 Expiration Date NOV 22, 2011  
 By Iskhan I. Chaudhary  
 Miami Dade Product Control  
 Division

**HINGES:**  
 BUTT HINGES AT 8" FROM EACH END AND 28" O.C. MAX.  
 EACH HINGE SECURED TO JAMB AND HINGE STILE  
 WITH (8) #12 X 1-1/2" SCREWS.

**LOCKS:**  
 MULTI POINT LOCKING SYSTEM WITH ADJACENT KEEPERS  
 LOCKING POINTS AT 16" FROM EACH END AND 43" O.C.  
 ACTUATING HANDLE AT 42" FROM BOTTOM.  
 SHOOT BOLTS ENGAGING SIMULTANEOUSLY AT TOP AND  
 BOTTOM OF EACH LEAF.

**SEALANT:**  
 INTERIOR AND ENDS OF THRESHOLD, AND INTERIOR  
 & EXTERIOR OF GLAZING SEALED WITH SILICONE SEALANT

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538

*Arshad*

OCT 28 2009

**af c**

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W97-34Z

H266 OUTSWING MAHOGANY WOOD FRENCH DOOR (L.M.I.)

**ZELUCK INCORPORATED**  
 5300 KINGS HIGHWAY  
 BROOKLYN, N.Y. 11234-9011  
 TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	no	date	by	description
	D	08.07.06		UPDATED FOR 2004 FBC
	E	11.17.06		NO CHANGE THIS SHEET
	F	07.11.07		GENERAL REV.
	G	12.03.08		UPDATED FOR 2007 FBC

date: 10-30-97  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W97-34**

sheet 4 of 6

ITEM NO.	QTY.	PART NO.	DESCRIPTION	REMARKS/SUPPLIER
1	1	-	FRAME HEAD (WOOD)	
2	1	-	FRAME SILL (WOOD)	
3	2	-	FRAME JAMB (WOOD)	
4	-	-	MOVING HORIZ. BOTT. RAIL (WOOD)	(1) @ BOTT. OF EA. MOVING PANEL
6	-	-	TOP MOVING RAIL (WOOD)	(1) @ TOP OF EA. MOVING PANEL
8	-	-	ACTIVE LOCK STILE (WOOD)	(1) @ EA. MOVING PANEL
9	1/	-	INACTIVE LOCK STILE (WOOD)	(1) @ EA. FIXED PANEL
10	AS REQD.	-	DOOR STOP (WOOD)	-
11	SEE SHEET 1	Z 4.5 BBBH	4-1/2" X 4-1/2" BALL BEARING BUTT HINGE (BRASS)	ZELUCK
12	SEE SHEET 1	-	MULTI POINT LOCK (ZINC CHRMT'D STEEL)	-
13	1/	-	ASTRAGAL (WOOD)	-
15	-	-	# 8 X 1-1/2" WOOD SCREWS	@ 10" O.C.
17	-	-	# 8 X 4" DRYWALL SCREWS	@ 12" O.C.
18	1/	Z/455 38X220 OC	DOOR HANDLE (SOLID BRASS)	ZELUCK
19	1/	B8809 0064	EUROPEAN PROFILE CYLINDER KEY/KNOB	BKS
20	1	Z 0-0	SOLID BRONZE SADDLE	ZELUCK
21	1	2684	ACTIVE DOOR LOCKING GEAR (ZINC CHRMT'D STEEL)	GU
22	1	2582	INACTIVE DOOR LOCKING GEAR (ZINC CHRMT'D STEEL)	GU
23	1/	1197	LOCKING GEAR EXTENSION (ZINC CHRMT'D STEEL)	GU
24	2/	M5Z1696	SHOOT BOLTS (ZINC CHRMT'D STEEL)	AT TOP & BOTTOM OF LEAF
25	1/	6826-2889	HANDLE SPINDLE (ZINC CHRMT'D STEEL)	GU
26	AS REQD.	ACC # 7	FRAME BRONZE HOOK W'STRIPPING	ACCURATE
27	AS REQD.	ACC # 8	DOOR BRONZE FLAT W'STRIPPING	ACCURATE
28	AS REQD.	ACC # 17	FRAME BRONZE HOOK W'STRIPPING	ACCURATE
29	2/	46-54183	FRAME LEG W'STRIPPING - EPDM (NEOPRENE)	VARNAME
30	1/	46-54183	FRAME HEAD W'STRIPPING - EPDM (NEOPRENE)	VARNAME
31	AS REQD.	NO. 10-UP	BRONZE NAILS FOR BRONZE W'STRIPPING	ACCURATE
32	1/	2. 0X8 0X0 .125	BRONZE SHOOT BOLT KEEPER	ZELUCK
33	2/	1.75X3 00X0 .125	BRONZE SHOOT BOLT HOUSING	ZELUCK
34	AS REQD.	44-00030	W'STRIPPING FOR ASTRAGAL (NEOPRENE)	VARNAME
35	-	NO. E-11637	STRIKING PLATE FOR ROLLING PIN (ZINC CHRMT'D STEEL)	GU
36	-	NO. E-11639	STRIKING PLATE FOR LATCH (ZINC CHRMT'D STEEL)	GU

**TYPICAL WOOD-HONDURES MAHOGANY LUMBER**  
 SPECIFIC GRAVITY = 0.45 MIN.  
 GRADE = 2 MIN.  
 MOISTURE CONTENT = 19% MAX.









**SILL**  
WOOD

**ASTRAGAL**  
WOOD

**DRIP CAP**  
WOOD

**SADDLE**  
BRONZE

Engr. ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538  
  
 OCT 28 2009

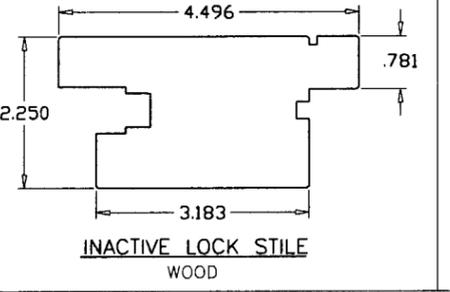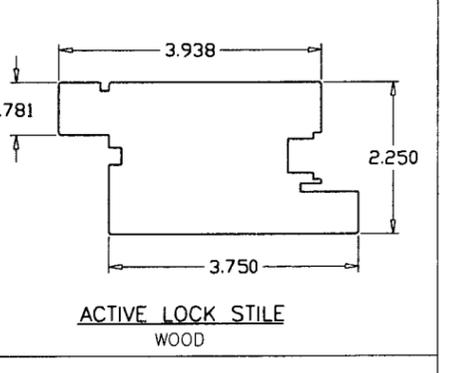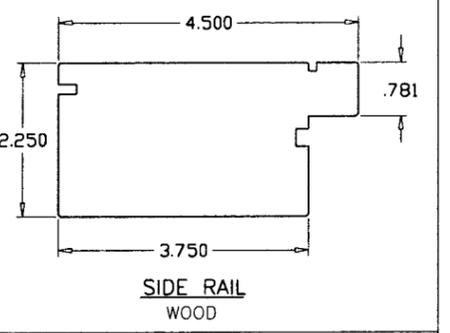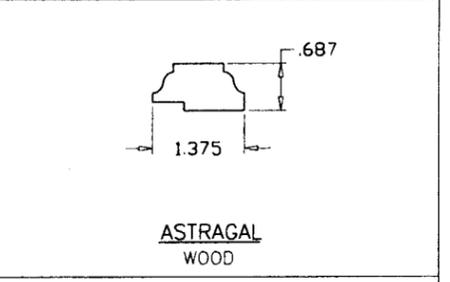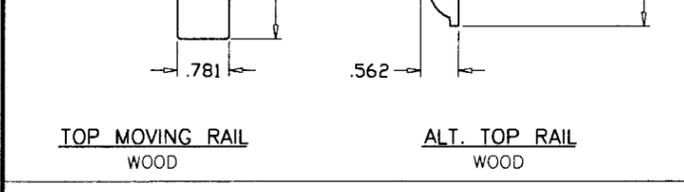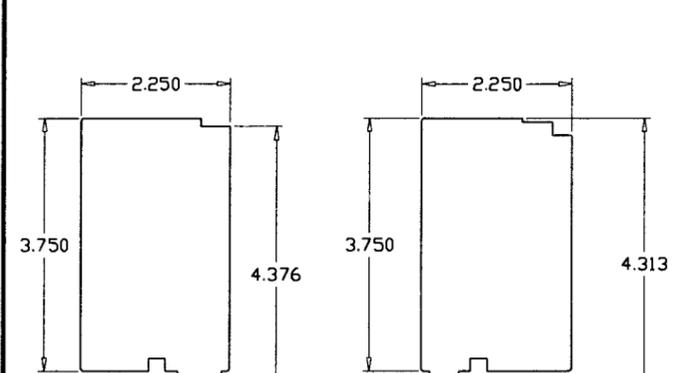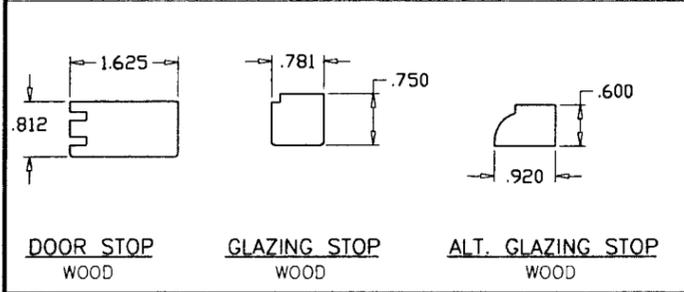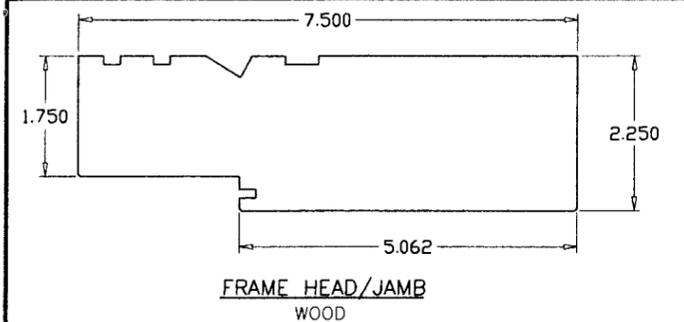


**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W97-34Z

H266 OUTSWING MAHOGANY WOOD FRENCH DOOR (L.M.I.)  
**ZELUCK INCORPORATED**  
 5300 KINGS HIGHWAY  
 BROOKLYN, N.Y. 11234-9011  
 TEL. (718) 251-8060 FAX. (718) 531-2564

no	date	by	description
D	08.07.06		UPDATED FOR 2004 FBC
E	11.17.06		NO CHANGE THIS SHEET
F	07.11.07		GENERAL REV.
G	12.03.08		UPDATED FOR 2007 FBC


date: 10-30-97  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:  
 drawing no. **W97-34**  
 sheet 5 of 6

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No 09-0720-05  
 Expiration Date NOV 22, 2011  
 By Iskander I. Hamid  
 Miami Dade Product Control  
 Division

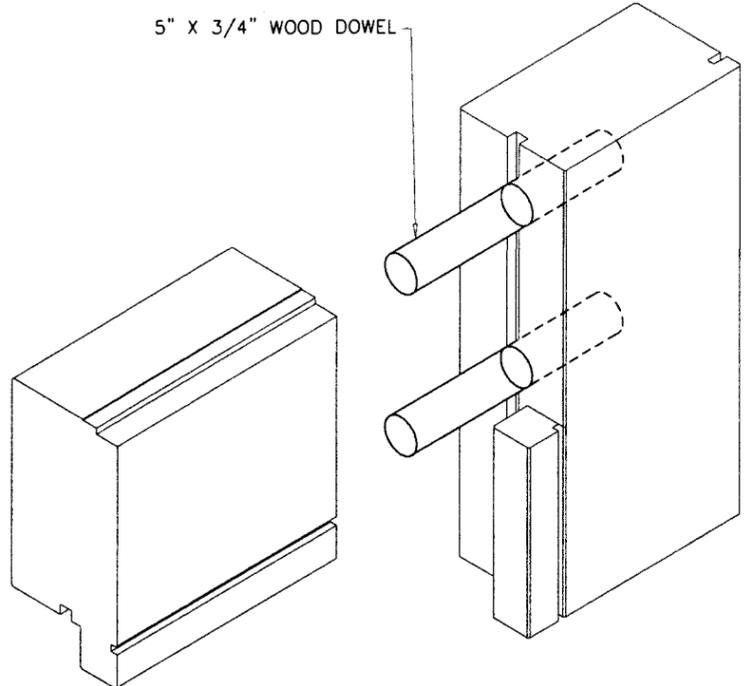


PANEL TOP CORNER

PANEL CORNERS & DOWELS SEALED/GLUED WITH 'PHENYL RESORCINOL' WATER PROOF ADHESIVE

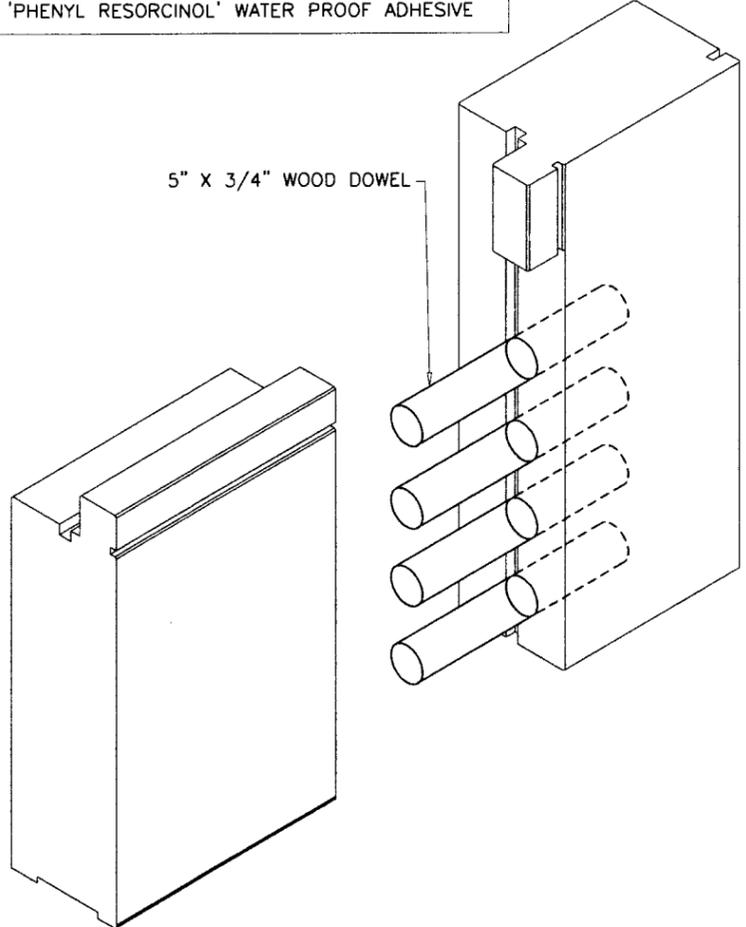


PANEL BOTTOM CORNER


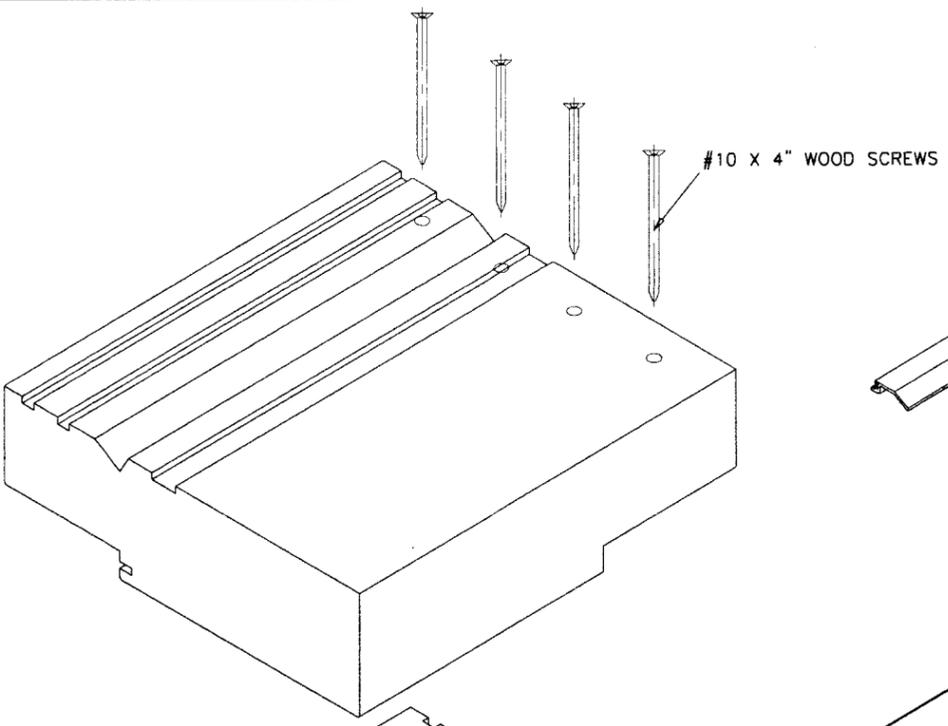


FRAME TOP CORNER

FRAME CORNERS SEALED WITH 'SIKAFLEX 1A' SEALANT

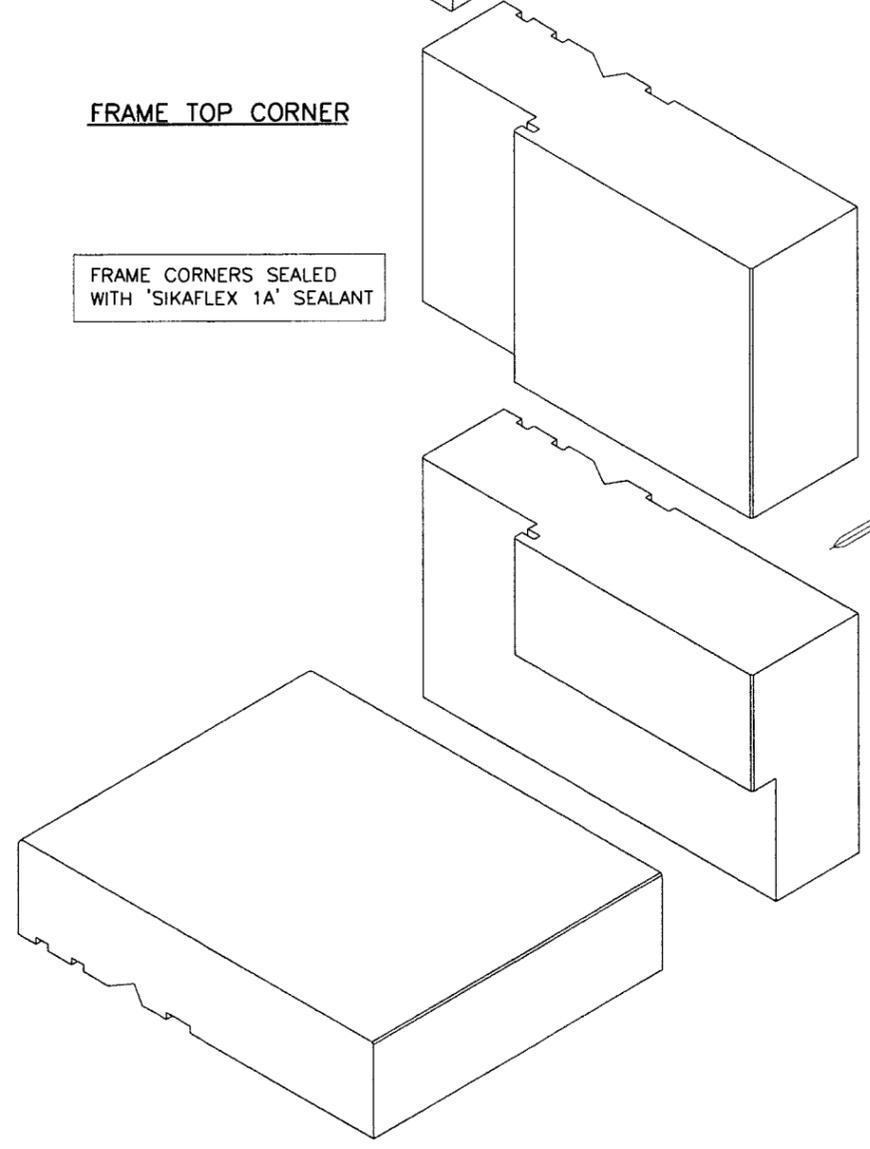

FRAME BOTTOM CORNER

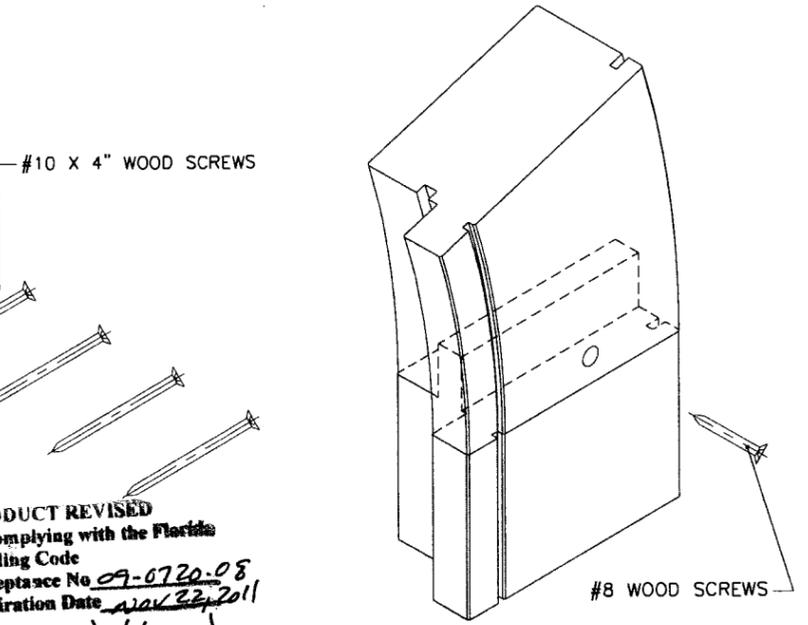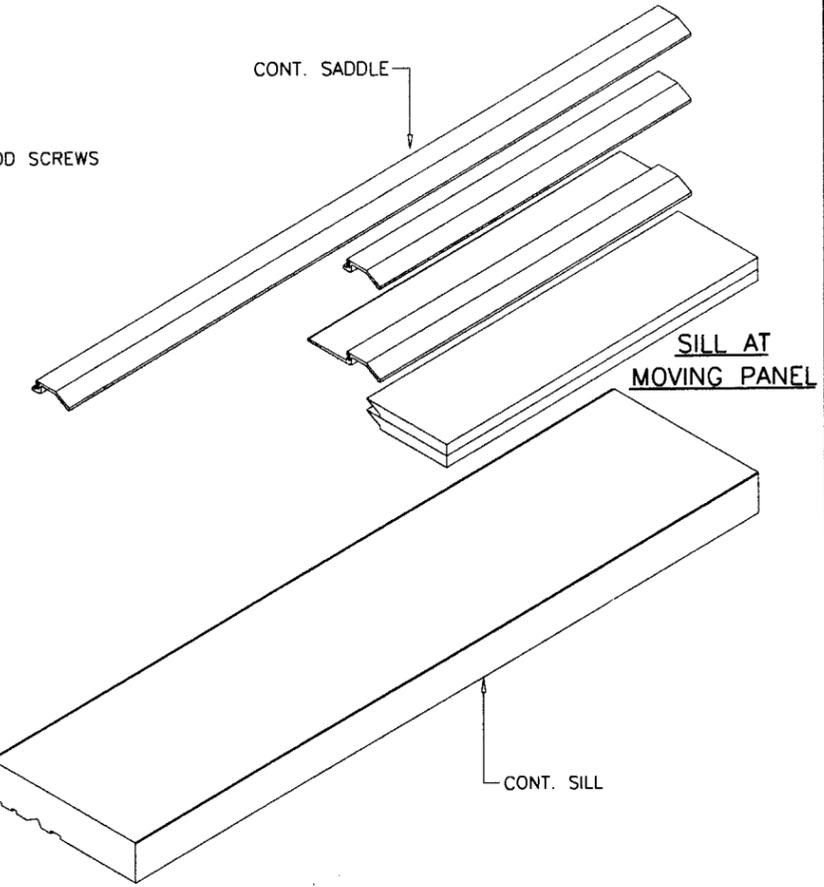

RADIAL HEAD PANEL JOINT

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 09-0720-08  
 Expiration Date 12/22/2011  
 By: *Khair J. Choudhury*  
 Product Control  
 Division

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538  
*Arq*  
 OCT 28 2009

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL W97-34Z1

H266 OUTSWING MAHOGANY WOOD FRENCH DOOR (L.M.I.)  
**ZELUCK INCORPORATED**  
 5300 KINGS HIGHWAY  
 BROOKLYN, N.Y. 11234-9011  
 TEL. (718) 251-8060 FAX. (718) 531-2564

no	date	by	description
D	08.07.06		UPDATED FOR 2004 FBC
E	11.17.06		NO CHANGE THIS SHEET
F	07.11.07		GENERAL REV.
G	12.03.08		NO CHANGE THIS SHEET

date: 10-30-97  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W97-34**  
 sheet 6 of 6