



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.buildingcodeonline.com**

NOTICE OF ACCEPTANCE (NOA)

**CGI Windows & Doors
10100 N. W. 25th Street
Miami, Fl. 33172**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "450" Outswing Aluminum Door w/wo Sidelites - Impact

APPROVAL DOCUMENT: Drawing No. **W98-01**, titled "Series 450 Doors & Sidelites", sheets 1, 1.1 through 7.1 of 7.1, prepared by Al-Farooq Corporation, dated 10/20/97 and last revised on July 14, 2009, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

Limitations:

1. See sheets 6 & 7 for unit sizes, anchors and design pressure ratings
2. For mulled units lower design pressure of doors or mullion shall control.
3. 1x or 2x bucks to be properly secured to transfer the imposed loads.
4. Doors with saddle threshold (SS) is not approved for water rating.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # **06-0127.02** and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**



9/1/19

**NOA No. 09-0723.04
Expiration Date: November 09, 2011
Approval Date: September 23, 2009
Page 1**

CGI Windows & Doors

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED




- A. DRAWINGS** (transferred from file # **06-0127.02**)
1. Manufacturer's die drawings and sections.
 2. Drawing No. **W98-01**, titled "Series 450 Doors & Sidelites", sheets 1, 1.1 through 7.1 of 7.1, prepared by Al-Farooq Corporation, dated 10/20/97 and last revised on July 14, 2009, signed and sealed by Arshad Viqar, P.E.
- B. TESTS** (transferred from file # **06-0127.02**) Original test conducted per FBC, PA 201, 202 & 203-94 now known as FBC, TAS 201, 202 & 203-94.
1. Test report on
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per PA 202-94.
 - 4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
 - 5) Large Missile Impact Test per SFBC and PA201-94
 - 6) Cyclic Wind Pressure Loading per SFBC and PA203-94Along with manufacturer's parts and section drawing marked-up drawings of an aluminum In/out swing door w/sidelites, by Hurricane Testing Laboratory, Inc., Test Report No. **HTL-97055 (0080-912-97)** dated 09/23/97 thru 02/27/98 for specimen #1, 2, 3, 4 tested per PA202-94, specimen #4, 5A, 5B, 5C tested per PA201-94 & PA203-94, signed and sealed by Timothy S. Marshall, P.E.
 2. Additional test report on
 - 1) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 2) Large Missile Impact Test per SFBC, PA201-94
 - 3) Cyclic Wind Pressure Loading per SFBC, PA 203-94Along with manufacturer's parts and section drawing marked-up drawings of aluminum out swing door w/sidelites, by Hurricane Testing Laboratory, Inc., Test Report No. **HTL-01071 (0080-0402-02)** dated 04/01/20028 tested per PA201-94 & PA203-94, signed and sealed by Vinu Abraham, P.E.
- C. CALCULATIONS**
1. Anchor verification calculations, complying w/ FBC 2007, prepared by Al-Farooq Corporation, dated July 14, 2009, signed and sealed by Arshad Viqar, P.E.
 2. Glazing complies with ASTM E-1300-02 & -04
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. 09-0127.13 issued to Solutia, Inc. for "*Solutia Interlayers for laminated glass*", expiring on 04/04/2014.
- F. STATEMENTS**
1. Statement letter of conformance and "no financial interest", dated July 06, 2009, prepared by Al-Farooq Corporation, signed by Arshad Viqar, P.E.
 2. Letter of lab compliance, part of the above test reports.
- G. OTHER**
1. This NOA revises # **06-0127.02**, expiring Nov. 09, 2011.
 2. Test proposal # **09-0033**, approved on 05/09/97.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No. 09-0723.04
Expiration Date: November 09, 2011
Approval Date: September 23, 2009

TYPICAL ELEVATIONS


TYPICAL ANCHORS SPACED AS SHOWN IN DETAILS AND CHARTS.
ANCHORS TO BE AT 6" FROM CORNERS
MAX. SPACING 24" O.C. AT HEAD & SILL.

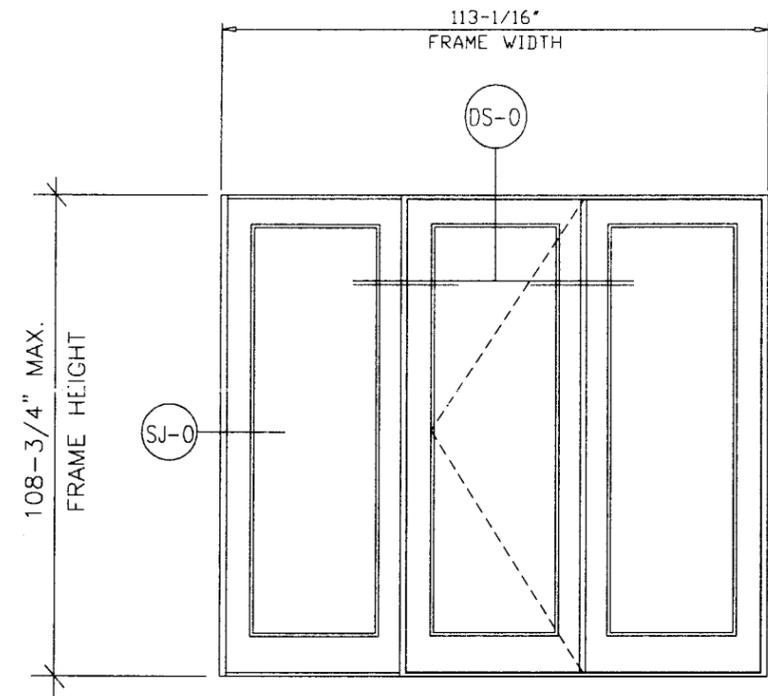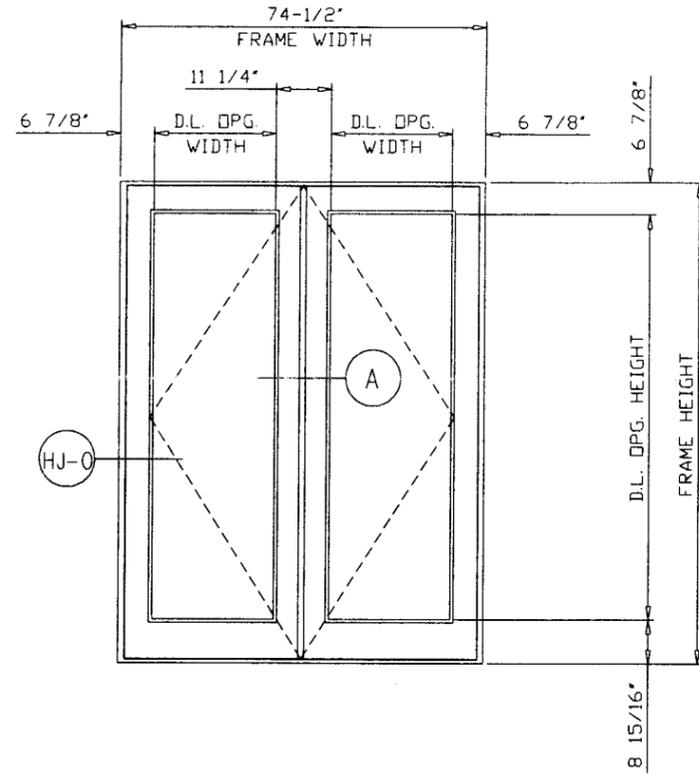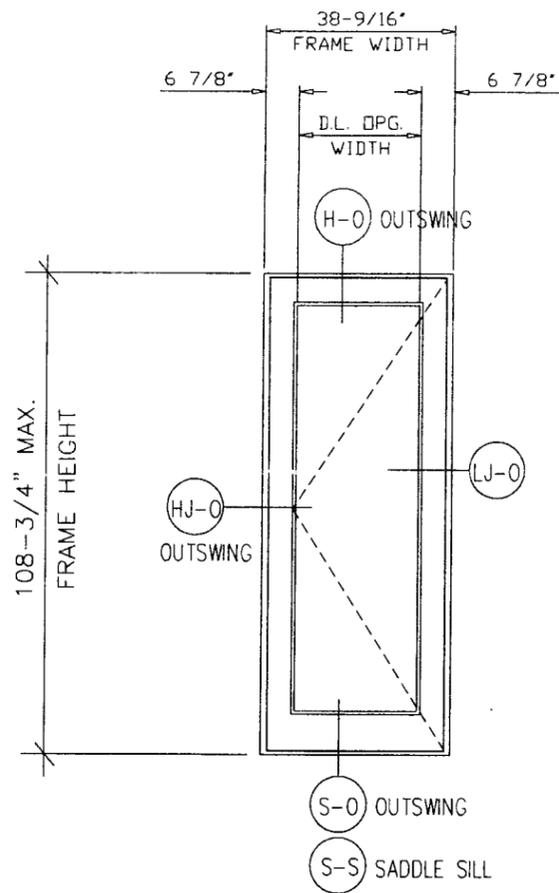

FRAME HEIGHT = PANEL HEIGHT + 1.750"
FRAME WIDTH = PANEL WIDTH + 2.750"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0723-04
Expiration Date Nov 09, 2011
By Shag I. Chand
Miami Dade Product Control
Division

STEPS TO USE CHARTS/GRAPHS
SEE SHEETS 6 & 7.

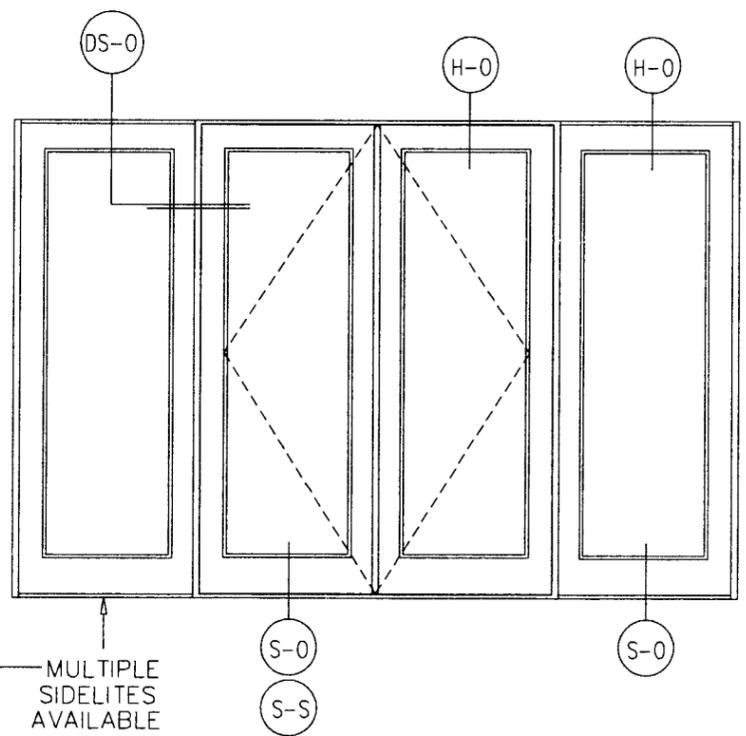

PANEL WIDTH	D.L. DPG. WIDTH
24"	12-7/8"
30"	18-7/8"
36"	24 7/8"
42"	30-7/8"

PANEL HEIGHT	D.L. DPG. HEIGHT
80"	66-1/2"
84"	70-1/2"
90"	76-1/2"
96"	82-1/2"
108"	94-1/2"

LEGEND

— O — OUTSWING DOOR DETAIL

□ — ITEM DESCRIPTION
(see sheet 2 of 7)

revisions:
A 11.01.01 CHART REV. PER ASTM E-1300 & 1997 NDS
B 11.14.02 GLASS TYPES REV.
INSUL. GLASS ADDED
C 08.05.03 NO CHANGE THIS SHEET
D 12.14.05 NO CHANGE THIS SHEET
E 10.16.06 REV. PER BCCO COMMENTS
F 07.10.09 UPDATED FOR 2007 FBC

W98-01

Engr. ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

[Signature]



JUL 14 2009

CGI
WINDOWS & DOORS
10100 northwest 25 street miami, florida 33172


product : Series 450 Outswing Doors & Sidelites

date : 10-20-97 sheet 1 of 7


TYPICAL ELEVATIONS

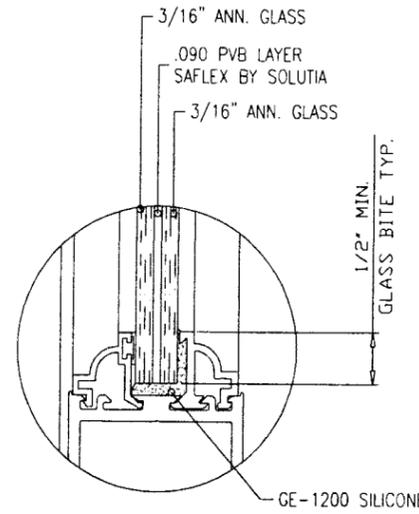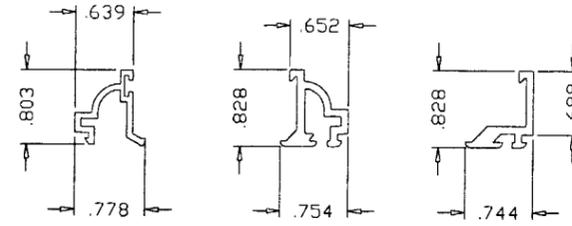

GLASS TYPE 13A

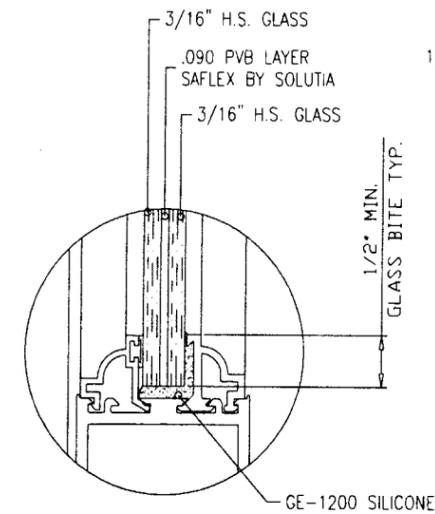


GLASS TYPE 13B

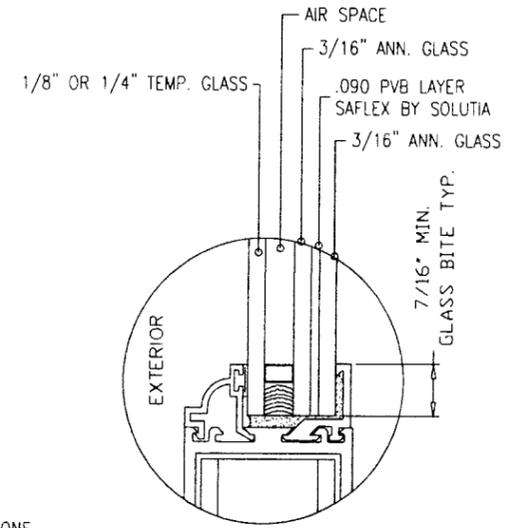


GLASS TYPE 13C


TYPICAL GLAZING DETAILS

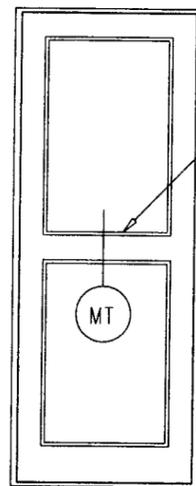


TRUE HORIZONTAL MUNTIN (1 OR MORE PER PANEL)

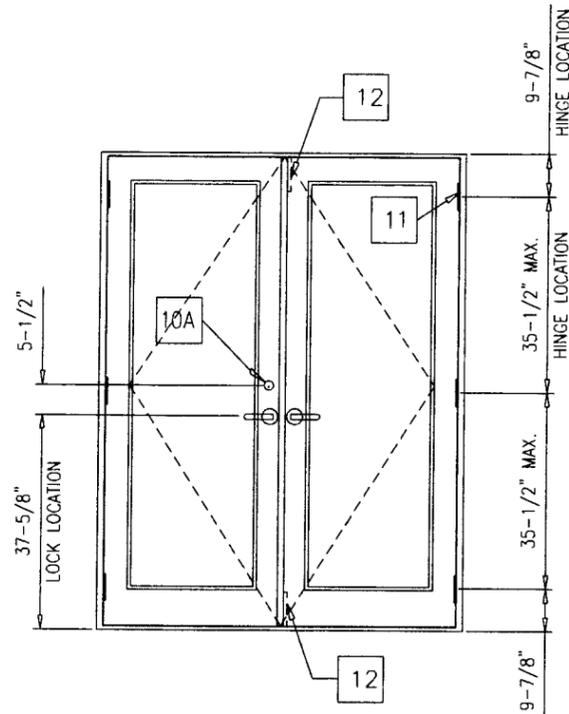

RESIDENTIAL HARDWARE

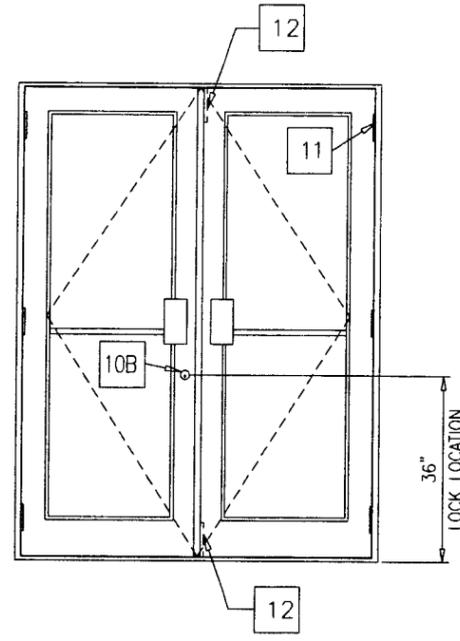

COMMERCIAL HARDWARE

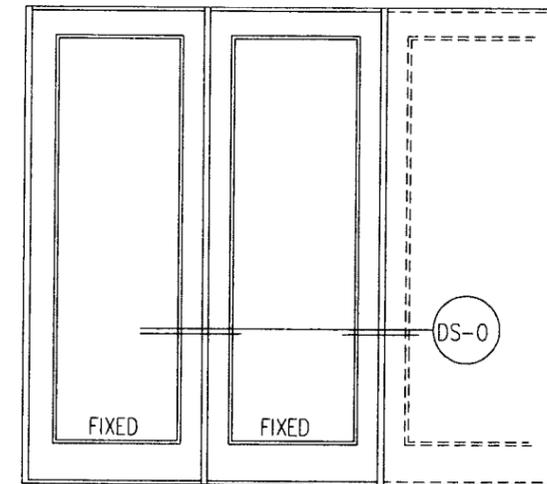

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 07-0723.04
 Expiration Date 11/09/2011
 By Ishaq I. Khan
 Miami Dade Product Control Division

LEGEND	
— 0 —	OUTSWING DOOR DETAIL
□	ITEM DESCRIPTION (see sheet 2 of 7)

HINGE LOCATIONS		
MAX. DOOR HEIGHT	NO. REQD.	MAX. SPACING
UPTO 90-3/4"	3	35 1/2"
ABOVE 90-3/4"	4	30 1/2"

OPTIONAL TRUE MUNTINS DOOR OR SIDELITE

HARDWARE DESCRIPTION

B 11.14.02 GLAZING DTL. REV.
 C 08.05.03 GLAZING DTL. ADDED
 D 12.14.05 NO CHANGE THIS SHEET
 E 10.16.06 REV. PER BCCO COMMENTS
 F 07.10.09 UPDATED FOR 2007 FBC

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

JUL 14 2009

W98-01



WINDOWS & DOORS

10100 northwest 25 street miami, florida 33172

product : Series 450 Outswing Doors & Sidelites

date : 10-20-97

sheet 1.1 of 7

BILL OF MATERIALS

ITEM	DESCRIPTION
1	#12 X 1 1/4" HEX HEAD S/S SMS (3 PER CONNECTION)
2A	3/8-16 FULLY THREADED CONTINUOUS ROD
2B	3/8-16 HEX NUT
2C	1 1/2" X 1 1/2" X 3/16"THK. ALUMINUM PLATE
3	SHEAR CLIP (EXT. NO. 506)
4	DOUBLE 9/32" DIA. JAMB INSTLL. HOLES AT 6" FROM ENDS & 24 3/16" O.C. MAX.
5	9/32" DIA. HEAD & SILL INSTLL. HOLES AT 6" FROM ENDS, 3 @ CENTER OF PAIRS SPACED 6" O.C. & 24" O.C. MAX.
6	#10 X 1" PH-PH-SS TEKS SCREW, @ 3" & 7" FROM ENDS & 24" O.C. MAX.
7	#14 X 3/4" HEX HEAD S/S TEKS SCREW AT 6" FROM ENDS & 24 3/16" O.C. MAX.
8	.320 HIGH WOOL PILE WITH CENTER FIN (ULTRAFAB # 3032)
9	.350 HIGH FOAM-TITE WEATHERSEAL (AMESBURY # 32011)
10	THREE POINT LOCK AT ACTIVE LEAF
10A	CUSTOM CGI THREE POINT LOCK MECHANISM WHICH CONSISTS OF (1) TITAN KWIKSET SERIES 780 DEADBOLT (OR EQUAL) (2) DEADBOLT LATCH (TOP & BOTTOM) AND CUSTOM CGI INTERIOR LINKAGE MECHANISM
10B	REFLECTOLITE SERIES 6000 THREE POINT LOCK MECHANISM
11	HAGER 4 1/2" X 4" SOLID BRASS (OR S/S) HINGE SECURED WITH (8) #12-24 X 1/2" BRASS F.H. M.S. (3 PER PANEL UP TO 7'-6 3/4" HIGH) (4 PER PANEL OVER 7'-6 3/4" TO 9'-0 3/4" HIGH)
12	FLUSHBOLT AT TOP & BOTTOM OF INACTIVE LEAF (DELTA MODEL 5509) WITH REINFORCED TIP

13	13A	1/2" NOMINAL (.466 ACTUAL) ANNEALED LAMINATED GLASS (2 PCS.) 3/16" THK. ANN. GLASS AND .090" SAFLEX INTERLAYER
	13B	1/2" NOMINAL (.466 ACTUAL) HEAT STREN'D LAMINATED GLASS (2 PCS.) 3/16" THK. H.S. GLASS AND .090" SAFLEX INTERLAYER
	13C	1" NOMINAL (.966 ACTUAL) INSUL. ANN. LAMINATED GLASS 1/8" TEMP. GLASS (OUTBOARD), 3/8" AIR SPACE AND (2 PCS.) 3/16" THK. ANN. GLASS AND .090" SAFLEX INTERLAYER OR 1" NOMINAL (.966 ACTUAL) INSUL. ANN. LAMINATED GLASS 1/4" TEMP. GLASS (OUTBOARD), 1/4" AIR SPACE AND (2 PCS.) 3/16" THK. ANN. GLASS AND .090" SAFLEX INTERLAYER
14		GE-1200 SILICONE
15		3/4" X 1 1/4" X 3/4" X 1/8"THK. CONTINUOUS ALUMINUM CHANNEL SECURED WITH INSTALLATION SCREWS (SEE ITEM 5)
16		1/2" THK. (nom) CUSTOM ALUMINUM PANEL CONSISTING OF (2) .090 THK. ALUM. SHEETS & (1) 1/4" PLYWOOD AT CENTER
17		1/2" X 1/2" CONTINUOUS CLOSED CELL FOAM TAPE WITH ONE SIDE ADHESIVE
18		PLASTIC WEEP BAFFLE
19		7/8" X 5" X 1/8" THK. CONTINUOUS ALUMINUM SILL ANGLE ADAPTOR

EXT. = EXTRUSION LIST 500, 501, 502, 506, 507, 508, 509, 510 & 511
ALL EXTRUSIONS ARE 6063-T6.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0723-04
Expiration Date Nov 09, 2011
By Ishaq I. Chaudhry
Miami Dade Product Control
Division

W98-01

GLASS TYPES REV.
INSUL. GLASS ADDED
NO CHANGE THIS SHEET
NO CHANGE THIS SHEET
REV. PER BICO COMMENTS
UPDATED FOR 2007 FBC

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

[Signature]
JUL 14 2009




WINDOWS & DOORS

10100 northwest 25 street miami, florida 33172

product : Series 450 Outswing Doors & Sidelites

date : 10-20-97

sheet 2 of 7

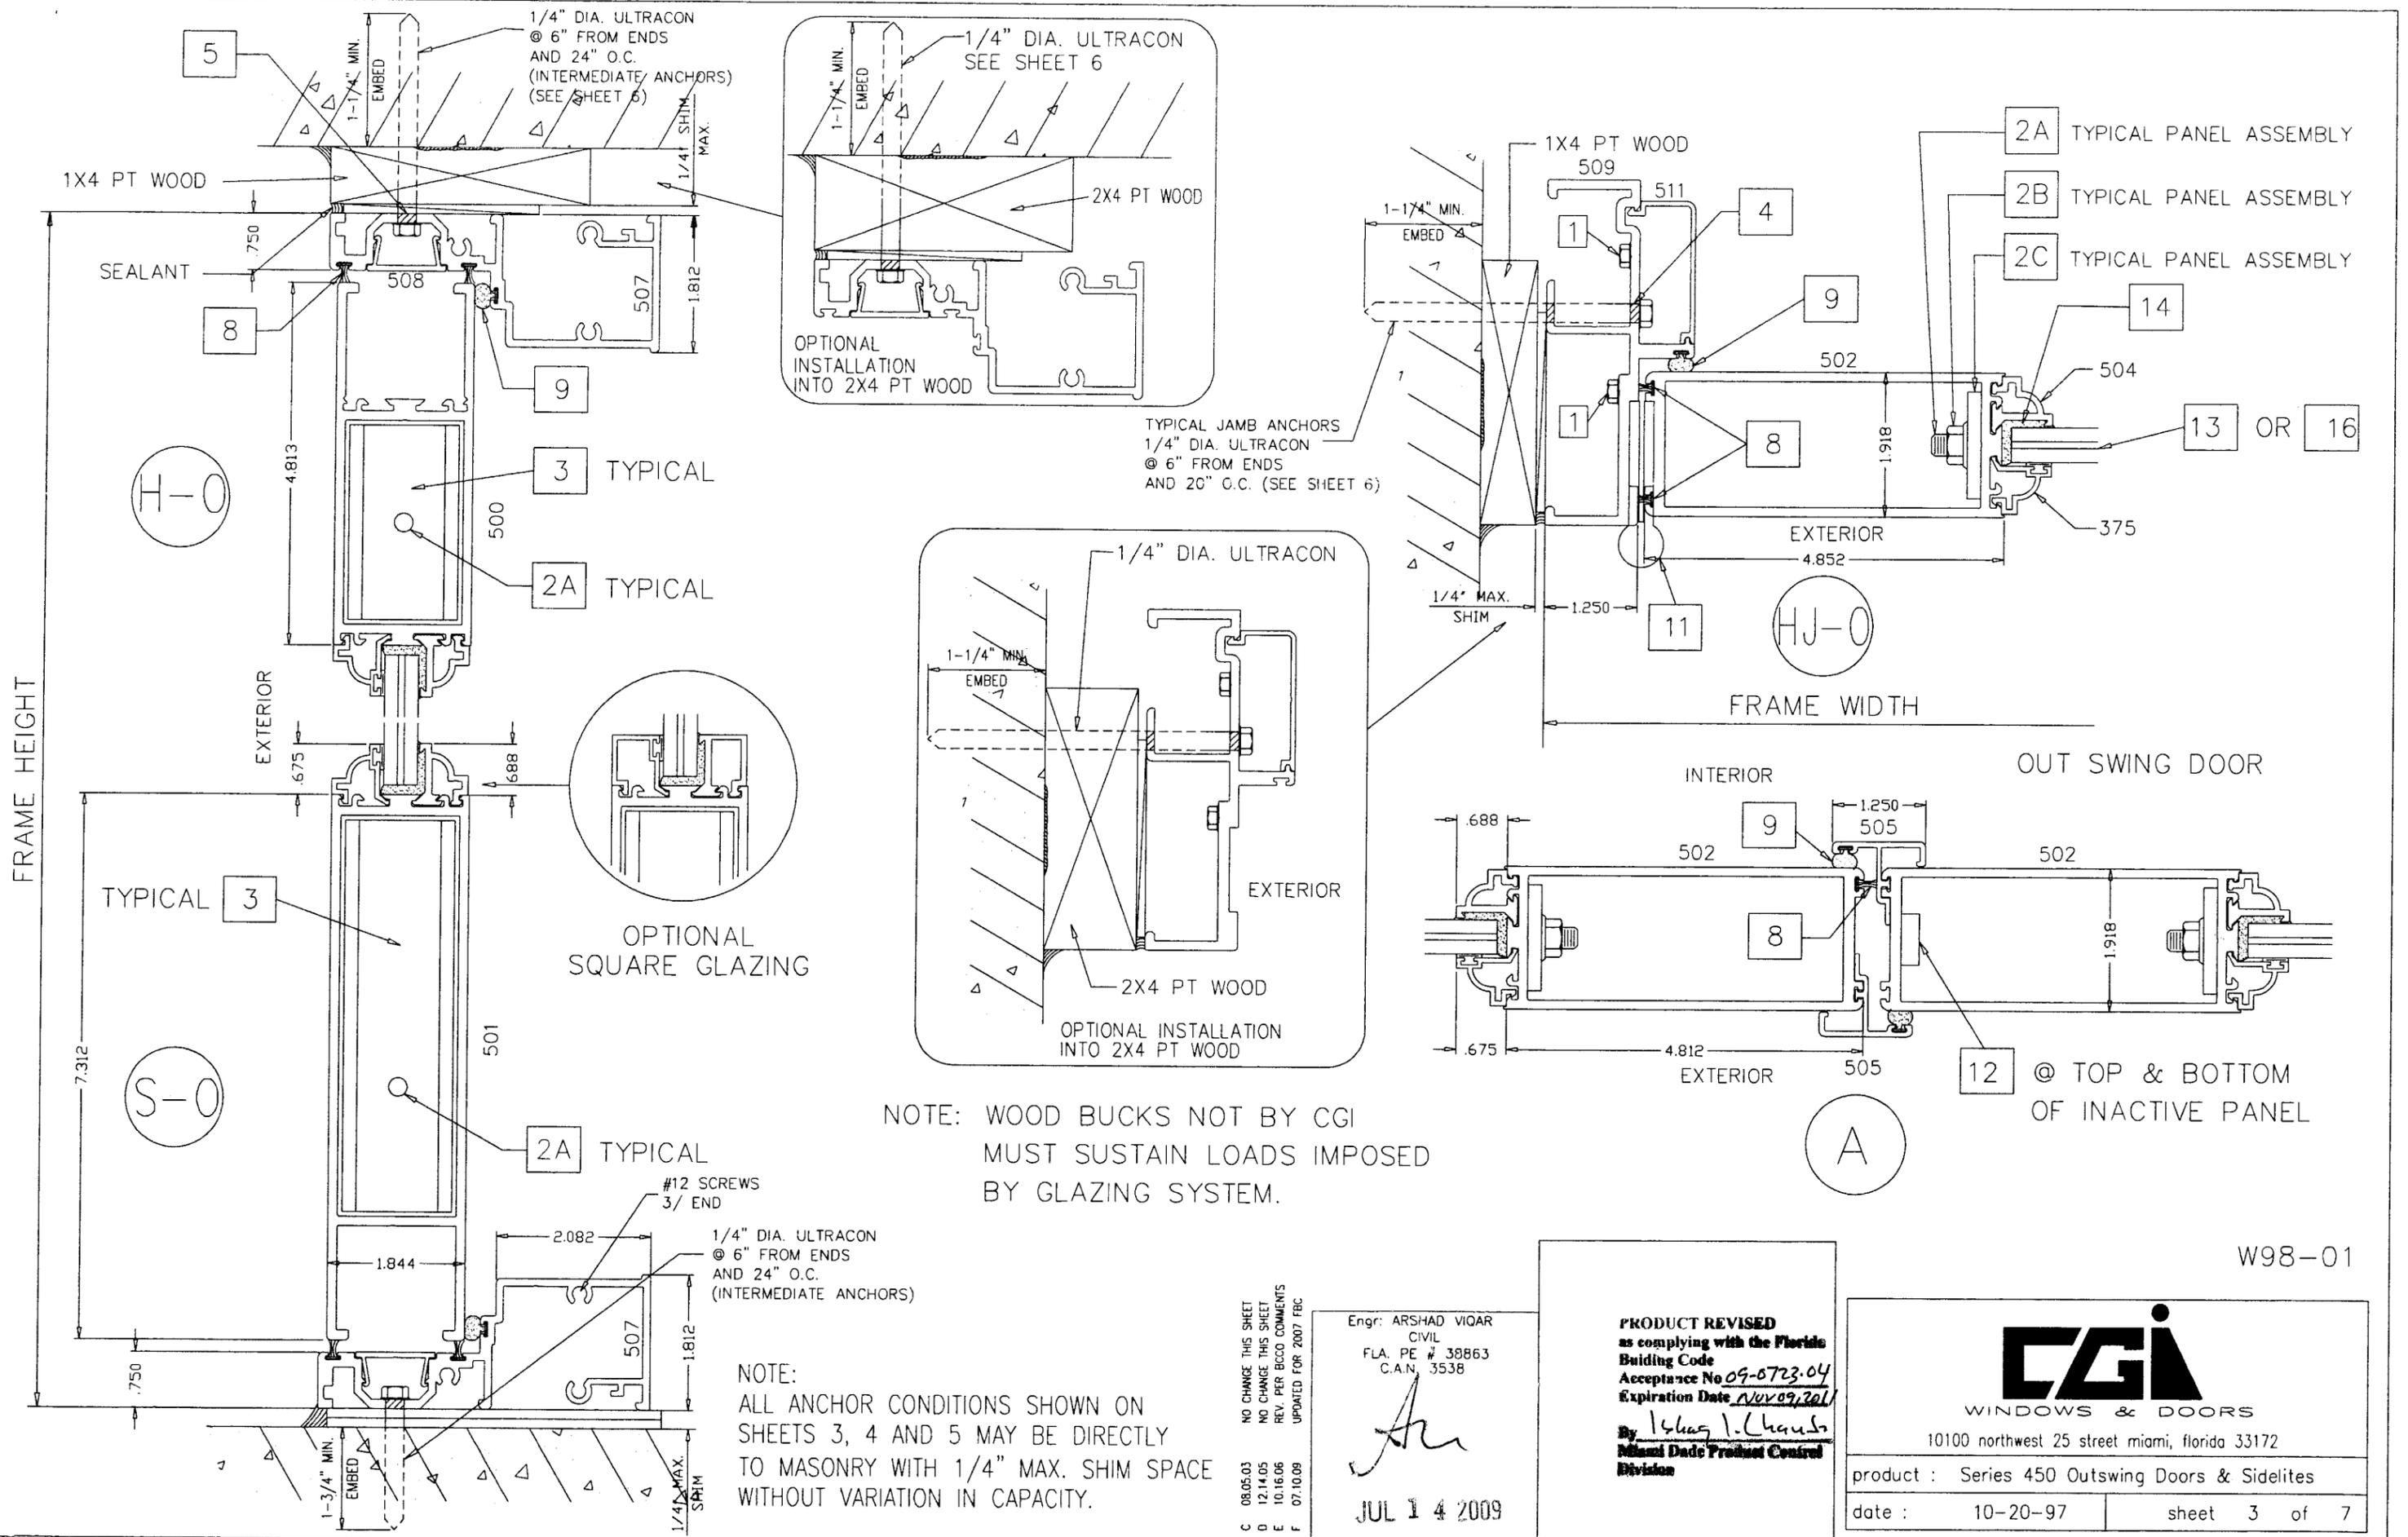

NOTE: WOOD BUCKS NOT BY CGI
MUST SUSTAIN LOADS IMPOSED
BY GLAZING SYSTEM.

NOTE:
ALL ANCHOR CONDITIONS SHOWN ON
SHEETS 3, 4 AND 5 MAY BE DIRECTLY
TO MASONRY WITH 1/4" MAX. SHIM SPACE
WITHOUT VARIATION IN CAPACITY.

C 08.05.03
D 12.14.05
E 10.16.06
F 07.10.09

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

Ar
JUL 14 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0723.04
Expiration Date Nov 09, 2011
By 16 Aug 1. Chauhan
Miami Dade Product Control
Division

W98-01





WINDOWS & DOORS

10100 northwest 25 street miami, florida 33172

product : Series 450 Outswing Doors & Sidelites

date : 10-20-97 sheet 3 of 7

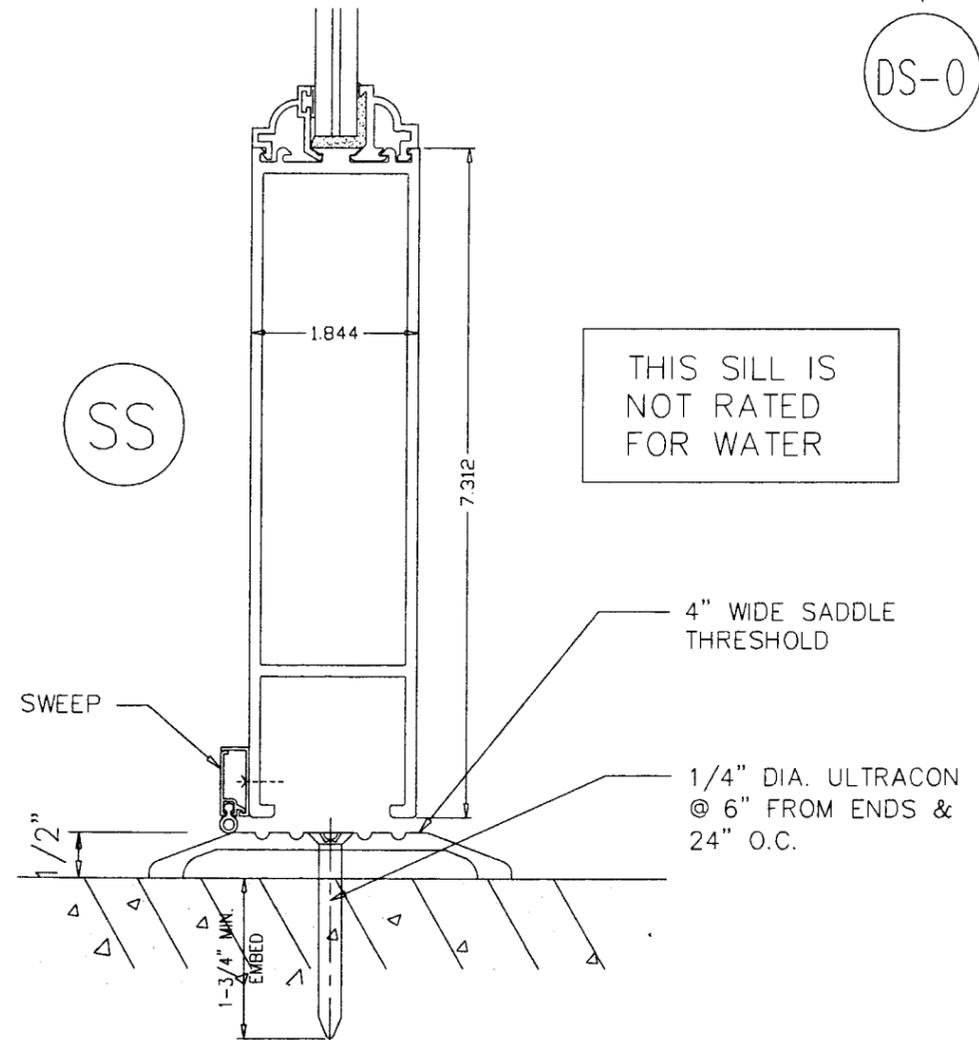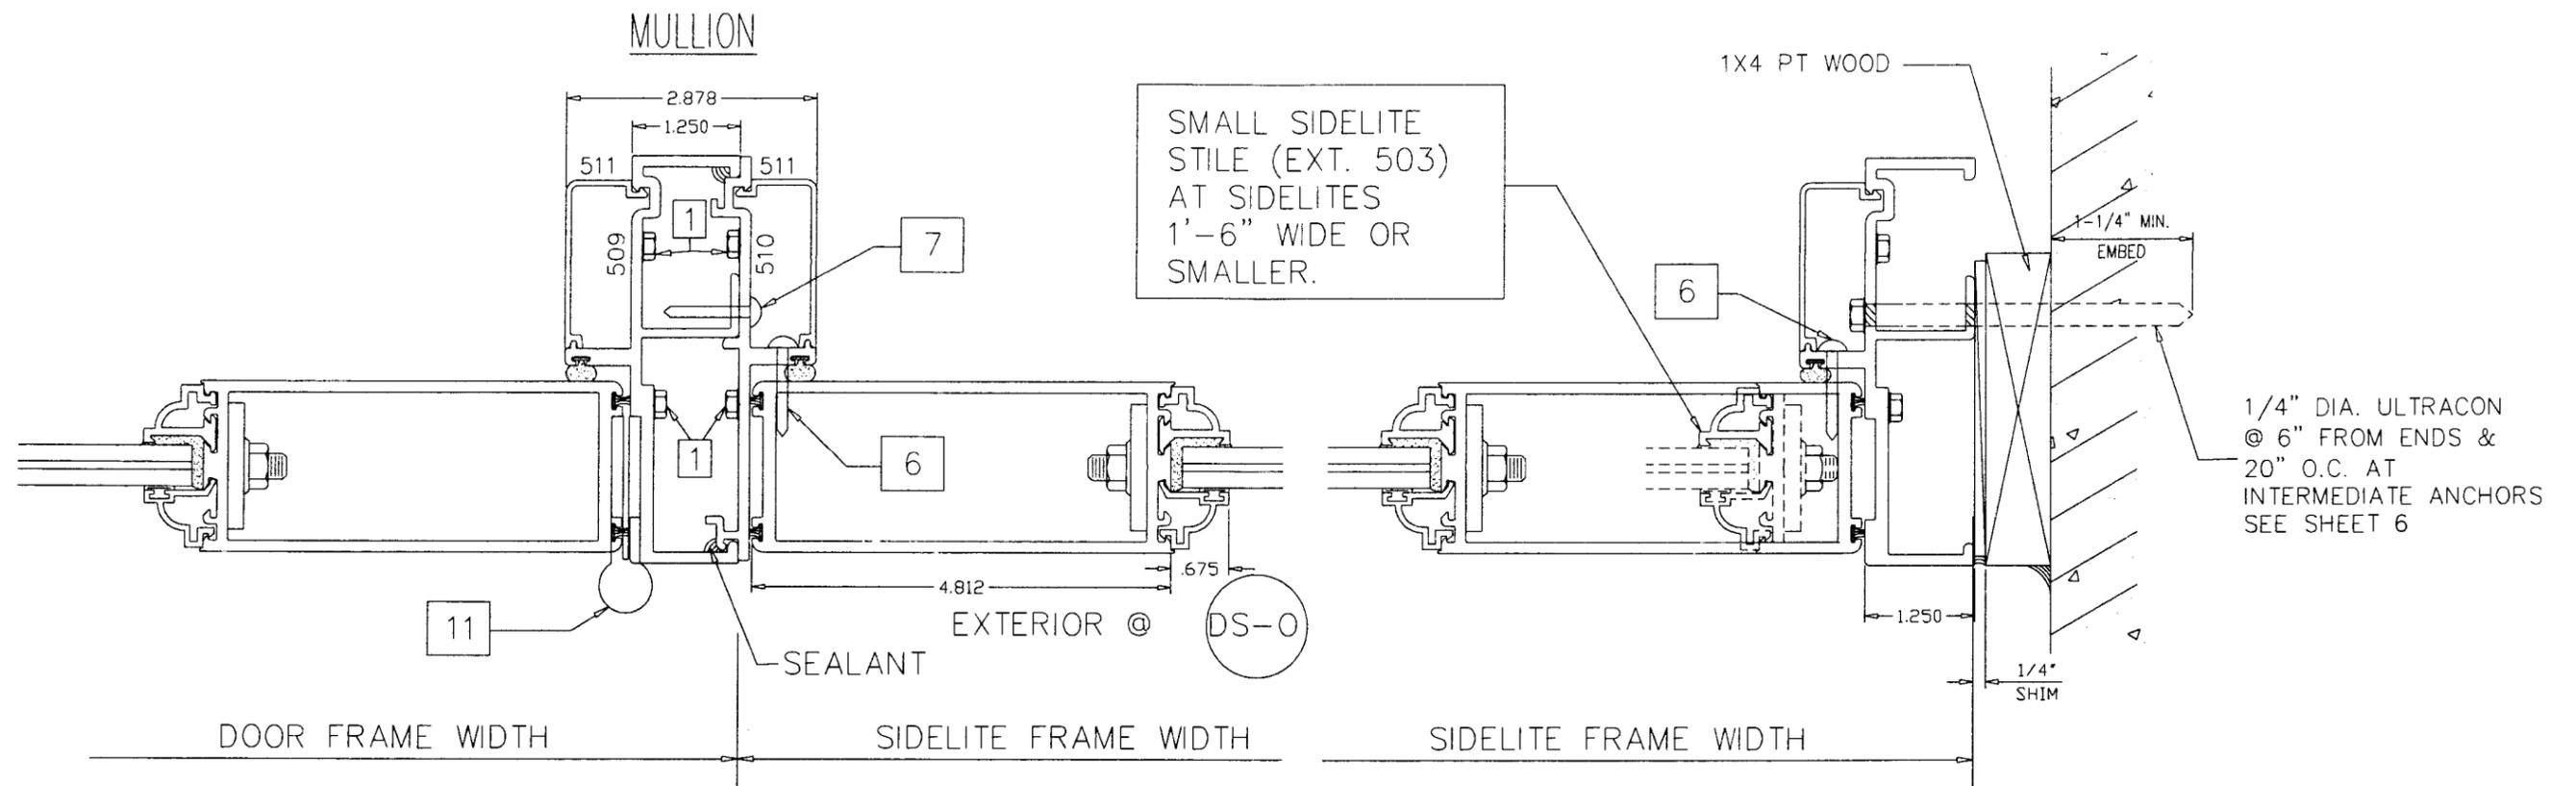

REFER TO SHEET 2 OF 7 FOR TYPICAL BILL OF MATERIALS

W98-01

B 11.14.02 GLASS TYPES REV.
C 08.05.03 INSUL. GLASS ADDED
D 12.14.05 NO CHANGE THIS SHEET
E 10.16.06 NO CHANGE THIS SHEET
F 07.10.09 REV. PER BCCO COMMENTS UPDATED FOR 2007 FBC

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

JUL 14 2009

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0723-04
Expiration Date Nov 09, 2011
By Ishag I. Chaudhry
Miami Dade Product Control
Division



WINDOWS & DOORS



10100 northwest 25 street miami, florida 33172

product : Series 450 Outswing Doors & Sidelites

date : 10-20-97

sheet 4 of 7

MT

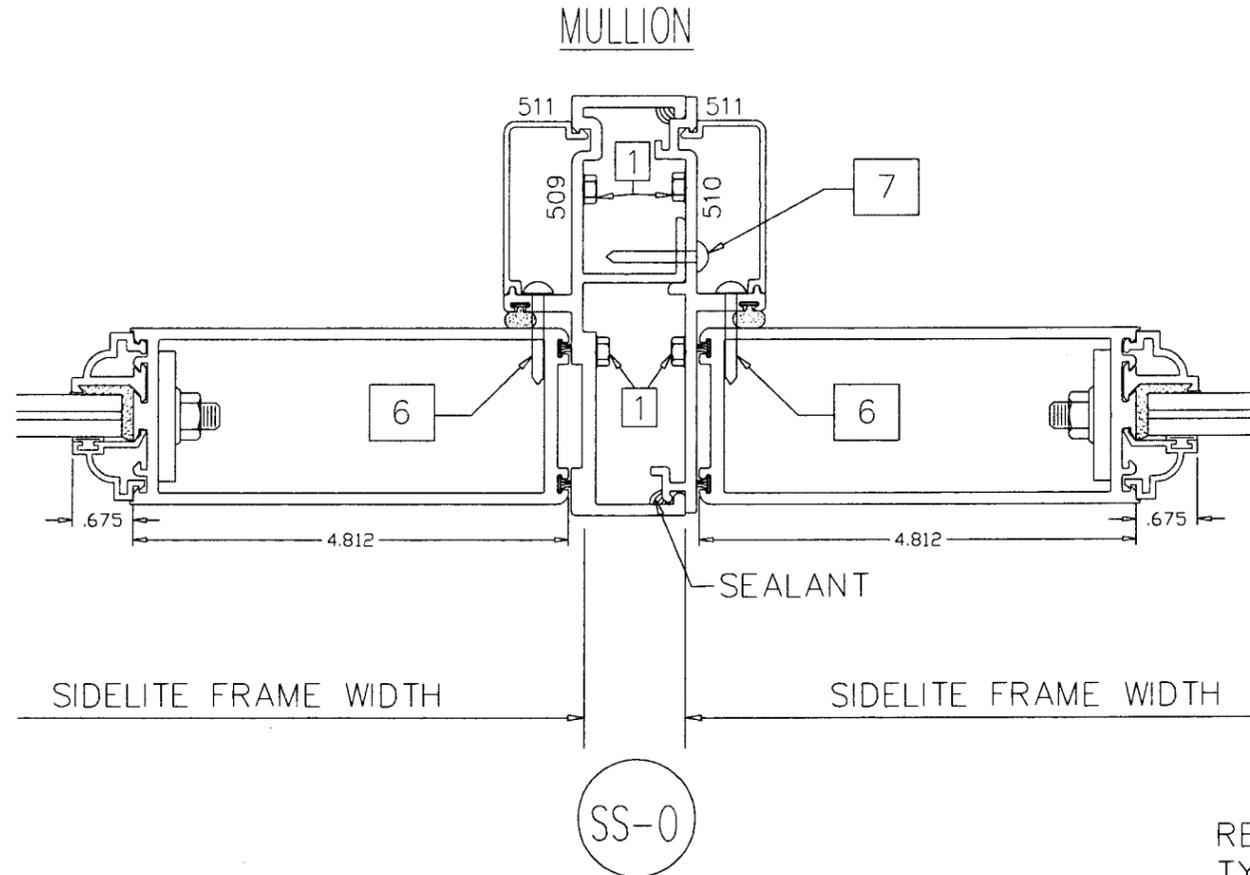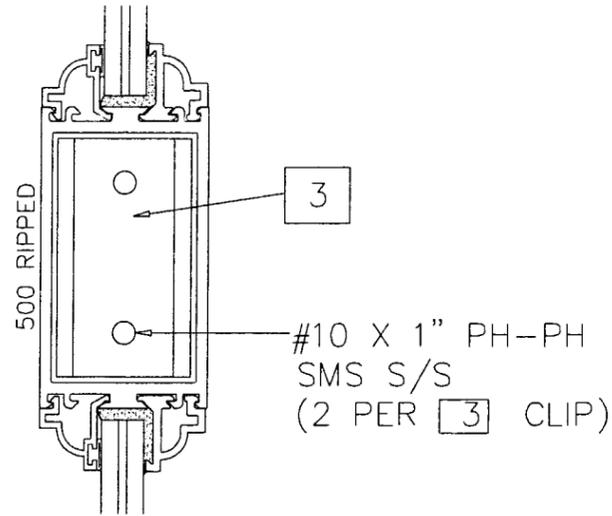

REFER TO SHEET 2 OF 7 FOR TYPICAL BILL OF MATERIALS

W98-01

08.05.03 NO CHANGE THIS SHEET
 D 12.14.05 NO CHANGE THIS SHEET
 E 10.16.06 REV. PER ECCC COMMENTS
 F 07.10.09 UPDATED FOR 2007 FBC

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

JUL 14 2009

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0723-04
 Expiration Date NOV 09, 2011
 By Isaac J. Lland
 Miami Dade Product Control
 Division



WINDOWS & DOORS

10100 northwest 25 street miami, florida 33172

product : Series 450 Outswing Doors & Sidelites

date : 10-20-97



sheet 5 of 7

PANEL PERFORMANCE CHART FOR DOORS, SINGLE SIDELITES AND MULLIONS
LAMINATED GLASS

NOMINAL DIMS.		OUT-SWING				MULLION LOAD CAPACITY PSF
		DESIGN LOAD CAPACITY-PSF				
		ANN. LAM. GLASS (TYPE 13A)		H.S. LAM. GLASS (TYPE 13B)		
PANEL WIDTH	PANEL HEIGHT	EXT.	INT.	EXT.	INT.	
2/0	6/8	100.0	100.0	100.0	110.0	110.0
2/6		100.0	100.0	100.0	110.0	110.0
3/0		100.0	100.0	100.0	110.0	110.0
3/6		87.1	87.1	100.0	110.0	110.0
2/0	7/0	100.0	100.0	100.0	110.0	110.0
2/6		100.0	100.0	100.0	110.0	110.0
3/0		100.0	100.0	100.0	110.0	110.0
3/6		82.6	82.6	100.0	110.0	110.0
2/0	7/6	100.0	100.0	100.0	110.0	110.0
2/6		100.0	100.0	100.0	110.0	110.0
3/0		100.0	100.0	100.0	110.0	110.0
3/6		76.8	76.8	100.0	102.9	110.0
2/0	8/0	100.0	100.0	100.0	110.0	110.0
2/6		100.0	100.0	100.0	110.0	110.0
3/0		100.0	100.0	100.0	110.0	110.0
2/0	9/0	100.0	100.0	100.0	110.0	110.0
2/6		100.0	100.0	100.0	110.0	96.6
3/0		100.0	100.0	100.0	100.0	80.5

LOADS SHOWN ABOVE ARE FOR DOORS USING THRESHOLD (S-S) WHERE WATER INFILTRATION REQUIREMENTS ARE NOT APPLICABLE AND FOR THRESHOLD (S-O) IN ANY CONDITION.



NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02 (3 SEC. GUSTS)

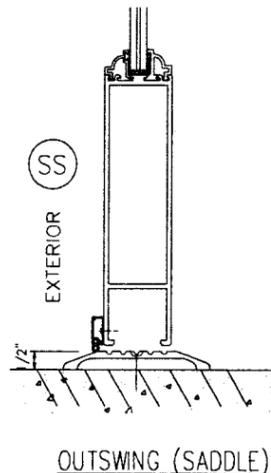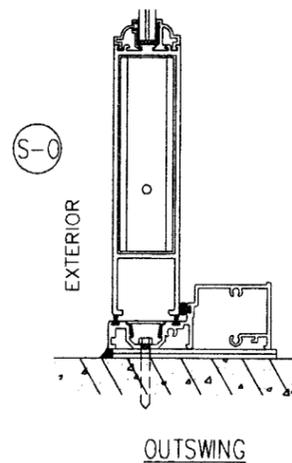

PANEL PERFORMANCE CHART FOR DOORS, SINGLE SIDELITES AND MULLIONS
INSULATED LAMINATED GLASS

NOMINAL DIMS.		OUT-SWING	
		DESIGN LOAD CAPACITY-PSF	
		INSUL. ANN. LAM. GLASS (TYPE 13C)	
PANEL WIDTH	PANEL HEIGHT	EXT.	INT.
2/0	6/8	80.0	80.0
2/6		80.0	80.0
3/0		80.0	80.0
3/6		80.0	80.0
2/0	7/0	80.0	80.0
2/6		80.0	80.0
3/0		80.0	80.0
2/0	7/6	80.0	80.0
2/6		80.0	80.0
3/0		80.0	80.0
2/0	8/0	80.0	80.0
2/6		80.0	80.0
3/0		80.0	80.0

LOADS SHOWN ABOVE ARE FOR DOORS USING THRESHOLD (S-S) WHERE WATER INFILTRATION REQUIREMENTS ARE NOT APPLICABLE AND FOR THRESHOLD (S-O) IN ANY CONDITION.

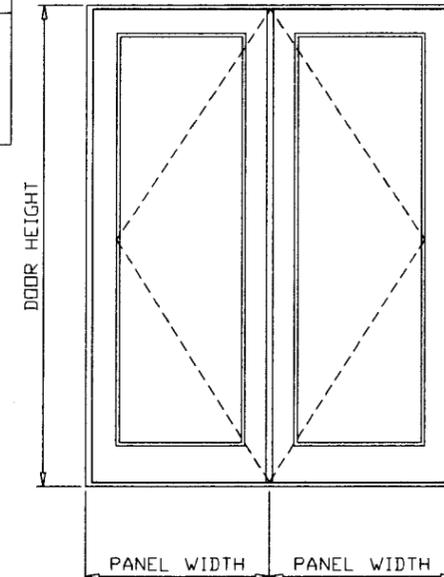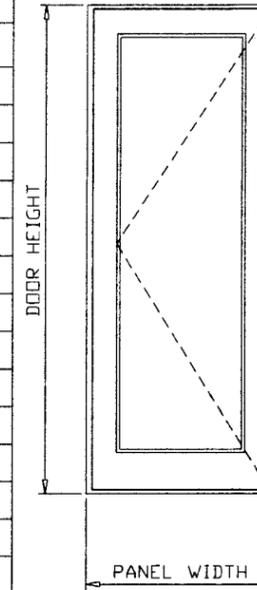

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0723-04
Expiration Date NOV 09, 2011
By Class 1, Chaudh
Miami Dade Product Control
Division

THESE CHARTS CAN BE USED TO CHECK CAPACITY FOR
SINGLE OR DOUBLE LEAF DOORS.
REFER TO TABLES ON SHEET 7 TO DETERMINE ANCHORS REQUIRED.

STEPS TO USE CHARTS:

1. DETERMINE WIND LOAD BASED ON PROVISIONS OF 2007 FLORIDA BLDG. CODE.
2. DETERMINE WATER INFILTRATION REQUIREMENTS BASED ON PROVISIONS OF FBC.
3. SELECT A DOOR SYSTEM I.E. INSWING OUTSWING AND TYPE OF THRESHOLD.
4. CHECK THE ALLOWABLE EXTERIOR AND INTERIOR LOADS FROM APPROPRIATE CHART. THE ALLOWABLE LOADS MUST MEET OR EXCEED THE DESIGN LOADS REQUIREMENTS.
5. SELECT AND CHECK ANCHORS TO MEET LOAD.
6. FOR MULLED SIDELITE REFER TO MULLION CAPACITY.

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538

JUL 14 2009


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-5100 FAX. (305) 262-6978
COMP - ANL W98-01CG

SERIES 450 OUTSWING DOOR AND SIDELITE
CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

no	date	by	description
B	11.14.02		GLASS TYPES REV.
C	08.05.03		NO CHANGE THIS SHEET
D	12.14.05		NOTE ADDED
E	10.16.06		REV. PER BCCO COMMENTS
F	07.10.09		UPDATED FOR 2007 FBC


date: 01-02-98
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W98-01
sheet 6 of 7

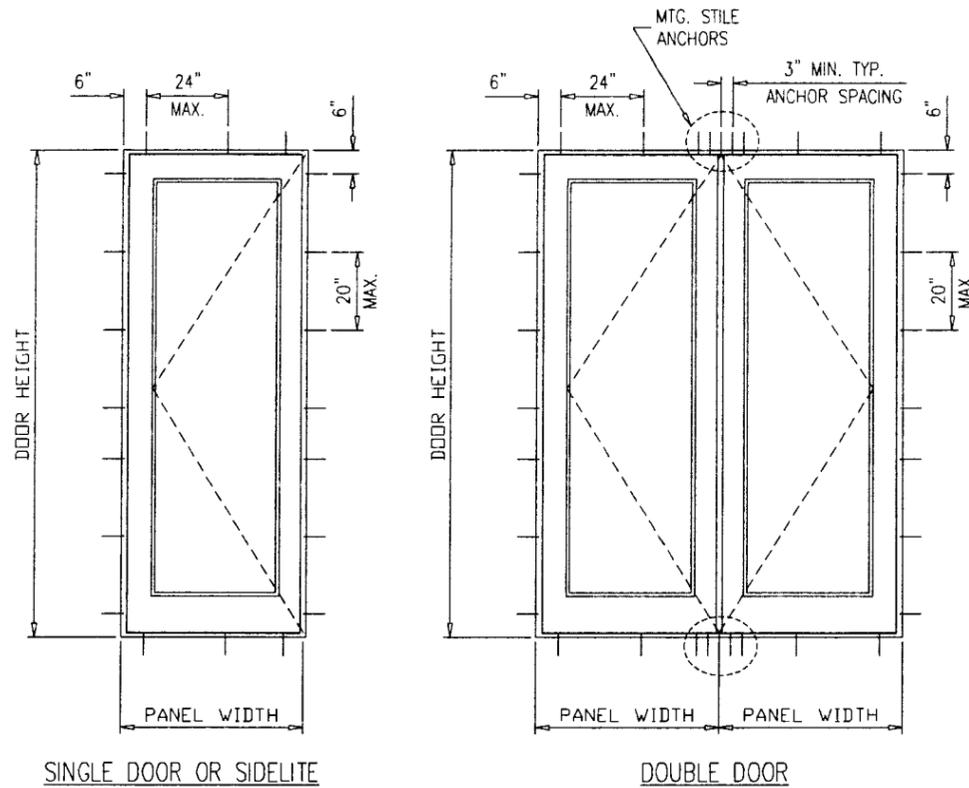

MULLION ANCHORS AT SIDELITES						
NOMINAL DIMS		DESIGN LOAD CAPACITY-PSF				
PANEL WIDTH	PANEL HEIGHT	TYPE 'B'			TYPE 'C'	
		CLUSTER OF 2 ANCHORS	CLUSTER OF 4 ANCHORS	CLUSTER OF 6 ANCHORS	CLUSTER OF 2 ANCHORS	CLUSTER OF 4 ANCHORS
2/0	6/8	88.2	110.0	110.0	110.0	110.0
2/6		70.6	110.0	110.0	100.3	110.0
3/0		58.8	110.0	110.0	83.6	110.0
3/6		50.4	100.8	110.0	71.7	110.0
2/0	7/0	84.0	110.0	110.0	110.0	110.0
2/6		67.2	110.0	110.0	95.5	110.0
3/0		56.0	110.0	110.0	79.6	110.0
3/6		48.0	96.0	110.0	68.2	110.0
2/0	7/6	78.4	110.0	110.0	110.0	110.0
2/6		62.7	110.0	110.0	89.2	110.0
3/0		52.3	104.5	110.0	74.3	110.0
3/6		44.8	89.6	110.0	63.7	110.0
2/0	8/0	73.5	110.0	110.0	104.5	110.0
2/6		58.8	110.0	110.0	83.6	110.0
3/0		49.0	98.0	110.0	69.7	110.0
2/0		9/0	65.3	110.0	110.0	92.9
2/6	52.3		104.5	110.0	74.3	110.0
3/0	43.6		87.1	110.0	61.9	110.0

MTG. STILE ANCHORS AT DOUBLE DOORS						
NOMINAL DIMS		DESIGN LOAD CAPACITY-PSF				
PANEL WIDTH	PANEL HEIGHT	TYPE 'B'			TYPE 'C'	
		CLUSTER OF 2 ANCHORS	CLUSTER OF 4 ANCHORS	CLUSTER OF 5 ANCHORS	CLUSTER OF 2 ANCHORS	CLUSTER OF 4 ANCHORS
2/0	6/8	88.2	110.0	110.0	110.0	110.0
2/6		70.6	110.0	110.0	100.3	110.0
3/0		58.8	110.0	110.0	83.6	110.0
3/6		50.4	100.8	110.0	71.7	110.0
2/0	7/0	84.0	110.0	110.0	110.0	110.0
2/6		67.2	110.0	110.0	95.5	110.0
3/0		56.0	110.0	110.0	79.6	110.0
3/6		48.0	96.0	110.0	68.2	110.0
2/0	7/6	78.4	110.0	110.0	110.0	110.0
2/6		62.7	110.0	110.0	89.2	110.0
3/0		52.3	104.5	110.0	74.3	110.0
3/6		44.8	89.6	110.0	63.7	110.0
2/0	8/0	73.5	110.0	110.0	104.5	110.0
2/6		58.8	110.0	110.0	83.6	110.0
3/0		49.0	98.0	110.0	69.7	110.0
2/0		9/0	65.3	110.0	110.0	92.9
2/6	52.3		104.5	110.0	74.3	110.0
3/0	43.6		87.1	108.9	61.9	110.0

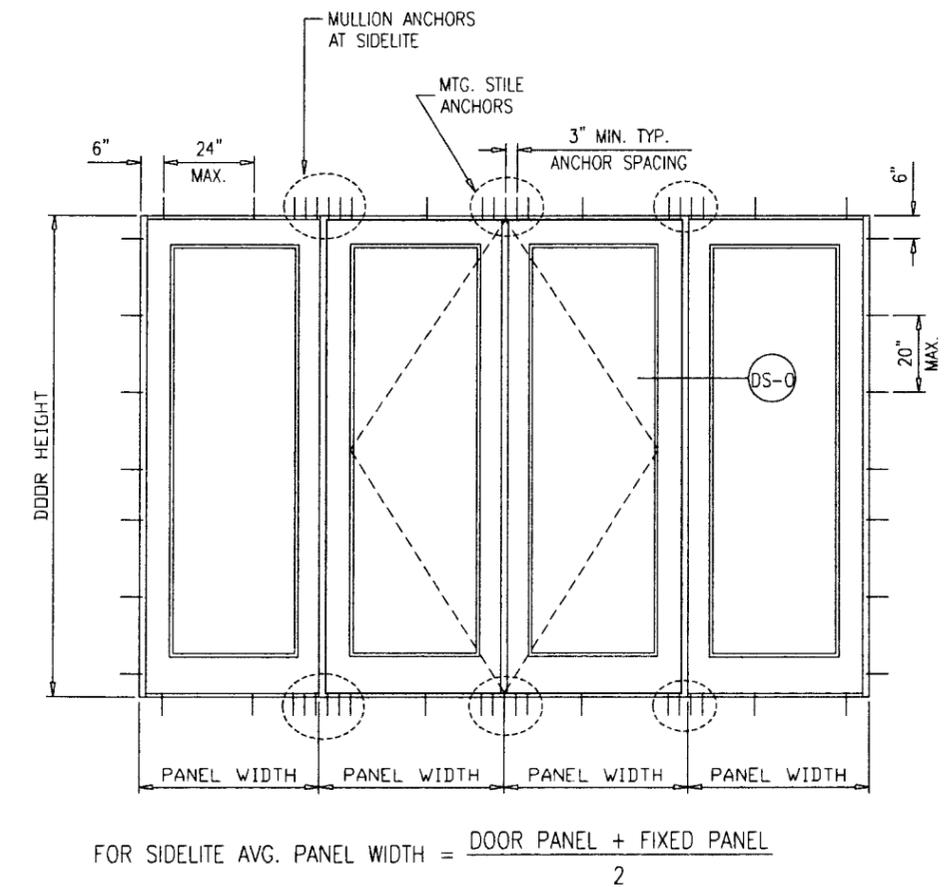

ANCHORS:

TYPE 'B' - 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU WOOD BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

EDGE DISTANCES

INTO CONCRETE AND MASONRY = 2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.

TYPE 'C' - 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

DIRECTLY INTO CONC. AT SILL
 1-3/4" MIN. EMBED INTO CONC.

EDGE DISTANCES

INTO CONCRETE = 2-1/2" MIN.

CONCRETE f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK f'm = 2000 PSI MIN.

STEPS TO USE CHARTS:

1. SELECT TYPE OF ANCHOR.
2. FOR SIZE OF UNITS DETERMINE ALLOWABLE LOAD CAPACITY. THIS LOAD CAPACITY MUST MEET OR EXCEED DESIGN WIND LOAD REQUIREMENT DETERMINE IN STEP 1 OF SHEET 6.

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538
 JUL 14 2009

af

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-8978
 COMP - ANL \ W98-01CG

SERIES 450 OUTSWING DOOR AND SIDELITE


CGI WINDOWS & DOORS
 10100 N.W. 25TH STREET
 MIAMI, FL. 33172
 TEL. (305) 593-6590 FAX. (305) 593-6592

no	date	by	description
A	11.01.01		CHARTS REV. PER 1987 NDS
C	08.05.03		NO CHANGE THIS SHEET
D	12.14.05		CHART REV.
E	10.16.06		REV. PER BCCO COMMENTS
F	07.10.09		UPDATED FOR 2007 FBC

date: 01-02-98
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
 W98-01

sheet 7 of 7

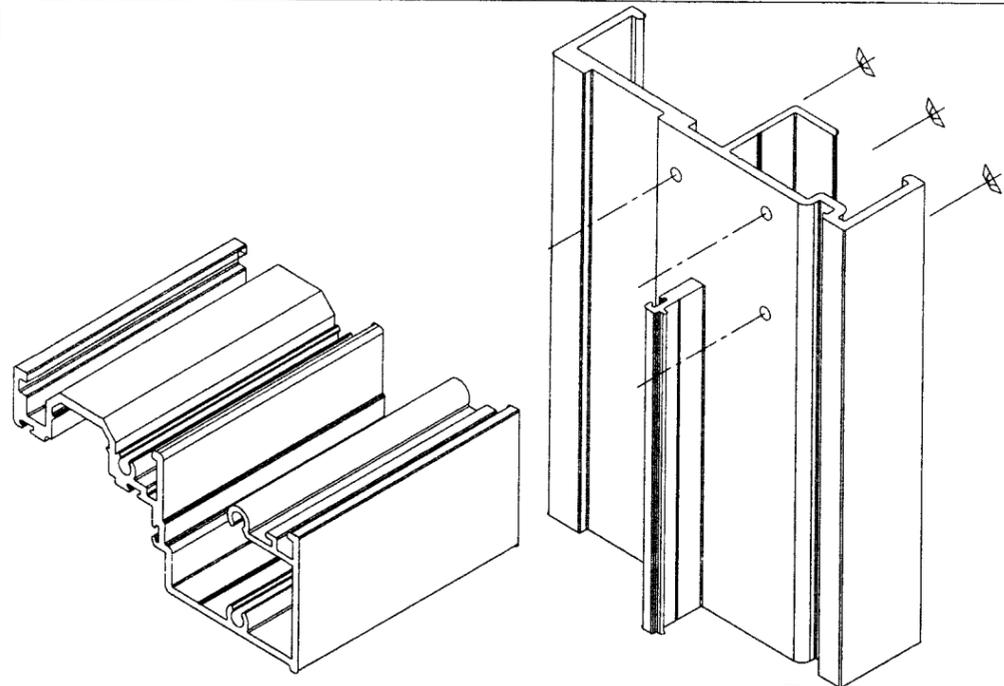


HEAD CORNER DETAIL


CORNERS TO BE SEALED WITH LOW MODULUS SILICONE SILPRUF OR EQUIVALENT.

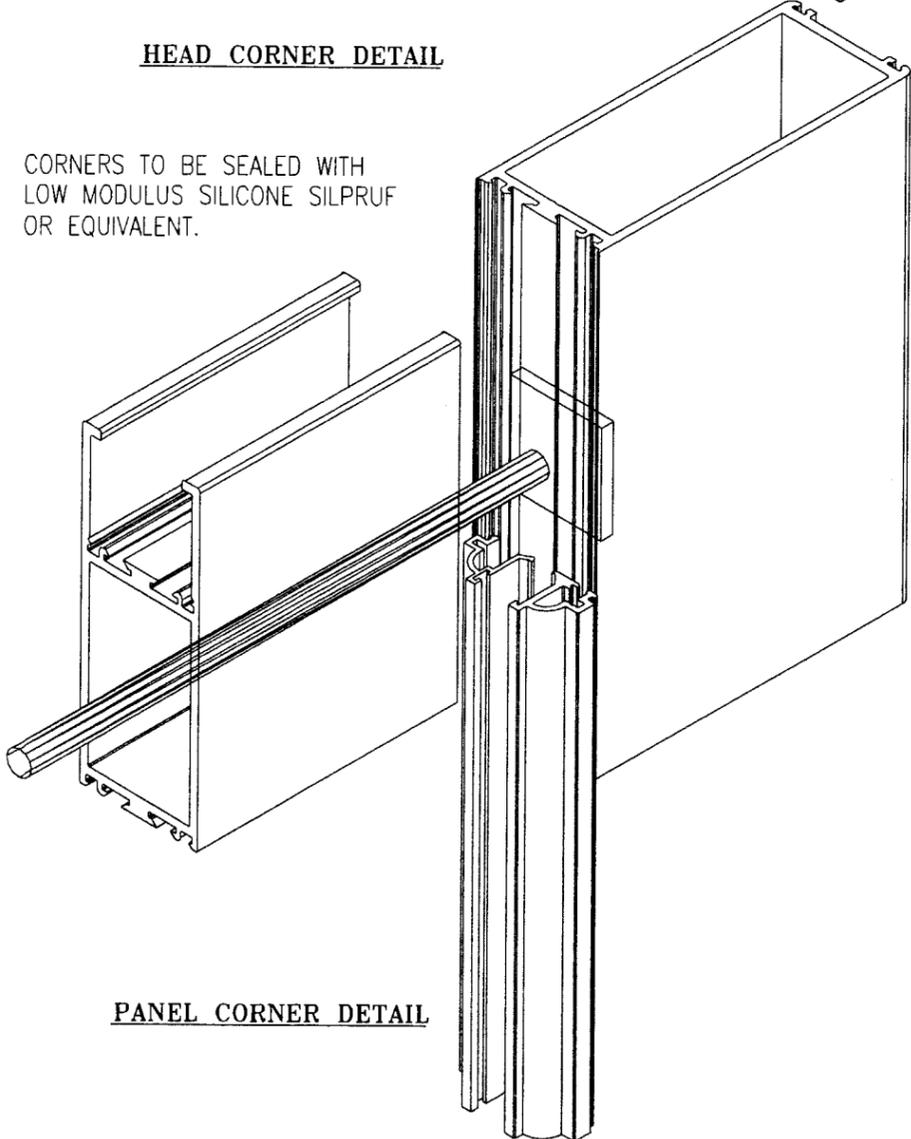

PANEL CORNER DETAIL

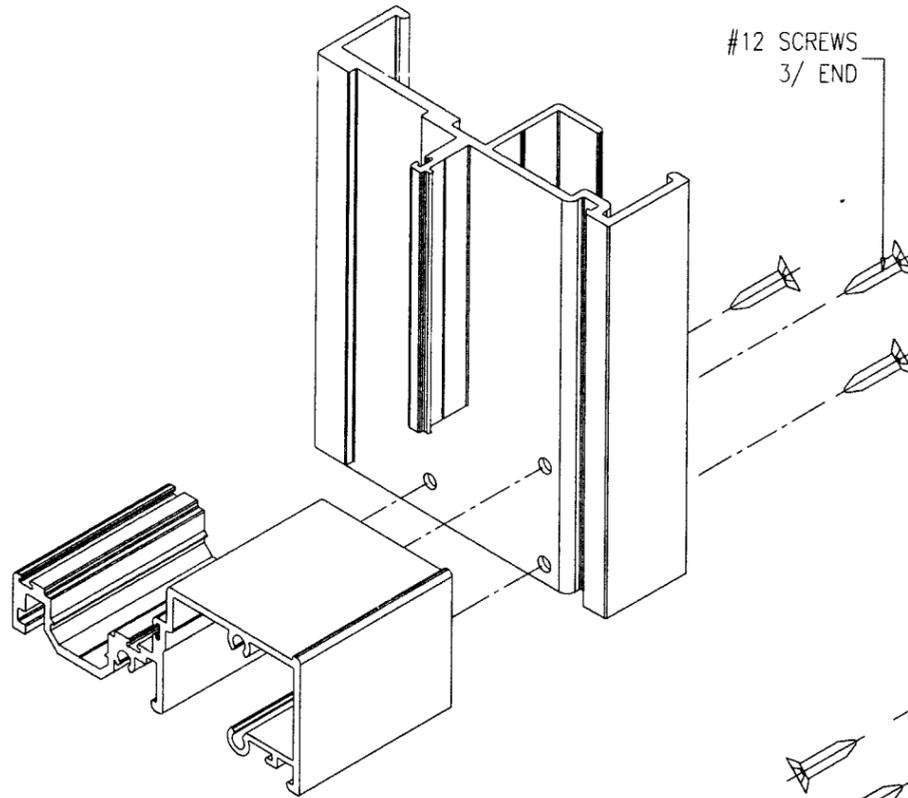

SILL CORNER DETAIL

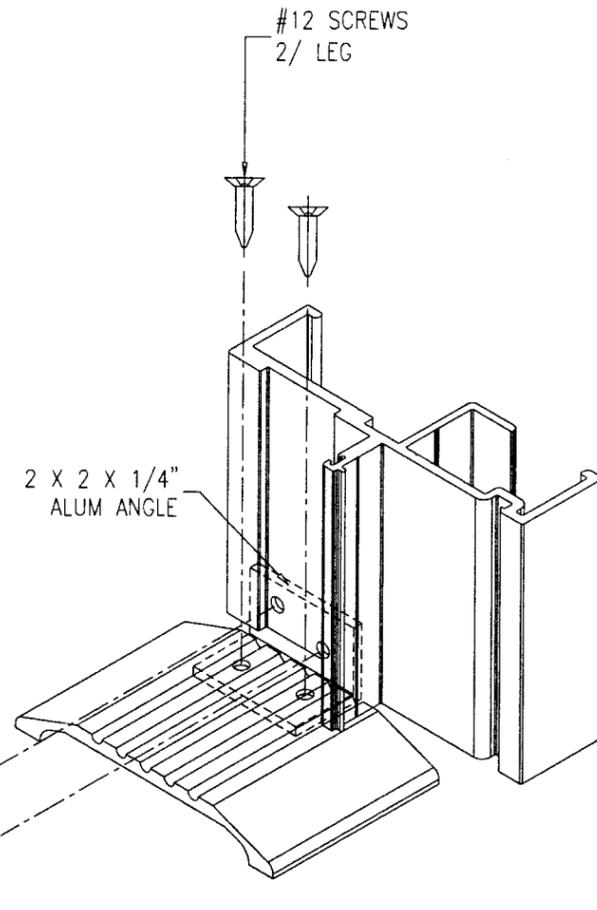

SILL CORNER DETAIL

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-072304
 Expiration Date NOV09,2011
 By Ishag I. Chand
 Miami Dade Product Control
 Division

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

 JUL 14 2009



AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1236 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W98-01CG

SERIES 450 OUTSWING DOOR AND SIDELITE
 CGI WINDOWS & DOORS
 10100 N.W. 25TH STREET
 MIAMI, FL. 33172
 TEL. (305) 593-6590 FAX. (305) 593-6592

no	date	description
A	11.01.01	CHARTS REV. PER 1997 NDS
C	08.05.03	NO CHANGE THIS SHEET
D	12.14.05	CHART REV.
E	10.16.06	REV. PER BCCO COMMENTS
F	07.10.09	UPDATED FOR 2007 FBC

date: 01-02-98
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W98-01
 sheet 7.1 of 7