



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
 (305) 375-2901 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

**Florida Extruders International, Inc.**  
**2540 Jewett Lane**  
**Sanford, FL 32771**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Milestone 5000" Aluminum Single Hung Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **FEI0001**, titled "Milestone Series 5000 Aluminum SH Windows", sheets 1 through 7 of 7, dated 07/20/09, prepared by PTC, LLC, signed and sealed by Robert J. Amoroso, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 09-0723.06**  
**Expiration Date: November 18, 2014**  
**Approval Date: November 18, 2009**  
 Page 1

**Florida Extruders International. Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **FEI0001**, Sheets 1 through 7 of 7, titled "Milestone Series 5000 Aluminum SH Windows", dated 07/20/09, prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.

**B. TESTS**

1. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of aluminum single hung window, specimens #SH-1 through #SH-6, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3567-1**, dated 10/24/08, signed and sealed by Gerard J. Ferrara, P.E.
2. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of aluminum single hung window, specimens #SH-9, #SH-10 and #SH-11 prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3568-1**, dated 10/24/08, signed and sealed by Gerard J. Ferrara, P.E.

**C. CALCULATIONS**


1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by PTC, LLC, dated 5/19/09, signed and sealed by Robert J. Amoruso, P.E.  
**Complies with ASTM E1300-04**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.

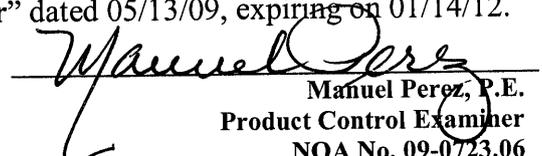  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 09-0723.06  
Expiration Date: November 18, 2014  
Approval Date: November 18, 2009

**Florida Extruders International, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**F. STATEMENTS**




1. Statement letter of conformance and no financial interest, dated July 20, 2009, signed and sealed by Robert J. Amoruso, P.E.

**G. OTHERS**

1. None.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 09-0723.06  
Expiration Date: November 18, 2014  
Approval Date: November 18, 2009



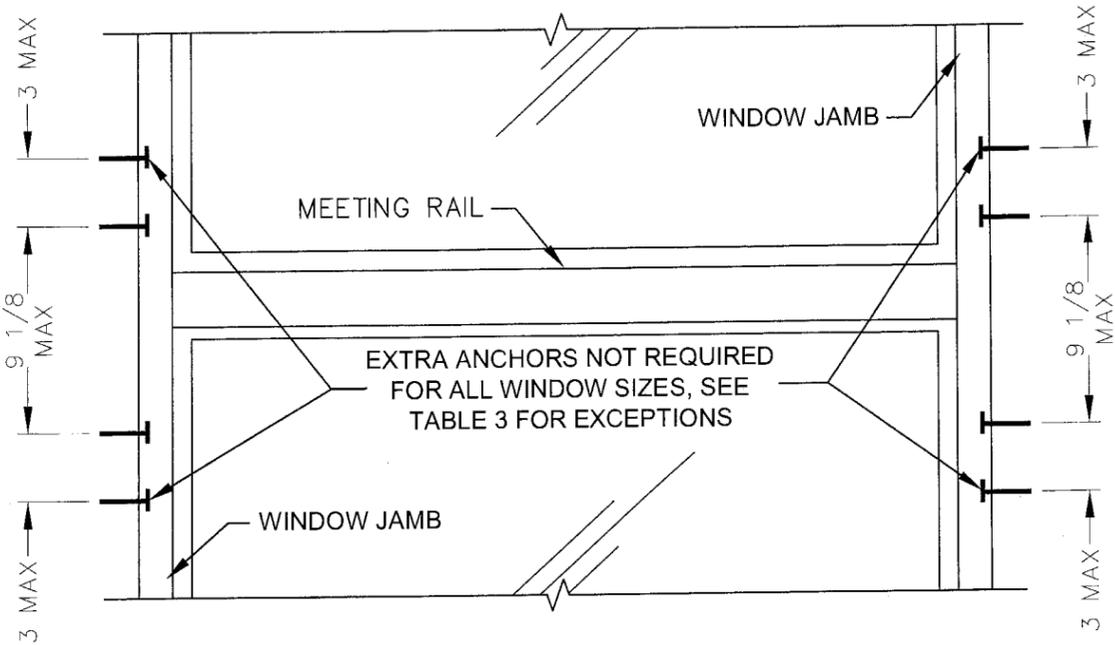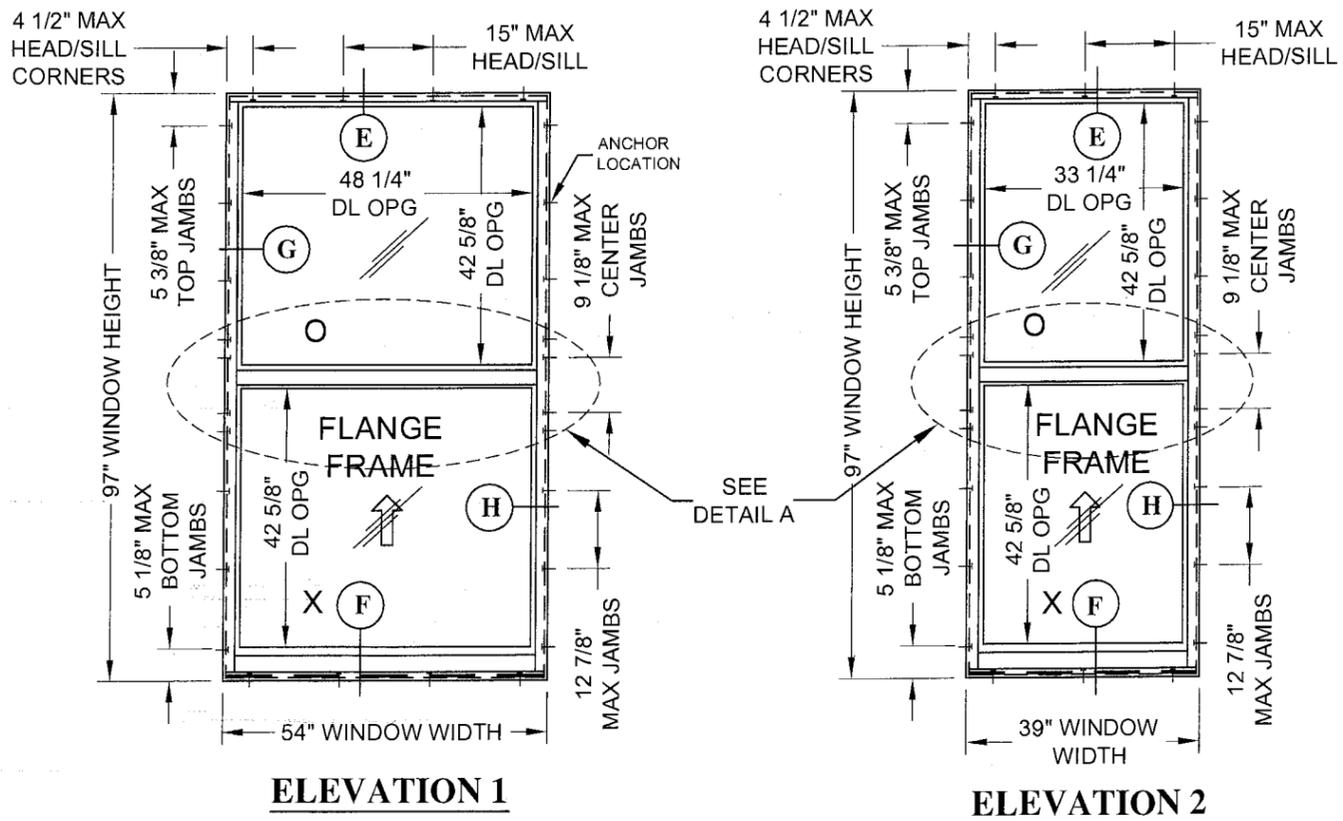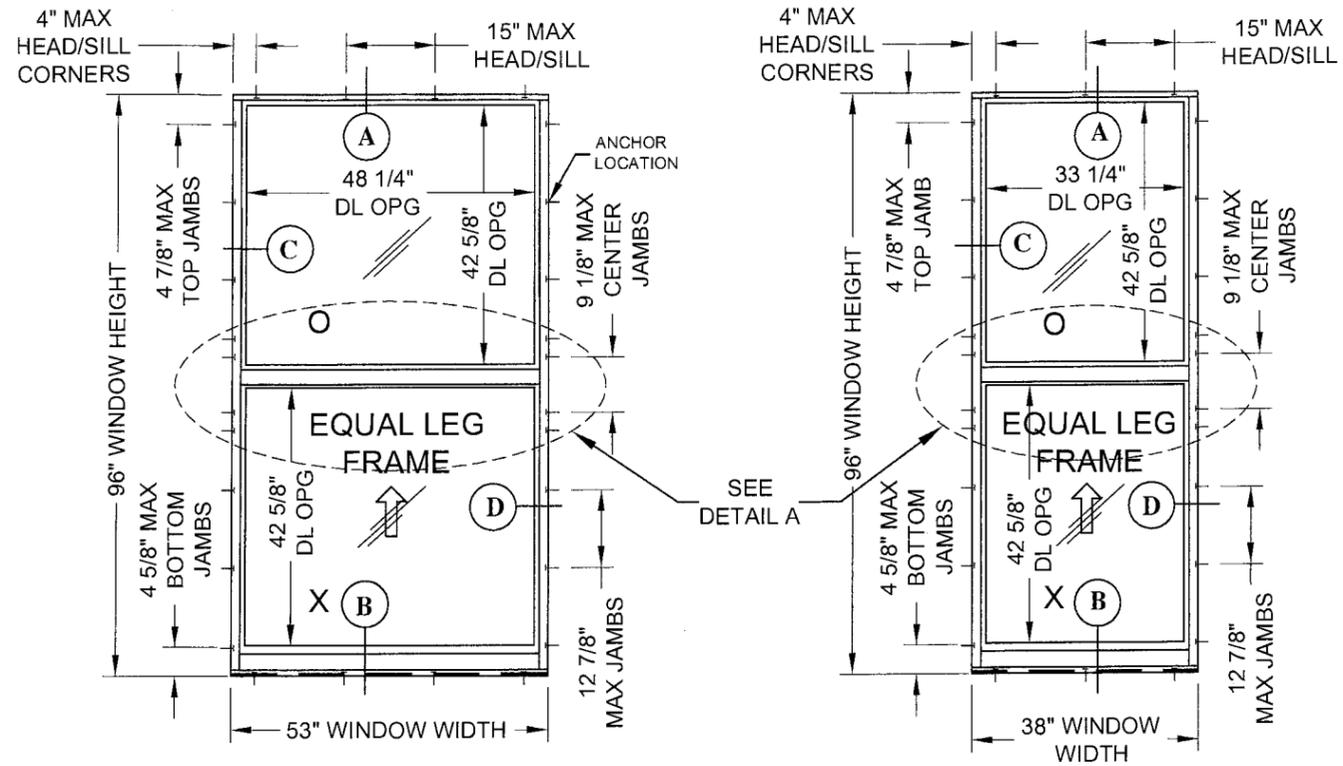

**DETAIL "A"**  
 ENHANCED MEETING RAIL ANCHORAGE  
 (NTS) REQUIRED ON ALL SIZES WITH BUCK  
 HEIGHT 30 1/2" AND GREATER.

**Table 2 - Design Pressure (psf) for Large Missile Impact**

Elevation	Window Size based on Buck Width and Height (in)		Design Pressure (psf)		Impact Rating
			Concrete/Masonry, Wood and Mullion Substrates (see Table 3 for exceptions)		
	Width	Height	Lami	Lami+IG	
1	> 38" to 53"	up to 96"	110	110	Large Missile Impact
2	up to 38"	up to 96"	110	110	

- NOTES:**
- FOR EQUAL LEG WINDOWS, BUCK DIMENSIONS ARE THE SAME AS WINDOW DIMENSIONS.
  - FOR FLANGE WINDOWS, BUCK DIMENSIONS ARE 1" LESS THAN WINDOW DIMENSIONS.
  - ELEVATIONS ARE VIEWED FROM EXTERIOR.
  - SCREENS ARE NOT SHOWN FOR CLARITY.
  - ALL DIMENSIONS ARE IN INCHES.
  - DL OPG: DAY LIGHT OPENING.
  - ANCHOR LOCATION SPACINGS SHOWN FOR THE JAMBS ARE THE SAME FOR A WALL OR A MULLION.

PROJECT #309-0209  
 Robert J. Amoroso, P.E.  
 FL. License no. 49752

Nov 18 2009  
 09-0723.06  
 Manual

PTC, LLC  
 1535 N. Cogswell Street Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

FLORIDA EXTRUDERS INTERNATIONAL, INC.  
 2540 JEWETT LANE  
 SANFORD, FLORIDA 32771-1687

TITLE: MILESTONE SERIES 5000 ALUMINUM SH WINDOWS ANCHOR LAYOUT & DP TABLE

DRAWN BY: C.D. DATE: 07/20/09  
 SCALE: 1:30 DRAWING NO: FEI0001  
 REV: SHEET: 2 OF 7

REV	DESCRIPTION	DATE	BY

TABLES 3A TO 3E - WINDOW SIZES WITH LIMITATIONS IN DESIGN PRESSURE DUE TO ANCHORAGE.

Table 3A - Commodity Sized Windows in Concrete/Masonry						
Design Pressure (DP) (psf) limited by Anchorage						
Concrete & Filled CMU			CMU			
Buck Sizes		DP (psf)	Buck Sizes		DP (psf)	
BW	BH		BW	BH		
No anchor limitations to DP.	110 psf (from Table 2)	> 52-1/8 to 53	> 95 to 96	95		
			> 83 to 95	96		
			> 71 to 83	104		
		> 47 to 52-1/8	> 95 to 96	97		
			> 83 to 95	98		
			> 71 to 83	106		
		No anchor limitations to DP for sizes smaller than those above.				110 psf (from Table 2)

Table 3B - Modular Sized Windows in Concrete/Masonry						
Design Pressure (DP) (psf) limited by Anchorage						
Concrete & Filled CMU			CMU			
Buck Sizes		DP (psf)	Buck Sizes		DP (psf)	
BW	BH		BW	BH		
No anchor limitations to DP.	110 psf (from Table 2)	> 52-1/8 to 53	> 95-1/2 to 96	95		
			> 83-1/2 to 95-1/2	96		
			> 71-1/2 to 83-1/2	103		
		> 47-1/2 to 52-1/8	> 95-1/2 to 96	97		
			> 83-1/2 to 95-1/2	98		
			> 71-1/2 to 83-1/2	106		
		No anchor limitations to DP for sizes smaller than those above.				110 psf (from Table 2)

Table 3C - Commodity & Modular Sized Windows Jamb to Mullion		
Design Pressure (DP) (psf) limited by Anchorage		
Buck Sizes		DP (psf)
BW	BH	
No anchor limitations to DP.		110 psf (from Table 2)

Table 3D - Commodity Sized Windows in Wood Substrates					
Design Pressure (DP) (psf) limited by Anchorage					
Buck Sizes		DP (psf)	Buck Sizes		DP (psf)
BW	BH		BW	BH	
53	96	61	47	96	75
53	95	61	47	95	75
53	83	66	47	83	79
53	72	73	47	72	85
53	71	73	47	71	85
53	62	78	47	62	92
53	55 1/4	86	47	55 1/4	99
53	49 5/8	94	47	49 5/8	107
53	43 3/4	100	47	43 3/4	110
53	37 3/8	110	47	37 3/8	110
53	30 1/2	110	47	30 1/2	110
53	25	* 85	47	25	* 96
52 1/8	96	62	38	96	97
52 1/8	95	63	38	95	103
52 1/8	83	68	38	> 71 to 83	106
52 1/8	72	75	38	25 to 71	110
52 1/8	71	75	36	> 95 to 96	105
52 1/8	62	80	36	25 to 95	110
52 1/8	55 1/4	88	No anchor limitations to DP for sizes smaller than those above.		110 psf (from Table 2)
52 1/8	49 5/8	96			
52 1/8	43 3/4	101			
52 1/8	37 3/8	110			
52 1/8	30 1/2	110			
52 1/8	25	* 87			

Table 3E - Modular Sized Windows in Wood Substrates					
Design Pressure (DP) (psf) limited by Anchorage					
Buck Sizes		DP (psf)	Buck Sizes		DP (psf)
BW	BH		BW	BH	
53	96	61	43 1/2	96	80
53	95 1/2	61	43 1/2	95 1/2	81
53	83 1/2	66	43 1/2	83 1/2	86
53	71 1/2	73	43 1/2	71 1/2	94
53	59 1/2	81	43 1/2	59 1/2	102
53	51 1/2	91	43 1/2	30-1/2 to 51-1/2	110
53	47 1/2	98	43 1/2	27 1/2	* 96
53	43 1/2	100	39 1/2	96	92
53	35 1/2	110	39 1/2	95 1/2	92
53	30 1/2	110	39 1/2	83 1/2	98
53	27 1/2	* 78	39 1/2	71 1/2	106
47 1/2	96	71	39 1/2	30-1/2 to 59-1/2	110
47 1/2	95 1/2	71	39 1/2	27 1/2	* 105
47 1/2	83 1/2	76	35 1/2	> 83 1/2 to 96	107
47 1/2	71 1/2	84	No anchor limitations to DP for sizes smaller than those above.		110 psf (from Table 2)
47 1/2	59 1/2	92			
47 1/2	51 1/2	103			
47 1/2	30-1/2 to 47-1/2	110			
47 1/2	27 1/2	* 87			

\* SIZES WITH BUCK HEIGHT (BH) LESS THAN 30 1/2" DO NOT HAVE SPACE FOR ENHANCED ANCHORAGE AT THE MEETING RAILS, THEREFORE THE DESIGN PRESSURE (DP) IS LOWER THAN THE NEXT LARGEST WINDOW. AT 30 1/2" BH OR LARGER, WINDOWS ARE FABRICATED AND INSTALLED WITH ENHANCED ANCHORAGE AT MEETING RAILS.

NOTES:

- FOR EQUAL LEG WINDOWS, BUCK DIMENSIONS ARE THE SAME AS WINDOW DIMENSIONS.
- FOR FLANGE WINDOWS, BUCK DIMENSIONS ARE 1" LESS THAN WINDOW DIMENSIONS.
- BW: BUCK WIDTH, BH: BUCK HEIGHT
- DP: DESIGN PRESSURE
- CMU: CONCRETE MASONRY UNIT

FLORIDA EXTRUDERS INTERNATIONAL, INC.  
2540 JEWETT LANE  
SANFORD, FLORIDA 32771-1687

TITLE: MILESTONE SERIES 5000 ALUMINUM SH WINDOWS ANCHORAGE LIMITATIONS DP TABLES

DATE: 07/20/09  
DRAWING NO: FEI0001  
SHEET: 3 OF 7



PTC, LLC  
Phone 321.600.1788  
Fax 321.600.1789

PROJECT #309-0209

Robert J. Amoruso, P.E.  
FL License no. 49752

*Handwritten signature*


PTC, LLC  
1535 N. Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 28935

Approved as complying with the Florida Building Code

Date Nov. 18, 2009  
NO. 09-0723-06  
Business Development Control


*Handwritten signature*

**A VERTICAL SECTION**  
CONCRETE / MASONRY SUBSTRATE  
WITH EQUAL LEG FRAME

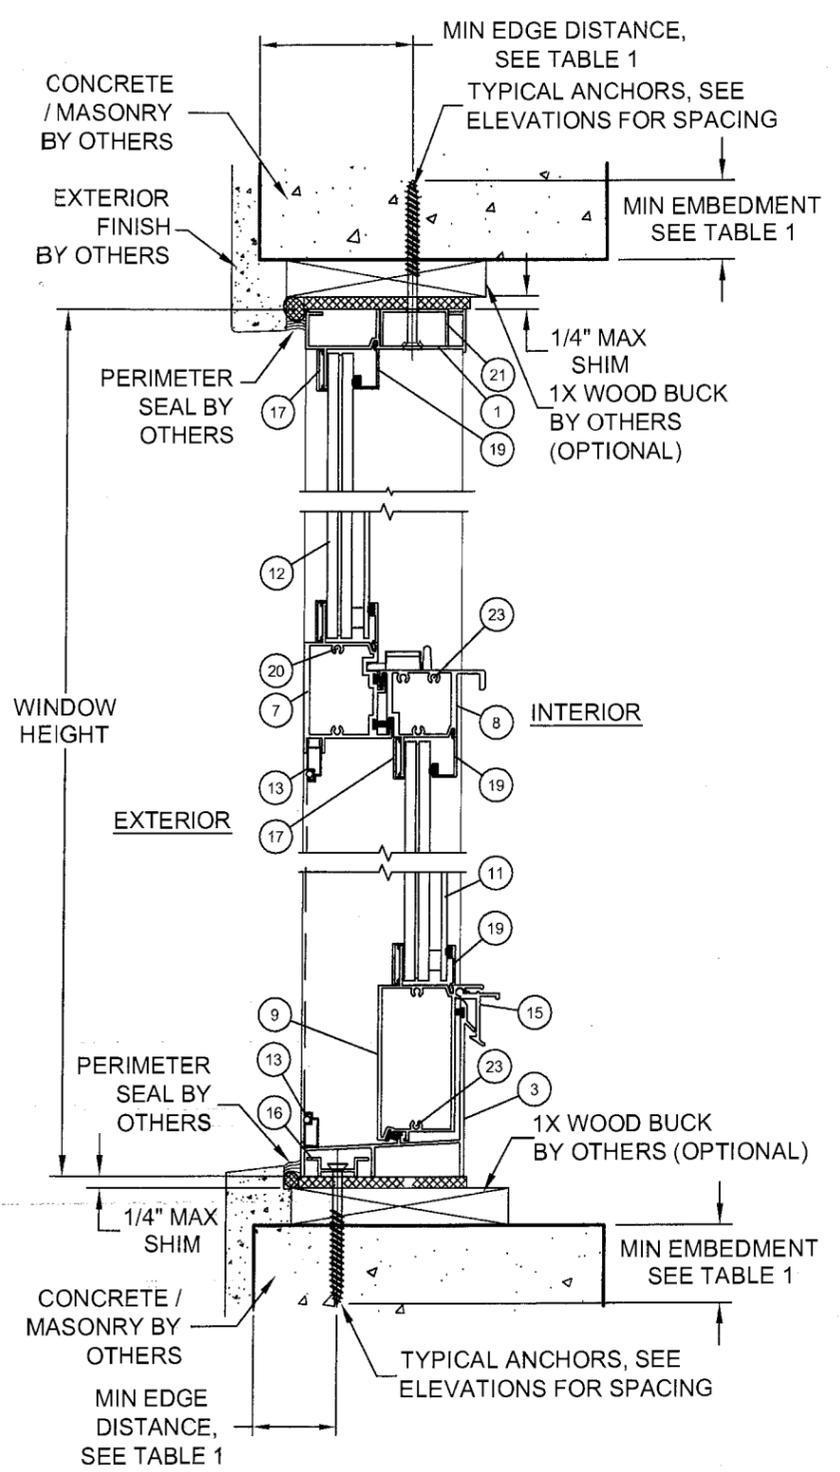


**B VERTICAL SECTION**  
CONCRETE/MASONRY SUBSTRATE  
WITH EQUAL LEG FRAME

**A VERTICAL SECTION**  
WOOD FRAME SUBSTRATE  
WITH EQUAL LEG FRAME

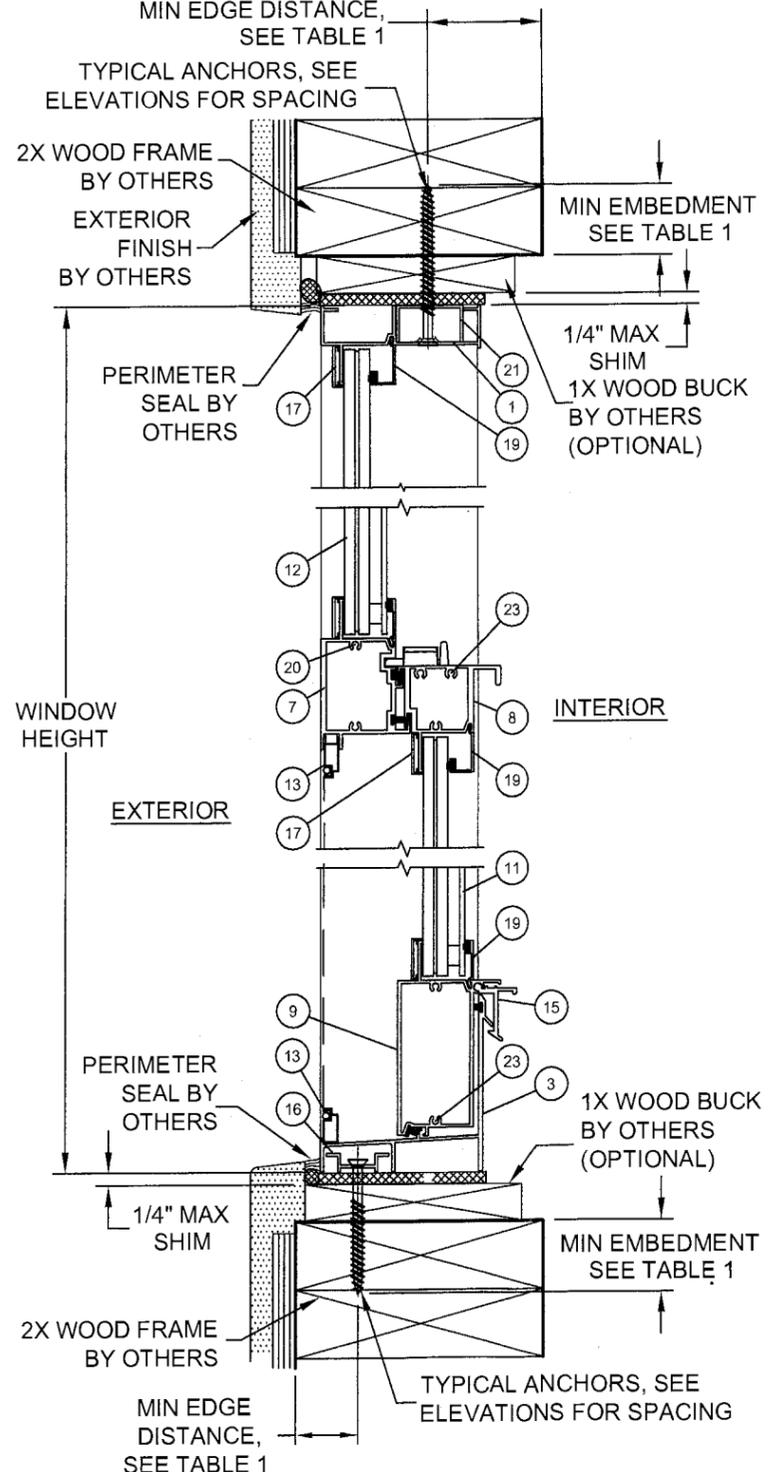

**B VERTICAL SECTION**  
WOOD FRAME SUBSTRATE  
WITH EQUAL LEG FRAME

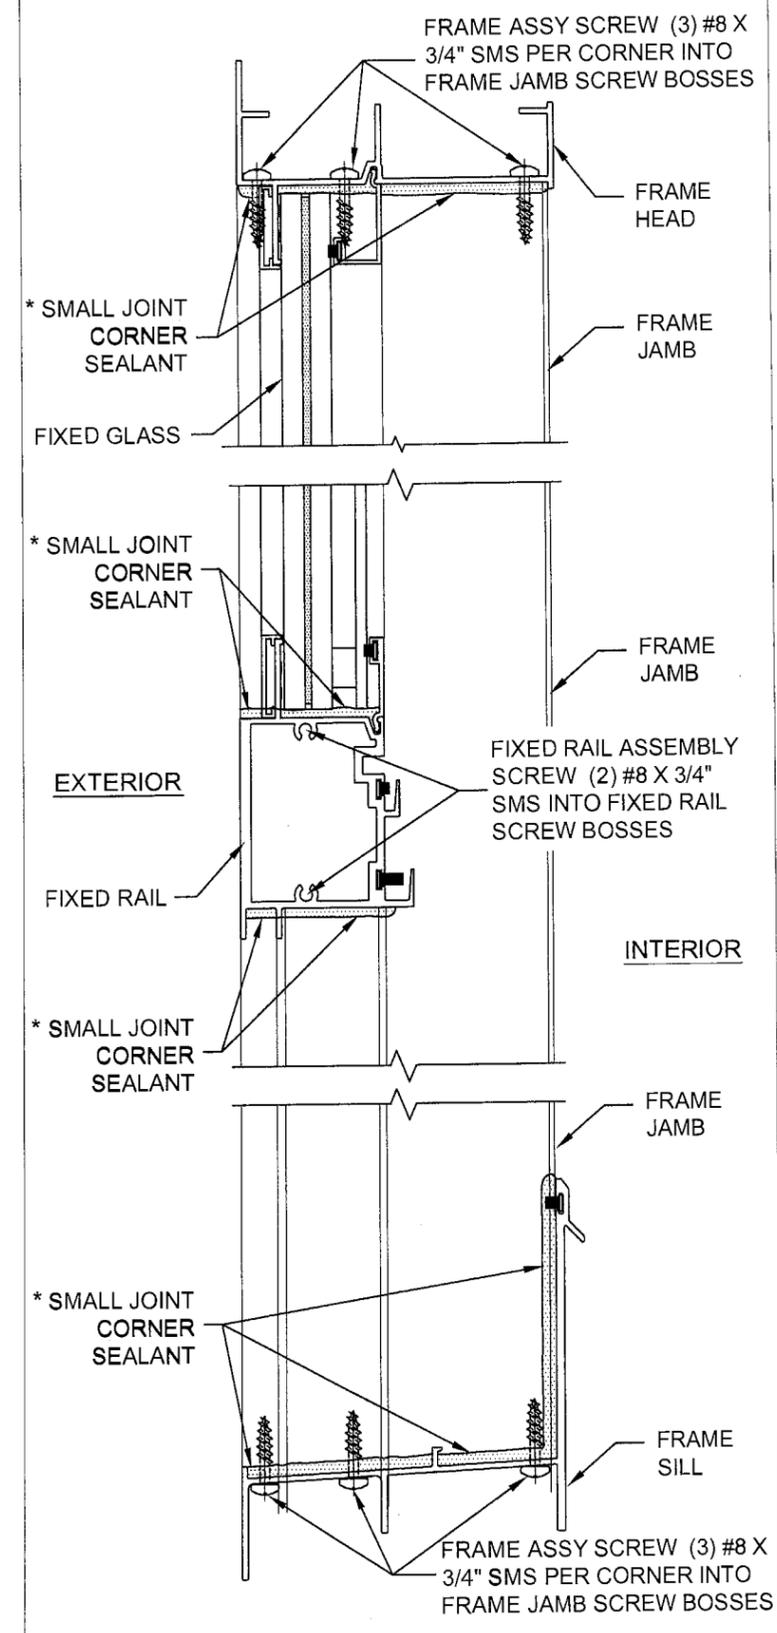

\* CORNER SEALANT APPLIED IN THE FACTORY IS INSTALLED ON THE EXTERIOR SURFACE OF THE FRAME JOINTS. AFTER WINDOW INSTALLATION THE SEALANT MAY NOT BE VISIBLE.

**FLANGE FRAME CORNER DETAIL**  
SIMILAR FOR EQUAL LEG FRAME


PROJECT #309-0209	PREPARED BY: <i>WJW</i>	DATE: 07/20/09	REVISIONS
Robert J. Amoroso, P.E. FL License no. 49762	DRAWN BY: C.D.	DRAWING NO: FEI0001	DESCRIPTION
1535 N. Cogswell Street, Suite C25 Rockledge, Florida 32955 FBPE Certificate of Authorization NO. 25935	SCALE: 1:4	SHEET: 4 OF 7	DATE
PTC, LLC Phone 321.690.1768 Fax 321.690.1768			BY

FLORIDA EXTRUDERS INTERNATIONAL, INC.  
 2540 JEWETT LANE  
 SANFORD, FLORIDA 32771-1687  
 MILESTONE SERIES 5000 ALUMINUM SH WINDOWS  
 VERTICAL SECTIONS & CORNER DETAIL  
 DRAWN BY: C.D. DATE: 07/20/09  
 SCALE: 1:4 DRAWING NO: FEI0001  
 SHEET: 4 OF 7

Approved as complying with the Florida Building Code  
 Date: NOV 18 2009  
 Noted by: 07-23-06  
 Prepared by: [Signature]  
 Checked by: [Signature]

E

**VERTICAL SECTION**  
CONCRETE / MASONRY SUBSTRATE  
WITH FLANGE FRAME

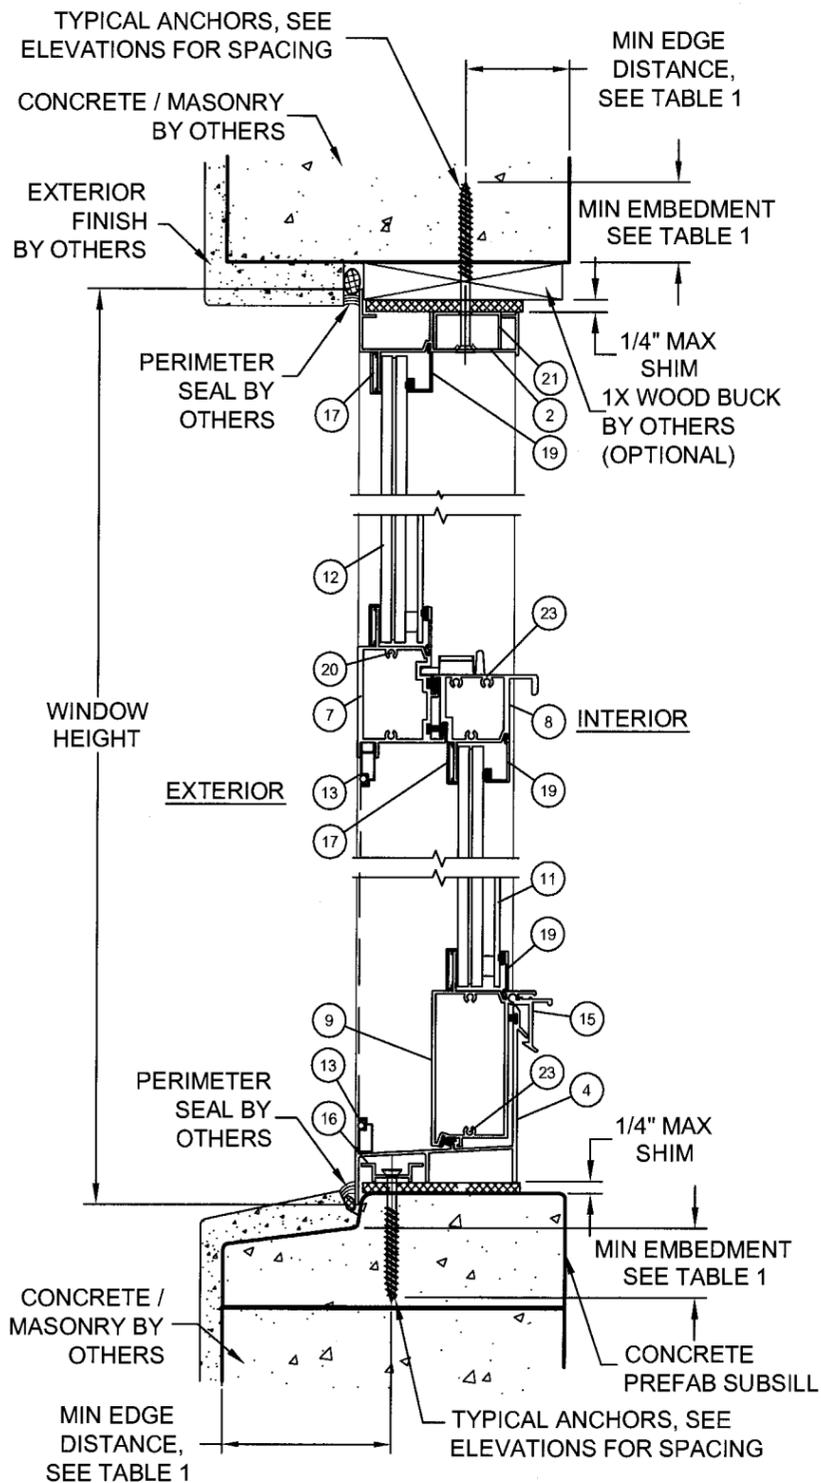


F

**VERTICAL SECTION**  
CONCRETE/MASONRY SUBSTRATE  
WITH FLANGE FRAME

E

**VERTICAL SECTION**  
WOOD FRAME SUBSTRATE  
WITH FLANGE FRAME

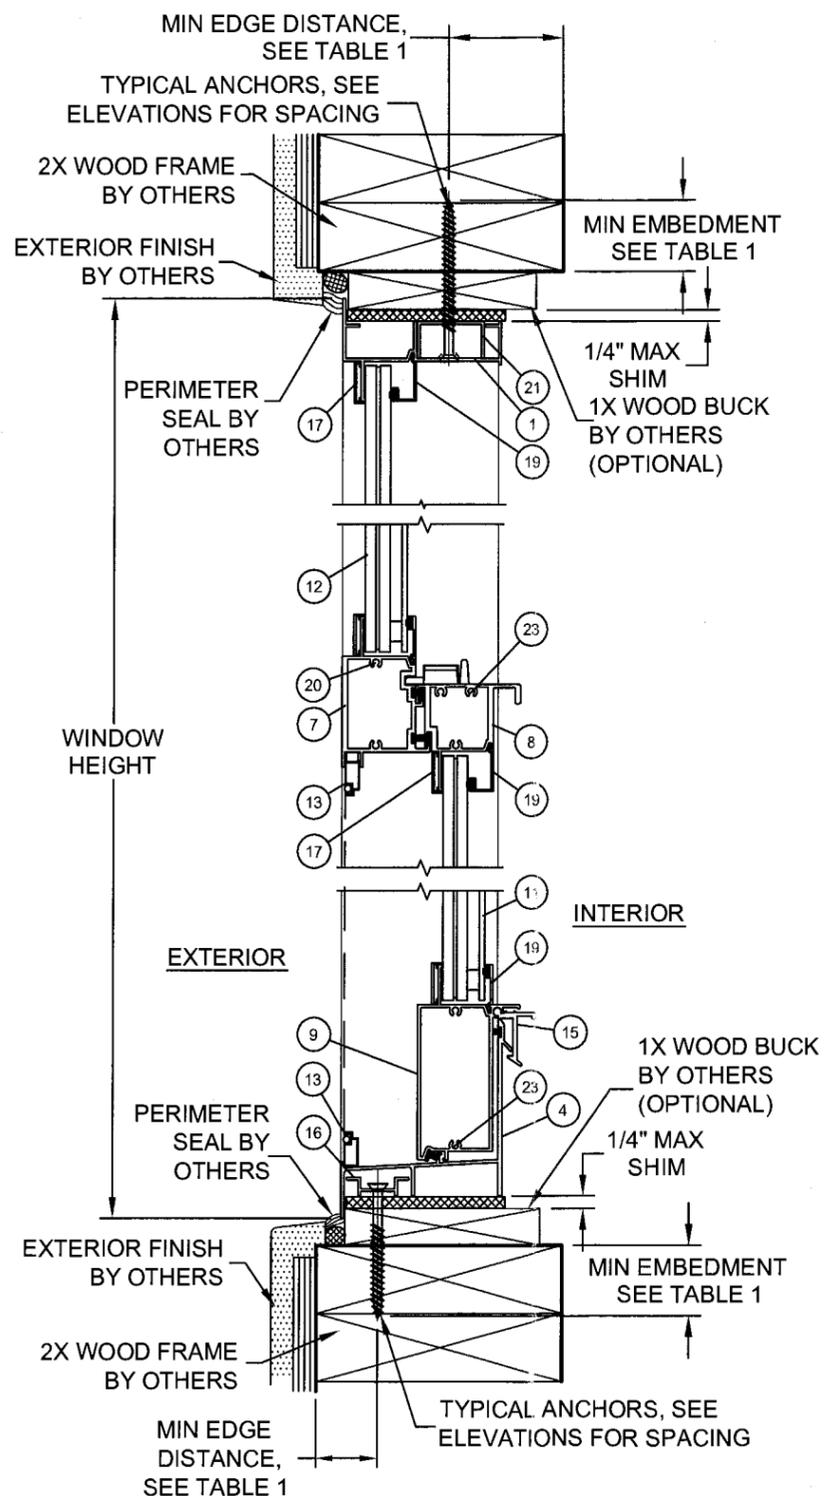


F

**VERTICAL SECTION**  
WOOD FRAME SUBSTRATE  
WITH FLANGE FRAME

F

**VERTICAL SECTION**  
CONCRETE/MASONRY SUBSTRATE  
WITH FLANGE FRAME

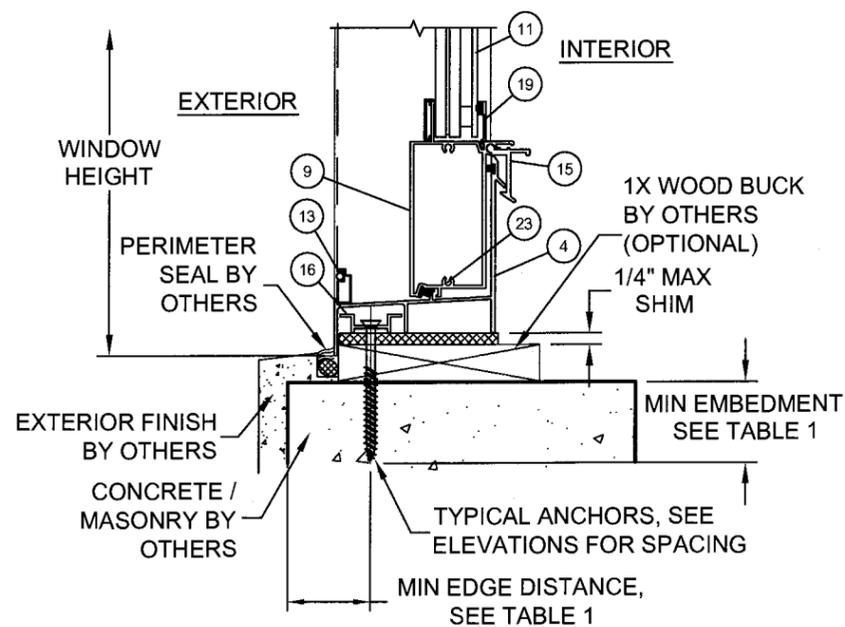

DATE: 06/02/09	APPROVED BY: RJA	DESCRIPTION	DATE	BY

FLORIDA EXTRUDERS INTERNATIONAL, INC.  
2540 JEWETT LANE  
SANFORD, FLORIDA 32771-1687

TITLE: MILESTONE SERIES 5000 ALUMINUM SH WINDOWS  
VERTICAL SECTIONS

DATE: 06/02/09  
DRAWING NO: FE10001  
SCALE: 1:4  
SHEET: 5 OF 7

PREPARED BY: C.D.  
SCALE: 1:4  
REV: 5 OF 7


**FEI**  
PTC, LLC  
Phone 321.690.1788  
Fax 321.690.1789

PROJECT #309-0209  
Robert J. Amoroso, P.E.  
FL License no. 48752


*7/20/09*

PTC, LLC  
1535 N. Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935


Approved as complying with the  
Florida Building Code  
Date NOV 18 2009  
NOA# 09-0723-06  
Miami Date Product Control  
By *Manuel Carr*

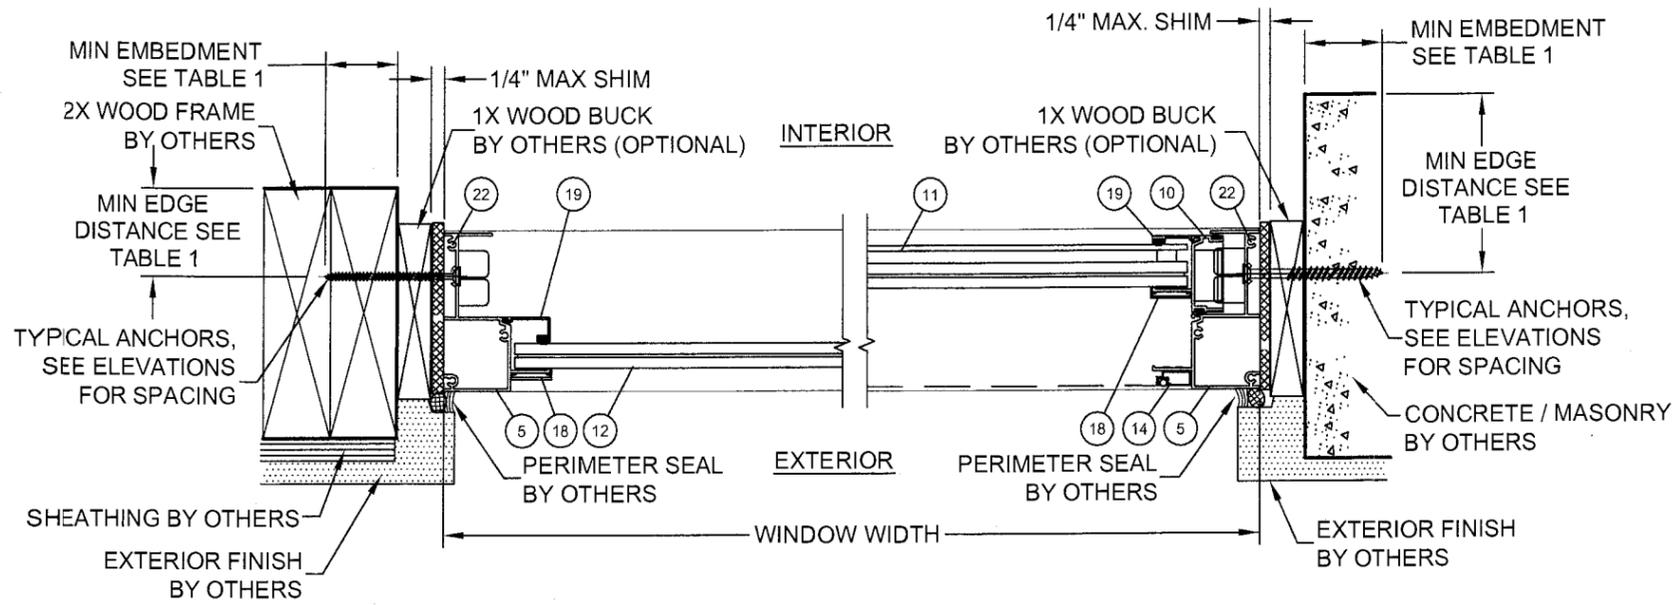


**C HORIZONTAL SECTION**  
WOOD FRAME SUBSTRATE  
WITH EQUAL LEG FRAME

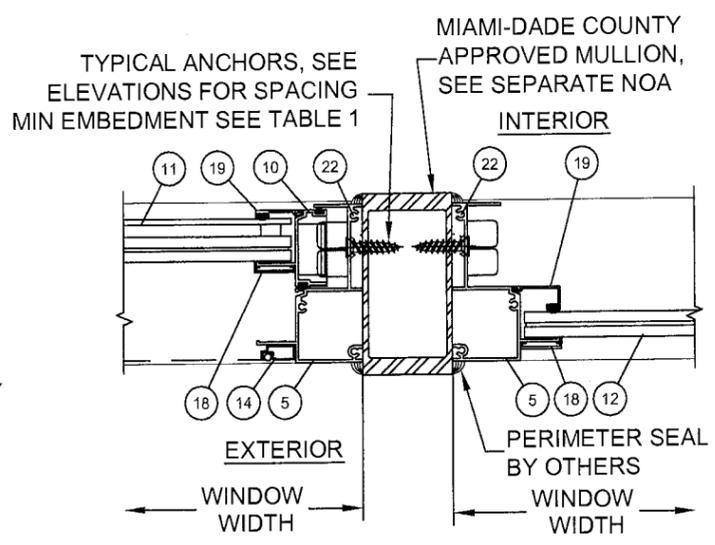


**D HORIZONTAL SECTION**  
CONCRETE / MASONRY SUBSTRATE  
WITH EQUAL LEG FRAME

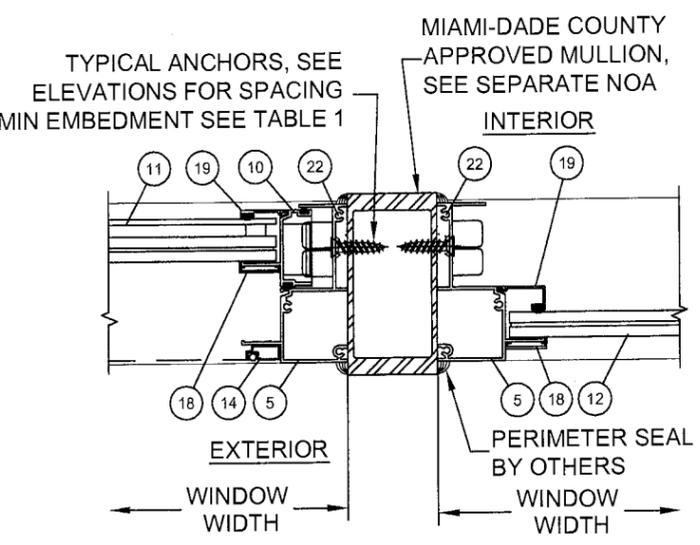


**HORIZONTAL SECTION**  
2x4 ALUMINUM TUBE MULLION  
WITH EQUAL LEG FRAME

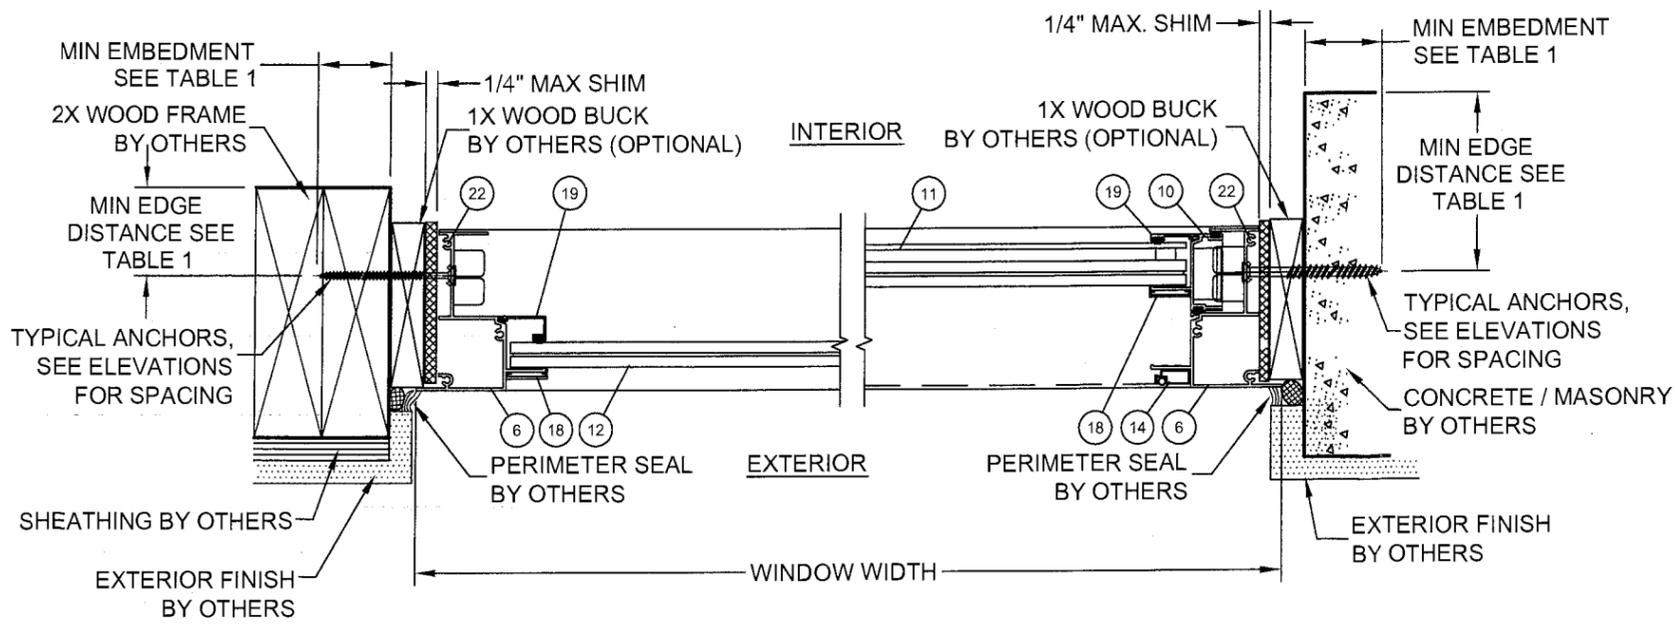

**G HORIZONTAL SECTION**  
WOOD FRAME SUBSTRATE  
WITH FLANGE FRAME

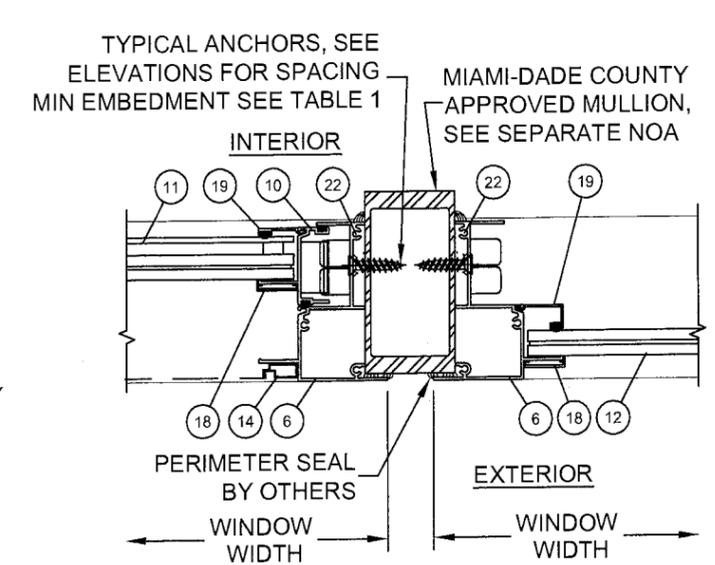

**H HORIZONTAL SECTION**  
CONCRETE / MASONRY SUBSTRATE  
WITH FLANGE FRAME

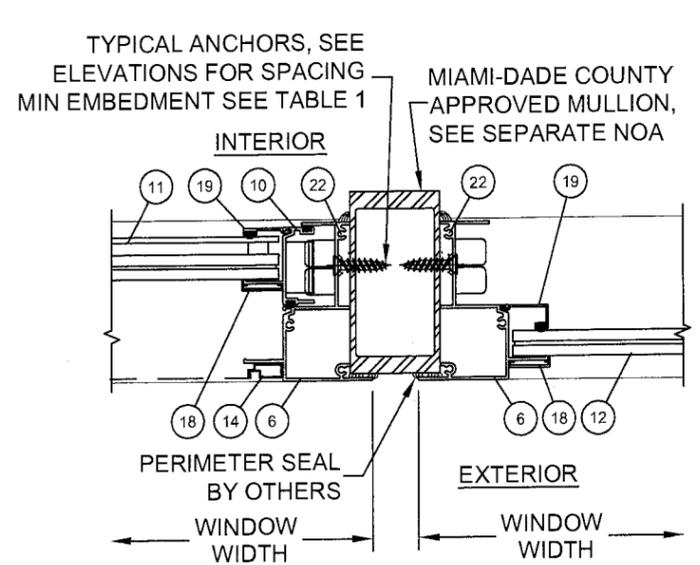

**HORIZONTAL SECTION**  
2x4 ALUMINUM TUBE MULLION  
WITH FLANGE FRAME

FLORIDA EXTRUDERS INTERNATIONAL, INC. 2540 JEWETT LANE SANFORD, FLORIDA 32771-1687		DATE: 07/20/09	BY
MILESTONE SERIES 5000 ALUMINUM SH WINDOWS HORIZONTAL SECTIONS		DRAWING NO: FEI0001	DATE
PREPARED BY: PTC, LLC Phone 321.660.1788 Fax 321.660.1789		SCALE: 1:4	DESCRIPTION
DRAWN BY: C.D.		REV: 6 OF 7	BY


PROJECT #309-0206  
Robert J. Amoroso, P.E.  
FL License no. 49782

*Walt Tuller*


PTC, LLC  
1535 N. Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

Approved as complying with the  
Florida Building Code  
Date: *Nov 18 2009*  
By: *Mamed J...*


① **FRAME HEAD-EQ LEG**

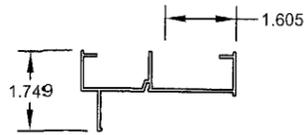


② **FRAME HEAD-FLANGE**




③ **FRAME SILL-EQ LEG**

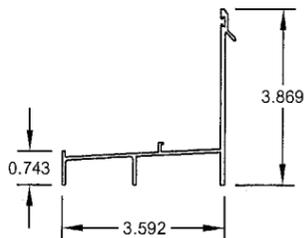


④ **FRAME SILL-FLANGE**

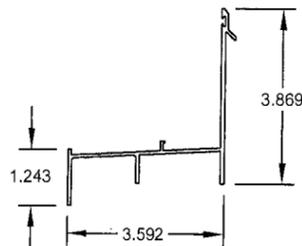


⑤ **FRAME JAMB-EQ LEG**




⑥ **FRAME JAMB-FLANGE**




⑦ **FIXED RAIL**




⑧ **MEETING RAIL**




⑨ **HIGH LIFT RAIL**




⑩ **SASH JAMB**




⑮ **SILL LOCK (OPTIONAL)**




⑯ **SILL RETAINER**




⑰⑱ **MUNTIN ADAPTOR HORIZONTAL OR VERTICAL**





⑲ **GLAZING BEAD HORIZONTAL OR VERTICAL FOR 7/16" GLASS**




⑲ **GLAZING BEAD HORIZONTAL OR VERTICAL FOR 1" INSULATED GLASS**



⑳ **FRAME HEAD OR SILL FILLER**

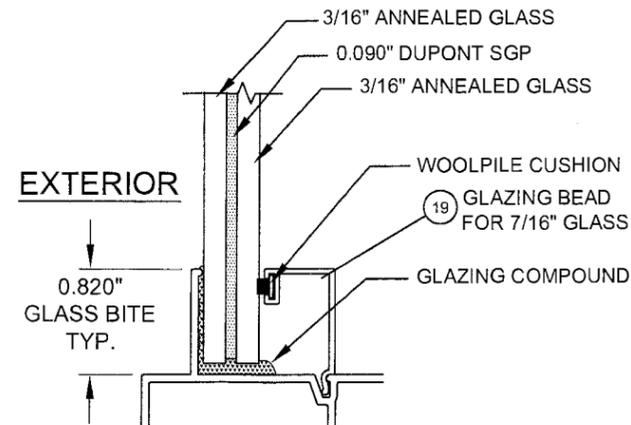

**7/16" LAMI GLAZING DETAIL**  
FOR ELEVATION 1 & 2

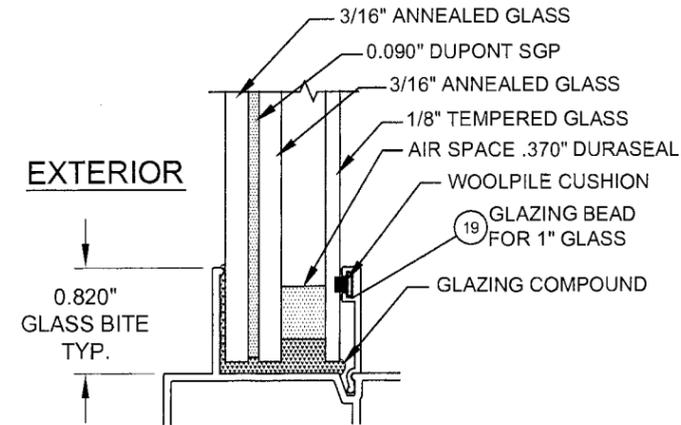

**1" LAMI+IG GLAZING DETAIL**  
FOR ELEVATION 1 & 2

**NOTES:**  
LAMI: LAMINATED GLASS  
IG: INSULATED GLASS

**COMPONENTS**  
SCALE: 1: 4

BILL OF MATERIALS			
ITEM #	PART DESCRIPTION	PART # OR FEI DWG	MATERIAL
1	FRAME HEAD-EQ LEG	FE 5900	ALUM. EXTRUSION
2	FRAME HEAD-FLANGE	FE 5907	(6063-T6) ALUM. EXTRUSION
3	FRAME SILL-EQ LEG	FE 5901	(6063-T6) ALUM. EXTRUSION
4	FRAME SILL-FLANGE	FE 5908	(6063-T6) ALUM. EXTRUSION
5	FRAME JAMB-EQ LEG	FE 5902	(6063-T6) ALUM. EXTRUSION
6	FRAME JAMB-FLANGE	FE 5909	(6063-T6) ALUM. EXTRUSION
7	FIXED RAIL	FE 5903	(6063-T6) ALUM. EXTRUSION
8	MEETING RAIL	FE 5904	(6063-T6) ALUM. EXTRUSION
9	HIGH LIFT RAIL	FE 5905	(6063-T6) ALUM. EXTRUSION
10	SASH JAMB	FE 5906	(6063-T6) ALUM. EXTRUSION
11	SASH GLASS	NA	SEE GLAZING DETAILS
12	FIXED GLASS	NA	SEE GLAZING DETAILS
13	SCREEN HEAD & SILL	ROLLFORM	
14	SCREEN JAMB	ROLLFORM	
15	SILL LOCK (OPTIONAL)	FE 5031	ALUM. EXTRUSION
16	SILL RETAINER	FE 5910	(6063-T6) ALUM. EXTRUSION
17	MUNTIN ADAPTER HORIZONTAL	FE 5911	(6063-T6) ALUM. EXTRUSION
18	MUNTIN ADAPTER VERTICAL	FE 5911	(6063-T6) ALUM. EXTRUSION
19	7/16" GLAZING BEAD	FE 5915	(6063-T6) ALUM. EXTRUSION
	1" GLAZING BEAD	FE 5912	(6063-T6) ALUM. EXTRUSION
20	FIXED RAIL ASSY SCREW	NA	#8 x 3/4" PN SMS SS
21	FRAME HEAD FILLER	FE 5922	ALUM. EXTRUSION
22	FRAME ASSY SCREW	NA	(6063-T6) #8 x 3/4" PN SMS SS
23	SASH ASSY SCREW	NA	#8 x 3/4" PN SMS SS

FLORIDA EXTRUDERS INTERNATIONAL, INC.  
2540 JEWETT LANE  
SANFORD, FLORIDA 32771-1687

MILESTONE SERIES 5000 ALUMINUM SH WINDOWS  
COMPONENTS, BOM & GLAZING DETAILS

DATE: 07/20/09  
DRAWING NO: FEI0001  
SHEET: 7 OF 7



PTC, LLC  
Phone 321.660.1788  
Fax 321.660.1789

PROJECT #309-0203

Robert J. Amoruso, P.E.  
FL License no. 49752

*Handwritten signature and date: 7/20/09*

PTC, LLC  
1535 N. Cogswell Street, Suite C25  
Rockledge, Florida 32855  
FBPE Certificate of Authorization NO. 25935

Approved as complying with the Florida Building Code  
Date: *08-18-2009*  
NGA# *09-0123-06*  
Missed Date Product Control  
By: *Manuel Perez*

REV	DESCRIPTION	DATE	BY