



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

www.miamidade.gov

NOTICE OF ACCEPTANCE (NOA)

Butler Manufacturing Company
13500 Botts Road
Grandview, Missouri 64030

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: "MR-24" 0.032" (min.) Galvalume Steel Roof Panel

APPROVAL DOCUMENT: Drawing No. B, titled "MR-24 Roof Panel", sheets 1 through 6 of 6, prepared by Butler Manufacturing Company, signed & sealed by Russell Benton, P.E., on September 15, 2009, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each panel shall bear a permanent label w/the manufacturer's name or logo, Jackson, TN / Annville, PA, and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews** NOA # **08-1112.11** and consists of this page 1, evidence submitted pages E-1, E-2 & E-3 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
 12/09/2009

NOA No. 09-0811.17
Expiration Date: 12/09/2014
Approval Date: 12/09/2009

Butler Manufacturing Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 99-0816.08

A. DRAWINGS

1. *Drawing No. B, sheets 1 through 6 of 6, prepared by Suresh C. Satsangi, P.E., dated November 4, 1999, signed and sealed by Suresh C. Satsangi, P.E.*

B. TESTS

1. *Test report on Uplift Resistance per UL 580 Class 90 on MR-24 Roof Panel, prepared by Hurricane Test Laboratory, Inc., Report No. 0063-0311-99, dated 03/22-24/99, signed and sealed by Vinu J. Abraham, P.E.*
2. *Test report on Accelerated Weathering Testing of Coating 2000 hours per ASTM G26-96, prepared by Celotex, Report No. 520223, dated 08/02/99, signed and sealed by R. C. Miller, P.E.*
3. *Test report on Salt Spray Testing of Coating 1000 hours per ASTM B117-95, prepared by Celotex, Report No. 520223, dated 08/02/99, signed and sealed by R. C. Miller, P.E.*
4. *Susceptibility to leakage test in accordance with Miami-Dade County Protocol PA 114 Appendix G, prepared by Celotex, Report No. 520223-1, dated 07/01/99, signed and sealed by R. C. Miller, P.E.*

C. CALCULATIONS

1. *Calculations titled "MR-24 Wind Load Design for Roof", dated 07/28/99, pages 1 through 10 of 10, prepared by Suresh C. Satsangi, P.E., signed and sealed by Suresh C. Satsangi, P.E.*

D. MATERIAL CERTIFICATIONS

1. *Mill Certified Test Report issued by U. S. Steel Group, dated 01/21/99, with chemical composition and mechanical properties of galvalume steel.*
2. *Tensile Test on specimen #3 of Test No. 0063-0311-99, Report No. 9CM-777A, prepared by QC Metallurgical, Inc., dated 04/23/99, signed and sealed by Frank Grate, P.E.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 02-1211.09

A. DRAWINGS

1. *Drawing No. B, titled "Mr-24 Roof Panel", sheets 1 through 6 of 6, prepared by Butler Manufacturing Company, dated January 06, 2003, sheets 1 & 2 of 6, and dated November 4, 1999, sheets 3, 4, 5, & 6 of 6, all signed and sealed by John Ernest Lamb, P.E. on January 16, 2003.*

B. TESTS

1. *None.*



Helmy A. Makar, P.E., M.S.
Senior Product Control Examiner
NOA No. 09-0811.17
Expiration Date: 12/09/2014
Approval Date: 12/09/2009

Butler Manufacturing Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. *None.*

D. MATERIAL CERTIFICATIONS

1. *None.*

3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 04-0803.01

A. DRAWINGS

1. *Drawing No. B, titled "MR-24 Roof Panel", sheets 1 through 6 of 6, prepared by Butler Manufacturing Company, dated 07/12/2004, sheets 1 & 2 of 6, & 11/04/1999, sheets 3, 4, 5, & 6 of 6, all signed & sealed by John Ernest Lamb, P.E. on 07/25/2004*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *Calculations titled "MR-24 Roof Panel", dated 07/08/04, 5 pages, prepared by Myron Kottwitz, P.E., signed and sealed by Myron Kottwitz.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*

4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #08-0208.04

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*



Helmy A. Makar, P.E., M.S.
Senior Product Control Examiner
NOA No. 09-0811.17
Expiration Date: 12/09/2014
Approval Date: 12/09/2009

Butler Manufacturing Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #08-1112.11

A. DRAWINGS

1. *None.*

B. TESTS

2. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*

6. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *Drawing No. B, titled "MR-24 Roof Panel", sheets 1 through 6 of 6, prepared by Butler Manufacturing Company, signed & sealed by Russell Benton, P.E., on September 15, 2009.*

B. TESTS

1. *Test report on Uplift Resistance per ASTM 1592 on MR-24 Roof Panel, prepared by Hurricane Test Laboratory, Inc., Report No. 0063-0904-08, dated 12/19/08, signed and sealed by Vinu J. Abraham, P.E.*

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*



E. MATERIAL CERTIFICATIONS

1. *None.*



Helmy A. Makar, P.E., M.S.
Senior Product Control Examiner
NOA No. 09-0811.17
Expiration Date: 12/09/2014
Approval Date: 12/09/2009


FIRST RELEASE	DATE	11/04/99	CHKD	MAH
REVISION NUMBER 1	DATE	01/06/03	CHKD	MAH
REVISION NUMBER 2	DATE	07/12/04	CHKD	JRS
REVISION NUMBER 3	DATE	09/14/09	CHKD	JRS

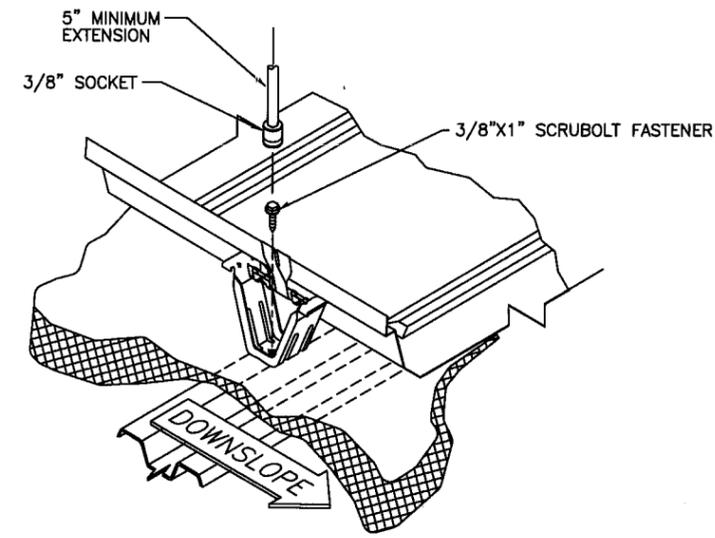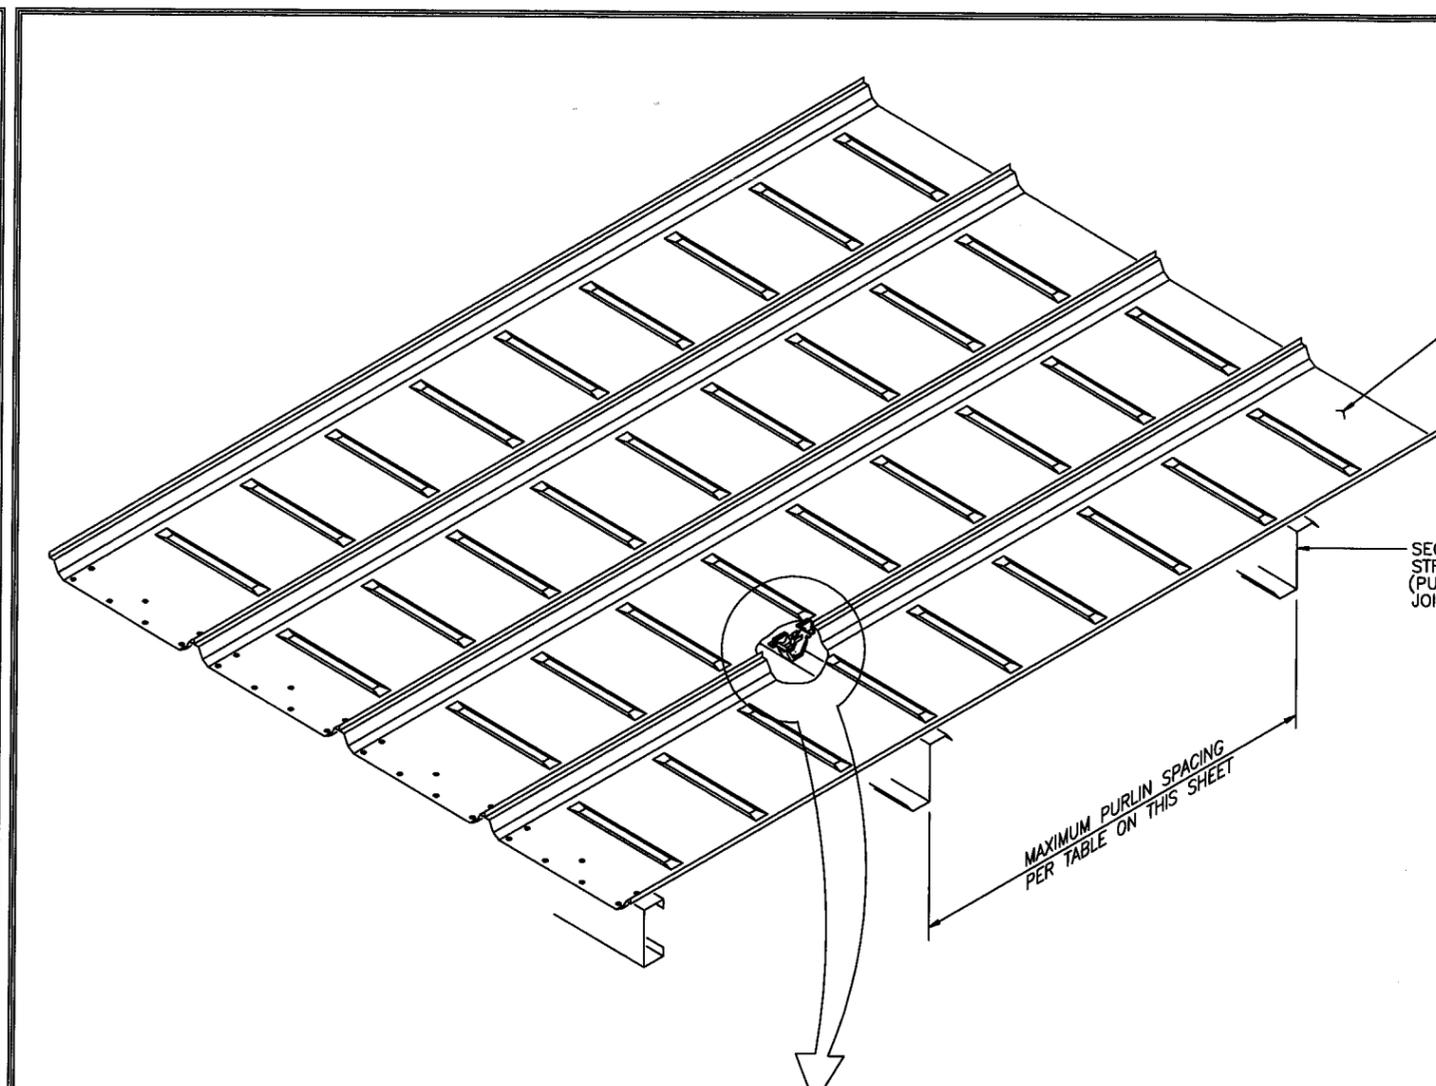

NOTE:
 WITH THE EXCEPTION OF THE PURLIN SPACING AND THE CLIP ATTACHMENT FASTENER SHOWN ON THIS DRAWING REFER TO THE STANDARD MR-24 DRAWINGS FOR ALL OTHER DETAILS AND INSTALLATION INSTRUCTIONS.

PURLIN SPACING		
ROOF ZONE	MAXIMUM PURLIN SPACING	MAX. UPLIFT PRESSURE
FIELD (INTERIOR)	4'-0"	45.0
EDGE	2'-0"	77.5
CORNER	1'-3"	115.8

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No 09-0811.17
 Expiration Date 12/09/2014
 By [Signature]
 Miami Dade Product Control Division

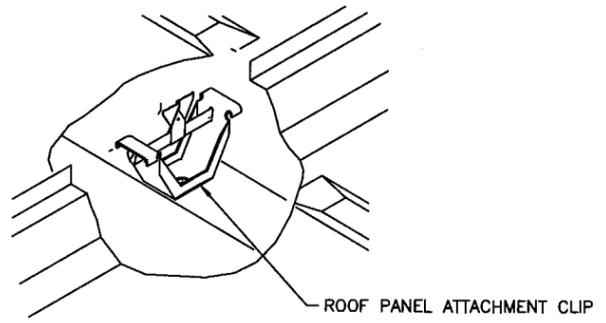



GENERAL NOTES:

1. THIS STRUCTURAL ROOF PANEL SHALL BE DESIGNED IN ACCORDANCE WITH THE 2007 EDITION OF THE FLORIDA BUILDING CODE.
2. ALL BUTLER MR-24 ROOF PANELS SHALL BE 22 GAUGE (0.032" MIN.) GALVALUME STEEL SHEET CONFORMING TO ASTM A 792, COATING DESIGNATION AZ55, WITH A MINIMUM FY=50 KSI.
3. ALL PANEL CLIPS SHALL HAVE A 16 GAUGE (0.062") BASE CONFORMING TO ASTM A 653 GRADE 42, COATING DESIGNATION G60 SHALL HAVE OVERALL DIMENSIONS OF 4-3/8"(LONG) X 1-1/2"(WIDE) X 2-1/4"(TALL) OR 3-5/16"(TALL), AND SHALL HAVE A 24 GAUGE STAINLESS STEEL TAB, 1-1/4" WIDE.
4. ALL SCREWS SHALL BE 3/8" DIA. X 1" HEX HEAD, SELF TAPPING SCRUBOLT, WITH EPDM BACKED STEEL WASHER, PART NUMBER 097196 BY BUTLER MANUFACTURING COMPANY.
5. ALL PANEL CLIPS SHALL BE ATTACHED TO PURLINS WITH A MINIMUM THICKNESS OF 0.067".
6. VALLEY ASSEMBLY IS NOT ALLOWED IN THIS ROOF PANEL APPROVAL.
7. EACH PANEL TO PANEL CONNECTION IS TO BE MADE WITH A POSITIVE, FIELD FORMED STANDING DOUBLE-LOCK SEAM.
8. THIS 22 GAUGE (0.032" MIN.) BUTLER MR-24 ROOF PANEL SHALL BE USED FOR ROOF CONSTRUCTION. EVERY PROJECT SHALL BE CONSTRUCTED USING THE SAME DETAILS SHOWN ON THESE APPROVED DRAWINGS INCLUDING:
 - DETAILS OF ALL PANEL MATERIAL CHARACTERISTICS AND SECTIONS WITH DIMENSIONS AND THICKNESS.
 - ASSEMBLY DETAILS INCLUDING ALL CONNECTIONS AND FASTENERS DIAGRAM WITH SIZE AND LOCATION.
 - PANEL'S MAXIMUM SPAN AND PRESSURE FOR THE ROOF'S FIELD, PERIMETER, AND CORNER ZONES BASED ON THE PANEL'S ALLOWABLES SHOWN IN THE TABLE ABOVE.


[Signature]
 9/15/09

GROUP	DRAWING NUMBER	REV.
02-030-06	B 1081383	03

	THIS PRINT SUBJECT TO CHANGE WITHOUT NOTICE. FOR BUILDING ERECTION ALWAYS USE THE PRINTS RECEIVED WITH THE BUILDING SHIPMENT.		MR-24	MR-24 PANEL INSTALLATION DADE COUNTY FLORIDA	ALL BUILDINGS
		BUTLER MANUFACTURING COMPANY	DATE 09/14/09	DRAWING NUMBER B 1081383	REV. 03

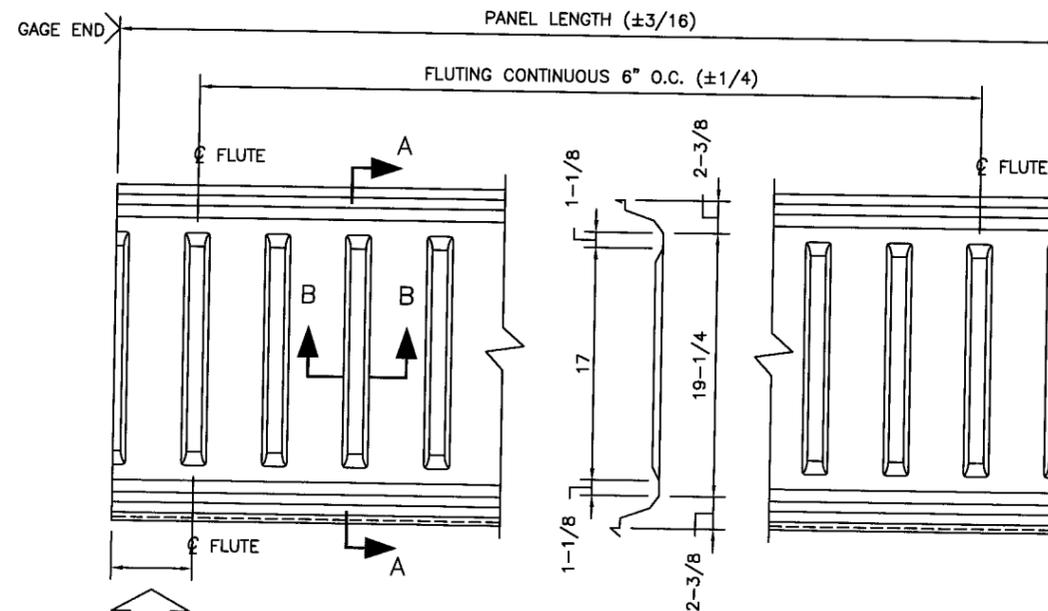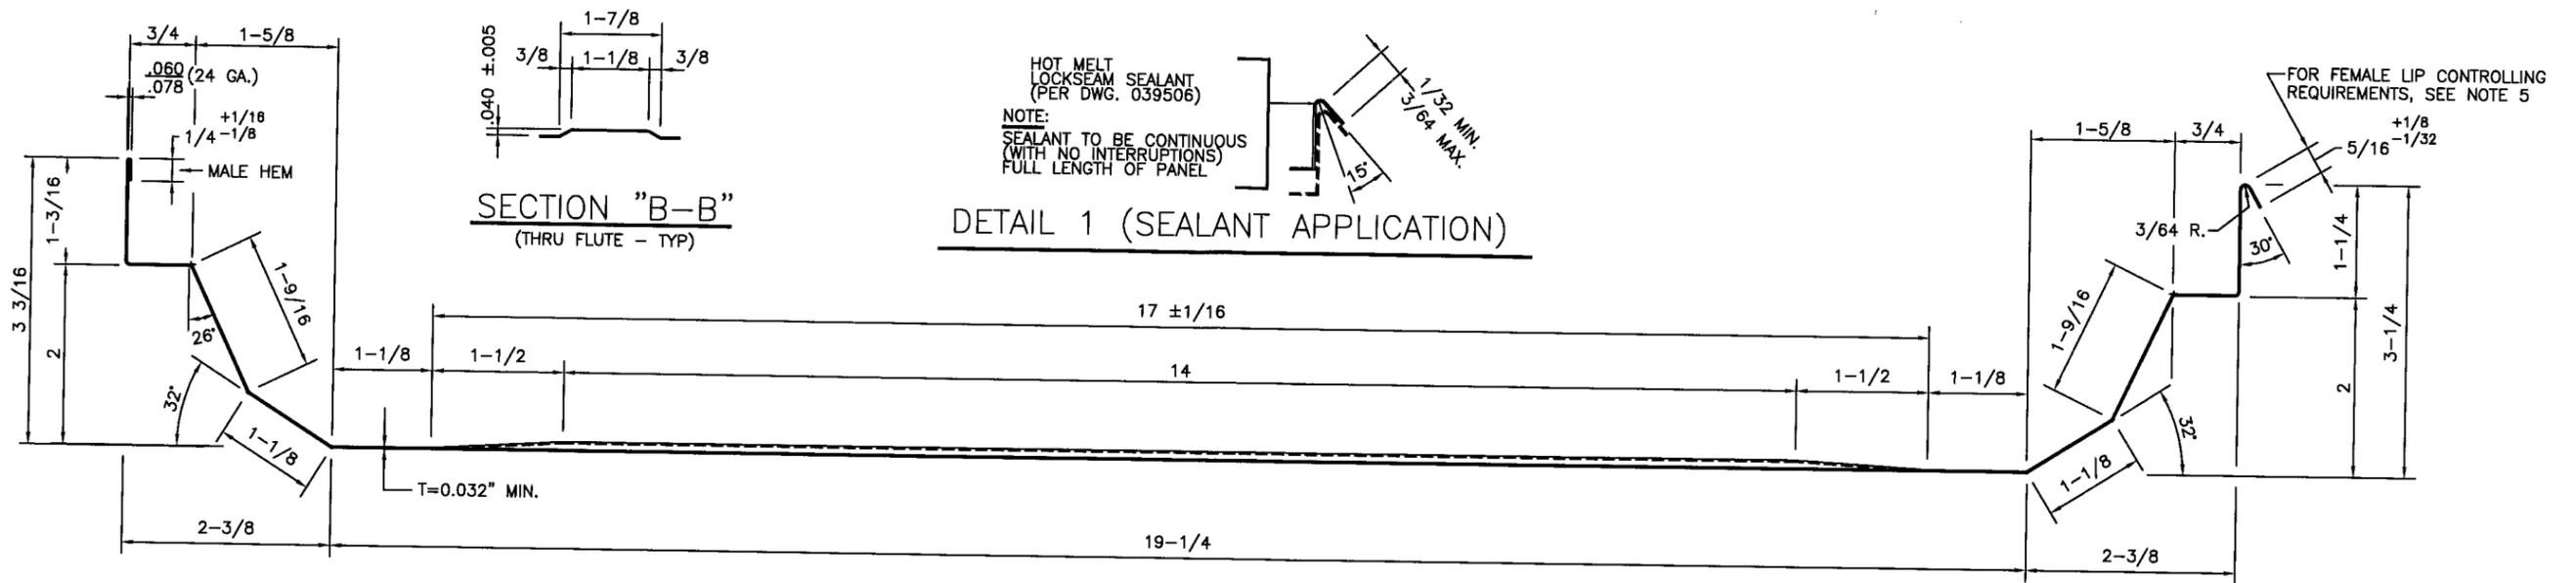

NO DIMENSIONAL LOCATION REQUIREMENTS FOR 6" FLUTE PATTERN IN RELATION TO END OF PANEL (TYPICAL BOTH ENDS OF PANEL)

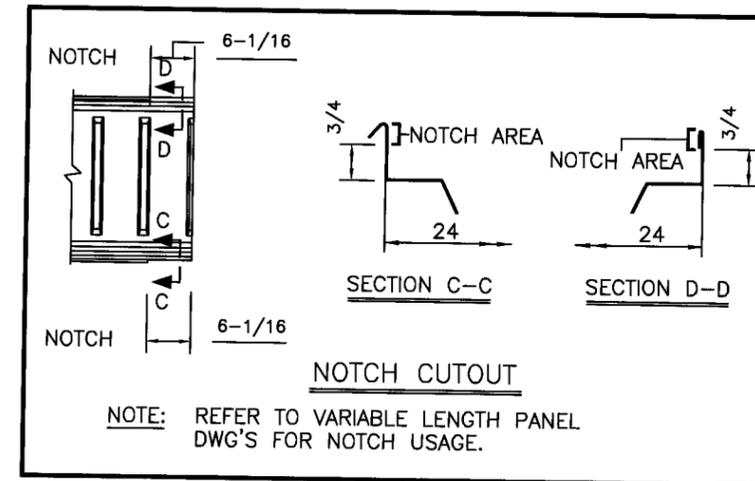

- NOTES:
1. DIMENSIONAL TOLERANCES = ±1/32 (EXCEPT AS NOTED)
 2. ALL INSIDE FORMING RADII = 1/32 (EXCEPT AS NOTED)
 3. ANGLE TOLERANCES ±2° (EXCEPT AS NOTED) (ANGLES TO BE MEASURED FROM A FLAT PLANE WITH PANEL HELD TO THAT PLANE WITHOUT DISTORTION OF FABRICATED CROSS-SECTIONAL SHAPE AND WITH OUTSIDE CORRUGATIONS FREE).
 4. CROSS SECTIONAL TOLERANCES SHOWN TO BE HELD THROUGHOUT LENGTH OF PANEL EXCEPT WHERE PANEL IS DISTORTED BY SHEARING OR BENDING. (MAXIMUM ALLOWABLE LATERAL OR VERTICAL DISTORTION BY THE SHEARING OPERATIONS IS ±1/32 FROM "AS ROLLED SHAPE")
 5. THE LENGTH OF FEMALE LIP MUST BE AT LEAST 1/16" LONGER THAN THE MALE HEM.

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 09-0811.17 Expiration Date 12/09/2014

By *Helmut A. Weber*
Miami Dade Product Control Division

Russell Butler
9/15/04

FIRST RELEASE	DATE	11/04/99	CHKD	JRS	MDK
REVISION NUMBER 1	DATE	01/06/03	DRWN	CHKD	JRS
REVISION NUMBER 2	DATE	07/12/04	DRWN	CHKD	JRS



MAT'L GRADES	MATERIAL DESCRIPTION	B. M. C. SPEC. NO.
GA. OF MAT'L		
22 (0.032" MIN.)	ALUMINUM ZINC ALLOY (GALVALUME)	10179
GR. 50		

GROUP	DRAWING NUMBER	REV.
02-030-06	B 1081384	02



THIS PRINT SUBJECT TO CHANGE WITHOUT NOTICE. FOR BUILDING ERECTION ALWAYS USE THE PRINTS RECEIVED WITH THE BUILDING SHIPMENT.

MR-24	MR-24 ROOF PANEL DADE COUNTY FLORIDA	ALL BUILDINGS
BUTLER A BlueScope Steel Company	BUTLER MANUFACTURING COMPANY	
DATE	DRAWING NUMBER	REV.
07/12/04	B 1081384	02
GROUP		
02-030-06		

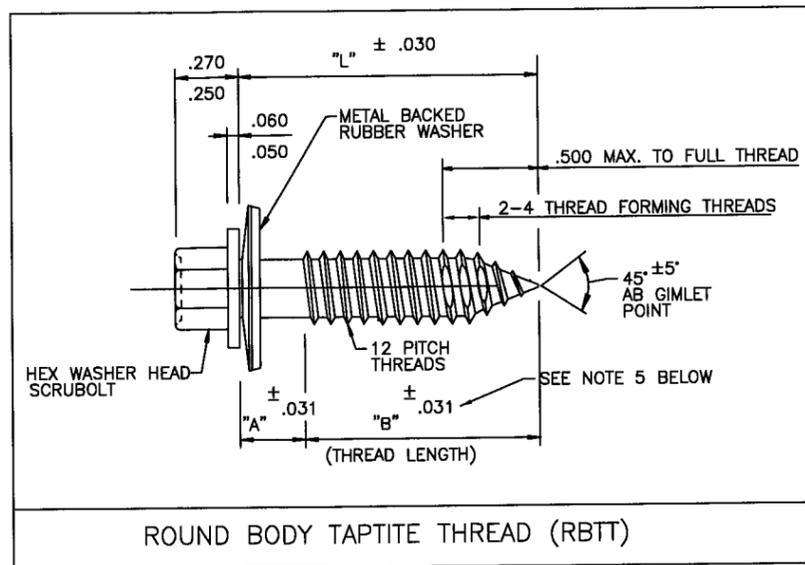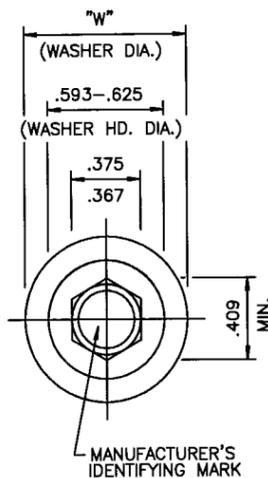

ASSEMBLY		SCRUBOLT WITHOUT WASHER						METAL BACKED RUBBER WASHER		
PART NO.	WEIGHT	SCRUBOLT PART NO.	MATERIAL	NOMINAL SIZE (SEE NOTE 6)	"L"	"A"	"B"	WASHER PART NO.	"W"	WASHER DWG. NO.
095984	0.031	095304	SS NOTE 1	11/32 X 7/8	.875	SEE NOTE 4	.875	097436	.729	095016
096932	0.038	096930	ST. NOTE 2	3/8 X 1-1/4	1.25	SEE NOTE 4	1.250	095154	.729	095016
097104	0.039	097103	SS NOTE 1	11/32 X 1-1/4	1.25	SEE NOTE 4	1.250	097436	.729	095016
097196	0.039	097195	ST. NOTE 2	3/8 X 1	1.00	SEE NOTE 4	1.00	095154	.729	095016
097222	0.055	097221	ST. NOTE 2	3/8 X 2	2.00	.187	1.813	095154	.729	095016
097264	0.074	096931	ST. NOTE 2	3/8 X 2-3/4	2.75	.750	2.00	095154	.729	095016
097270	0.060	097268	ST. NOTE 2	3/8 X 2-1/4	2.25	.250	2.00	095154	.729	095016
097271	0.086	097269	ST. NOTE 2	3/8 X 3-1/2	3.50	.500	3.00	095154	.729	095016
097292	0.125	097291	ST. NOTE 2	3/8 X 5	5.00	2.000	3.00	095154	.729	095016
097298	0.145	097297	ST. NOTE 2	3/8 X 6	6.00	3.000	3.00	095154	.729	095016

SEE NOTE 5

MATERIALS:

- 410 STAINLESS W/CLEAR CHROMATE, BMC EMS 10,073
- CARBON STEEL W/YELLOW CHROMATE - BMC EMS 10,073.
- WASHER SPEC. AND DIMENSIONS - SEE DWG 095016

SCRUBOLT WITH FULL THREADS:

- FULL THREAD TO WITHIN 1 THREAD OF HEAD & SHANK JUNCTURE.
- 3" THREAD LENGTH
HAS A ± .050 TOLERANCE
- DIAMETER OF 3/8" SCRUBOLT IS .367±.003
DIAMETER OF 11/32" SCRUBOLT IS .345±.003

PRODUCT REVISED

as complying with the Florida Building Code
Acceptance No 09-0811-17
Expiration Date 12/09/2014

By *Harley A. Nelson*
Miami Dade Product Control Division

Russell B. Smith
9/15/09

SHEET 3 OF 6




REVISION NUMBER 1
GENERAL REVISION TO REMOVE OBSOLETE FASTENER FROM DRAWING FOR HEX HEAD SCRUBBOLTS.
DATE 11/04/99
DRAWN JRS
CHKD MAH
RHE B.F. LCPD RELEASE 1.1819.

GROUP 02-030-01
DRAWING NUMBER B 1081385
REV. 01




THIS PRINT SUBJECT TO CHANGE WITHOUT NOTICE. FOR BUILDING ERECTION ALWAYS USE THE PRINTS RECEIVED WITH THE BUILDING SHIPMENT.

MR-24 FASTENERS	HEX HEAD SCRUBBOLTS DADE COUNTY FLORIDA	ALL BUILDINGS
BUTLER A BlueScope Steel Company	BUTLER MANUFACTURING COMPANY	DATE 08/30/05 GROUP 02-030-01 DRAWING NUMBER B 1081385 REV. 01

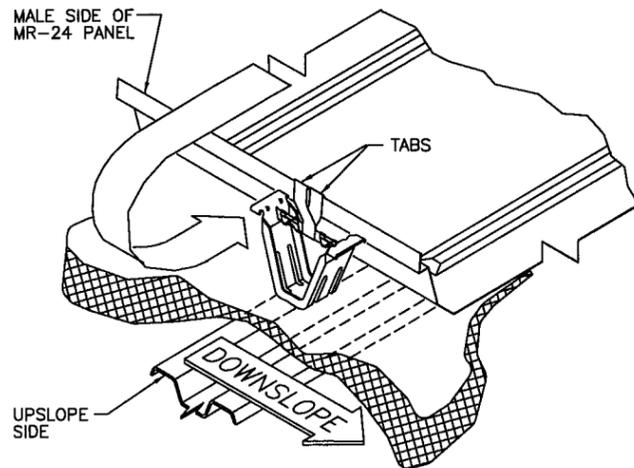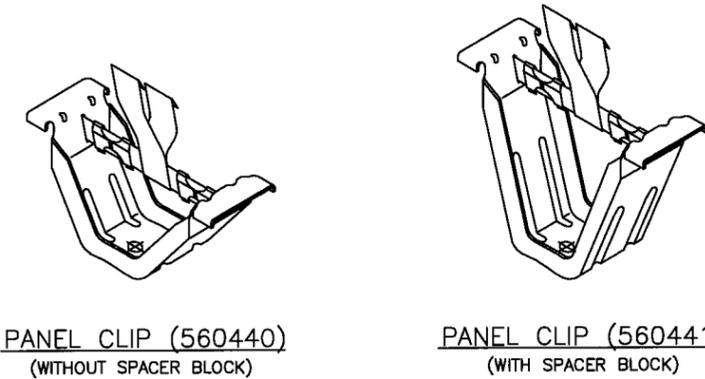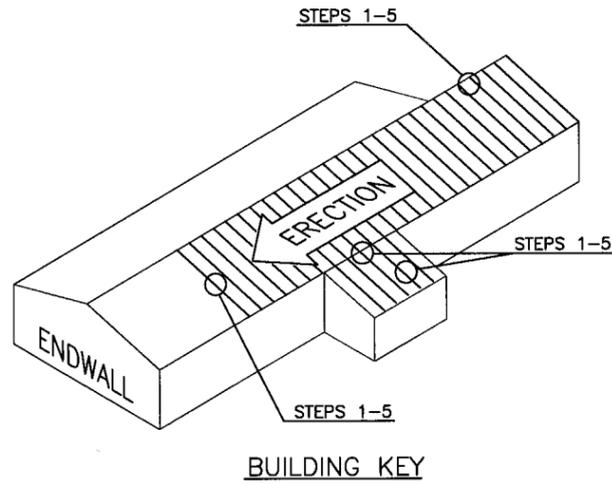


STEP 3 HOOK PANEL CLIP TABS OVER PANEL AND ROTATE CLIP INTO POSITION

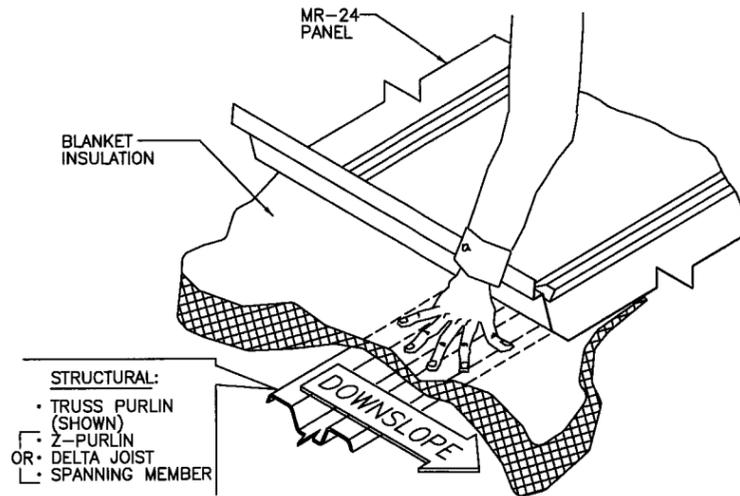


STRUCTURAL:
 • TRUSS PURLIN (SHOWN)
 • Z-PURLIN
 OR • DELTA JOIST
 • SPANNING MEMBER

STEP 1 LOCATE STRUCTURAL


• FROM THE ADJACENT MR-24 PANEL, LOCATE THE STRUCTURAL UNDER THE BLANKET INSULATION.

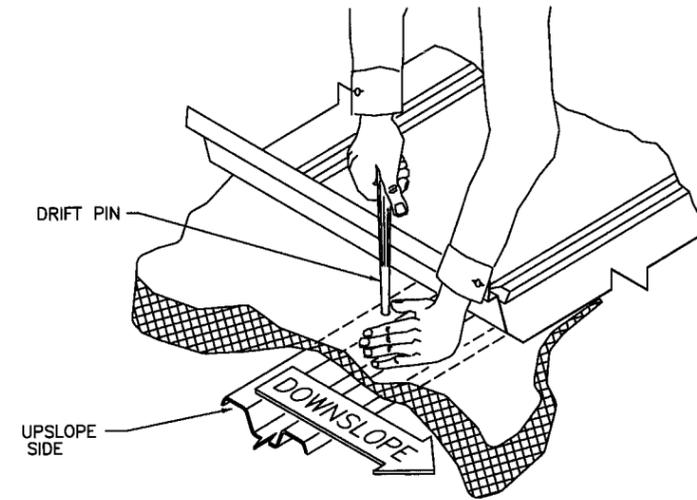

STEP 2 LOCATE HOLE IN STRUCTURAL WITH DRIFT PIN

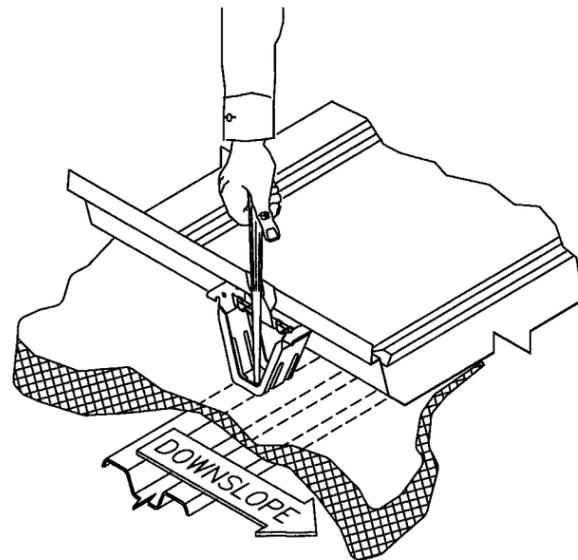

STEP 4 TEMPORARILY SECURE THE PANEL CLIP WITH A DRIFT PIN

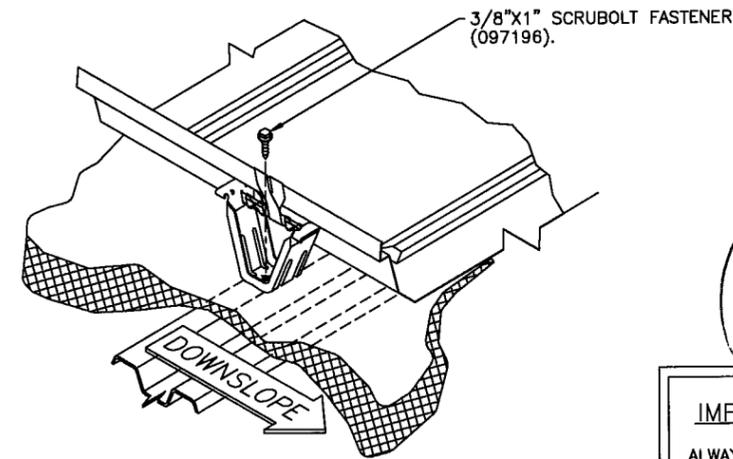

STEP 5 INSTALL SCRUBOLT FASTENER

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0811.17
 Expiration Date 12/09/2014
 By *Helene A. Baker*
 Miami Dade Product Control
 Division

Russell Smith
 9/15/09

IMPORTANT NOTE
 ALWAYS MAKE SURE TABS ARE CENTERED IN THE MR-24 CLIP AFTER THE CLIP IS INSTALLED.


FIRST RELEASE
 DATE 11/04/99
 DRAWN JRS
 CHKD MJH

GROUP 02-030-06
 DRAWING NUMBER B 1081386
 REV. 00




THIS PRINT SUBJECT TO CHANGE WITHOUT NOTICE. FOR BUILDING ERECTION ALWAYS USE THE PRINTS RECEIVED WITH THE BUILDING SHIPMENT.


MR-24	MR-24 PANEL CLIP INSTALLATION DADE COUNTY FLORIDA	ALL BUILDINGS
BUTLER A BlueScope Steel Company	BUTLER MANUFACTURING COMPANY	DATE 11/04/99 GROUP 02-030-06
DRAWING NUMBER B 1081386		REV. 00

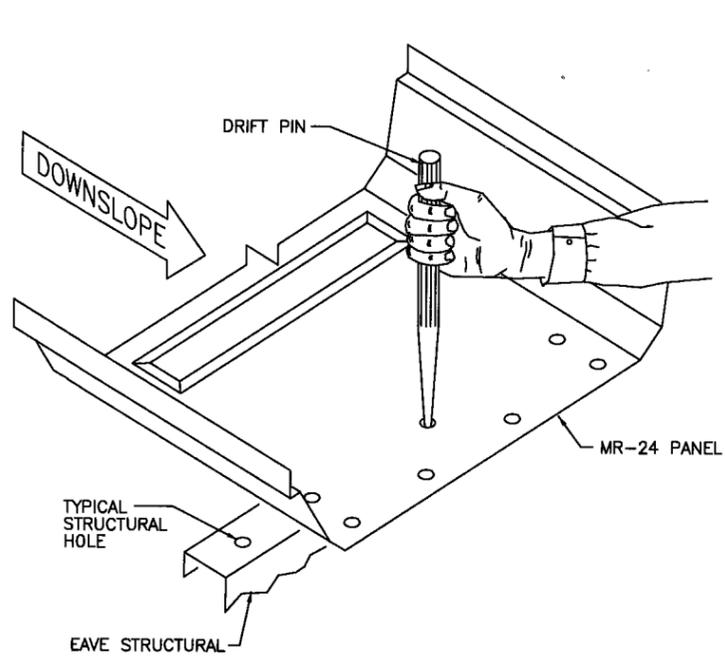


STEP 1 - LOCATE STRUCTURAL HOLE

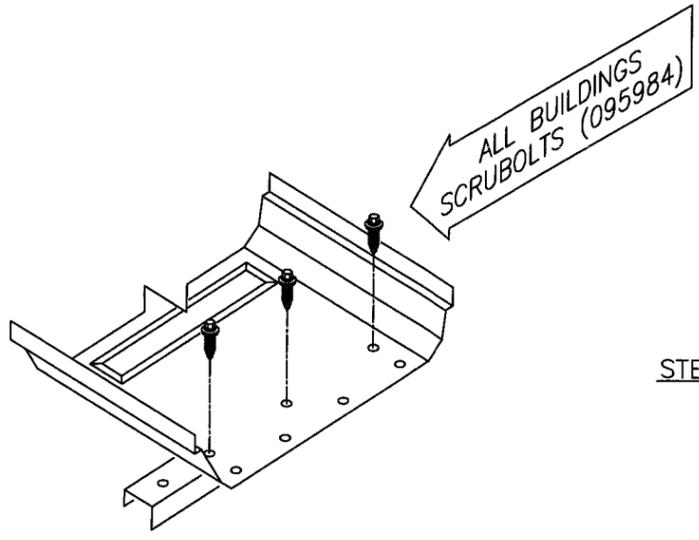


STEP 2 - INSTALL FASTENERS

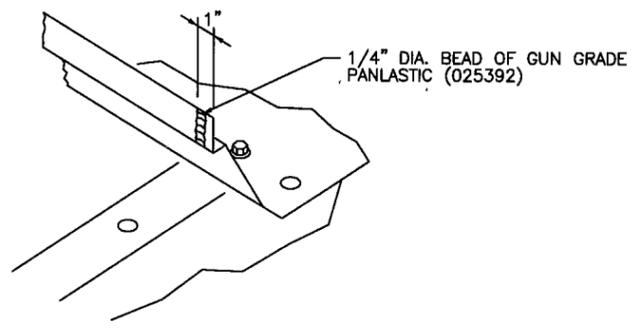


STEP 3 - INSTALL SEALANT

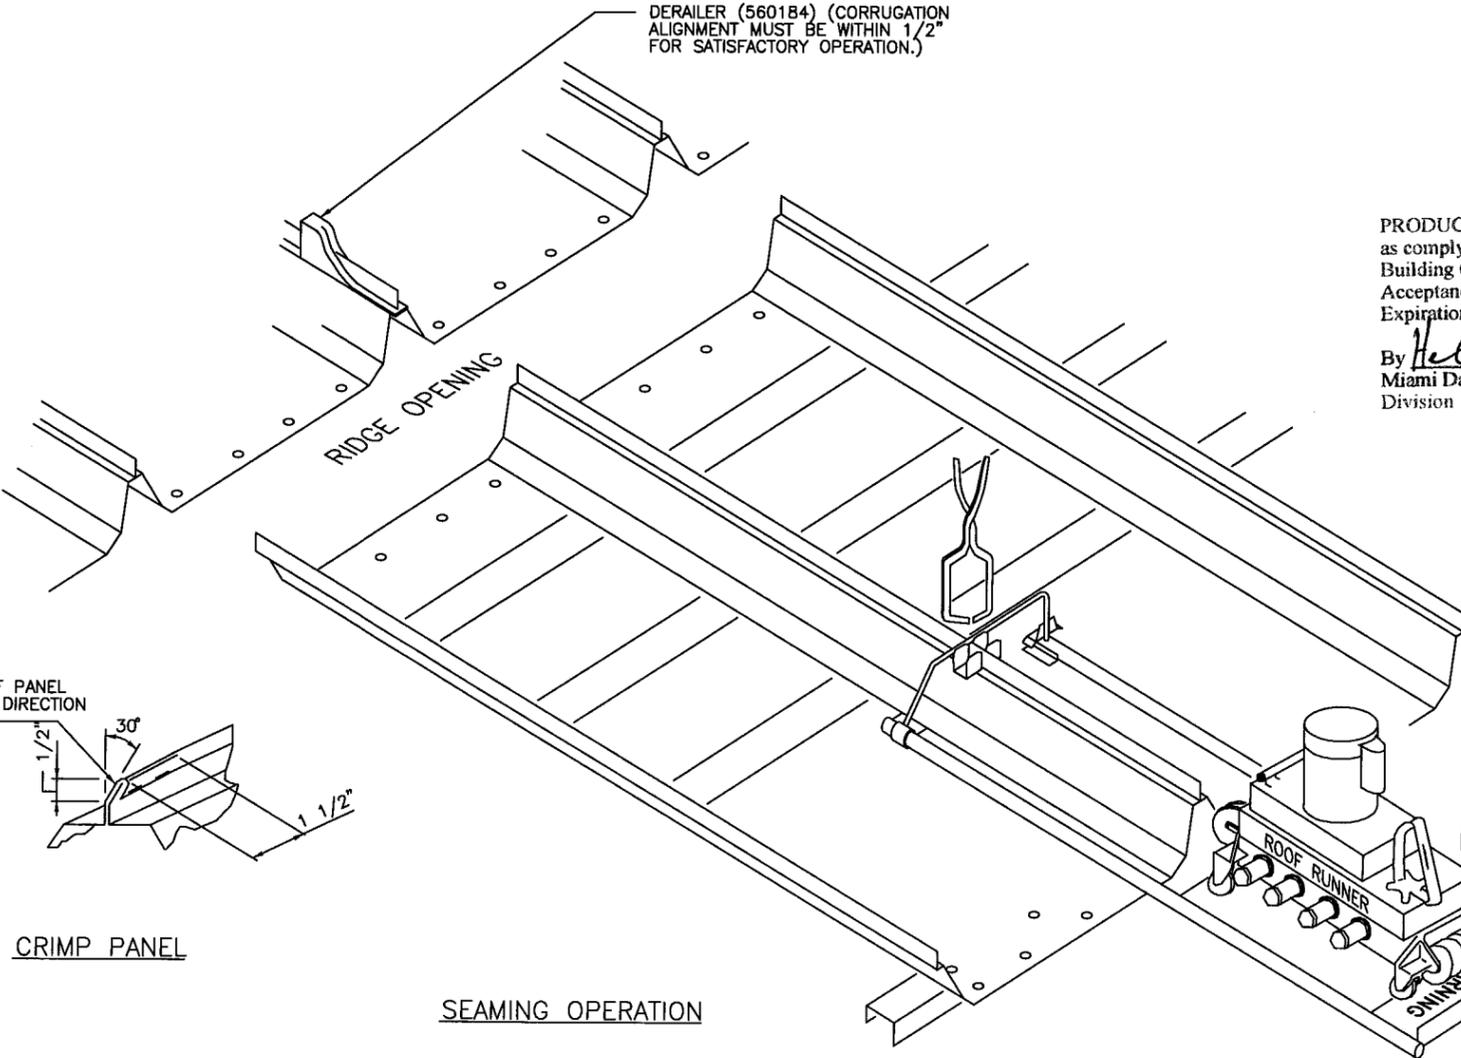

SEAMING OPERATION

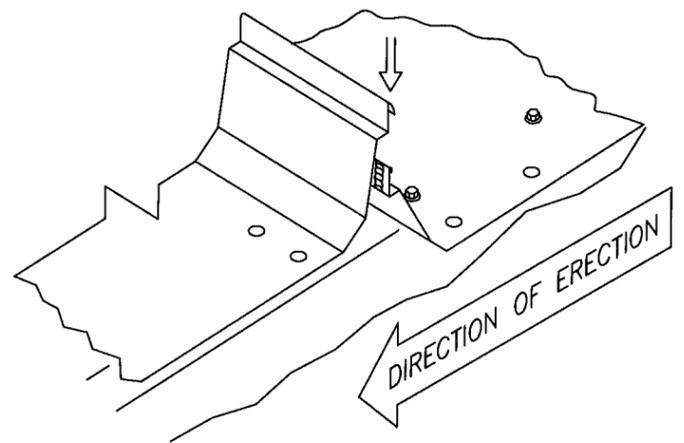

STEP 4 - NEXT PANEL

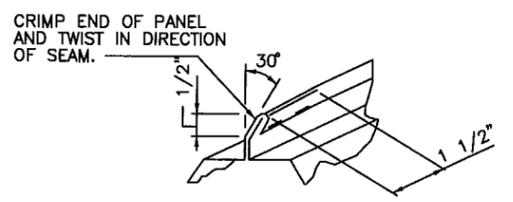

CRIMP PANEL

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0811-17
 Expiration Date 12/09/2014
 By Helena A. Miller
 Miami Dade Product Control
 Division


9/15/09

FIRST RELEASE

DATE 11/04/99

DRAWN CHKD MJH

JRS

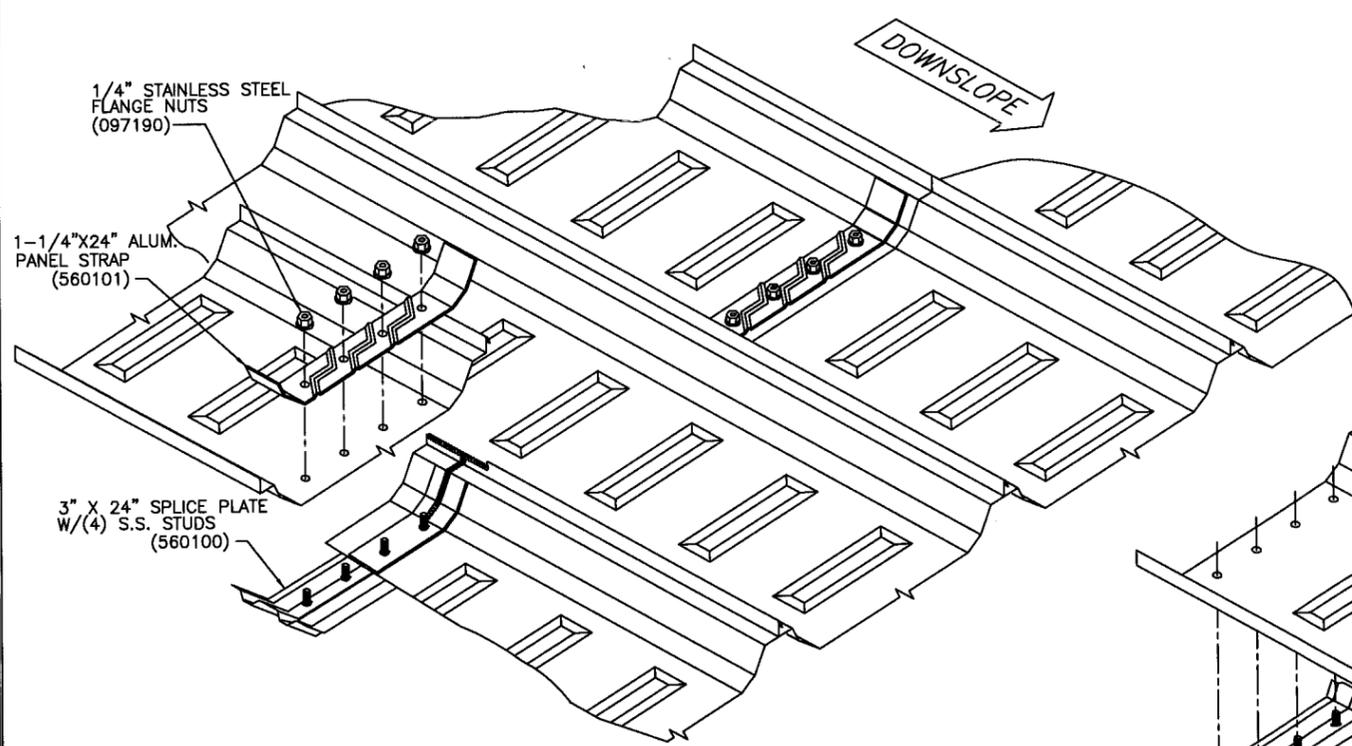


PANEL END LAP SPlice

- PUNCHED AND NOTCHED PANELS ARE FURNISHED WITH LENGTHS CALCULATED FOR END LAP SPICES TO OCCUR OVER SECONDARY STRUCTURALS.
- REFER TO ROOF PANEL LAYOUT DRAWINGS PROVIDED WITH EACH ORDER FOR PROPER PLACEMENT OF STAGGERED END LAP SPICE LOCATIONS.

IMPORTANT:


COMPLETELY ASSEMBLE SPICE BEFORE SEAMING ADJACENT PANELS.

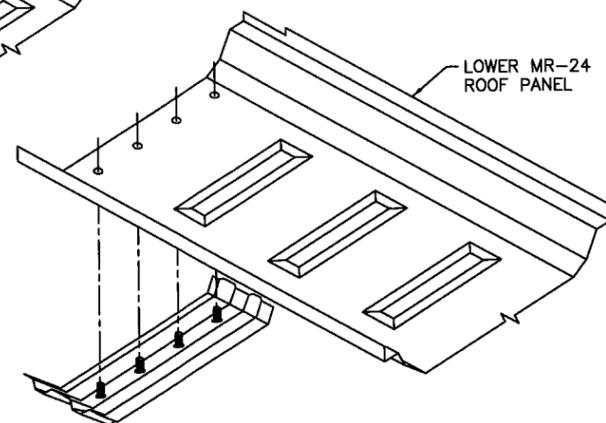

STEP 1 - SPICE PLATE INSTALLATION

- ATTACH PANEL AT EAVE TO STRUCTURAL MEMBER.
- FOR EASE OF INSTALLATION, SPICE PLATE (560100) CAN BE TEMPORARILY ATTACHED TO PANEL WITH (2) FLANGE NUTS BEFORE POSITIONING PANEL.



CAUTION: DO NOT OVERTIGHTEN FLANGE NUTS OR YOU MAY TWIST OFF THE PROJECTING STUDS.

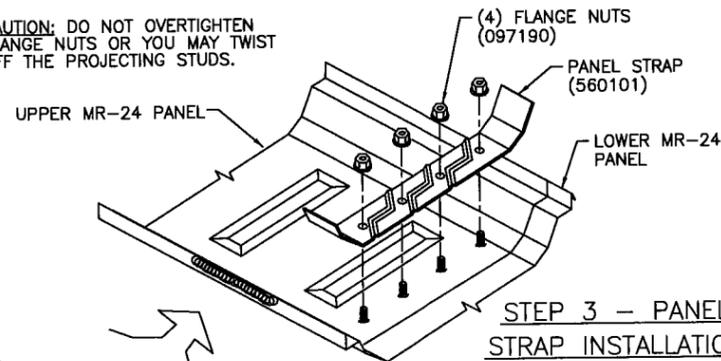

STEP 3 - PANEL STRAP INSTALLATION


- POSITION UPPER PANEL INTO NOTCHED AREA ON LOWER PANEL WHILE ENGAGING STUDS IN PREPUNCHED HOLES.
- HAND HELD WRENCH IS RECOMMENDED TO TIGHTEN FLANGE NUTS (DO NOT USE POWER TOOLS.)
- IF STUDS BREAK, INSTALL A NEW SPICE PLATE.
- APPLY GUN GRADE PANLASTIC TO BACK SIDE OF SEAM BEFORE SUCCEEDING PANELS ARE INSTALLED.

3/8" DIA BEAD OF GUN GRADE PANLASTIC (025392)

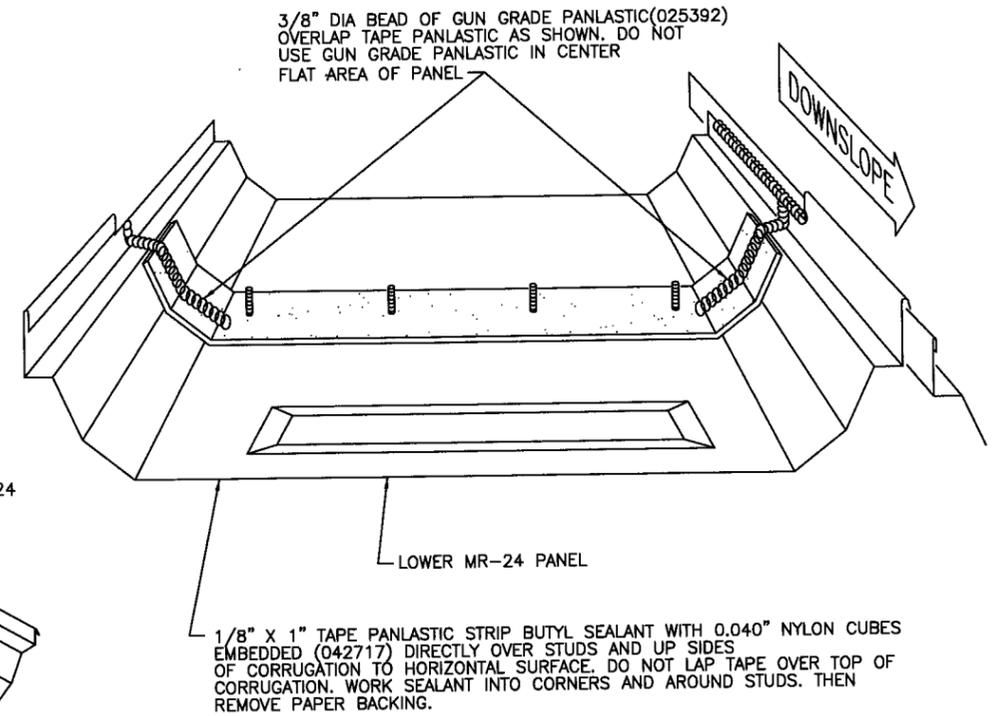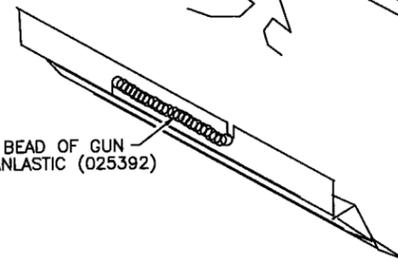

STEP 2 - SEALANT APPLICATION

1/8" X 1" TAPE PANLASTIC STRIP BUTYL SEALANT WITH 0.040" NYLON CUBES EMBEDDED (042717) DIRECTLY OVER STUDS AND UP SIDES OF CORRUGATION TO HORIZONTAL SURFACE. DO NOT LAP TAPE OVER TOP OF CORRUGATION. WORK SEALANT INTO CORNERS AND AROUND STUDS. THEN REMOVE PAPER BACKING.

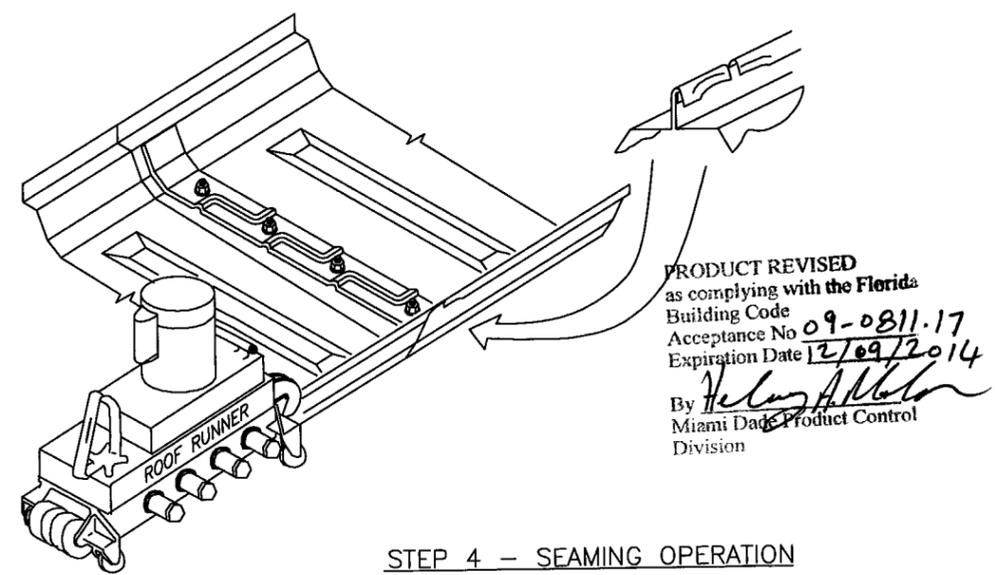

STEP 4 - SEAMING OPERATION

- INSPECT EACH END LAP SPICE FOR PROPER FIT AND WEATHER TIGHTNESS.

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No 09-0811.17
 Expiration Date 12/09/2014
 By *Helena Adelman*
 Miami Dade Product Control Division

Paul Butler
 9/15/09

FIRST RELEASE
 DATE 11/04/99
 DRAWN JRS
 CHKD MJH

GROUP 02-030-06 DRAWING NUMBER B 1081388 REV. 00



THIS PRINT SUBJECT TO CHANGE WITHOUT NOTICE. FOR BUILDING ERECTION ALWAYS USE THE PRINTS RECEIVED WITH THE BUILDING SHIPMENT.

MR-24	MR-24 END LAP SPICE DADE COUNTY FLORIDA	ALL BUILDINGS
BUTLER A BlueScope Steel Company	BUTLER MANUFACTURING COMPANY	DATE 11/04/99 GROUP 02-030-06
DRAWING NUMBER B 1081388		REV. 00