

**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1107
MIAMI, FLORIDA 33130-1563
(305) 375-2902 FAX (305) 372-6339**

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

**Jeld-Wen, Inc. (OR)
3737 Lakeport Blvd.,
Klamath Falls, OR 97601**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "6500 Premium Atlantic" Aluminum Horizontal Slider Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. **JELD0092**, titled "Series 6500 Premium Atlantic Horizontal Slider, LMI", sheets 1 through 7 of 7, prepared by PTC, LLC, dated 04/24/06 with revision "1" on 02/10/10, signed and sealed by L. Roberto J. Amoroso, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. **06-0504.01** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
2/18/10

**NOA No. 09-0916.03
Expiration Date: August 10, 2011
Approval Date: March 10, 2010
Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **JELD0092**, titled "Series 6500 Premium Atlantic Horizontal Slider, LMI", sheets 1 through 7 of 7, prepared by PTC, LLC, dated 04/24/06 with revision "1" on 02/10/10, signed and sealed by Roberto J. Amoruso, P. E.

B. TESTS


1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3588-1**, dated 07/08/09, revised and dated 01/06/10, signed and sealed by Gerard J. Ferrara, P. E.
2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3208-1**, dated 10/31/05, signed and sealed by Gerard J. Ferrara, P. E.
(Submitted under previous NOA No. 06-0504.01)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by PTC, LLC, dated 08/11/09 and 02/09/10, signed and sealed by Roberto J. Amoruso, P. E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0916.03

Expiration Date: August 10, 2011
Approval Date: March 10, 2010

Jeld-Wen, Inc. (OR)

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their “**DuPont Sentry Glass® Interlayer**” dated 05/13/09, expiring on 01/14/12.
2. Notice of Acceptance No. **09-0312.02** issued to E.I. DuPont DeNemours & Co., Inc. for their “**DuPont Butacite® PVB, Interlayer**” dated 05/13/09, expiring on 12/11/10.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated August 11, 2009, signed and sealed by Roberto J. Amoruso, P. E.
2. Laboratory compliance letter for Test Report no. **NCTL-210-3588-1**, issued by National Certified Testing Laboratories, dated July 08, 2009, signed and sealed by Gerard J. Ferrara, P. E.
3. Laboratory compliance letter for Test Report no. **NCTL-210-3208-1**, issued by National Certified Testing Laboratories, dated October 31, 2005, signed and sealed by Gerard J. Ferrara, P. E.
(Submitted under previous NOA No. 06-0504.01)
4. Proposal issued by BCCO, dated November 3, 2008, signed by Jaime D. Gascon, P. E.

G. OTHERS

1. Notice of Acceptance No. **06-0504.01**, issued to Jeld-Wen, Inc. for their Series “6500 Premium Atlantic Aluminum Horizontal Slider Window – LMI”, approved on 08/10/06 and expiring on 08/10/11.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0916.03
Expiration Date: August 10, 2011
Approval Date: March 10, 2010

JELD-WEN

SERIES "6500 PREMIUM ATLANTIC" ALUMINUM HORIZONTAL SLIDER WINDOW, LMI INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE (HVHZ) OF THE 2007 FLORIDA BUILDING CODE (FBC) AT THE DESIGN PRESSURE STATED HEREIN. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORTS #NCTL-210-3208-1 DATED 10/31/05 AND # NCTL-210-3588-1 DATED 06/22/09 AND ASSOCIATED LABORATORY STAMPED DRAWINGS AND WERE TESTED IN ACCORDANCE WITH CURRENT DADE COUNTY PROTOCOLS.
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE STRUCTURE IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
3. 1X BUCKS AND 2X WOOD FRAMING (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.

4. IN AREAS WHERE WIND-BORNE DEBRIS PROTECTION REQUIREMENTS EXIST, USE OF AN APPROVED MIAMI DADE IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED.
5. WINDOW FRAME MATERIAL: ALUMINUM ALLOY 6063-T6
6. GLASS MEETS THE REQUIREMENTS OF ASTM E1300.
7. DESIGNATION "X" STANDS FOR THE FOLLOWING:
X: OPERABLE PANEL
8. A 1/3 INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THE DESIGN OF THE PRODUCT(S) SHOWN HEREIN. WIND LOAD DURATION FACTOR (Cd = 1.0) HAS BEEN USED FOR WOOD ANCHOR DESIGN.

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM SIZE IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
4. FOR INSTALLATION INTO WOOD FRAMING, USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT. MINIMUM EDGE DISTANCE IS 7/8 INCHES.
5. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE / MASONRY, OR DIRECTLY INTO CONCRETE / MASONRY, USE 1/4 INCH ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT. MINIMUM EDGE DISTANCE IS 2-1/2 INCHES.
6. INSTALLATION ANCHORS ARE TO BE LOCATED THROUGH PERIMETER OF NAILING FIN WHEN APPLICABLE .
7. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING.

8. FOR CONCRETE BLOCK APPLICATIONS DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
10. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3192 psi AND COMPLIES WITH ACI 301, ACI 318-05 AND ACI 355
 - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90 AND ACI 530-05, GRADE N, TYPE 1 (OR GREATER).

TABLE OF CONTENTS		
SHEET	REV.	SHEET DESCRIPTION
1	---	GENERAL NOTES, INSTALLATION NOTES & D.P. CHART
2	1	ELEVATIONS & ANCHOR LAYOUTS
3	---	VERTICAL SECTIONS
4	---	HORIZONTAL SECTIONS
5	---	GLAZING DETAIL & BILL OF MATERIALS
6	---	COMPONENTS
7	---	CORNER CONSTRUCTION DETAILS

DESIGN PRESSURE RATING (PSF)	IMPACT RATING
+60.0 / -60.0	LARGE MISSILE IMPACT


PROJECT # 309-0709

JELD-WEN
 355 CENTER COURT
 VENICE, FLORIDA 334292
 TITLE: SERIES 6500 PREMIUM ATLANTIC HORIZONTAL SLIDER, LMI
 GENERAL NOTES, INSTALLATION NOTES & D.P. CHART
 PREPARED BY: SMC
 DRAWN BY: SMC
 DATE: 08/11/09
 SCALE: N.T.S.
 DRAWING NO: JELD0092
 SHEET: 1 OF 7
 REV: 1
 PER MAMI DADE COMMENTS 11/23/09
 DATE 02/10/10
 BY SMC


PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 09-0916.03
 Expiration Date 03/10/2011
 By *[Signature]*
 Miami Dade Product Control Division

Robert J. Amoruso, P.E.
 Florida P.E. No. 49752


[Handwritten Signature]
 02/10/10

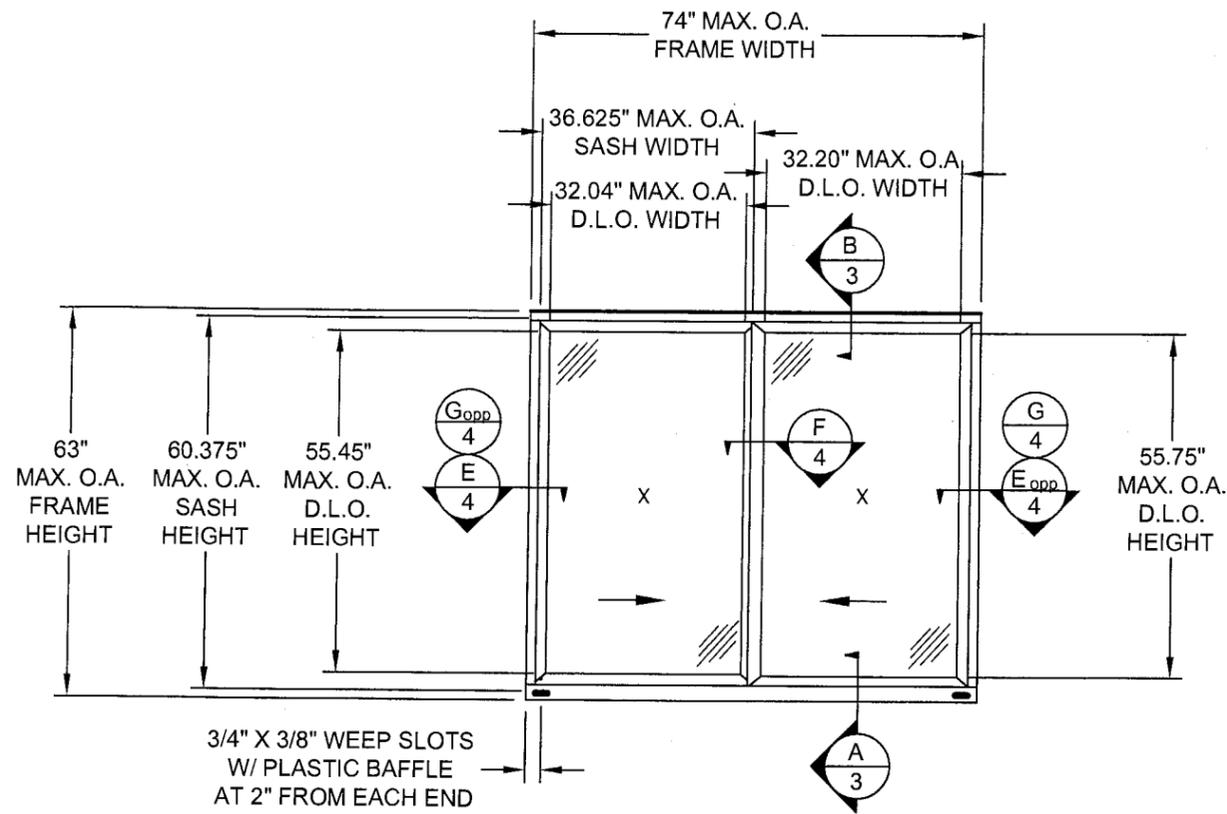


ELEVATION
EXTERIOR VIEW (FLANGE)

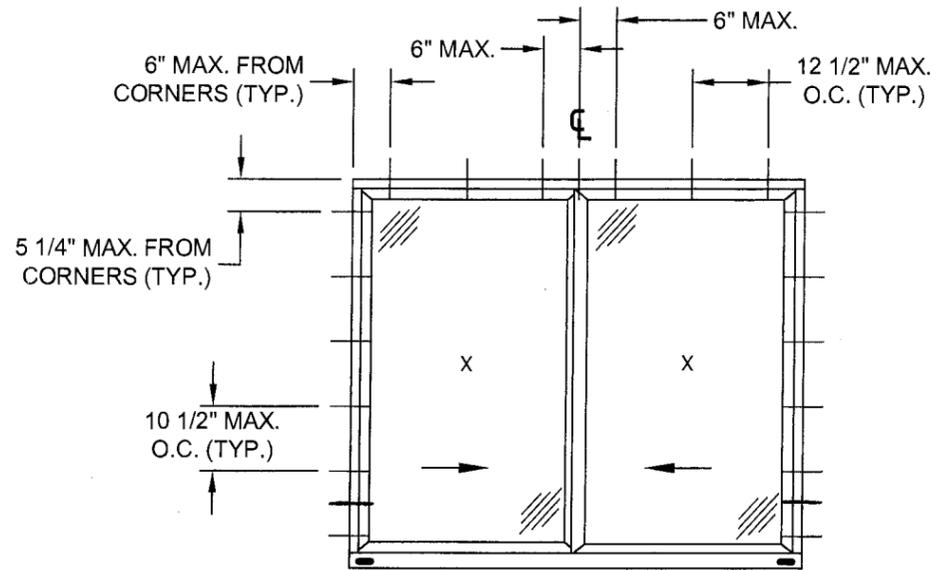

ANCHOR LAYOUT
EXTERIOR VIEW (FLANGE)

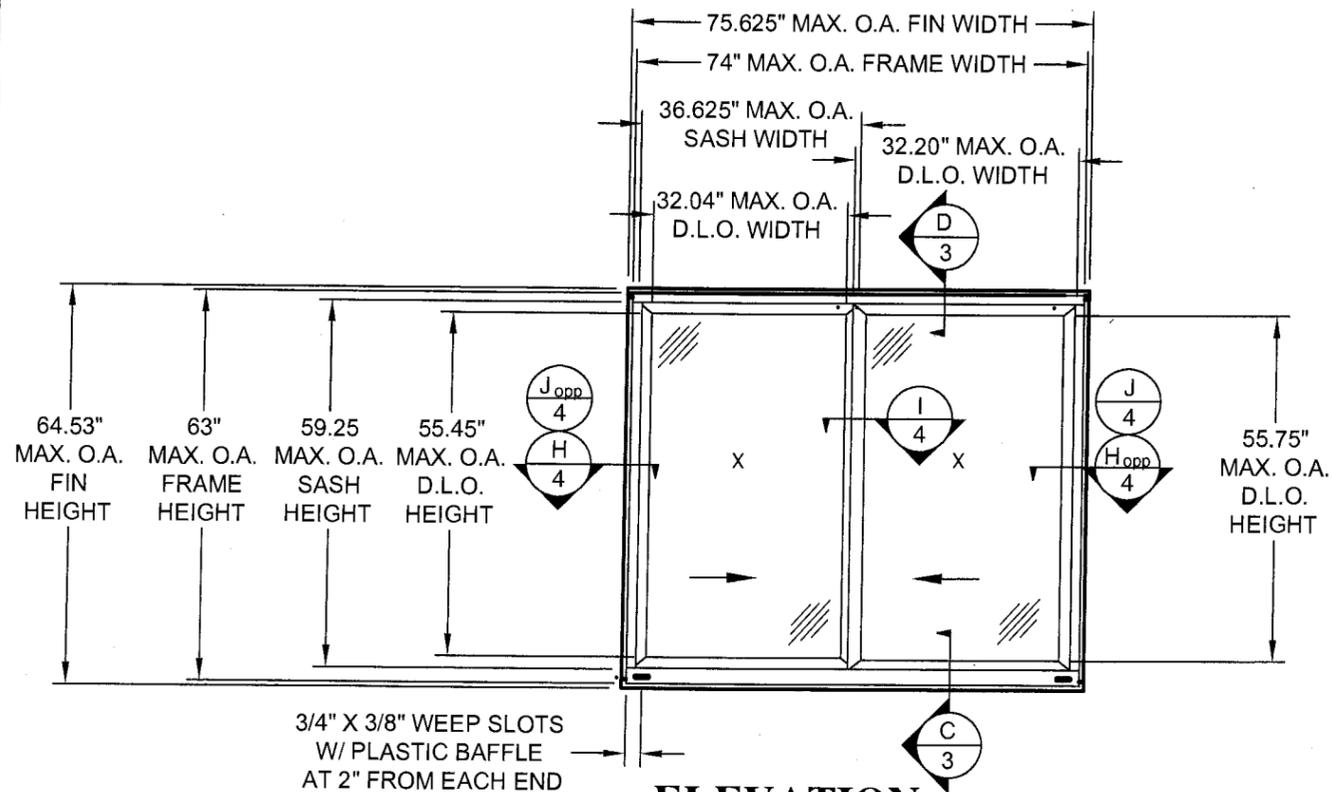

ELEVATION
EXTERIOR VIEW (WITH NAILING FIN)

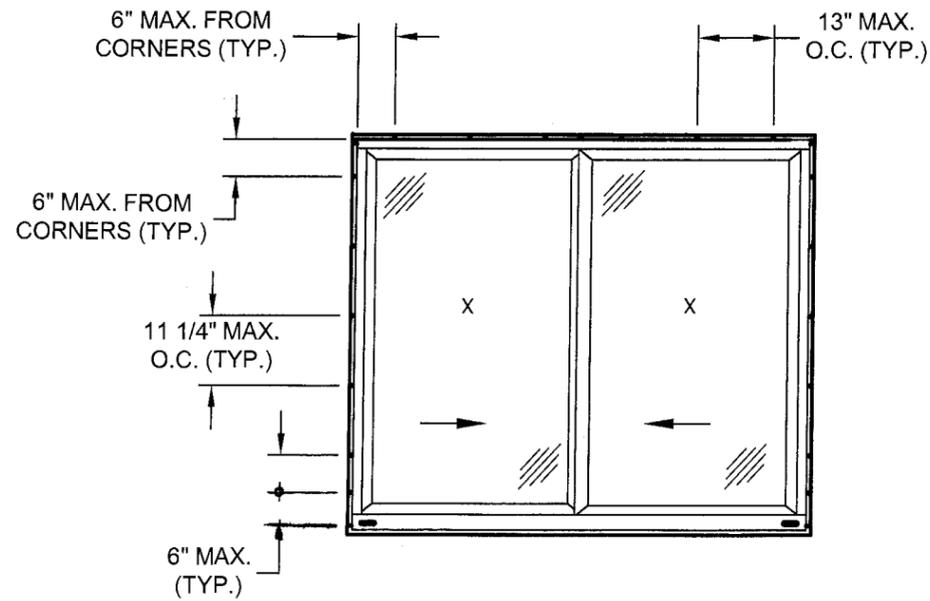

ANCHOR LAYOUT
EXTERIOR VIEW (WITH NAILING FIN)

PROJECT # 309-0709

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292
TITLE: SERIES 6500 PREMIUM ATLANTIC HORIZONTAL SLIDER, LMI
ELEVATIONS & ANCHOR LAYOUTS

DRAWN BY:	SMC	DATE:	08/11/09
SCALE:	N.T.S.	DRAWING NO.:	JELD0092
REV:	1	SHEET:	2 OF 7




PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **09-0916-03**
Expiration Date **05/10/2011**
By *[Signature]*
Miami Dade Product Control
Division


Robert J. Amoruso, P.E.
Florida P.E. No. 49752

[Signature] 2/10/10


REV	DESCRIPTION	DATE	BY
1	PER MIAMI DADE COMMENTS 11/23/09	02/10/10	SMC

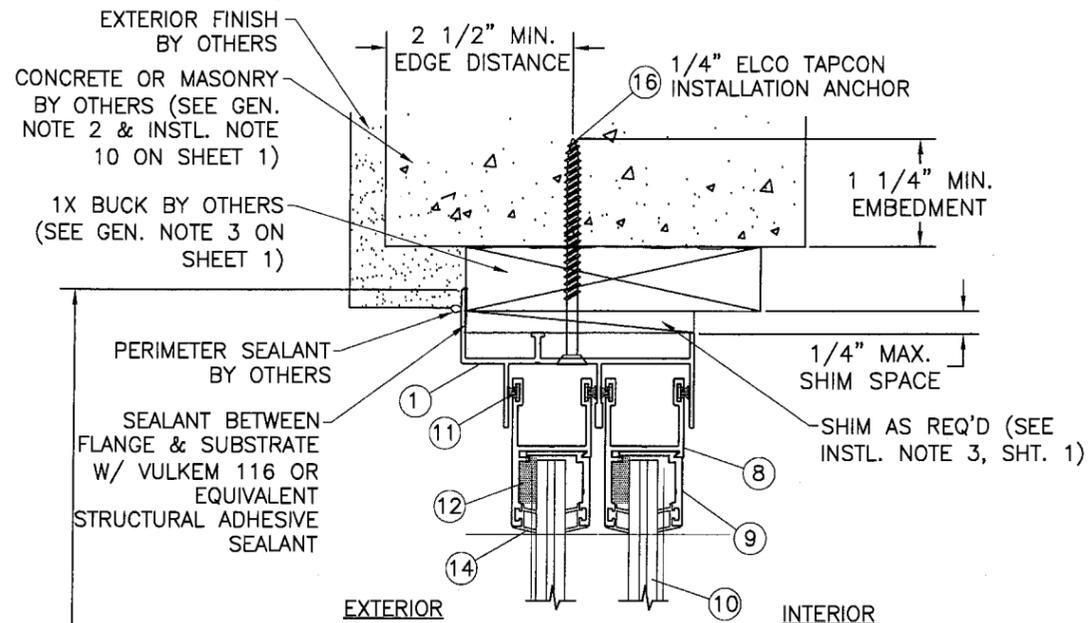


B VERTICAL SECTION
CONCRETE / MASONRY
SUBSTRATE

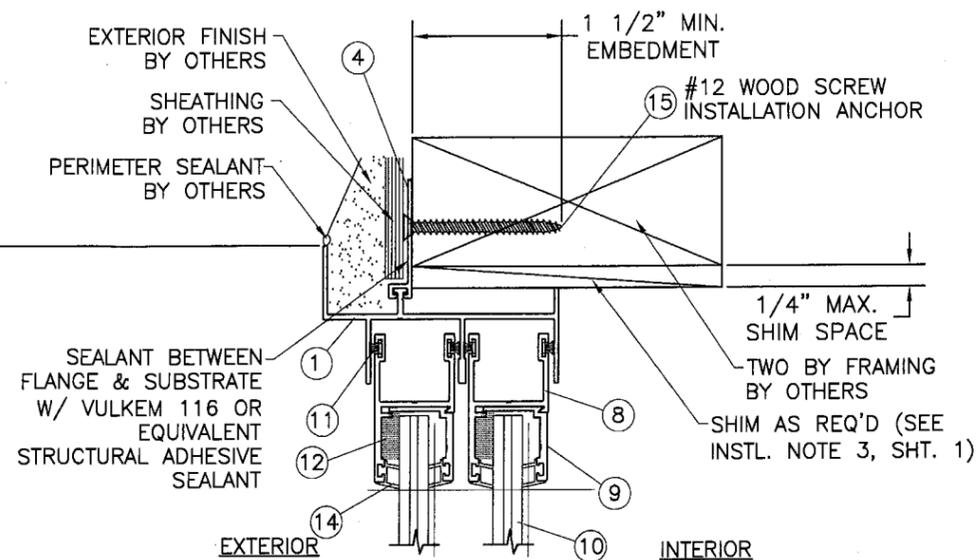

D HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

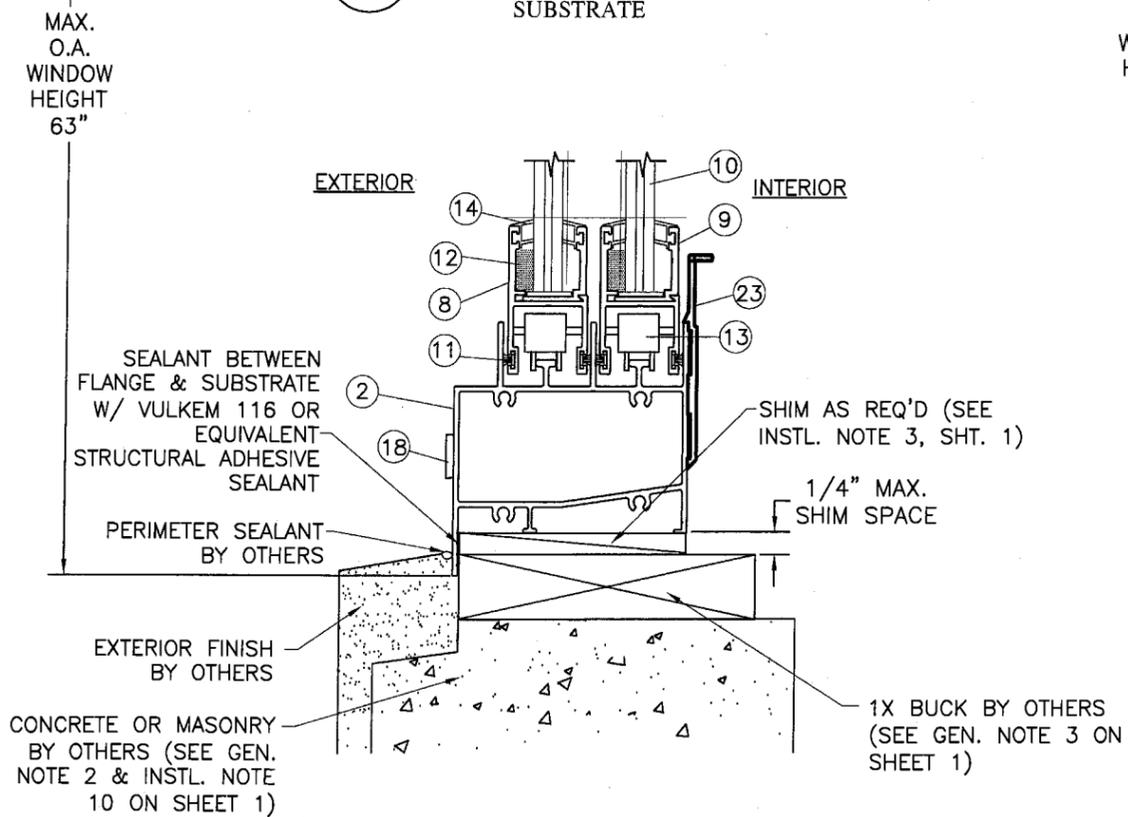

A VERTICAL SECTION
CONCRETE / MASONRY
SUBSTRATE

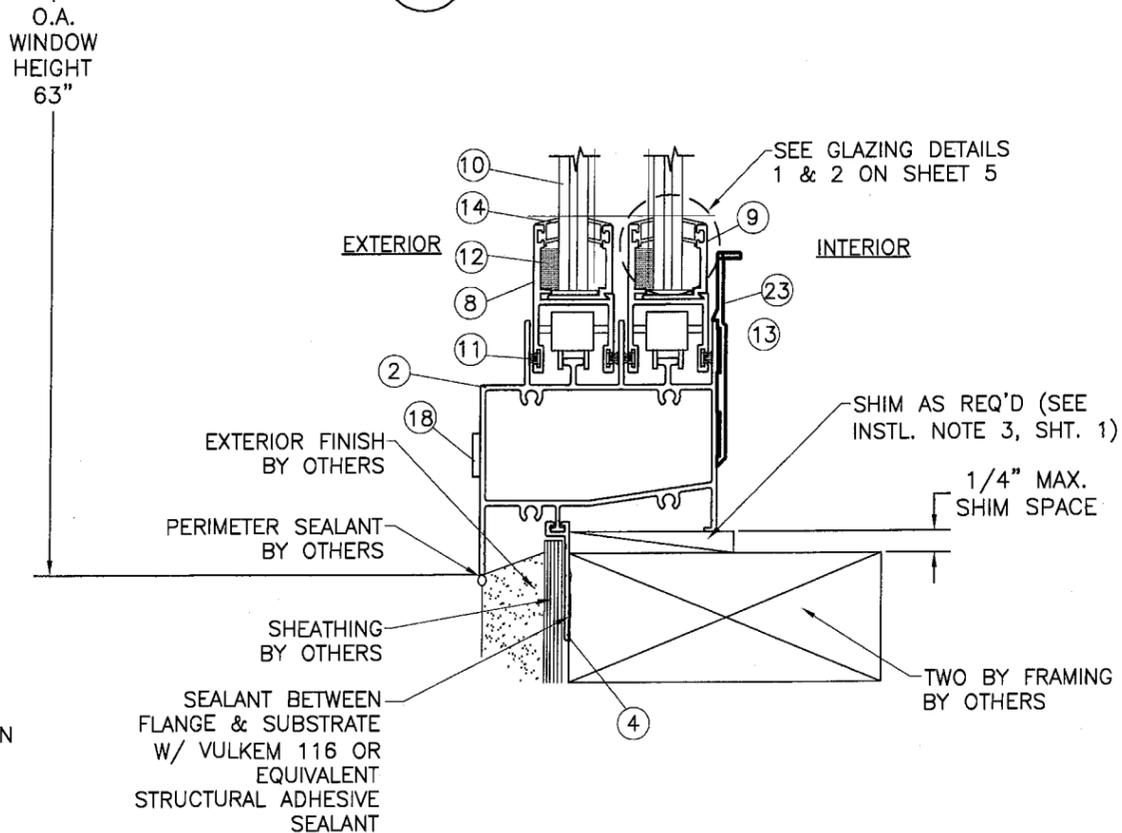

C HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

MAX. O.A. WINDOW HEIGHT 63"

O.A. WINDOW HEIGHT 63"

PROJECT # 309-0709

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292
TITLE: SERIES 6500 PREMIUM ATLANTIC HORIZONTAL SLIDER, LMI
VERTICAL SECTIONS


DATE: 08/11/09
DRAWING NO: JELD0092
SHEET: 3 OF 7
DRAWN BY: SMC
SCALE: N.T.S.
REV: -



PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0916.03
Expiration Date 08/16/2011
By *[Signature]*
Miami Dade Product Control
Division

Robert J. Amoruso, P.E.
Florida P.E. No. 49752


[Signature] 2/10/10

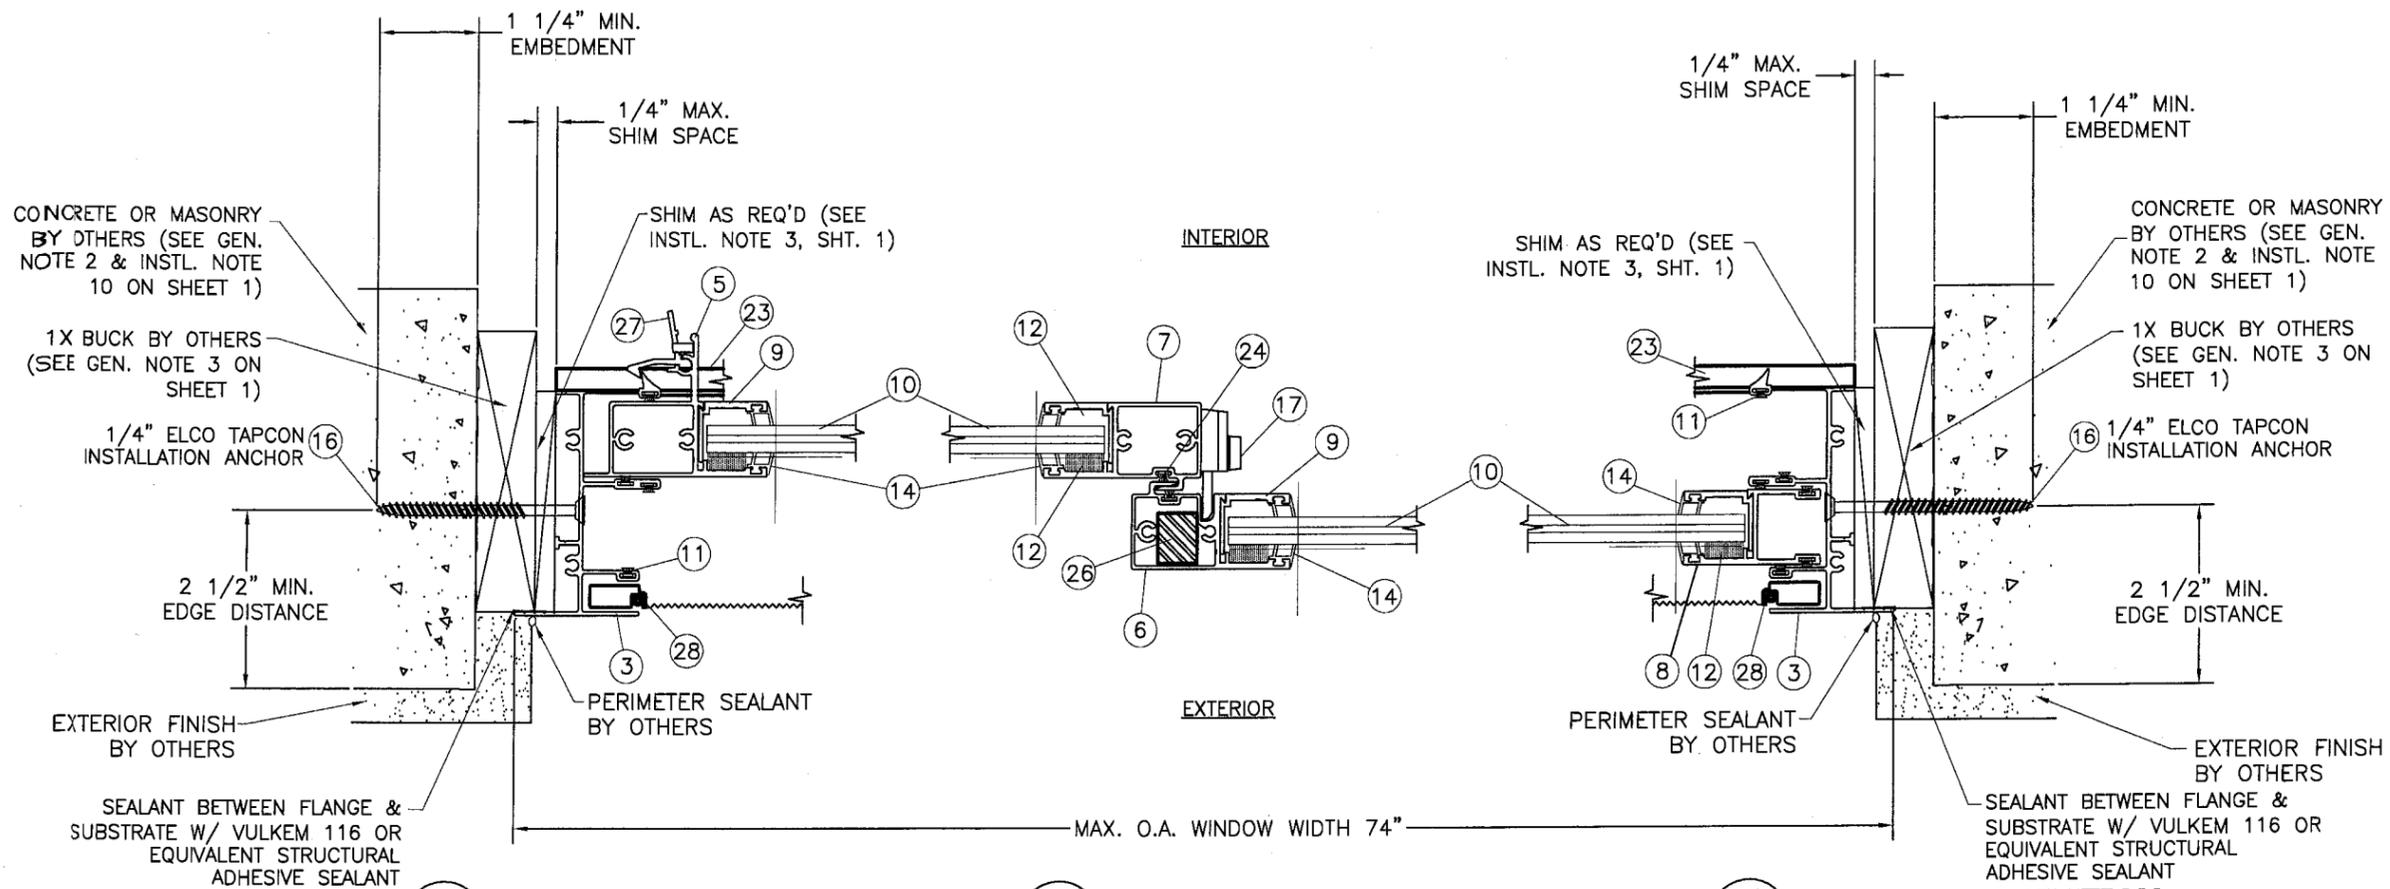

E HORIZONTAL SECTION
CONCRETE / MASONRY
SUBSTRATE

F HORIZONTAL SECTION

G HORIZONTAL SECTION
CONCRETE / MASONRY
SUBSTRATE

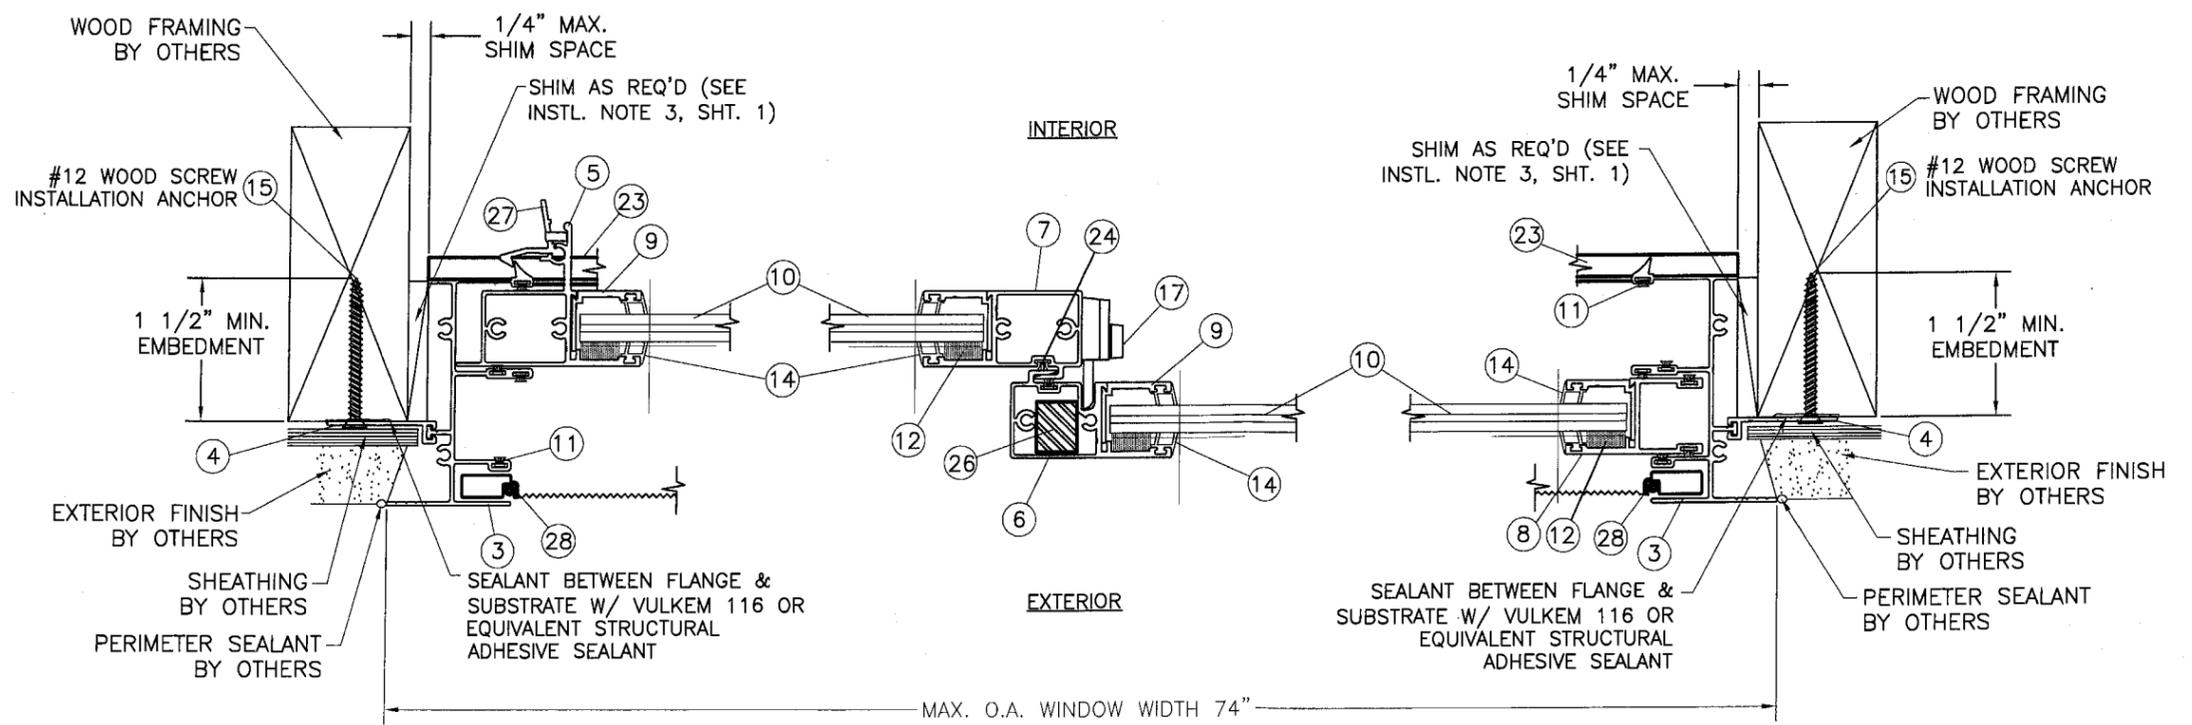

H HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

I HORIZONTAL SECTION

J HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

PROJECT # 309-0709

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292
TITLE: SERIES 6500 PREMIUM ATLANTIC HORIZONTAL SLIDER, LMI
HORIZONTAL SECTIONS

DRAWN BY:	SMC	DATE:	08/11/09
SCALE:	N.T.S.	DRAWING NO.:	JELD0092
REV.:		SHEET:	4 OF 7



PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **09-0916.03**
Expiration Date **08/10/2011**
By *[Signature]*
Miami Dade Product Control
Division


Robert J. Amoroso, P.E.
Florida P.E. No. 49752

[Handwritten Signature]
2/10/10


BY DATE DESCRIPTION REV

BILL OF MATERIAL

NO.	PART NO.	DESCRIPTION	MATERIAL	SUPPLIER
1	11343	FRAME HEAD	6063-T6	INDALEX
2	11396	FRAME SILL	6063-T6	INDALEX
3	11395	FRAME JAMB	6063-T6	INDALEX
4	45222	SLIP-ON NAIL FIN	6063-T6	INDALEX
5	60IVSL	INTERIOR VENT JAMB STILE	6063-T6	INDALEX
6	60ITVI	EXTERIOR VENT INTERLOCK STILE	6063-T6	INDALEX
7	60IBVI	INTERIOR VENT INTERLOCK STILE	6063-T6	INDALEX
8	60IVJS	TOP & BOTTOM VENT RAIL & EXTERIOR VENT JAMB STILE	6063-T6	INDALEX
9	60IGLB	GLAZING BEAD	6063-T6	INDALEX
10A/B	---	0.340" OVERALL LAMINATED GLASS (SEE GLAZING DETAILS 1 AND 2 ON THIS SHEET)	GLASS	---
11	---	0.170" HIGH WOOL PILE WITH INTEGRAL PLASTIC FIN	WOOL PILE	---
12	---	DOW CORNING 995 SILICONE BACK BEDDING	SILICONE	---
13	HRWHEL	WHEEL HOUSING ASSEMBLY	VINYL/STL	---
14	---	VINYL WEDGE	VINYL	---
15	---	#12 WOOD SCREW - INSTALLATION ANCHOR	STEEL	---
16	---	1/4" DIA. ELCO TAPCON TYPE INSTALLATION ANCHOR	STEEL	---
17	3588-1	LOCK ASSEMBLY	STEEL	---
18	---	WEEP COVER	VINYL	---
19	65GASK-4	SILL GASKET (OPEN CELL FOAM)	FOAM	---
20	---	SELF LEVELING SEALANT	SEALANT	---
21	---	#8 X 5/8" PHILLIPS PAN HEAD SHEET METAL SCREW	STEEL	---
22	65GASK-2	FRAME GASKET (OPEN CELL FOAM)	FOAM	---
23	---	OPTIONAL SILL RISER (AFFIXED W/ DBL SIDED ADHESIVE TAPE)	6063-T6	INDALEX
24	---	0.130" HIGH WOOL PILE W/ INTEGRAL PLASTIC FIN	WOOL PILE	---
25	---	NOT USED	---	---
26	CRS	1/2" X 5/8" STEEL BAR REINFORCEMENT	STEEL	---
27	---	INTERIOR VENT SASH LATCH	6063-T6	INDALEX
28	---	INSECT SCREEN	ALUMINUM	---

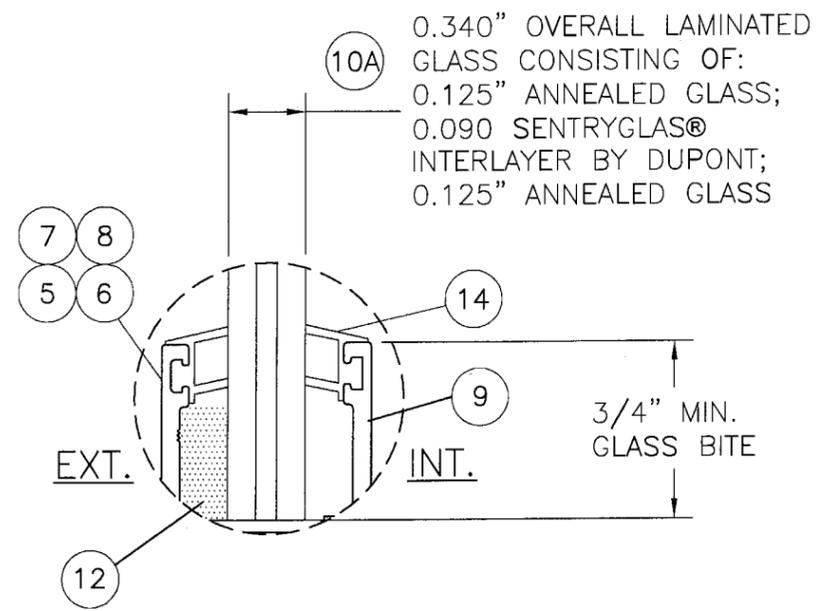

GLAZING DETAIL 1

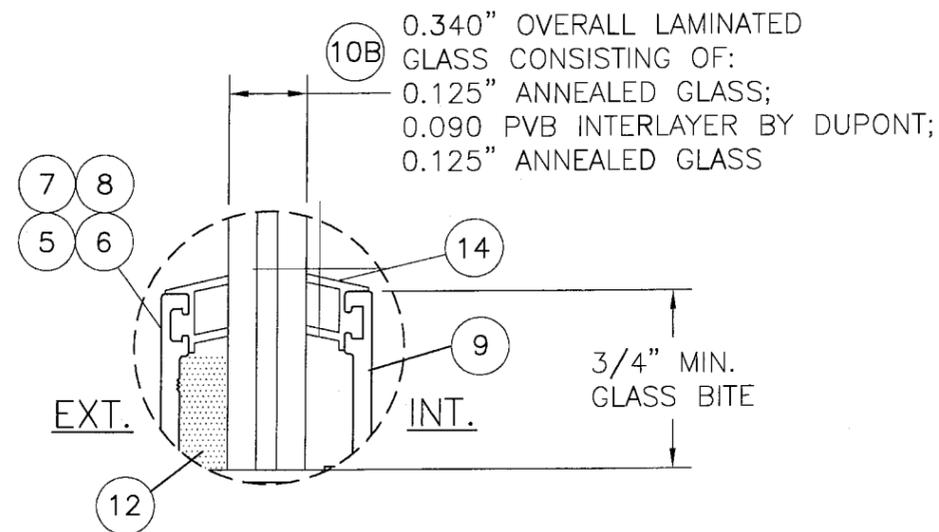

GLAZING DETAIL 2

PROJECT # 309-0709

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292

TITLE: SERIES 6500 PREMIUM ATLANTIC HORIZONTAL SLIDER, LMI
GLAZING DETAIL & BILL OF MATERIALS

PREPARED BY: SMC
SCALE: N.T.S.
REV: -

DATE: 08/11/09
DRAWING NO: JELDD0092
SHEET: 5 OF 7

PTC, LLC
1535 N. Cogswell Street, Suite C25
Rockledge, Florida 32955
Phone: 321.660.1788
Fax: 321.660.1789
Email: info@ptc-usa.com
FBPE CA, NO. 25395


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0916.03
Expiration Date 08/10/2011

By: *[Signature]*
Miami Dade Product Control
Division


Robert J. Amoruso, P.E.
Florida P.E. No. 49752

[Signature] 2/10/10


① 11343
FRAME HEAD
TYP. WALL THICKNESS 0.050"

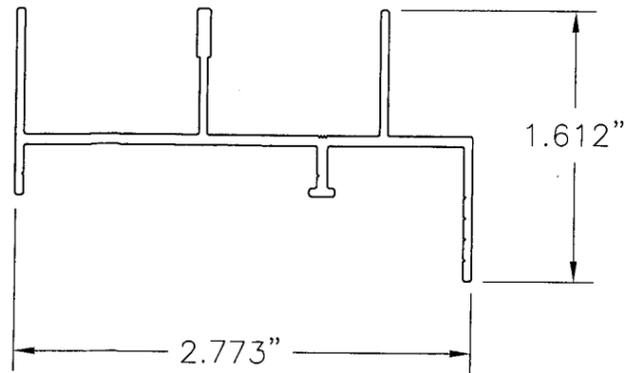


② 11396
FRAME SILL
TYP. WALL THICKNESS 0.060"

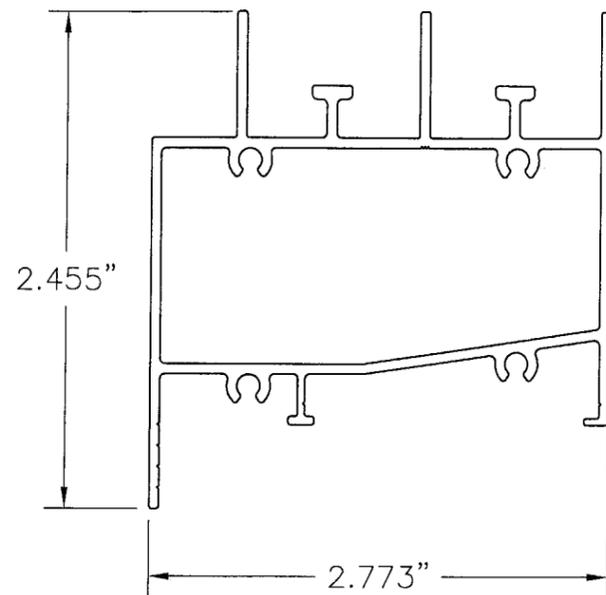


③ DHRMJ
FRAME JAMB
TYP. WALL THICKNESS 0.050"

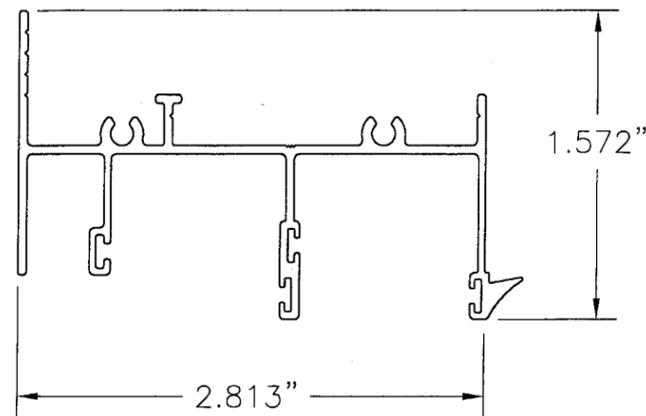


④ 45222
APPLIED FIN
TYP WALL
THICKNESS 0.050"

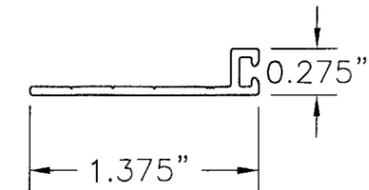


⑤ 60IVSI
INT. VENT JAMB STILE
TYP. WALL THICKNESS 0.050"

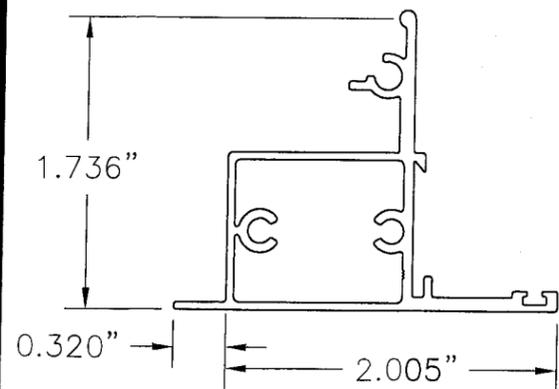


⑥ 60ITVI
EXT. VENT INTERLOCK STILE
TYP. WALL 0.050"

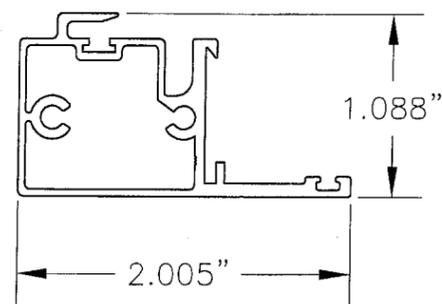


⑦ 60IBVI
INT. VENT INTERLOCK STILE
TYP. WALL 0.050"

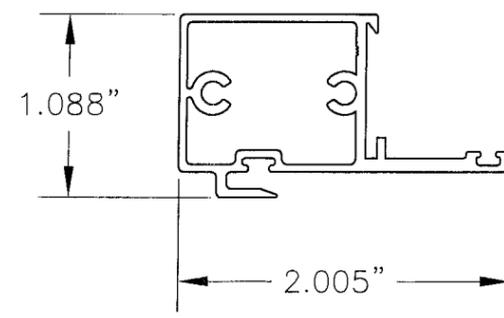


⑧ 60IVJS
TOP & BOTTOM VENT RAIL &
EXT. VENT JAMB STILE
THICKNESS 0.045"

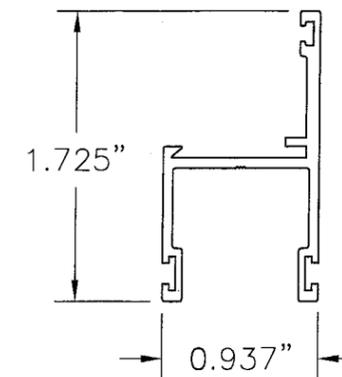

⑨ 60IGLB
GLAZING BEAD
TYP. WALL THICKNESS 0.080"

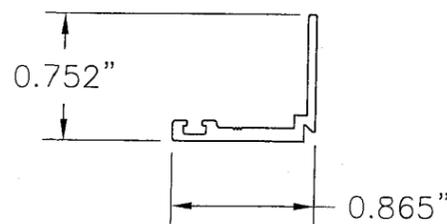

②③ OPTIONAL SILL RISER
TYP. WALL THICKNESS 0.068"

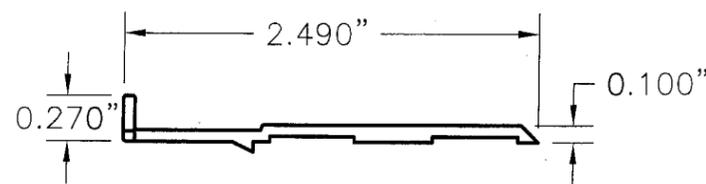

PROJECT # 309-0709

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292
TITLE: SERIES 6500 PREMIUM ATLANTIC HORIZONTAL SLIDER, LMI COMPONENTS



DATE:	08/11/09
DRAWING NO.:	JELD0092
SCALE:	N.T.S.
REV.:	6 OF 7

PREPARED BY:
FPE
PTC, LLC
1638 N. Cogswell Street, Suite C25
Rockledge, Florida 32955
Phone: 321.660.1788
Fax: 321.660.1789
Email: info@fpe.com

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0916.03
Expiration Date 03/10/2011
By *[Signature]*
Miami Dade Product Control
Division

Robert J. Amoroso, P.E.
Florida P.E. No. 49752

[Signature] 2/10/10

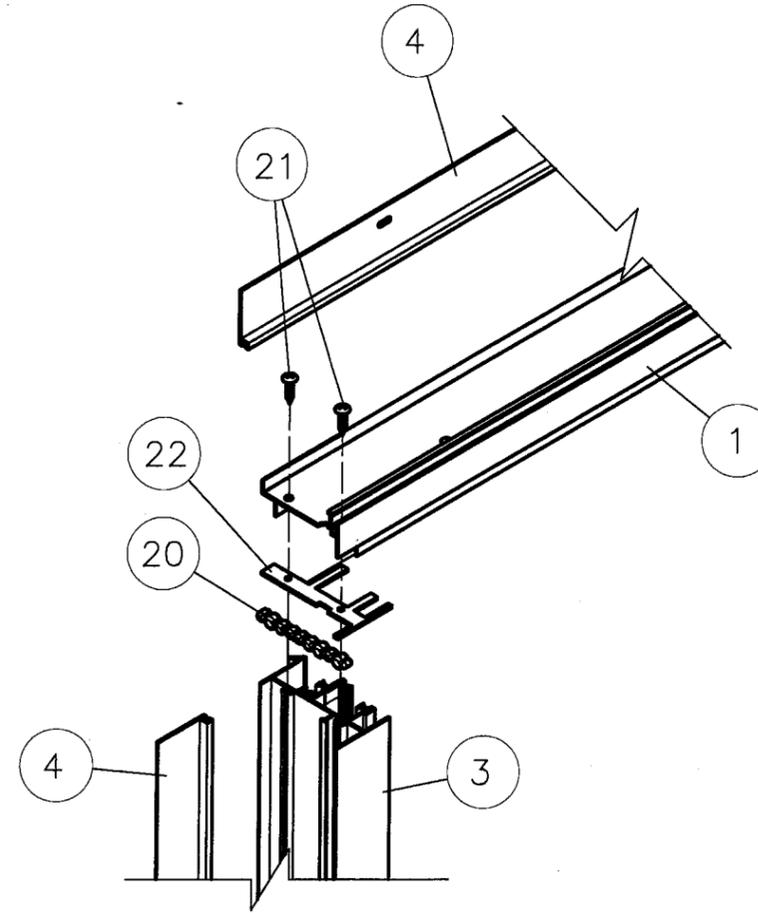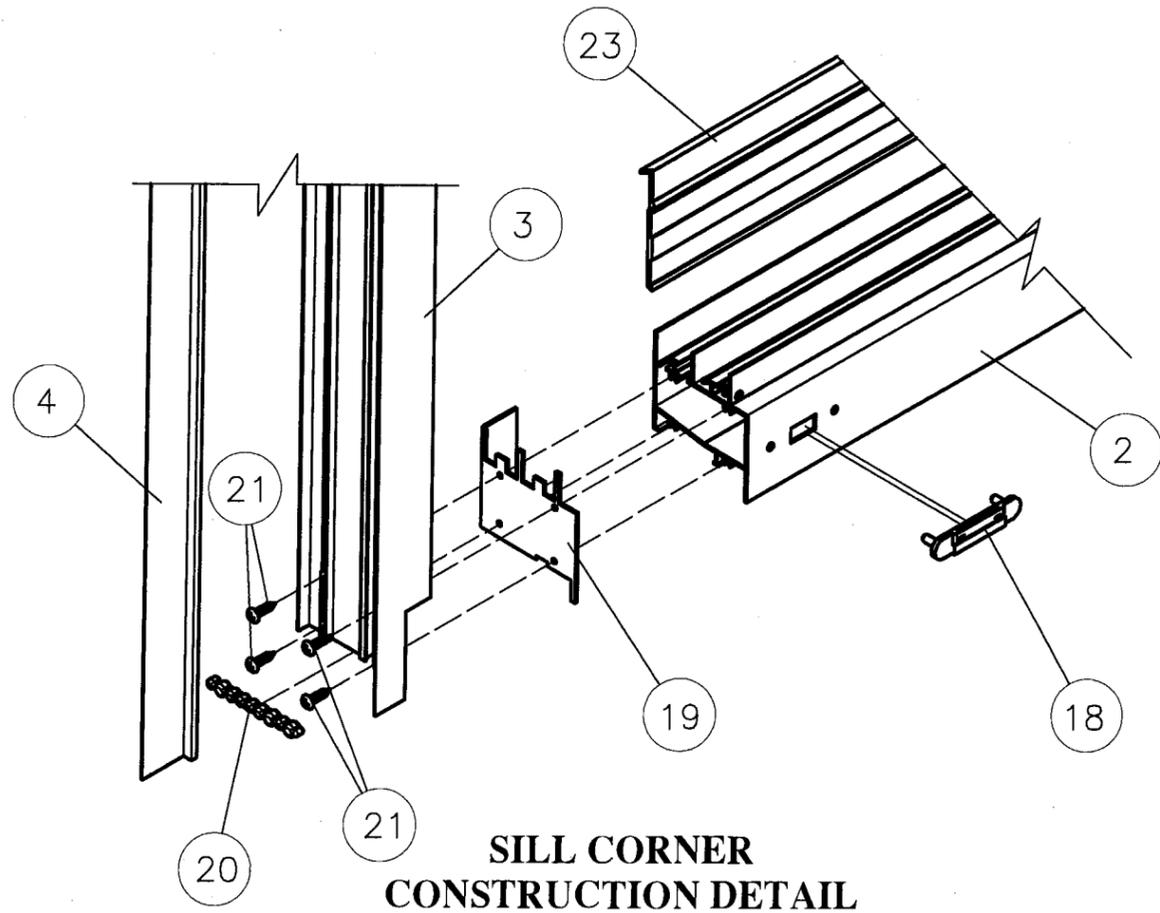

PROJECT # 309-0709

REV	DESCRIPTION	DATE	BY

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292

TITLE: SERIES 6500 PREMIUM ATLANTIC HORIZONTAL SLIDER, LMI
CORNER CONSTRUCTION DETAILS

PREPARED BY: SMC
SCALE: N.T.S.
DATE: 08/11/09
DRAWING NO: JELD0092
REV: 7 OF 7

JELD-WEN
P.T.C. LLC
1636 N. Cogswell Street, Suite C25
Rockledge, Florida 32955
Phone: 321.860.1788
Fax: 321.860.1788
Email: info@jeld-wen.com

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-0916-03
Expiration Date 08/10/2011
By [Signature]
Miami Code Product Control
Division

Robert J. Amoruso, P.E.
Florida P.E. No. 49752

[Signature] 2/10/10