



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1107
MIAMI, FLORIDA 33130-1563
(305) 375-2902 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Jeld-Wen, Inc. (OR)
3737 Lakeport Blvd.,
Klamath Falls, OR 97601

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "6600 Premium Atlantic" Aluminum Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **JELD0082** titled "Series 6600 Premium Atlantic Aluminum Fixed Window L.M.I.", sheets 1 through 5 of 5, dated August 01, 2009 with revision "A" dated February 03, 2010, prepared by P.T.C., LLC, dated February 11, 2010, signed and sealed by Robert J. Amoruso, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises** NOA No. **07-0515.05** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
2/22/10

NOA No. 09-0916.04
Expiration Date: July 24, 2013
Approval Date: March 17, 2010
Page 1

Jeld-Wen, Inc. (OR)

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **JELD0082** titled "Series 6600 Premium Atlantic Aluminum Fixed Window L.M.I.", sheets 1 through 5 of 5, dated August 01, 2009 with revision "A" dated February 03, 2010, prepared by P.T.C., LLC, dated February 11, 2010, signed and sealed by Robert J. Amoruso, P. E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of **Aluminum Fixed Window**, prepared by National Certified Testing Laboratories, Inc., Test Report No. **NCTL 210-3588-2**, dated June 08, 2009, signed and sealed by Gerard J. Ferrara, P. E.

2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of **Aluminum Fixed Window**, prepared by Architectural Testing, Inc., Test Report No. **ATI 70141.01-401-18**, dated March 01, 2007, signed and sealed by Joseph A. Reed, P. E.

(Submitted under NOA No. 07-0515.05)

3. Test reports on:
 - 1) Air Infiltration Test, per FBC, PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC PA 202-94
 - 3) Water Resistance Test, per FBC, PA 202-94
 - 4) Large Missile Impact Test per FBC, PA 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, PA 203-94
 - 6) Forced Entry Test, per ASTM F-588 and PA 202-94


along with marked-up drawings and installation diagram of Aluminum fixed window, prepared by Certified Testing Laboratories, Test Report No. **CTLA-1019W**, dated February 07, 2003, signed and sealed by Ramesh Patel, P.E.

(Submitted under NOA No. 02-0408.01)

4. Test reports on:
 - 1) Large Missile Impact Test per FBC, TAS 201-94
 - 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of Aluminum fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3287**, dated January 28, 2002, signed and sealed by Luis Antonio Figueredo, P. E.

(Submitted under NOA No. 02-0408.01)



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0916.04
Expiration Date: July 24, 2013
Approval Date: March 17, 2010

Jeld-Wen, Inc. (OR)

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

5. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 3603.2 (b), TAS 202-94

Along with marked-up drawings and installation diagram of Aluminum fixed window, prepared by Fenestration Testing laboratory Inc, Test Report No. **FTL-3356**, dated January 28, 2002, signed and sealed by Luis Antonio Figueredo, P. E.
(Submitted under NOA No. 02-0408.01)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by P.T.C., LLC, dated August 11, 2009, signed and sealed by Robert J. Amoruso, P. E.

Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).


E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.
2. Notice of Acceptance No. **09-0312.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 05/13/09, expiring on 12/11/10.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated August 11, 2009, signed and sealed by Robert J. Amoruso, P. E.
2. Laboratory addendum letter for Test Report no. **NCTL 210-3588-2**, issued by National Certified Testing Laboratories, Inc., dated January 06, 2010, signed and sealed by Gerard J. Ferrara, P. E.
3. Laboratory compliance letter for Test Report no. **NCTL 210-3588-2**, issued by National Certified Testing Laboratories, Inc., dated June 08, 2009, signed and sealed by Gerard J. Ferrara, P. E.
4. Laboratory compliance letter for Test Report no. **ATI 70141.01-401-18**, issued by Architectural Testing, Inc., dated March 01, 2007, signed and sealed by Joseph A. Reed, P. E.

(Submitted under NOA No. 07-0515.05)



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0916.04
Expiration Date: July 24, 2013
Approval Date: March 17, 2010

Jeld-Wen, Inc. (OR)

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

5. Laboratory compliance letter for Test Report no. **CTLA-1019W**, issued by Certified Testing Laboratories, Inc., dated February 07, 2003, signed and sealed by Ramesh Patel, P. E.
(Submitted under NOA No. 02-0408.01)
6. Laboratory compliance letter for Test Report no.'s **FTL-3287** and **FTL-3356**, issued by Fenestration Testing Laboratory, Inc., dated January 28, 2002, both signed and sealed by Luis Antonio Figueredo, P. E.
(Submitted under NOA No. 02-0408.01)
7. Proposal issued by BCCO, dated November 03, 2008, signed by Jaime D. Gascon, P.E.

G. OTHERS

1. Notice of Acceptance No. **07-0515.05**, issued to Jeld-Wen, Inc. (FL) for their Series "6600 Premium Atlantic Aluminum Fixed Window - L.M.I.", approved on 02/21/08 and expiring on 07/24/13.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-0916.04
Expiration Date: July 24, 2013
Approval Date: March 17, 2010

JELD-WEN

SERIES "6600 PREMIUM ATLANTIC" ALUMINUM FIXED WINDOW, LMI INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

- THIS PRODUCT IS DESIGNED TO COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE (HVHZ) OF THE 2007 FLORIDA BUILDING CODE (FBC) AT THE DESIGN PRESSURE(S) STATED HEREIN. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORTS # NCTL-210-3588-2 DATED 06/22/09, #ATI-70141.01-401-18 DATED 03/01/07, #CTLA-1019W DATED 02/07/03 AND #FTL-3356 DATED 01/28/02 AND ASSOCIATED LABORATORY STAMPED DRAWINGS AND WERE TESTED IN ACCORDANCE WITH CURRENT DADE COUNTY PROTOCOLS.
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE STRUCTURE IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
- 1X BUCKS AND 2X WOOD FRAMING (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.

- IN AREAS WHERE WIND-BORNE DEBRIS PROTECTION REQUIREMENTS EXIST, USE OF AN APPROVED MIAMI DADE IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED.
- WINDOW FRAME MATERIAL: 6063-T6 ALUMINUM ALLOY
- GLASS MEETS THE REQUIREMENTS OF ASTM E1300.
- DESIGNATION "O" STANDS FOR THE FOLLOWING:
O: FIXED PANEL
- A 1/3 INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THE DESIGN OF THE PRODUCT(S) SHOWN HEREIN. WIND LOAD DURATION FACTOR (Cd = 1.0) HAS BEEN USED FOR WOOD ANCHOR DESIGN.

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM SIZE IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING, USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT. MINIMUM EDGE DISTANCE IS 3/4 INCHES.
- FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE / MASONRY, OR DIRECTLY INTO CONCRETE / MASONRY, USE 3/16 INCH ELCO TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT (FOR MASONRY) AND 1 3/8 INCHES MINIMUM EMBEDMENT (FOR CONCRETE). MINIMUM EDGE DISTANCE IS 2-1/2 INCHES FOR BOTH CONCRETE AND MASONRY.
- INSTALLATION ANCHORS ARE TO BE LOCATED THROUGH PERIMETER OF NAILING FIN WHEN APPLICABLE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING.

- FOR CONCRETE BLOCK APPLICATIONS DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 psi AND COMPLIES WITH ACI 301, ACI 318-05 AND ACI 355
 - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90 AND ACI 530-05, GRADE N, TYPE 1 (OR GREATER).

TABLE OF CONTENTS		
SHEET	REV.	SHEET DESCRIPTION
1	---	GENERAL NOTES, INSTALLATION NOTES & D.P. CHART
2	A	ELEVATIONS & ANCHOR LAYOUTS
3	A	ELEVATIONS & ANCHOR LAYOUTS
4	---	VERTICAL & HORIZONTAL SECTIONS
5	A	COMPONENTS, BOM, GLAZING & CORNER DETAILS

SIZE	GLAZING OPTIONS	DESIGN PRESSURE RATING (PSF)	IMPACT RATING
36" X 62"	1, 2, 3, 4 & 5	+50.0 / -50.0	LARGE MISSILE IMPACT
52-1/8" X 75"	1 & 5	+60.0 / -60.0	
48" X 96"	2	+60.0 / -60.0	

PROJECT # 309-0708

REV	DESCRIPTION	DATE	BY
A	PER MIAMI DADE COMMENTS	02/03/10	SMC
0	ORIGINAL ISSUE DATE	08/03/09	SMC

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292

SERIES 6600 PREMIUM ATLANTIC ALUMINUM FIXED WINDOW, LMI
GENERAL NOTES, INSTALLATION NOTES & D.P. CHART

PREPARED BY: 

DATE: 08/01/09
DRAWING NO: JELD0094
SCALE: N.T.S.
SHEET: 1 OF 5


DRIVEN BY: SMC
REV: A

Phone: 321.690.1788
Fax: 321.690.1789
Email: info@jwc.com
P.O. Box 325
Rockledge, FL 32955
FPE C.A. NO. 26535

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **09-0916-04**
Expiration Date **07/24/2013**
By 
Miami Dade Product Control
Division


Robert J. Amoruso, P.E.
Florida P.E. No. 49752



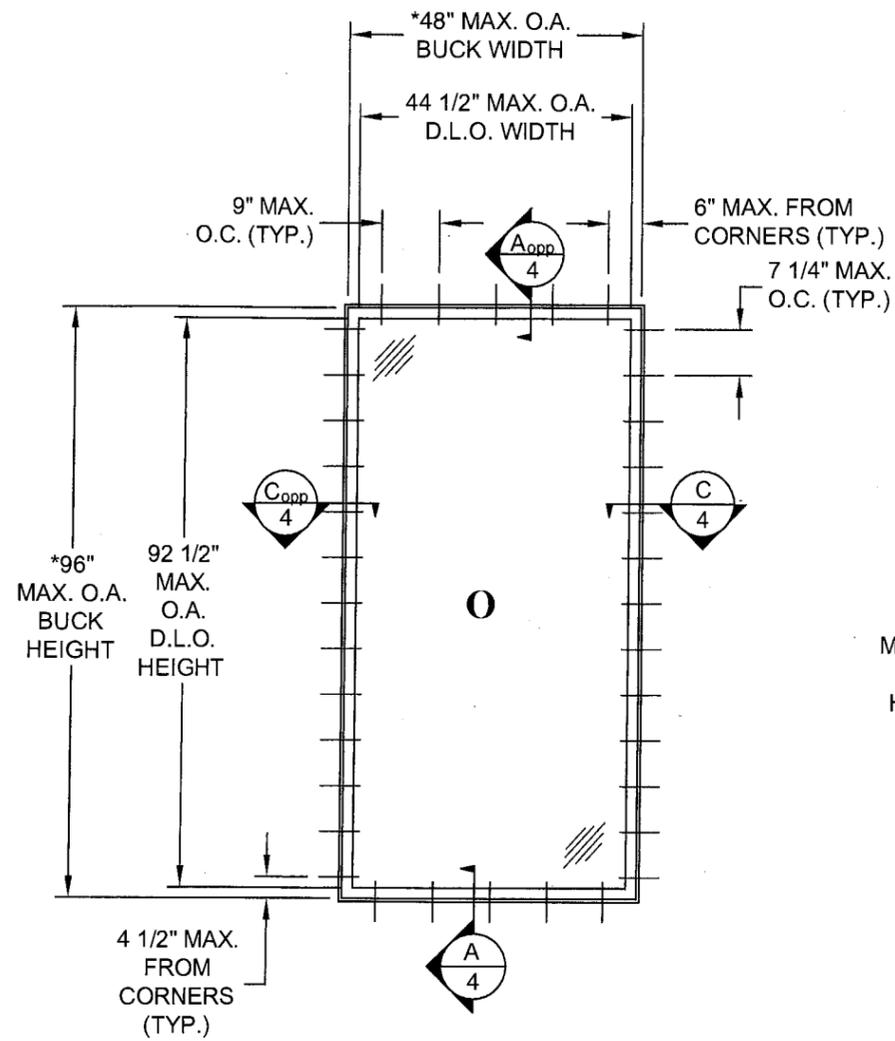


**ELEVATION &
ANCHOR LAYOUT**

48 X 96
FLANGE INSTALLATION
EXTERIOR VIEW
SEE GLAZING DETAIL 2 ON SHT. 5
FOR GLASS OPTION

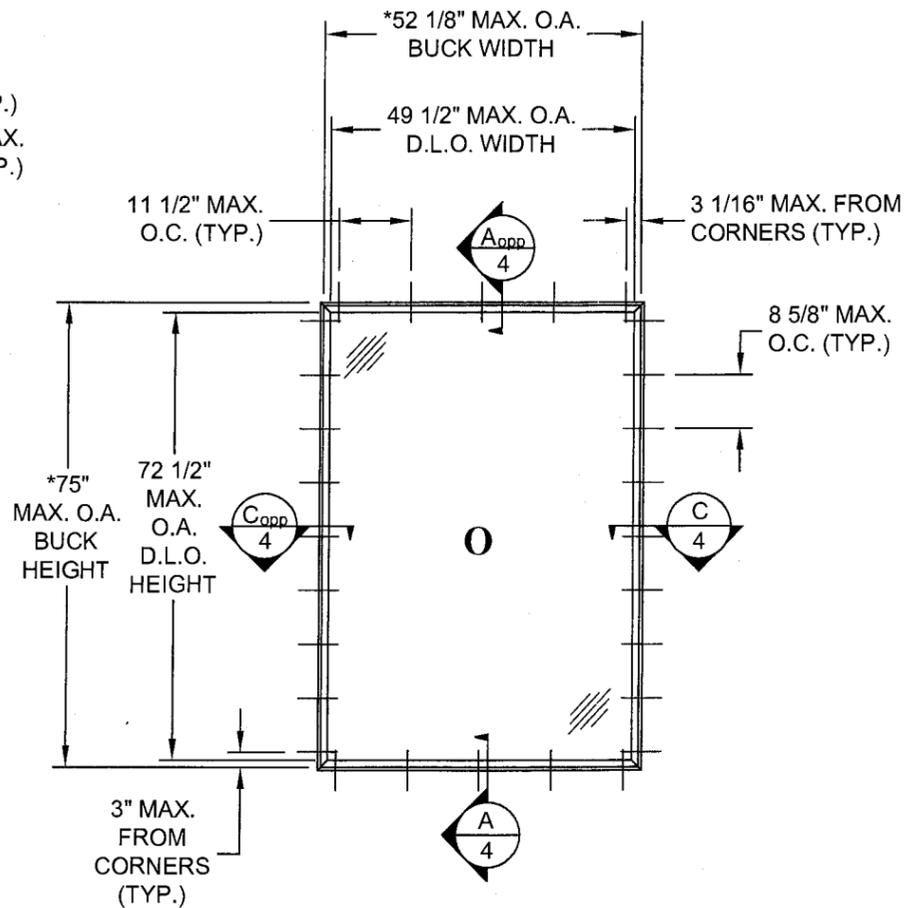

**ELEVATION &
ANCHOR LAYOUT**

52 1/8 X 75
FLANGE INSTALLATION
EXTERIOR VIEW
SEE GLAZING DETAILS 1 & 5 ON SHT. 5
FOR GLASS OPTION

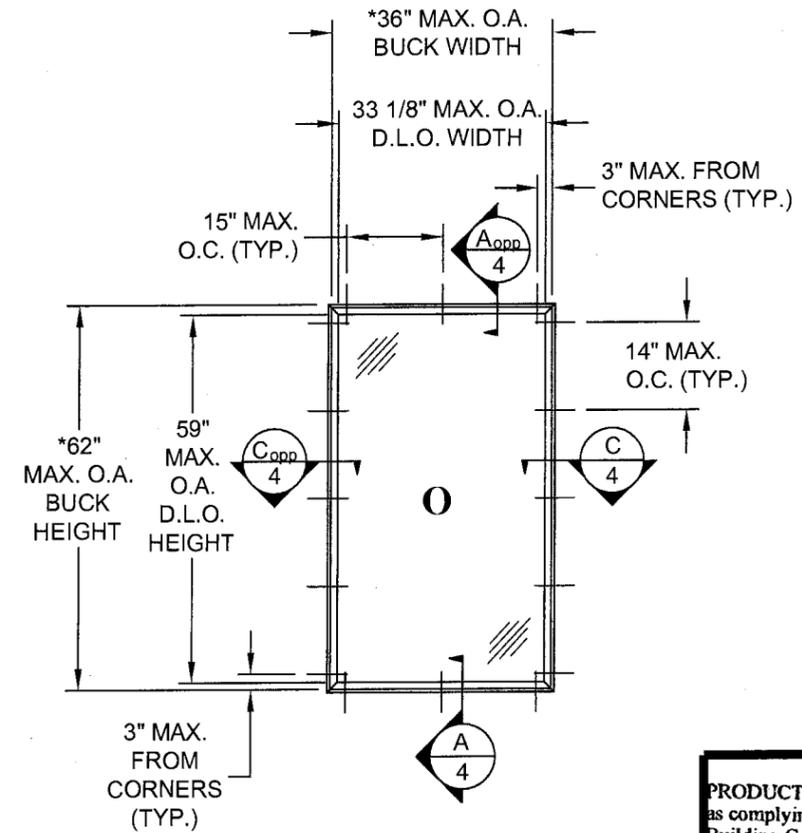

**ELEVATION &
ANCHOR LAYOUT**

36 X 62
FLANGE INSTALLATION
EXTERIOR VIEW
SEE GLAZING DETAILS 3 & 4 ON SHT. 5
FOR GLASS OPTIONS

*NOTE: ADD 1" TO THE MAX. O.A. BUCK WIDTH & HEIGHT
FOR THE MAX. O.A. FLANGE WIDTH & HEIGHT.

PROJECT # 309-0708

PER MIAMI DADE COMMENTS	02/03/10	SMC	BY
ORIGINAL ISSUE DATE	08/03/09	SMC	DATE
DESCRIPTION	REV		

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292

SERIES 6600 PREMIUM ATLANTIC ALUMINUM FIXED WINDOW, LMI ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: SMC
SCALE: N.T.S.
REV: A


DATE: 08/01/09
DRAWING NO: JELD0094
SHEET: 2 OF 5

PTC, LLC
1935 N. Cogswell Street, Suite C25
Rockledge, Florida 32955
Phone: 321.600.1788
Fax: 321.600.1789
Email: info@ptc-corp.com

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **09-0916.04**
Expiration Date **07/24/2013**
By *[Signature]*
Miami Dade Product Control
Division


Robert J. Amoruso, P.E.
Florida P.E. No. 49752

[Signature] 2/11/10

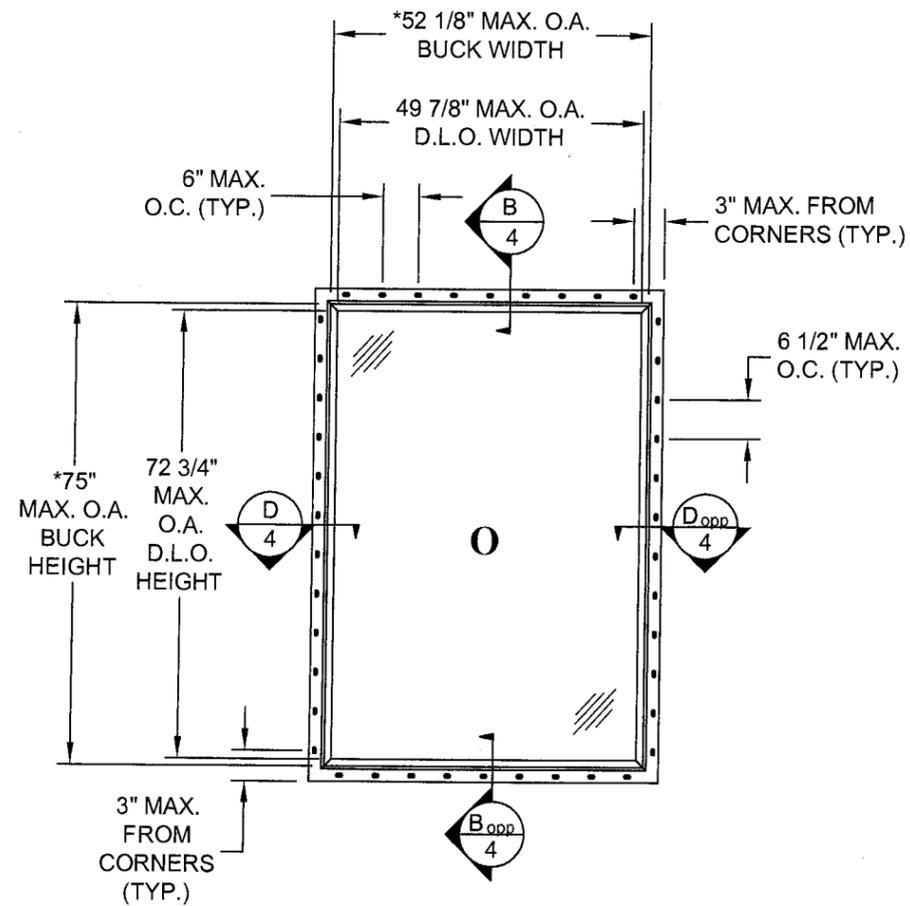

**ELEVATION &
ANCHOR LAYOUT**

52 1/8 X 75
FIN INSTALLATION
EXTERIOR VIEW
SEE GLAZING DETAILS 1 & 5 ON SHT. 5
FOR GLASS OPTIONS

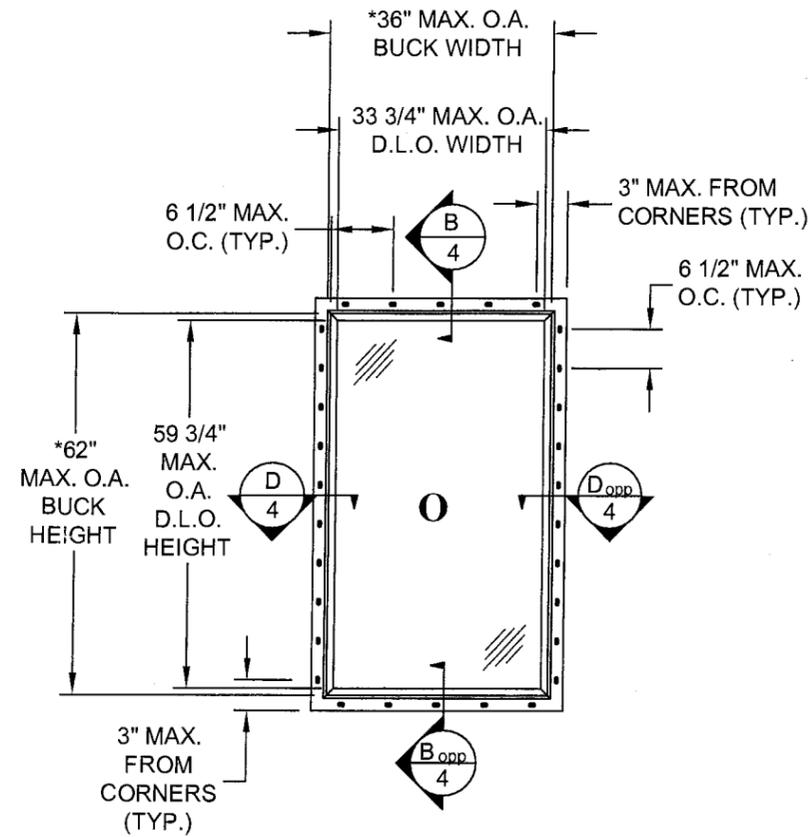

**ELEVATION &
ANCHOR LAYOUT**

36 X 62
FIN INSTALLATION
EXTERIOR VIEW
SEE GLAZING DETAILS 3 & 4 ON SHT. 5
FOR GLASS OPTIONS

*NOTE: ADD 1" TO THE MAX. O.A. BUCK WIDTH & HEIGHT
FOR THE MAX. O.A. FLANGE WIDTH & HEIGHT.

PROJECT # 309-0708		SMC	BY
A	PER MIAMI DADE COMMENTS	02/03/10	SMC
0	ORIGINAL ISSUE DATE	08/03/09	SMC
REV	DESCRIPTION	DATE	BY

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292

SERIES 6600 PREMIUM ATLANTIC ALUMINUM FIXED WINDOW, LMI ELEVATIONS & ANCHOR LAYOUTS


PREPARED BY: **JELD-WEN**
DATE: 08/01/09
DRAWING NO: JELD0094
SCALE: N.T.S.
SHEET: 3 OF 5

1535 N. Coquina Street, Suite C25
P.O. Box 321, 890, 1789
Palm Bay, FL 32909
Phone: 321.690.1788
Fax: 321.690.1789
Email: info@jld-corp.com
FBPE C.A. NO. 25825


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **09-0916.04**
Expiration Date **01/24/2013**
By *[Signature]*
Miami Dade Product Control
Division

Robert J. Amoruso, P.E.
Florida P.E. No. 49752

[Signature] 2/11/10

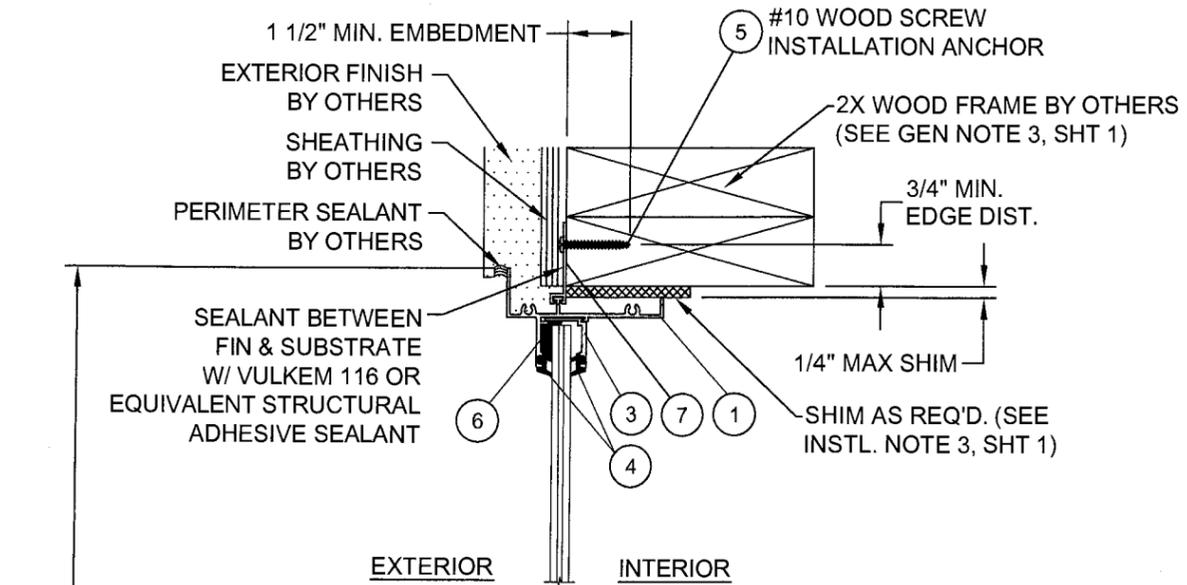


B VERTICAL SECTION
FIN INSTALLATION
WOOD FRAME SUBSTRATE

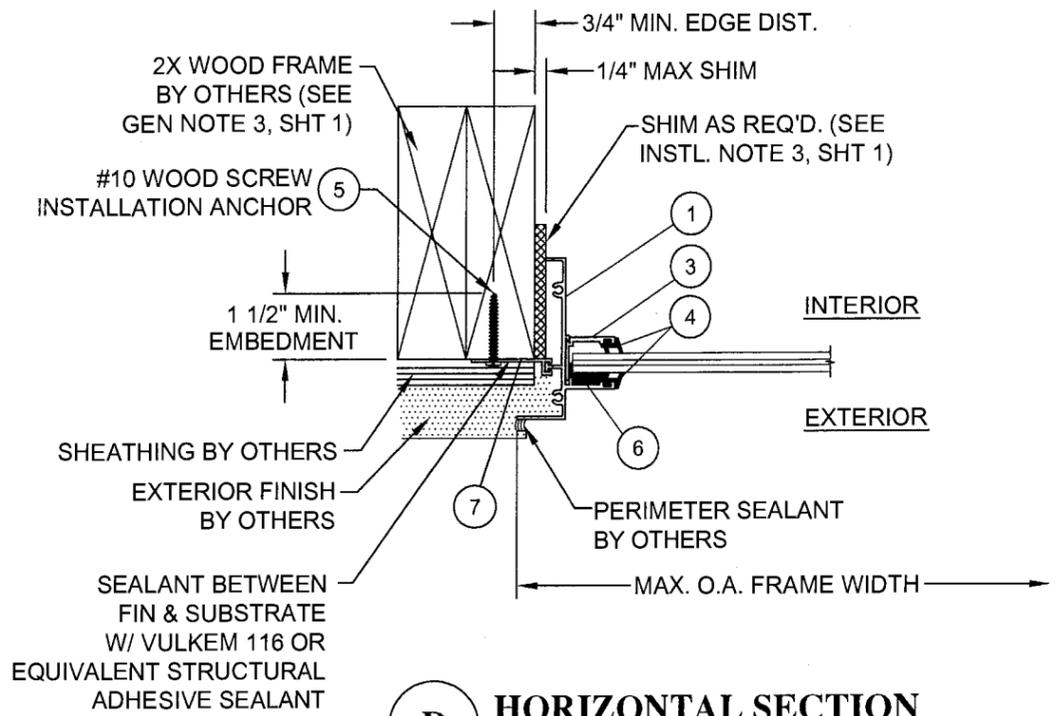


D HORIZONTAL SECTION
FIN INSTALLATION
WOOD FRAME SUBSTRATE

MAX. O.A. FRAME HEIGHT

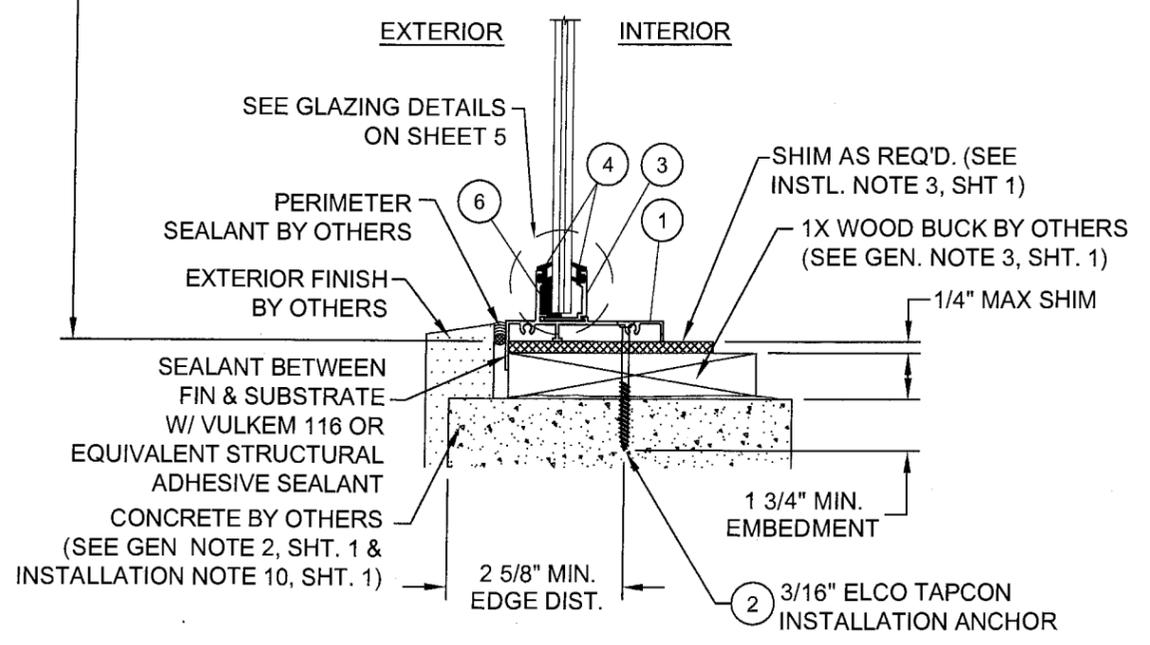

A VERTICAL SECTION
FLANGE INSTALLATION
CONCRETE SUBSTRATE

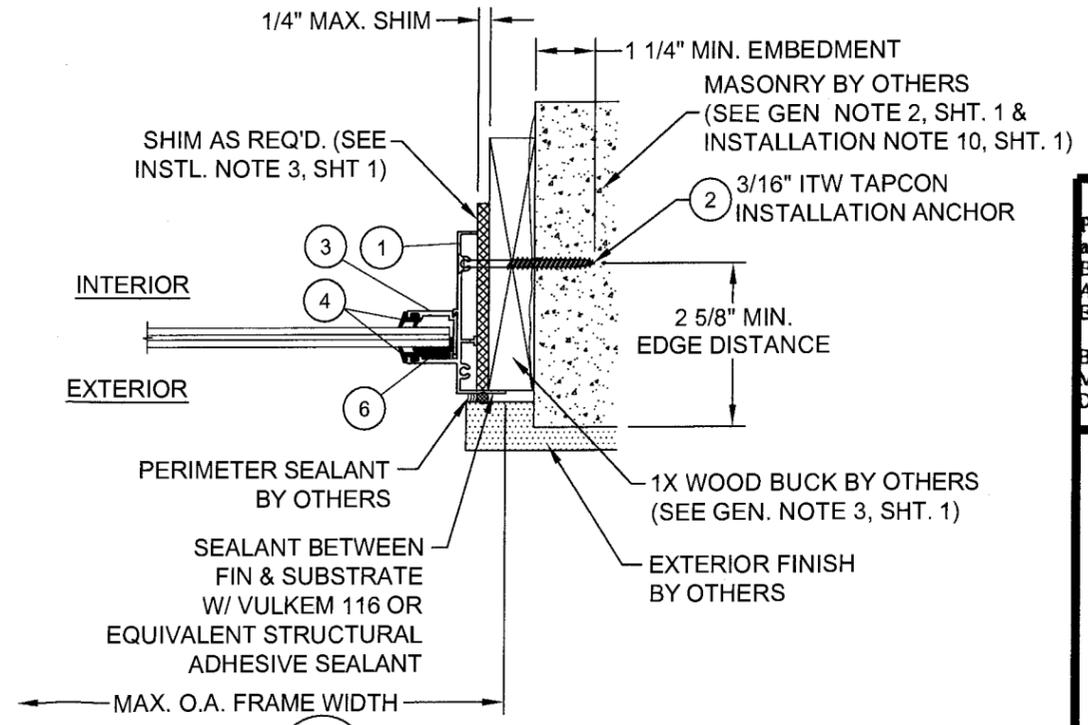

C HORIZONTAL SECTION
FLANGE INSTALLATION
CONCRETE SUBSTRATE

PROJECT # 309-0708

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292
SERIES 6600 PREMIUM ATLANTIC ALUMINUM FIXED WINDOW, LMI
VERTICAL & HORIZONTAL SECTIONS

DATE:	08/01/09
DRAWN BY:	SMC
SCALE:	N.T.S.
DRAWING NO.:	JELD0094
REV.:	0
SHEET:	4 OF 5



PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-09/6.04
Expiration Date 07/24/2013
By: *[Signature]*
Miami Dade Product Control
Division









Robert J. Amoruso, P.E.
Florida P.E. No. 49752

[Signature] 2/11/16

DATE	08/03/09	SMC
DESCRIPTION	ORIGINAL ISSUE DATE	0
REV.	0	4 OF 5

BILL OF MATERIALS



ITEM #	PART #	DESCRIPTION	MATERIAL	MANUFACTURER
1	GAS-46211	MAIN FRAME	6063-T6 ALUMINUM	INDALEX
2	-----	3/16" ITW TAPCON - INSTALLATION ANCHOR	STEEL	ITW
3	GAS-46210	GLAZING BEAD	6063-T6 ALUMINUM	INDALEX
4	601GLVB	GLAZING WEDGE (DUROMETER = 75)	VINYL	JELD-WEN
5	-----	#10 WOOD SCREW - INSTALLATION ANCHOR	STEEL	-----
6	995	SILICONE SEALANT	SILICONE	DOW CORNING
7	30SLF	SLIP ON NAIL FIN	6063-T6 ALUMINUM	INDALEX
8	-----	SELF LEVELING SEALANT	ADHESIVE SEALANT	-----
9	66GASK-1	CORNER GASKET	SOFT CELL FOAM	FRANK LOWE RUBBER & GASKET
10	-----	#8 X 5/8" P.P.H. SHEET METAL SCREW	STEEL	-----

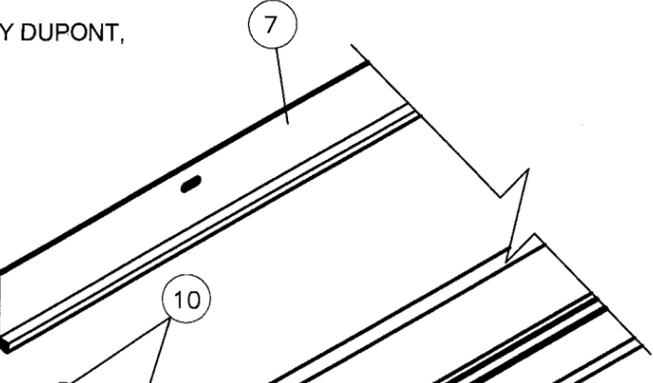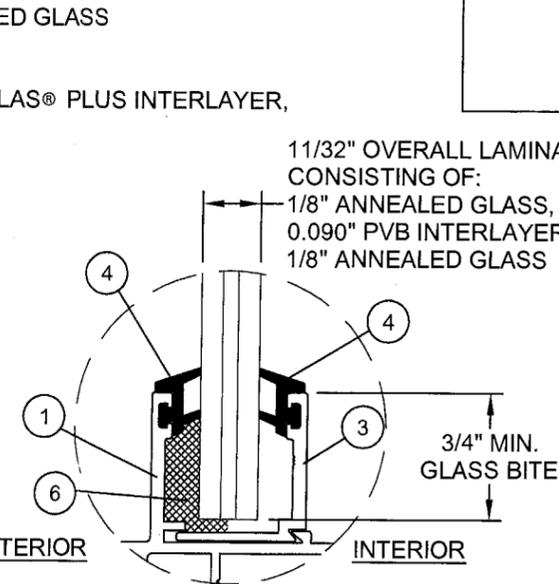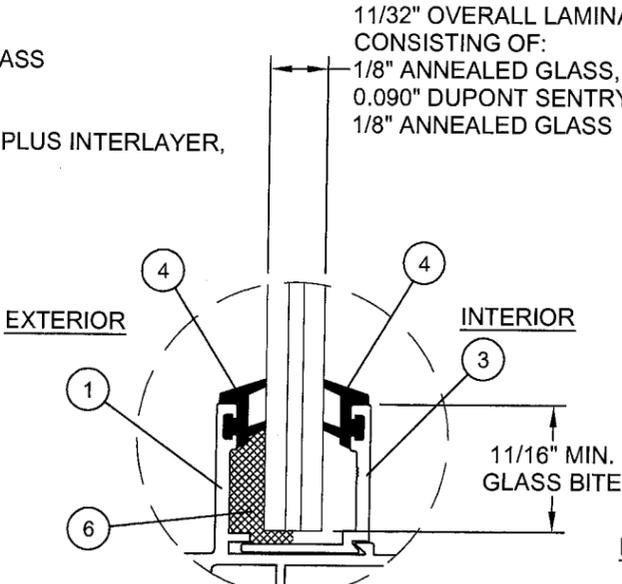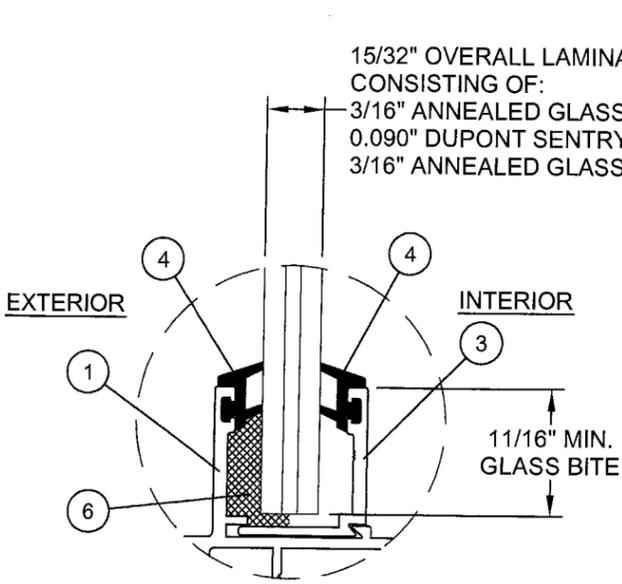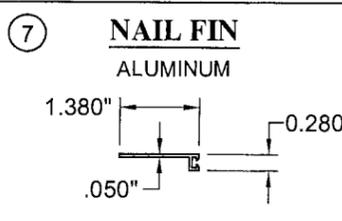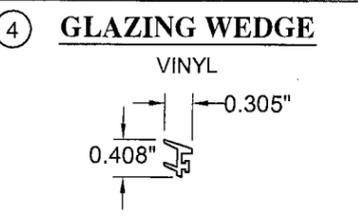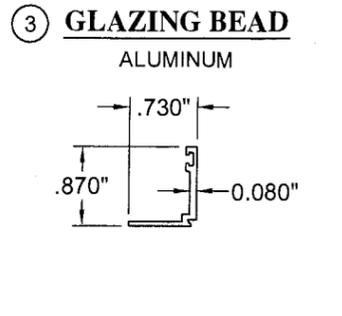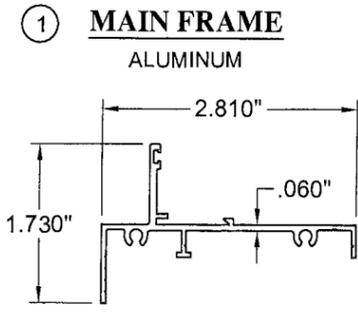

GLAZING DETAIL 1
FOR 52-1/8" X 75" MAX. OR SMALLER


GLAZING DETAIL 3
FOR 36" X 62"
MAX. OR SMALLER

GLAZING DETAIL 5
FOR 52-1/8" X 75" MAX. OR SMALLER

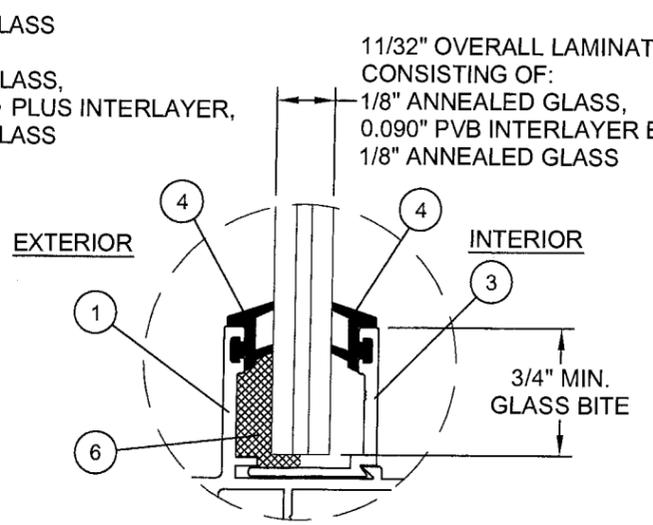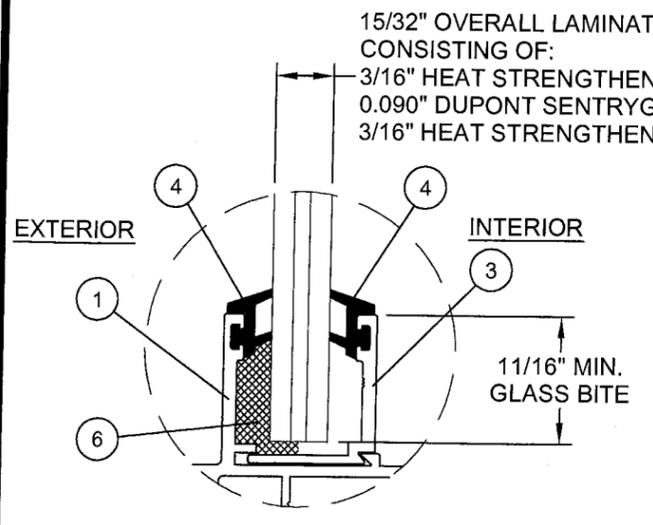

GLAZING DETAIL 2
FOR 48" X 96" MAX. OR SMALLER

GLAZING DETAIL 4
FOR 36" X 62"
MAX. OR SMALLER

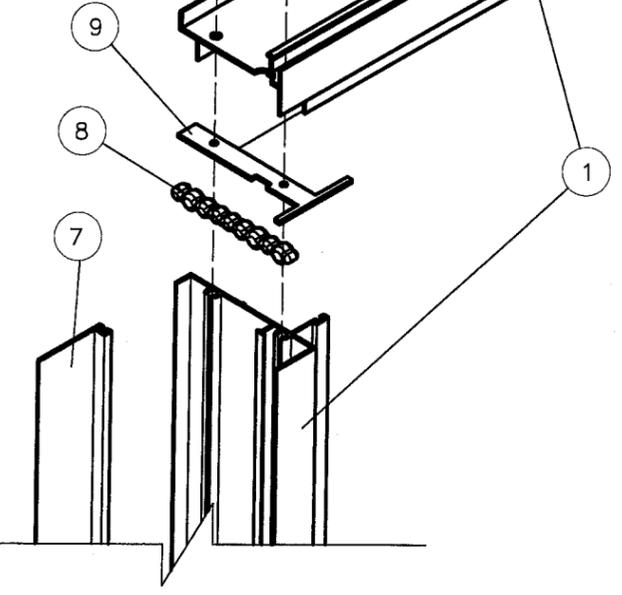

CORNER DETAIL

PROJECT # 309-0708

SMC	SMC	BY
02/03/10	08/03/09	DATE
PER MIAMI DADE COMMENTS	ORIGINAL ISSUE DATE	DESCRIPTION
A	0	REV

JELD-WEN
355 CENTER COURT
VENICE, FLORIDA 34292

PREPARED BY: SMC
SCALE: N.T.S.
DATE: 08/01/09
DRAWING NO: JELD0094
SHEET: 5 OF 5

SERIES 6600 PREMIUM ATLANTIC ALUMINUM FIXED WINDOW, LMI COMPONENTS, BOM, GLAZING & CORNER DETAILS

1555 N. Cogswell Street, Suite C25
Royal Palm Beach, Florida 33486
Phone: 321.660.1788
Fax: 321.660.1789
E-mail: info@jwd.com

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **09-0916.04**
Expiration Date **07/24/2013**
By *[Signature]*
Miami Dade Product Control
Division

Robert J. Amoruso, P.E.
Florida P.E. No. 49752

[Signature]