



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Loren Cook Company
2015 E. Dale Street
Springfield, MO 65803

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model SRSR Steel Roof Fan

APPROVAL DOCUMENT: Drawing No. **SD080717-09**, titled "SRSR Power Ventilator Hurricane Rated", sheets 1 through 11 of 11, dated 07/16/08, Revision B, prepared by Loren Cook Company, signed and sealed by John D. Winslow, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **08-0314.05** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



Carlos M. Utrera
 12/07/09

NOA No. **09-0921.05**
 Expiration Date: **September 4, 2013**
 Approval Date: **December 30, 2009**
 Page 1

Loren Cook Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **SD080717-09**, titled "SRSH Power Ventilator Hurricane Rated", sheets 1 through 11 of 11, dated 07/16/08, Revision B, prepared by Loren Cook Company, signed and sealed by John D. Winslow, P.E.

B. TESTS

1. Addendum letter for Test Report No. 210-3416-1, dated 11/03/09, signed and sealed by Gerard J. Ferrara, P.E.
1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of 270 SRSH-B Tamper Proof Downblast Centrifugal Exhaust Ventilator, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3416-1**, dated 11/13/07, signed and sealed by Gerard J. Ferrara, P.E. "**Submitted under NOA # 08-0314.05**"

C. CALCULATIONS "*Submitted under NOA # 08-0314.05*"

1. Wind Load and Anchor verification calculations, prepared by Tom Barrow Co., complying with FBC-2004, dated 02/29/08, signed and sealed by John D. Winslow, P.E.
2. Wind Load and Anchor verification calculations, prepared by Tom Barrow Co., complying with FBC-2004, dated 07/17/08, signed and sealed by John D. Winslow, P.E.

D. QUALITY ASSURANCE


1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS "*Submitted under NOA # 08-0314.05*"

1. Statement letter of conformance issued by Tom Barrow Co., dated 02/29/08, signed and sealed by John D. Winslow, P.E.
2. Statement letter of no financial interest issued by Tom Barrow Co., dated 02/29/08, signed and sealed by John D. Winslow, P.E.
3. Laboratory compliance letter issued by National Certified Testing Laboratories for Test Report No. **NCTL-210-3416-1**, dated 12/18/07, signed and sealed by Gerard J. Ferrara, P.E.



12/07/09




Carlos M. Utrera, P.E.

Product Control Examiner

NOA No. 09-0921.05

Expiration Date: September 4, 2013

Approval Date: December 30, 2009

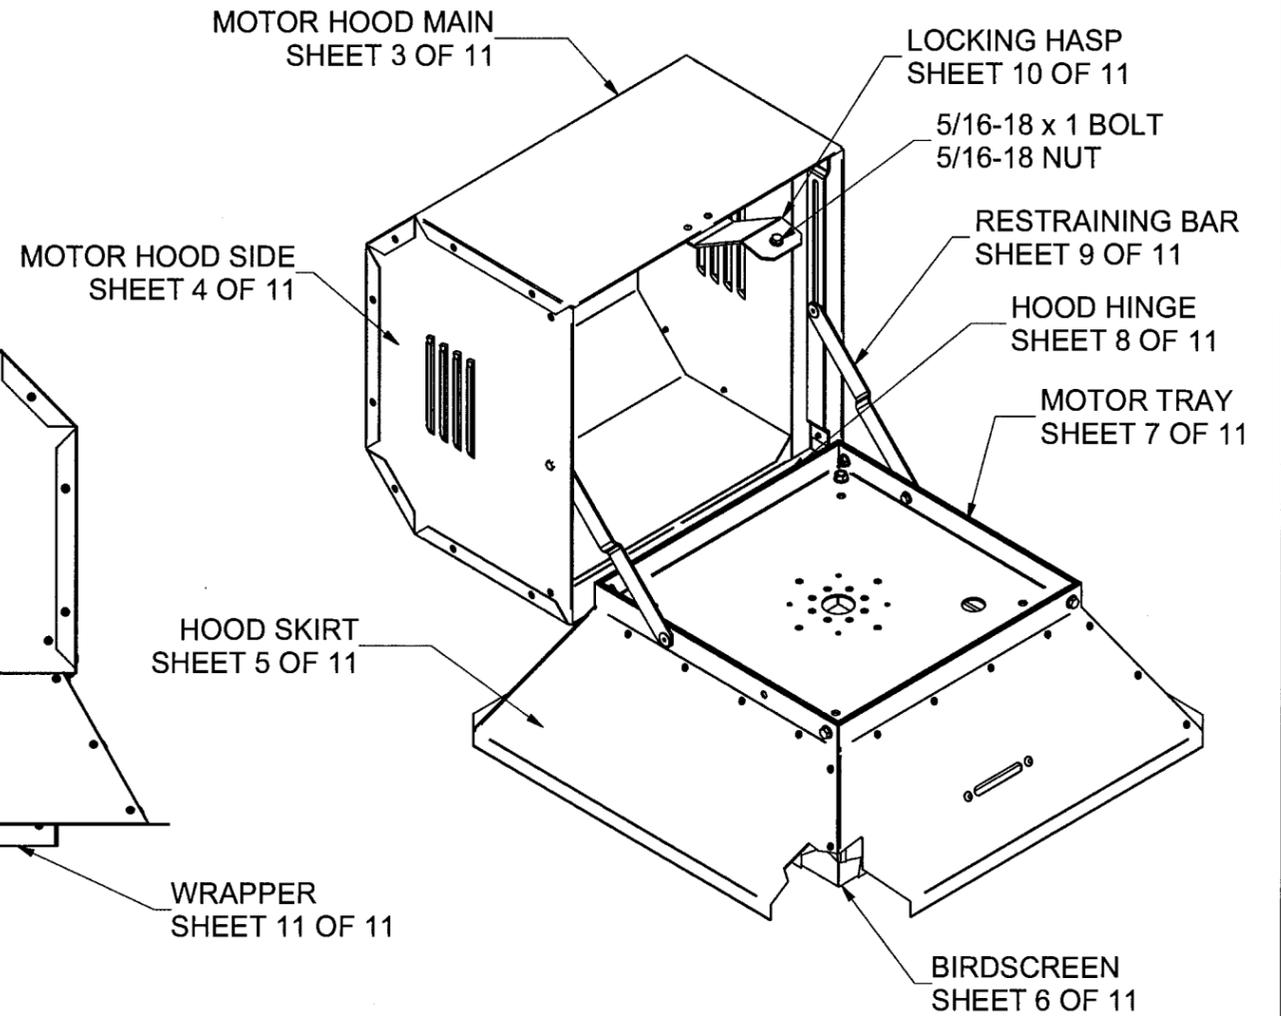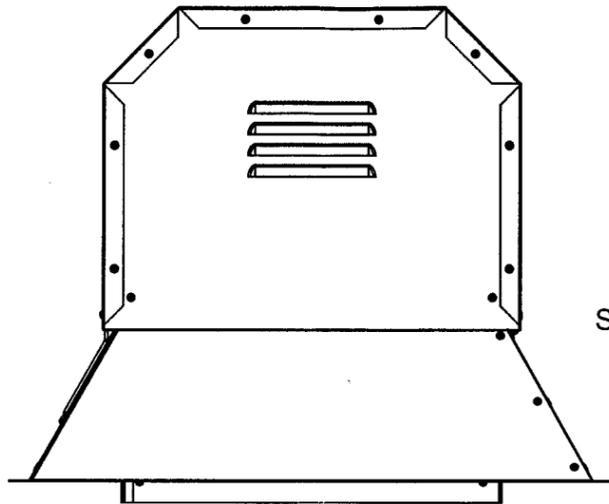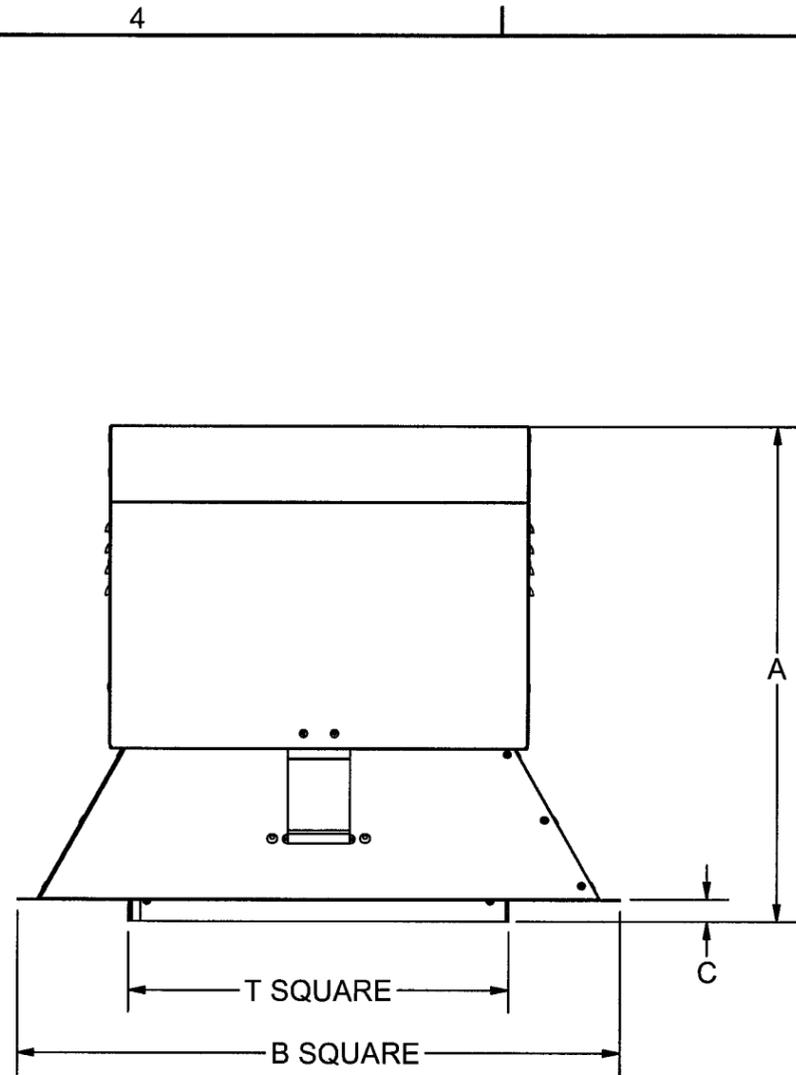


270	46	60	1 1/2	36 1/4
245	40 1/2	52 1/4	1 1/2	30 1/4
225	39 1/4	50 13/16	1 17/32	30 1/4
210	38 5/16	49 3/4	1 1/2	30 1/4
195	37 3/8	48 11/16	1 1/2	30 1/4
180	36 7/16	47 9/16	1 1/2	30 1/4
165	30 1/2	39 15/16	1	24 1/4
150	29 9/16	38 13/16	1	24 1/4
135	25 5/8	33 3/4	1	20 1/4
120	24 11/16	32 11/16	1	20 1/4
100	23 7/16	29 1/4	1	18 1/4
80	23 7/16	29 1/4	1	18 1/4
70	23 7/16	29 1/4	1	18 1/4
60	23 7/16	29 1/4	1	18 1/4
UNIT	A	B	C	T
SIZE	DIM	DIM	DIM	DIM

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0921.05
Expiration Date 29/09/2013
By *[Signature]*
Miami Dale Product Control
Division


NOTE:
DESIGN PRESSURE: +/- 45 PSF
IMPACT RATING: LARGE MISSILE IMPACT RESISTANT

[Signature]
Sept. 11, 2009
JOHN D. WINSLOW P.E.
FL PE LIC. NO. 55841


MATL					LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI	
DRAWN	JMD	7/16/2008				
DESIGNER	BFS	SHEET 1 OF 11				
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED						
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"		FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"				
ANGULAR ± 2°		(NC) = NO INSPECTION REQ'D				
SIZE		DRAWING NO.		REV.		
B		SD080717-09		B		

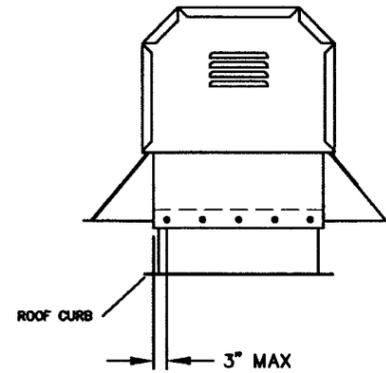


ATTACHMENT OF CURB TO ROOF STRUCTURE

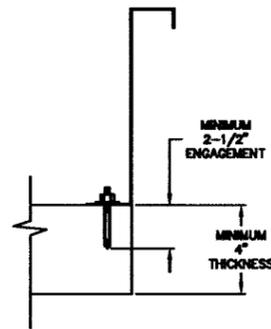

CONCRETE ROOF DECK

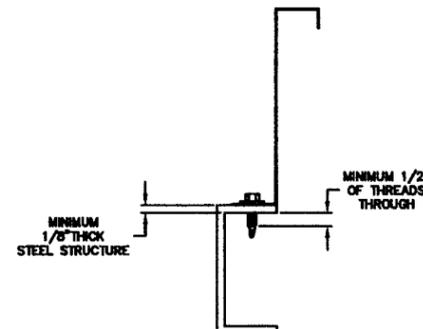

STEEL ROOF STRUCTURE

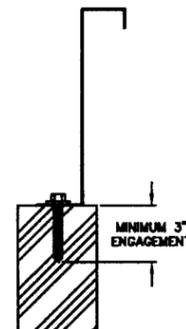

TIMBER ROOF STRUCTURE

UNIT SIZE	MINIMUM NUMBER OF FASTENERS PER SIDE TO ATTACH UNIT TO CURB	MINIMUM NUMBER OF FASTENERS PER SIDE TO ATTACH CURB TO ROOF STRUCTURE
60	5	3
70	5	3
80	5	3
100	5	3
120	5	3
135	5	3
150	6	4
165	6	4
180	7	5
195	7	5
210	7	5
225	7	5
245	7	5
270	9	6


PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 09-0921-05
 Expiration Date 09/04/2013
 By *[Signature]*
 Miami/Dade Product Control Division

[Signature]
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55481

NOTES:

- 1) SRSH MODEL AS REFERRED TO HEREIN REFERS TO ALL LOREN COOK MODEL SRSH FANS INCLUDING BOTH DIRECT AND BELT DRIVE UNITS WHICH ARE CONSTRUCTED WITH THE SAME OUTER HOUSING COMPONENTS.
- 2) THIS APPROVAL IS FOR THE STRUCTURAL CAPACITY OF THE EXTERIOR HOUSING ONLY, IT DOES NOT INCLUDE ANY INTERIOR MECHANISM OR ELECTRICAL PART.
- 3) THIS PRODUCT HAS NOT BEEN TESTED FOR WATER PENETRATION.
- 4) UNIT IS TO BE ROOF MOUNTED ON A ROOF CURB THAT IS ADEQUATELY ATTACHED TO THE ROOF STRUCTURE TO SUSTAIN ALL FORCES WHICH MAY BE PRODUCED BY THE PRESCRIBED ENVIRONMENTAL FORCES EXERTED ON THE FAN AND CURB.
 CONCRETE DECK: CURB IS TO BE ATTACHED WITH WEDGE TYPE CONCRETE ANCHOR - MINIMUM 3/8" DIAMETER CARBON STEEL - HILTI KWIK BOLT 3 OR EQUAL. MINIMUM 2-1/2" OF ENGAGEMENT IN 2000 PSI MINIMUM CONCRETE. MINIMUM DECK THICKNESS IS 4" AND ANCHORS ARE MINIMUM 2" FROM EDGE. SEE TABLE FOR MINIMUM QUANTITY OF ANCHORS REQUIRED PER CURB SIDE.
 STEEL ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH SELF-TAPPING STEEL SCREW OF MINIMUM NOMINAL SIZE OF 3/8" DIAMETER AND SCREW SHALL PASS THROUGH STEEL AT LEAST 1/2". THE SCREW MUST BE AT LEAST 2 SCREW DIAMETERS FROM MATERIAL EDGE. SEE TABLE FOR MINIMUM QUANTITY OF SCREWS REQUIRED PER CURB SIDE.
 TIMBER ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH STEEL LAG BOLTS NOMINAL SIZE OF 3/8" DIAMETER OR LARGER. TIMBER IS TO BE 2" NOMINAL SIZE OR GREATER. THE BOLT SHALL HAVE A MINIMUM OF 3" OF THREAD ENGAGEMENT AND SHALL BE AT LEAST 1" FROM MATERIAL EDGE. SEE TABLE FOR MINIMUM QUANTITY OF BOLTS REQUIRED PER CURB SIDE.
- 5) THE CURB SHALL BE CONSTRUCTED OF G-90 GALVANIZED STEEL OR STAINLESS STEEL. THE CURB MATERIAL THICKNESS SHALL BE 18 GA OR GREATER AND HEIGHT SHALL NOT EXCEED A HEIGHT 24".
- 6) THE SRSH SHALL BE ATTACHED TO THE CURB WITH ONE OF THE FOLLOWING METHODS INSTALLED ON ALL FOUR SIDES OF THE CURB CAP. THE FASTENERS SHALL BE ATLEAST 3" FROM THE UNIT CORNER AND THE QUANTITY OF FASTENERS SHALL EQUAL OR EXCEED THE QUANTITY SHOWN IN THE FASTENER TABLE.
 A) .25 X 2" HEX HEAD SCREW
 B) ALTERNATE .25" HEX HEAD BOLT WITH COMPANION NUT INSTALLED ON THE INTERIOR OF THE CURB
- 7) ALL FASTENERS ARE TO BE HIGH QUALITY CORROSION RESISTANT STEEL OR STAINLESS STEEL
- 8) ANY GAP BETWEEN THE CURB AND CURB CAP SHALL BE FILLED BY THE INSTALLING CONTRACTOR WITH A SUITABLE CORROSION RESISTANT MATERIAL THAT ALLOWS THE FASTENERS TO BE INSTALLED WITHOUT CAUSING EXCESSIVE DISTORTION OF THE UNIT FLANGES.
- 9) THE INSTALLER IS RESPONSIBLE FOR CHECKING THAT ALL FASTENERS ARE PROPERLY INSTALLED AND ALL ACCESS PANELS ARE IN PLACE BEFORE PUTTING THE UNIT INTO SERVICE.
- 10) ALL FASTENERS AND ACCESS PANELS MUST BE PROPERLY INSTALLED AFTER MAINTENANCE OPERATIONS FOR UNIT TO MAINTAIN CODE COMPLIANCE.

MAT'L	-		 LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD	7/16/2008	
DESIGNER	BFS	SHEET 2 OF 11	
DO NOT SCALE DRAWING			SRSH POWER VENTILATOR HURRICANE RATED
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL		FRACTIONAL	
.XX=±.063"		≤12"=±1/16"	
.XXX=±.010"		>12" THRU 96"=±1/8"	
.XXXX=±.001"		>96" THRU 144"=±1/4"	
ANGULAR		>144"=±3/8"	
±2'		(NC)=NO INSPECTION REQ'D	
SIZE	DRAWING NO.		REV.
B	SD080717-09		B

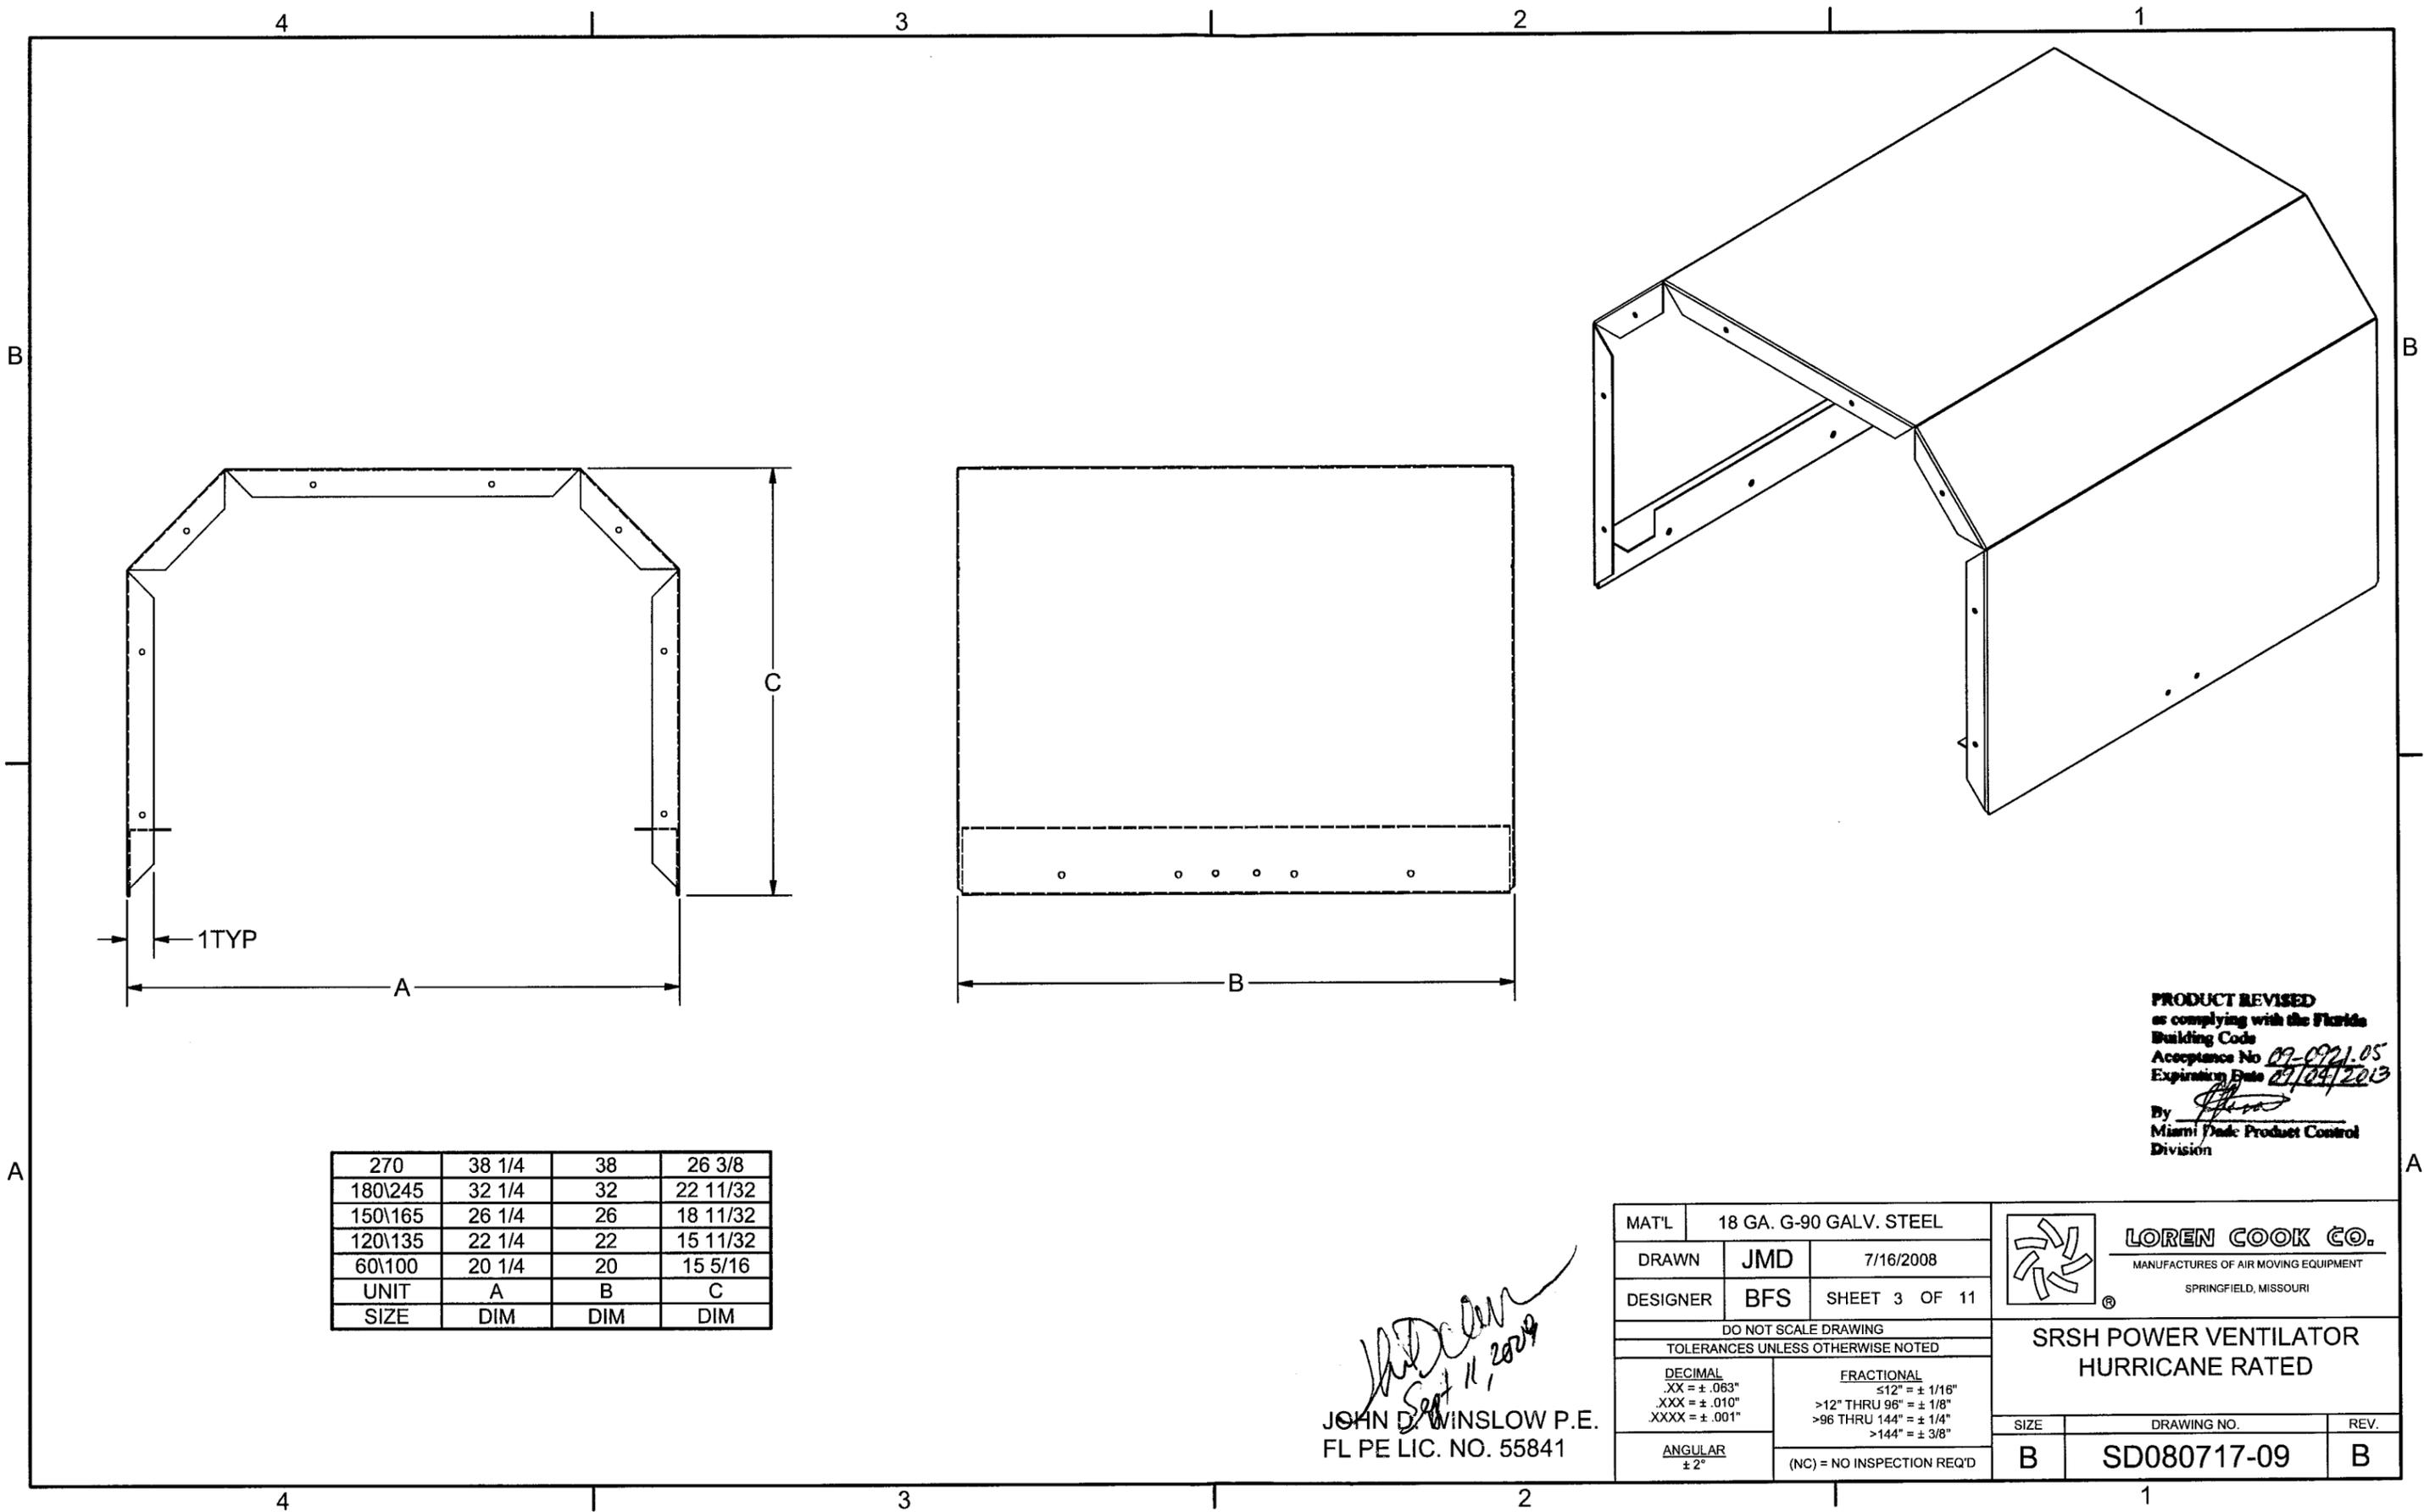


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0921.05
 Expiration Date 07/09/2013
 By [Signature]
 Miami Dade Product Control
 Division

270	38 1/4	38	26 3/8
180\245	32 1/4	32	22 11/32
150\165	26 1/4	26	18 11/32
120\135	22 1/4	22	15 11/32
60\100	20 1/4	20	15 5/16
UNIT	A	B	C
SIZE	DIM	DIM	DIM

[Signature]
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841

MAT'L	18 GA. G-90 GALV. STEEL		 LOREN COOK CO. <small>MANUFACTURERS OF AIR MOVING EQUIPMENT</small> <small>SPRINGFIELD, MISSOURI</small>						
DRAWN	JMD	7/16/2008							
DESIGNER	BFS	SHEET 3 OF 11	SRSH POWER VENTILATOR HURRICANE RATED						
DO NOT SCALE DRAWING									
TOLERANCES UNLESS OTHERWISE NOTED									
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"		FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"							
ANGULAR ± 2°		(NC) = NO INSPECTION REQ'D	<table border="1"> <tr> <td>SIZE</td> <td>DRAWING NO.</td> <td>REV.</td> </tr> <tr> <td>B</td> <td>SD080717-09</td> <td>B</td> </tr> </table>	SIZE	DRAWING NO.	REV.	B	SD080717-09	B
SIZE	DRAWING NO.	REV.							
B	SD080717-09	B							


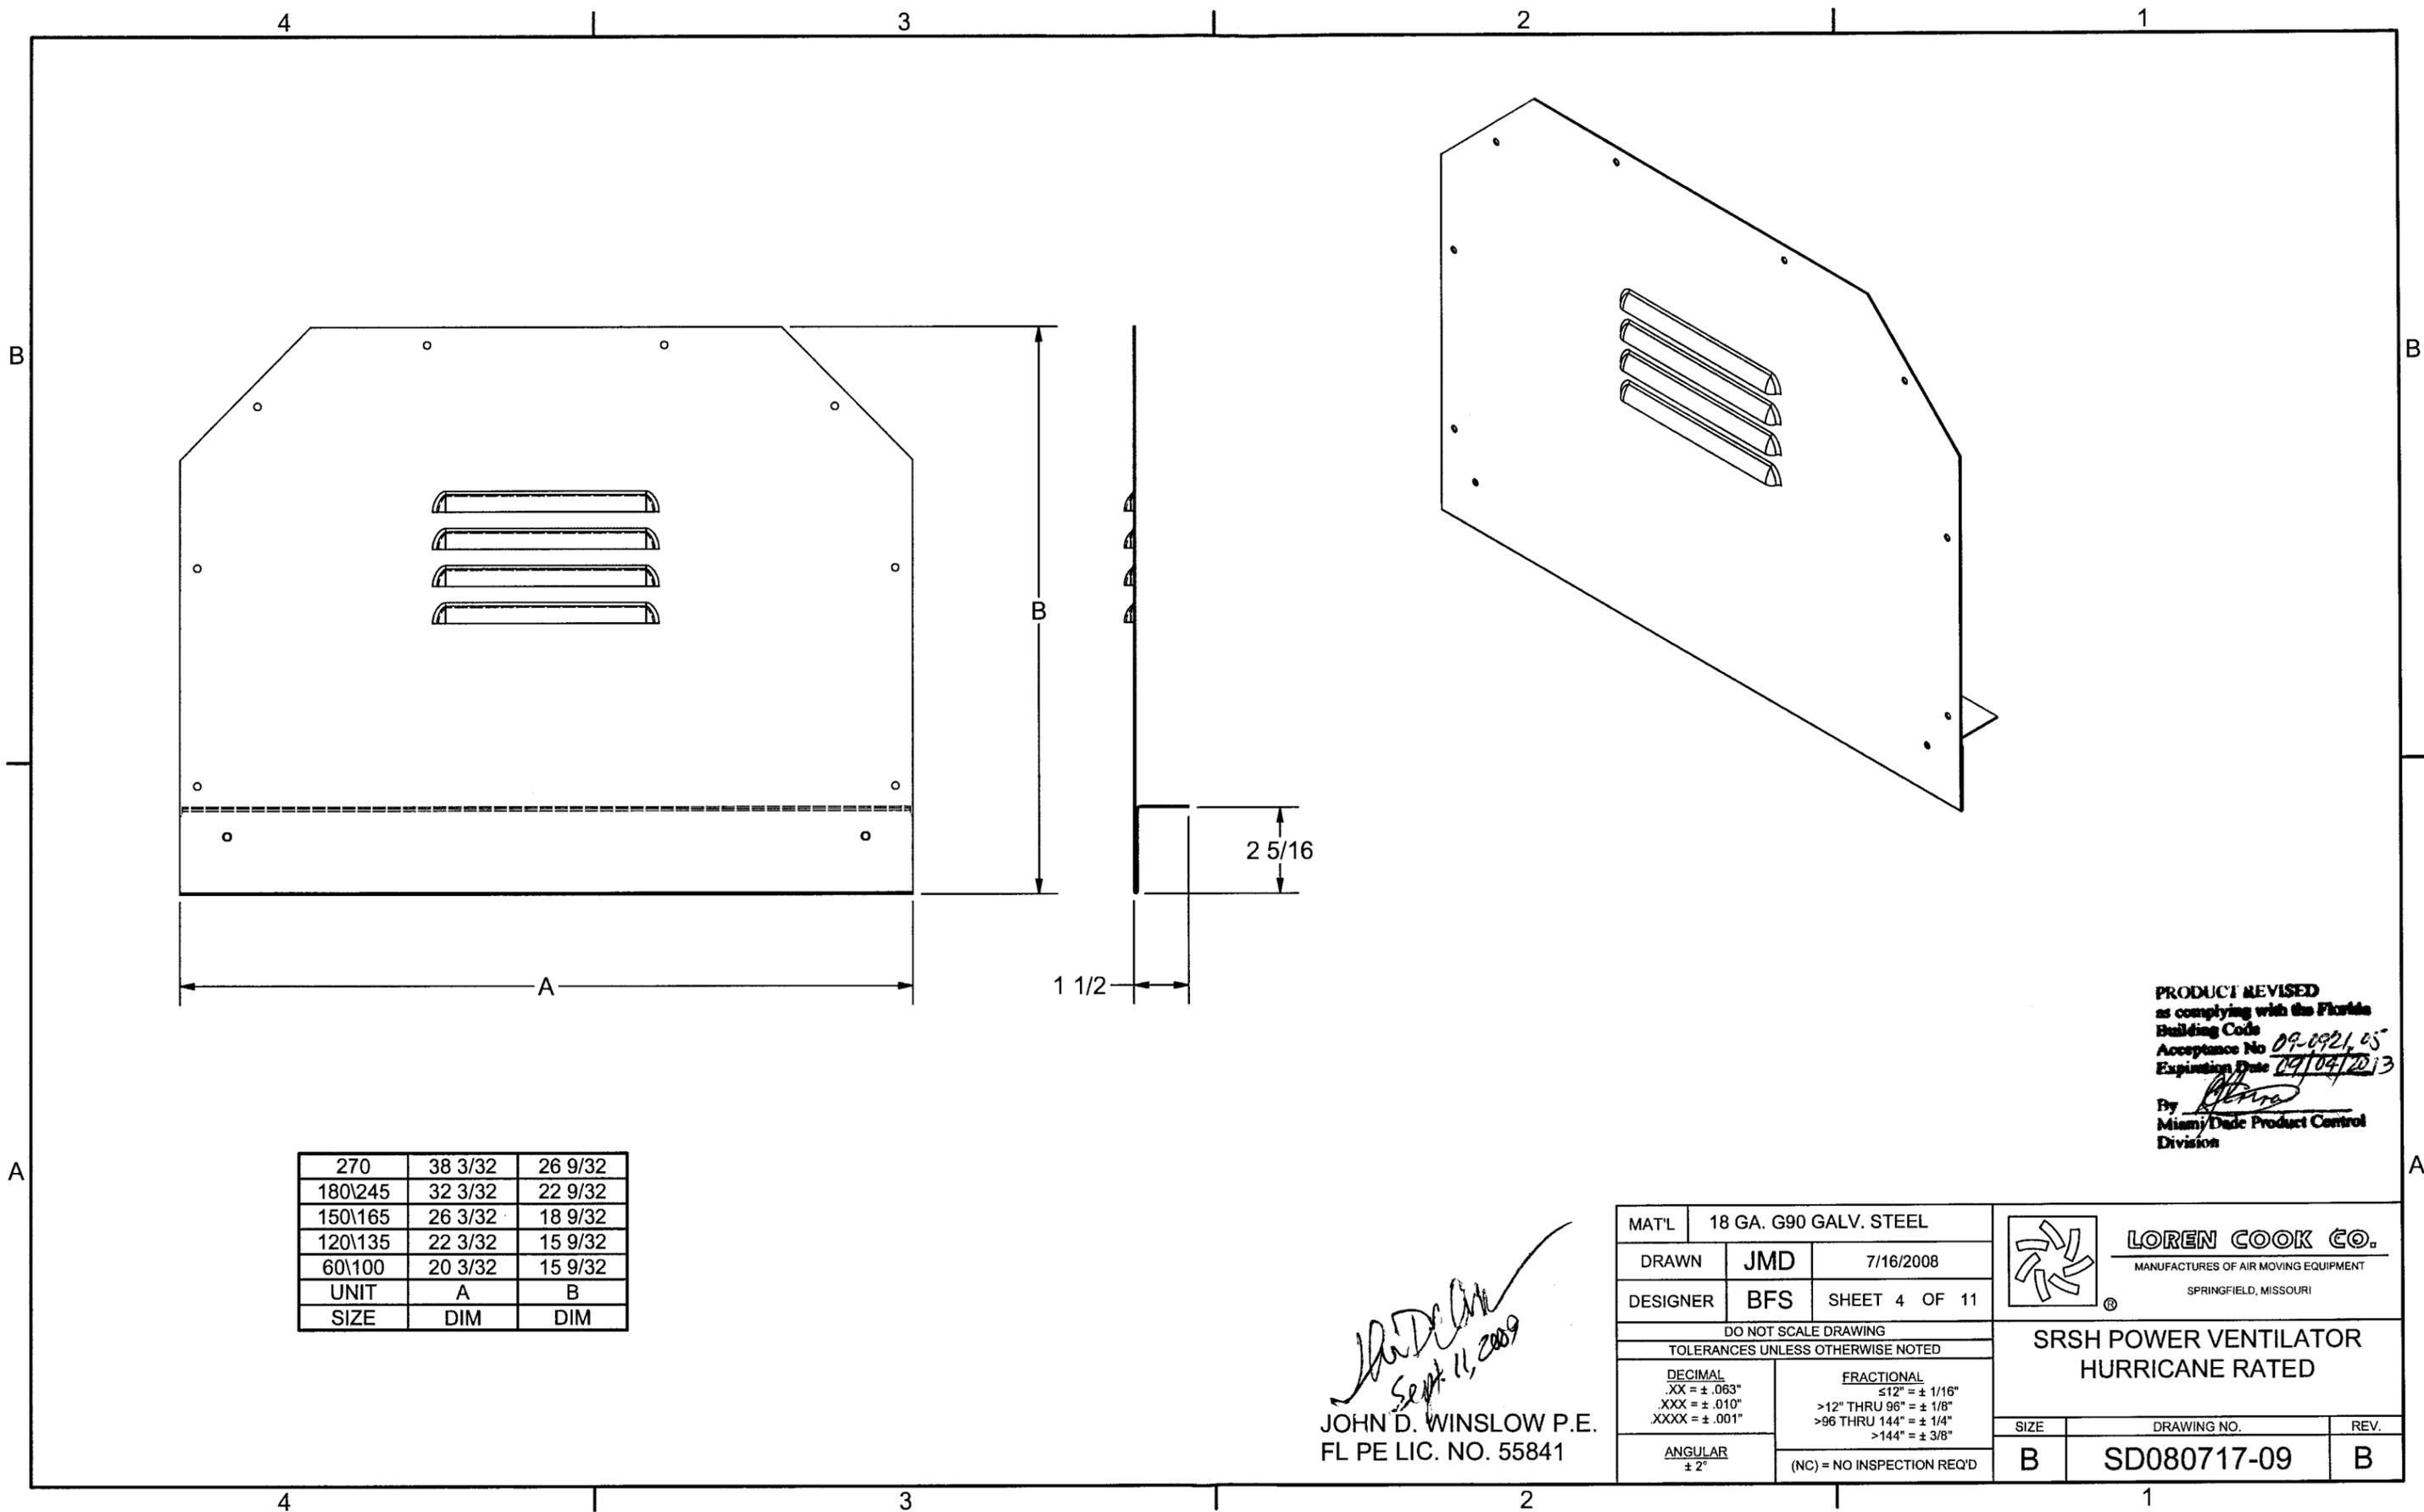


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0921-05
 Expiration Date 09/09/2013
 By *[Signature]*
 Miami/Dade Product Control
 Division

270	38 3/32	26 9/32
180\245	32 3/32	22 9/32
150\165	26 3/32	18 9/32
120\135	22 3/32	15 9/32
60\100	20 3/32	15 9/32
UNIT	A	B
SIZE	DIM	DIM

[Signature]
 Sept 11, 2009
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841

MAT'L	18 GA. G90 GALV. STEEL		 LOREN COOK CO. <small>MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI</small>
DRAWN	JMD	7/16/2008	
DESIGNER	BFS	SHEET 4 OF 11	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED			SRSH POWER VENTILATOR HURRICANE RATED
<small>DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"</small>		<small>FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96" THRU 144" = ± 1/4" >144" = ± 3/8"</small>	
<small>ANGULAR ± 2°</small>		<small>(NC) = NO INSPECTION REQ'D</small>	
SIZE	DRAWING NO.	REV.	
B	SD080717-09	B	

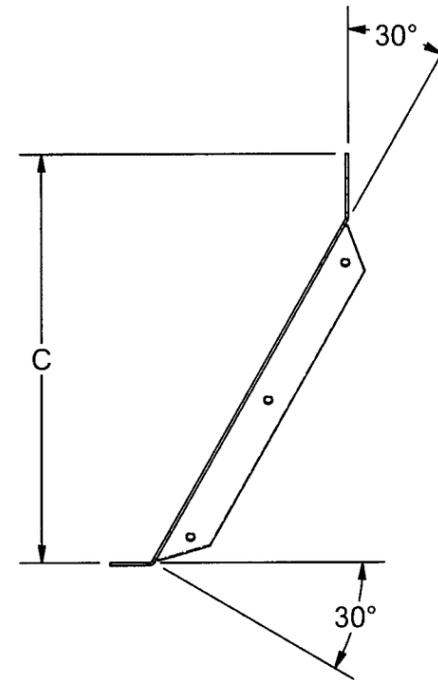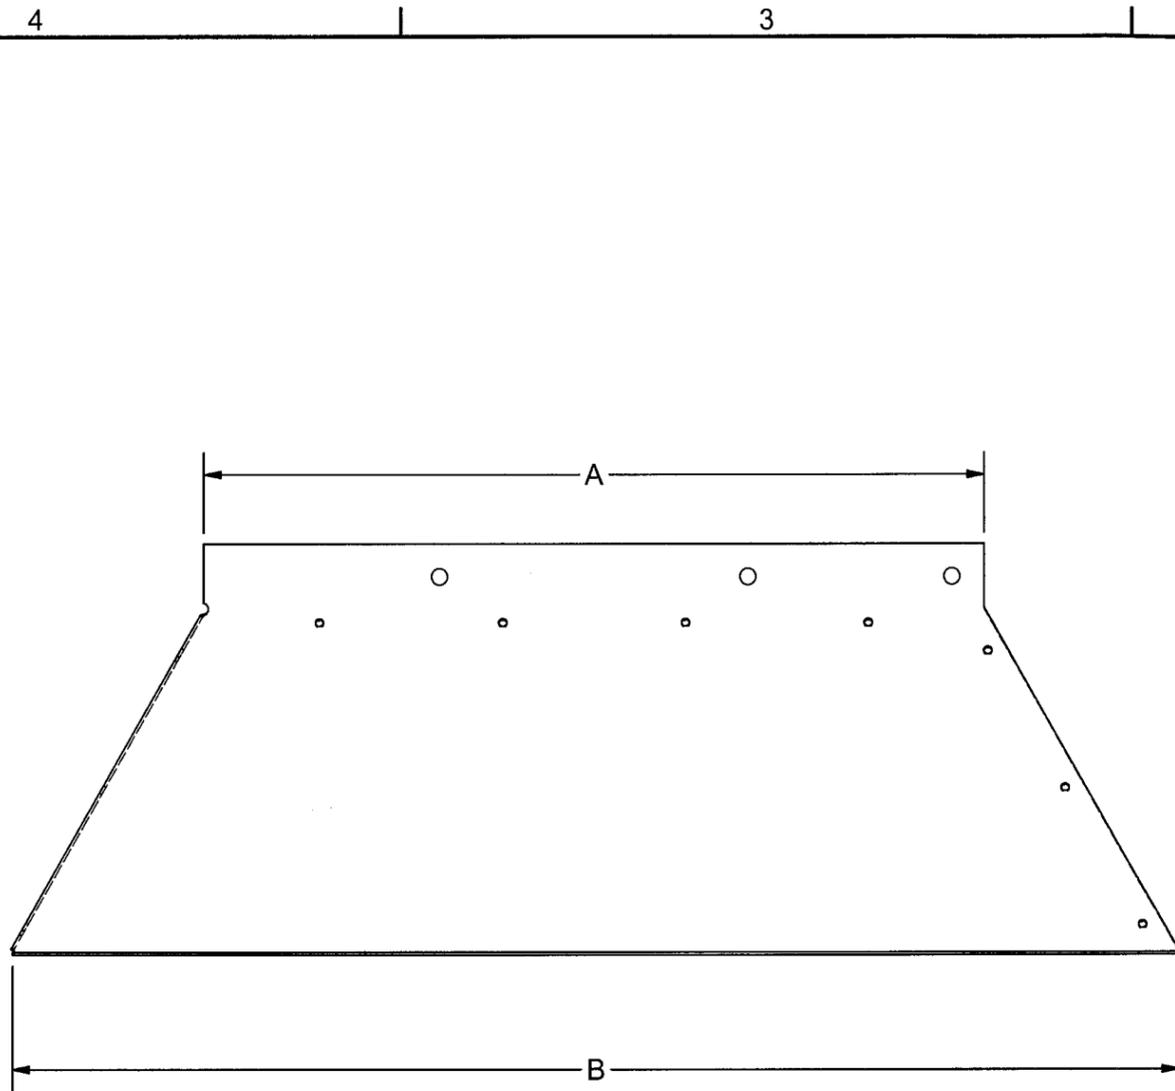


270	36 1/8	58	20 7/16
245	30 1/8	50 7/32	18 29/32
225	30 1/8	48 25/32	17 21/32
210	30 1/8	47 23/32	16 3/4
195	30 1/8	46 21/32	15 13/16
180	30 1/8	45 9/16	14 7/8
165	24 1/8	37 29/32	13 13/32
150	24 1/8	36 13/16	12 1/2
135	20 1/8	31 3/4	11 9/16
120	20 1/8	30 11/16	10 5/8
60\100	18 1/8	27 1/4	9 13/32
UNIT	A	B	C
SIZE	DIM	DIM	DIM

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0921-05
 Expiration Date 07/04/2013
 By *[Signature]*
 Miami Dade Product Control
 Division

[Signature]
 Sept. 11, 2009
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841

MAT'L	16 GA. G90 GALV. STEEL SHEET	
DRAWN	JMD	7/16/2008
DESIGNER	BFS	SHEET 5 OF 11
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"		FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"
ANGULAR ± 2°	(NC) = NO INSPECTION REQ'D	
 LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI		
SRSH POWER VENTILATOR HURRICANE RATED		
SIZE	DRAWING NO.	REV.
B	SD080717-09	B



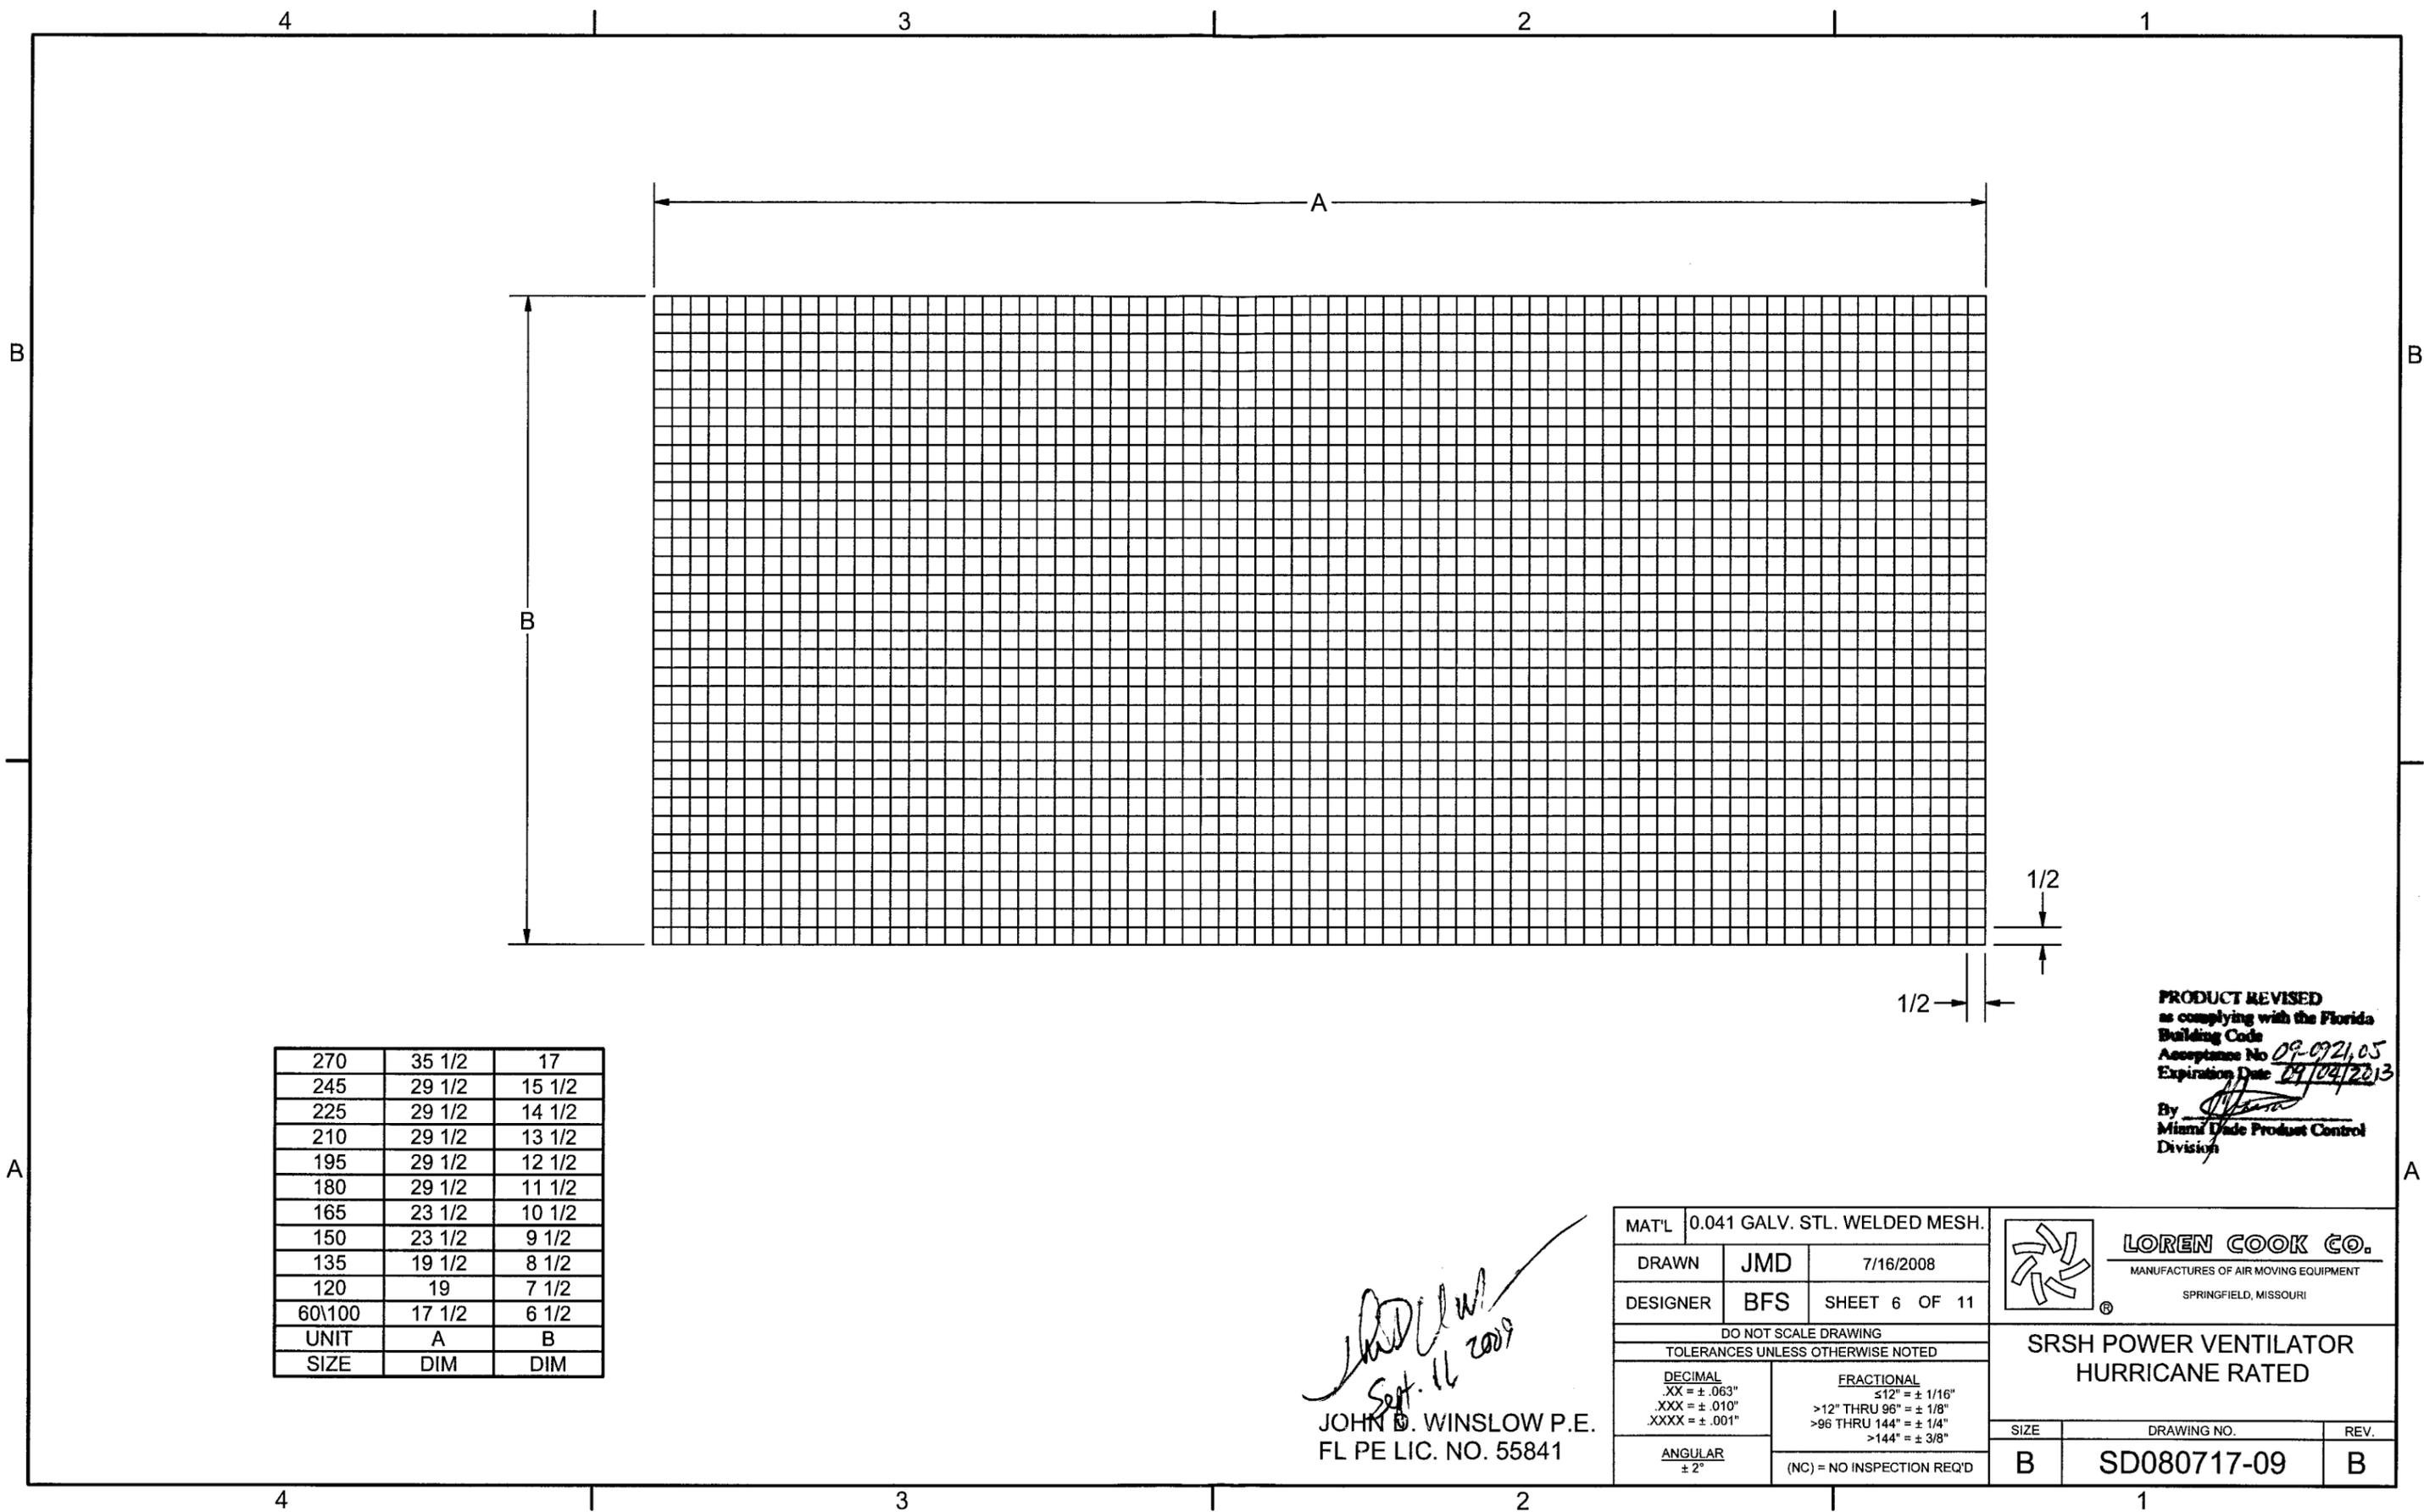


270	35 1/2	17
245	29 1/2	15 1/2
225	29 1/2	14 1/2
210	29 1/2	13 1/2
195	29 1/2	12 1/2
180	29 1/2	11 1/2
165	23 1/2	10 1/2
150	23 1/2	9 1/2
135	19 1/2	8 1/2
120	19	7 1/2
60\100	17 1/2	6 1/2
UNIT	A	B
SIZE	DIM	DIM

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0721,05
 Expiration Date 09/04/2013
 By [Signature]
 Miami Dade Product Control
 Division

[Handwritten Signature]
 Sept. 16 2009
JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841


MAT'L	0.041 GALV. STL. WELDED MESH.	
DRAWN	JMD	7/16/2008
DESIGNER	BFS	SHEET 6 OF 11
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
XX = ± .063"	≤12" = ± 1/16"	
.XXX = ± .010"	>12" THRU 96" = ± 1/8"	
.XXXX = ± .001"	>96 THRU 144" = ± 1/4"	
	>144" = ± 3/8"	
ANGULAR	(NC) = NO INSPECTION REQ'D	
± 2°		
LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI		
SRSH POWER VENTILATOR HURRICANE RATED		
SIZE	DRAWING NO.	REV.
B	SD080717-09	B

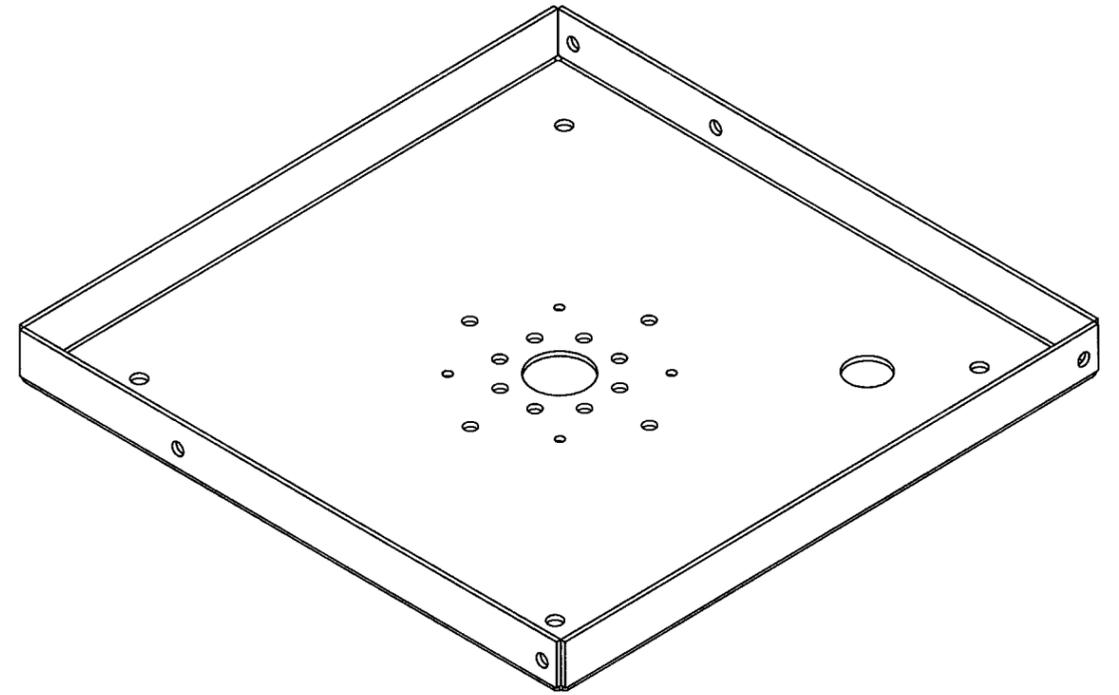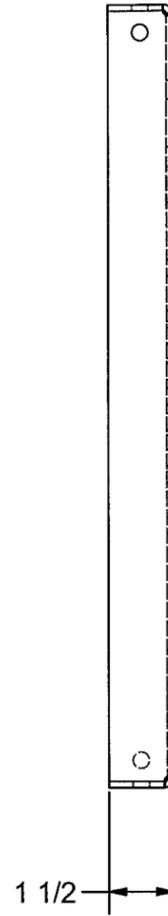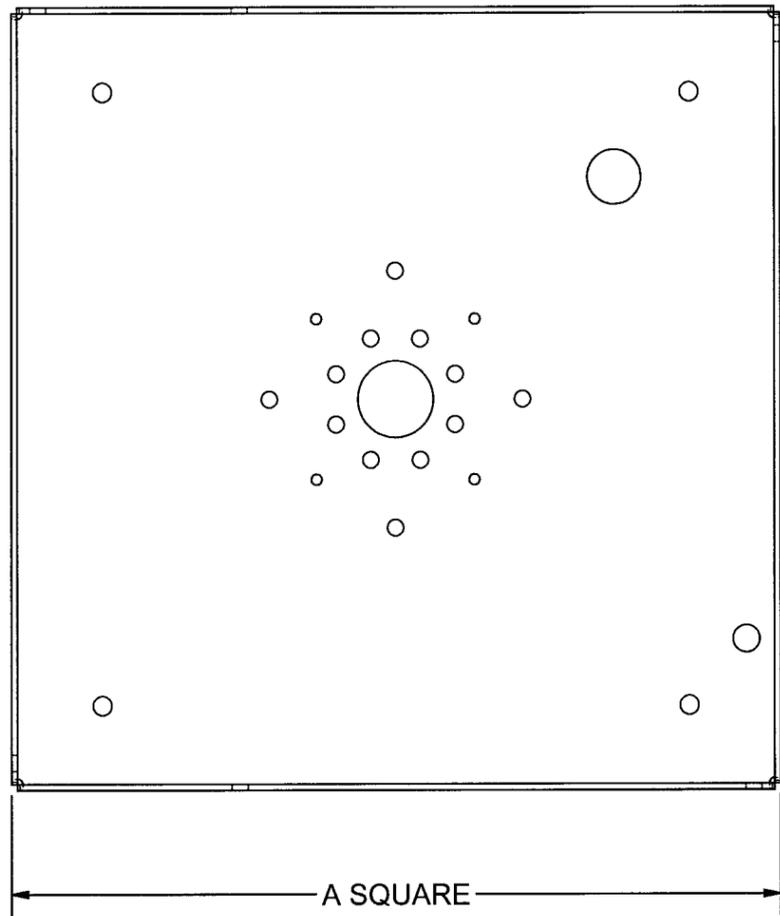


270	35 7/8
225\245	29 7/8
180\210	29 7/8
150\165	23 7/8
120\135	19 7/8
60\100	17 7/8
UNIT	A
SIZE	DIM

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 07-0921-05
 Expiration Date 07/04/2013
 By [Signature]
 Miami Dade Product Control
 Division

[Signature]
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841


MAT'L	10 GA. G90-GALV. STEEL		 LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD	7/16/2008	
DESIGNER	BFS	SHEET 7 OF 11	
DO NOT SCALE DRAWING			SRSH POWER VENTILATOR HURRICANE RATED
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"		FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"	
ANGULAR ± 2°		(NC) = NO INSPECTION REQ'D	
SIZE	DRAWING NO.	REV.	
B	SD080717-09	B	


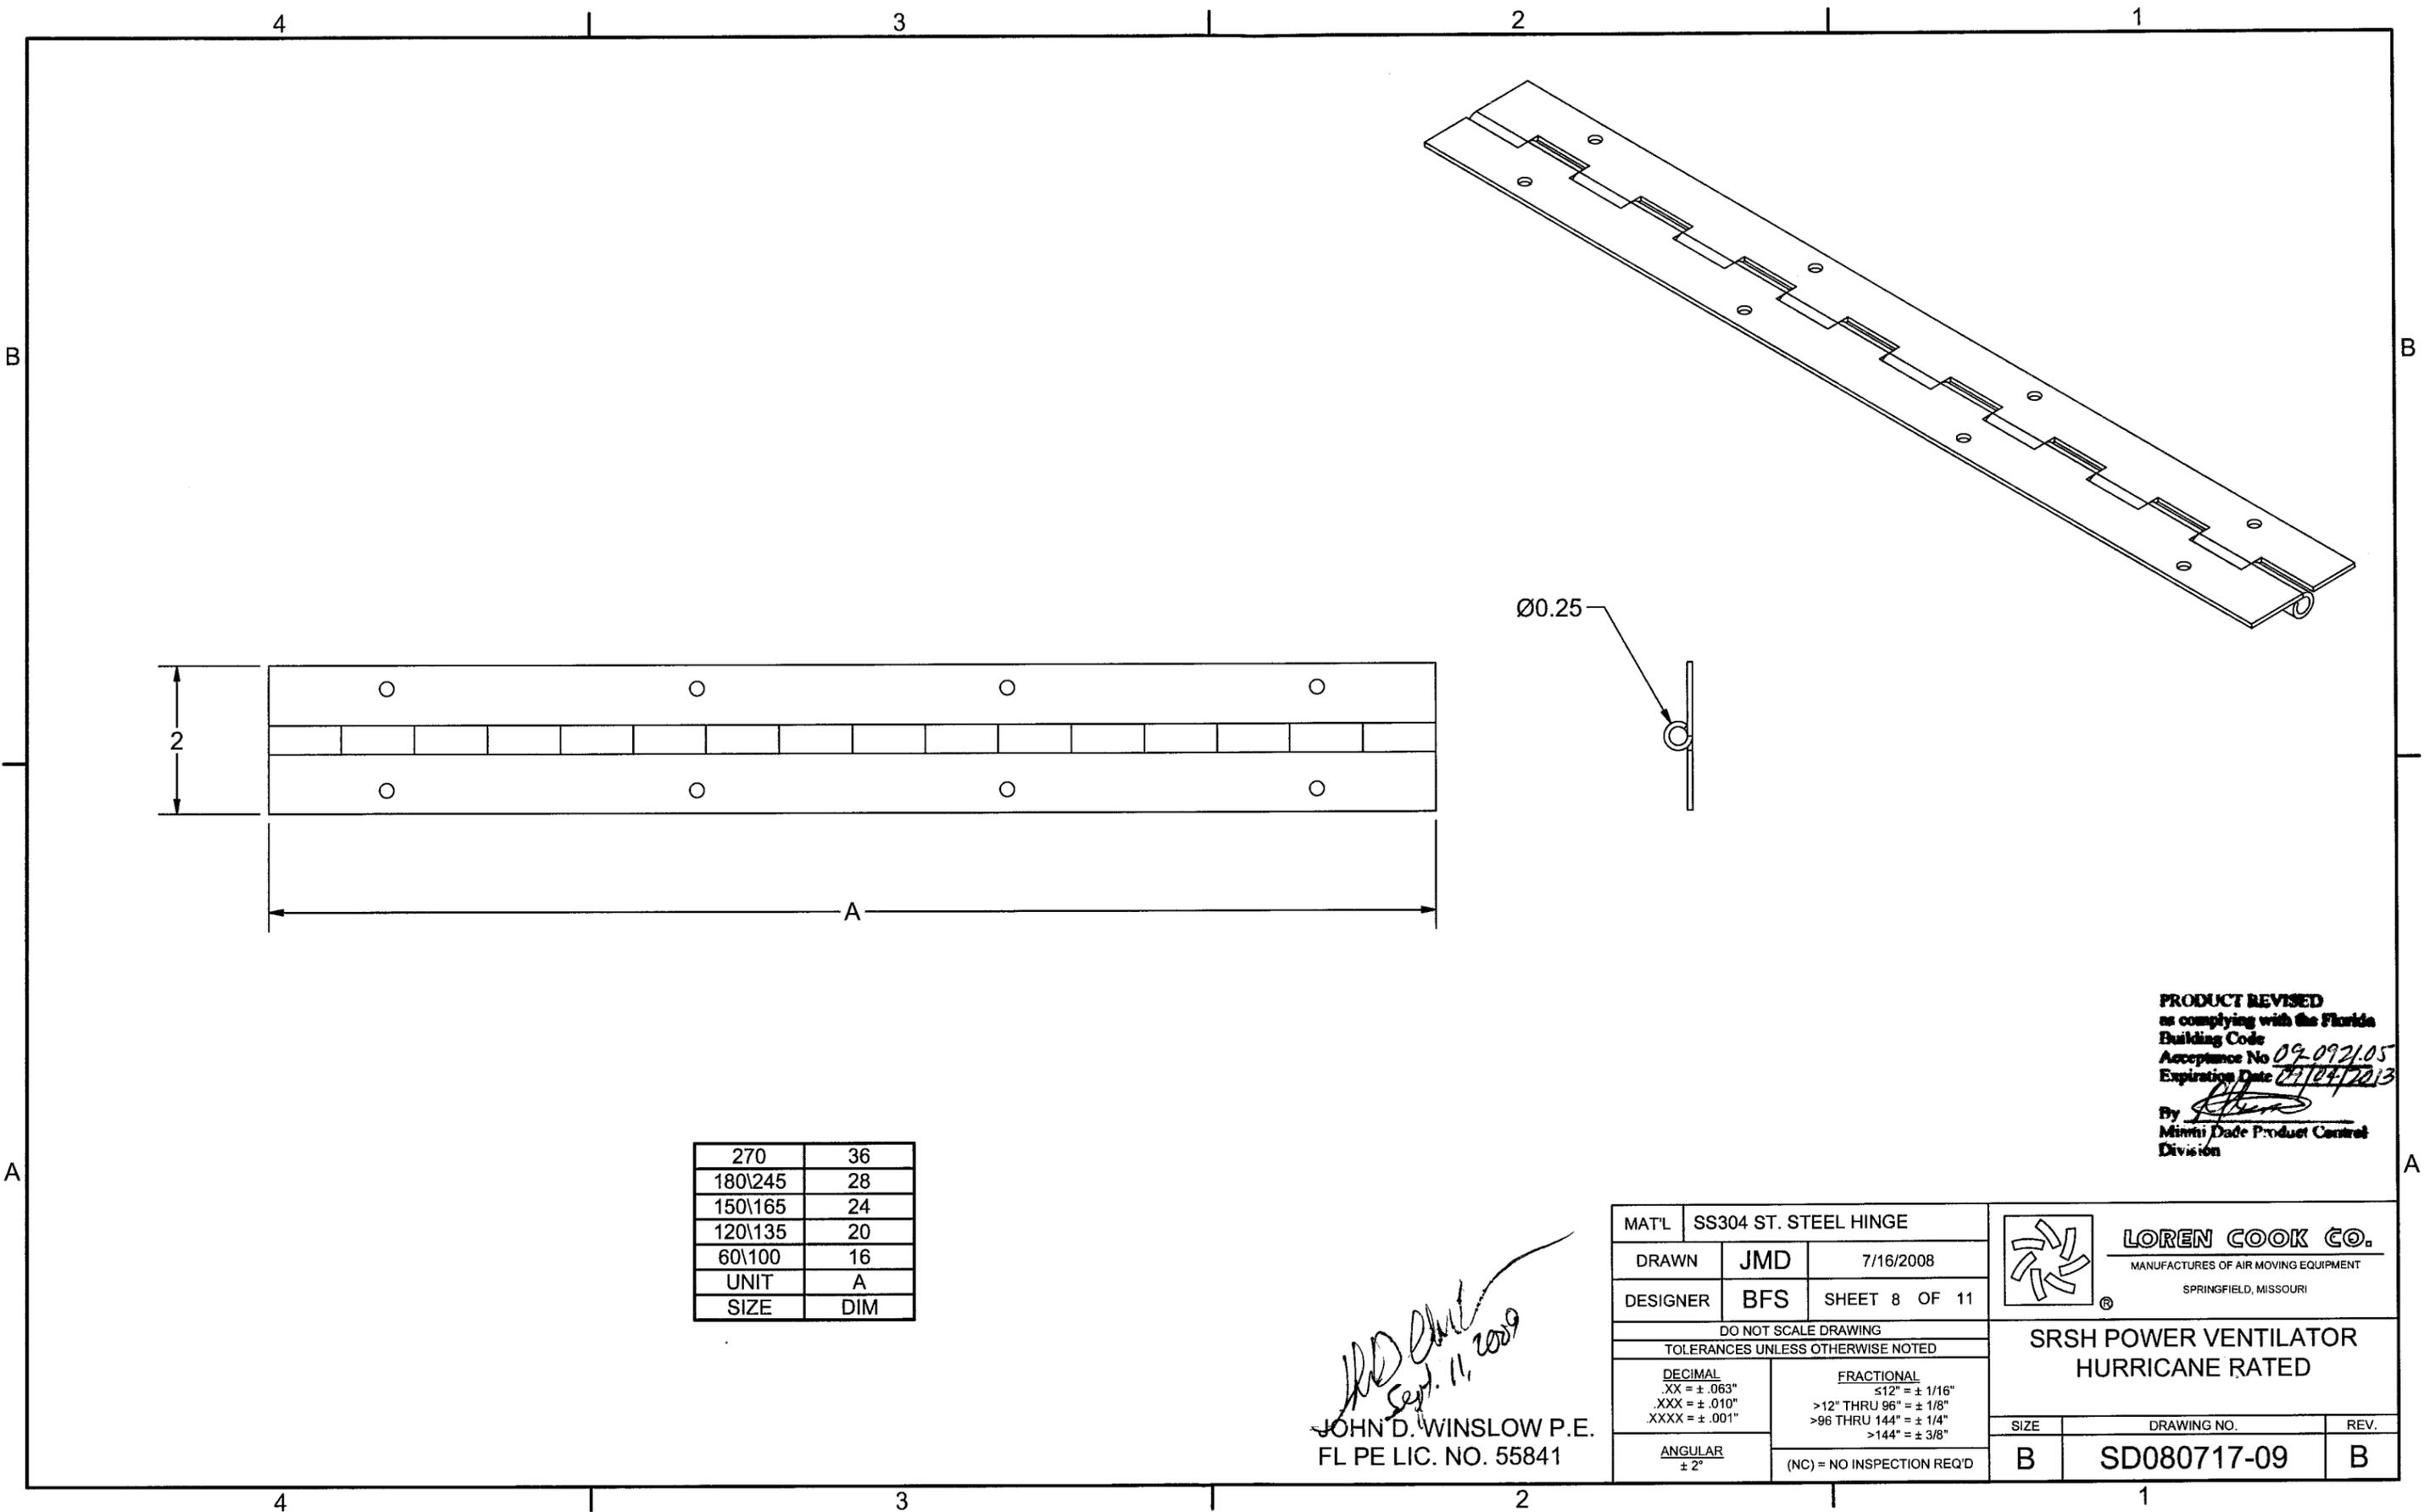


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0921.05
 Expiration Date 07/07/2013
 By *[Signature]*
 Miami Dade Product Control
 Division

270	36
180\245	28
150\165	24
120\135	20
60\100	16
UNIT	A
SIZE	DIM

[Signature]
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841

MAT'L	SS304 ST. STEEL HINGE		 LOREN COOK CO. <small>MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI</small>
DRAWN	JMD	7/16/2008	
DESIGNER	BFS	SHEET 8 OF 11	
DO NOT SCALE DRAWING			
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"		FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"	
ANGULAR ± 2°		(NC) = NO INSPECTION REQ'D	
		SIZE	DRAWING NO.
		B	SD080717-09
		REV.	B

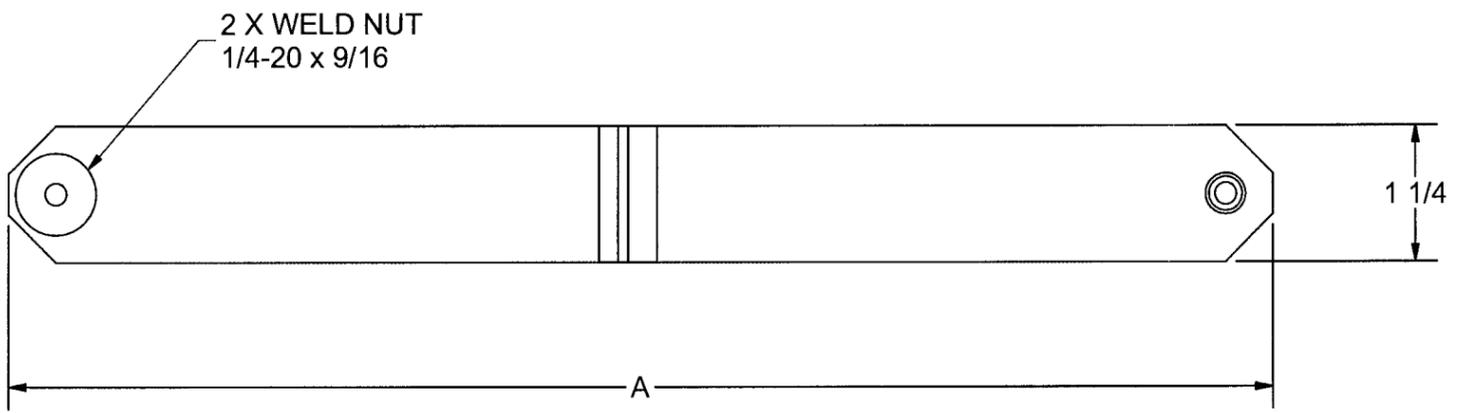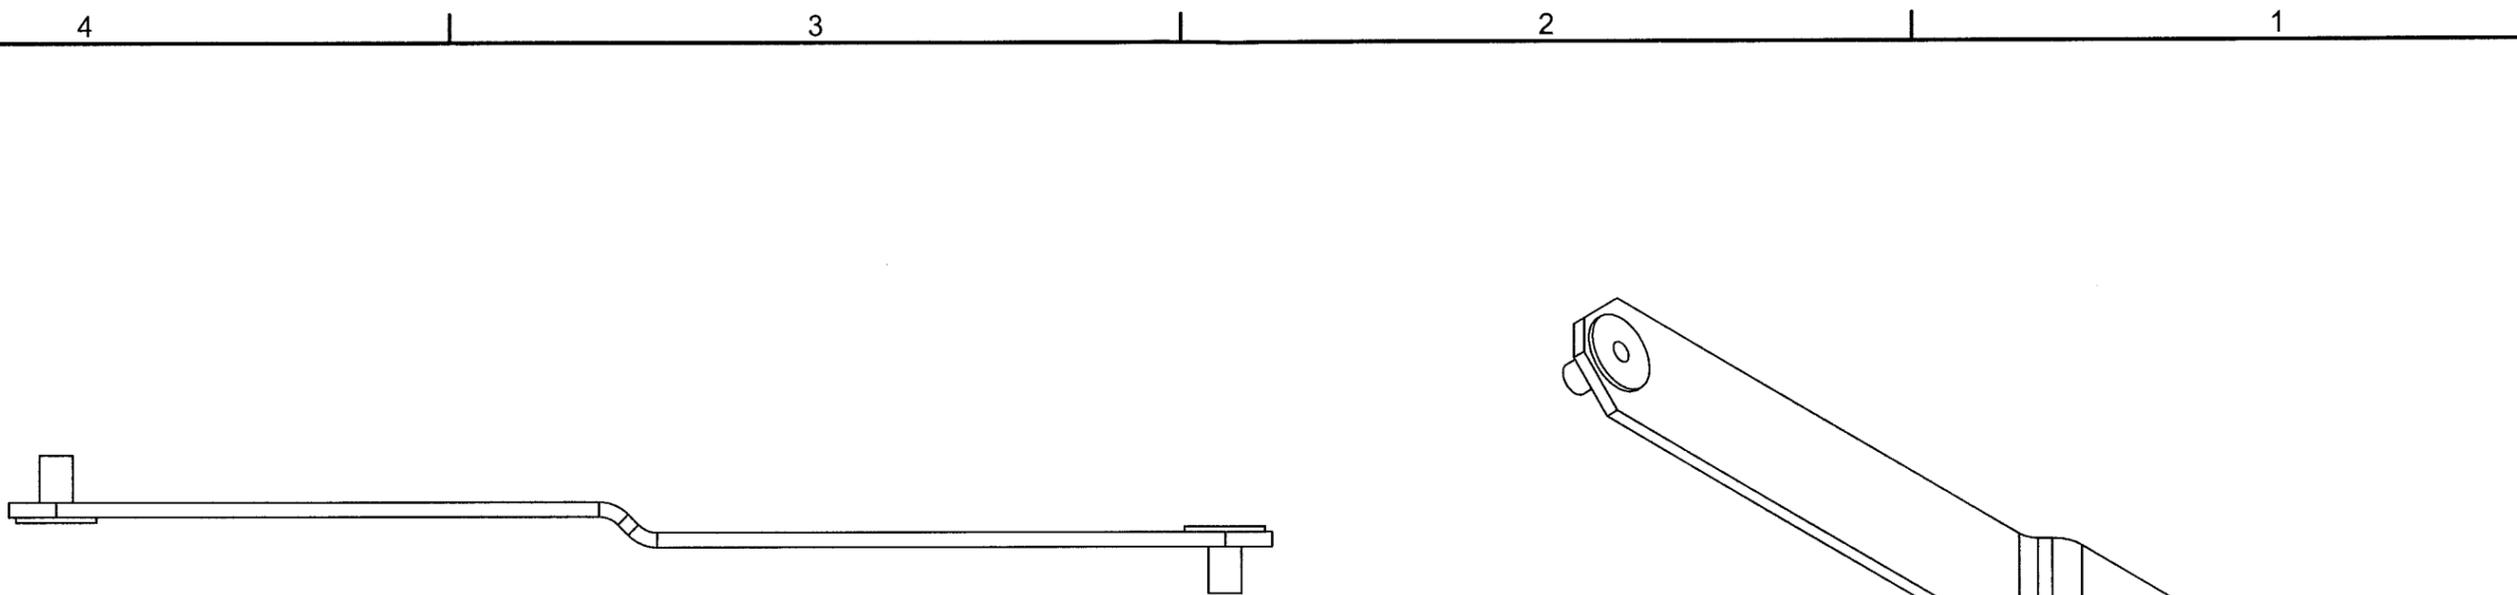


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0921.05
 Expiration Date 07/09/2013
 By *[Signature]*
 Miami Dade Product Control
 Division

270	22 1/4
180\245	18 3/4
150\165	15 1/4
120\135	12 7/8
60\100	11 3/4
UNIT	A
SIZE	DIM

[Signature]
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841


MATL	10 GA. SS303-ST. STEEL		 LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	JMD	7/16/2008	
DESIGNER	BFS	SHEET 9 OF 11	
DO NOT SCALE DRAWING			SRSH POWER VENTILATOR HURRICANE RATED
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"		FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"	
ANGULAR ± 2°		(NC) = NO INSPECTION REQ'D	
SIZE	DRAWING NO.	REV.	
B	SD080717-09	B	

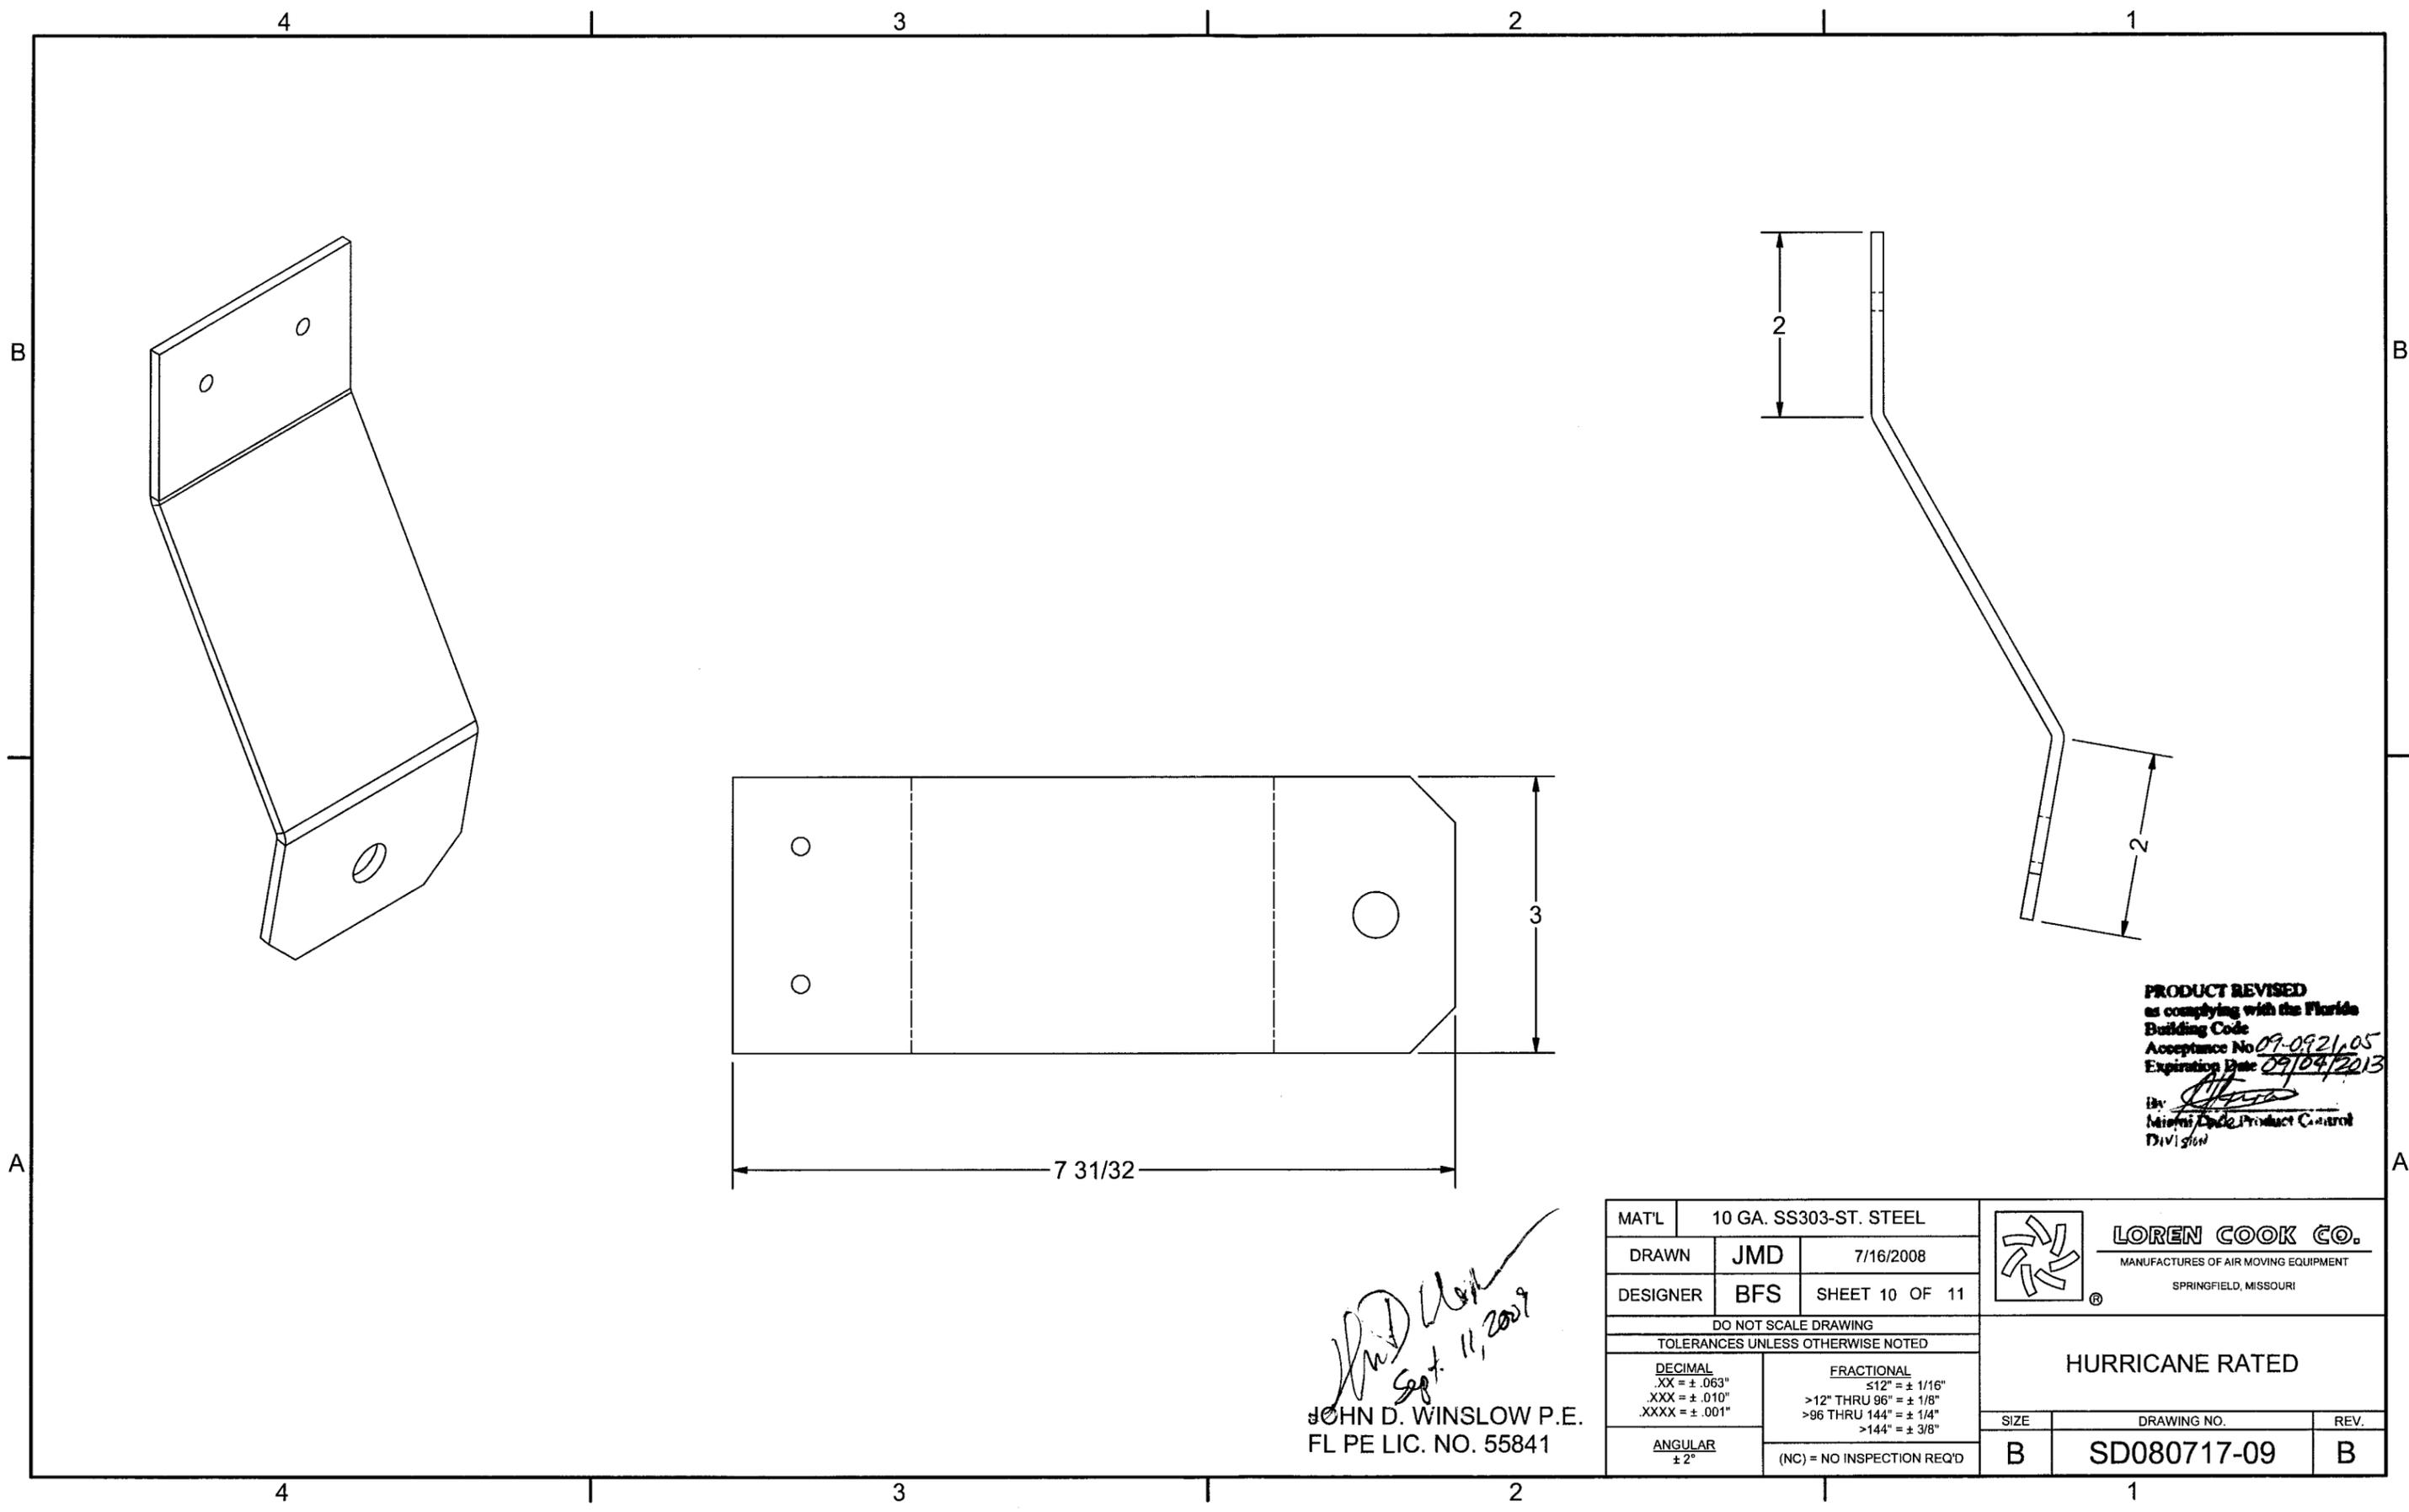

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 09-0921-05
 Expiration Date 09/04/2013
 By: *[Signature]*
 Loren Cook Product Control
 Division

[Signature]
 Sept. 11, 2009
JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841

MAT'L	10 GA. SS303-ST. STEEL		 LOREN COOK CO. <small>MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI</small>
DRAWN	JMD	7/16/2008	
DESIGNER	BFS	SHEET 10 OF 11	
DO NOT SCALE DRAWING			HURRICANE RATED
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"		FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"	
ANGULAR ± 2°		(NC) = NO INSPECTION REQ'D	
SIZE	DRAWING NO.	REV.	
B	SD080717-09	B	

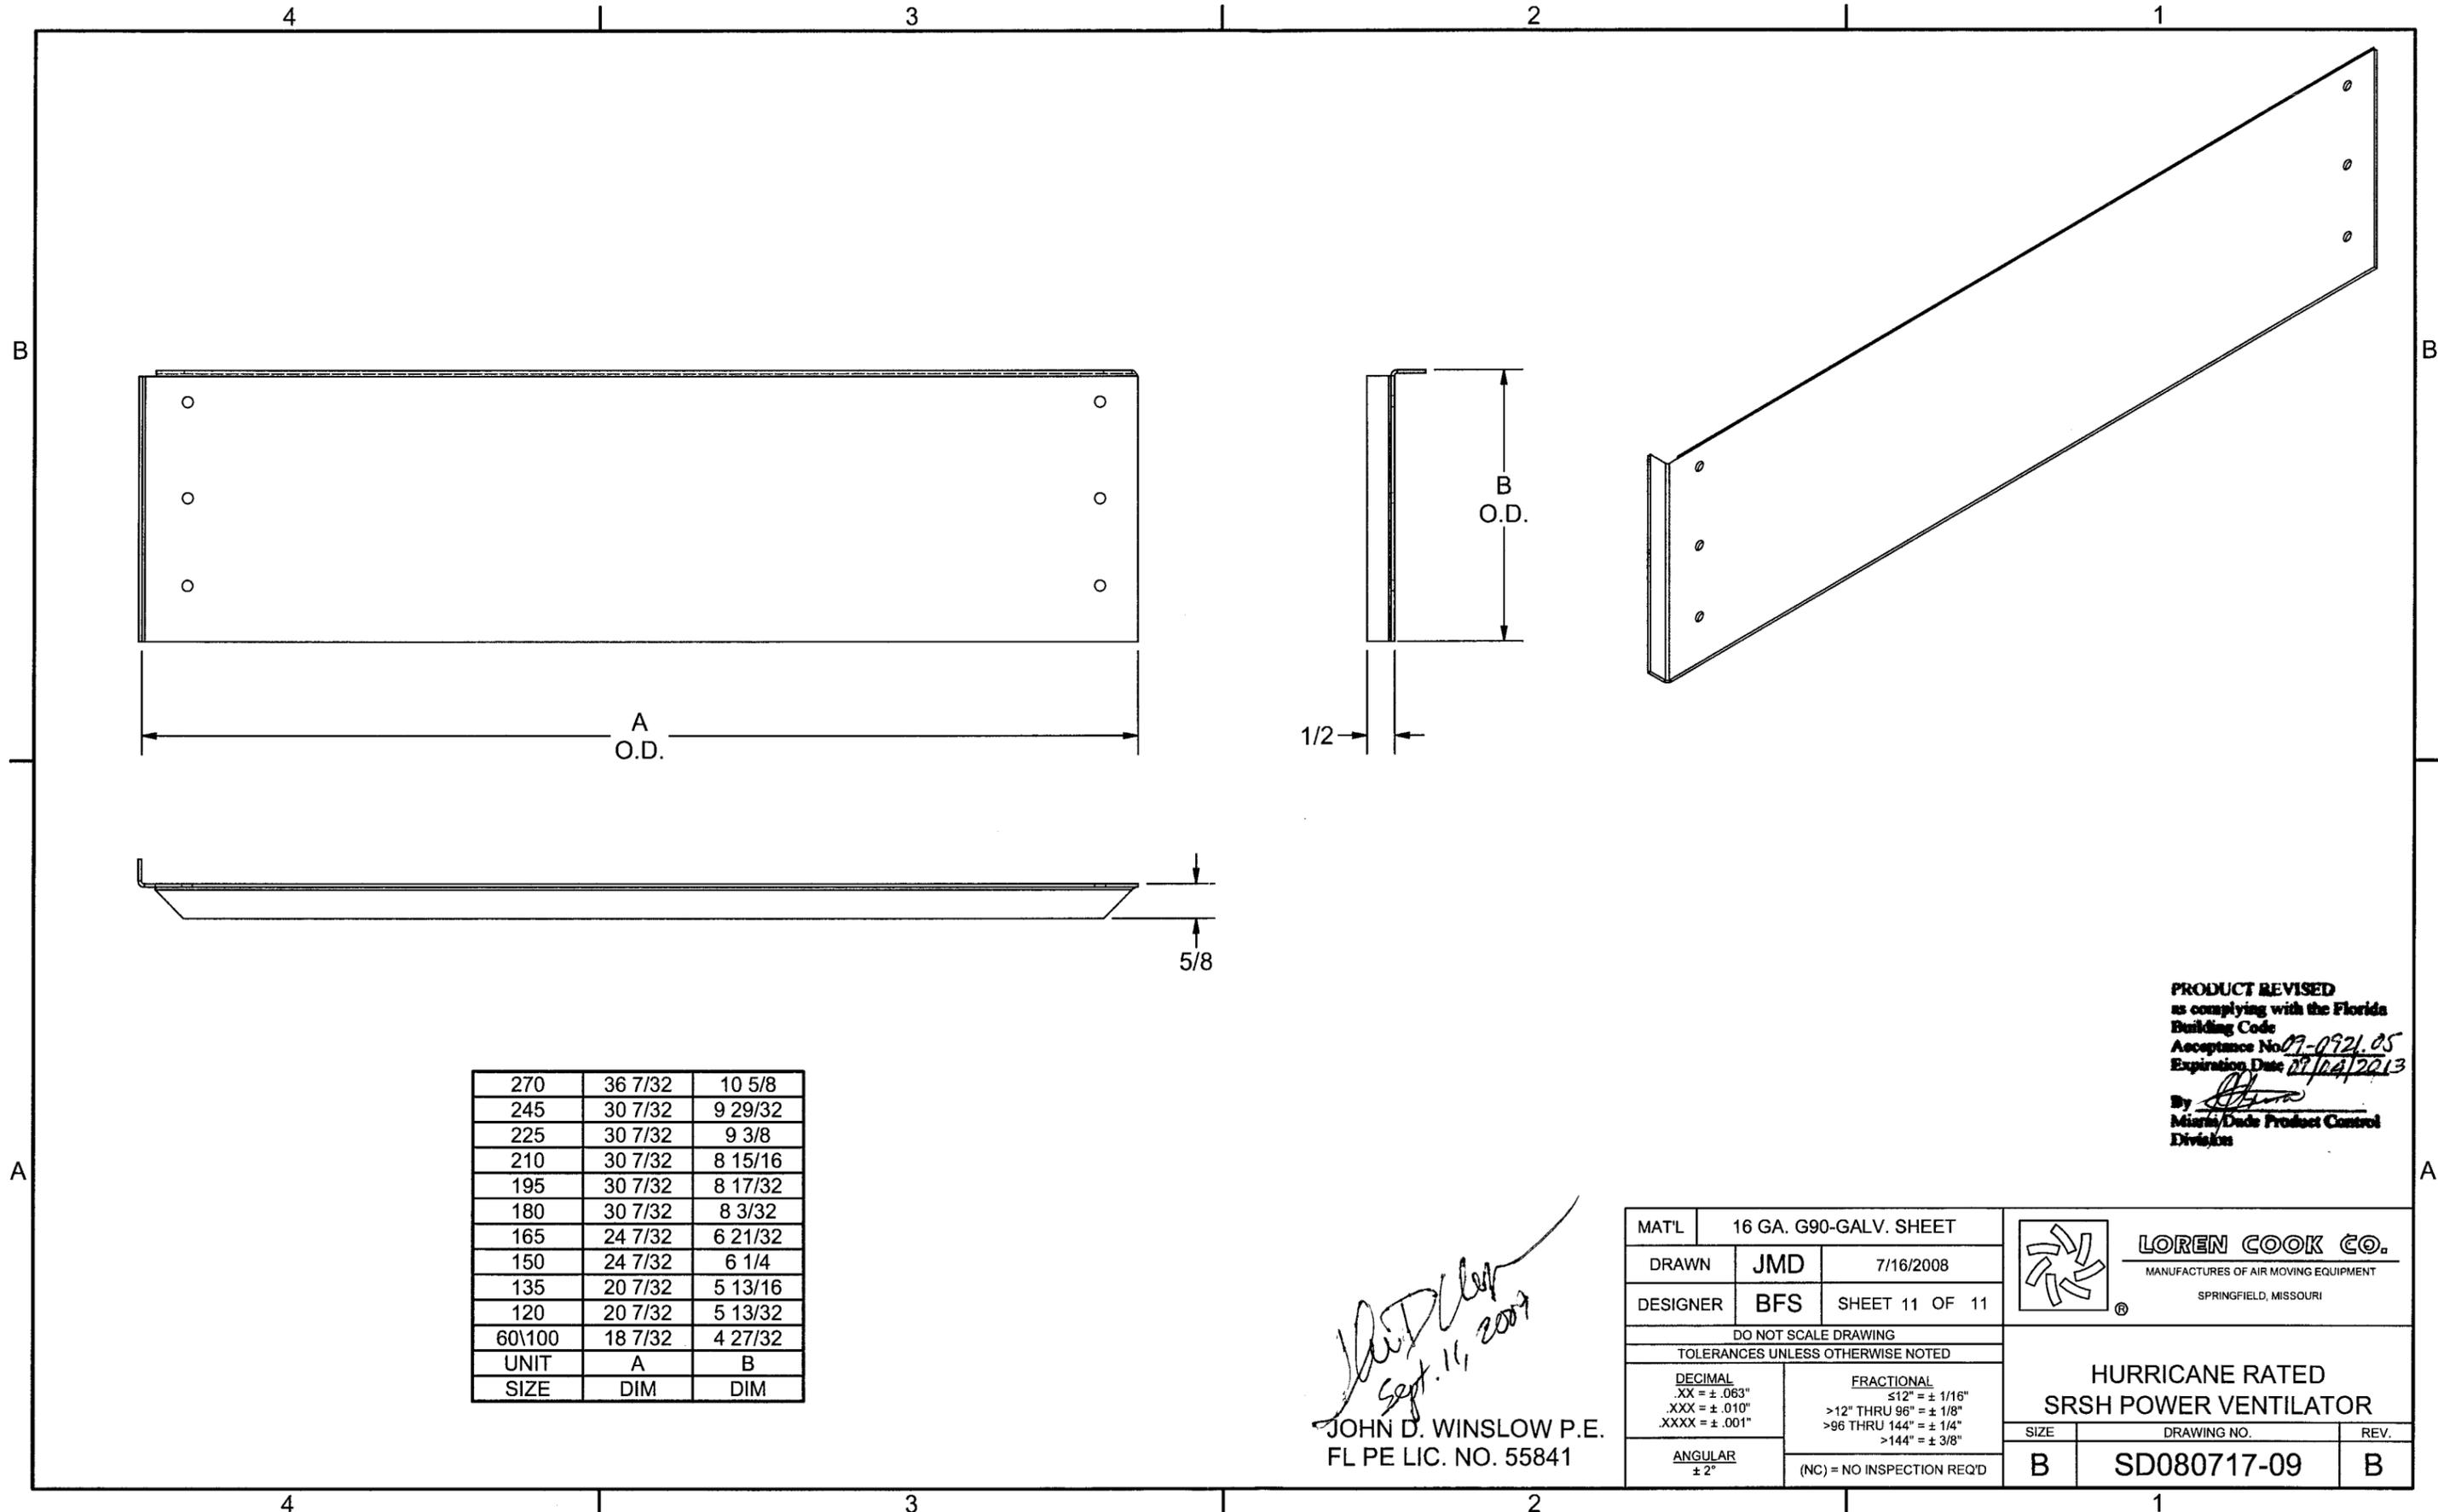

270	36 7/32	10 5/8
245	30 7/32	9 29/32
225	30 7/32	9 3/8
210	30 7/32	8 15/16
195	30 7/32	8 17/32
180	30 7/32	8 3/32
165	24 7/32	6 21/32
150	24 7/32	6 1/4
135	20 7/32	5 13/16
120	20 7/32	5 13/32
60\100	18 7/32	4 27/32
UNIT	A	B
SIZE	DIM	DIM

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. *07-0921.05*
 Expiration Date *07/24/2013*
 By *[Signature]*
 Miami/Dade Product Control
 Division

[Signature]
 JOHN D. WINSLOW P.E.
 FL PE LIC. NO. 55841

MAT'L	16 GA. G90-GALV. SHEET	
DRAWN	JMD	7/16/2008
DESIGNER	BFS	SHEET 11 OF 11
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL .XX = ± .063" .XXX = ± .010" .XXXX = ± .001"	FRACTIONAL ≤12" = ± 1/16" >12" THRU 96" = ± 1/8" >96 THRU 144" = ± 1/4" >144" = ± 3/8"	
ANGULAR ± 2°	(NC) = NO INSPECTION REQ'D	
 LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI		
HURRICANE RATED SRSH POWER VENTILATOR		
SIZE	DRAWING NO.	REV.
B	SD080717-09	B