



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1107  
MIAMI, FLORIDA 33130-1563  
(305) 375-2902 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

**Continental Glass Systems, Inc.**  
325 West 74 Place  
Hialeah, FL 33014

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "2200" Aluminum Sliding Glass Door – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. CGS007, titled "Series 2200 SDG – L.M.I.", sheets 1 through 9 of 9, dated 09/02/09, prepared by CertWorks, LLC, dated 01/29/10, signed and sealed by Kristina S. Daugherty, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



*J Gascon*  
*2/3/10*

NOA No. 09-0924.17  
Expiration Date: February 24, 2015  
Approval Date: February 24, 2010  
Page 1

Continental Glass Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **CGS007**, titled "Series 2200 SDG – L.M.I.", sheets 1 through 9 of 9, dated 09/02/09, prepared by CertWorks, LLC, dated 01/29/10, signed and sealed by Kristina S. Daugherty, P. E.

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202–94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202–94
  - 3) Water Resistance Test, per FBC, TAS 202–94
  - 4) Large Missile Impact Test per FBC, TAS 201–94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203–94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202–94along with marked-up drawings and installation diagram of sdg, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL–5857**, dated 09/02/09, signed and sealed by Julio E. Gonzalez, P. E.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC–2007, prepared by CertWorks, LLC, dated 09/23/09 and 01/29/10, both signed and sealed by Kristina S. Daugherty, P. E.  
**Complies with ASTM E1300–98/ 04**

**D. QUALITY ASSURANCE**

1. Miami–Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated 05/04/06, expiring on 05/21/11.

**F. STATEMENTS**

Statement letter of conformance and no financial interest, dated September 23, 2009, signed and sealed by Kristina S. Daugherty, P.E.

2. Laboratory compliance letter for Test Report No. **FTL–5857**, issued by Fenestration Testing Laboratory, Inc., dated September 02, 2009, signed and sealed by Julio E. Gonzalez, P. E.

**G. OTHERS**

1. None.



Jaime D. Gascon, P. E.  
Chief, Product Control Division  
NOA No. 09–0924.17

Expiration Date: February 24, 2015  
Approval Date: February 24, 2010

# CONTINENTAL GLASS SYSTEMS

## SERIES 2200 SLIDING GLASS DOOR (LARGE MISSILE IMPACT RATED)

### INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, USE 5/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 3/4 INCH MINIMUM EMBEDMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
  - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
  - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).

### GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2007 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - TAS 201-94
  - TAS 202-94
  - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM IS **NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: ALUMINUM 6005-T5
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAIL.

### TABLE OF CONTENTS

SHEET	REVISION	SHEET DESCRIPTION
1	-	INSTALLATION & GENERAL NOTES
2	-	ELEVATION & ANCHOR LAYOUT
3	-	ELEVATIONS & ANCHOR LAYOUTS
4	-	VERTICAL SECTIONS
5	-	HORIZONTAL SECTIONS
6	-	HORIZONTAL SECTIONS & GLAZING DETAIL
7	-	COMPONENTS & BILL OF MATERIALS
8	-	COMPONENTS
9	-	CORNER ASSEMBLY

### DESIGN PRESSURE RATING

	DESIGN PRESSURE - ALL SIZES	MISSILE IMPACT RATING
NON-REINFORCED	+70.0 / -70.0 PSF	LARGE MISSILE IMPACT RATED
REINFORCED	+90.0 / -90.0 PSF	LARGE MISSILE IMPACT RATED



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 SGD - LMI  
INSTALLATION &  
GENERAL NOTES

PREPARED BY:  
CERTWORKS, LLC  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

### REVISIONS

NO.	DESCRIPTION	BY	DATE

*[Handwritten Signature]*  
1-29-10  
KRISTINA S. CALICHERY  
FLORIDA P.E. NO. 68465  
127 W. FAIRBANKS AVE. STE. 438  
WINTER PARK, FL 32789  
FBPE CERT. OF AUTHORIZATION NO. 266520



Approved as complying with the  
Florida Building Code  
Date 02/24/2010  
NOA# 09-0924.17  
Miami Dade Product Council  
Division  
By *[Signature]*

DATE: 09.02.09  
DWN BY: GRN  
CHK BY: KSD  
SCALE: NTS  
DWG #: **CGS007**  
SHEET: 1 OF 9








1/29/2010 3:01 PM

p:\projects\continental glass systems\md-p-09-0512 series 2200 sgd - large mistle - 2010-01-29.dwg


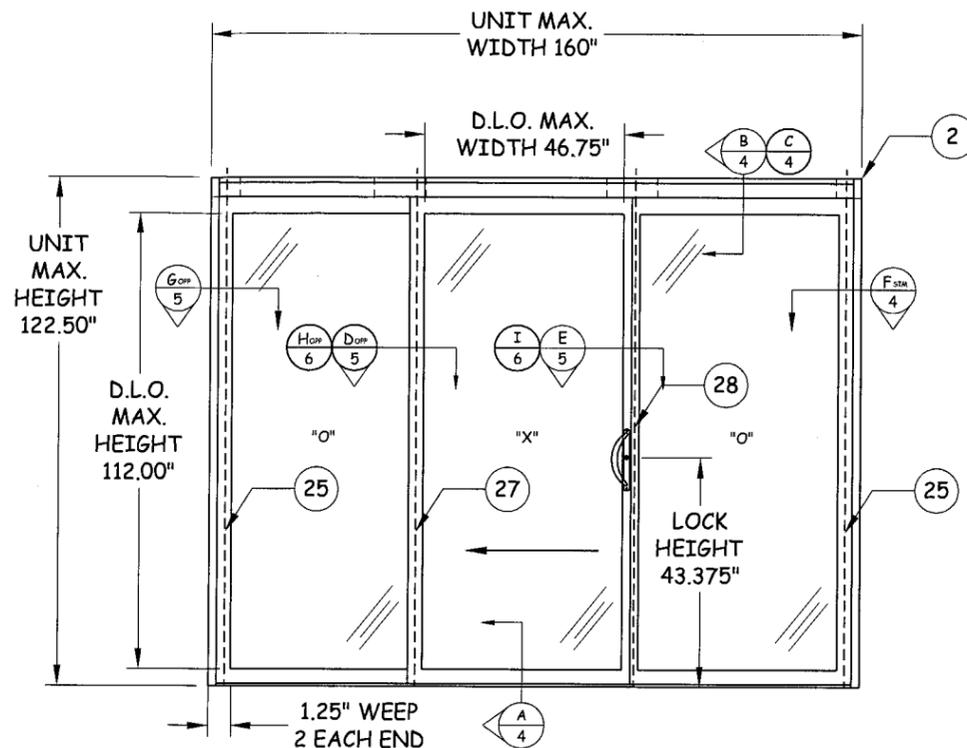
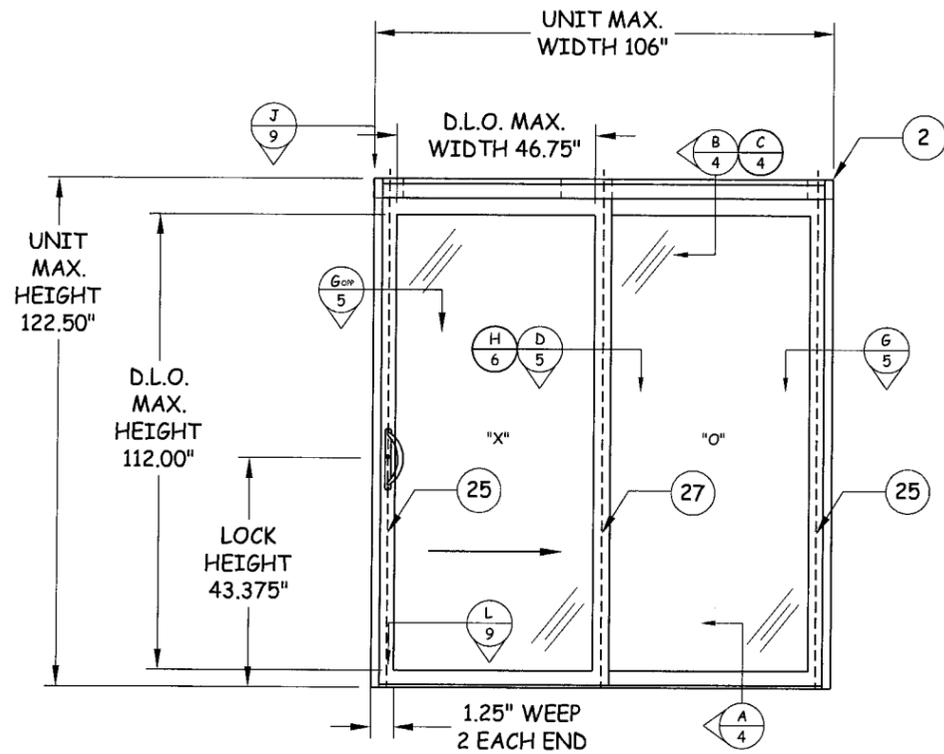


### ELEVATIONS

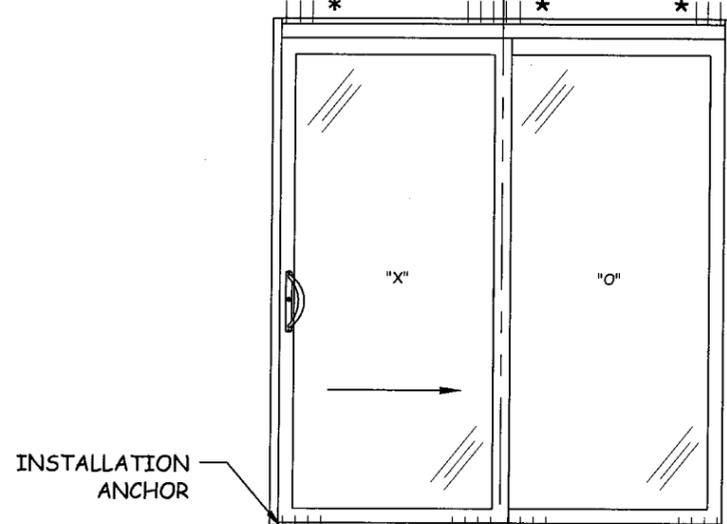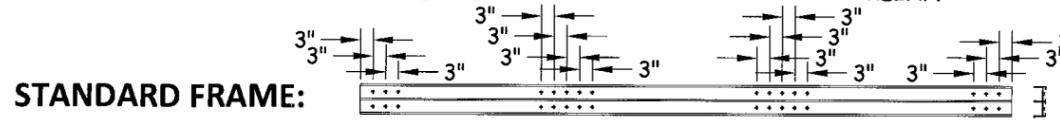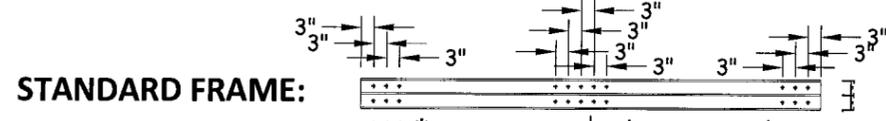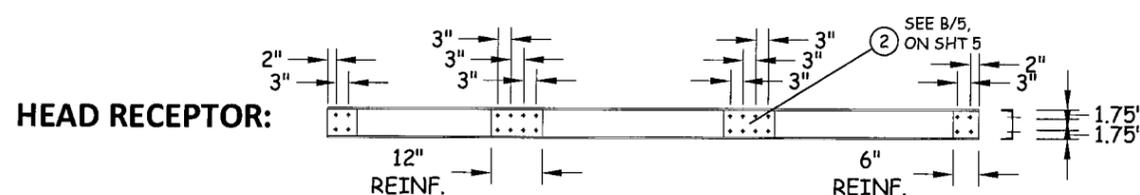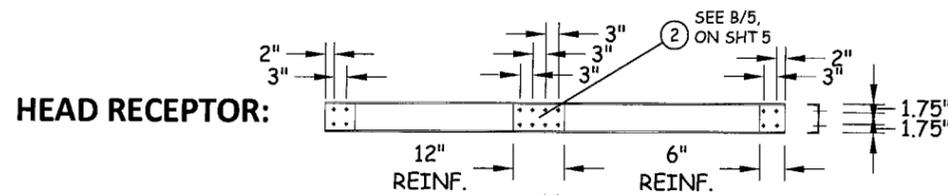

NOTE:  
TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.

### ANCHOR LAYOUTS

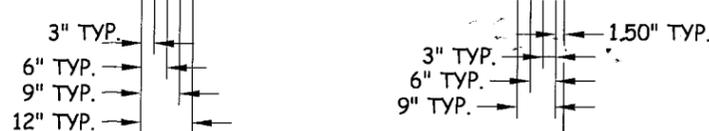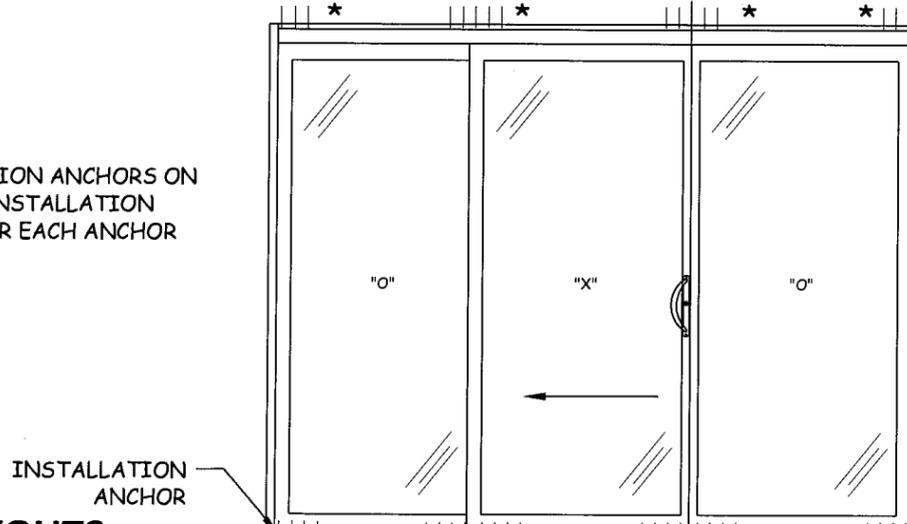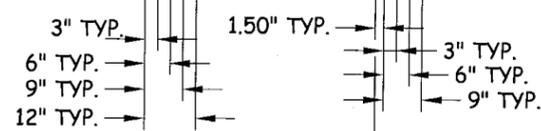

Approved as complying with the Florida Building Code  
Date 02/24/2010  
NOA# 09-0924-17  
Miami Dade Product Control Division  
By *[Signature]*

\* NOTE:  
ADDITIONAL STANDARD FRAME INSTALLATION



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 SGD - LMI ELEVATIONS & ANCHOR LAYOUTS  
PREPARED BY: CERTWORKS, LLC  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366


NO.	DESCRIPTION	BY	DATE

*[Signature]*  
1-29-10  
KRISTINA S. DALPHERY  
FLORIDA P. E. NO. 68495  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FBI CERT. OF AUTHORIZATION NO. 289520


DATE: 09.02.09	DWN BY: GRN	CHK BY: KSD	SCALE: NTS
DWG #: CGS007			
SHEET: 3 OF 9			

1/29/2010 2:26 PM

p:\projects\continental glass systems\ind-p-09-0512 series 2200 sgcd\dwgs\cgs007 - series 2200 sgcd - large.misfile - 2010-01-29.dwg

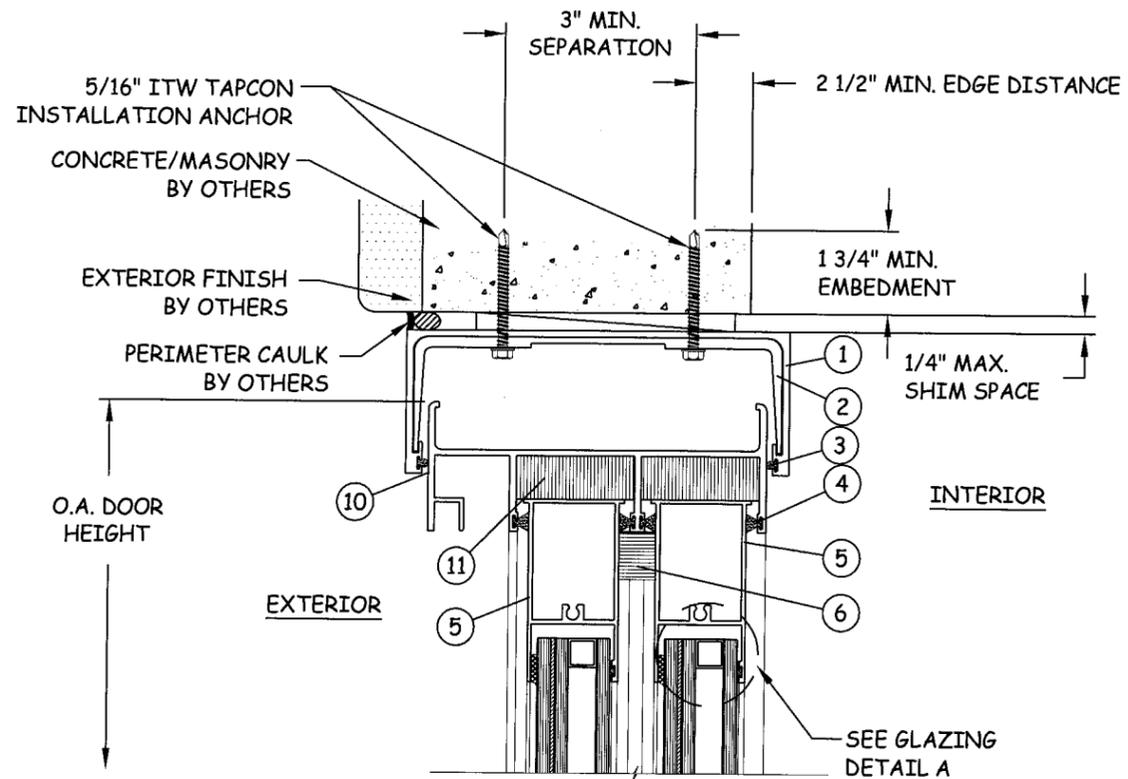


**B**  
**4** VERTICAL SECTION  
REINFORCED HEAD RECEPTOR  
CONCRETE/MASONRY

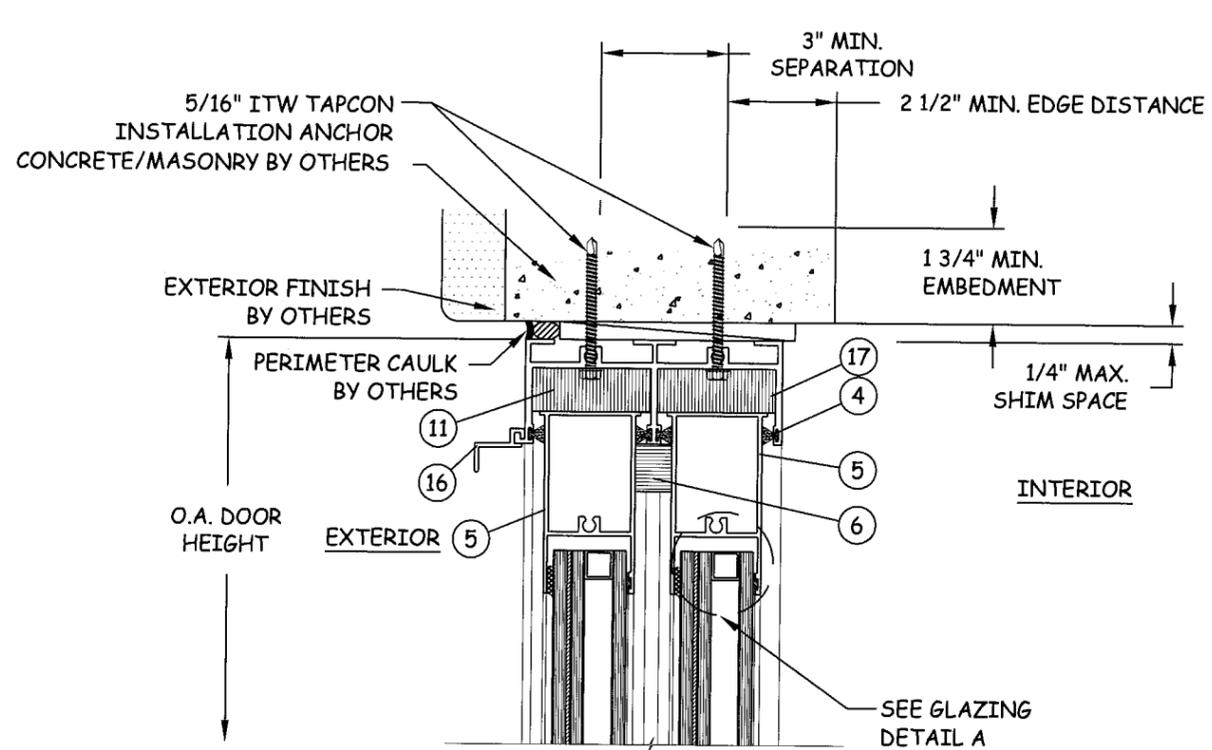

**C**  
**4** VERTICAL SECTION  
STANDARD HEAD - CONCRETE/MASONRY

NOTE:  
ITEM 11 TO BE USED CONTINUOUS IN  
ENTIRE LENGTH OF FRAME

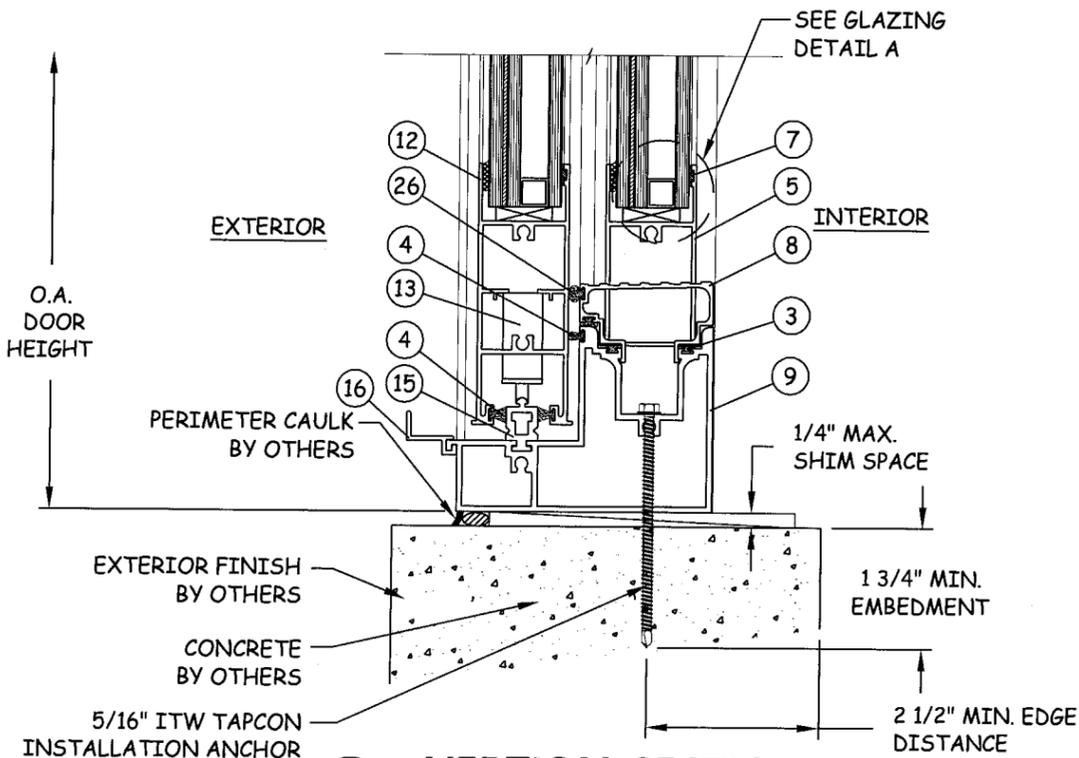

**A**  
**4** VERTICAL SECTION  
SILL - CONCRETE/MASONRY  
PRE-CAST SILL

Approved as complying with the  
Florida Building Code  
Date: 02/24/2010  
NOAH: 09-0924.17  
Miami-Dade Product Control  
Division  
By: *[Signature]*



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 SGD - LMI  
VERTICAL SECTIONS  
PREPARED BY: CERTWORKS, LLC  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	BY	DATE

*[Signature]*  
1-29-10  
KRISTINA S. DAUGHERTY  
FLORIDA P.E. NO. 096451  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FBPE CERT. OF AUTHORIZATION NO. 09620

DATE: 09.02.09  
DWN BY: GRN  
CHK BY: KSD  
SCALE: NTS  
DWG #: CGS007  
SHEET: 4 OF 9

1/29/2010 2:27 PM

p:\projects\continental\_glass\_systems\m-d-p-09-0512 series 2200 sgd\dwgs\cgs007 - series 2200 sgd - large.misak - 2010-01-29.dwg




325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 SGD - LMI  
HORIZONTAL SECTIONS  
PREPARED BY: CERTWORKS, LLC  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366


NO.	DESCRIPTION	BY	DATE

Approved as complying with the Florida Building Code  
Date: 02/24/2019  
NOA#: 09-027-19  
Miami Dade Product Control Division  
By: *[Signature]*  
KRYSTINA S. DAUGHERTY  
FLORIDA P. E. INC. 68455  
127 W. FAIRBANKS AVE. STE. 438  
WINTER PARK, FL 32789  
PERMIT OF AUTHORIZATION NO. 88520

DATE: 09.02.09	DWN BY: GRN	CHK BY: KSD	SCALE: NTS
DWG #: CGS007			
SHEET: 5 OF 9			

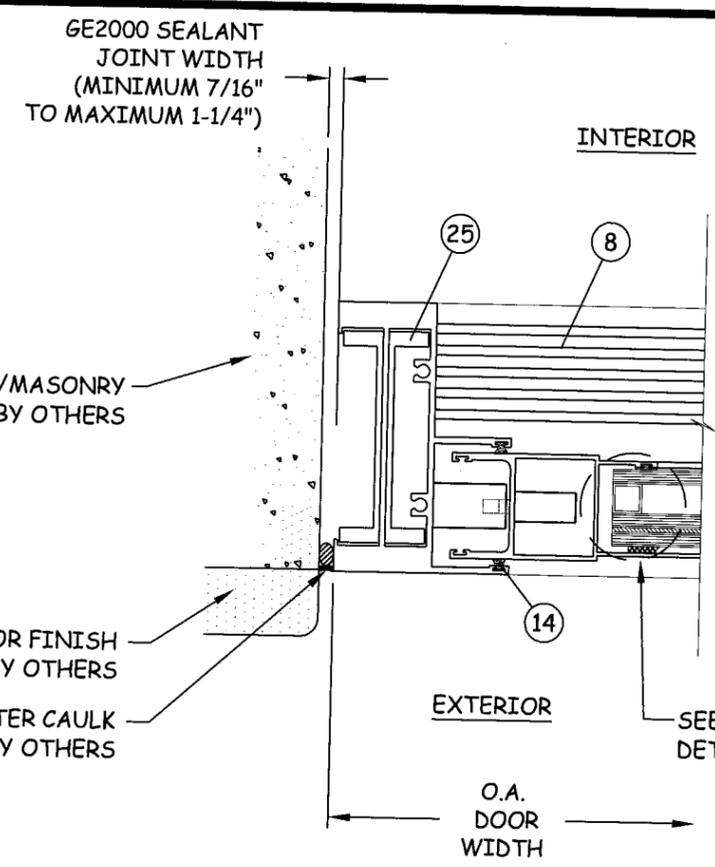


**F**  
**5** HORIZONTAL SECTION  
REINFORCED JAMB - CONCRETE/MASONRY

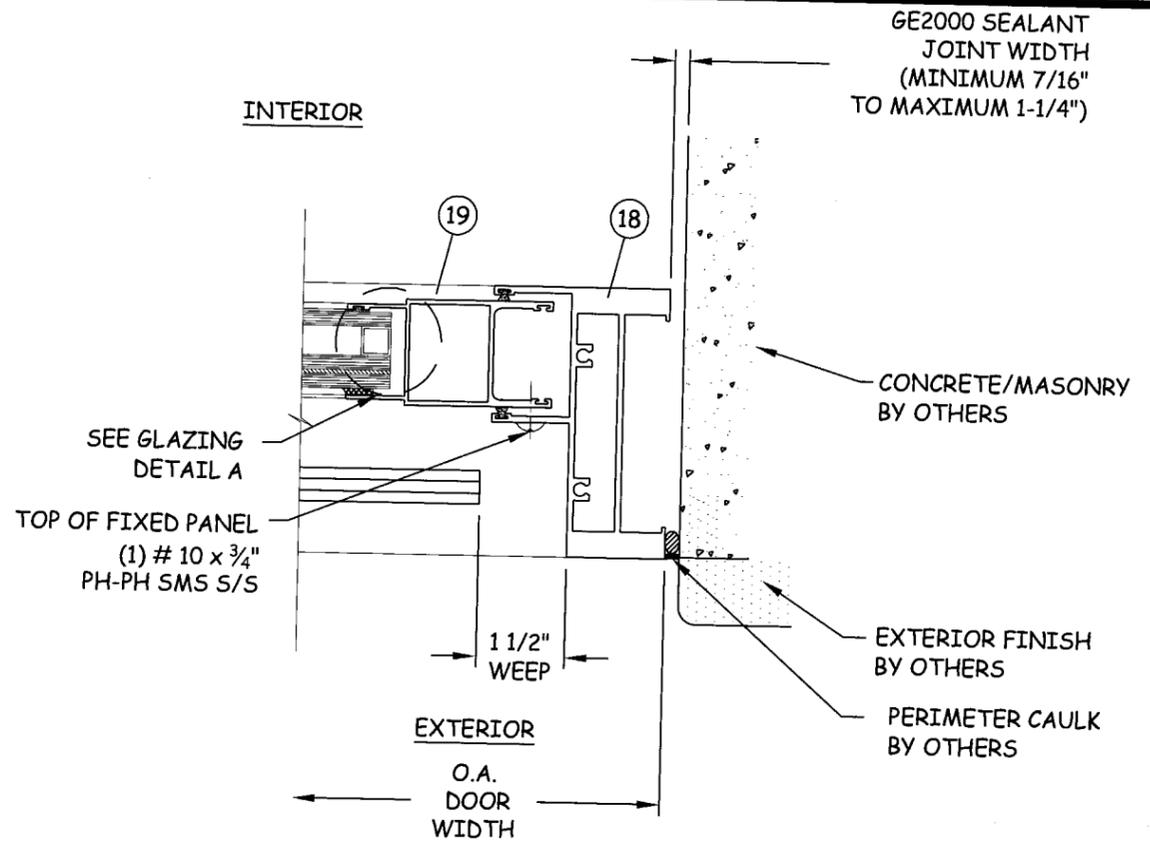


**G**  
**5** HORIZONTAL SECTION  
JAMB - CONCRETE/MASONRY


NOTES:  
1. BACKER ROD DIAMETER EQUALS SEAL WIDTH X 120%  
2. SEALANT DEPTH IS 5/8" (-0", +1/16") FOR SEALANT WIDTH UP TO 1-1/4"

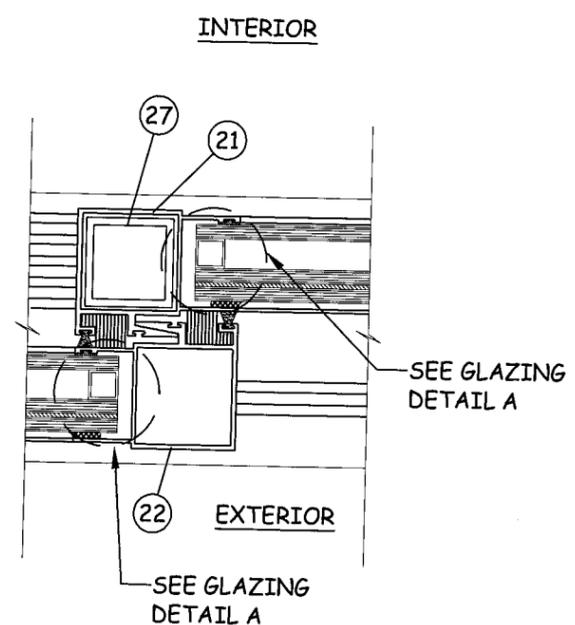


**D**  
**5** HORIZONTAL SECTION  
INTERLOCK

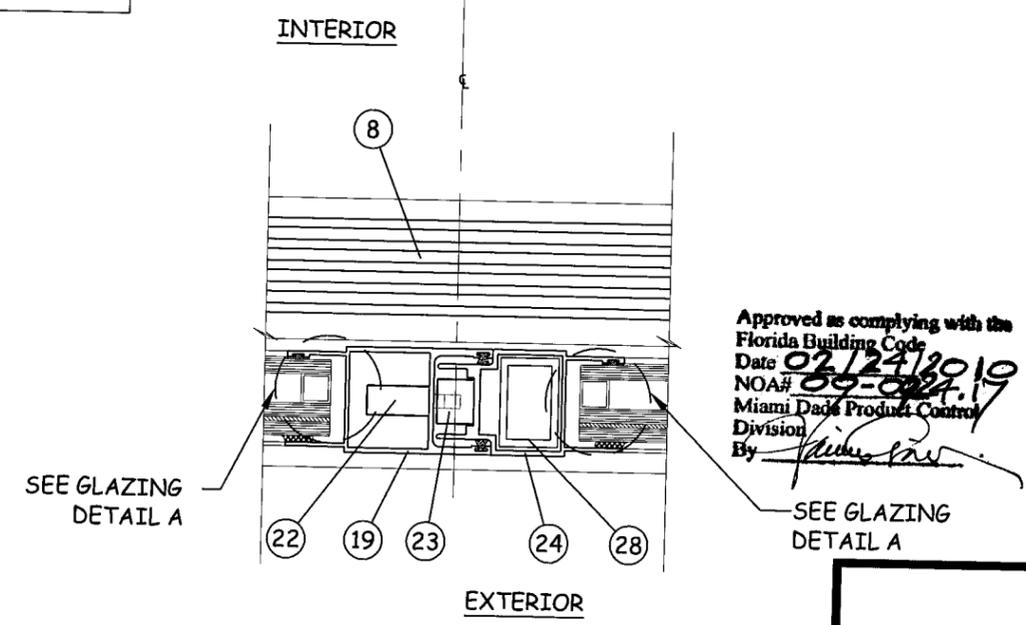


**E**  
**5** HORIZONTAL SECTION  
BUTTSTILE

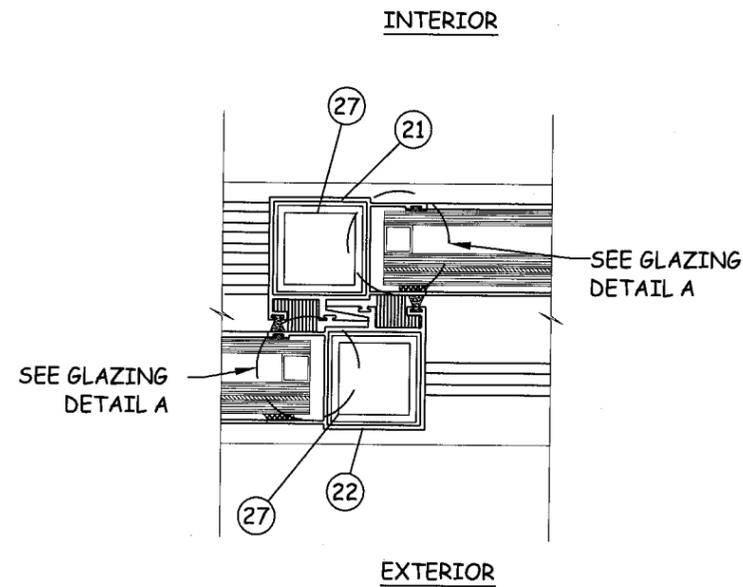

**H**  
**6** **HORIZONTAL SECTION**  
REINFORCED INTERLOCK

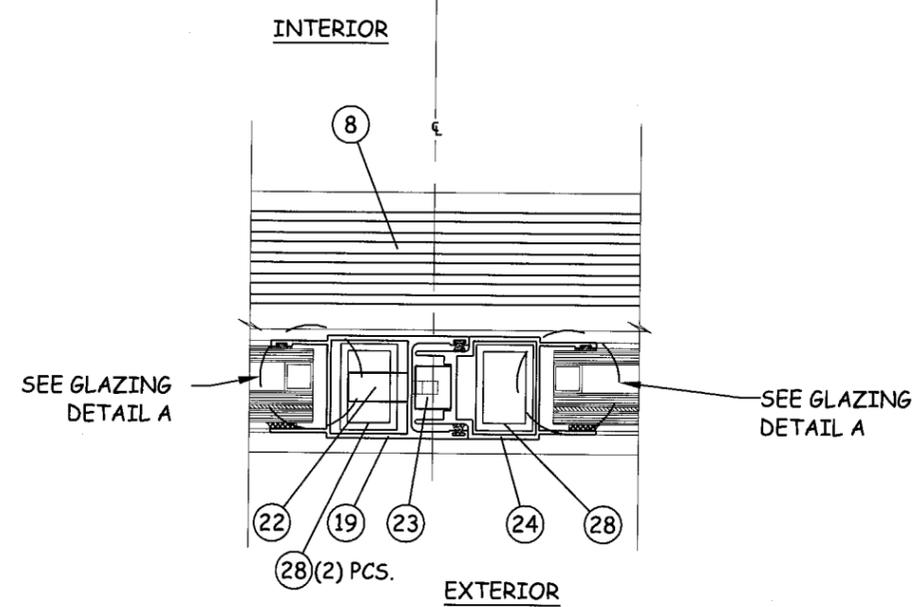

**I**  
**6** **HORIZONTAL SECTION**  
REINFORCED BUTTSTILE

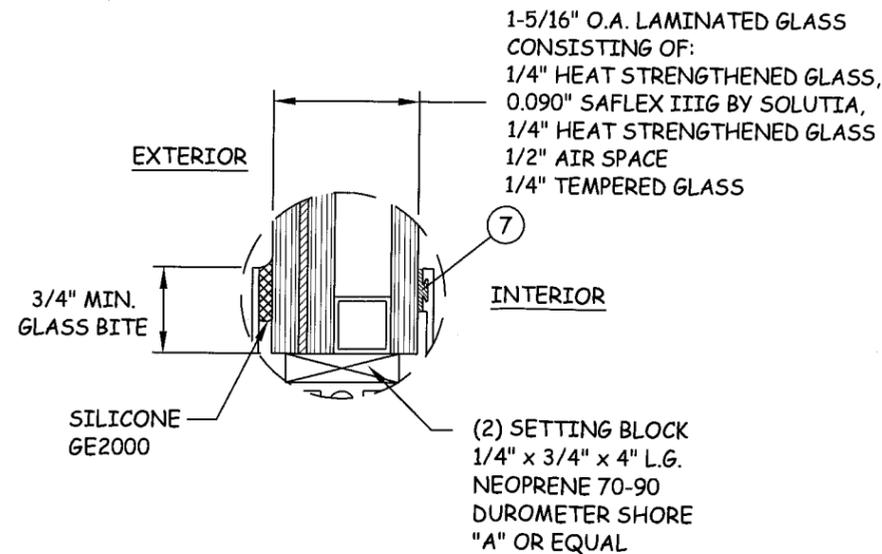

**GLAZING DETAIL A**

Approved as complying with the  
Florida Building Code  
Date 02/24/2010  
NOA# 09-0727-17  
Miami Dade Product Control  
Division  
By [Signature]

TITLE:  
SERIES 2200 SGD - LMI  
HORIZONTAL SECTIONS  
& GLAZING DETAIL

PREPARED BY:  
CERTWORKS, LLC  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	REVISIONS	
		BY	DATE

[Signature] 02-29-10  
KIRSTINA S. DAUGHERTY  
FLORIDA P. E. NO. 68455  
127 W. FAIRBANKS AVE. STE. 438  
WINTER PARK, FL 32789  
FBPE CERT. OF AUTHORIZATION NO. 2885C

DATE:	09.02.09
DWN BY:	GRN
CHK BY:	KSD
SCALE:	NTS
DWG #:	<b>CGS007</b>
SHEET:	6 OF 9


1/29/2010 2:27 PM

p:\projects\continental\_glass\_systems\mid-p-09-0512-series 2200 sgd\dwg\sgs007 -series 2200 sgd - large.mxd - 2010-01-29.dwg


**BILL OF MATERIALS**

ITEM NO.	DESCRIPTION	PARTS NUMBERS	MATERIAL	MANUFACTURER
1	HEAD RECEPTOR	2000-07	ALUMINUM 6005-T5	CGS
2	REINFORCING	2000-16	ALUMINUM 6005-T5	CGS
3	VINYL BULB	FP-448-V	PLASTIC	
4	FIN-SEAL .370 X .187		ULTRAFAB	ULTRAFAB
5	TOP & BOTTOM PANEL STILE	2200-09	ALUMINUM 6005-T5	CGS
6	INTERLOCK PAD	P 7509 AFK	ULTRAFAB	ULTRAFAB
7	GLASS SPACING		PLASTIC	
8	THRESHOLD	2000-24	ALUMINUM 6063-T6	CGS
9	SILL	2000-03	ALUMINUM 6005-T5	CGS
10	HEAD	2000-01	ALUMINUM 6005-T5	CGS
11	HEAD PAD	P 10009 AFK	ULTRAFAB	ULTRAFAB
12	BOTTOM MOVING PANEL STILE	2200-38	ALUMINUM 6005-T5	CGS
13	WHEEL	AR-50A		
14	FIN-SEAL .250 X .187		ULTRAFAB	ULTRAFAB
15	SILL TRACK	2000-05	ALUMINUM 6005-T5	CGS
16	SCREEN TRACK	2000-15	ALUMINUM 6005-T5	CGS
17	STANDARD HEAD	2000-02	ALUMINUM 6005-T5	CGS
18	JAMB	2000-36	ALUMINUM 6063-T6	CGS
19	LOCK STILE	2200-10	ALUMINUM 6005-T5	CGS
20	INTERLOCK	2200-11	ALUMINUM 6005-T5	CGS
21	LEFT INTERLOCK	2200-17	ALUMINUM 6005-T5	CGS
22	LOCK	D-60 C		
23	KEEPER	KP-50		
24	ASTRAGAL	2200-18	ALUMINUM 6005-T5	CGS
25	ALUMINUM CHANNEL REINFORCEMENT	2200-37	ALUMINUM 6005-T5	CGS
26	Q-LON	U4332		
27	1/8" X 1 1/2" X 1 1/2" ALUMINUM TUBE	2200-38	ALUMINUM 6005-T5	CGS
28	1/8" X 1" X 1 1/2" ALUMINUM TUBE	2200-39	ALUMINUM 6005-T5	CGS


1 HEAD RECEPTOR  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .118"

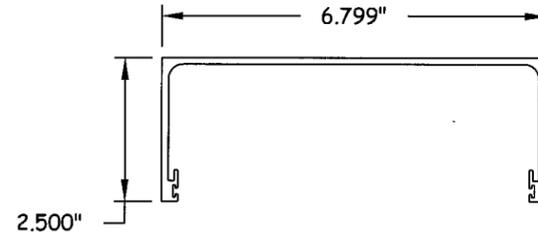


2 REINFORCING  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .188"

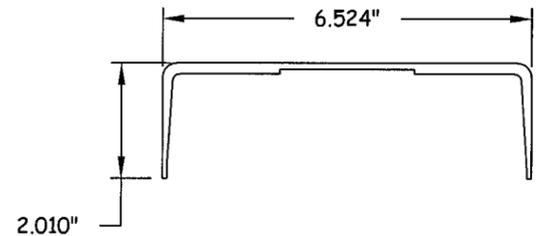

5 TOP & BOTTOM PANEL STILE  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"



8 THRESHOLD  
ALUMINUM 6063-T6  
TYPICAL WALL THICKNESS: .075"



Approved as complying with the  
Florida Building Code  
Date 02/24/2010  
NOA# 09-0924-17  
Miami-Dade Product Control  
Division  
By [Signature]



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 SGD - LMI  
COMPONENTS &  
BILL OF MATERIALS  
PREPARED BY: CERTWORKS, LLC  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	REVISIONS	
		BY	DATE

[Signature]  
1-29-10  
KRISTINA S. DALGHERTY  
FLORIDA P. E. NO. 65475  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FBI CERT. OF AUTHORIZATION NO. 28560

DATE: 09.02.09  
DWN BY: GRN  
CHK BY: KSD  
SCALE: NTS


DWG #: CGS007

SHEET: 7 OF 9


1/29/2010 2:27 PM

P:\projects\continental\_glass\_systems\ind-p-09-0512\_ser\ser\series 2200\_sgd\dwgs\cgs007 - series 2200\_sgd - large.misite - 2010-01-29.dwg


9 SILL ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

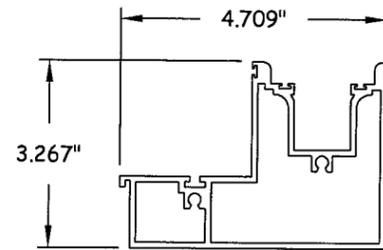


10 HEAD ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

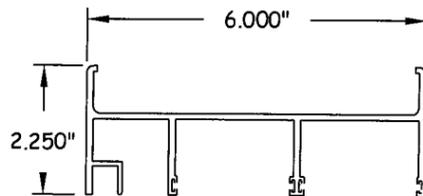


12 BOTTOM MOVING PANEL STILE ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"

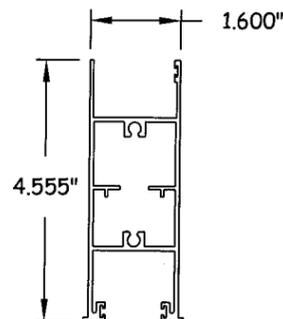


15 SILL TRACK ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"




16 SCREEN TRACK ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"

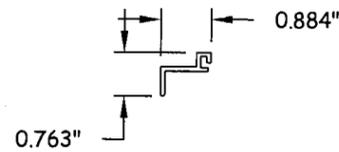


17 STANDARD HEAD ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

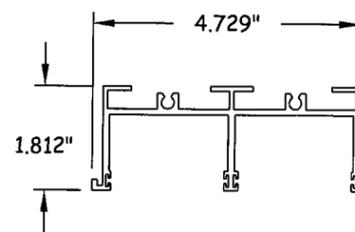


18 JAMB ALUMINUM 6063-T6  
TYPICAL WALL THICKNESS: .075"

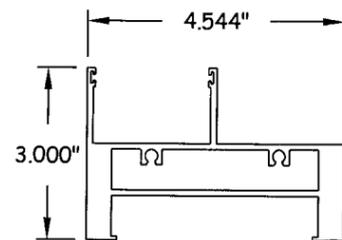


19 LOCK STILE ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"




20 INTERLOCK ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"




21 LEFT INTERLOCK ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"



24 ASTRAGAL ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"



25 ALUMINUM CHANNEL REINFORCEMENT ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .019"



Approved as complying with the Florida Building Code  
Date 02/24/2010  
NOA# 09-0924-17  
Miami Dade Product Control Division  
By [Signature]



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 SGD - LMI

COMPONENTS

PREPARED BY: CERTWORKS, LLC  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS

NO.	DESCRIPTION	BY	DATE

[Signature] 1-29-10  
KRISTINA S. DAUGHERTY  
FLORIDA P.E. NO. 69455  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FIBRE CERT. OF AUTHORIZATION NO. 28620

DATE: 09.02.09  
DWN BY: GRN  
CHK BY: KSD  
SCALE: NTS

DWG #: CGS007  
SHEET: 8 OF 9

