



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

MIAMI-DADE COUNTY, FLORIDA  
 METRO-DADE FLAGLER BUILDING  
 140 WEST FLAGLER STREET, SUITE 1603  
 MIAMI, FLORIDA 33130-1563  
 (305) 375-2901 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

**T.M. Window & Door LLC**  
**601 N.W. 12<sup>th</sup> Ave.**  
**Pompano Beach, FL 33609**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series 515 Outswing Aluminum Casement Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W06-30**, titled "Series 515 Aluminum Casement Window (L.M.I.)", sheets 1 through 6 of 6, dated 04/14/06 with revision C dated 08/27/09, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises **NOA # 08-0506.11** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 09-1015.02**  
**Expiration Date: May 01, 2013**  
**Approval Date: January 27, 2010**  
**Page 1**


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **W06-30**, Sheets 1 through 6 of 6, titled "Series 515 Aluminum Casement Window (L.M.I.)", dated 04/14/06 with revision C dated 08/27/09, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94  
along with marked-up drawings and installation diagram of a series 515 outswing aluminum casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5404**, dated 11/16/07, signed and sealed by Carlos S. Rionda, P.E.  
*(Submitted under NOA# 08-0506.11)*
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a series 515 outswing aluminum casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4891**, dated 04/13/06, signed and sealed by Edmundo Largaespada, P.E.  
*(Submitted under NOA# 06-0614.03)*
3. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a series 515 outswing aluminum casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4890**, dated 04/13/06, signed and sealed by Edmundo Largaespada, P.E.  
*(Submitted under NOA# 06-0614.03)*
4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with installation diagram of an aluminum casement window, prepared by American Test Lab of South Florida, Test Report No. **ATL 0806.01-02** dated 09/24/02, signed and sealed by William R. Mehner, P.E.  
*(Submitted under NOA# 01-1129.03)*

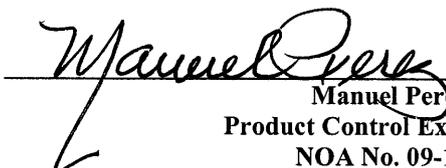  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 09-1015.02  
Expiration Date: May 01, 2013  
Approval Date: January 27, 2010

**T.M. Window & Door LLC**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 8/26/09, signed and sealed by Arshad Viqar, P.E.  
**Complies with ASTM E1300-98/04**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated 05/04/06, expiring on 05/21/11.
2. Notice of Acceptance No. **07-1116.11** issued to Saf-Glas, LLC for their "**SAF-GLAS Polycarbonate Laminate**", dated 12/27/07, expiring on 12/16/12.
3. Notice of Acceptance No. **09-0310.02** issued to Cytec Industries, Inc. for their "**Uvekol S Laminated Glass Interlayer**", dated 04/02/09, expiring on 02/08/10.


**F. STATEMENTS**

1. Statement letter of conformance and no financial interest, dated August 25, 2009, signed and sealed by Arshad Viqar, P.E.
2. Laboratory compliance letter for Test Report no. **FTL-4891**, issued by Fenestration Testing Laboratory, Inc., dated April 17, 2006, signed and sealed by Edmundo Largaespada, P.E.
3. Laboratory compliance letter for Test Report no. **FTL-5404**, issued by Fenestration Testing Laboratory, Inc., dated December 19, 2007, signed and sealed by Carlos S. Rionda, P.E.


**G. OTHERS**

1. Notice of Acceptance No. **08-0506.11**, issued to T.M. Window & Door LLC for their Series "515" Outswing Aluminum Casement Window – L.M.I., approved on 06/05/08 and expiring on 05/01/13.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 09-1015.02  
Expiration Date: May 01, 2013  
Approval Date: January 27, 2010

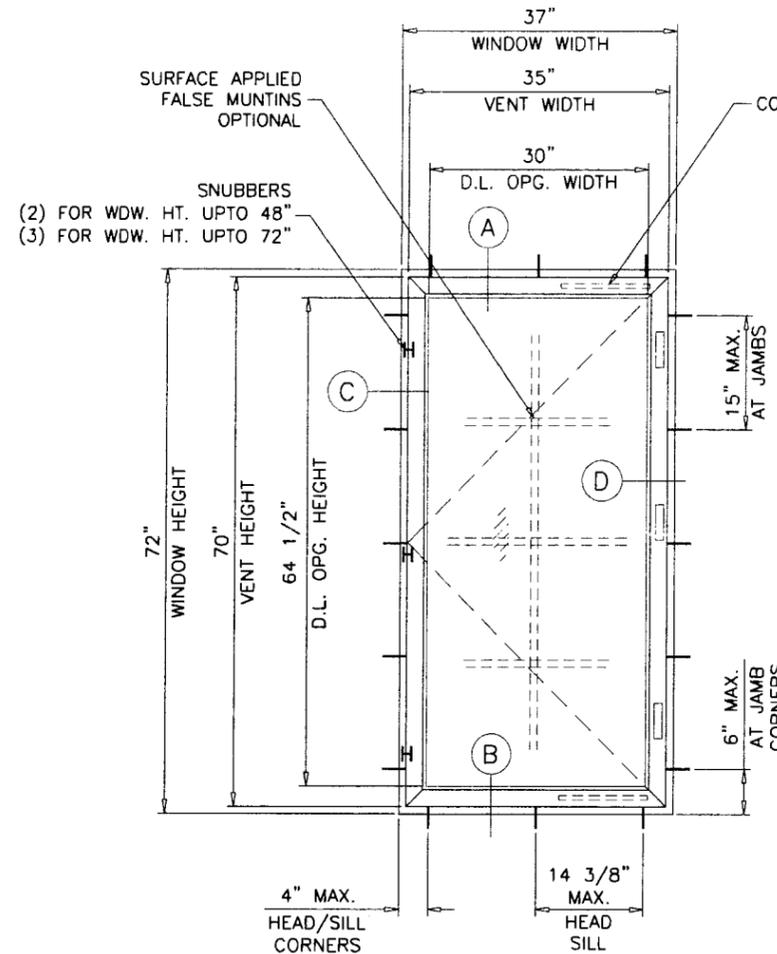

**SINGLE VENT WDW.**

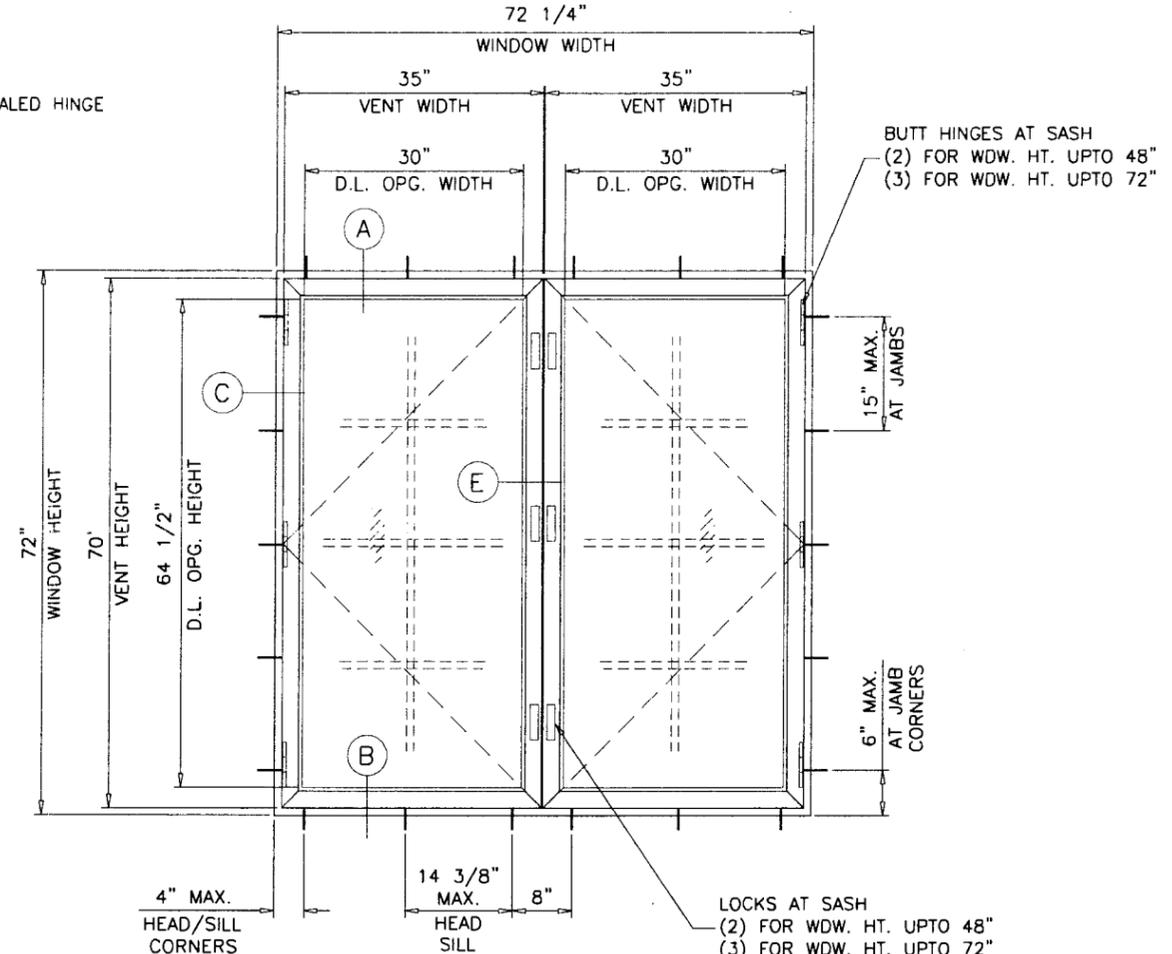

**DUAL VENT WDW.**

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

**SERIES 515 ALUMINUM CASEMENT WINDOW**

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE CASEMENT WINDOWS, ALSO COMBINATIONS OF CASMT/CASMT OR CASMT WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

**D.L. OPENINGS**  
 DLO HT. = WDW. HT - 7.5"  
 DLO W. (SINGLE VENT) = WDW. W - 7"  
 DLO W. (DUAL VENT) = WDW. W/2 - 6.125"

**LAMINATED GLASS  
 LARGE MISSILE IMPACT**

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538  
  
 AUG 31 2009

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 Acceptance No. 09-1015.02  
 Expiration Date MAY 1, 2013  
 By   
 Miami Dade Product Control Division

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP - ANL \ W06 - 30TMM


SERIES 515 ALUMINUM CASEMENT WINDOW (L.M.I.)  
**TM WINDOW AND DOOR**  
 601 N.W. 12TH AVE.  
 POMPANO BEACH, FL. 33069  
 TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	by	description
A	10.11.06	REV. PER BCCO COMMENTS	
B	01.11.08	GLASS & HARDWARE OPTIONS ADD.	
C	08.27.09	UPDATED FOR 2007 FBC	

date: 04-14-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:  
 drawing no.  
**W06-30**  
 sheet 1 of 6

DESIGN LOAD CAPACITY - PSF FOR ( X ) SIZES					
WINDOW DIMS.		GLASS TYPE 'C'		GLASS TYPES 'B', 'D' & 'E'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26" (2)	62.0	62.0	80.0	80.0
26-1/2"		62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
19-1/8"	38-3/8" (3)	62.0	62.0	80.0	80.0
26-1/2"		62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
19-1/8"	50-5/8" (4)	62.0	62.0	80.0	80.0
26-1/2"		62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
19-1/8"	63" (5)	62.0	62.0	80.0	80.0
26-1/2"		62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
19-1/8"	74-1/4" (6)	62.0	62.0	80.0	80.0
26-1/2"		62.0	62.0	80.0	80.0
30"	74-1/4"(6)	62.0	62.0	80.0	80.0
18"	24" (2)	62.0	62.0	80.0	80.0
24"		62.0	62.0	80.0	80.0
30"		62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
18"	36" (3)	62.0	62.0	80.0	80.0
24"		62.0	62.0	80.0	80.0
30"		62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
18"	48" (4)	62.0	62.0	80.0	80.0
24"		62.0	62.0	80.0	80.0
30"		62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
18"	60" (5)	62.0	62.0	80.0	80.0
24"		62.0	62.0	80.0	80.0
30"		62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
18"	63" (5)	62.0	62.0	80.0	80.0
24"		62.0	62.0	80.0	80.0
30"		62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
18"	72" (6)	62.0	62.0	80.0	80.0
24"		62.0	62.0	80.0	80.0
30"		62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
37"	72"(6)	62.0	62.0	80.0	80.0


( ) = NO. OF ANCHORS PER JAMB

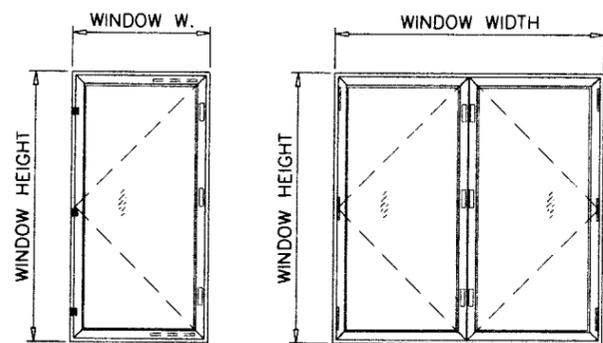


X  
XX  
APPROVED CONFIGURATIONS

DESIGN LOAD CAPACITY - PSF FOR ( XX ) SIZES					
WINDOW DIMS.		GLASS TYPE 'C'		GLASS TYPES 'B', 'D' & 'E'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26" (2)	62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
53-1/8"		62.0	62.0	80.0	80.0
74"		62.0	62.0	80.0	80.0
26-1/2"	38-3/8" (3)	62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
53-1/8"		62.0	62.0	80.0	80.0
74"		62.0	62.0	80.0	80.0
26-1/2"	50-5/8" (4)	62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
53-1/8"		62.0	62.0	80.0	80.0
74"		62.0	62.0	80.0	80.0
26-1/2"	63" (5)	62.0	62.0	80.0	80.0
37"		62.0	62.0	80.0	80.0
53-1/8"		62.0	62.0	67.9	67.9
74"		48.8	48.8	48.8	48.8
26-1/2"	72" (6)	62.0	62.0	80.0	80.0
37"		62.0	62.0	65.4	65.4
53-1/8"		45.5	45.5	45.5	45.5
74"		32.7	32.7	32.7	32.7
24"	24" (2)	62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
48"		62.0	62.0	80.0	80.0
60"		62.0	62.0	80.0	80.0
24"	36" (3)	62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
48"		62.0	62.0	80.0	80.0
60"		62.0	62.0	80.0	80.0
24"	48" (4)	62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
48"		62.0	62.0	80.0	80.0
60"		62.0	62.0	80.0	80.0
24"	60" (5)	62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
48"		62.0	62.0	80.0	80.0
60"		62.0	62.0	69.6	69.6
24"	63" (5)	62.0	62.0	80.0	80.0
36"		62.0	62.0	80.0	80.0
48"		62.0	62.0	75.2	75.2
60"		60.2	60.2	60.2	60.2
24"	72" (6)	62.0	62.0	80.0	80.0
36"		62.0	62.0	67.2	67.2
48"		50.4	50.4	50.4	50.4
60"		40.3	40.3	40.3	40.3
72"	33.6	33.6	33.6	33.6	


( ) = NO. OF ANCHORS PER JAMB

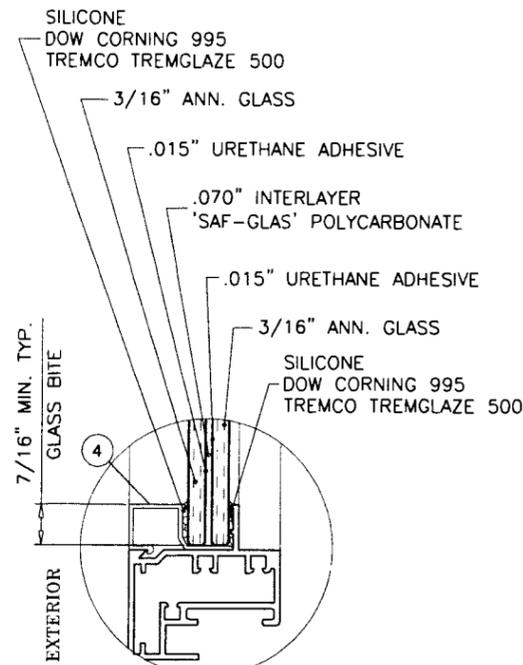


GLASS TYPE 'B'

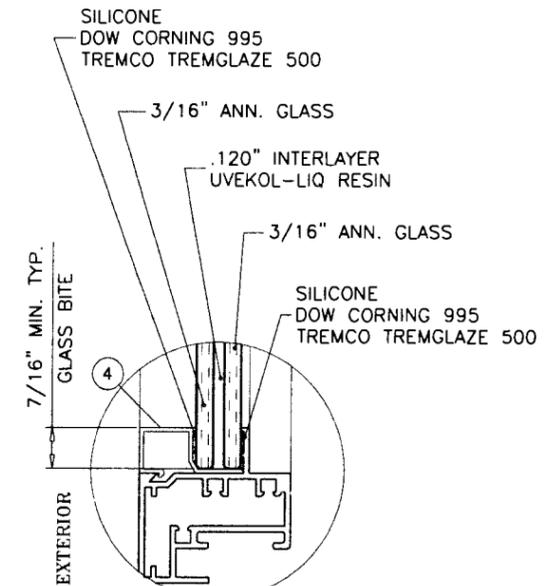

GLASS TYPE 'C'

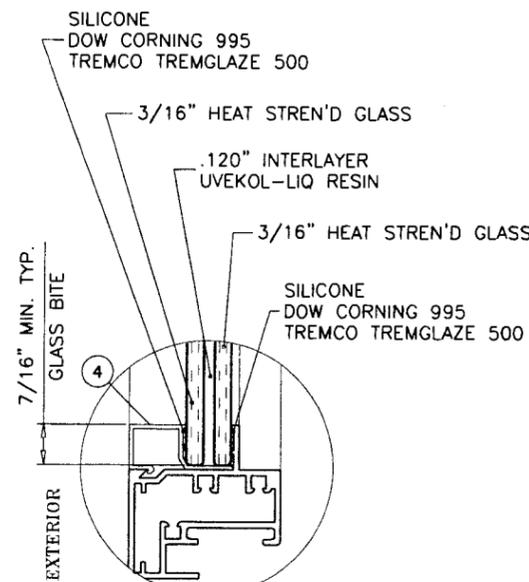

GLASS TYPE 'D'

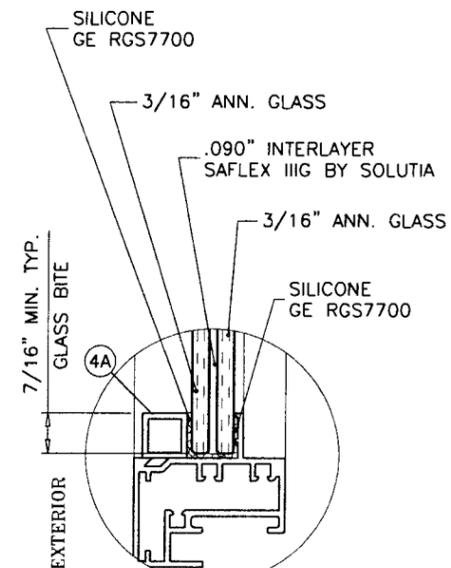

GLASS TYPE 'E'

GLAZING OPTIONS

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

Engr: ARSHAD VIQAR  
CIVIL  
FLA. PE # 38863  
C.A.N. 3538  
  
AUG 31 2009


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 09-1015.07  
Expiration Date MAY 1, 2013  
  
By: *M. M. J.*  
Miami Dade Product Control  
Division

**afC**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-30TMM


SERIES 515 ALUMINUM CASEMENT WINDOW (L.M.I.)  
**TM WINDOW AND DOOR**  
601 N.W. 12TH AVE.  
POMPANO BEACH, FL. 33069  
TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	description
A	10.11.06	REV. PER BCCO COMMENTS
B	01.11.08	GLASS & HARDWARE OPTIONS ADD.
C	08.27.09	UPDATED FOR 2007 FBC



revisions:  
date: 04-14-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:  
drawing no.  
**W06-30**  
sheet 2 of 6

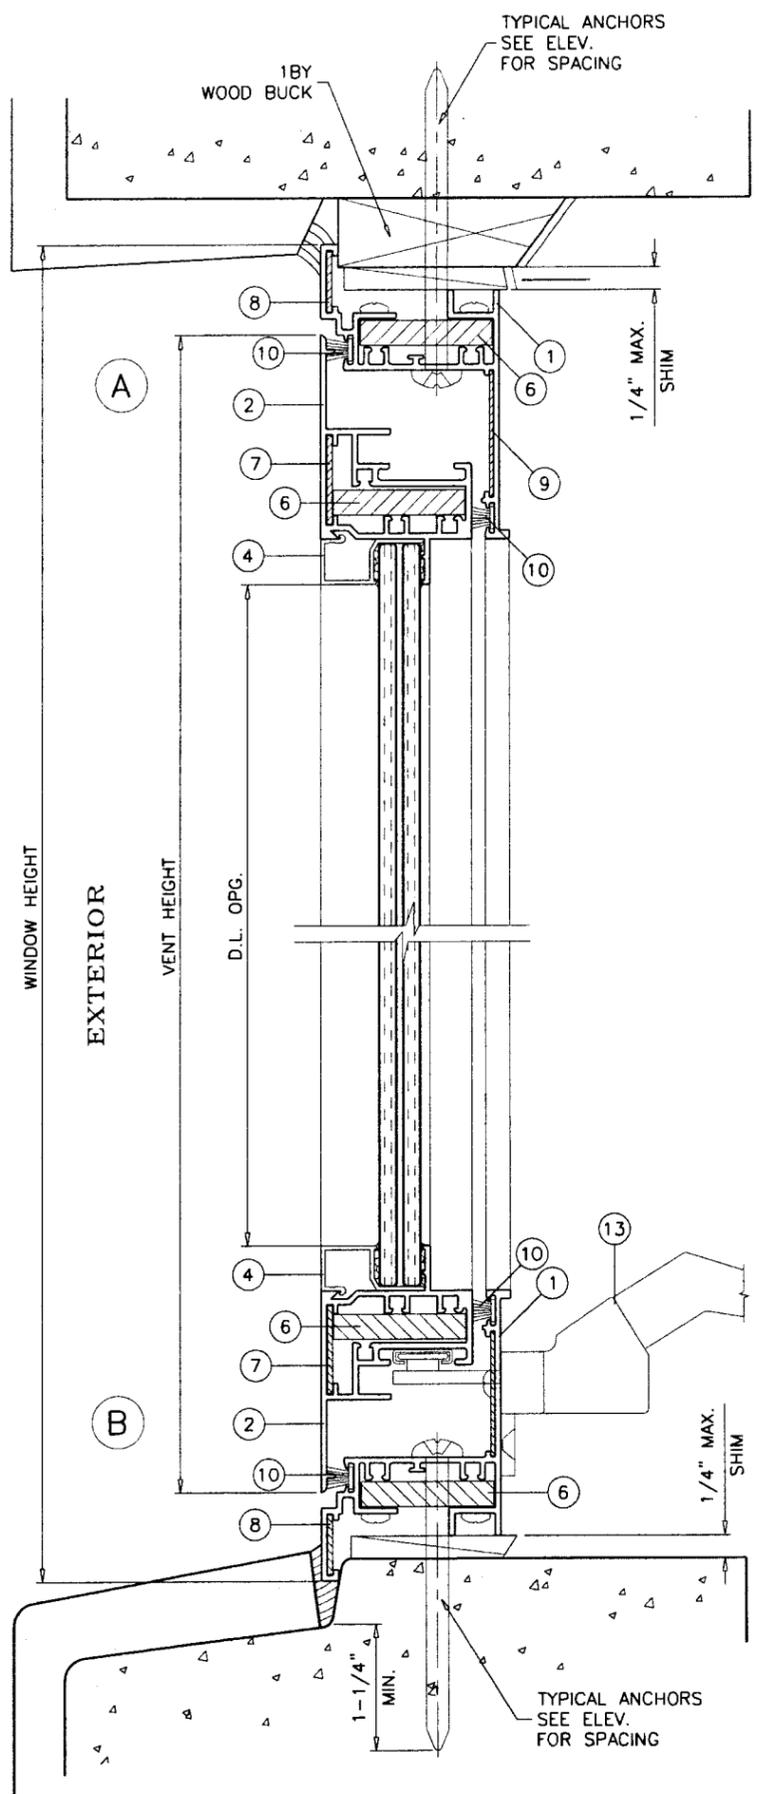

BUTT HINGE OPTION

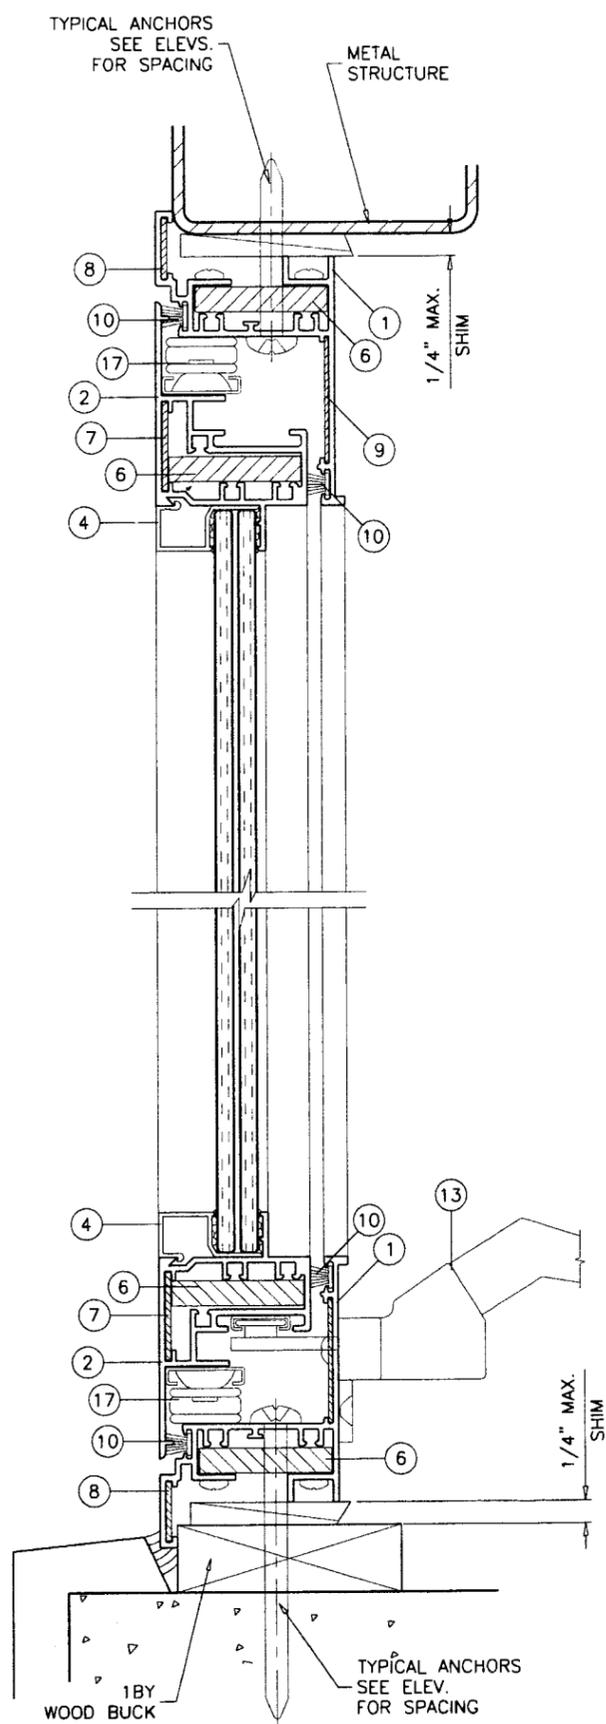

CONCEALED HINGE OPTION

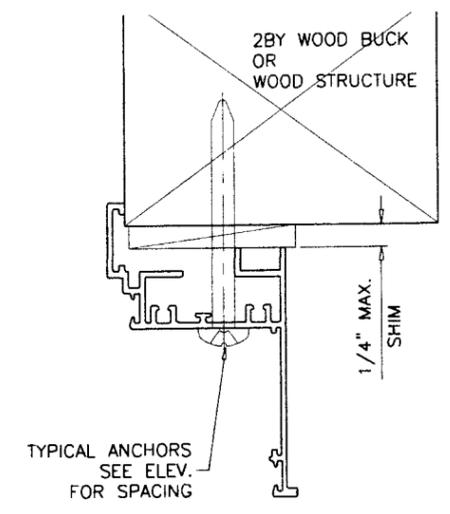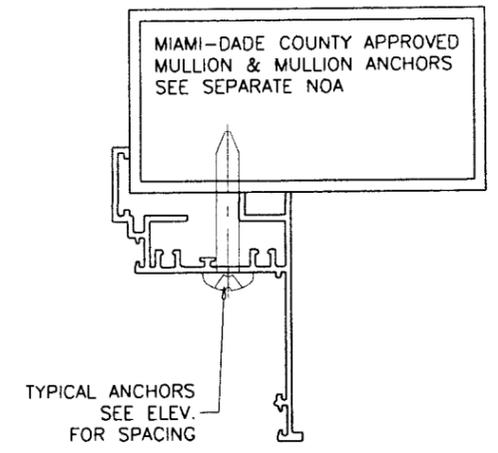

WOOD BUCKS AND METAL STRUCTURE NOT BY TM WINDOWS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING  
**1/4" DIA. ULTRACON BY 'ELCO'** (Fu=177 KSI, Fy=155 KSI)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-3/8" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
**#14 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)  
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")  
 INTO METAL STRUCTURES  
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**TYPICAL EDGE DISTANCE**  
 INTO CONCRETE AND MASONRY = 1-1/2" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.  
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

**SEALANTS:**  
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SILICONE OR ACRYLIC SEALANT.

Engr: ARSHAD VIGAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538  
 AUG 31 2009


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 09-1015.02  
 Expiration Date MAY 1, 2013  
 By Manuel Perez  
 Miami Dade Product Control  
 Division

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL W06-30TMM


SERIES 515 ALUMINUM CASEMENT WINDOW (L.M.I.)  
**TM WINDOW AND DOOR**  
 601 N.W. 12TH AVE.  
 POMPANO BEACH, FL. 33069  
 TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	by	description
A	10.11.06	REV. PER BCCO COMMENTS	
B	01.11.08	GLASS & HARDWARE OPTIONS ADD.	
C	08.27.09	UPDATED FOR 2007 FBC	



date: 04-14-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:  
 drawing no. W06-30  
 sheet 3 of 6

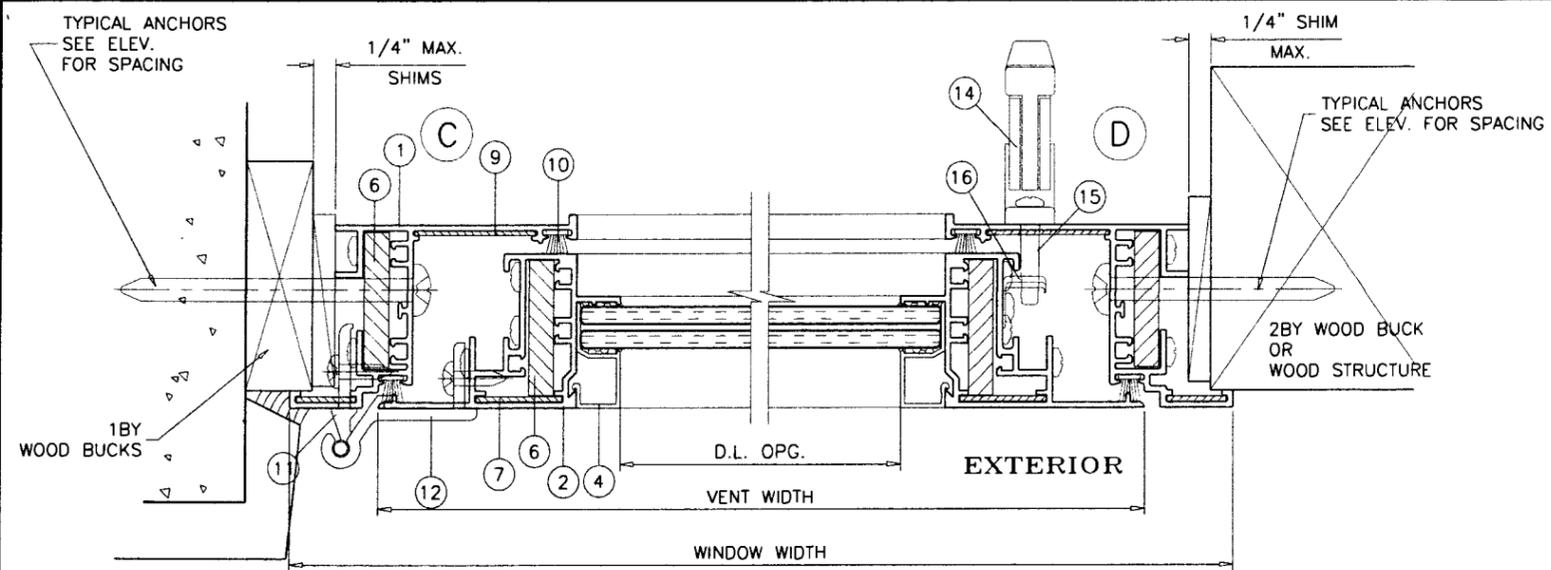

SINGLE VENT WINDOWS (BUTT HINGE OPTION)

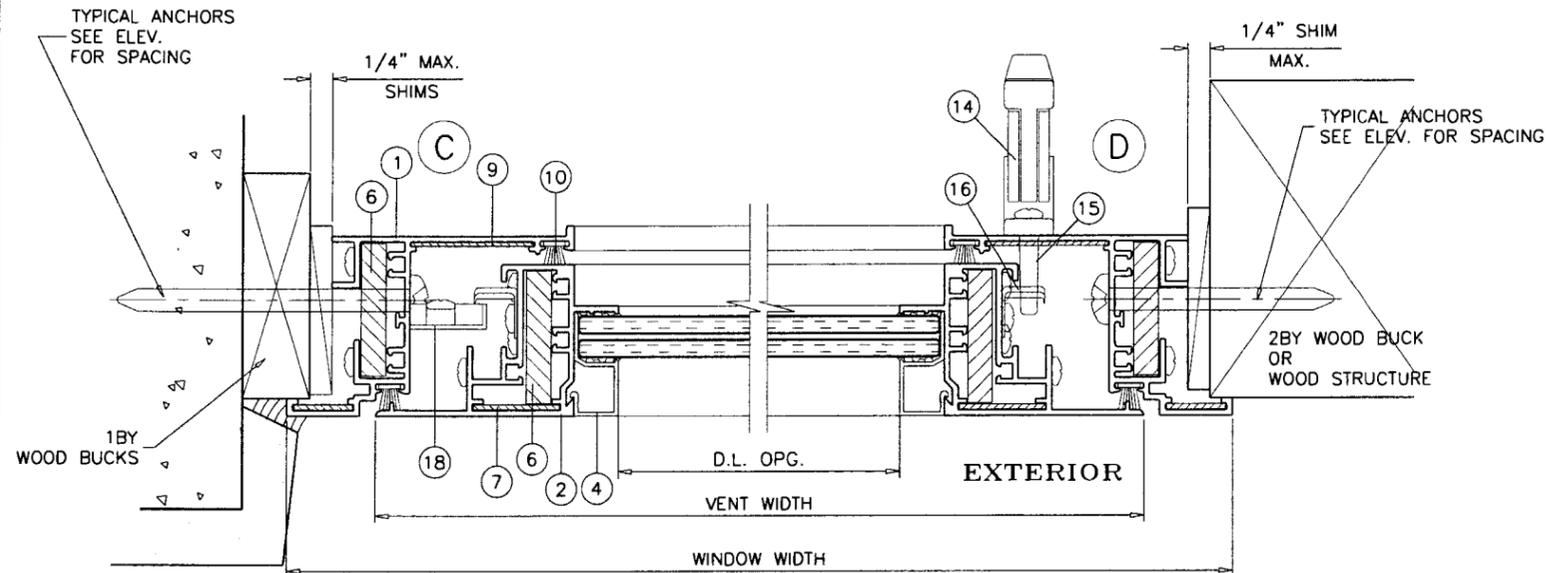

SINGLE VENT WINDOWS (CONCEALED HINGE OPTION)

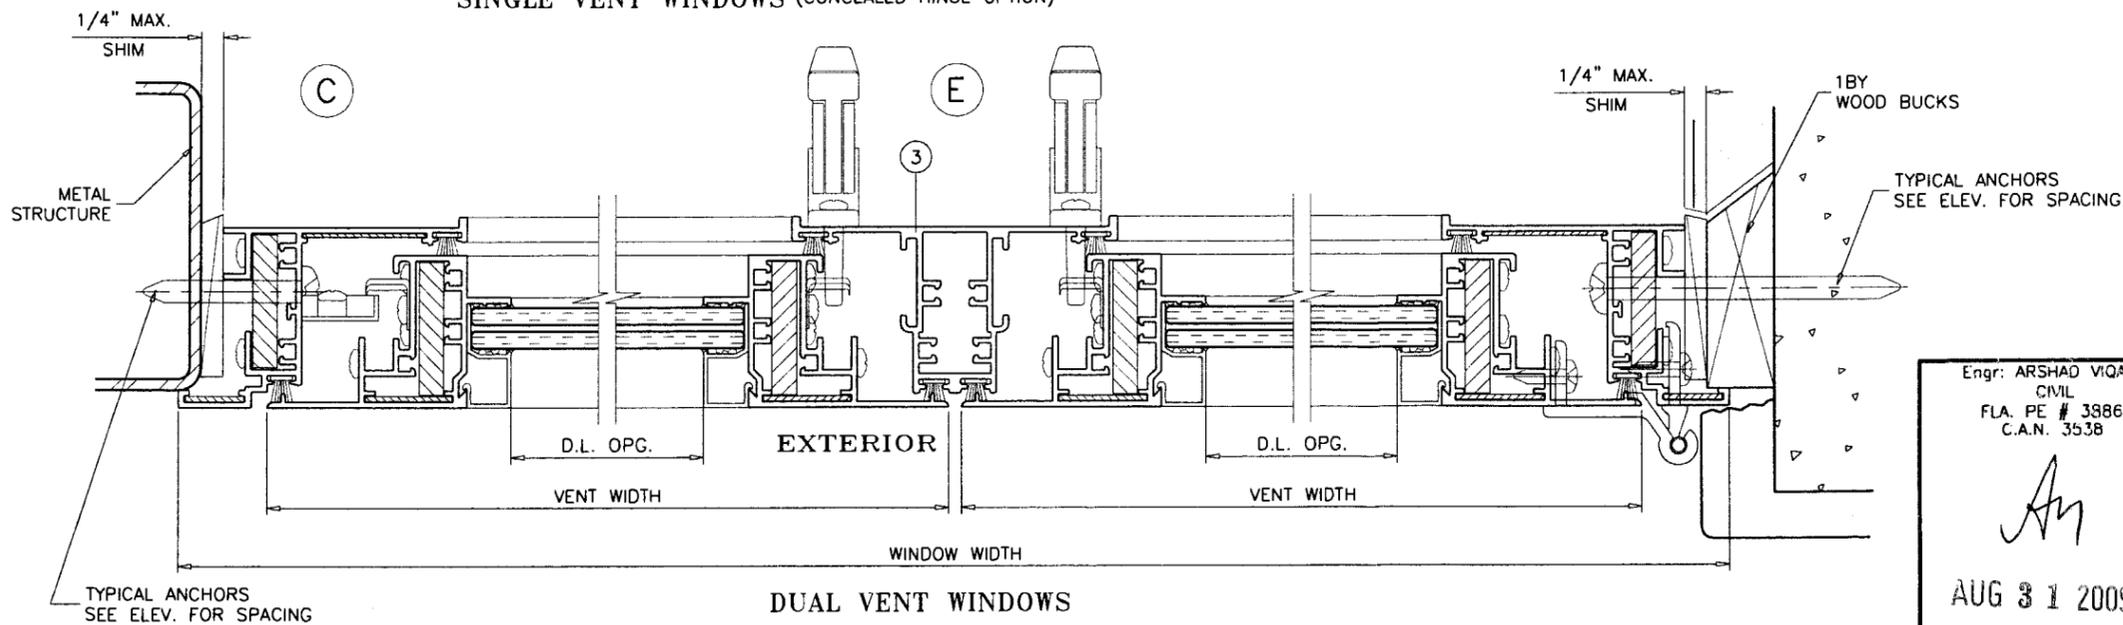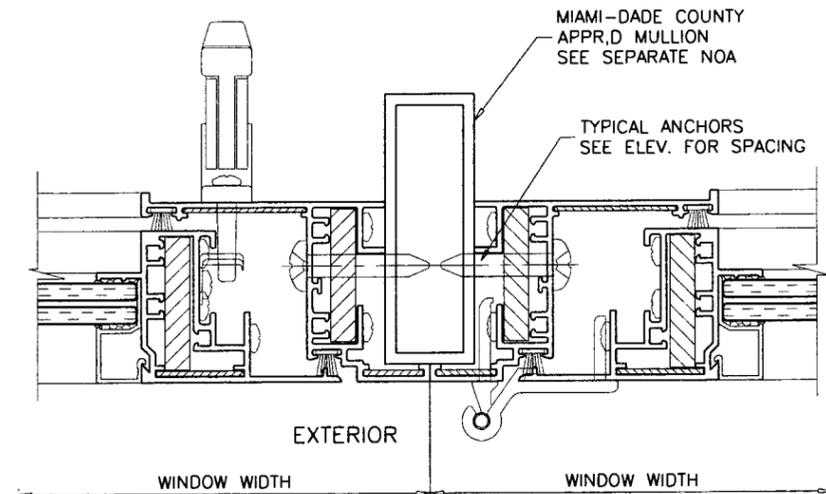

DUAL VENT WINDOWS

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538

*An*

AUG 31 2009

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 09-1015.02  
 Expiration Date MAY 1, 2013  
 By Manuel Perez  
 Miami-Dade Product Control  
 Division


**afC**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W06-30TMM

SERIES 515 ALUMINUM CASEMENT WINDOW (L.M.I.)  
**TM WINDOW AND DOOR**  
 601 N.W. 12TH AVE.  
 POMPANO BEACH, FL. 33069  
 TEL. (954) 781-4430 FAX. (954) 781-5078


NO	DATE	BY	DESCRIPTION
A	10.11.06	REV. PER BCCO COMMENTS	
B	01.11.08	GLASS & HARDWARE OPTIONS ADD.	
C	08.27.09	UPDATED FOR 2007 FBC	

date: 04-14-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:


drawing no.  
**W06-30**  
 sheet 4 of 6

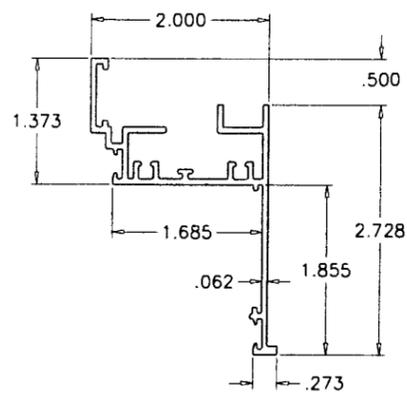


1 FRAME

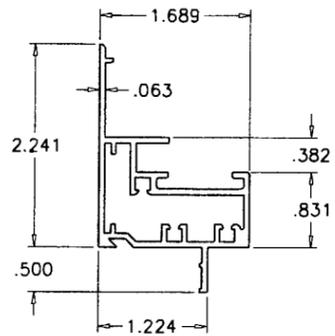


2 VENT




4 GLAZING BEAD




4A GLAZING TUBE

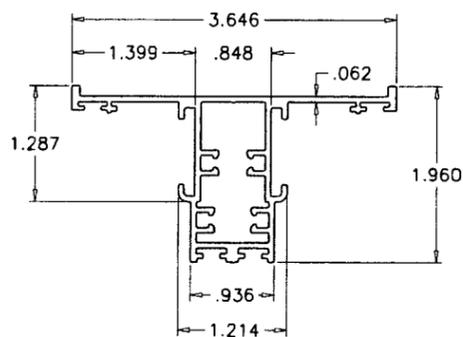


3 IMPOST

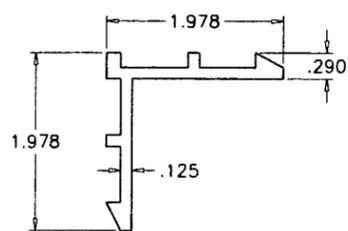


6 CORNER KEY

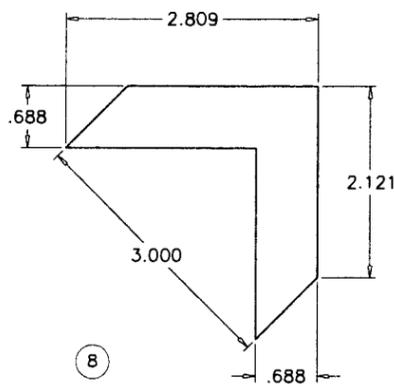

8

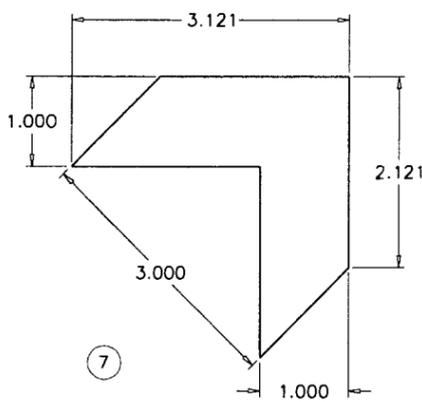

7

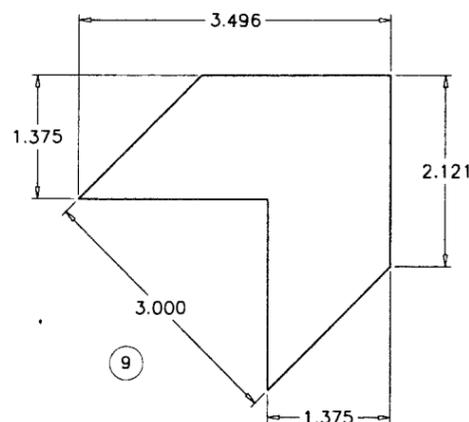

9

CORNER KEYS

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	GW37528	4	FRAME	6063-T6	-
2	GW37526	4	VENT	6063-T6	-
3	GW37524	1	IMPOST	6063-T6	-
4	TM145	AS REQD.	GLAZING BEAD	6063-T6	-
4A	-	AS REQD.	GLAZING TUBE	6063-T6	-
5	#10 X 1-1/4"	2/ CORNER	FRAME/VENT ASSEMBLY SCREWS	ST. STEEL	PH SMS
6	SW27713	-	CORNER KEY	ALUMINUM	-
7	-	-	CORNER KEY (3 X 1 X .062" CHEVRON)	ALUMINUM	-
8	-	-	CORNER KEY (3 X 11/16 X .062" CHEVRON)	ALUMINUM	-
9	-	-	CORNER KEY (3 X 1-3/8" X .041" CHEVRON)	ALUMINUM	-
10	2230	AS REQD.	FRAME & VENT W'TRIPPING	FINSEAL	-
11	GW37521	AS REQD.	BUTT HINGE INTERIOR (FASTENED W/ (3) #10 X 3/8" PH SMS)	ALUMINUM	-
12	GW37522	AS REQD.	BUTT HINGE EXTERIOR (FASTENED W/ (2) #10 X 3/8" PH SMS)	ALUMINUM	-
13	23-65-32	-	ROTO OPERATOR (FASTENED W/ (4) #10 X 3/8" PH SMS)	-	TRUTH
14	24-11-32	AS REQD.	LEVER TYPE CAM LOCK (FASTENED W/ (2) #10 X 3/8" PH SMS)	-	-
15	21089	-	STRIKE KEEPER (FASTENED W/ (4) #8 X 1/2" TH SMS)	-	TRUTH
16	30238	AS REQD.	KEEPER (FASTENED W/ (2) #10 X 3/8" PH SMS)	-	-
17	300 SERIES	2/ VENT	3 BAR CONCEALED HINGE (FASTENED W/ (2) #10 X 3/8" PH SMS)	ST. STEEL	AT SASH TOP & BOTTOM
18	SB001/SB002	3/ VENT	4" LONG SNUBBER (FASTENED WITH (2) #8 X 1/2" HEX H SD SCREWS)	ZINC	AT HINGE RAIL

Engr: ARSHAD VIQAR  
CIVIL  
FLA. PE # 38863  
C.A.N. 3538

*Ar*  
AUG 31 2009

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. *09-1015.02*  
Expiration Date *MAY 1 2013*  
By *Maurell Perry*  
Release Date Product Control  
Division


SERIES 515 ALUMINUM CASEMENT WINDOW (L.M.I.)  
TM WINDOW AND DOOR  
601 N.W. 12TH AVE.  
POMPANO BEACH, FL. 33069  
TEL. (954) 781-4430 FAX. (954) 781-5078

no.	date	description
A	10.11.06	REV. PER BCCO COMMENTS
B	01.11.08	GLASS & HARDWARE OPTIONS ADD.
C	08.27.09	UPDATED FOR 2007 FBC


date: 04-14-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W06-30**  
sheet 5 of 6


**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-30TAW

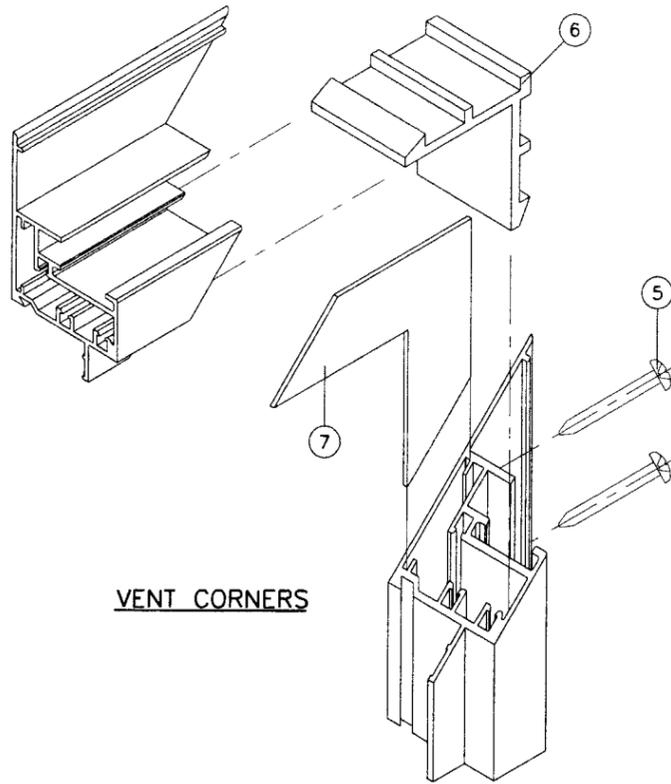

VENT CORNERS

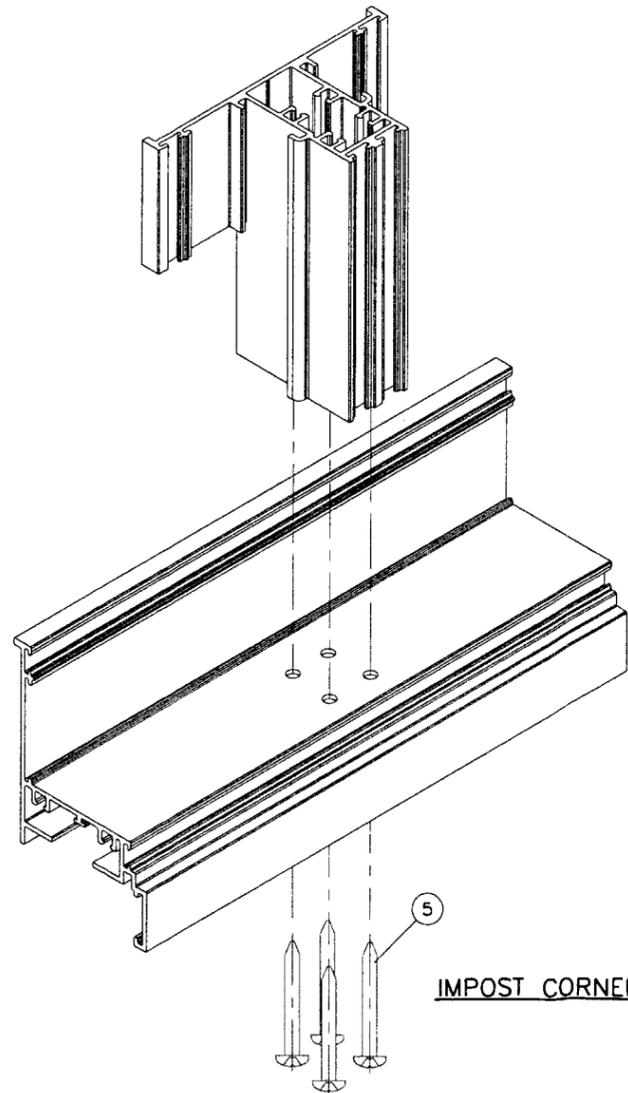

IMPOST CORNERS

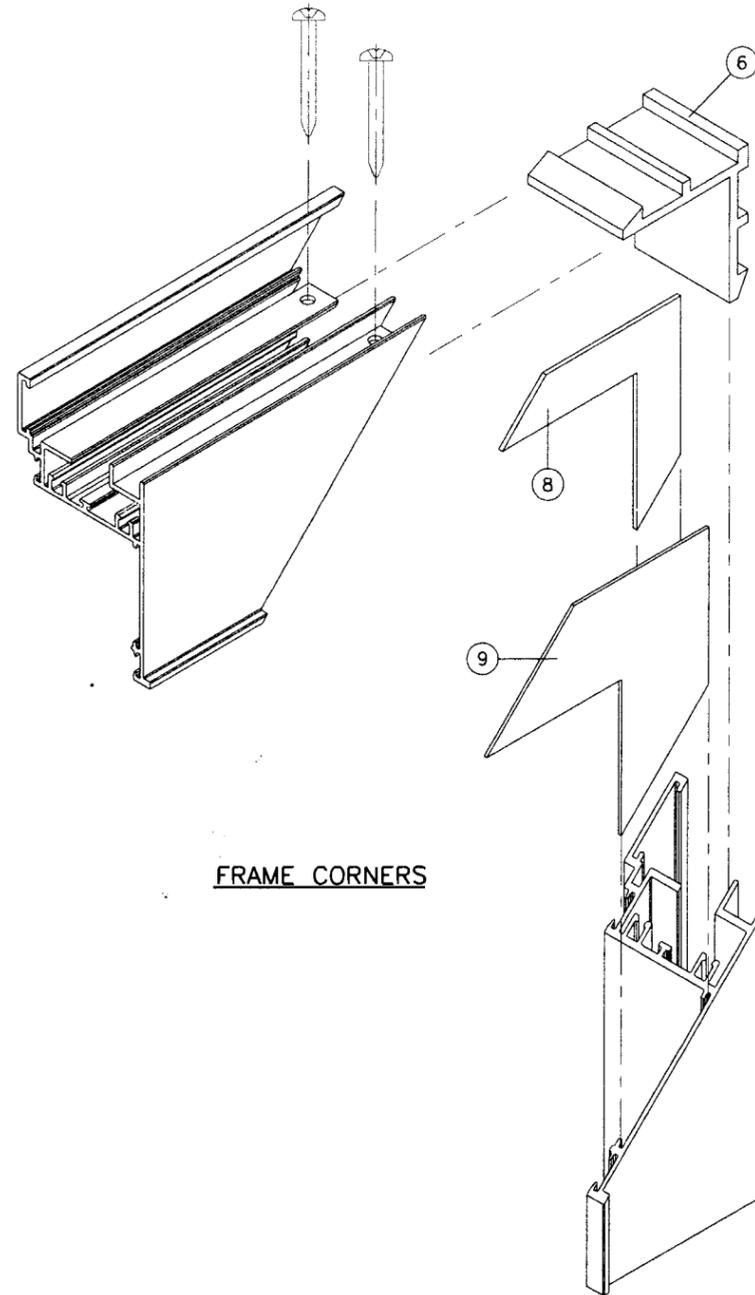

FRAME CORNERS

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538

*Arj*  
 AUG 31 2009

PRODUCT REVIEWED  
 as complying with the Florida  
 Building Code  
 Approval No. 09-1015-02  
 Expiration Date MAY 1, 2013

By *Manuel Perez*  
 Miami Trade Product Control  
 Division

**af c**

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP - ANL \ W06 - 30TMM

---

SERIES 515 ALUMINUM CASEMENT WINDOW (L.M.I.)

**TM WINDOW AND DOOR**  
 601 N.W. 12TH AVE.  
 POMPANO BEACH, FL. 33069  
 TEL. (954) 781-4430 FAX. (954) 781-5078

---

no	date	by	description
A	10.11.06	REV. PER BCCO COMMENTS	
B	01.11.06	GLASS & HARDWARE OPTIONS ADD	
C	08.27.09	UPDATED FOR 2007 FBC	

---

date: 04-14-06  
 scale: 1/2" = 1"  
 dr. by: HAM/D  
 chk. by:

---

drawing no.  
**W06-30**

---

sheet 6 of 6