



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Owens Corning Roofing and Asphalt LLC.
One Owens Corning Parkway
Toledo, OH. 43659

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: VentSure 4-Foot Strip Heat and Moisture Ridge Vents and VentSure 4-Foot Strip Heat and Moisture Ridge Vents with Weather Protection and Moisture Barrier.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 4.

The submitted documentation was reviewed by Alex Tigera.



NOA No.: 09-1019.03
Expiration Date: 04/07/15
Approval Date: 04/07/10
Page 1 of 4

ROOFING COMPONENT APPROVAL

Category: Roofing
Sub-Category: Roof Vent
Material: Plastic

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
VentSure 4-Foot Strip Heat and Moisture Ridge Vents	Ht. = 1-1/4" Width = 15" Length = 48"	TAS 100(A)	Plastic low profile attic ridge vent consisting of a two layer composite consisting of a nylon-polyester, for installation in shingle roof systems.
VentSure 4-Foot Strip Heat and Moisture Ridge Vents with Weather Protection and Moisture Barrier	Ht. = 1-1/4" Width = 15" Length = 48"	TAS 100(A)	Plastic low profile attic ridge vent consisting of a two layer composite consisting of a nylon-polyester, with a polyester fabric moisture barrier for installation in shingle roof systems.
VentSure Nail	Length = 2.5" Diameter = 0.125"	TAS 114 Appendix E	Corrosion Resistant nail for use with VentSure Ridge Vents.

MANUFACTURING LOCATION:

1. Niles, OH.

EVIDENCE SUBMITTED

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
PRI Construction Materials Technologies	OCF-116-02-01	TAS-100(A)	05/12/09
ETC Laboratories	ETC-08-718-21721.1	ASTM D 1929 ASTM D635 ASTM D 2843	12/08/08
PRI Construction Materials Technologies	OCF-112-02-01	ASTM G 155 ASTM D 638	05/11/09
PRI Construction Materials Technologies	OCF-132-02-01	TAS 114 Appendix E	10/05/09



NOA No.: 09-1019.03
 Expiration Date: 04/07/15
 Approval Date: 04/07/10
 Page 2 of 4

APPROVED APPLICATIONS:

Trade Name: VentSure 4-Foot Vent (with or without Weather Protection and Moisture Barrier)

- Installation:**
1. Allow a 2" opening (1" on each side of the ridge) centered in the deck at the ridge for ventilation. The slot shall terminate approximately 6" from the rake edges.
 2. Apply a 1/4" bead of roofing cement along the entire length of the outside edges of the vent to seal the vent to the field shingles.
 3. Center the vent over the opening and fasten to the deck using the Ventsure Nails. Fasteners are placed on both sides of the vent 1", 12", 24", 36", and 47" from the start of each vent piece.
 4. Prepare the adjacent vent section by applying the roofing cement along the edges, snap together with fixed vent, and fasten to the deck in the same manner as the first section.
 5. Fasten the ridge shingles over the vent to the deck on the marked "shingle nail line" with (2) Ventsure nails. Outside edges of the shingles are to be sealed with flashing cement.

Net Free Area: Refer to Manufacturer's Published Literature


Minimum Slope: 2:12

SYSTEM LIMITATIONS:

1. Refer to applicable Building code for required ventilation.
2. Ridge vent ventilators shall not be installed on roof mean heights greater than 33 ft.
3. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 9B-72 of the Florida Administrative Code.
4. Ridge Vent shall comply with 1517.6 of the Florida Building Code (FBC).



PRODUCT DETAILS

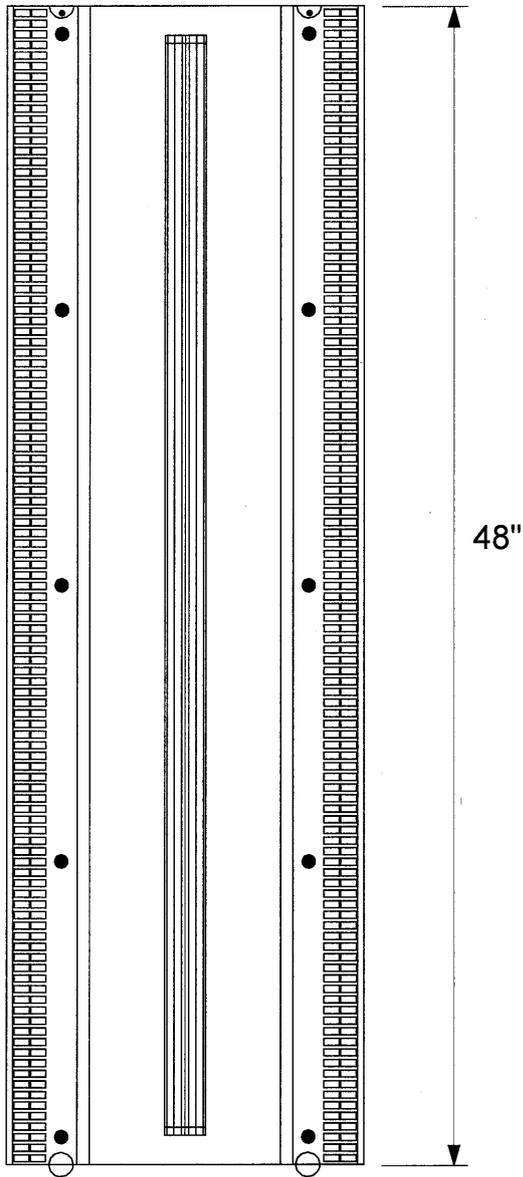

END OF THIS ACCEPTANCE



NOA No.: 09-1019.03
Expiration Date: 04/07/15
Approval Date: 04/07/10
Page 4 of 4