



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Zeluck, Inc.
5300 Kings Highway
Brooklyn, NY 11234

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "W & C Mahogany" Wood Double Hung Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W05-03** titled "Series W&C Double Hung Wood Windows (L.M.I.)", sheets 1 through 5 of 5, prepared by Al-Farooq Corporation., dated 01/14/05 with revision C dated 11/18/08, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and renews NOA # 09-0106.06** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 09-1209.03
Expiration Date: May 05, 2015
Approval Date: April 07, 2010
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W05-03** titled "Series W&C Double Hung Wood Windows (L.M.I.)", sheets 1 through 5 of 5, dated 01/14/05 with revision C dated 11/18/08, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of a wood double hung window, prepared by Architectural Testing, Inc., Test Report No. **ATI-59246.01-122-18**, dated 09/22/04, signed and sealed by Steven H. Urich, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 10/14/09, signed and sealed by Arshad Viqar, P.E.
Complies with ASTM E1300-02/04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to **Solutia, Inc.** for their "**Saflex III Clear or colored Interlayer**" dated 05/04/06, expiring on 05/21/11.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated October 14, 2009, signed and sealed by Arshad Viqar, P.E.

G. OTHER

1. Notice of Acceptance No. **09-0106.06**, issued to Zeluck, Inc. for their Series "W&C" Mahogany Double Hung Wood Windows, approved on 05/06/09 and expiring on 05/05/10.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 09-1209.03
Expiration Date: May 05, 2015
Approval Date: April 07, 2010

MAXIMUM DESIGN LOAD RATING = + 60.0 PSF
(FOR SIZES SHOWN OR SMALLER) - 70.0 PSF

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES W&C DOUBLE HUNG WOOD WINDOWS

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF D.H./D.H. OR DOUBLE HUNG WITH OTHER MIAMI-DADE COUNTY APPROVED WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.
LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

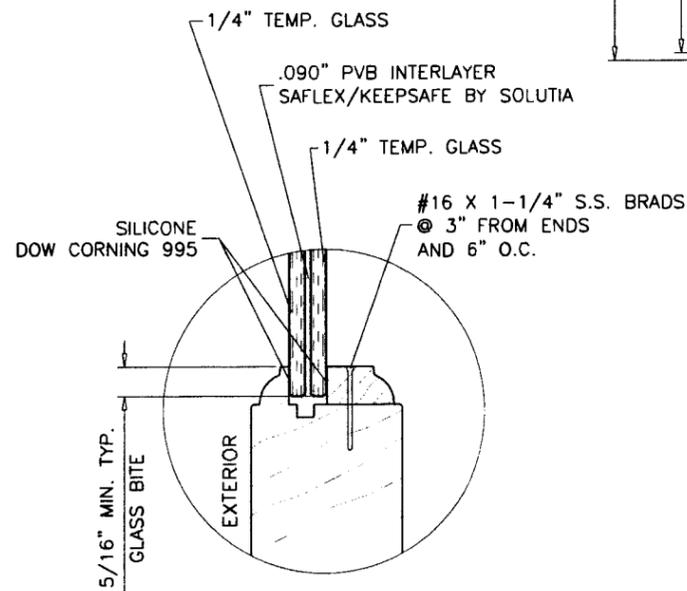

GLAZING DETAIL

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-02/04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

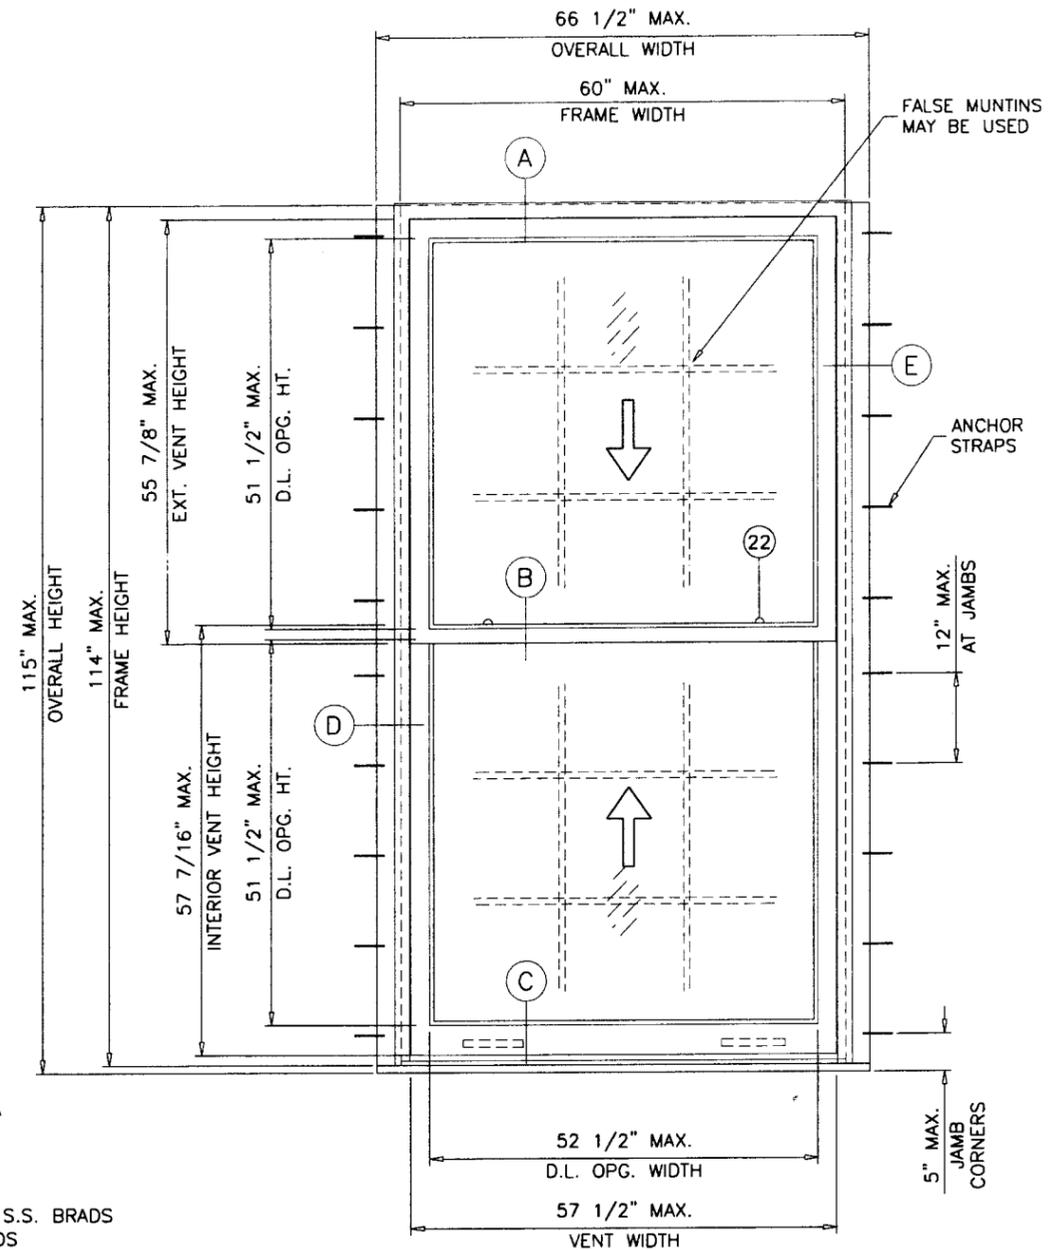

TYPICAL ELEVATION

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
OCT 14 2009

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 09-1209.03
Expiration Date MAY 5, 2015
By: *Manuel Torres*
Miami/Dade Product Control Division


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-03Z1

SERIES W&C DOUBLE HUNG WOOD WINDOWS (L.M.I.)
ZELUCK INC.
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234
TEL. (718) 251-8060 FAX (718) 531-2564

no	date	by	description
A	08.01.06		UPDATED FOR 2004 FBC
B	12.20.06		REV. PER BCCO COMMENTS
C	11.18.08		UPDATED FOR 2007 FBC

date: 01-14-05
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W05-03
sheet 1 of 5

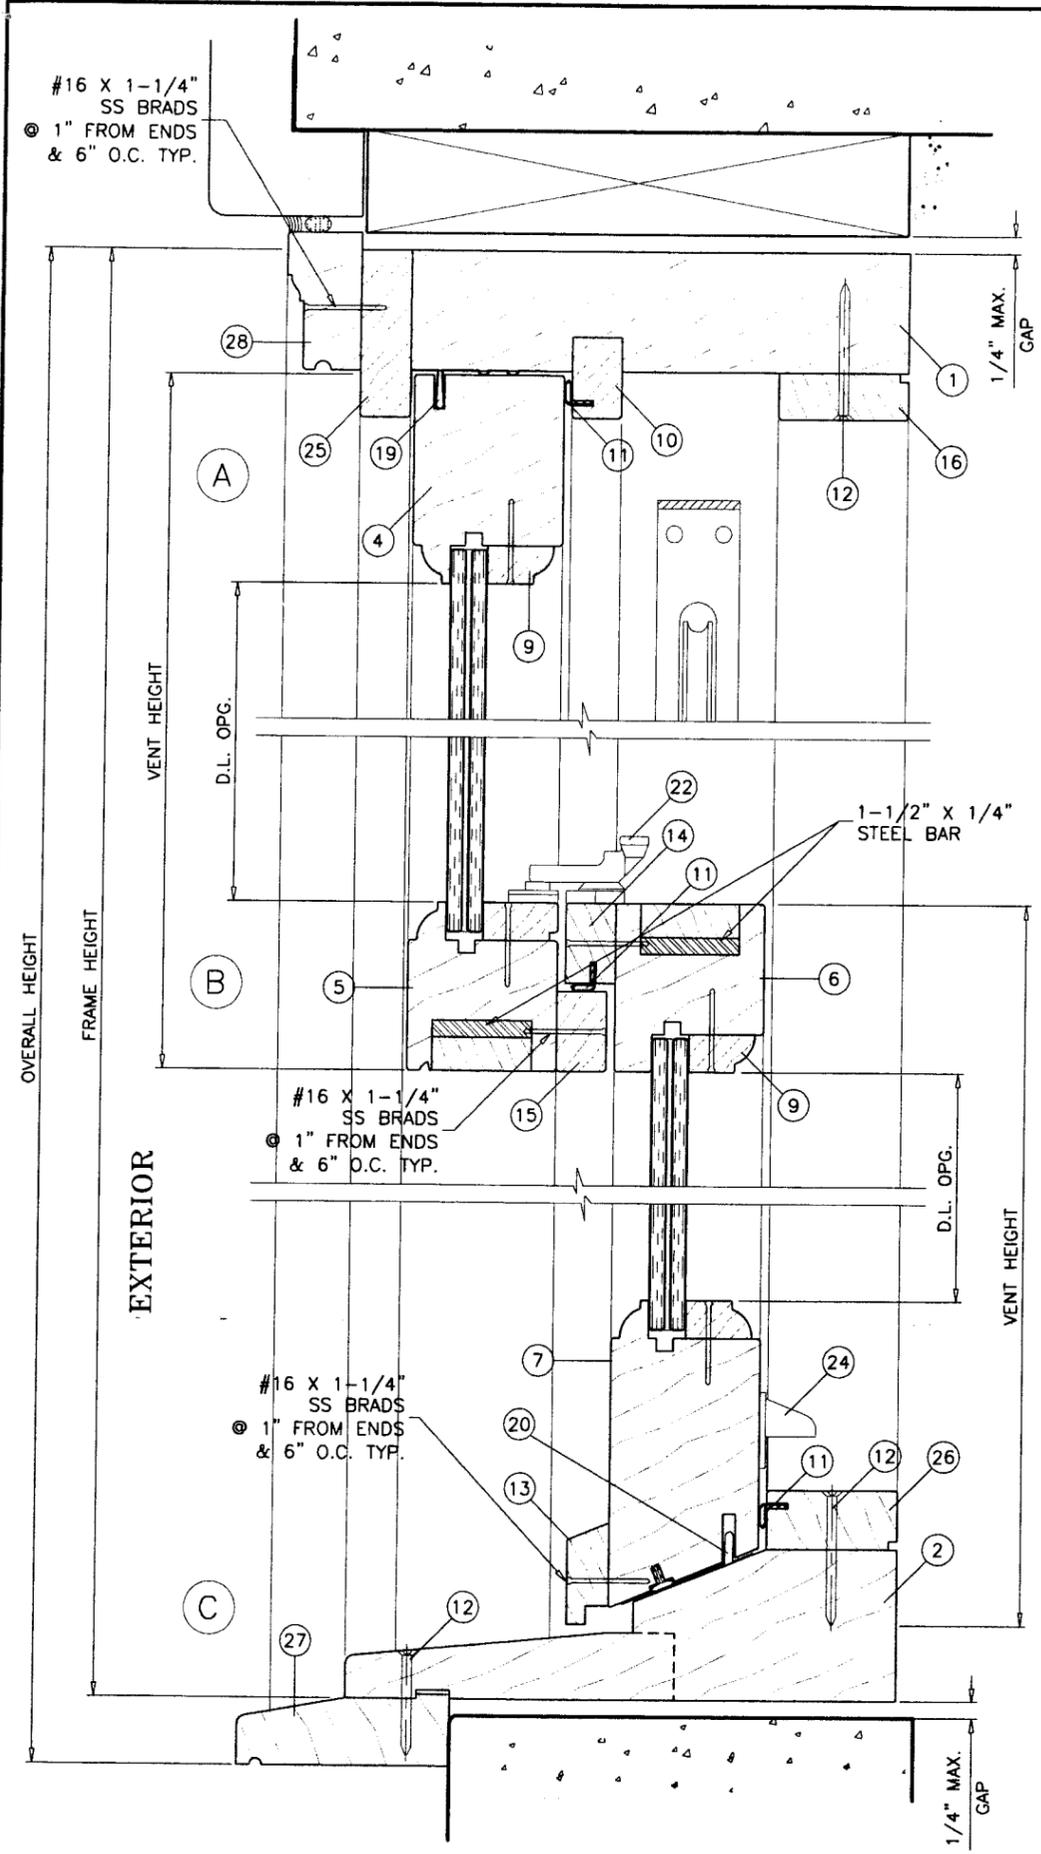

WOOD BUCKS AND METAL STRUCTURE NOT BY ZELUCK INC. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING THRU INSTALLATION CLIPS

#12 SMS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD

3/16" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD


THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#12 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1-1/2" MIN.
 INTO WOOD STRUCTURE = 3/4" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE f'c = 2730 PSI MIN.
 MASONRY f'm = 1924 PSI MIN.

SEALANTS:
 FRAME CORNERS, INTERIOR AND EXTERIOR OF GLAZING TO BE SEALED WITH SILICONE SEALANT.
 ALL WOOD TO WOOD JOINTS GLUED WITH 'PHENYL RESORCINOL' WATER PROOF ADHESIVE.

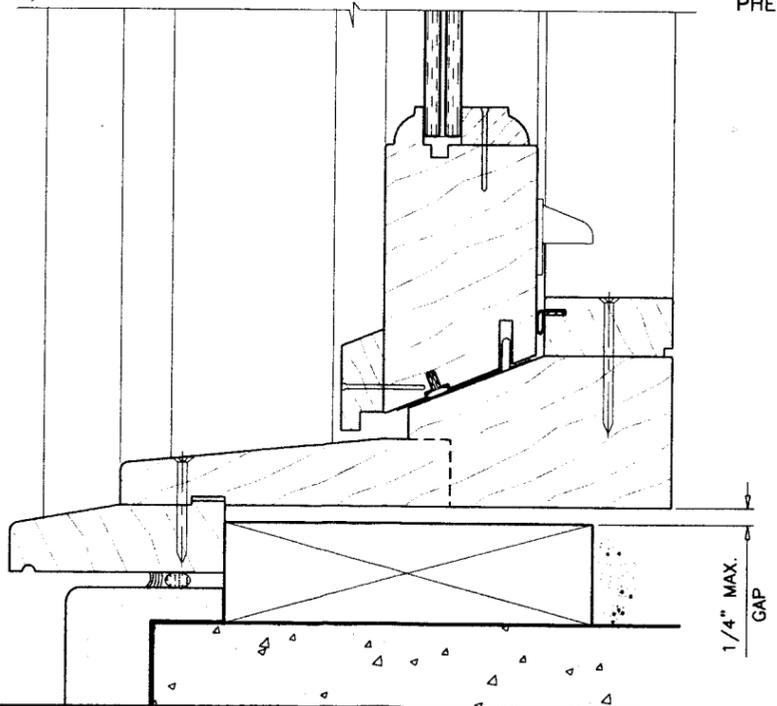

Engr: ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538
 OCT 14 2009





PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-1209.03
 Expiration Date MAY 5, 2015
 By: *Manuel Berg*
 Manual Code Product Control
 Division

afc
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-03Z1

SERIES W&C DOUBLE HUNG WOOD WINDOWS (L.M.I.)
ZELUCK INC.
 5300 KINGS HIGHWAY
 BROOKLYN, N.Y. 11234
 TEL. (718) 251-8060 FAX (718) 531-2564

no	date	description
A	08.01.06	UPDATED FOR 2004 FBC
B	12.20.06	REV. PER BCCO COMMENTS
C	11.18.08	UPDATED FOR 2007 FBC

date: 01-14-05
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W05-03
 sheet 2 of 5

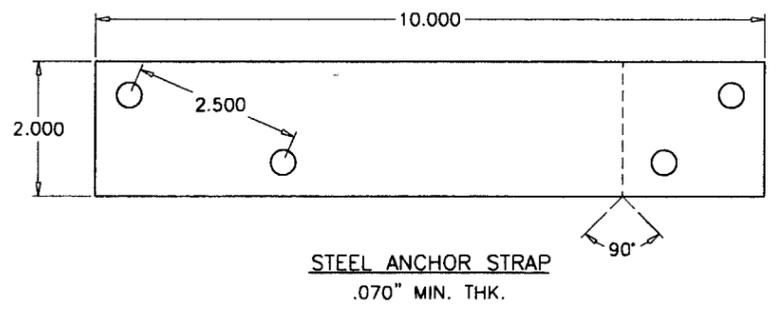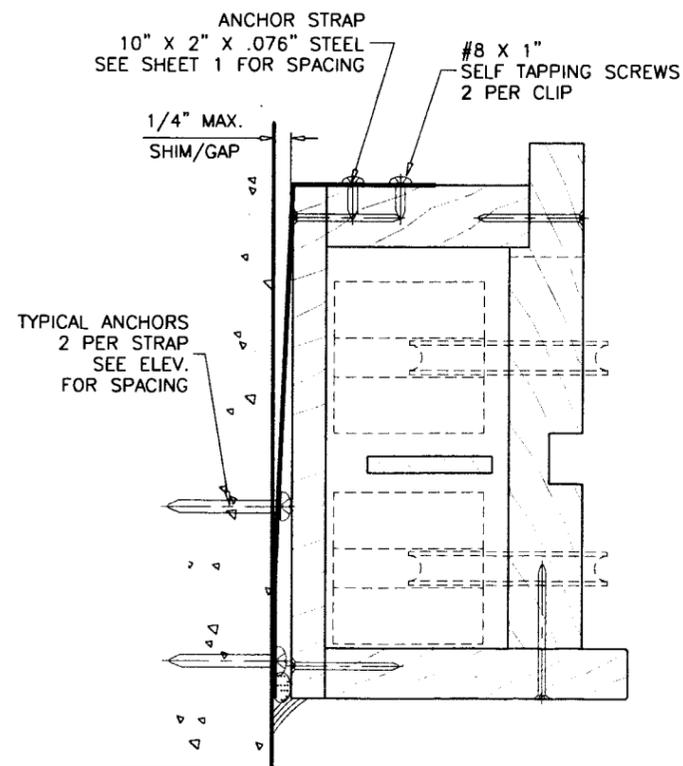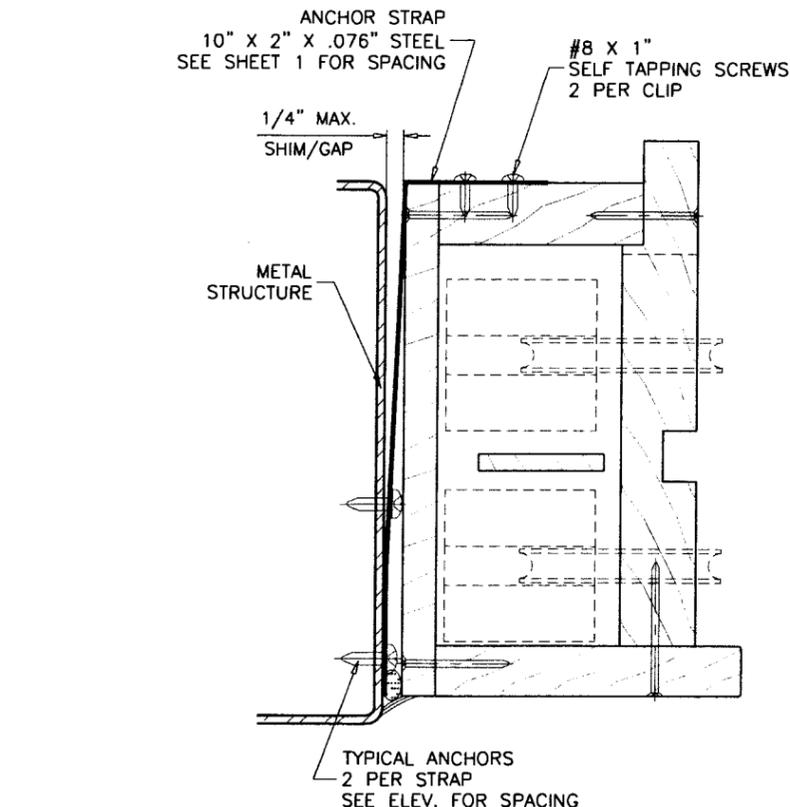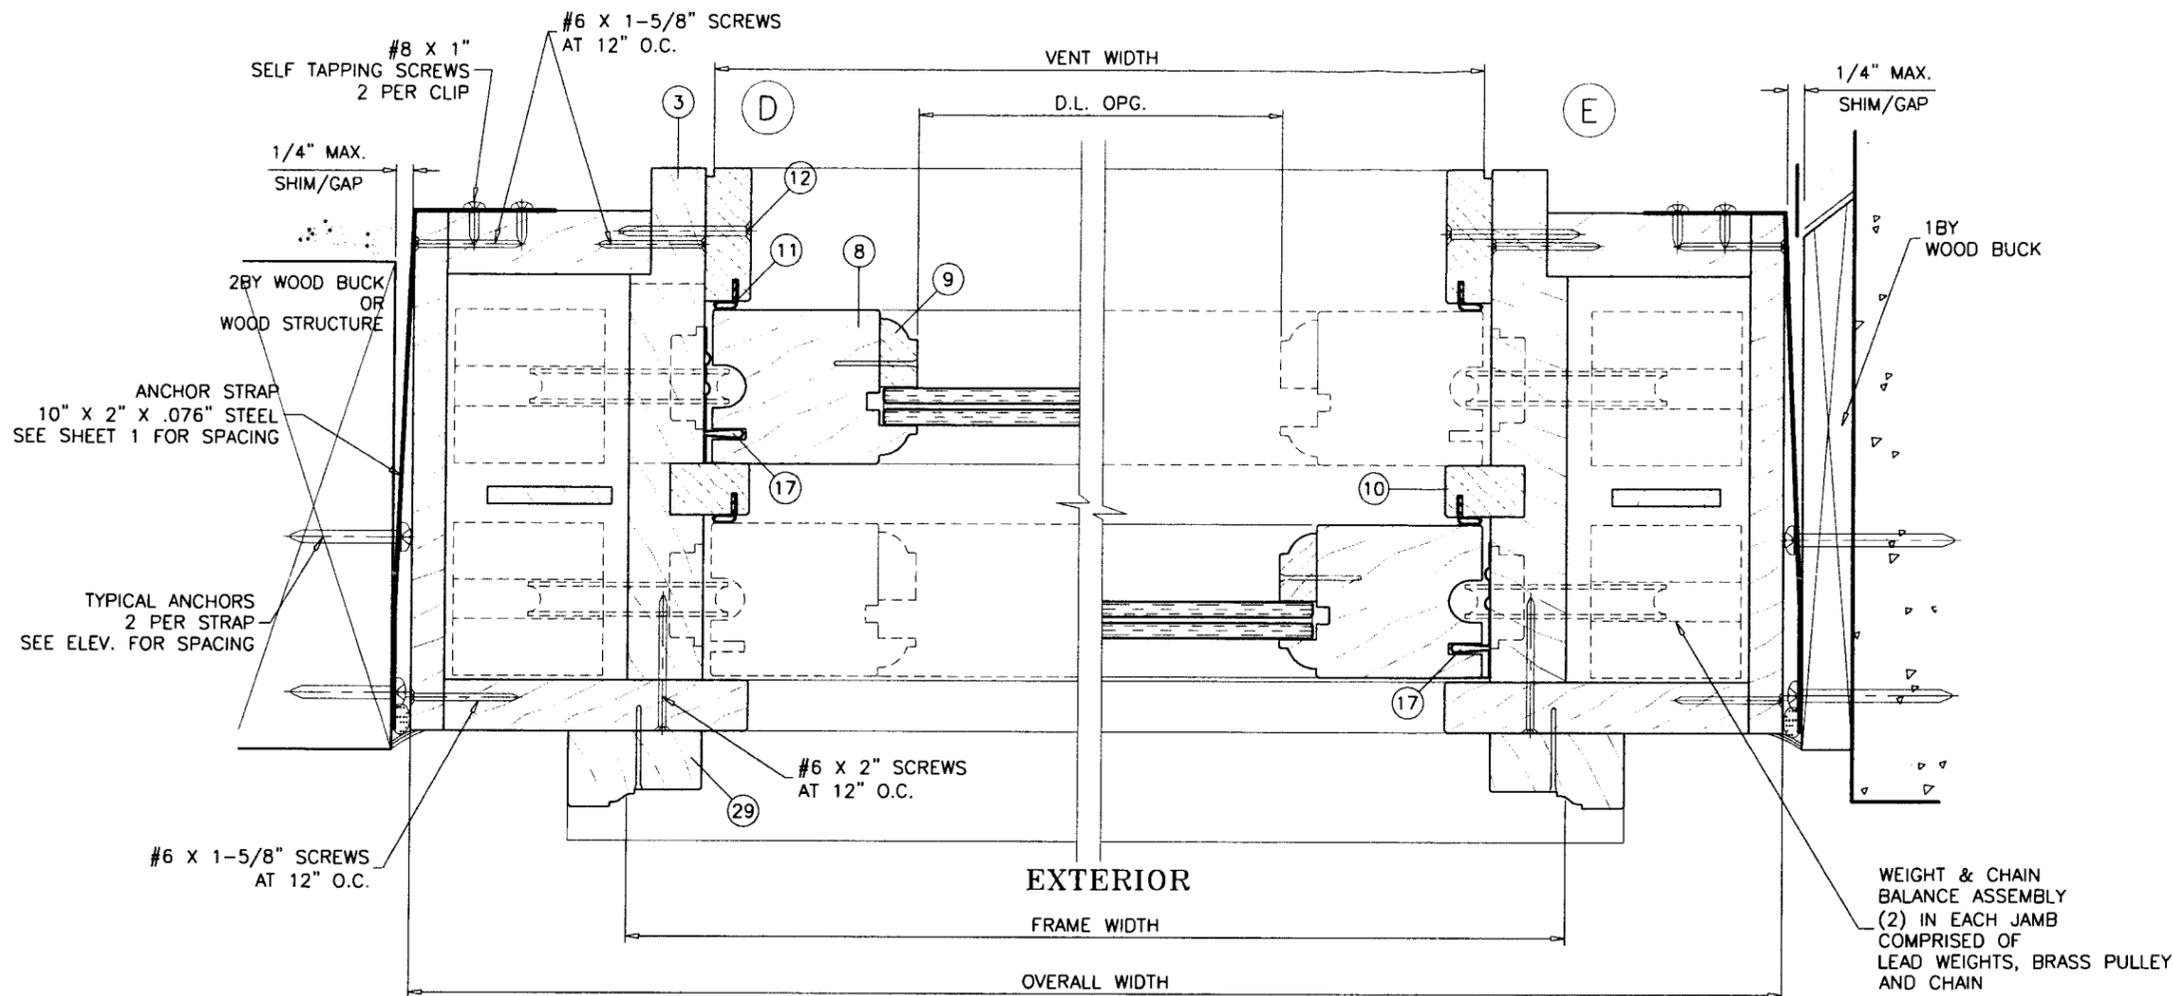

Engr. ARSHAD VIQAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538

OCT 14 2009

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-1209.03
 Expiration Date MAY 5, 2015

By: *Manuel Perez*
 Project Product Control
 Division

afc
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 12335 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-03Z1


SERIES W&C DOUBLE HUNG WOOD WINDOWS (L.M.I.)
ZELUCK INC.
 5300 KINGS HIGHWAY
 BROOKLYN, N.Y. 11234
 TEL. (718) 251-8060 FAX (718) 531-2564

no	date	by	description
A	08.01.06		UPDATED FOR 2004 FBC
B	12.20.06		REV. PER BCCO COMMENTS
C	11.18.08		NO CHANGE THIS SHEET


date: 01-14-05
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W05-03
 sheet 3 of 5


ITEM #	PART NO.	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	-	1	FRAME HEAD	WOOD	-
2	-	1	FRAME SILL	WOOD	-
3	-	2	FRAME JAMB	WOOD	-
4	-	1	TOP SASH TOP RAIL	WOOD	-
5	-	1	TOP SASH BOTTOM RAIL	WOOD	-
6	-	1	BOTTOM SASH TOP RAIL	WOOD	-
7	-	1	BOTTOM SASH BOTTOM RAIL	WOOD	-
8	-	2	SASH JAMB	WOOD	-
9	-	AS REQD.	GLAZING STOP	WOOD	-
10	-	AS REQD.	SASH STOP AT EXTERIOR	WOOD	-
11	-	AS REQD.	BULB GASKET 9/32" DIA.	FLEXIBLE VINYL	-
12	-	AS REQD.	# 8 X 2" WOOD SCREWS	-	⊙ 10" O.C.
13	-	1	DRIP CAP	WOOD	-
14	-	1	MTG. RAIL STRIP	WOOD	-
15	-	1	MTG. RAIL STRIP	WOOD	-
16	-	AS REQD.	SASH STOP INTERIOR	WOOD	⊙ 8" O.C.
17	NO. 6CHX	2	JAMB WEATHERSTRIPPING	BRONZE	ACCURATE
19	NO. 6CHX	1	FRAME HEAD WEATHERSTRIPPING	BRONZE	ACCURATE
20	NO. 3X	1	FRAME SILL WEATHERSTRIPPING	BRONZE	ACCURATE
21	NO. 46-59921	1	CHECK RAIL W'STRIPPING	EPDM	VARNAME
22	NO. AWD-102	2	SASH LOCK AT 15" FROM ENDS ON INT. MTG. RAIL	-	BRONZE CRAFT
23	NO. AWD-100-1	2	SASH LOCK KEEPER ALLIGNED WITH LOCKS ON EXT. MTG. RAIL	-	BRONZE CRAFT
24	NO. 26	2	SASH LIFT	-	BRONZE CRAFT
25	-	1	SASH STOP EXTERIOR	WOOD	-
26	-	1	SASH STOP SILL	WOOD	-
27	-	1	SILL NOSING	WOOD	-
28	-	AS REQD.	BRICK MOULDING (HEAD)	WOOD	-
29	-	AS REQD.	BRICK MOULDING JAMB (OPTIONAL)	WOOD	-

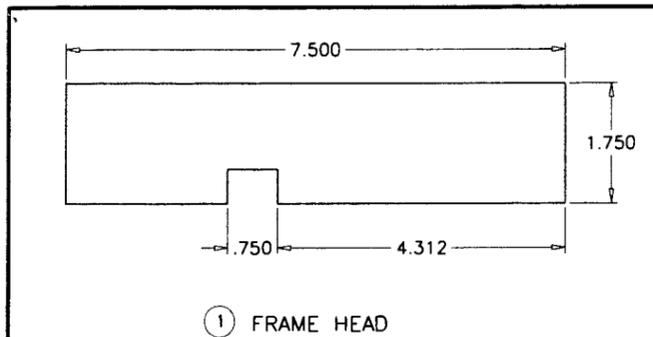


① FRAME HEAD

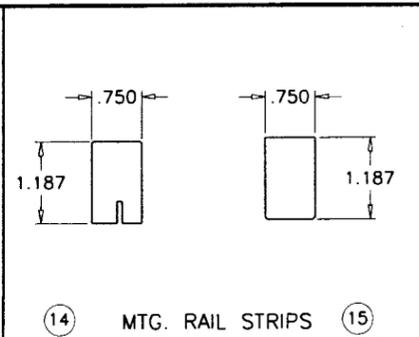


⑭ MTG. RAIL STRIPS ⑮

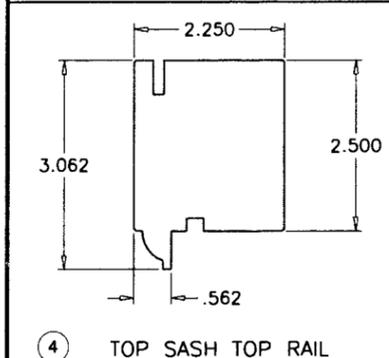


④ TOP SASH TOP RAIL

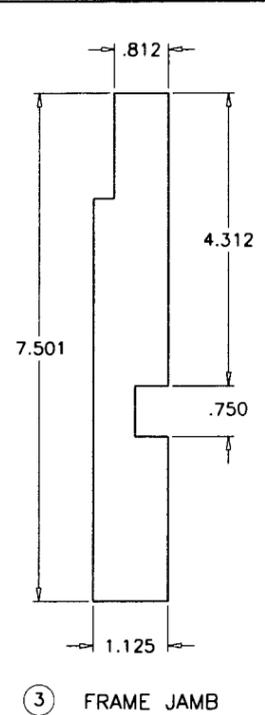


③ FRAME JAMB

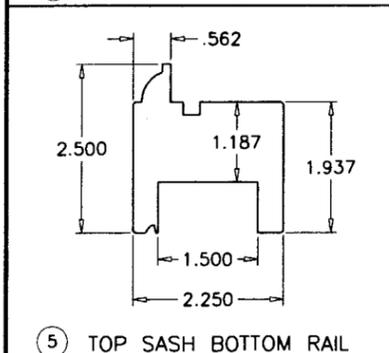


⑤ TOP SASH BOTTOM RAIL

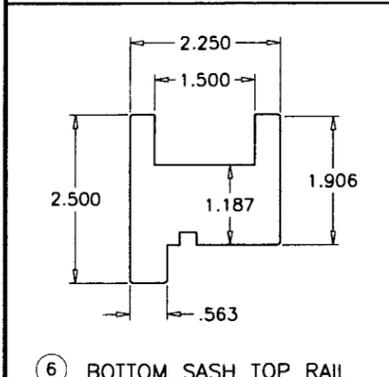


⑥ BOTTOM SASH TOP RAIL

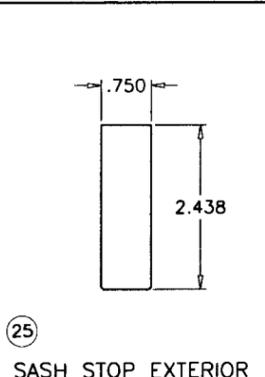


⑫ SASH STOP EXTERIOR

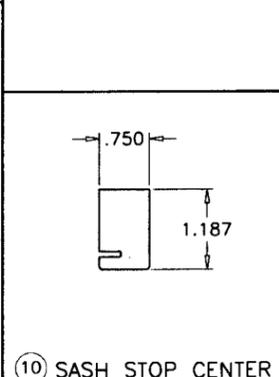


⑩ SASH STOP CENTER

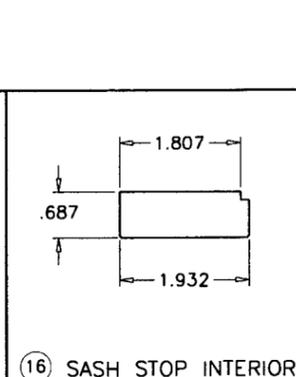


⑬ SASH STOP INTERIOR

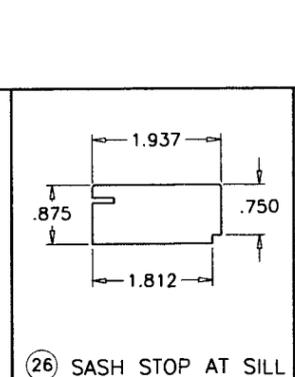


⑭ SASH STOP AT SILL

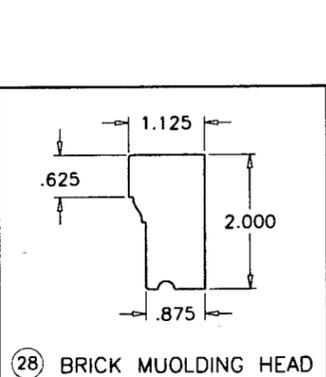


⑮ BRICK MUOLDING HEAD

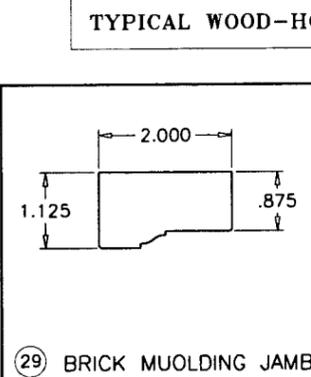


⑯ BRICK MUOLDING JAMB

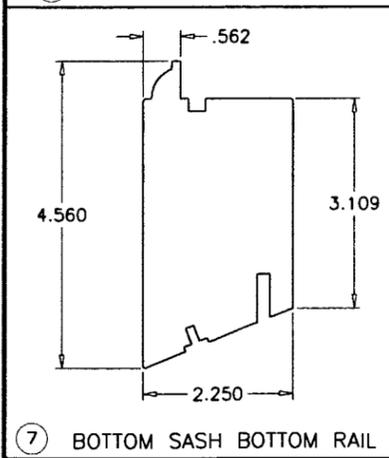


⑦ BOTTOM SASH BOTTOM RAIL

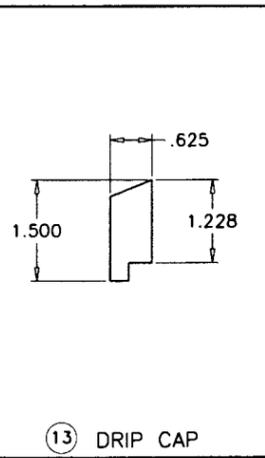

⑬ DRIP CAP

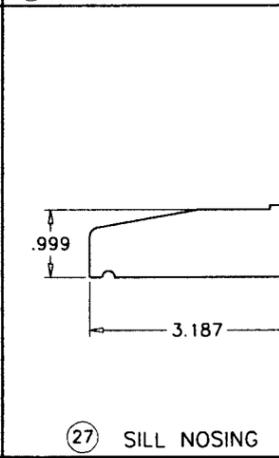

⑰ SILL NOSING

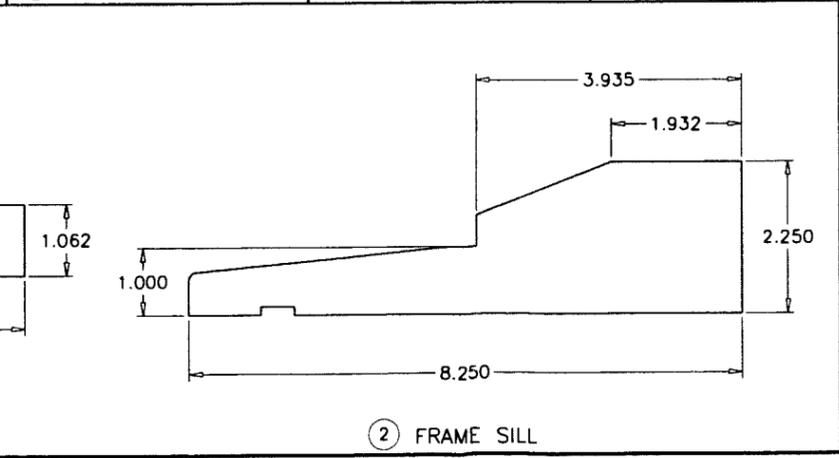

② FRAME SILL

TYPICAL WOOD-HONDURES MAHOGANY LUMBER

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
OCT 14 2009


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-1709.03
Expiration Date MAY 5, 2015
By: *Manuel Perez*
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-03Z


SERIES W&C DOUBLE HUNG WOOD WINDOWS (L.M.I.)
ZELUCK INC.
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234
TEL. (718) 251-8060 FAX (718) 531-2564

no	date	by	description
A	08.01.06		NO CHANGE THIS SHEET
B	12.20.06		REV. PER BCCO COMMENTS
C	11.18.08		NO CHANGE THIS SHEET

date: 01-14-05
scale: 3/8" = 1"
dr. by: HAMID
chk. by:
drawing no. **W05-03**
sheet 4 of 5

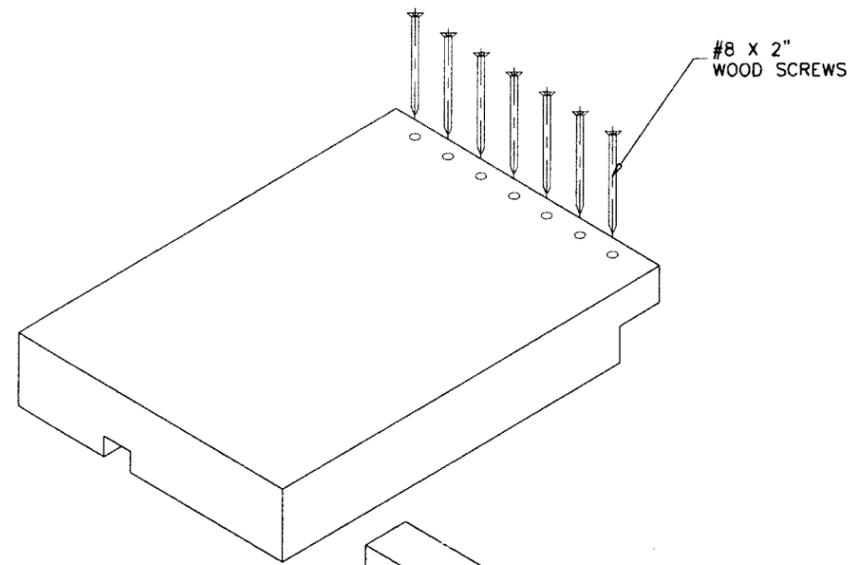


FRAME TOP CORNER

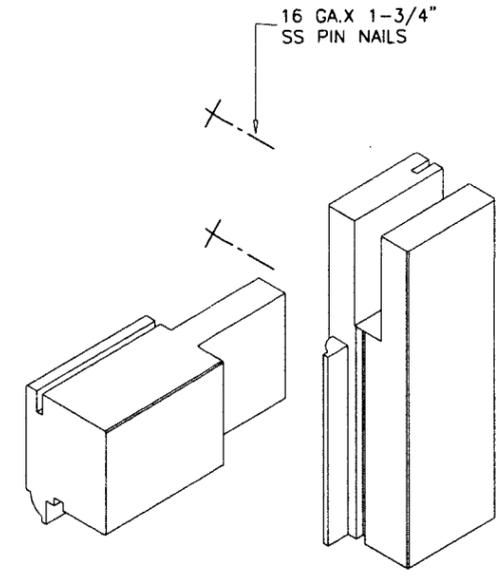


SASH TOP CORNER

FRAME AND VENT CORNERS SEALED/GLUED WITH 'PHENYL RESORCINOL' WATER PROOF ADHESIVE

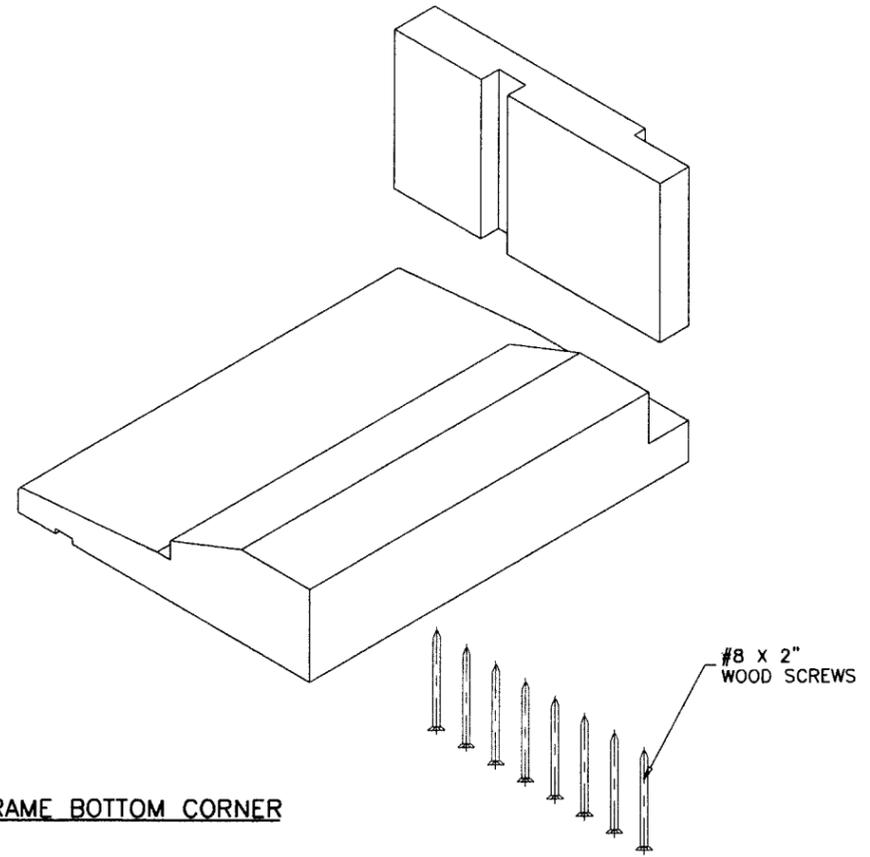

FRAME BOTTOM CORNER

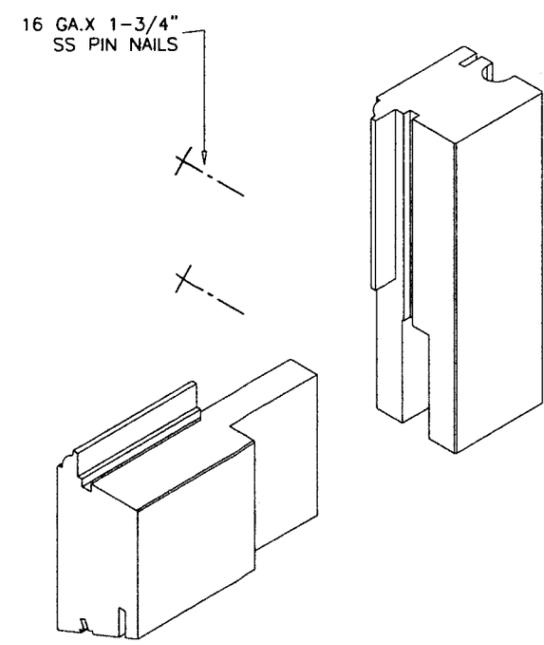

SASH BOTTOM CORNER

Engr: ARSHAD VIGAR
 CIVIL
 FLA. PE # 38863
 C.A.N. 3538
 OCT 14 2009

PRODUCT REVIEWED
 as complying with the Florida
 Building Code
 Adoption No. 09-1209-03
 Expiration Date MAY 5, 2015
 By: *Manuel Perez*
 Miami Basic Product Control
 Division

afc
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-03Z1

SERIES W&C DOUBLE HUNG WOOD WINDOWS (L.M.I.)
ZELUCK INC.
 5300 KINGS HIGHWAY
 BROOKLYN, N.Y. 11234
 TEL. (718) 251-8060 FAX (718) 531-2564

no	date	by	description
A	08.01.06		NO CHANGE THIS SHEET
B	12.20.06		NO CHANGE THIS SHEET
C	11.18.08		NO CHANGE THIS SHEET

date: 01-14-05
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W05-03
 sheet 5 of 5