



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

DAB Door Company, Inc.
12195 NW 98th Avenue
Hialeah Gardens, FL 33018

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Up to 14' Wide Steel Roll-up Door

APPROVAL DOCUMENT: Drawing No. **97-30**, titled "Rolling Type Garage Door", sheets 1 and 2, dated 07/30/97, with Revision G dated 10/29/08, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **renews NOA # 08-1106.06** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



Handwritten signature and date: 01/14/10

NOA No. 09-1210.03
Expiration Date: January 22, 2015
Approval Date: February 03, 2010
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **97-30**, titled "Rolling Type Garage Door", sheets 1 and 2, dated 07/30/97, with Revision G dated 10/29/08, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

B. TESTS

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Forced Entry Test, per SFBC 3603.2,
Along with marked-up drawings and installation diagram of a Roll-up Garage Door, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-09-2637**, dated 11/09/09, signed and sealed by Candido F. Font, P.E.
2. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
Along with marked-up drawings and installation diagram of a Roll-up Garage Door, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-09-2638**, dated 11/09/09, signed and sealed by Candido F. Font, P.E.
3. Test report on Tensile Test of 20 Gage Galvanized Steel per ASTM E 8-01, prepared by Hurricane Engineering & Testing, Inc, Test Report No. **HETI-09-T140**, dated on 11/09/09, signed and sealed by Candido F. Font, P.E.

C. CALCULATIONS "*Submitted under NOA # 08-1106.06*"

1. Calculations of 14' Rolling Steel Door, prepared by Al-Farooq Corporation, dated 10/17/08, signed and sealed by Humayoun Farooq, P.E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS


1. Statement letter of code conformance and no financial interest, prepared by Al-Farooq Corporation, dated 11/25/09, signed and sealed by Arshad Viqar, P.E.



01/14/10



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 09-1210.03

Expiration Date: January 22, 2015
Approval Date: February 03, 2010

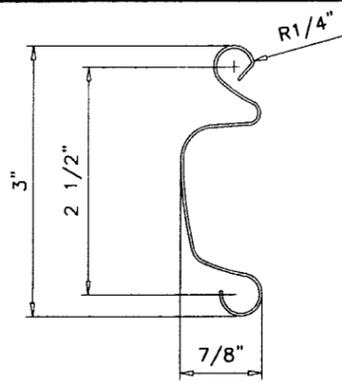


SLAT

20 GA. COLD FORMED STEEL (ASTM A446)
MIN. YIELD STRENGTH OF 50000 PSI
GALVANIZED ACCORDING TO ASTM A-525
WITH A COATING DESIGNATION OF G-90
EXTERIOR AND INTERIOR

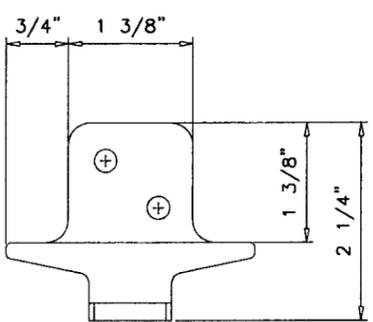


WIND LOCK


MALLEABLE IRON
WITH A GALVANIZED FINISH

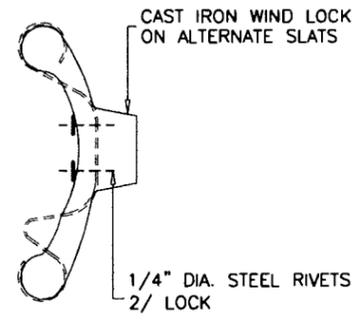


WIND LOCK DETAIL

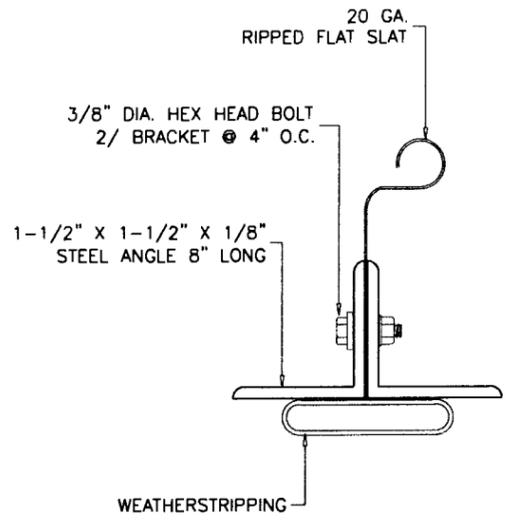

END BRACKET DETAIL

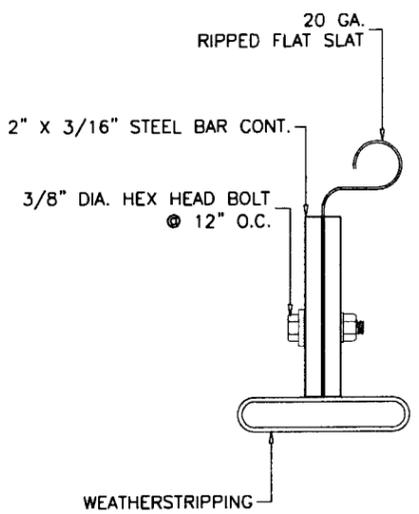

BOTTOM BAR DETAIL

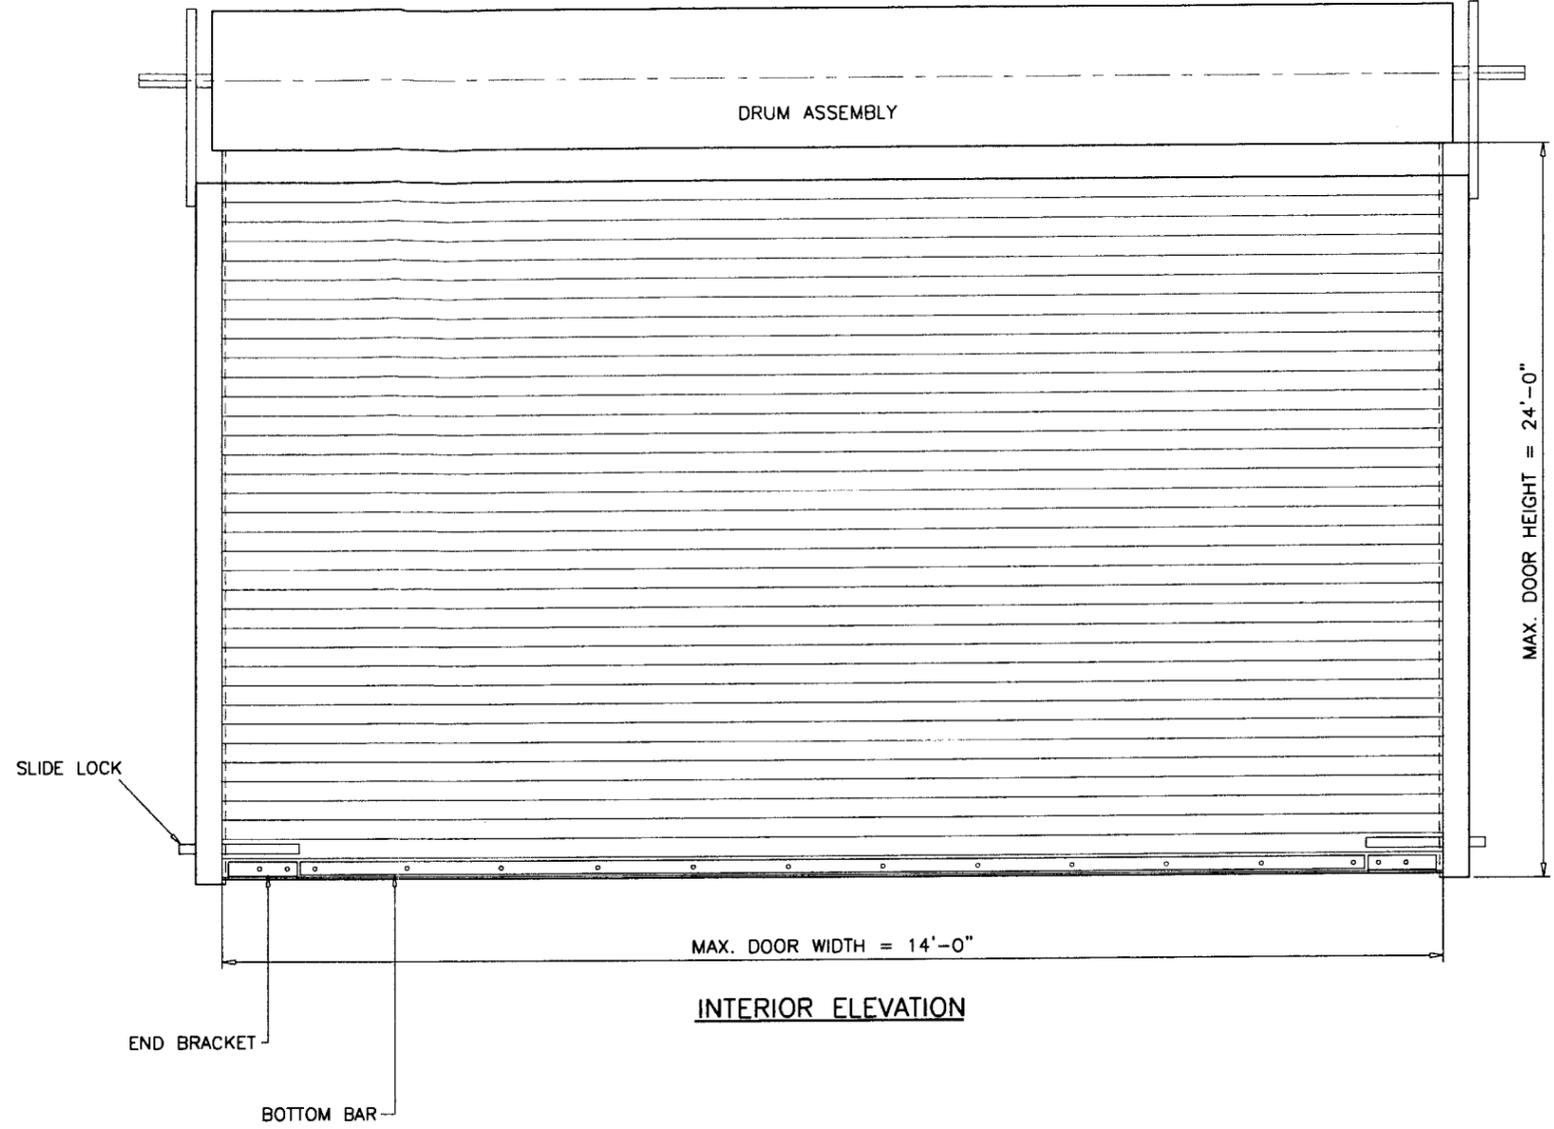

GENERAL NOTES

1. THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).
2. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
3. GUIDE AND WALL ANGLES SHALL CONFORM TO ASTM A-36.
4. ALL BOLTS, NUTS AND WASHERS SHALL BE ZINC PLATED CARBON STEEL.
5. ANCHORING OR LOADING CONDITIONS OTHER THAN THOSE SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
6. SLIDE BOLT (1/4" THICK LATCH) IS INSTALLED AT EACH END BOTTOM, AND SHALL BE ENGAGED DURING HURRICANE WINDS.
7. ALL WELDING TO CONFORM TO AWS LATEST REGULATIONS AND S.F.B.C. USE E70XX ELECTRODES AND 3/16" FILLET SIZE.

MAXIMUM DESIGN LOAD RATING = + 60.0 PSF
(FOR SIZES SHOWN OR SMALLER) - 60.0 PSF

THIS PRODUCT IS RATED FOR LARGE MISSILE IMPACT

Engr. ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N. 3538
Ar
NOV 30 2009

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 09-1210.03
Expiration Date 01/22/2015
By *[Signature]*
Miami Trade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
GARAGE\97-30DAB

ROLLING TYPE GARAGE DOOR
DAB DOORS INC.
12195 N.W. 98 TH. AVE.
HIALEAH GARDENS, FL. 33018
TEL. (305) 556 - 6624

revisions:	no	date	by	description
	C	11.18.97	H	GUIDE FORCES TABLE REV.
	D	12.19.97	H	GENERAL REVISION
	E	10.24.00	H	REV. PER BCCO COMMENTS
	F	07.26.02	H	BLK ANCH. AD. IMPACT REV.
	G	10.29.08	H	UPDATED FOR 2007 FBC

date: 07-30-97
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:
drawing no.
97-30
sheet 1 of 2

MAXIMUM DOOR WIDTH	BOLT SPACING-INCHES	
	UPTO 50 PSF	UPTO 60 PSF
10 FT.	12	12
12 FT.	12	11
14 FT.	12	9

1/2" DIA. MACHINE BOLTS
TAPPED IN 1/4" MIN. STEEL

MAXIMUM DOOR WIDTH	ANCHOR SPACING-INCHES		
	UPTO 40 PSF	UPTO 50 PSF	UPTO 60 PSF
10 FT.	12	12	8
12 FT.	12	7	5
14 FT.	8-1/2	5-1/2	4


1/2" DIA. KWIK BOLT II
2-1/4" MIN. EMBED.
4" MIN. EDGE DIST.
IN 3000 PSI CONC.

MAXIMUM DOOR WIDTH	WELD LENGTH INCHES
8-10 FT.	1"
12 FT.	1"
14 FT.	1-1/4"

WELD OPTION:
GUIDE ANGLE SECURED TO
MIN. 1/4" THICK STEEL STRUCTURE
WITH 3/16" WELD @ 12" O.C.

SCHEDULE 'A'


MAXIMUM DOOR WIDTH	SLIP INCHES
8-10 FT.	1/4"
12 FT.	3/8"
14 FT.	5/8"

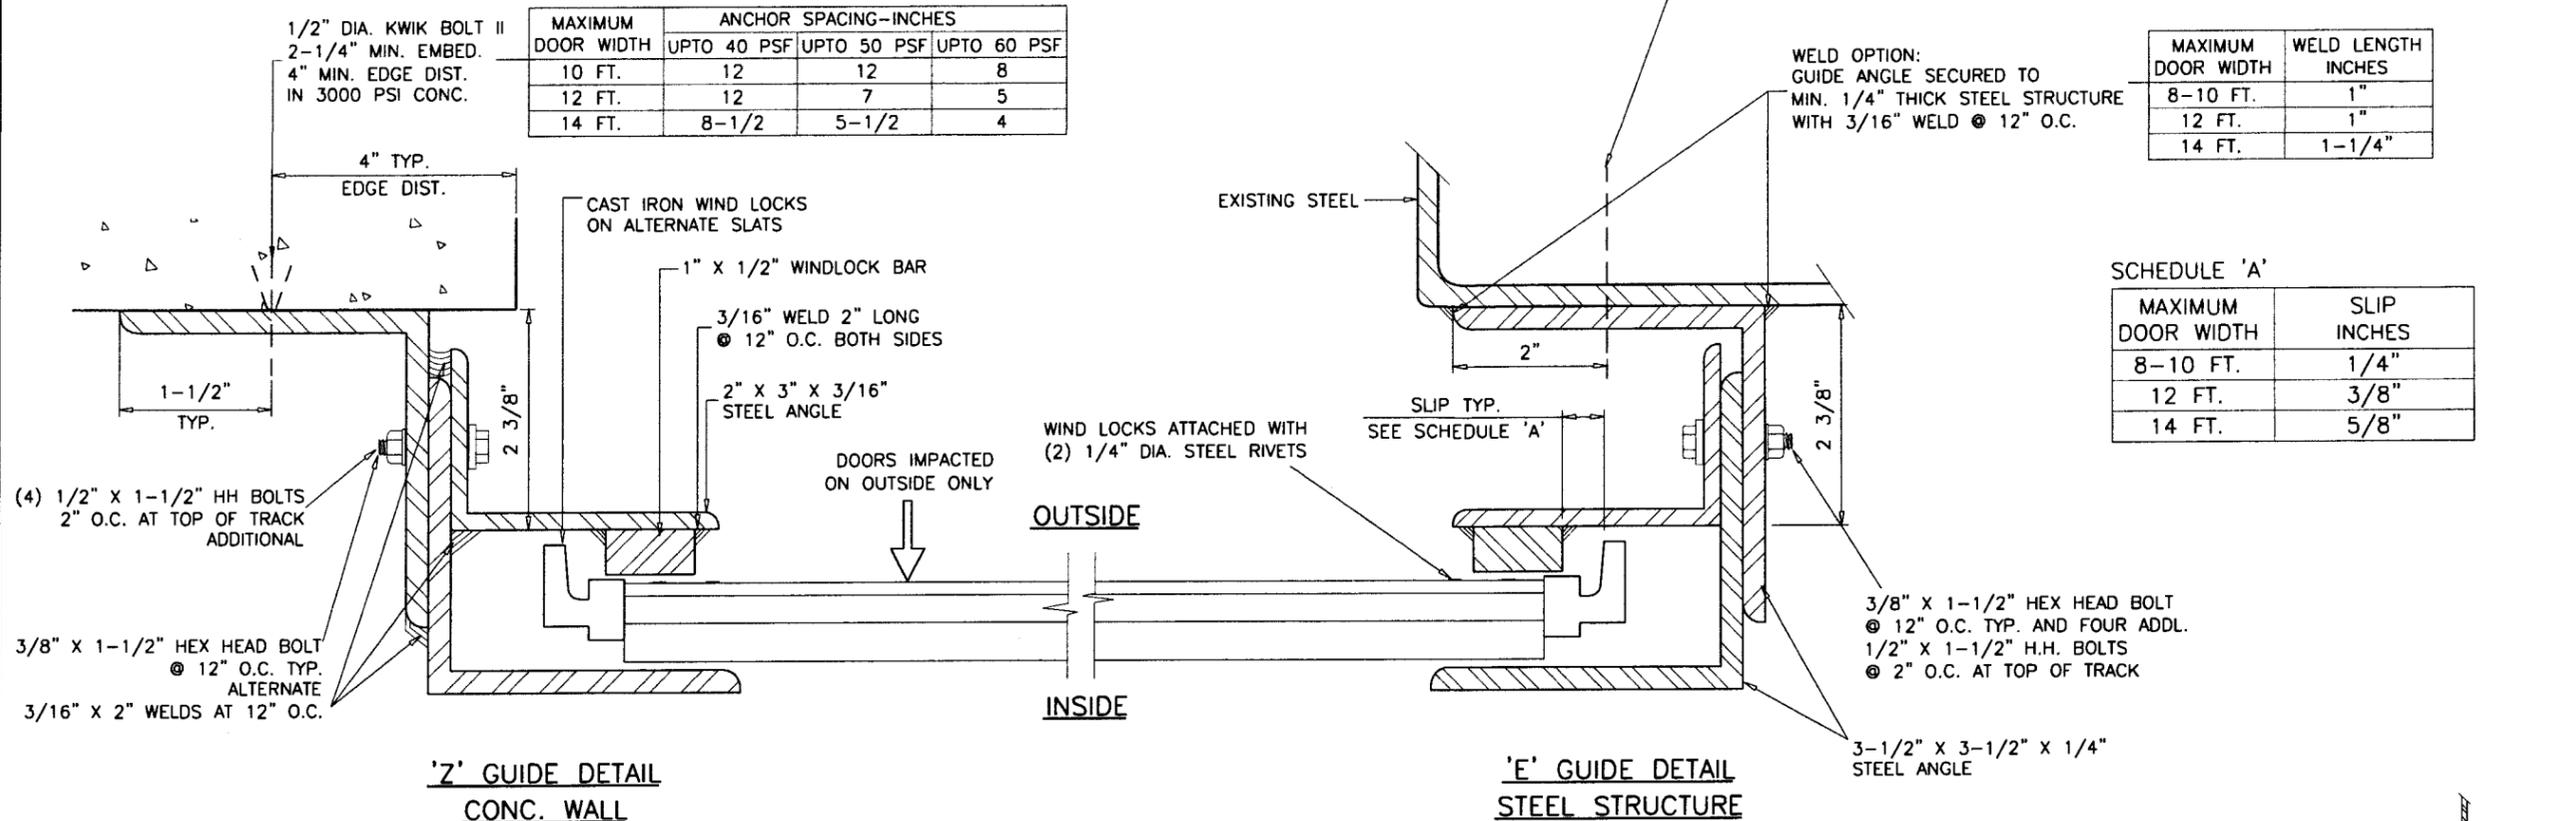

GUIDE DETAILS CAN BE USED
IN ANY COMBINATIONS.

SUPPORTING STRUCTURE MUST BE DESIGNED TO SUPPORT
SHEAR & TENSION FORCES AT EACH JAMB.
FOR DESIGN VALUES OF SHEAR & TENSION SEE SCHEDULE.
ARCH./ENGR. TO VERIFY ADEQUACY OF SUPPORTING STRUCTURE.

FORCES ON GUIDE/FT.		
MAXIMUM DOOR WIDTH	TENSION	SHEAR
10 FT.	320	744
12 FT.	380	1254
14 FT.	440	1419

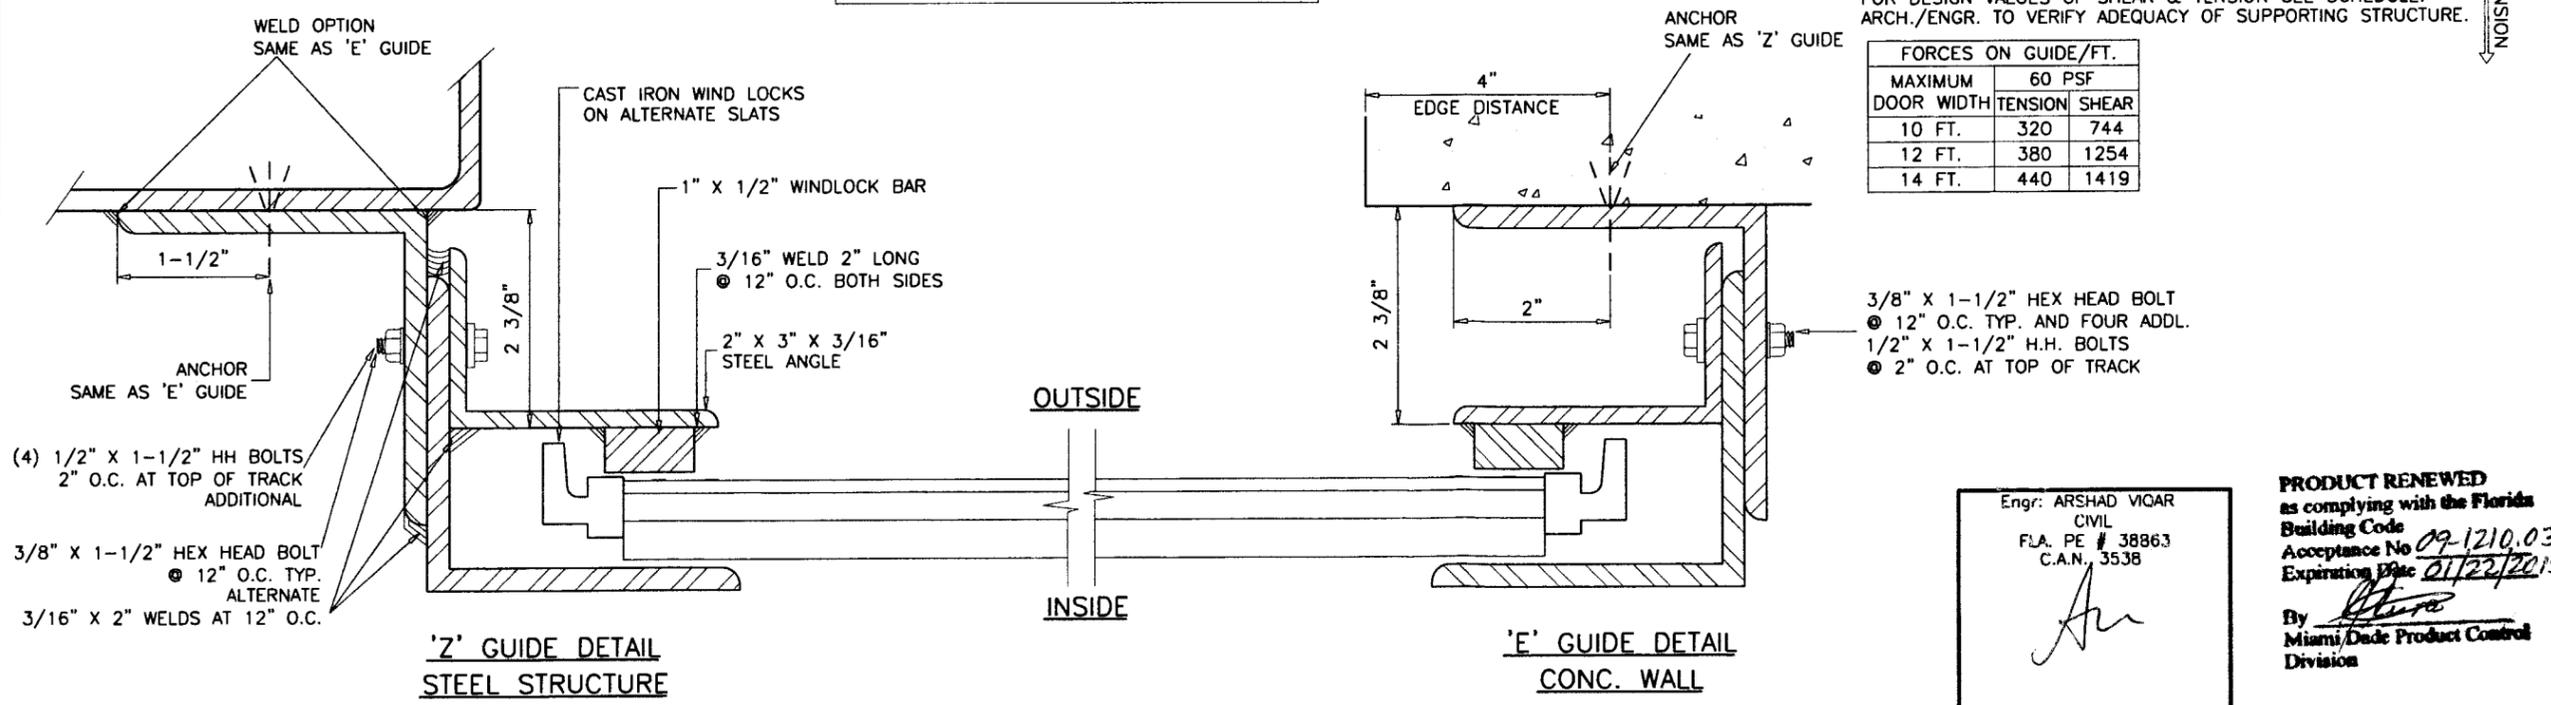

Engr: ARSHAD VIQAR
CIVIL
FLA. PE # 38863
C.A.N., 3538

NOV 30 2009

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 09-1210.03
Expiration Date 01/22/2015

By: *[Signature]*
Miami/Dade Product Control
Division

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
GARAGE\97-30DAB

ROLLING TYPE GARAGE DOOR
DAB DOORS INC.
12195 N.W. 98 TH. AVE.
HIALEAH GARDENS, FL. 33018
TEL. (305) 556 - 6624

revisions:	no	date	by	description

G 10.29.08
UPDATED FOR 2007 FBC

date: 07-30-97
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
97-30
sheet 2 of 2