



MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339
www.miamidade.gov/buildingcode

BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION
NOTICE OF ACCEPTANCE (NOA)

Sunshine Windows Manufacturing, Inc.
 1745 W. 33rd Place
 Hialeah, FL 33012

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 1650 Aluminum Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **HS08-01**, titled "Series 1650 Aluminum Horizontal Sliding Window (XO) Impact Resistant Glass", sheets 1 through 7 of 7, dated 03/14/08 with the latest revision dated 12/10/09, prepared by manufacturer, signed and sealed by Francisco Hernandez, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises NOA No. 08-0107.08** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 1/14/10

NOA No. 09-1217.04
 Expiration Date: April 10, 2013
 Approval Date: February 03, 2010
 Page 1

Sunshine Windows Manufacturing, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **HS08-01**, titled "Series 1650 Aluminum Horizontal Sliding Window (XO) Impact Resistant Glass", sheets 1 through 7 of 7, dated 03/14/08 with the latest revision dated 12/10/09, prepared by manufacturer, signed and sealed by Francisco Hernandez, P. E.

B. TESTS


1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of Aluminum Horizontal Sliding Window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5331**, dated 09/18/07, signed and sealed by Carlos S. Rionda, P. E.
(Submitted under previous NOA No. 08-0107.08)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of Aluminum Horizontal Sliding Window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5015**, dated 07/27/07, signed and sealed by Carlos S. Rionda, P. E.
(Submitted under previous NOA No. 08-0107.08)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Sunshine Windows Manufacturing, Inc., dated 12/15/07, signed and sealed by Francisco Hernandez, P. E.
Complies with ASTM E1300-02
(Submitted under previous NOA No. 08-0107.08)

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-1217.04
Expiration Date: April 10, 2013
Approval Date: February 03, 2010

Sunshine Windows Manufacturing, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 05/13/09, expiring on 12/11/10.

F. STATEMENTS

1. Statement letter of conformance, dated December 15, 2007, signed and sealed by Francisco Hernandez, P. E.
(Submitted under previous NOA No. 08-0107.08)
2. Statement letter of no financial interest, dated December 15, 2007, signed and sealed by Francisco Hernandez, P. E.
(Submitted under previous NOA No. 08-0107.08)
3. Laboratory compliance letter for Test Report No. **FTL-5331**, issued by Fenestration Testing Laboratory, Inc., dated September 21, 2007, signed and sealed by Carlos S. Rionda, P. E.
(Submitted under previous NOA No. 08-0107.08)
4. Laboratory compliance letter for Test Report No. **FTL-5015**, issued by Fenestration Testing Laboratory, Inc., dated August 07, 2007, signed and sealed by Carlos S. Rionda, P. E.
(Submitted under previous NOA No. 08-0107.08)


G. OTHERS

1. Notice of Acceptance No. **08-0107.08**, issued to Sunshine Windows Manufacturing, Inc., for their Series "1650 Aluminum Horizontal Sliding Window, approved on 04/10/08 and expiring on 04/10/136.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 09-1217.04
Expiration Date: April 10, 2013
Approval Date: February 03, 2010

DESIGN PRESSURE CHART - PSF								
SERIES 1650 ALUMINUM HORIZONTAL SLIDING WINDOW (XO)								
HEAT STRENGTHENED LAMINATED IMPACT RESISTANT GLASS								
WINDOW DIMENSION		ANCHOR SCHEDULE		HURRICANE PROTECTION IS NOT REQUIRED				
WIDTH	HEIGHT	PER HEAD & SILL	PER JAMB	1 3/4" SILL		3" SILL		
				EXT.	INT.	EXT.	INT.	
STANDARD SIZES	26 1/2"	26"	4	3	53.33	120.00	80.00	120.00
	37"		5		53.33	120.00	80.00	120.00
	53 1/8"		6		53.33	119.30	80.00	119.3
	74"		8		53.33	90.0	80.00	90.00
STANDARD SIZES	26 1/2"	38 3/8"	4	5	53.33	120.0	80.00	120.00
	37"		5		53.33	120.0	80.00	120.00
	53 1/8"		6		53.33	95.50	80.00	95.50
	74"		8		53.33	78.90	78.90	78.90
	37"	5	53.33	104.70	80.00	104.70		
	53 1/8"	50 5/8"	6	6	53.33	88.40	80.00	88.40
	74"	8	53.33		67.30	67.30	67.30	
	37"	5	53.33	88.20	80.00	88.20		
STANDARD SIZES	53 1/8"	63"	6	7	53.33	75.00	75.00	75.00
	74"		8		53.33	62.00	62.00	62.00
MODULAR SIZES	24"	24"	3	3	53.33	120.0	80.00	120.0
	36"		4		53.33	120.0	80.00	120.0
	48"		6		53.33	120.0	80.00	120.0
	60"		7		53.33	120.00	80.00	120.0
	72"		8		53.33	90.00	80.00	90.00
	24"	36"	3	4	53.33	120.00	80.00	120.0
	36"		4		53.33	120.00	80.00	120.0
	48"		6		53.33	120.00	80.00	120.0
	60"		7		53.33	99.90	80.00	99.90
	72"		8		53.33	88.60	80.00	88.60
	36"	48"	4	6	53.33	100.40	80.00	100.40
	48"		6		53.33	93.90	80.00	93.90
	60"		7		53.33	87.00	80.00	87.00
	72"		8		53.33	74.30	74.30	74.30
	36"	60"	4	7	53.33	90.00	80.00	90.00
	48"		6		53.33	87.00	80.0	87.00
60"	7		53.33		83.40	80.0	83.40	
72"	8		53.33		67.80	67.80	67.80	

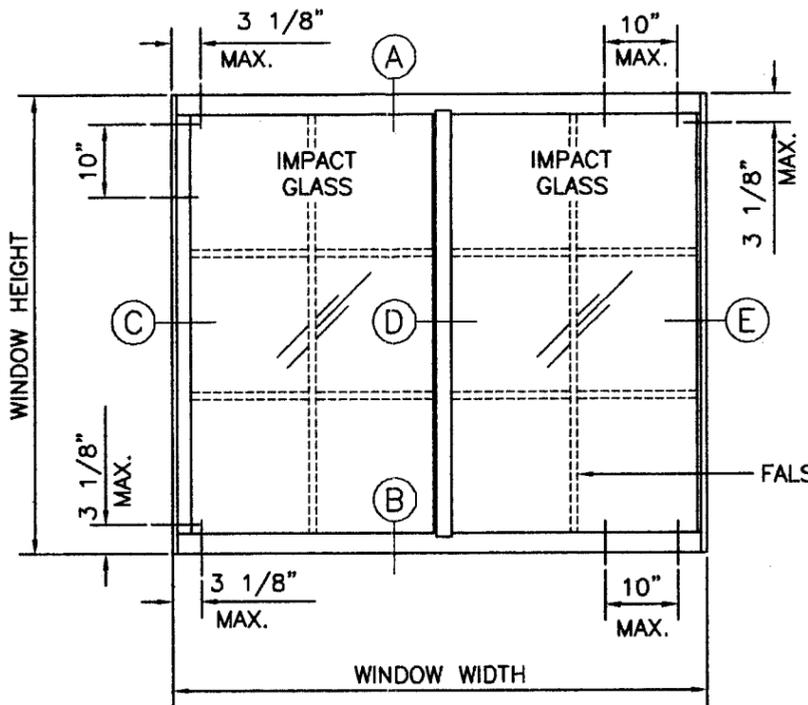

TYPICAL ELEVATION (XO)

- GENERAL NOTES: IMPACT HORIZONTAL ROLLER WINDOW.
- 1.- CONFIGURATIONS OX AND XO
 - 2.- FOR NUMBER OF ANCHORS FOR EACH UNIT SIZE REFER TO DESIGN PRESSURE CHART
 - 3.- REFERENCES: TEST REPORT FTL--5015
 - 4.- THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE
 - 5.- FASTENERS MUST HAVE THEIR OWN NOTICE OF ACCEPTANCE AND MUST BE MADE OF STAINLESS STEEL OR HAVE ADEQUATE PROTECTION AGAINST CORROSION, PER DIN 50018. ALUMINUM CONTACTING METALS SHALL BE PROPERLY PROTECTED.
 - 6.- GLAZING: 0.340" OVERALL LAMINATED GLASS USING TWO LITES OF 0.125" HEAT STRENGTHENED GLASS WITH A 0.090" INTERLAYER FILM DUPONT BUTACITE PVB, BETWEEN THE TWO LITES OF GLASS. LAMINATED BY TECNOGLASS OR SIMILAR

MIAMI-DADE IMPACT RESISTANT SHUTTERS ARE NOT REQUIRED

IMPACT RESISTANT WINDOW

Sunshine Windows Manufacturing, Inc.
 1745 W. 33rd Place
 Hialeah, Florida 33012
 Ph: (305)364-9952
 Fax:(305)828-5118

SERIES 1650 ALUMINUM HORIZONTAL SLIDING WINDOW (XO) IMPACT RESISTANT GLASS

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 09-1217-04
 Expiration Date 04/10/2013
 By *[Signature]*
 Miami Dade Product Control Division


[Signature]
 12-10-09

Drawn By: RF
 Date: 03-14-08
 Scale: 1/2"=1'
 Revision: 12-10-09
 Revision:

DRAWING NO. HS08-01

SHEET 1 OF 7

FRANCISCO HERNANDEZ
 FLORIDA PE # 51393




Sunshine Windows Manufacturing, Inc.
 1745 W. 33rd Place
 Hialeah, Florida 33012
 Ph: (305)364-9952
 Fax: (305)828-5118

**SERIES 1650 ALUMINUM
 HORIZONTAL SLIDING WINDOW (XO)
 IMPACT RESISTANT GLASS**

DESIGN PRESSURE CHART - PSF
SERIES 1650 ALUMINUM
HORIZONTAL SLIDING WINDOW (XO)
HEAT STRENGTHENED LAMINATED IMPACT RESISTANT GLASS

SIZES	WINDOW DIMENSION		ANCHOR SCHEDULE		HURRICANE PROTECTION IS NOT REQUIRED			
	WIDTH	HEIGHT	PER HEAD & SILL	PER JAMB	1 3/4" SILL		3" SILL	
					EXT.	INT.	EXT.	INT.
STANDARD	74"	38 3/8"	11	6	53.33	90.00	80.00	90.00
	74"	50 5/8"	11	8	53.33	90.00	80.00	90.00
	37"	63"	6	9	53.33	90.00	80.00	90.00
	53 1/8"		8		53.33	90.00	80.00	90.00
	74"		11		53.33	85.20	80.00	85.20
MODULAR	72"	48"	11	7	53.33	90.00	80.00	90.00
	48"	60"	7	9	53.33	90.00	80.00	90.00
	60"		9		53.33	90.00	80.00	90.00
	72"		11		53.33	90.00	80.00	90.00

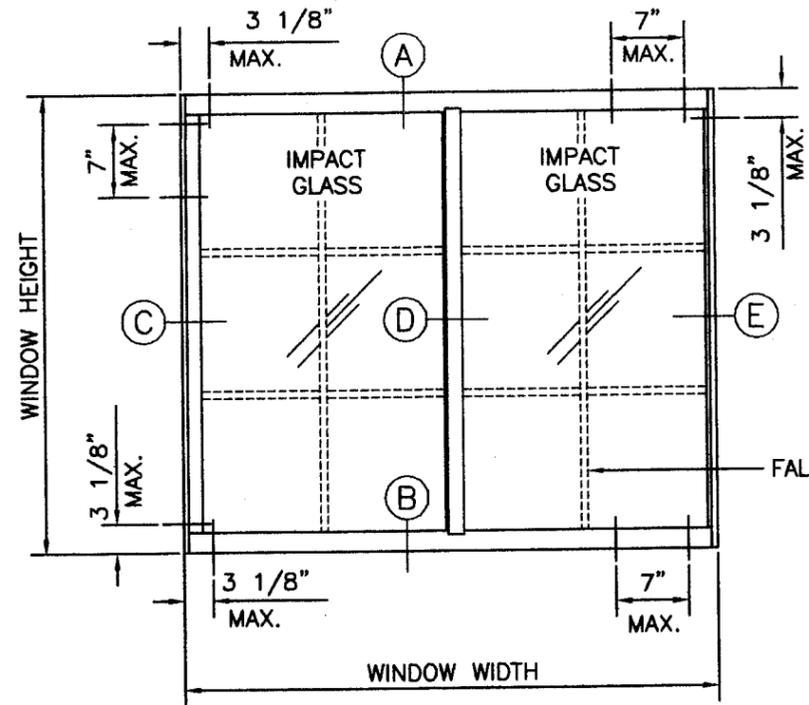

TYPICAL ELEVATION (XO)

GENERAL NOTES: IMPACT HORIZONTAL ROLLER WINDOW.

- 1.- CONFIGURATIONS OX AND XO
- 2.- FOR NUMBER OF ANCHORS FOR EACH UNIT SIZE REFER TO DESIGN PRESSURE CHART
- 3.- REFERENCES: TEST REPORT FTL-5331
- 4.- THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE
- 5.- FASTENERS MUST HAVE THEIR OWN NOTICE OF ACCEPTANCE AND MUST BE MADE OF STAINLESS STEEL OR HAVE ADEQUATE PROTECTION AGAINST CORROSION, PER DIN 50018. ALUMINUM CONTACTING METALS SHALL BE PROPERLY PROTECTED.
- 6.- GLAZING: 0.340" OVERALL LAMINATED GLASS USING TWO LITES OF 0.125" HEAT STRENGTHENED GLASS WITH A 0.090" INTERLAYER FILM DUPONT BUTACITE PVB, BETWEEN THE TWO LITES OF GLASS. LAMINATED BY TECNOGLASS OR SIMILAR

MIAMI- DADE IMPACT RESISTANT SHUTTERS ARE NOT REQUIRED

IMPACT RESISTANT WINDOW


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-1217.04
 Expiration Date 04/10/2013
 By *[Signature]*
 Miami Dade Product Control
 Division

[Signature]
 12-10-09
 FRANCISCO HERNANDEZ
 FLORIDA PE # 51393

Drawn By: RF
 Date: 03-14-08
 Scale: 1/2" = 1'
 Revision: 12-10-09
 Revision:


DRAWING NO.
 HS08-01

SHEET
 2 OF 7




Sunshine Windows
Manufacturing, Inc.
1745 W. 33rd Place
Hialeah, Florida 33012
Ph: (305)364-9952
Fax: (305)828-5118


SERIES 1650 ALUMINUM
HORIZONTAL SLIDING WINDOW (XO)
IMPACT RESISTANT GLASS

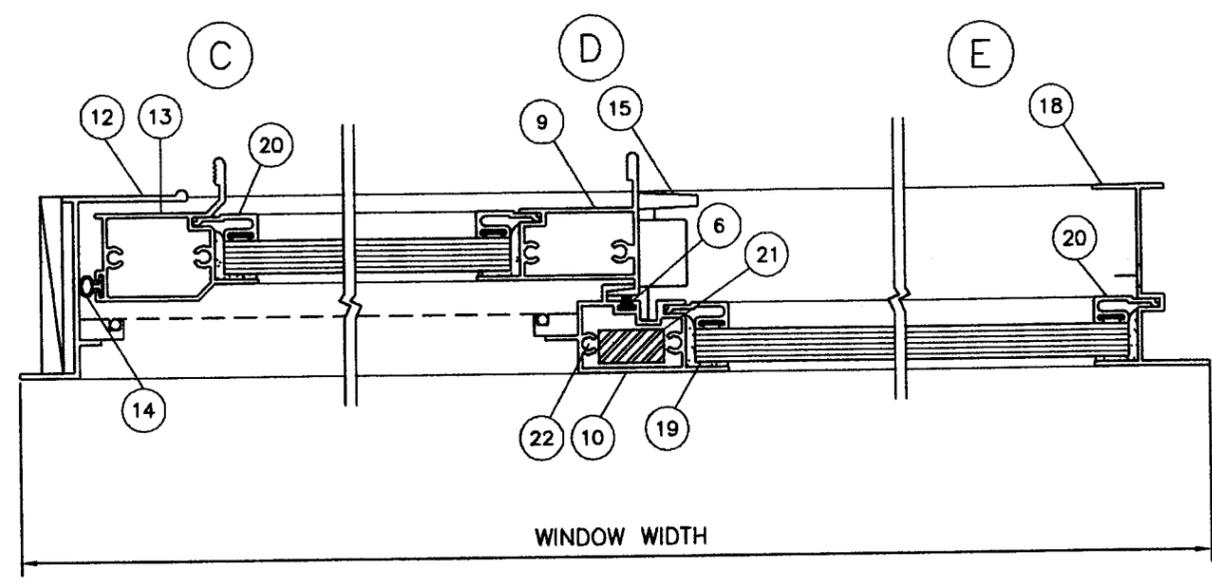

HORIZONTAL SECTION

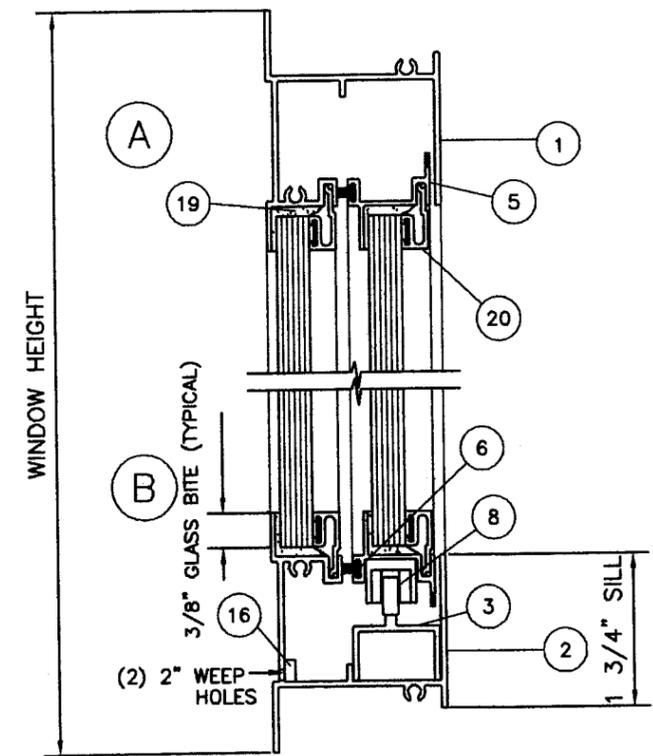

VERTICAL SECTION

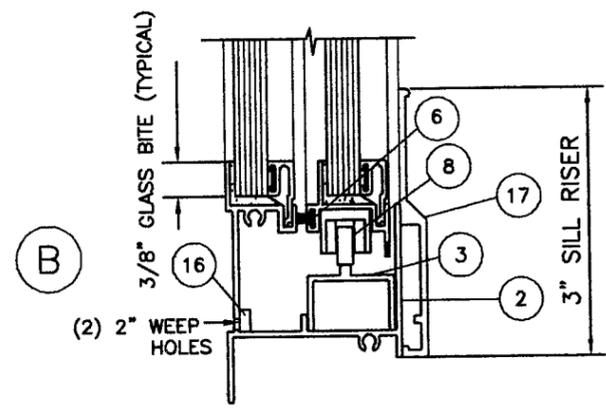

VERTICAL SECTION WITH SILL RISER

IMPACT RESISTANT WINDOW

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-1217.04
Expiration Date 02/10/2013
By *[Signature]*
Miami Dade Product Control
Division

[Signature]
12-10-09

FRANCISCO HERNANDEZ
FLORIDA PE # 51393

Drawn By: RF
Date: 03-14-08
Scale: 1/2" = 1'
Revision: 12-10-09

DRAWING NO.
HS08-01



SHEET
3 OF 7

MATERIAL LIST

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL
1	SW-019	1	FRAME HEAD	6063-T5
2	SW-019	1	FRAME SILL	6063-T5
3	SWxxx21	1	INSERT TRACK	6063-T5
5	SW-012	2	SLIDER TOP/BOTTOM RAIL	6063-T5
6	SW3019	AS RQD	FIN SEAL PILE	FELT
8	SW321W	2	WHEEL	BRASS
9	SW-017	1	MOVING MEETING RAIL	6063-T5
10	SW40111	1	FIXED MEETING RAIL	6063-T5
11	SW-AS	AS RQD	ASSEMBLY SCREWS	# 8 X 1" SMS.
12	SW-013	1	JAMB TO MOVING PANEL	6063-T5

MATERIAL LIST

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL
13	SW-016	1	MOVING SIDE RAIL	6063-T5
14	SW3257	AS RQD	WEATHER STRIP BULB	VINYL
15	SW-667	AS RQD	LATCH	ZINC
16	SW-S10	2/SILL	RETICULATED FILTER	FOAM
17	SW40771	1	SILL RISER	6063-T5
18	SW-014	1	JAMB TO FIXED PANEL	6063-T5
19	-	AS RQD	SILICONE	PEC.-895 OR SIMILAR
20	SW-101	AS RQD	IMPACT GLAZING BEAD	6063-T6
21	SW-STL	1	3/8" X 3/4" FLAT BAR	STEEL
22	SW-AS	4	ASSEMBLY SCREWS	# 8 X 2 1/2" SMS.

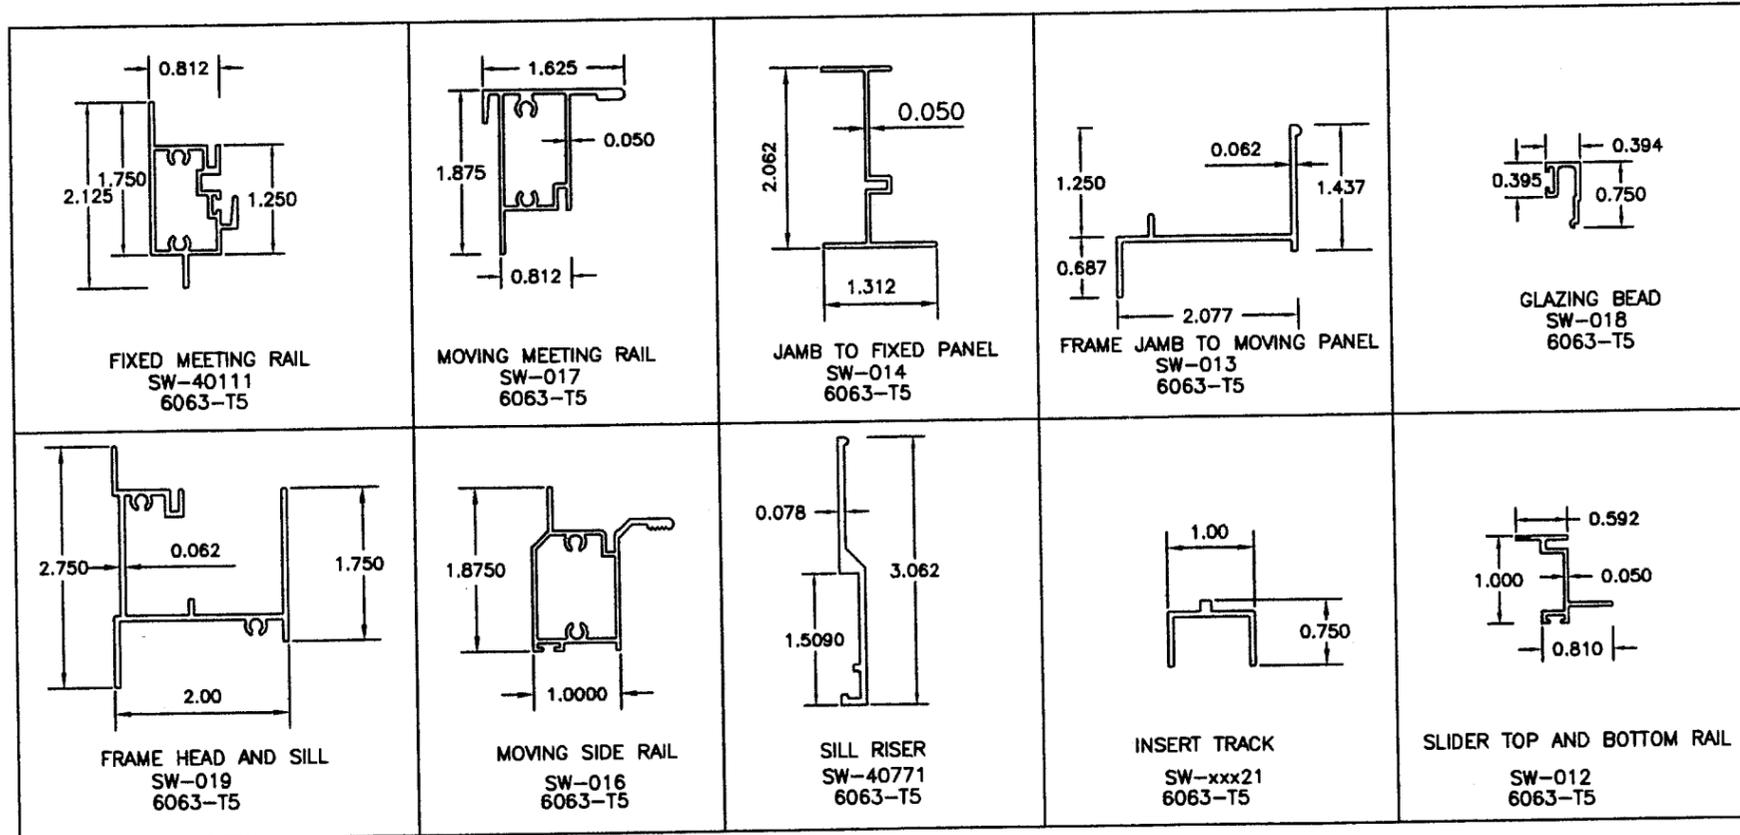

Sunshine Windows Manufacturing, Inc.
 1745 W. 33rd Place
 Hialeah, Florida 33012
 Ph: (305)364-9952
 Fax:(305)828-5118

SERIES 1650 ALUMINUM
 HORIZONTAL SLIDING WINDOW (XO)

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-1217.04
 Expiration Date 04/10/2013
 By: *[Signature]*
 Miami Dade Product Control
 Division


[Signature]
 12-10-09

FRANCISCO HERNANDEZ
 FLORIDA PE # 51393

Drawn By: RF
 Date: 03-14-08
 Scale: 1/2"=1"
 Revision: 12-10-09


DRAWING NO.
 HS08-01
 SHEET
 4 OF 7

IMPACT RESISTANT WINDOW

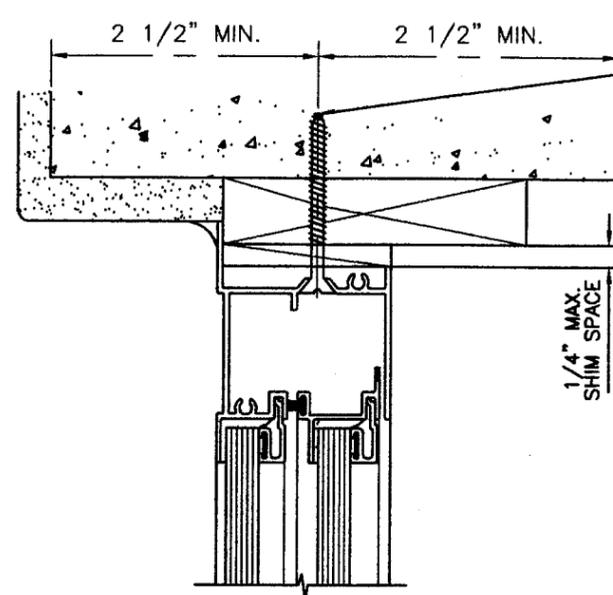


DETAIL A
ATTACHMENT TO MASONRY

TYPICAL ANCHORS
1/4" TAPCONS 1 1/4" MIN. EMBEDMENT INTO MASONRY THROUGH 1" BY WOOD BUCK (FOR MAX. ANCHOR SPACING AND NUMBER OF ANCHORS REFER TO DESIGN PRESSURE CHART)

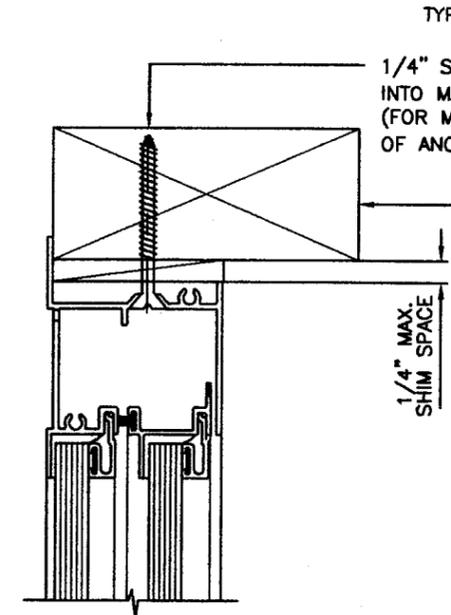

DETAIL B
ATTACHMENT TO WOOD

TYPICAL ANCHORS
1/4" SMS 1 1/2" MIN. PENETRATION INTO WOOD. INTO MASONRY THROUGH 1" BY WOOD BUCK (FOR MAX. ANCHOR SPACING AND NUMBER OF ANCHORS REFER TO DESIGN PRESSURE CHART)

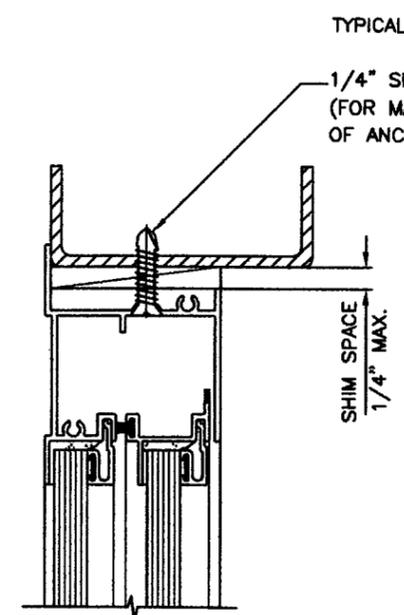

DETAIL C
ATTACHMENT TO METAL STRUCTURE DETAIL
(STEEL OR ALUMI. 1/8" MIN. THICKNESS)

TYPICAL ANCHORS
1/4" SMS. THROUGH METAL (FOR MAX. ANCHOR SPACING AND NUMBER OF ANCHORS REFER TO DESIGN PRESSURE CHART)

TYPICAL HEAD SECTIONS

IMPACT RESISTANT WINDOW

Sunshine Windows Manufacturing, Inc.
1745 W. 33rd Place
Hialeah, Florida 33012
Ph: (305)364-9952
Fax: (305)828-5118

SERIES 1650 ALUMINUM
HORIZONTAL SLIDING WINDOW (XO)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-127.04
Expiration Date 07/10/2013
By *Francisco Hernandez*
Miami Dade Product Control
Division


Francisco Hernandez
12-10-09

FRANCISCO HERNANDEZ
FLORIDA PE # 51393

Drawn By: RF
Date: 03-14-08
Scale: 1/2"=1'
Revision: 12-10-09


DRAWING NO.
HS08-01

SHEET
5 OF 7




Sunshine Windows
Manufacturing, Inc.
1745 W. 33rd Place
Hialeah, Florida 33012
Ph: (305)364-9952
Fax:(305)828-5118


SERIES 1650 ALUMINUM
HORIZONTAL SLIDING WINDOW (XO)

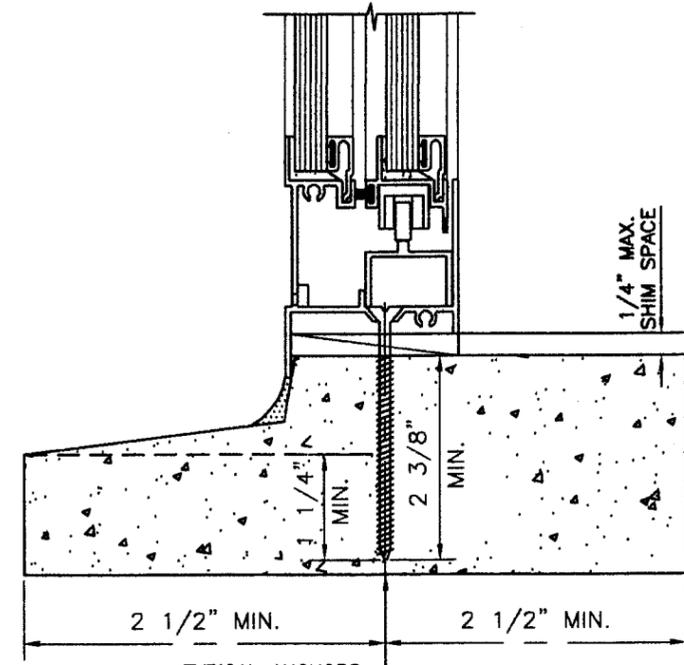

TYPICAL ANCHORS
1/4" TAPCONS 1 1/4" MIN. EMBEDMENT INTO MASONRY
(FOR MAX. ANCHOR SPACING AND NUMBER OF ANCHORS REFER TO DESIGN PRESSURE CHART)

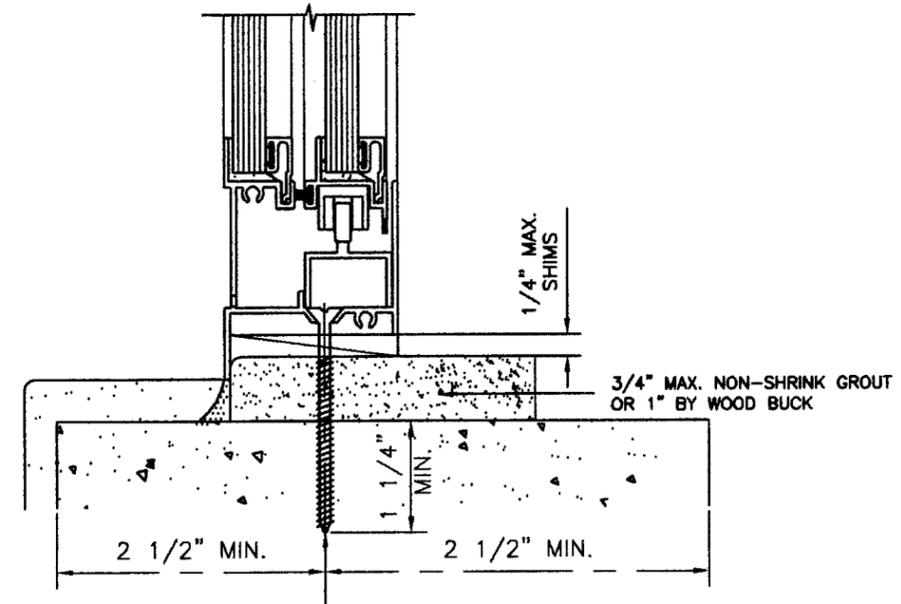


TYPICAL ANCHORS
1/4" TAPCONS 1 1/4" MIN. EMBEDMENT INTO MASONRY THROUGH 1" BY WOOD BUCK OR NON SHRINK NON METALLIC GROUT
(FOR MAX. ANCHOR SPACING AND NUMBER OF ANCHORS REFER TO DESIGN PRESSURE CHART)

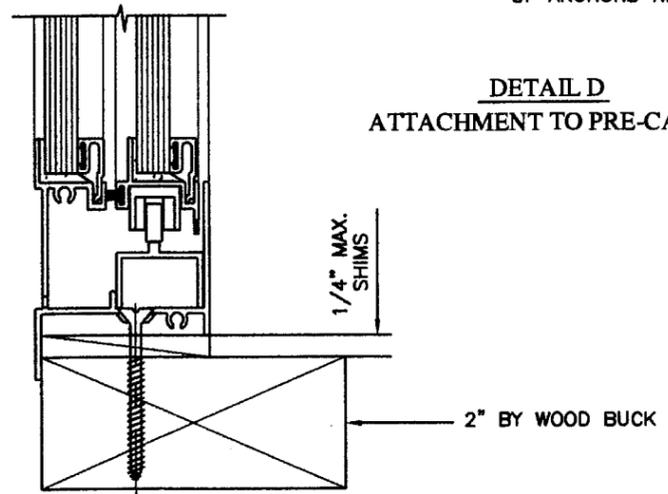

DETAIL D
ATTACHMENT TO PRE-CAST SILL

TYPICAL ANCHORS
1/4" SMS 1 1/2" MIN. PENETRATION INTO WOOD.
(FOR MAX. ANCHOR SPACING AND NUMBER OF ANCHORS REFER TO DESIGN PRESSURE CHART)

DETAIL F
ATTACHMENT TO WOOD

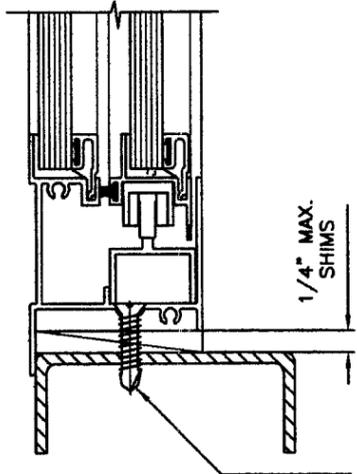

DETAIL E
ATTACHMENT TO MASONRY

TYPICAL ANCHORS
1/4" SMS THROUGH METAL.
(FOR MAX. ANCHOR SPACING AND NUMBER OF ANCHORS REFER TO DESIGN PRESSURE CHART)

DETAIL G
ATTACHMENT TO METAL STRUCTURE
(STEEL OR ALUM. 1/8" MIN. THICKNESS)

TYPICAL SILL SECTIONS
IMPACT RESISTANT WINDOW


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-1217.04
Expiration Date 04/10/2013
By *[Signature]*
Miami Dade Product Control
Division

[Signature]
12-10-09
FRANCISCO HERNANDEZ
FLORIDA PE # 51393


Drawn By: RF
Date: 03-14-08
Scale: 1/2"=1'
Revision: 12-10-09
Revision:

DRAWING NO.
HS08-01


SHEET
6 OF 7

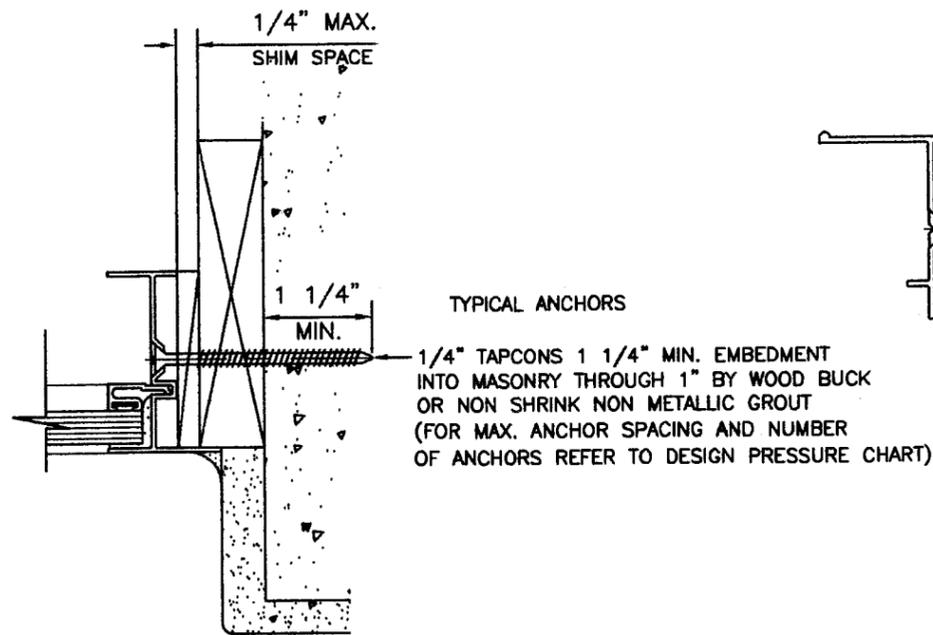


DETAIL H
ATTACHMENT TO MASONRY

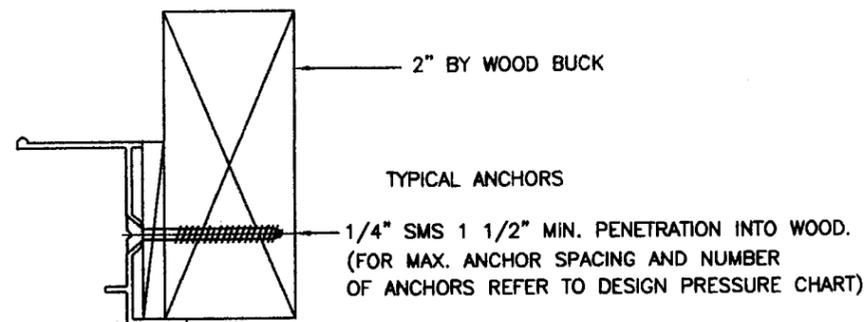

DETAIL I
ATTACHMENT TO WOOD DETAIL

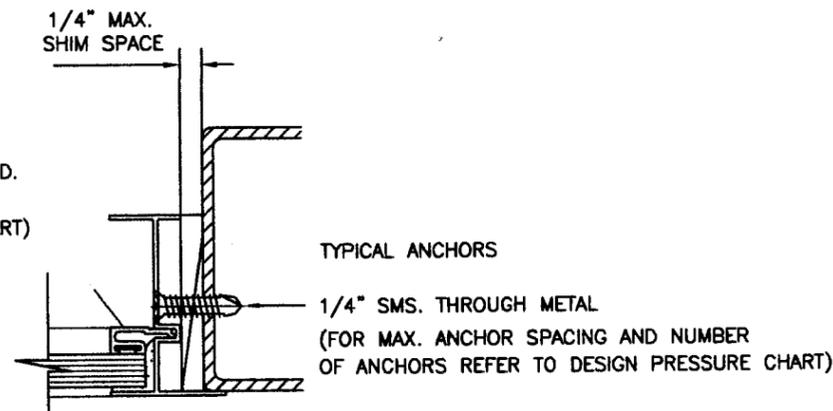


DETAIL J
ATTACHMENT TO METAL STRUCTURE DETAIL
(STEEL OR ALUM. 1/8" MIN. THICKNESS)

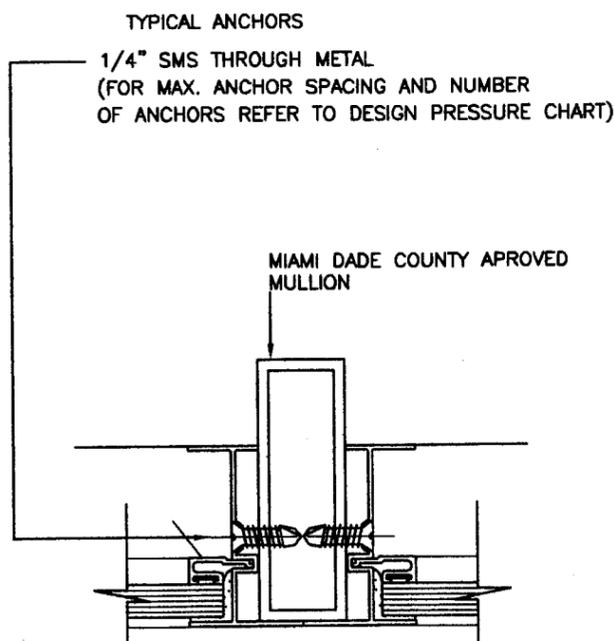

ATTACHMENT TO MULLIONS DETAIL


GLAZING DETAIL

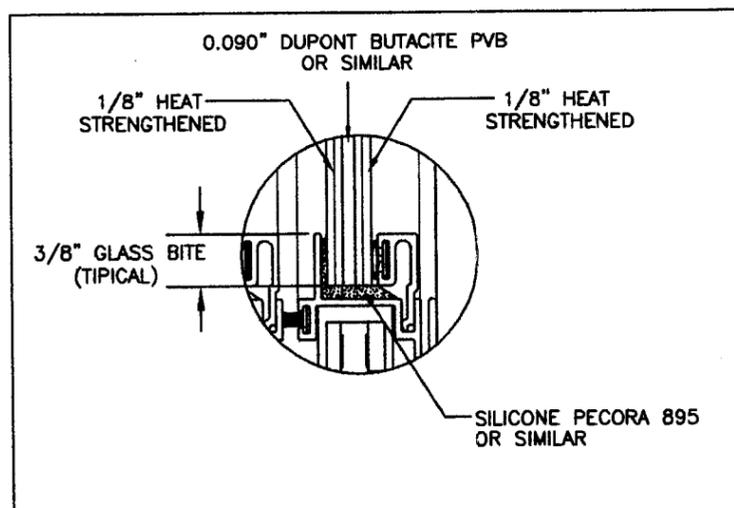

GLAZING: 0.340" OVERALL LAMINATED GLASS USING TWO LITES OF 0.125" HEAT STRENGTHENED GLASS WITH A 0.090" INTERLAYER FILM DUPONT BUTACITE PVB, BETWEEN THE TWO LITES OF GLASS. LAMINATED BY TECNOGLASS OR SIMILAR

TYPICAL JAMB SECTIONS

IMPACT RESISTANT WINDOW



Sunshine Windows Manufacturing, Inc.
1745 W. 33rd Place
Hialeah, Florida 33012
Ph: (305)364-9952
Fax:(305)828-5118

SERIES 1650 ALUMINUM
HORIZONTAL SLIDING WINDOW (XO)

PRODUCT REVISED
in complying with the Florida
Building Code
Acceptance No. 09-1217-04
Expiration Date 04/10/2013
By [Signature]
Miami Dade Product Control
Division

[Signature]
12-10-09

FRANCISCO HERNANDEZ
FLORIDA PE # 51393

Drawn By: RF
Date: 03-14-08
Scale: 1/2"=1'
Revision: 12-10-09
Revision:

DRAWING NO.
HS08-01

SHEET
7 OF 7