



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Kawneer Company, Inc.
555 Guthridge Court
Norcross, Georgia 30092

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "HPX" Aluminum Sliding Glass Door – L.M.I.

APPROVAL DOCUMENT: Drawing No. **03-KAW-0938**, titled "HPX-Sliding Glass Door", sheets 1 through 7 of 7, prepared by Engineering Express, dated 06/14/05 and last revised on 01/13/2009, signed and sealed by Frank L. Bennardo, P. E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitation: 1. Site specific conditions, other than NOA conditions in HVHZ will require one time product approval from Miami-Dade County.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 09-0121.05** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
2/25/10

NOA No 10-0202.02
Expiration Date: February 24, 2015
Approval Date: March 17, 2010
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **03-KAW-0938**, titled "HPX-Sliding Glass Door", sheets 1 through 7 of 7, prepared by Engineering Express, dated 06/14/05 and last revised on 01/13/2009, signed and sealed by Frank L. Bennardo, P. E.
(Submitted under previous NOA No.09-0121.05)

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
 - 5) Large Missile impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of aluminum sliding glass door, prepared by American Test Lab., Inc., Test Report No. **ATLNC 1021.01-03**, dated 01/14/04, signed and sealed by William F. Wescott, P. E.
(Submitted under previous NOA No.05-0707.02)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, dated 06/01/05, prepared, signed and sealed by Frank L. Bennardo, P. E.
Complies with ASTM E1300-02/ 04
(Submitted under previous NOA No.09-0121.05)

D. QUALITY ASSURANCE BY:

1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.

F. STATEMENTS

1. Statement letter of conformance to FBC 2007, dated January 14, 2009, prepared, signed and sealed by Frank L. Bennardo, P. E.
(Submitted under previous NOA No.09-0121.05)
2. Statement letters of conformance to FBC 2004 and "No financial interest", both dated July 01, 2005, signed and sealed by Frank L. Bennardo, P. E.
(Submitted under previous NOA No.05-0707.02)



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No 10-0202.02

Expiration Date: February 24, 2015
Approval Date: March 17, 2010

Kawneer Company, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

3. Laboratory addendum letters for Test Report No. ATLNC 1021.01-03, issued by American Test Lab., Inc., dated August 12, 2004, September 15, 2004 and February 03, 2005, all signed and sealed by William F. Wescott, P. E.
(Submitted under previous NOA No.04-0506.02)
4. Laboratory compliance letter for Test Report No. ATLNC 1021.01-03, issued by American Test Lab., Inc., dated January 14, 2004, signed and sealed by William F. Wescott, P. E.
(Submitted under previous NOA No.04-0506.02)

D. OTHERS

1. Notice of Acceptance No. **09-0121.05**, issued to Kawneer Company, Inc. for their Series **"HPX Aluminum Sliding Glass Door – L.M.I."**, approved on 03/04/09 and expiring on 02/24/10.



Jaime D. Gascon, P. E.

Chief, Product Control Division

NOA No 10-0202.02

Expiration Date: February 24, 2015

Approval Date: March 17, 2010

01/13/2009 - 3:28pm rbartlett F:\01 Project Files\Kawneer (KAW)\2003 Jobs\03-0938-136 HPX Slider\03-0938-136_02b HPX Slider.dwg

KAWNEER HPX ALUMINUM SLIDING GLASS DOOR LARGE MISSILE IMPACT (OXO, XO, OX)




DESIGN PRESSURE = +100/- 125 PSF

GENERAL NOTES:

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE, FOR USE WITHIN THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201 / 202 / 203 & ASTM E1300-98 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. MULTIPLE UNITS MUST BE INSTALLED USING MIAMI-DADE COUNTY BCCO-APPROVED STRUCTURAL MULLIONS
5. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
6. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
7. ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, UNLESS NOTED OTHERWISE.
8. USE OF KEYHOLE WASHERS IS OPTIONAL IN CONJUNCTION WITH ANY MOUNTING CONDITION. WASHERED WINGNUTS SHALL HAVE 0.865" MINIMUM WASHER DIAMETER.
9. PANELS GLAZED WITH 9/16" LAMINATED GLASS ARE LARGE MISSILE IMPACT RESISTANT. NO PROTECTION REQUIRED FOR ANY INSTALLATION.
10. DOORS MAY HAVE TWO OR THREE PANELS IN OX, XO, OR OXO CONFIGURATIONS
11. EXTERIOR SEAM OF FRAME CORNERS SHALL BE SEALED WITH SILICONE.
12. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI. ALL 3/16"Ø OR 1/4"Ø POP RIVETS SHALL BE 5056-H32 ALUMINUM ALLOY OR STRONGER.
13. PLASTIC COMPONENTS USED WITHIN THE HVHZ MUST MEET ALL APPLICABLE FIRE/SMOKE/UV PERFORMANCE REQUIREMENTS AS SET FORTH IN THE ABOVE-NOTED BUILDING CODE.
14. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.

HARDWARE SCHEDULE

- (A) (2) KAWNEER 911-581 STAINLESS STEEL A.R. MS1847 LOCKS WITH 089-410/089-411 STRIKE PACKAGE.
- (B) (2) KAWNEER 590-411 STAINLESS STEEL TANDEM CASTER ASSEMBLIES
- (C) (2) 1"W X .75"H WEEP SLOTS PER FIXED PANEL - ONE AT EACH END OF FIXED SILL TRACK FILLERS.
- (D) 3"W X 3/8"H WEEP SLOTS IN SILL ANTI-BLOWOUT ADAPTER
 - (3) FOR OX OR XO CONFIG
 - (5) FOR OXO CONFIG

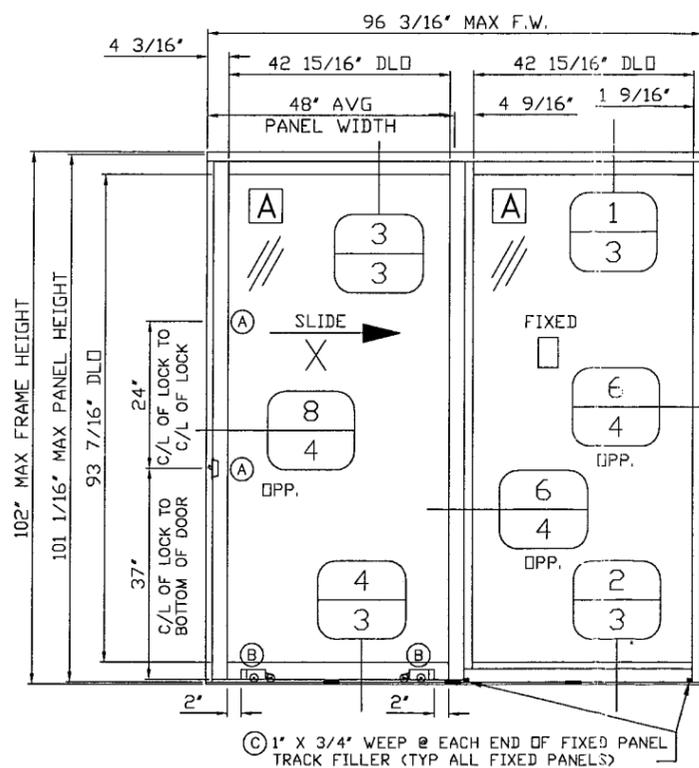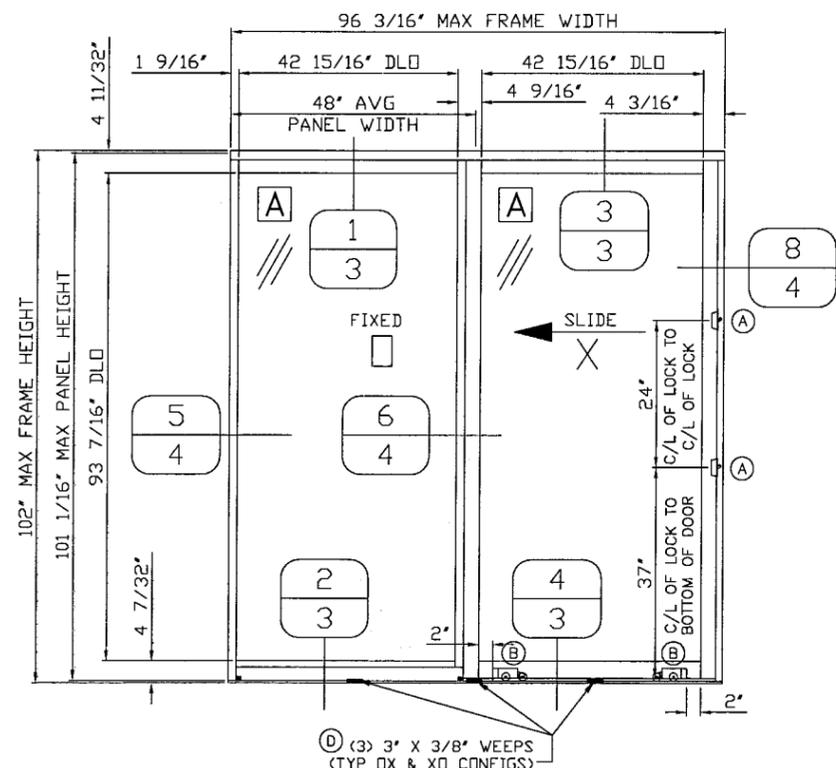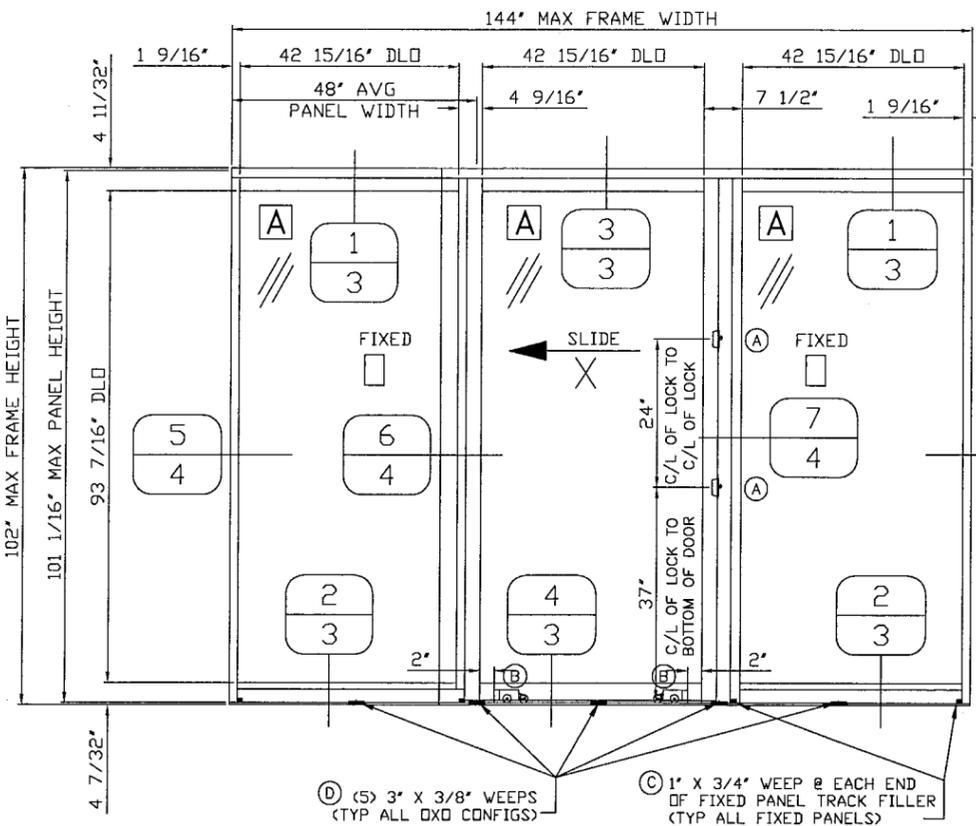

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 10-0202.02
Expiration Date 02/24/2015
By [Signature]
Miami Dade Product Control
Division

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0121.05
Expiration Date FEB 24, 2010
By [Signature]
Miami Dade Product Control
Division

GLAZING SCHEDULE

TYPE	NOMINAL THICKNESS	TYPICAL THICKNESS	DESCRIPTION
A	9/16"	.506"	1/4" HS OUTBOARD / 0.100" DUPONT SENTRY-GLAS PLUS® (SGP) PVB / 1/4" HS INBOARD

FRANK L. BENNARDO, P.E.
#PE0046549

01/13/2009

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGINEERINGEXPRESS.COM
CERT. OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

555 GUTHRIE COURT
NORCROSS, GEORGIA 30092
PHONE: (770) 449-5555
FAX: (770) 734-1560
KAWNEER
AN ALCOA COMPANY
HPX - SLIDING GLASS DOOR
9/16" LAMINATED GLASS - LARGE MISSILE IMPACT
PROTOCOLS-TAS 201/202/203 ASTM E1886/1996, SSTD 12-99

REMARKS	DRWN	CHKD	DATE
2004 FBC	CL	CL	06/14/05
2007 FBC	AML	CL	12/17/08

03-KAW-0938
SCALE: 02
PAGE DESCRIPTION:

1

01/13/2009



ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE: (770) 449-5555
FAX: (770) 734-1560
KAWNEER
AN ALCOA COMPANY
HPX - SLIDING GLASS DOOR
9/16" LAMINATED GLASS - LARGE MISSILE IMPACT
PROTOCOLS-TAS 201/202/203 ASTM E1886/1996, SSTD 12-99

REMARKS	DATE
2004 FBC	06/14/05
2007 FBC	12/17/08

03-KAW-0938
SCALE: 1/2"
PAGE DESCRIPTION:

2

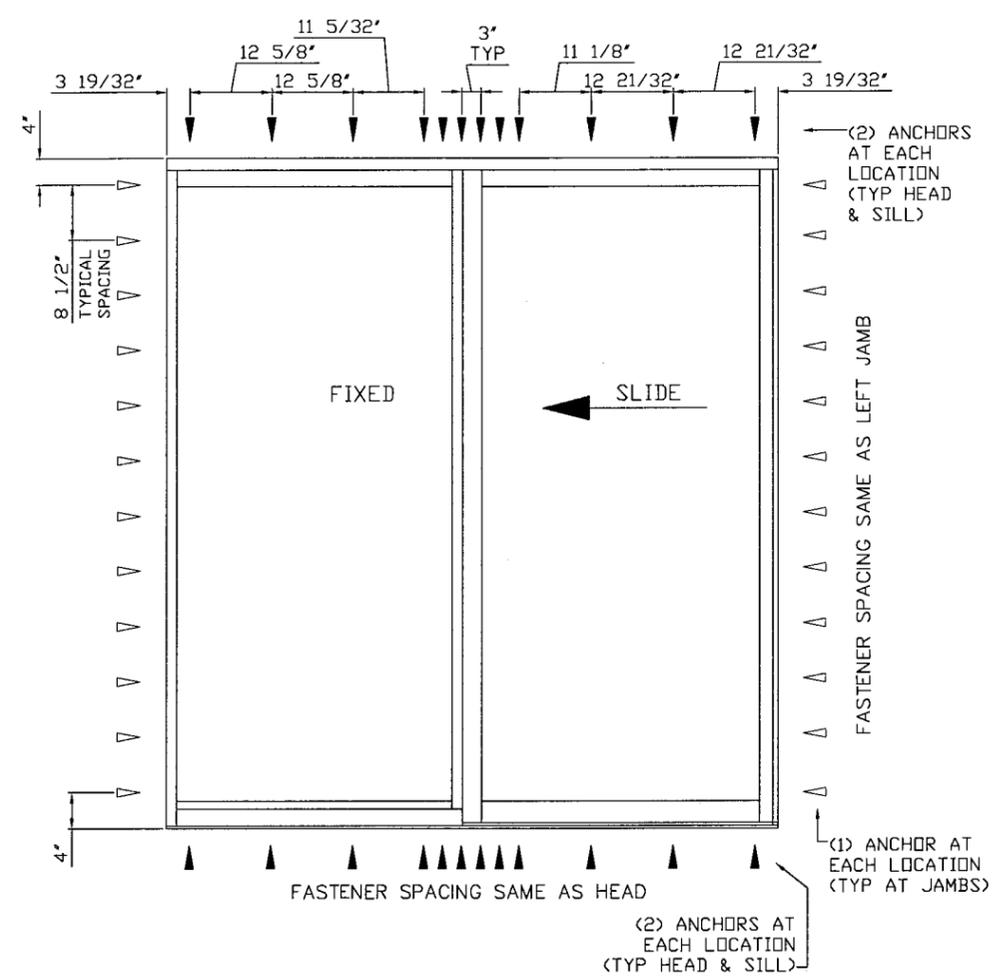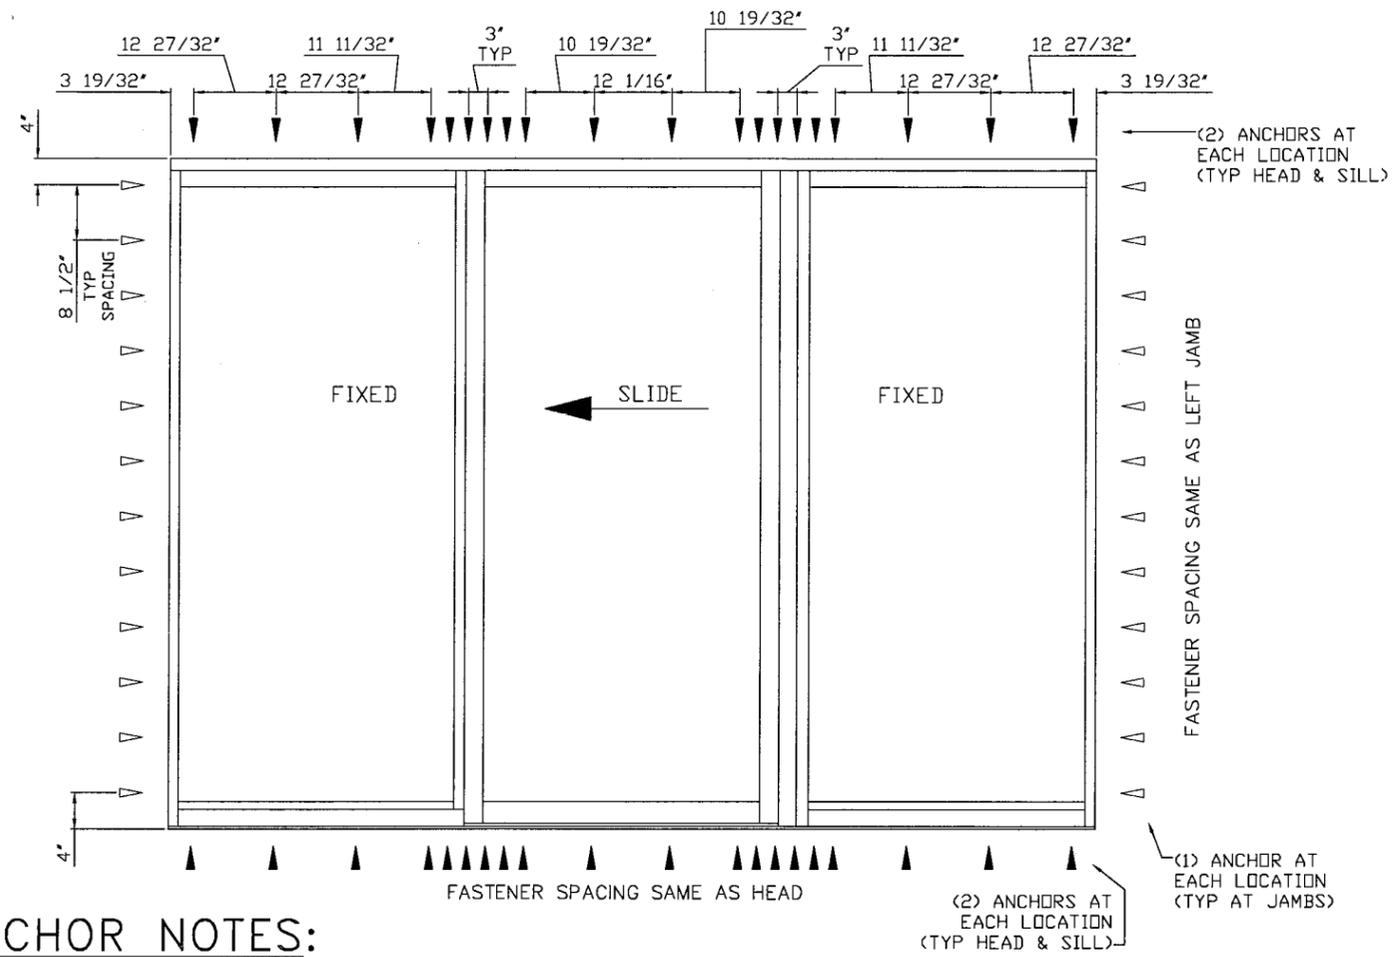

ANCHOR NOTES:

1. SEE EXTERIOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. TAPCONS SHALL BE MANUFACTURED BY ITW.
4. ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK. EDGE DISTANCE OF 3/4" IS ACCEPTABLE FOR ANCHORS TO STEEL OR ALUMINUM.
5. ENSURE 1-1/4" MIN EMBEDMENT TO HOLLOW BLOCK, 1-1/2" MIN EMBEDMENT TO CONCRETE OR TO WOOD, AND FULL THREAD ENGAGEMENT TO 1/8" MIN STEEL SUBSTRATE.
6. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD. 1" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING.
7. BASE SUBSTRATE MATERIAL SHALL BE CONCRETE BLOCK (ASTM C-90), CONCRETE (MIN 3192psi COMPRESSIVE STRENGTH), WOOD (SOUTHERN PINE W/ G=0.55 OR GREATER SPECIFIC GRAVITY), OR A36 STEEL (1/8" MIN THICKNESS).
8. MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
9. ANCHOR SCHEDULE APPLIES TO ALL PRODUCTS CERTIFIED HEREIN, BUT ONLY PROVIDES MAXIMUM ALLOWABLE ANCHOR SPACING.
10. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
11. MACHINE SCREWS SHALL BE INSTALLED WITH FULL ENGAGEMENT OF THREADS INTO METAL HOST STRUCTURE AND MAY HAVE EITHER A FLAT HEAD, PAN HEAD, TRUSS HEAD, OR OTHER HEAD STYLES.

PERIMETER FASTENER LOCATIONS

ALL SUBSTRATES

ALLOWABLE ANCHORS:

- HEAD:**
- 1/4" ITW TAPCON TO CONCRETE (WITH OR WITHOUT WOOD BUCK) OR TO WOOD.
 - #14 WOOD SCREW TO WOOD.
 - #14 SELF-TAPPING METAL SCREW (Fy=92ksi MIN) TO 1/8" MIN STEEL
- JAMBS:**
- 1/4" ITW TAPCON TO CONCRETE OR HOLLOW BLOCK (WITH OR WITHOUT WOOD BUCK) OR TO WOOD.
 - #14 WOOD SCREW TO WOOD.
 - #14 SELF-TAPPING METAL SCREW (Fy=92ksi MIN) TO 1/8" MIN STEEL
- SILL:**
- 1/4" ITW TAPCON TO CONCRETE (WITHOUT WOOD BUCK).


LEGEND:

- ▼ (2) ANCHORS PER LOCATION INDICATED ABOVE
- ▽ (1) ANCHOR PER LOCATION INDICATED ABOVE

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 10-0202.02
Expiration Date 02/24/2015
By [Signature]
Miami Dade Product Control
Division


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0121.05
Expiration Date FEB 24, 2010
By [Signature]
Miami Dade Product Control
Division

01/13/2009 - 3:28pm rbarlett F:\01 Project Files\Kawneer (KAW)\2003 Jobs\05-0938-136 HPX Slider\05-0938-136_02b HPX Slider.dwg

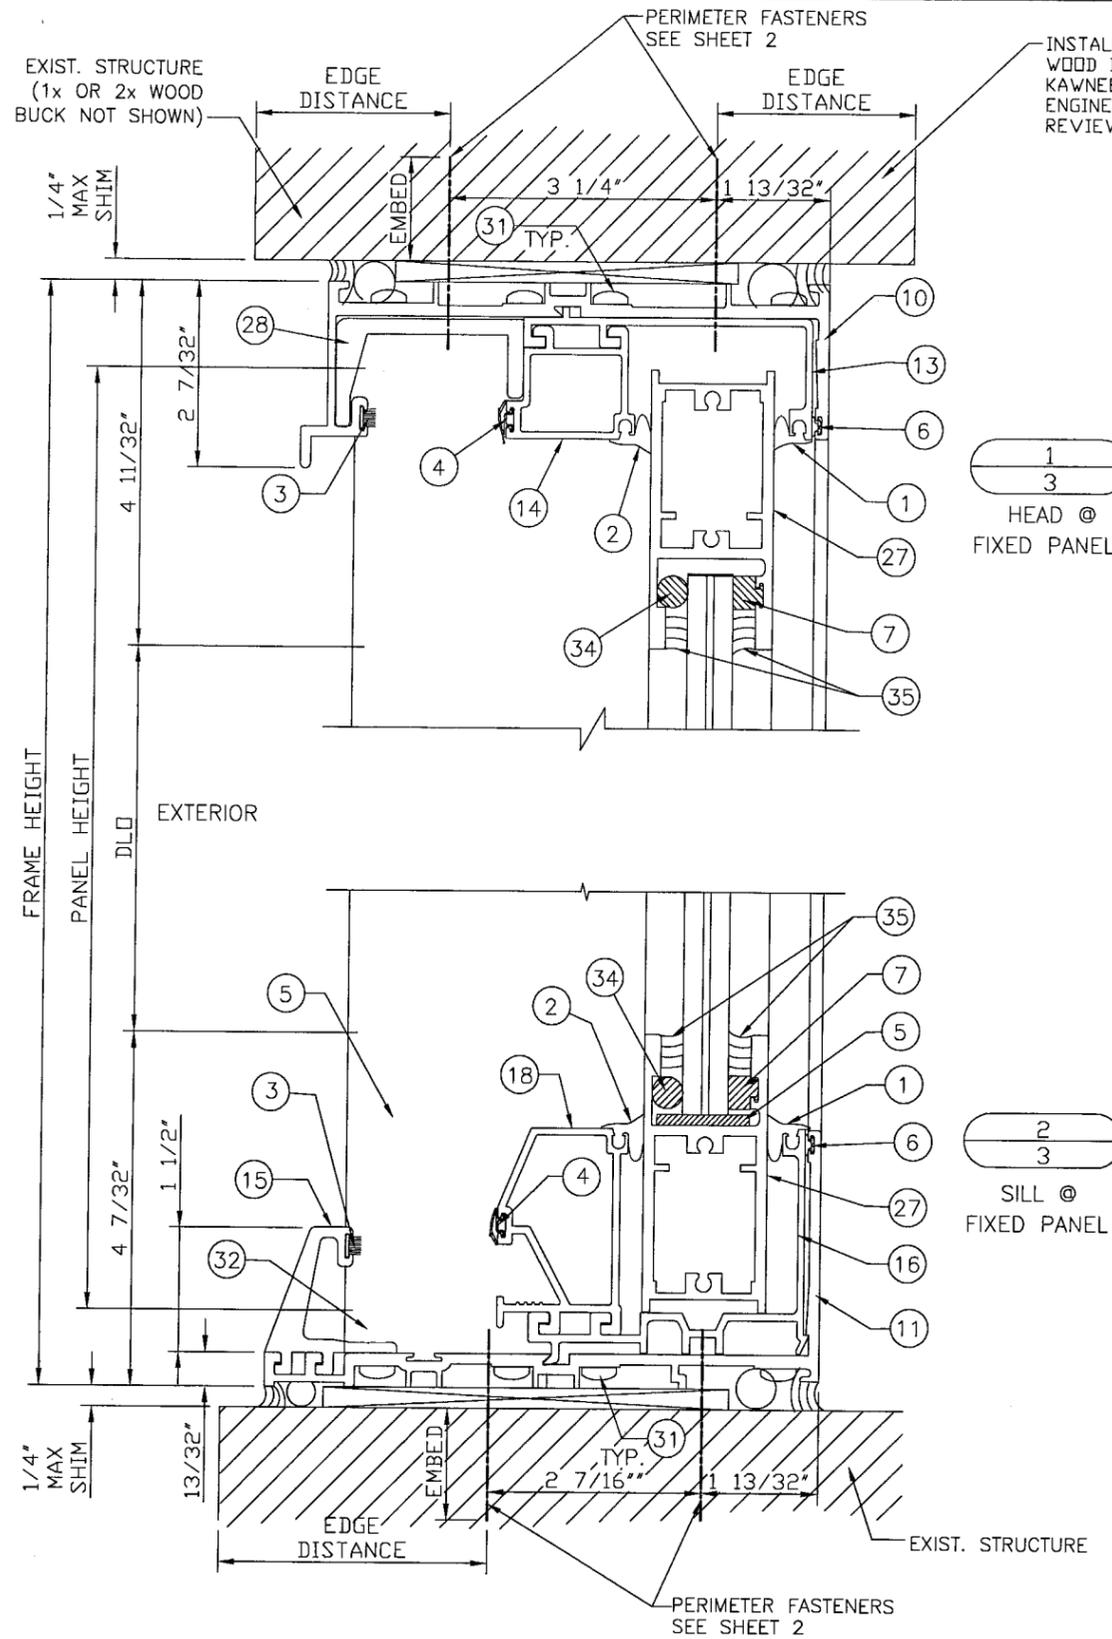

TYPICAL SECTION AT FIXED PANEL

REFER TO GLAZING DETAIL ON SHEET 6 OF 7 FOR SPECIFIC INFORMATION REGARDING GLAZING MATERIALS AND GLASS BITE

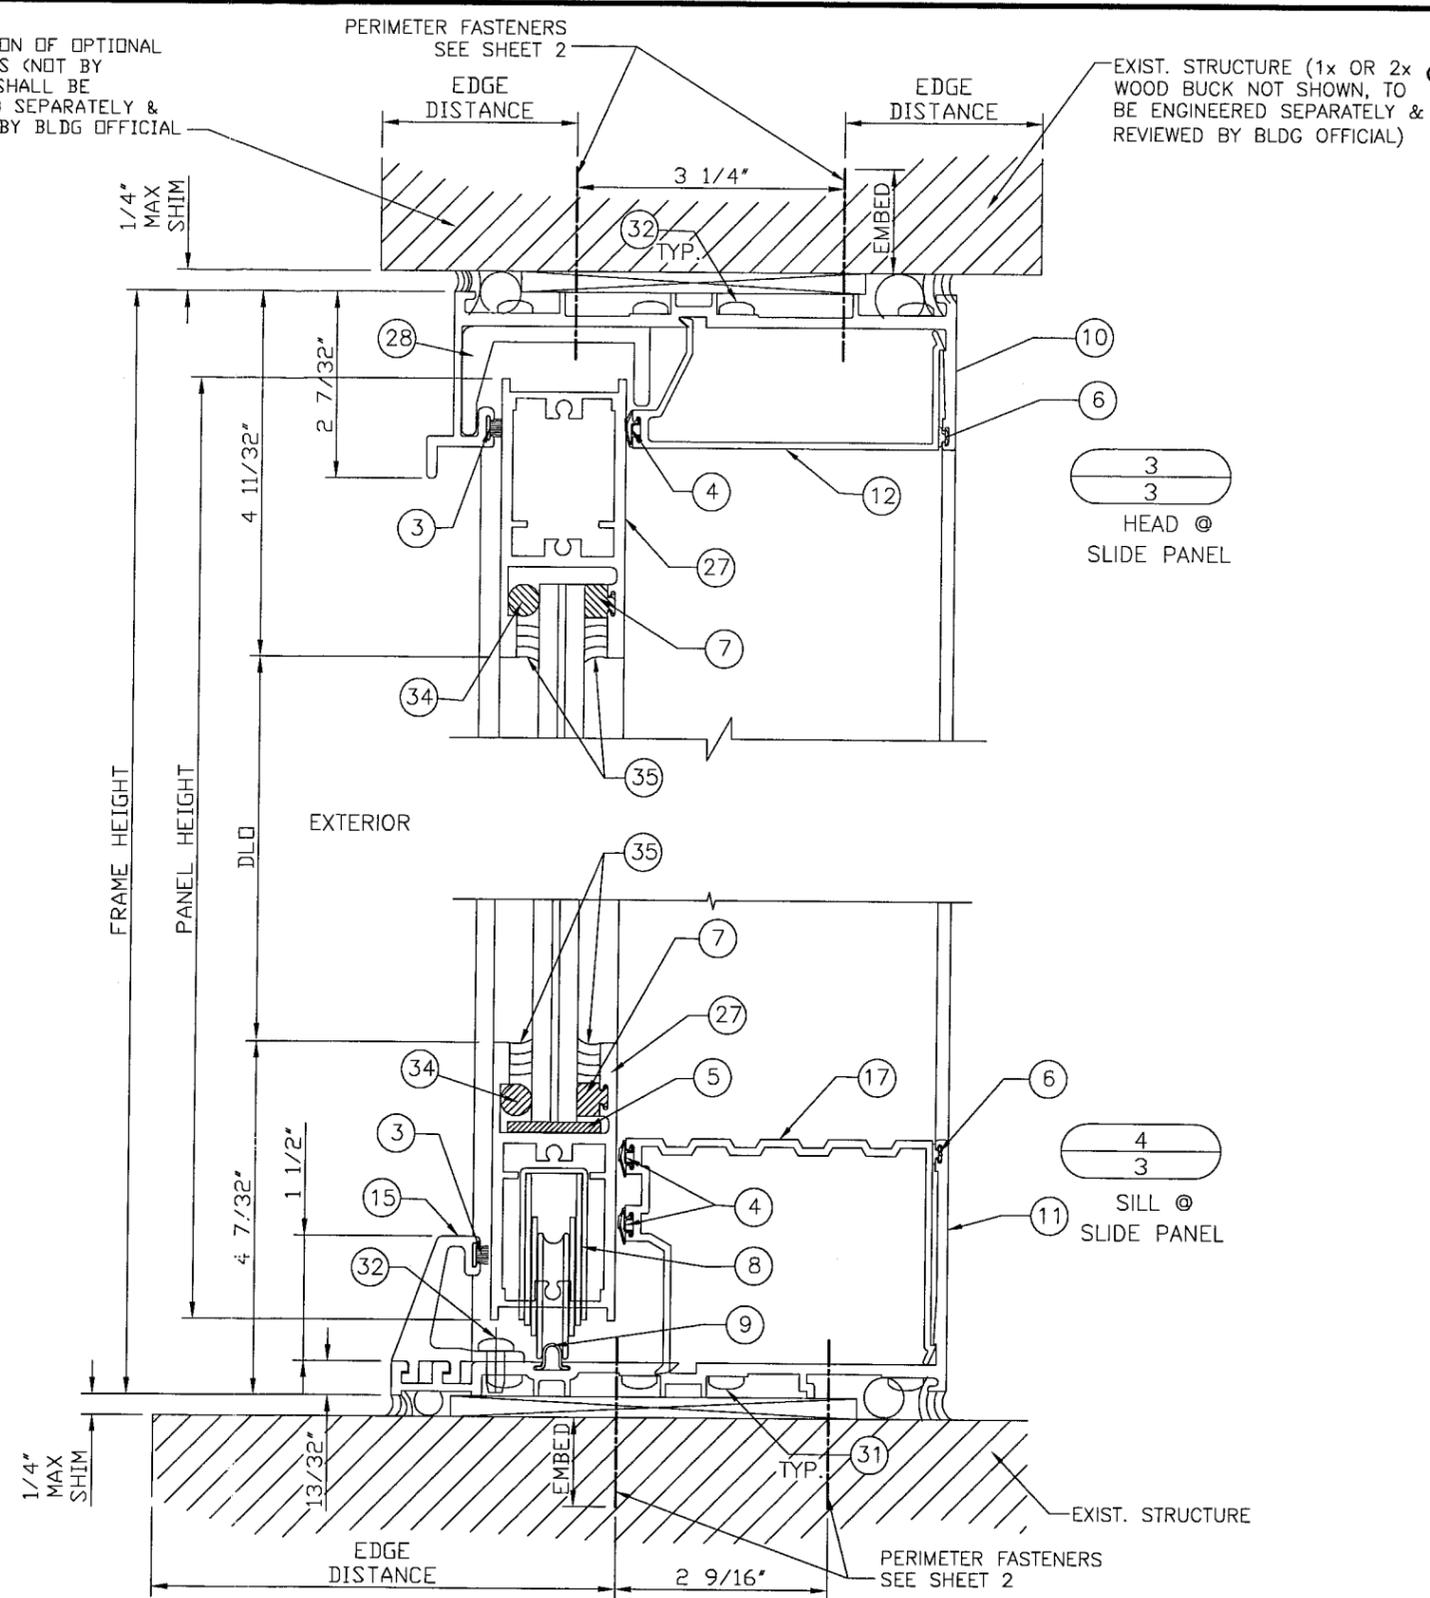

TYPICAL SECTION AT SLIDE PANEL

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No **10-0202.02**
 Expiration Date **02/24/2015**
 By *[Signature]*
 Miami Dade Product Control Division

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No **09-0121.05**
 Expiration Date **FEB 24 2010**
 By *Chag I. Chanda*
 Miami Dade Product Control Division

FRANK L. BENNARDO, P.E.
 # PE0046549

01/13/2009

ENGINEERING EXPRESS

160 SW 12th AVENUE, # 106
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0443
 WWW.ENGEXP.COM
 CERT OF AUTH #9885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

KAWNEER
 AN ALCOA COMPANY

555 GUTHRIDGE COURT
 NORCROSS, GEORGIA 30092
 PHONE: (770) 449-5555
 FAX: (770) 734-1560

HPX - SLIDING GLASS DOOR
 9/16" LAMINATED GLASS - LARGE MISSILE IMPACT
 PROTOCOLS-TAS 201/202/203 ASTM E1886/1996, SSTD 12-99

REMARKS	DRWN	CHKD	DATE
2004 FBC	CL	CL	06/14/05
2007 FBC	AML	CL	12/17/08

03-KAW-0938

SCALE: **1/2"**

PAGE DESCRIPTION:

7

3

01/13/2009


ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE: (770) 449-5555
FAX: (770) 734-1560
KAWNEER
AN ALCOA COMPANY
HPX - SLIDING GLASS DOOR
9/16" LAMINATED GLASS - LARGE MISSILE IMPACT
PROTOCOLS-TAS 201/202/203 ASTM E1886/1996, SSTD 12-99

REMARKS	DRWN	CHKD	DATE
2004 FBC	CL	CL	06/14/05
2007 FBC	AML	CL	12/17/08


03-KAW-0938
SCALE: 02
PAGE DESCRIPTION:

4

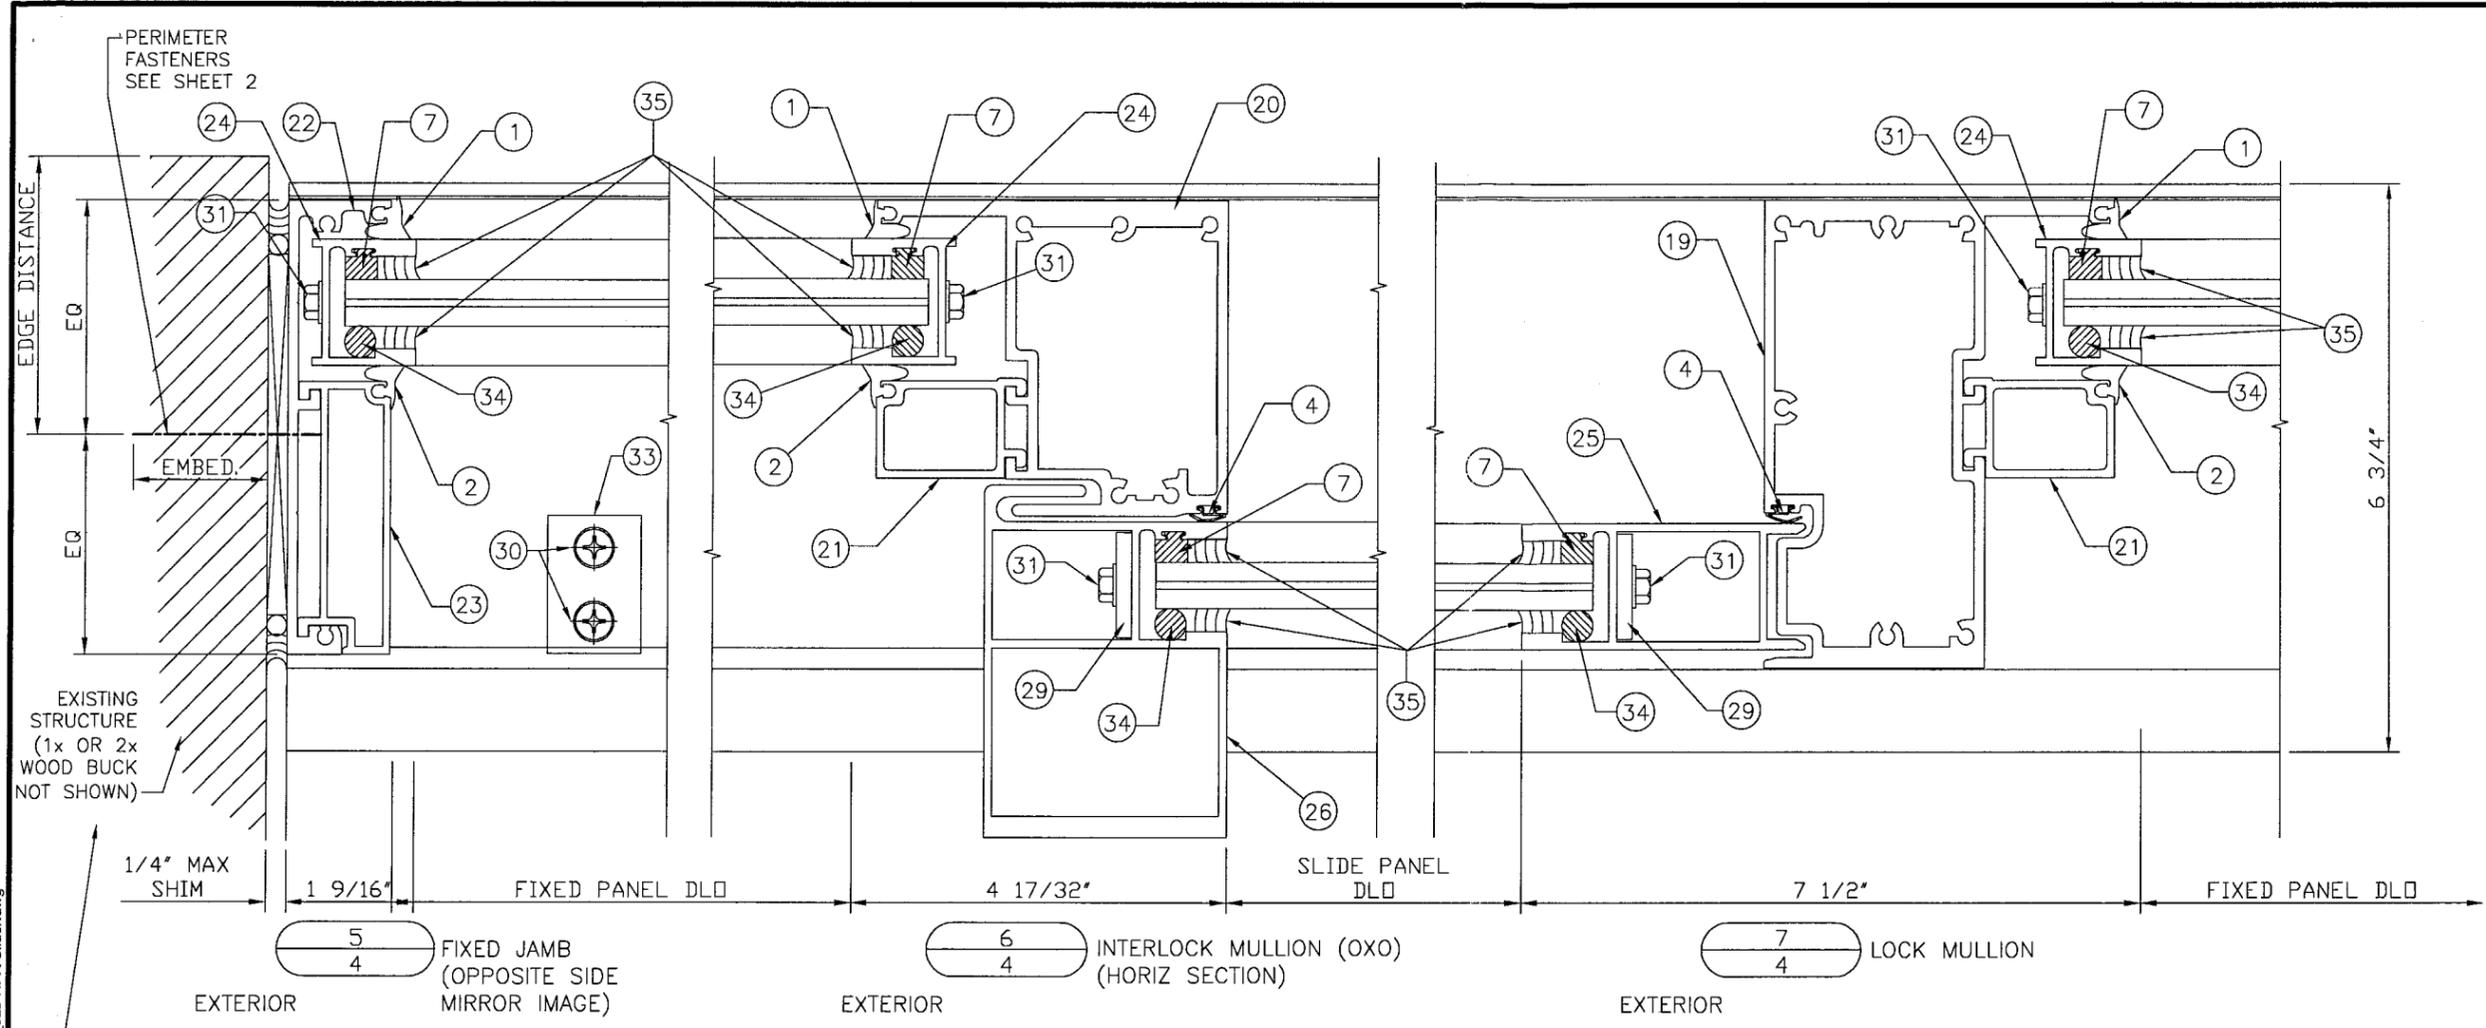

INSTALLATION OF OPTIONAL WOOD BUCKS (NOT BY KAWNEER) SHALL BE ENGINEERED SEPARATELY & REVIEWED BY BLDG OFFICIAL

REFER TO GLAZING DETAIL ON SHEET 6 OF 7 FOR SPECIFIC INFORMATION REGARDING GLAZING MATERIALS AND GLASS BITE

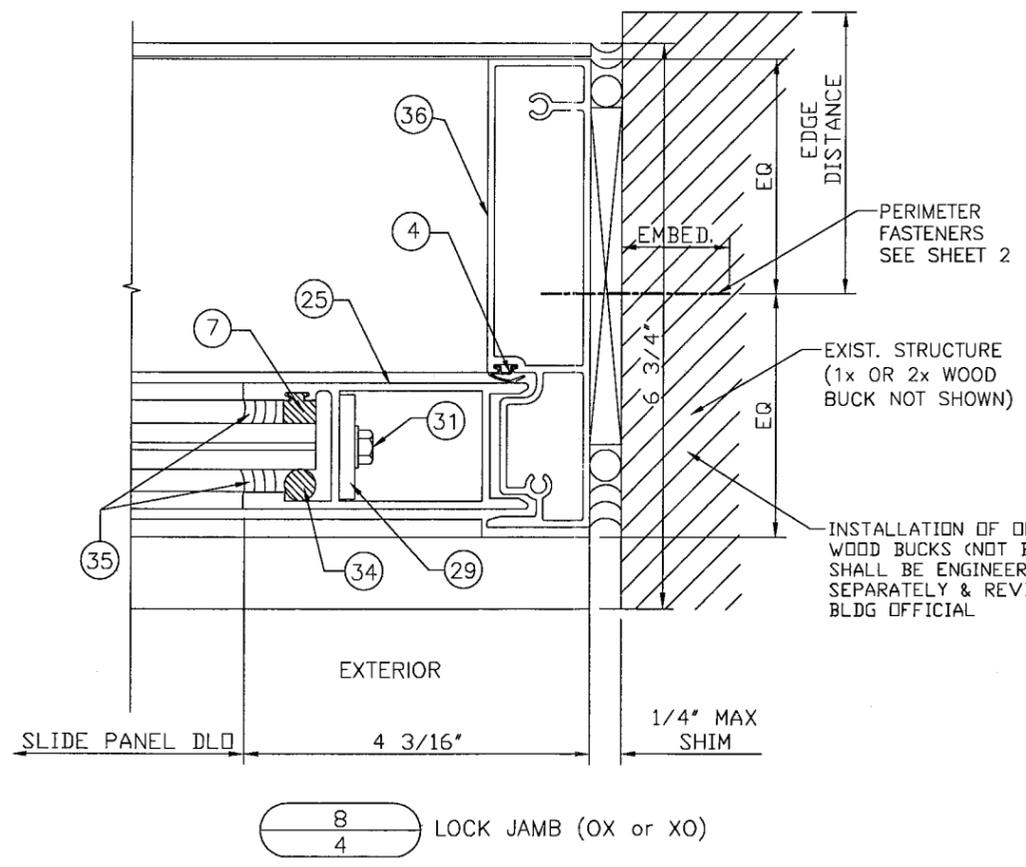


PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 09-0121-05
Expiration Date FEB 24, 2010
By Isaac L. Chanda
Miami Dade Product Control Division


PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 10-0202-02
Expiration Date 02/24/2015
By [Signature]
Miami Dade Product Control Division

F:\01 Project Files\Kawneer (KAW)\2003 Jobs\03-0938-136 HPX Slider\03-0938-136_02b HPX Slider.dwg
01/13/2009 - 3:28pm
rbarlett


01/13/2009 - 3:28pm rbartlett F:\01 Project Files\Kawneer (KAW)\2003 Jobs\03-0938-136 HPX Slider\03-0938-136_02b HPX Slider.dwg

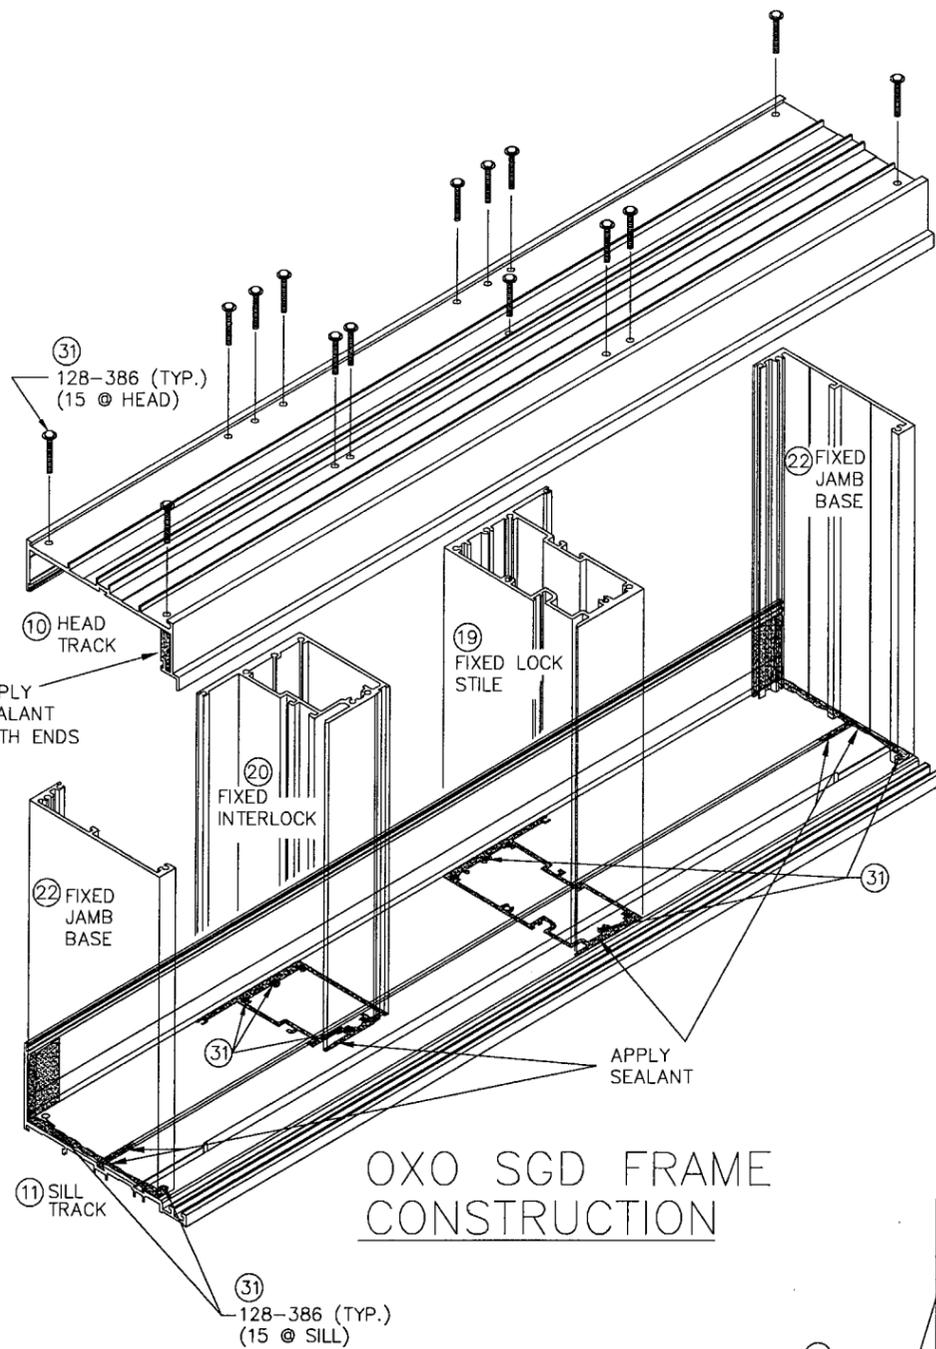


OXO SGD FRAME CONSTRUCTION

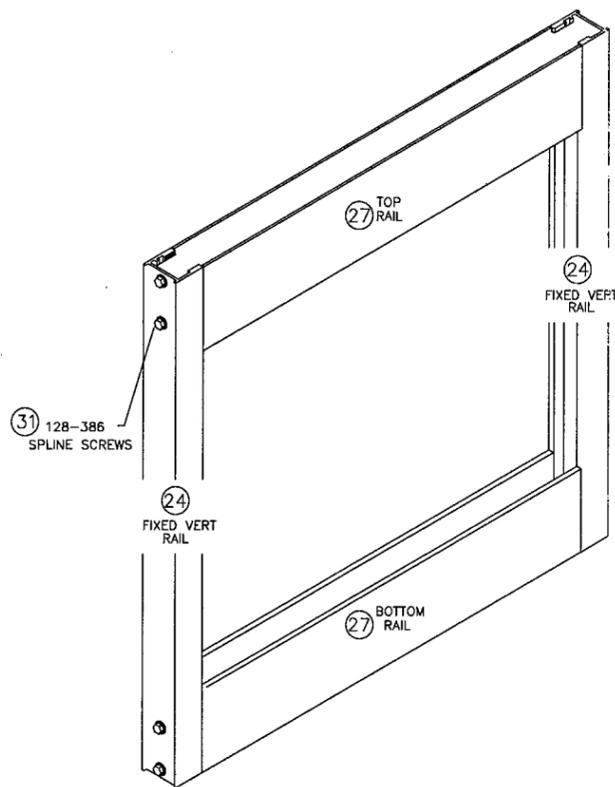

FIXED PANEL CONSTRUCTION

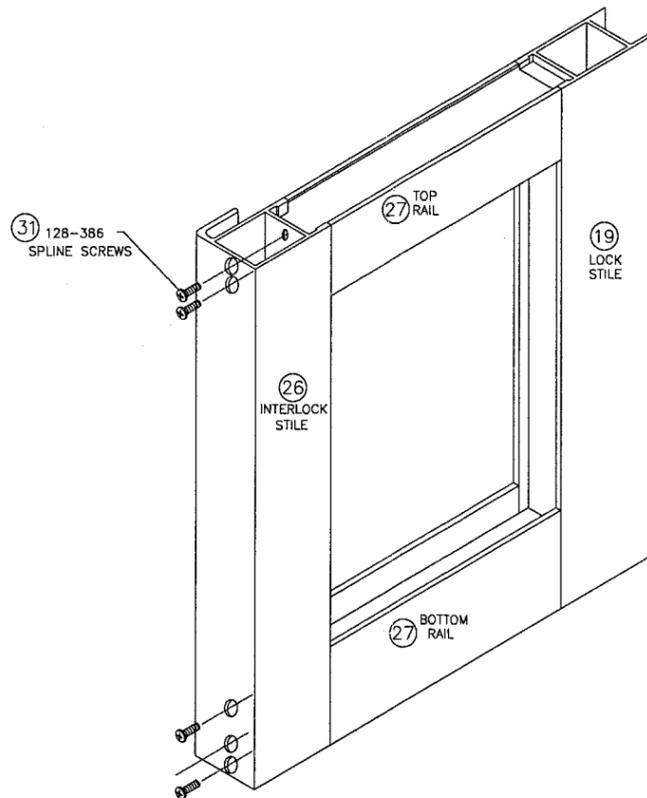

OPERABLE PANEL CONSTRUCTION

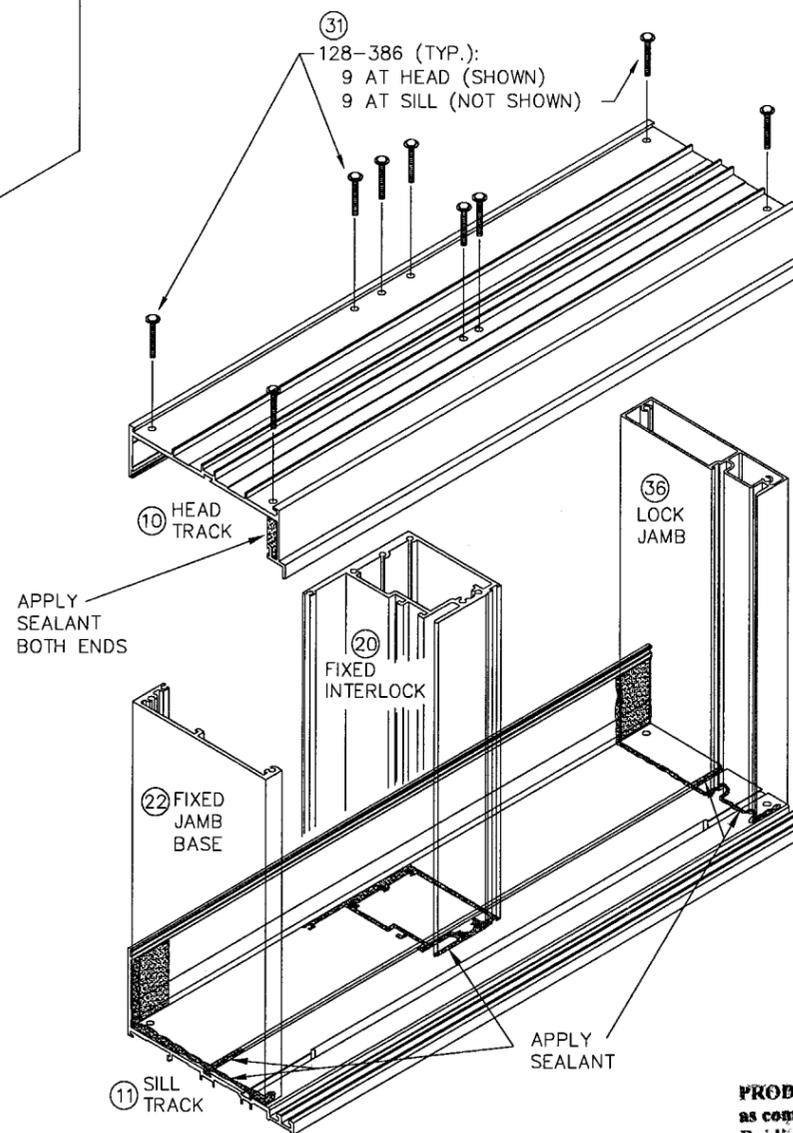

OX, XO SGD FRAME CONSTRUCTION

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 0-0202.02
 Expiration Date 02/24/2015
 By [Signature]
 Miami Dade Product Control
 Division

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 09-0121.05
 Expiration Date FEB 24, 2010
 By [Signature]
 Miami Dade Product Control
 Division

FRANK L. BENNARDO, P.E.
 # PE0046549

01/13/2009

ENGINEERING EXPRESS®
 160 SW 12th AVENUE, # 106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 FAX: (954) 354-0443
 WWW.ENGEXP.COM

CERT. OF AUTH. #8885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

555 GUTHRIDGE COURT
 NORCROSS, GEORGIA 30092
 PHONE: (770) 449-5555
 FAX: (770) 734-1560

KAWNEER
 AN ALCOA COMPANY

HPX - SLIDING GLASS DOOR
 9/16" LAMINATED GLASS - LARGE MISSILE IMPACT
 PROTOCOLS-TAS 201/202/203 ASTM E1886/1996, SSTD 12-99

DRWN	CHKD	DATE
CL	CL	06/14/05
AML	CL	12/17/08


REMARKS
 2004 FBC
 2007 FBC

03-KAW-0938
 SCALE: 02
 PAGE DESCRIPTION:

MATERIAL PARTS LIST

NO.	PART NUMBER	DESCRIPTION	DIMENSIONS (in)	MATERIAL
1	027-074	FIXED GASKET	0.188 SPACE	EPDM 70 DUROMETER
2	027-077	FIXED GASKET	0.188 SPACE	EPDM 70 DUROMETER
3	027-088	PILE WEATHER-STRIP	0.230 SPACE	# PB 9322 POLY BOND
4	027-110	FIXED WEATHER-STRIP	0.125	G E GELOY/DUPONT HYTREL 40 DUROMETER
5	027-423	SETTING BLOCK	0.125 X 1.125 X 4.125	EPDM 90 DUROMETER
6	027-579	BULB WEATHER-STRIP	0.072 SPACE	--
7	127-001	SILICONE SPACER	0.300 X 0.25	TPV 65 DUROMETER
8	590-411	TANDEM CASTER ASSEMBLE	-	300 SERIES STAINLESS STEEL
9	925-393	SILL TRACK INSERT	0.312 X 0.385/0.405 X 0.031	300 SERIES STAINLESS STEEL
10	592-001	HEAD TRACK	2.219 X 6.406 X 0.125	6063-T6 EXTRUDED ALUMINUM
11	592-002	SILL TRACK	3.000 X 6.725 X 0.125	6063-T6 EXTRUDED ALUMINUM
12	592-005	HEAD TRACK CAP	1.563 X 3.718 X 0.078	6063-T6 EXTRUDED ALUMINUM
13	592-007	HEAD TRACK FILLER	1.438 X 3.519 X 0.090	6063-T6 EXTRUDED ALUMINUM
14	592-008	HEAD TRACK FILLER STOP	1.342 X 1.567 X 0.080	6063-T6 EXTRUDED ALUMINUM
15	592-009	SILL ANTI-BLOWOUT ADAPTOR	1.560 X 1.764 X 0.125	6063-T6 EXTRUDED ALUMINUM
16	592-011	SILL TRACK FILLER	2.688 X 3.125 X 0.090	6063-T6 EXTRUDED ALUMINUM
17	592-025	SILL TRACK CAP	2.672 X 3.718 X 0.094	6063-T6 EXTRUDED ALUMINUM
18	592-026	SILL TRACK STOP	2.383 X 1.575 X 0.090	6063-T6 EXTRUDED ALUMINUM
19	592-013	LOCK STILE	4.250 X 5.562 X 0.125	6063-T6 EXTRUDED ALUMINUM
20	592-016	FIXED INTERLOCK	4.250 X 3.750 X 0.125	6063-T6 EXTRUDED ALUMINUM
21	592-022	VERTICAL STOP	1.819 X 1.186 X 0.093	6063-T6 EXTRUDED ALUMINUM
22	592-023	FIXED JAMB BASE	1.250 X 5.398 X 0.125	6063-T6 EXTRUDED ALUMINUM
23	592-024	FIXED JAMB STOP	1.125 X 3.242 X 0.094	6063-T6 EXTRUDED ALUMINUM
24	592-012	FIXED PANEL VERTICAL RAIL	1.273 X 1.500 X 0.094	6063-T6 EXTRUDED ALUMINUM
25	592-014	SLIDE PANEL LOCK STILE	3.437 X 1.500 X 0.094	6063-T6 EXTRUDED ALUMINUM
26	592-017	SLIDE PANEL INTERLOCK STILE	2.937 X 4.188 X 0.094	6063-T6 EXTRUDED ALUMINUM
27	592-018	FIXED/SLIDE TOP AND BOTTOM RAIL	1.500 X 3.312 X 0.094	6063-T6 EXTRUDED ALUMINUM
28	592-405	HEAD TRACK REINFORCEMENT	2.265 X 1.293 X 0.188 X 6.000	6063-T6 EXTRUDED ALUMINUM
29	590-403	REINFORCEMENT PLATE FOR SLIDE PANEL	1.250 X 2.500 X 0.188	A36 STEEL
30	128-271	# 12 X 5/8" PHTFS	-	300 SERIES STAINLESS STEEL
31	128-386	# 12 X 2" HWH THREAD FORMING SCREW	-	300 SERIES STAINLESS STEEL
32	977-108	# 10 X 1/2" PHTFS	-	300 SERIES STAINLESS STEEL
33	911-347	PANEL BUMPER	1.125 X 1.125 X 1.641	EPT 70 DUROMETER
34	-	BACKER ROD	3/8" DIAMETER	CLOSED CELL
35	-	STRUCTURAL SILICONE	VARIES	DOW CORNING 995, TREMCO SPECTRUM 2, OR GE SILPRUF
36	591-009	LOCK JAMB (OX or XO)	1.250 X 5.562 X 0.094	6063-T6 EXTRUDED ALUMINUM

HPX SLIDING DOOR
IMPACT RESISTANT 9/16"
LAMINATED GLASS INFILL

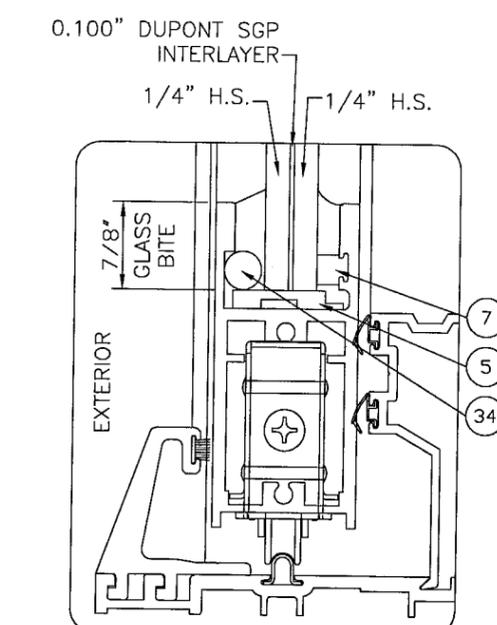

GLASS SIZE = DLD + 1 3/4"
UNLESS OTHERWISE NOTED.

TYP GLAZING DETAIL

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0121-05
Expiration Date FEB 24, 2010
By (Signature)
Miami Dade Product Control
Division

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 10-0202-02
Expiration Date 02/24/2015
By (Signature)
Miami Dade Product Control
Division

FRANK L. BENNARDO, P.E.
PE0046549

01/13/2009

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION




















KAWNEER
AN ALCOA COMPANY
555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE: (770) 449-5555
FAX: (770) 734-1560
HPX - SLIDING GLASS DOOR
9/16" LAMINATED GLASS - LARGE MISSILE IMPACT
PROTOCOLS-TAS 201/202/203 ASTM E1886/1996, SSTD 12-99

REMARKS	DRWN	CHKD	DATE
2004 FBC	CL	CL	06/14/05
2007 FBC	AVL	CL	12/17/08

03-KAW-0938
SCALE: 02
PAGE DESCRIPTION:

7
6

01/13/2009 - 3:29pm rbarlett F:\01 Project Files\Kawneer (KAW)\2003 Jobs\03-0938-136 HPX Sliders\03-0938-136_02b HPX Slider.dwg

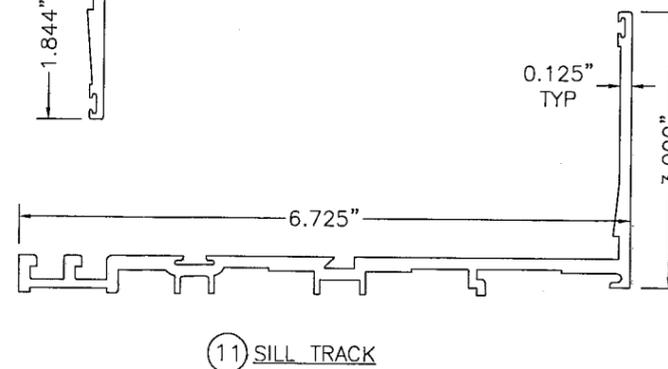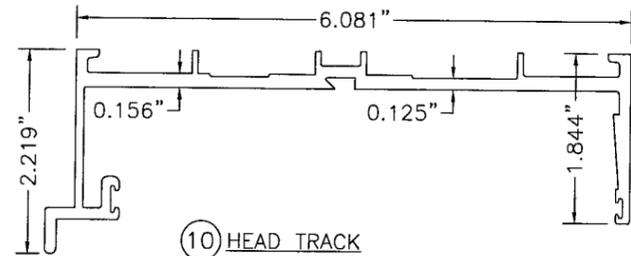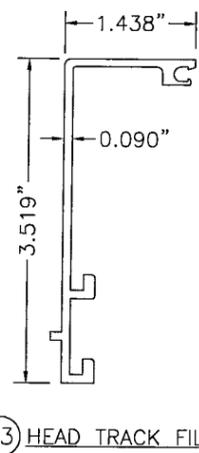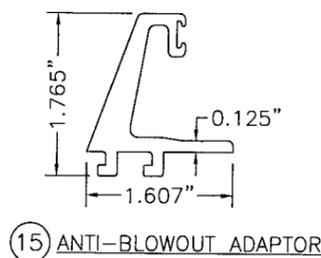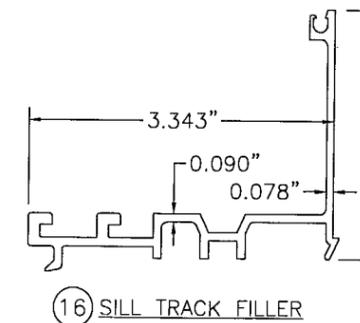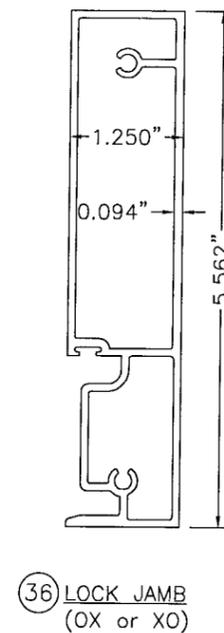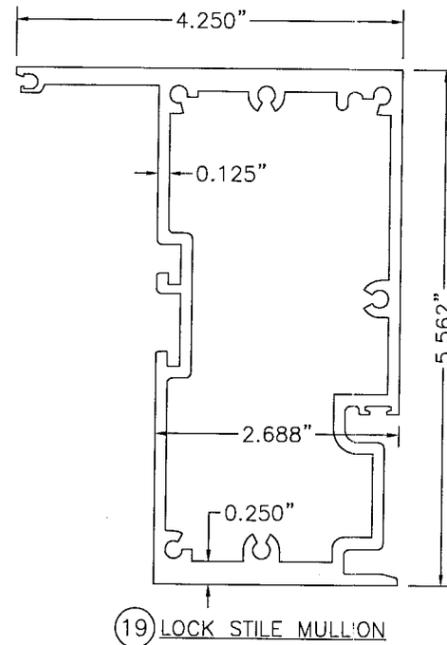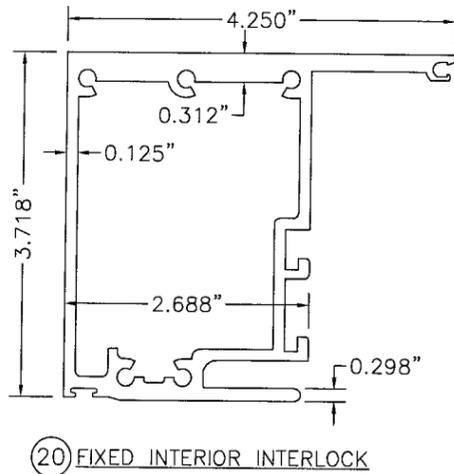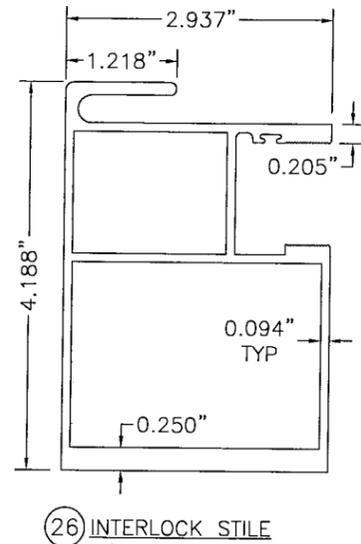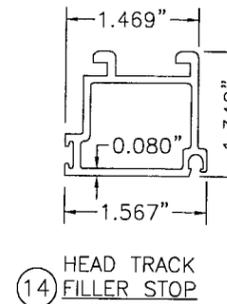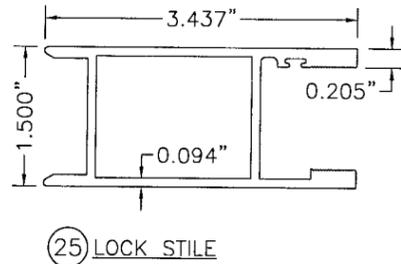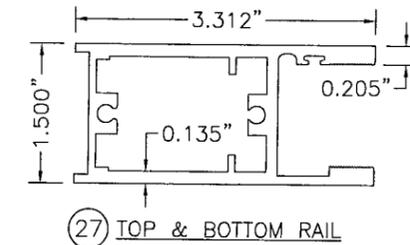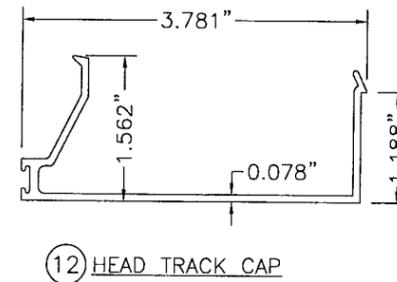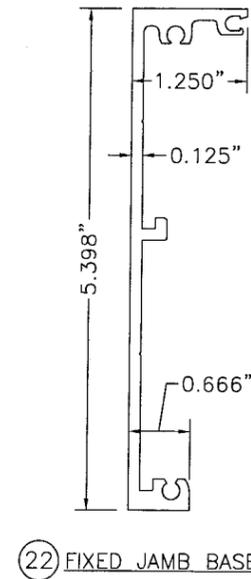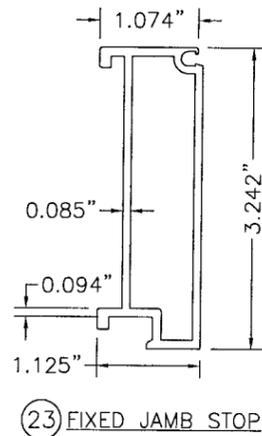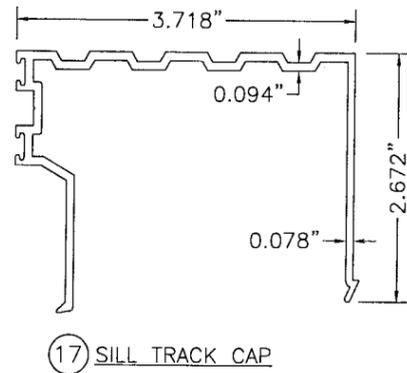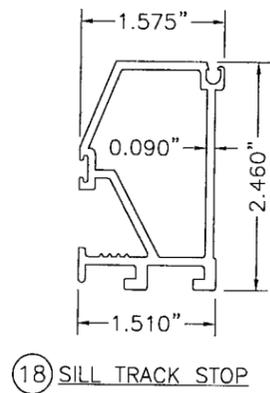

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No 10-0202.02 Expiration Date 02/24/2015 By [Signature] Miami Dade Product Control Division

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 02-0121-05 Expiration Date FEB 24, 2010 By [Signature] Miami Dade Product Control Division

FRANK L. BENNARDO, P.E. # PE0046549
01/13/2009
ENGINEERING EXPRESS
160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE: (770) 449-5555
FAX: (770) 734-1560
KAWNEER AN ALCOA COMPANY
HPX - SLIDING GLASS DOOR
9/16" LAMINATED GLASS - LARGE MISSILE IMPACT
PROTOCOLS-TAS 201/202/203 ASTM E1886/1996, SSTD 12-99

DRWN	CHKD	DATE
CL	CL	06/14/05
AML	CL	12/17/08

REMARKS
2004 FBC
2007 FBC

03-KAW-0938
SCALE: 1/2"
PAGE DESCRIPTION:
7